



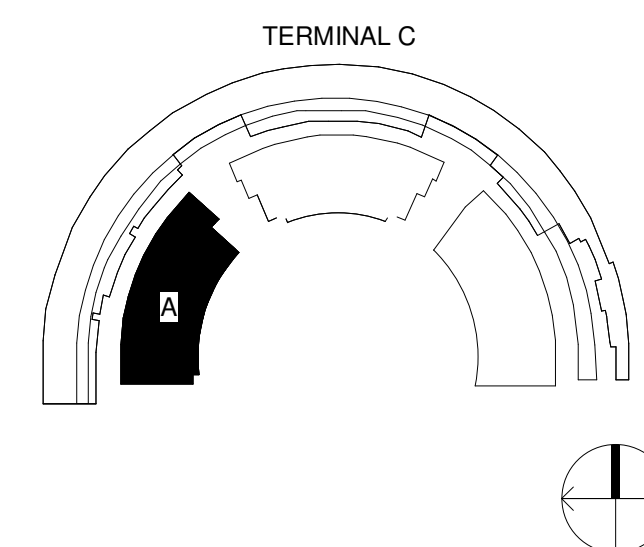


DFW AIRPORT

DFW TERMINAL C GARAGE AND ROADWAYS

PHASE 3

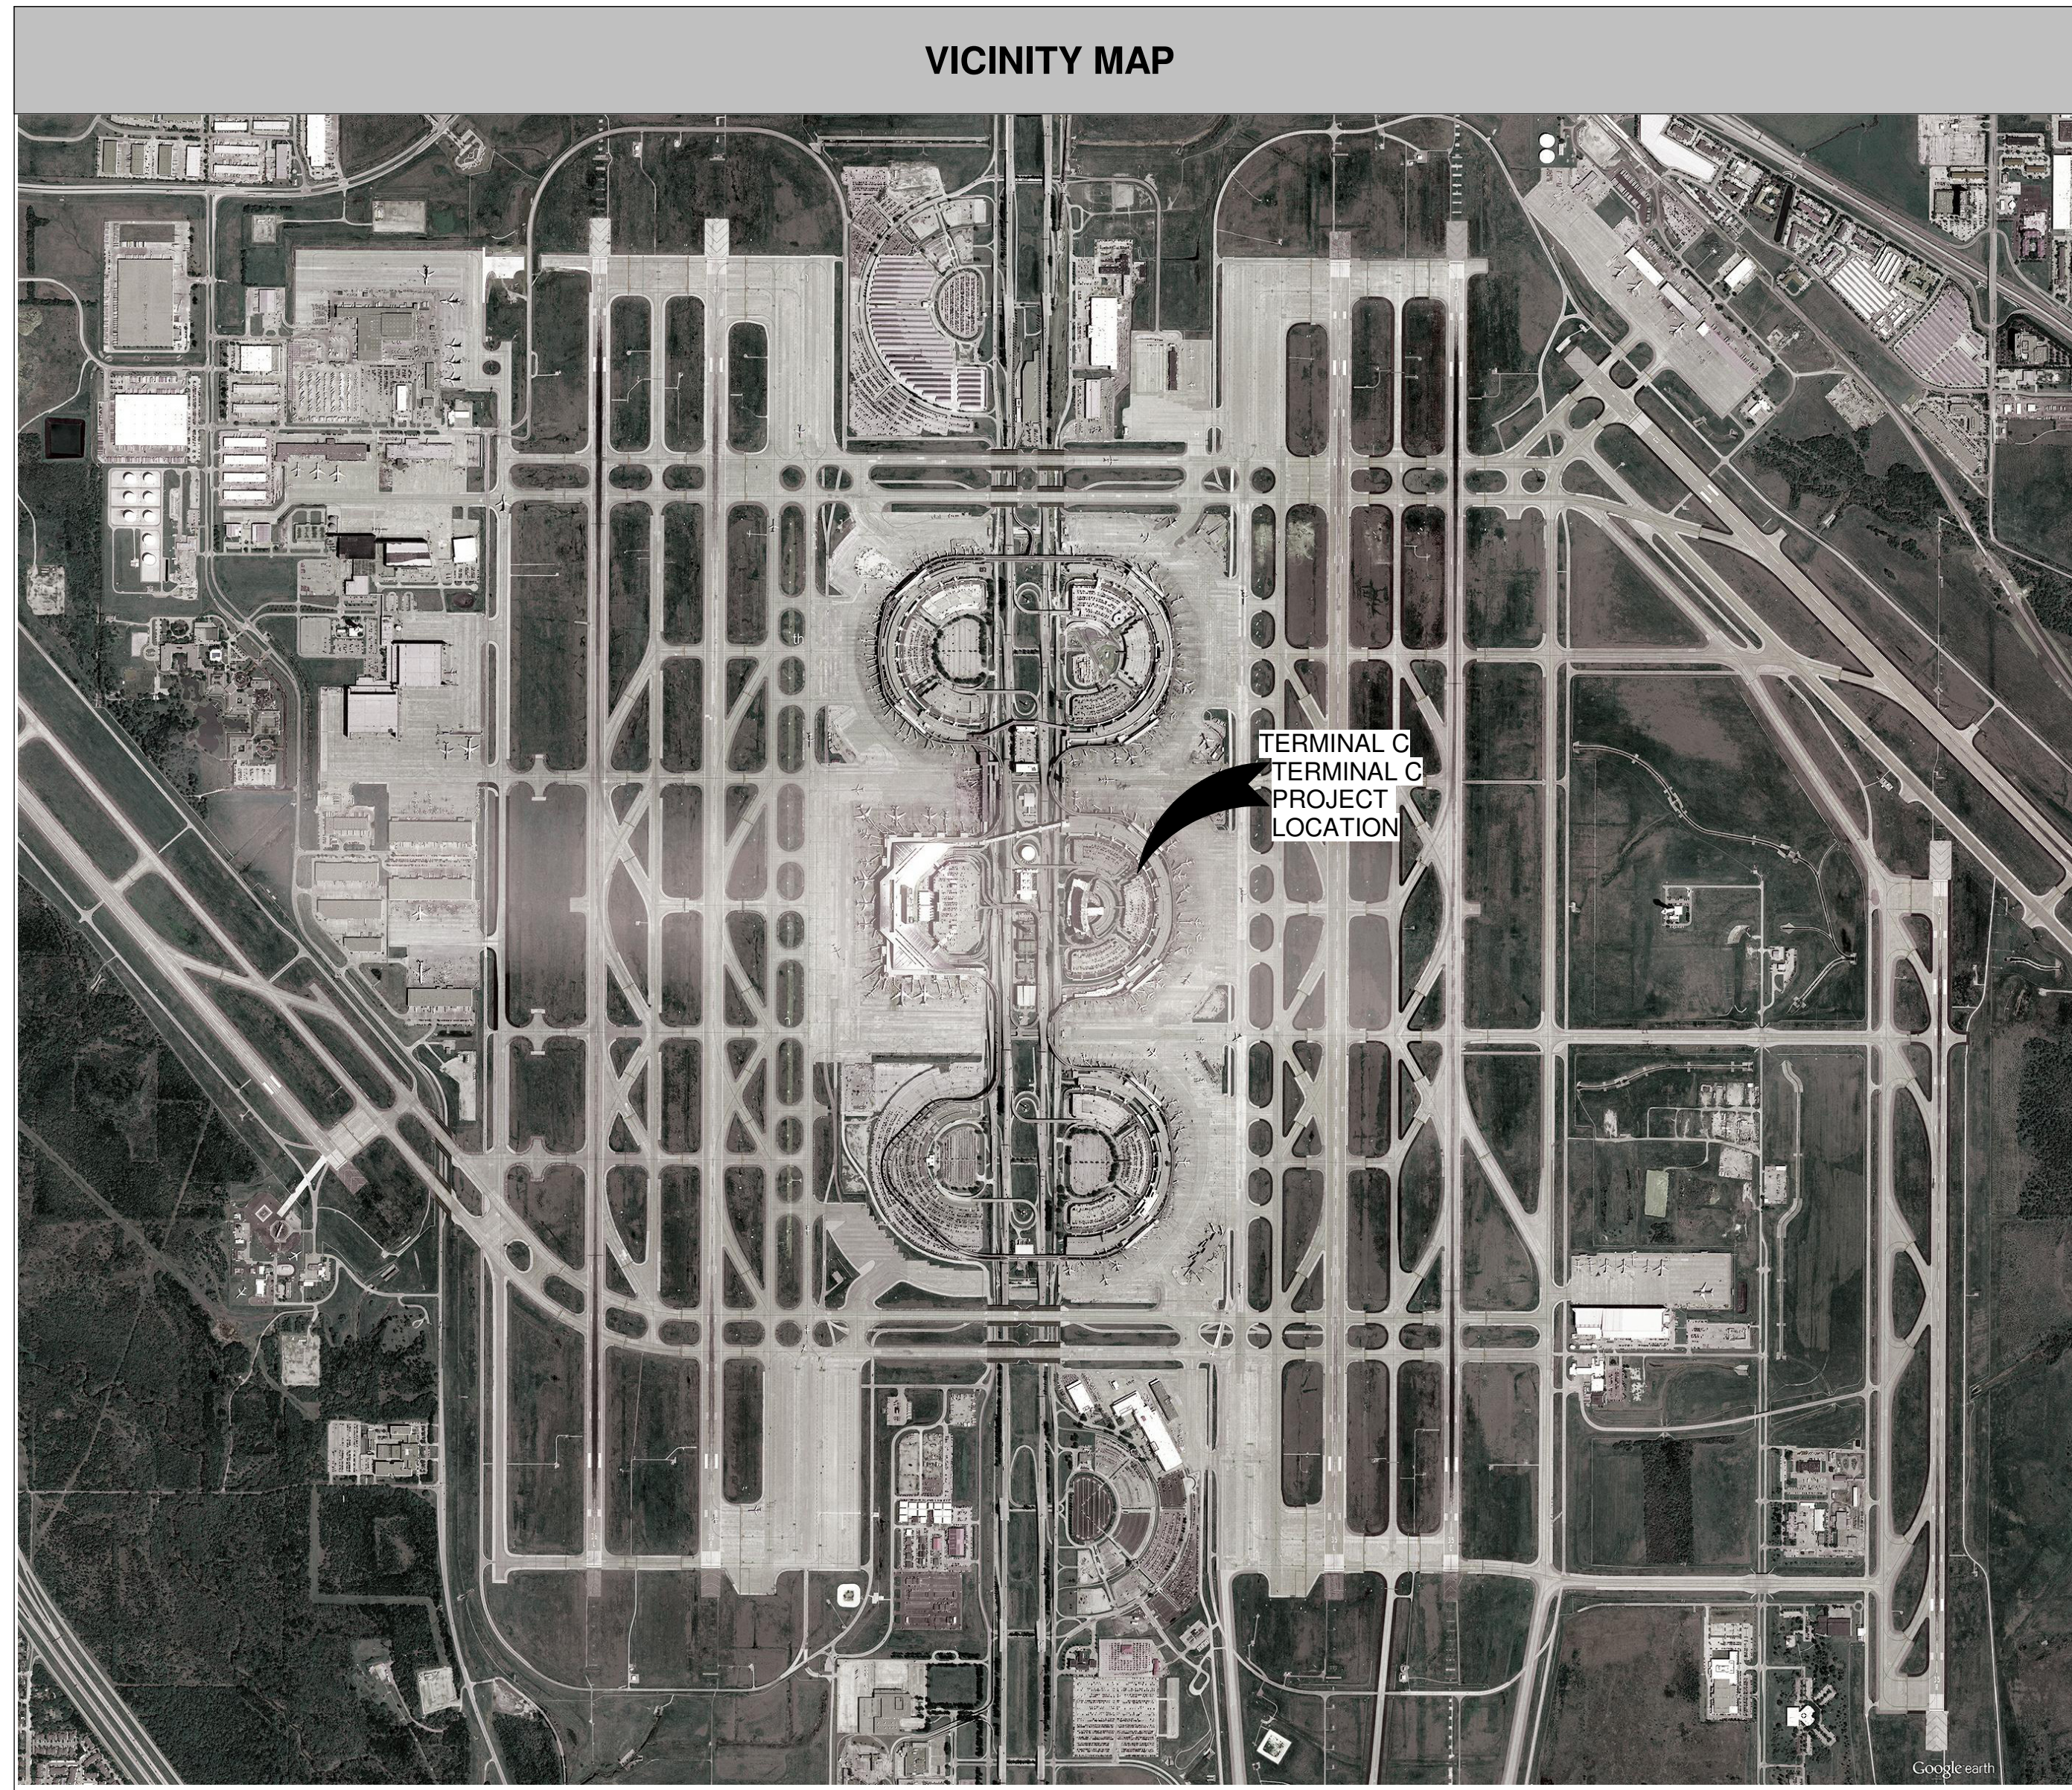

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

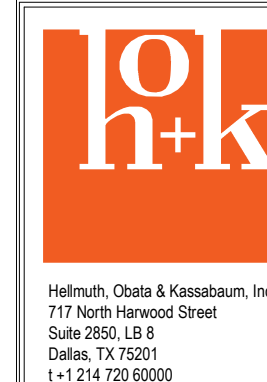

Hobas, Clark & Koenigsmann, Inc.
717 North Memorial Street
Dallas, TX 75201
1-214-722-6000

DRAWN BY: RB
APPROVED BY: DM
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2022-01-08	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS
COVER SHEET - PHASE 3

PERMIT NUMBER: B22-0022


SHEET NUMBER
GI003-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

SHEET INDEX - PHASE 3		Terminal C Garage C	Terminal C Garage B	Terminal C Garage A	Terminal C Roadway
SHEET NUMBER	SHEET NAME	A21-188B - Terminal C Garage C	B22-0021 - Terminal C Garage B	B22-0025 - Terminal C Garage A	B22-0025 - Terminal C Roadway
00 - GENERAL					
GI003-900A	COVER SHEET - PHASE 3				•
GI013-900A	SHEET INDEX - PHASE 3				•
00 - GENERAL: 2					
D 05 - CIVIL					
E-001-900R	ELECTRICAL ABBREVIATIONS AND SYMBOLS	•	•	•	•
E-002-900R	ELECTRICAL GENERAL NOTES	•	•	•	•
ES105-900R	LIGHTING DEMOLITION - UPPER ROADWAY, NORTH	•	•	•	•
ES103-900R	ELECTRICAL NEW WORK - LOWER ROADWAY, NORTH	•	•	•	•
ES105-900R	LIGHTING NEW WORK - LOWER ROADWAY, NORTH	•	•	•	•
ES107-900R	LIGHTING NEW WORK - UPPER ROADWAY, NORTH	•	•	•	•
ES603-900R	ELECTRICAL LIGHTING RISERS	•	•	•	•
ES604-900R	ELECTRICAL SCHEDULES	•	•	•	•
ES605-900R	ELECTRICAL SCHEDULES	•	•	•	•
05 - CIVIL: 9					
07 - STRUCTURAL					
S-001-900A	GENERAL NOTES - GARAGE A				•
S-002-900A	GENERAL NOTES - GARAGE A				•
S-003-900A	GENERAL NOTES - GARAGE A				•
S-100-900A	GARAGE A OVERALL 3D VIEW & PLAN				•
S-101-900A	GARAGE A LEVEL A FRAMING PLAN - NORTH				•
S-102-900A	GARAGE A LEVEL A FRAMING PLAN - SOUTH				•
S-103-900A	GARAGE A LEVEL B FRAMING PLAN - NORTH				•
S-104-900A	GARAGE A LEVEL B FRAMING PLAN - SOUTH				•
S-105-900A	GARAGE A LEVEL C FRAMING PLAN - NORTH				•
S-106-900A	GARAGE A LEVEL C FRAMING PLAN - SOUTH				•
S-107-900A	GARAGE A LEVEL D FRAMING PLAN - NORTH				•
S-108-900A	GARAGE A LEVEL D FRAMING PLAN - SOUTH				•
S-109-900A	GARAGE A LEVEL E FRAMING PLAN - NORTH				•
S-110-900A	GARAGE A LEVEL E FRAMING PLAN - SOUTH				•
S-111-900A	GARAGE A CANOPY FRAMING PLAN SOUTH				•
S-501-900A	PIER & GRADE BEAM SCHEDULE AND TYP FOUNDATION DETAILS				•
S-502-900A	TYPICAL FOUNDATION DETAILS				•
S-503-900A	MISC. TYPICAL FOUNDATION SECTIONS AND DETAILS				•
S-511-900A	TYPICAL CMU DETAILS AND SCHEDULES				•
S-521-900A	NEW CONCRETE AT EXISTING CONCRETE DETAILS				•
S-531-900A	TYPICAL STEEL DETAILS				•
07 - STRUCTURAL: 21					
C 08 - ARCHITECTURE					
AD101-900A	GARAGE A DEMO PLAN - LEVEL A				•
AD102-900A	GARAGE A DEMO PLAN - LEVEL B				•
AD103-900A	GARAGE A DEMO PLAN - LEVEL C				•
AD104-900A	GARAGE A DEMO PLAN - LEVEL D				•
AD105-900A	GARAGE A DEMO PLAN - LEVEL E				•
AE101-900A	FLOOR PLAN - LEVEL A - OVERALL				•
AE102-900A	FLOOR PLAN - LEVEL B - OVERALL				•
AE103-900A	FLOOR PLAN - LEVEL C - OVERALL				•
AE104-900A	FLOOR PLAN - LEVEL D - OVERALL				•
AE105-900A	FLOOR PLAN - LEVEL E - OVERALL				•
AE106-900A	ROOF PLAN - OVERALL				•
AE141-900A	PARKING PLAN - LEVEL A				•
AE142-900A	PARKING PLAN - LEVEL B				•
AE143-900A	PARKING PLAN - LEVEL C				•
AE144-900A	PARKING PLAN - LEVEL D				•
AE145-900A	PARKING PLAN - LEVEL E				•
AE203-900A	PARTIAL EXTERIOR ELEVATION				•
AE401-900A	ENLARGED ELEVATOR LOBBY PLANS - LEVELS A & C				•
AE402-900A	ENLARGED ELEVATOR LOBBY PLANS - LEVELS B & D				•
AE403-900A	ENLARGED ELEVATOR LOBBY PLANS - LEVEL E				•
AE404-900A	ENLARGED STAIR PLANS				•
AE408-900A	ENLARGED STAIR PLANS-LEVEL E				•
AE409-900A	ENLARGED ROOF PLANS - GARAGE A				•
AE110-900A	ENLARGED TYPICAL ELECTRICAL ROOM LAYOUT				•
AE501-900A	DOOR SCHEDULE				•
GI101-900A	LIFE SAFETY PLAN - LEVEL A				•
GI102-900A	LIFE SAFETY PLAN - LEVEL B				•
GI103-900A	LIFE SAFETY PLAN - LEVEL C				•
GI104-900A	LIFE SAFETY PLAN - LEVEL D				•
GI105-900A	LIFE SAFETY PLAN - LEVEL E				•
08 - ARCHITECTURE: 30					
B 08.1 - ARCH WAYFINDING					
AG100-900A	ARCH WAYFINDING GARAGE COMPOSITE PLAN	•	•	•	•
AG101-900A	ARCH WAYFINDING GARAGE A PLAN - LEVEL A				•
AG102-900A	ARCH WAYFINDING GARAGE A PLAN - LEVEL B				•
AG103-900A	ARCH WAYFINDING GARAGE A PLAN - LEVEL C				•
AG104-900A	ARCH WAYFINDING GARAGE A PLAN - LEVEL D				•
AG105-900A	ARCH WAYFINDING GARAGE A PLAN - LEVEL E				•
AG201-900A	ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL A				•
AG202-900A	ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL B				•
AG203-900A	ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL C				•
AG204-900A	ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL D				•
AG501-900	SIGNAGE DETAIL	•	•	•	•
AG502-900	SIGNAGE DETAIL	•	•	•	•
AG503-900	SIGNAGE DETAIL	•	•	•	•
AG504-900	SIGNAGE DETAIL	•	•	•	•
AG505-900	SIGNAGE DETAIL	•	•	•	•
AG506-900	SIGNAGE DETAIL	•	•	•	•
AG507-900	SIGNAGE DETAIL	•	•	•	•
AG508-900	SIGNAGE DETAIL	•	•	•	•
AG509-900	SIGNAGE DETAIL	•	•	•	•
AG510-900	SIGNAGE DETAIL	•	•	•	•
AG601-900A	GARAGE A SIGNAGE SCHEDULE - LEVEL A				•
AG602-900A	GARAGE A SIGNAGE SCHEDULE - LEVEL B				•
AG603-900A	GARAGE A SIGNAGE SCHEDULE - LEVEL C				•
AG604-900A	GARAGE A SIGNAGE SCHEDULE - LEVEL D				•
AG605-900A	GARAGE A SIGNAGE SCHEDULE - LEVEL E				•
AG610-900A	GARAGE A COLUMN SIGN SCHEDULE				•
08.1 - ARCH WAYFINDING: 26					
11 - FIRE PROTECTION					
F-001-900A	FIRE PROTECTION COVER SHEET				•
F-002-900A	FIRE PROTECTION SCHEDULES				•
F-201-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL A - PHASE 3				•
F-202-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL B - PHASE 3				•
F-203-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL C - PHASE 3				•
F-204-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL D - PHASE 3				•
F-205-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL E - PHASE 3				•
F-401-900A	FIRE PROTECTION ENLARGED PLAN				•
F-501-900A	FIRE PROTECTION DETAILS				•
11 - FIRE PROTECTION: 9					
A 12 - PLUMBING					
P-001-900A	PLUMBING COVER SHEET				•
P-002-900A	SCHEDULES				•
P-101-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL A - PHASE 3				•
P-102-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL B - PHASE 3				•
P-103-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL C - PHASE 3				•
P-104-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL D - PHASE 3				•
P-105-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL E - PHASE 3				•
P-201-900A	GARAGE A PLUMBING PLAN - LEVEL A - PHASE 3				•
P-202-900A	GARAGE A PLUMBING PLAN - LEVEL B - PHASE 3				•
P-203-900A	GARAGE A PLUMBING PLAN - LEVEL C - PHASE 3				•
P-204-900A	GARAGE A PLUMBING PLAN - LEVEL D - PHASE 3				•
P-205-900A	GARAGE A PLUMBING PLAN - LEVEL E - PHASE 3				•
P-501-900A	DETAILS				•
12 - PLUMBING: 13					

SHEET INDEX - PHASE 3		Terminal C Garage C	Terminal C Garage B	Terminal C Garage A	Terminal C Roadway
SHEET NUMBER	SHEET NAME	A21-188B - Terminal C Garage C	B22-0021 - Terminal C Garage B	B22-0025 - Terminal C Garage A	B22-0025 - Terminal C Roadway
14 - MECHANICAL					
M-001-900A	MECHANICAL COVER SHEET				•
M-002-900A	SCHEDULES				•
M-101-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL A - PHASE 3				•
M-102-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL B - PHASE 3				•
M-103-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL C - PHASE 3				•
M-104-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL D - PHASE 3				•
M-105-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL E - PHASE 3				•
M-201-900A	GARAGE A HVAC PLAN - LEVEL A - PHASE 3				•
M-202-900A	GARAGE A HVAC PLAN - LEVEL B - PHASE 3				•
M-203-900A	GARAGE A HVAC PLAN - LEVEL C - PHASE 3				•
M-204-900A	GARAGE A HVAC PLAN - LEVEL D - PHASE 3				•
M-205-900A	GARAGE A HVAC PLAN - LEVEL E - PHASE 3				•
M-501-900A	DETAILS				•
X-205-900A	GARAGE A VERTICAL TRANSPORTATION PLAN - LEVEL E - PHASE 3				•
X-502-900A	ELEVATOR A1 & A2 PLANS & SECTION				•
14 - MECHANICAL: 15					
15 - ELECTRICAL					
E-001-900A	ELECTRICAL COVER SHEET				•
E-002-900A	SINGLE LINE DIAGRAM				•
E-402-900A	ENLARGED ELECTRICAL PLANS				•
E-501-900A	DETAILS				•
E-502-900A	DETAILS				•
E-601-900A	SCHEDULES				•
E-603-900A	SCHEDULES				•
E-604-900A	SCHEDULES				•
EL101-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL A - PHASE 3				•
EL102-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL B - PHASE 3				•
EL103-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL C - PHASE 3				•
EL104-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL D - PHASE 3				•
EL105-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL E - PHASE 3				•
EL201-900A	GARAGE A LIGHTING PLAN - LEVEL A - PHASE 3				•
EL202-900A	GARAGE A LIGHTING PLAN - LEVEL B - PHASE 3				•
EL203-900A	GARAGE A LIGHTING PLAN - LEVEL C - PHASE 3				•
EL204-900A	GARAGE A LIGHTING PLAN - LEVEL D - PHASE 3				•
EP101-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL A - PHASE 3				•
EP102-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL B - PHASE 3				•
EP103-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL C - PHASE 3				•
EP104-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL D - PHASE 3				•
EP105-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL E - PHASE 3				•
EP201-900A	GARAGE A POWER PLAN - LEVEL A - PHASE 3				•
EP202-900A	GARAGE A POWER PLAN - LEVEL B - PHASE 3				•
EP203-900A	GARAGE A POWER PLAN - LEVEL C - PHASE 3				•
EP204-900A	GARAGE A POWER PLAN - LEVEL D - PHASE 3				•
EP205-900A	GARAGE A ELECTRICAL PLAN - LEVEL E - PHASE 3				•
15 - ELECTRICAL: 27					
16.1 TELECOMMUNICATIONS					
TN001-900A	TELECOM LEGEND AND ABBREVIATIONS				•
TN002-900A	TELECOM SYSTEMS OVERVIEW AND GENERAL NOTES				•
TN010-900A	TELECOM LEVEL A SITE DATA ZONING PLAN				•
TN020-900A	TELECOM LEVEL B SITE DATA ZONING PLAN				•
TN030-900A	TELECOM LEVEL C SITE DATA ZONING PLAN				•
TN040-900A	TELECOM LEVEL D SITE DATA ZONING PLAN				•
TN050-900A	TELECOM LEVEL E SITE DATA ZONING PLAN				•
TN101-900A	TELECOM GARAGE A (PHASE 3) LEVEL A OVERALL				•
TN102-900A	TELECOM GARAGE A (PHASE 3) LEVEL B OVERALL				•
TN103-900A	TELECOM GARAGE A (PHASE 3) LEVEL C OVERALL				•
TN104-900A	TELECOM GARAGE A (PHASE 3) LEVEL D OVERALL				•
TN105-900A	TELECOM GARAGE A (PHASE 3) LEVEL E OVERALL				•
TN111A-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL A AREA A				•
TN111B-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL A AREA B				•
TN112A-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL B AREA A				•
TN112B-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL B AREA B				•
TN113A-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL C AREA A				•
TN113B-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL C AREA B				•
TN114A-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL D AREA A				•
TN114B-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL D AREA B				•
TN115A-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL E AREA A				•
TN115B-900A	TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL E AREA B				•
TN131A-900A	TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL A AREA A				•
TN131B-900A	TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL A AREA B				•
TN131C-900A	TELECOM CEILING PLAN - TERMINAL C RAMP LEVEL AREA 302				•
TN132A-900A	TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL B AREA A				•
TN132B-900A	TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL B AREA B				•

SITE LIGHTING SYMBOLS						LIGHTING CONTROL SYMBOLS						SINGLE LINE SYMBOLS						GENERAL DEMOLITION LEGEND											
						<p>3W XXa MANUAL, STAND ALONE LIGHT SWITCH</p> <p>SUBSCRIPT(S) INDICATES THE FOLLOWING:</p> <p>"a" CIRCUIT DESIGNATION "3d" WALL MOUNTED DIMMER "EP" WALL MOUNTED EXPLOSION PROOF "K" WALL MOUNTED KEY OPERATED "NS-X" WALL MOUNTED NETWORK MASTER "OR" WALL MOUNTED OVERRIDE "OS" WALL MOUNTED OCCUPANCY SENSOR "PL" WALL MOUNTED PILOT LIGHT "TM" WALL MOUNTED TIMER OPERATED "WP" WALL MOUNTED WEATHERPROOF "XX" CIRCUIT NUMBER "3W" WALL MOUNTED THREE-WAY "4W" WALL MOUNTED FOUR-WAY</p> <p>H-CL XXa OL XXa PHOTOCELL</p> <p>SUBSCRIPT(S) INDICATES THE FOLLOWING:</p> <p>"a" CIRCUIT DESIGNATION "CL" CLOSED LOOP "L" LONG RANGE "OL" OPEN LOOP "XX" CIRCUIT NUMBER</p> <p> LOW VOLTAGE LIGHTING CONTROL RELAY CABINET</p> <p>SUBSCRIPT(S) INDICATES THE FOLLOWING:</p> <p>"LRP" LIGHTING RELAY PANEL "LRSP" LIGHTING RELAY SATELLITE PANEL "LRSPD" LIGHTING RELAY SATELLITE PANEL (DIMMING)</p> <p> CONTACTOR</p> <p> TIME CLOCK</p>						<p>CIRCUIT BREAKER " _ " A" INDICATES TRIP RATING/SETTING (AMPS)</p> <p>DRAW OUT CIRCUIT BREAKER " _ " A" INDICATES TRIP RATING/SETTING (AMPS)</p> <p>FUSIBLE SWITCH " _ " A" INDICATES DISCONNECT TRIP RATING AND FUSE SIZE, RESPECTIVELY (AMPS)</p> <p>AUTOMATIC TRANSFER SWITCH</p> <p>GROUND</p> <p>TRANSFORMER</p> <p>GROUND FAULT PROTECTIVE RELAY</p> <p>LONG TERM, SHORT TERM, INSTANTENOUS ANS GROUND FAULT PROTECTION</p> <p>SURGE PROTECTION DEVICE</p> <p>ELECTRIC UTILITY METER (CURRENT TRANSFORMER TYPE)</p> <p>FEEDER SIZE TAG - REFER TO FEEDER SCHEDULE</p>						<p>E - EXISTING ELECTRICAL EQUIPMENT (DEVICE) TO REMAIN IN SERVICE. NO WORK REQUIRED.</p> <p>ER - EXISTING ELECTRICAL EQUIPMENT (DEVICE) TO BE DISCONNECTED AND REMOVED.</p> <p>ERR - EXISTING ELECTRICAL EQUIPMENT (DEVICE) TO BE RELOCATED. CONTRACTOR SHALL INTERCEPT EXISTING CONDUIT AND WIRING AND EXTEND THEM TO NEW LOCATION. RECONNECT DEVICE AT NEW LOCATION AS INDICATED ON THE DRAWINGS.</p> <p>ERN - EXISTING ELECTRICAL EQUIPMENT (DEVICE) TO BE REPLACED WITH NEW AT SAME LOCATIONS. CONTRACTOR SHALL PROVIDE NEW EQUIPMENT (DEVICE) AS SPECIFIED. EXISTING RACEWAY AND WIRING TO REMAIN UNLESS NOTED OTHERWISE. RECONNECT NEW DEVICE FOR A WORKING SYSTEM.</p> <p>ED - EXISTING EQUIPMENT TO BE DISCONNECT FOR THE REMOVAL BY OTHERS. CONTRACTOR SHALL DISCONNECT AND REMOVE ALL ASSOCIATED ELECTRICAL EQUIPMENT, CONTROLS, CONDUIT AND WIRING.</p> <p>EN - NEW LOCATED FOR EXISTING ELECTRICAL EQUIPMENT, LIGHTING FIXTURES, DEVICE BEING RELOCATED. CONTRACTOR SHALL EXTEND EXISTING CONDUIT AND WIRING TO NEW LOCATION. PROVIDE NEW CONDUIT AND WIRING WHERE REQUIRED.</p>											
POWER SYMBOLS						ABBREVIATIONS						GROUNDING SYMBOLS						PANELBOARD SYMBOLS						GENERAL NOTES					
<p>SUBSCRIPT INDICATES THE FOLLOWING:</p> <p>"AC" MOUNTED 6" ABOVE COUNTER "AV" AUDIOVISUAL, COMPUTER GRADE "CR" CHILD RESISTANT (SAFETY TYPE) "EM" FED BY EMERGENCY CIRCUIT "EP" EXPLOSION PROOF "EW" ELECTRIC WATER COOLER "GFI" GROUND FAULT CIRCUIT INTERRUPTER "IG" ISOLATED GROUND "IP" POWER CONNECTION "WP" WATERPROOF COVER "#" CIRCUIT NUMBER</p> <p> DUPLEX RECEPTACLE</p> <p> JUNCTION BOX</p> <p> JUNCTION BOX WITH FLEXIBLE CONDUIT</p>						<p>AMPERS INTERRUPTING CAPACITY MFC AUTOMATIC TRANSFER SWITCH MCH BUILDING AUTOMATION SYSTEM MIN CONDUIT MLO CIRCUIT BREAKER MOC CABLE TELEVISION MTD CIRCUIT N CLOSED CIRCUIT TELEVISION N/A CHICAGO ELECTRIC CODE NEC CONTROL PANEL NIC CHILD RESISTANT NTS CURRENT TRANSFORMER PLUMB COPPER PRI DISCONNECT SWITCH RGS ELECTRIC, ELECTRICAL SEC EMERGENCY SPD EQUIPMENT SPEC EXISTING SWGR FULL LOAD AMPS SWGR FUSE TYP GROUND FAULT INTERRUPTER UL GROUND UNO HIGH MAST LIGHTING SYSTEM UPS HORSEPOWER VA HERTZ W INTERMEDIATE DISTRIBUTION FRAME WG ISOLATED GROUND WP KILO-VOLT AMP WR KILOWATT XFMR MAXIMUM XP</p> <p>MAIN CIRCUIT BREAKER MCB MOTOR CONTROL CENTER MCC MECHANICAL MECH MINIMUM MIN MAIN LUIS ONLY MLO MAIN OVERCURRENT PROTECTION MOC MOUNTED MTD NEUTRAL N NOT APPLICABLE N/A NATIONAL ELECTRIC CODE NEC NOT IN CONTRACT NIC NOT TO SCALE NTS PRIMARY PRI RIGID GALVANIZED STEEL RGS SECONDARY SEC SURGE PROTECTION DEVICE SPD SPECIFICATIONS SPEC SWITCHBOARD SWGR SWITCHGEAR SWGR TYPICAL TYP UNDERWRITER LABORATORIES UL UNLESS NOTED OTHERWISE UNO UNINTERRUPTIBLE POWER SUPPLY UPS VOLTS VA VOLTS/AMPS VA WATTS W WIRE GUARD WG WEATHERPROOF WP WITHSTAND RATING WR TRANSFORMER XFMR EXPLOSION PROOF XP</p>						<p> 10 FT COPPER GROUND ROD</p> <p> 10 FT COPPER GROUND ROD WITH TEST WELL</p> <p> GROUNDING TRIAD. PROVIDE A MINIMUM 10'-0" DISTANCE BETWEEN ROUND RODS</p>						<p>PLAN SYMBOL</p> <p> SWITCHGEAR, SWITCHBOARD OR MOTOR CONTROL CENTER. DASHED LINES INDICATE FUTURE SECTIONS. DOUBLE LINE INDICATES FRONT</p> <p> SURFACE MOUNTED DISTRIBUTION PANELBOARD</p> <p> SURFACE MOUNTED PANELBOARD</p>						<p>1. ALL ELECTRICAL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE PROJECT SPECIFICATIONS AND ALL OTHER DRAWINGS RELATED TO THE PERFORMANCE OF THE WORK.</p> <p>2. THE CONTRACTOR RESPONSIBLE FOR THE EXECUTION OF THIS WORK SHALL BECOME THOROUGHLY FAMILIAR WITH THE PROJECT SPECIFICATIONS BEFORE COMMENCING ANY WORK. THE PROJECT SPECIFICATIONS ARE DRAWINGS FORM THE BASIS OF THIS CONTRACT REQUIREMENTS AND INCLUDE THE TYPE AND BASIS OF THIS CONTRACT REQUIREMENTS AND INCLUDED THE TYPE AND GRADE OF MATERIALS TO BE INSTALLED. EQUIPMENT TO BE FURNISHED, THE MANNER BY WHICH TO BE INSTALLED AND WHERE TO BE LOCATED. IN THE MANNER BY WHICH TO BE INSTALLED AND WHERE TO BE LOCATED. IN THE EVENT OF A CONFLICT BETWEEN THE PROJECT SPECIFICATIONS AND DRAWINGS, SPECIFICATIONS GOVERN UNLESS THE ARCHITECT/ENGINEER DIRECTS OTHERWISE.</p> <p>3. THE CONTRACTOR SHALL CHECK CAREFULLY ALL CONSTRUCTION DRAWINGS AND SPECIFICATIONS THAT ARE PART OF THIS PROJECT TO INSURE THAT NO FIXTURE, OUTLET, ALARM STATION OR CONTROL AND POWER WIRING IS OMITTED. HE SHALL CONDUIT ALL TRADES FURNISHING EQUIPMENT AND OBTAIN FROM THEM ALL DATA. IN SOME CASES EQUIPMENT, FIXTURES AND DEVICES ARE SHOWN ONLY. ASCERTAIN AND PROVIDE THE WIRING AND CONTROL STATIONS REQUIRED TO THE PROPER FUNCTION OF BUILDING EQUIPMENT.</p> <p>4. EQUIPMENT LABELS AND INSTRUCTIONS REGARDING THE APPLICATION AND INSTALLATION OF THE LISTED EQUIPMENT SHALL BE FOLLOWED TO INSURE THAT THE EQUIPMENT IS BEING INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S LISTING INSTRUCTIONS. THE TEMPERATURE RATINGS OF THE EQUIPMENT TERMINATIONS MUST BE CAREFULLY CORRELATED WITH THE CONDUCTOR AMPACITY TO PREVENT OVERHEATING AND PREMATURE FAILURE.</p> <p>5. COORDINATE WITH OTHER TRADES AND INSTALL CONDUIT AND BOXES TO CLEAR EMBEDDED DUCTS, OPENINGS AND OTHER STRUCTURAL FEATURES.</p> <p>6. ALL LIGHTING FIXTURES ARE TO BE LOCATED AS REQUIRED ON THE JOB TO CLEAR DUCTS, PIPING, EQUIPMENT, AND/OR MECHANICAL UNITS.</p> <p>7. CONDUIT RUNS SHOWN ON THE DRAWINGS ARE DIAGRAMMATIC. ALL CONDUITS SHALL RUN CONCEALED, EXCEPT IN EQUIPMENT ROOMS AND WHERE APPROVED BY THE ARCHITECT.</p> <p>8. FURNISH AND INSTALL EQUIPMENT DISCONNECT SWITCHES IN COMPLIANCE WITH NEC.</p> <p>9. ALL OUTDOOR RECEPTACLES SHALL BE WEATHERPROOF, GFCI AND UL LISTED FOR WET LOCATIONS.</p> <p>10. NO WIRING SHALL BE DONE PRIOR TO THE CONTRACTOR'S REVIEW OF THE PROJECT EQUIPMENT SHOP DRAWINGS AND COORDINATION WITH THE DESIGN DOCUMENTS. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ARCHITECT/ENGINEER ATTENTION FOR FINAL RESOLUTION. WORK THAT HAS TO BE REPLACED DUE TO LACK OF PROPER SHOP DRAWINGS CO-ORDINATION SHALL BE DONE AT CONTRACTOR'S EXPENSE.</p> <p>11. MOTOR SIZES AND LOCATIONS SHOWN ON THE DRAWINGS ARE BASED ON INFORMATION OBTAINED DURING DESIGN. VERIFY THE ACTUAL LOCATIONS AND PROVIDE WIRING AND PROTECTION OF PROPER SIZES AS REQUIRED. WIRE MOTORS FOR PROPER DIRECTION OF ROTATION AND CHECK ROTATION AT START-UP.</p> <p>12. ALL BRANCH CIRCUIT FEEDERS SHALL BE PROVIDED WITH SEPARATE GROUNDING CONDUCTORS.</p> <p>13. ALL 120V, 1PH BRANCH CIRCUITS SHALL HAVE DEDICATED NEUTRALS.</p> <p>14. UNLESS NOTED OTHERWISE, 15 AND 20 AMP 120 VOLT BRANCH CIRCUITS SHALL UTILIZE MINIMUM #12 AWG FOR CIRCUITS UP TO 75' IN LENGTH #10 AWG FOR CIRCUITS 76' TO 100' IN LENGTH, AND #8 AWG FOR CIRCUITS OVER 100' IN LENGTH. THE LENGTH OF THE CIRCUIT SHALL BE MEASURED FROM THE LAST DEVICE OR OUTLET ON THE CIRCUIT TO THE PANEL/SOURCE.</p> <p>15. UNLESS NOTED OTHERWISE, 15 AND 20 AMP 277 VOLT BRANCH CIRCUITS SHALL UTILIZE MINIMUM #12 AWG FOR CIRCUITS UP TO 100' IN LENGTH #10 AWG FOR CIRCUITS 100' TO 150' IN LENGTH, #8 AWG FOR CIRCUITS 150' TO 300' IN LENGTH, AND #6 AWG FOR CIRCUITS OVER 300'. THE LENGTH OF THE CIRCUIT SHALL BE MEASURED FROM THE LAST DEVICE OR OUTLET ON THE CIRCUIT TO THE PANEL/SOURCE.</p> <p>16. CONDUIT FOR ALL ELECTRICAL WORK RUNNING ACROSS THE BUILDING CONSTRUCTION JOINT SHALL BE PROVIDED WITH CONDUIT EXPANSION FITTINGS (WITH BONDING JUMPERS ACROSS EACH FITTINGS.)</p> <p>17. PROVIDE FUNCTIONAL TESTING AND CERTIFICATION OF THE LIGHTING CONTROL SYSTEM WHICH MUST BE PERFORMED BY AN INDEPENDENT PARTY (NOT DIRECTLY INVOLVED IN DESIGN OR CONSTRUCTION OF THE PROJECT) AND HIRED BY THE DIV. 26 CONTRACTOR TO ASSURE COMPLIANCE WITH IECC-2015 ART. C408.3, UNDER THE IECC, THIS INDEPENDENT PARTY MUST BE A REGISTERED DESIGN PROFESSIONAL.</p> <p>THE TESTING SHALL ENSURE THAT CONTROL HARDWARE AND SOFTWARE ARE CALIBRATED, ADJUSTED, PROGRAMMED, AND IN PROPER WORKING CONDITION IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND THESE CONSTRUCTION DOCUMENTS. THIS TESTING SHALL INCLUDE OCCUPANCY SENSORS, TIME SWITCH CONTROLS, TIME CLOCK PROGRAMMING, AND DAYLIGHT RESPONSIVE CONTROLS. IECC-2015 ART. C408.3 FURTHER OUTLINE THE TESTING REQUIREMENTS.</p> <p>PROVIDE DOCUMENTATION OF THE FINAL CONSTRUCTION CONDITIONS (AS-BUILTS), LIGHTING CONTROL PROGRAMMING, EQUIPMENT O&M MANUALS, AND FUNCTIONAL TESTING REPORTS WITHIN 90 DAYS OF THE RECEIPT OF THE CERTIFICATE OF OCCUPANCY, OR WITHIN 90 DAYS OF SYSTEM ACCEPTANCE, WHICHEVER OCCURS FIRST. THESE DOCUMENTS SHALL BE PROVIDED TO THE EOR AND THE OWNER OR OWNER'S AUTHORIZED AGENT, AND IN FULL COMPLIANCE WITH IECC-2015 ART. C408.3 REQUIREMENTS.</p>					
FIRE ALARM SYMBOLS						PANELBOARD IDENTIFICATION LOGIC						FIRE ALARM SYMBOLS						RACEWAYS & WIRING											
<p> AUDIO ALARM DEVICE WITH VISUAL ALARM DEVICE</p> <p> VISUAL ALARM DEVICE</p> <p> SYSTEM SMOKE DETECTOR</p> <p> SPRINKLER PRESSURE SWITCH</p> <p> TROUBLE BELL</p> <p> FIRE ALARM CONTROL PANEL</p>						<p>EM - EMERGENCY LP - LIGHTING DP - DISTRIBUTION PANELBOARD KP - KITCHEN LP - LIGHTING PP - POWER RP - RECEPTACLES SWGR - SWITCHGEAR</p>						<p> CONDUIT HOMERUN</p> <p> PHASE NEUTRAL GROUND</p> <p> CONDUIT - SURFACE MOUNTED OR CONCEALED</p> <p> CONDUIT UNDERFLOOR OR UNDERGROUND</p> <p> CONDUIT TURNED UP</p> <p> CONDUIT TURNED DOWN</p> <p> CONCRETE ENCASED CONDUIT</p> <p> FLEXIBLE CONDUIT</p> <p> JUNCTION BOX</p> <p> JUNCTION BOX - WALL MOUNTED</p> <p> JUNCTION BOX UNDER FLOOR</p> <p> PULLBOX</p> <p> CONDUIT EXPANSION JOINT</p>																	

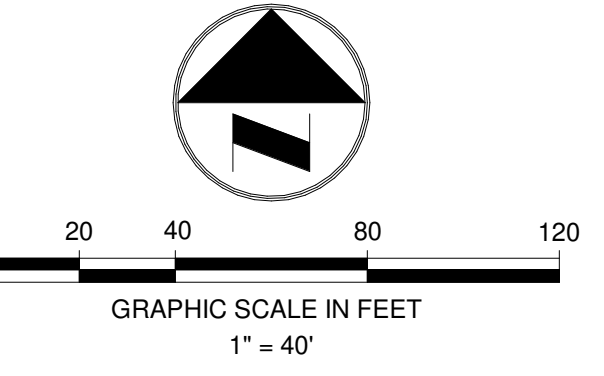



GENERAL NOTES:

1. REFER TO PHASING DEMARCATION LINES ON PLANS.
2. CARE SHALL BE TAKEN DURING DEMOLITION TO PRESERVE THE FOLLOWING: LARGE SHADE TREES, LARGE FLAG POLES, HIGHWAY SIGNAGE, REMAINING STRUCTURES, ETC.
3. ALL EXISTING HANDHOLES THAT ARE NOT COMPLETELY ABANDONED BY THIS WORK SHALL REMAIN AS IS.

KEYED NOTES:

- ① EXIST HID LIGHTS AND POLES MOUNTED TO GARAGE STRUCTURE THAT SERVES THE ELEVATED ROADWAY SHALL BE REMOVED AND REPLACED IN FULL. WIRING AND CONDUIT FEEDING POLES SHALL BE REMOVED AND REPLACED IN FULL. TYPICAL FOR HATCHED AREA.
- ② EXISTING LIGHTS MOUNTED TO SHADE AND CONCRETE STRUCTURE ON TERMINAL BUILDING SIDE ARE NOT IN SCOPE. REFER TO TERMINAL RENOVATIONS. TYPICAL FOR HATCHED AREA.
- ③ EXISTING LED HIGHMAST LIGHTS SERVING THE RAMPS ARE TO REMAIN IN PLACE. CONDUIT AND WIRING SHALL BE PRESERVED. TYPICAL FOR HATCHED AREA.
- ④ EXISTING DOWNLIGHTS EMBEDDED IN OVERPASS SHALL BE RETROFITTED WITH LED RETROFIT KITS.


NOTE TO REVIEWER:
PHASING PLANS WILL REQUIRE ADDITIONAL COORDINATION BETWEEN GARAGE AND TERMINAL WORK PRIOR TO 100% SUBMITTAL.

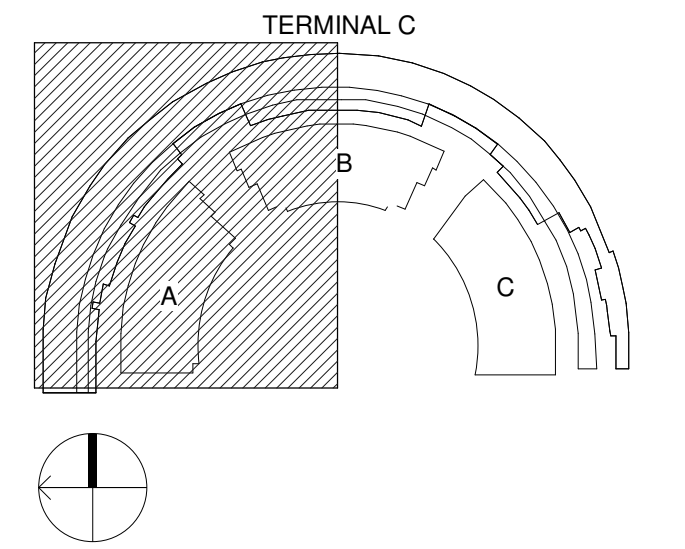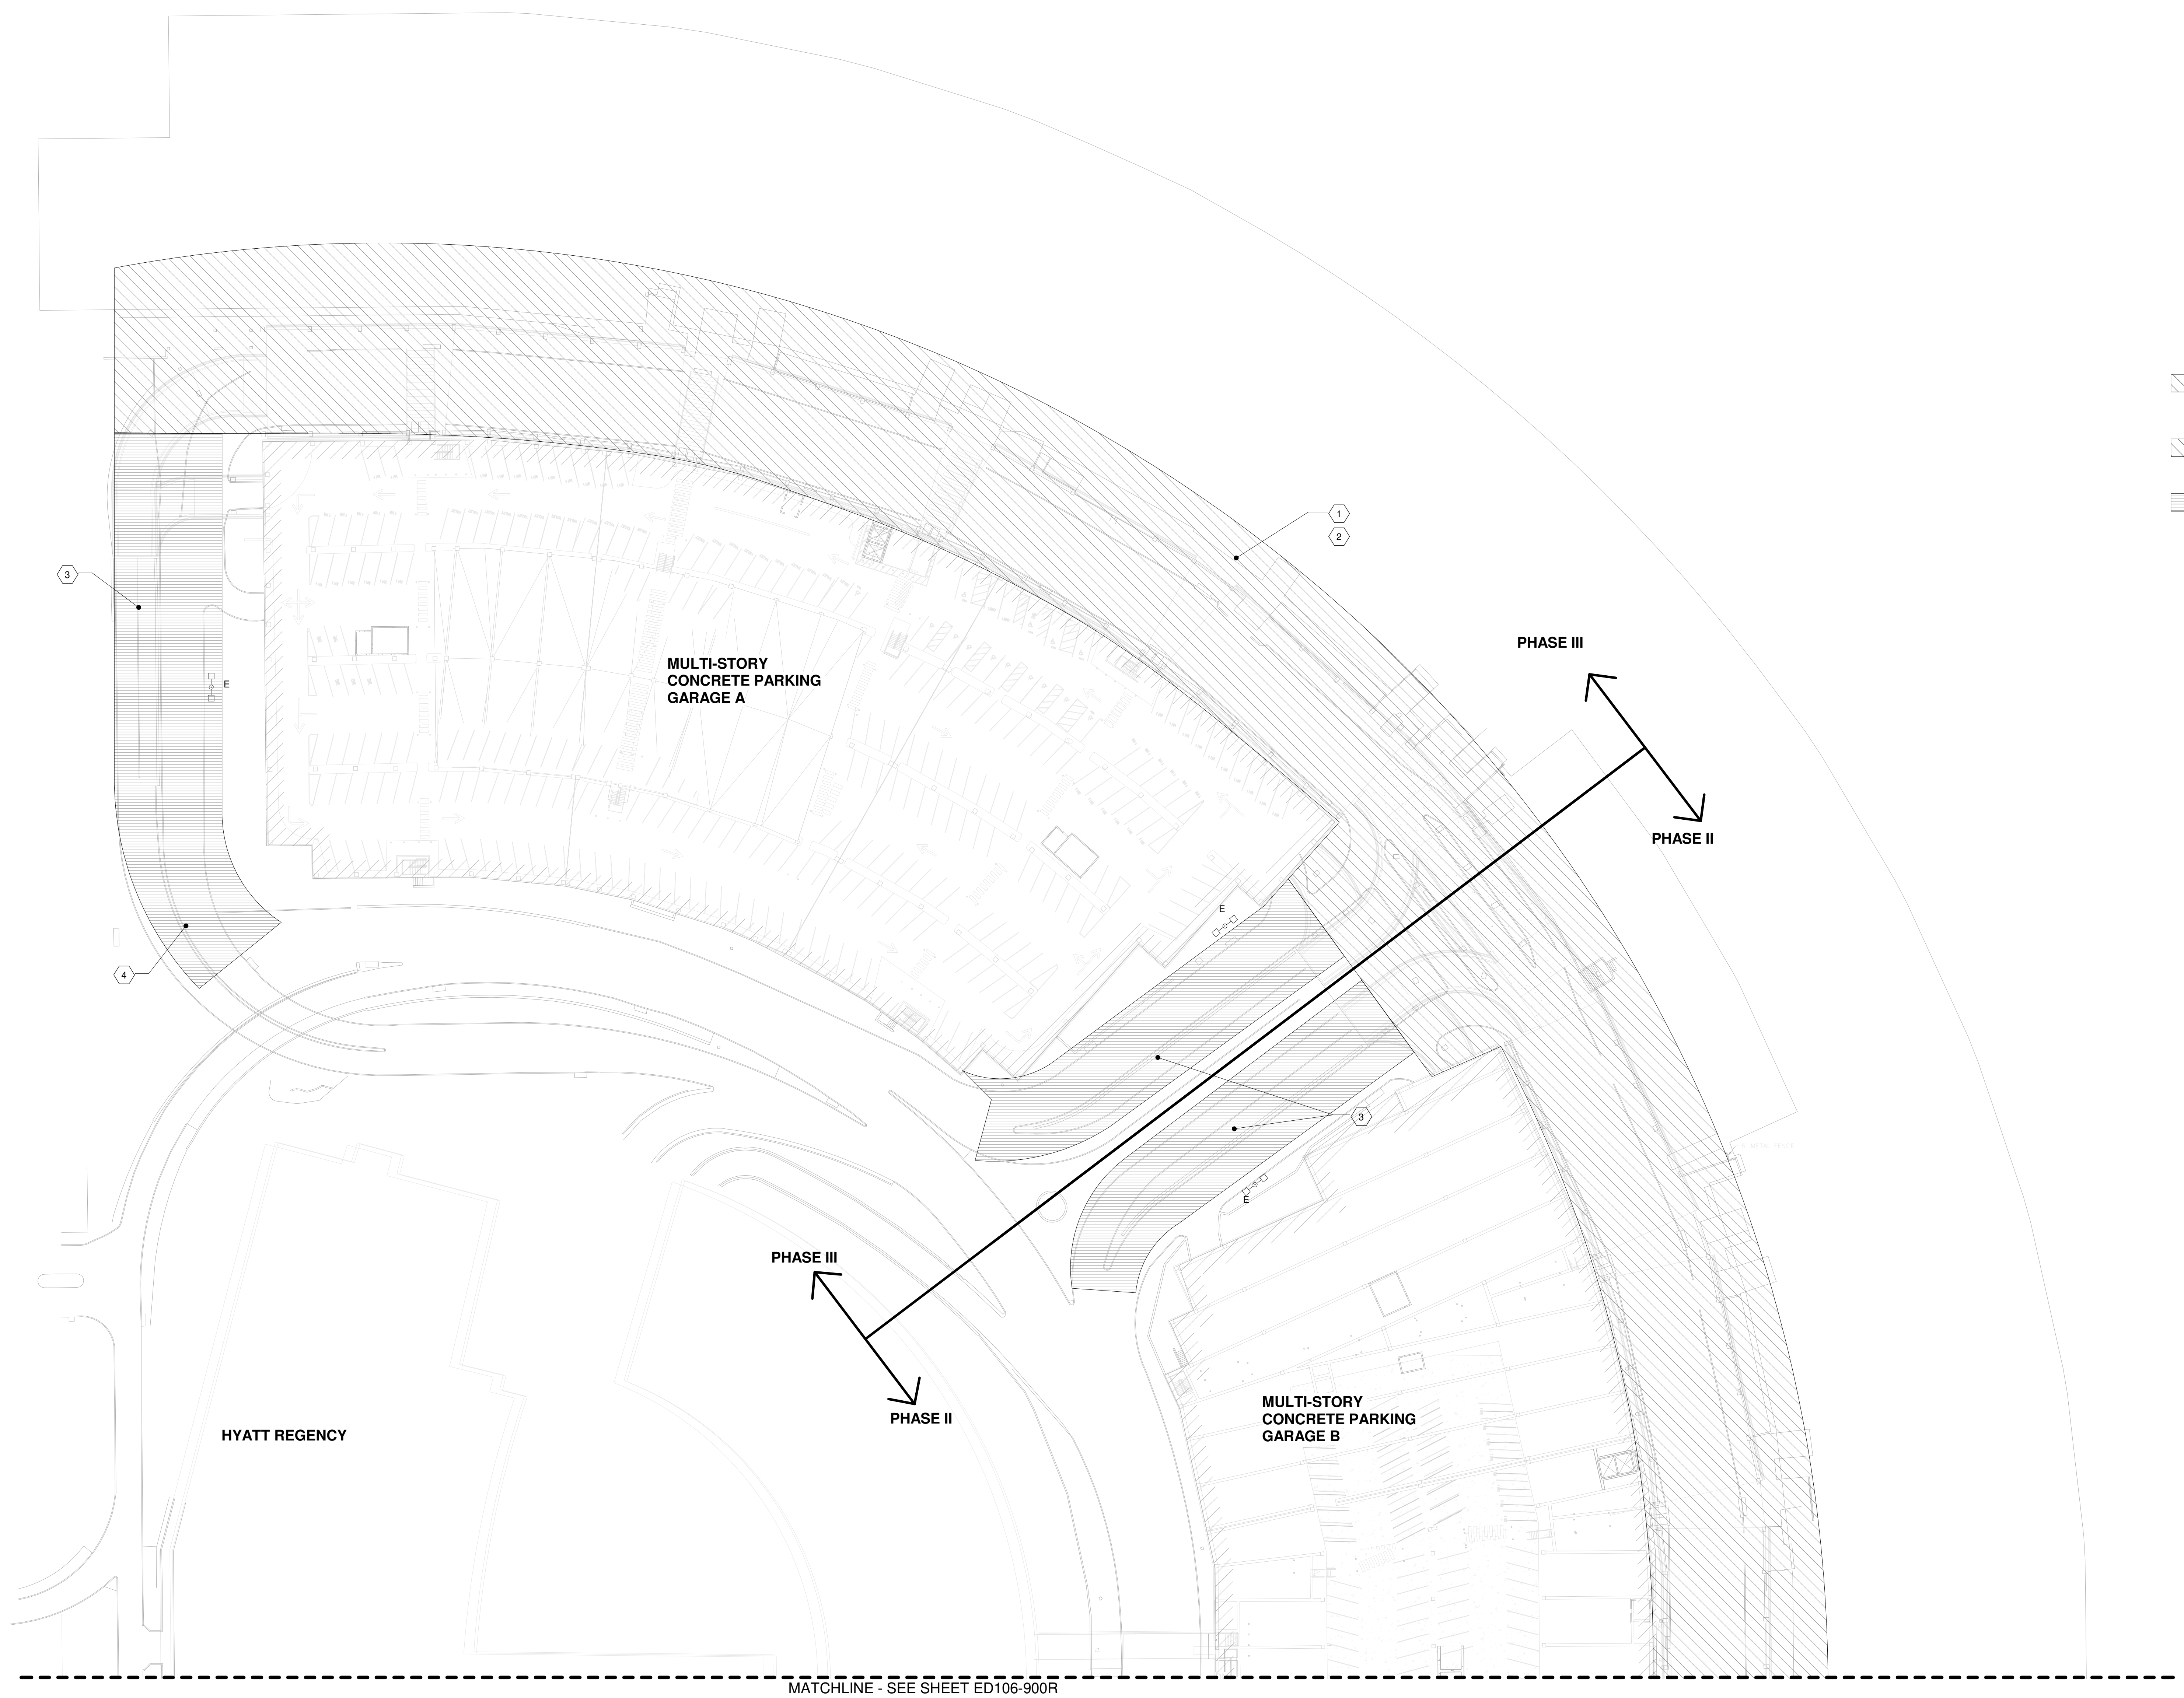

① UPPER ROADWAY - LIGHTING DEMOLITION - NORTH
1" = 40'-0"



DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

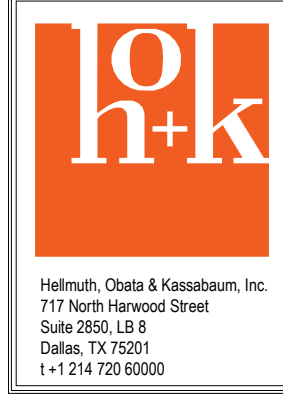

Primera

Hydrex, Clark & Koenigsmann, Inc.
717 North Westwood Street
Suite 2050, LB #
Dallas, TX 75201
1-214-722-6000

Primera Engineers, LLC
3000 Easton Trail
Suite 214
Coppell, TX 75011
1-972-899-9910

PROJECT NUMBER: TFD007

DRAWN BY: BMAY
APPROVED BY: RL/DS
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2021-10-28	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE AND ROADWAYS
LIGHTING DEMOLITION - UPPER ROADWAY, NORTH

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0021, B22-0022, B22-0023


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

SHEET NUMBER
ED105-900R

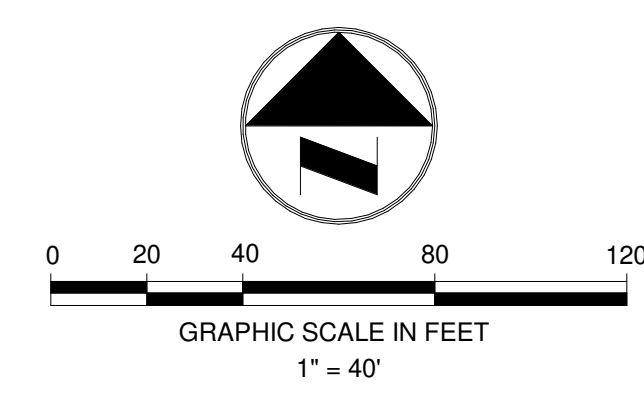


- NOTES:**
- ALL WORK SHOWN ON THIS PLAN IS UNDER PHASE I SCOPE.
 - REFER TO GARAGE A AND B DRAWINGS FOR CONDUIT ROUTING.
 - THE ROUTING OF THE UNDERGROUND DUCT BANK AND FINAL ELEVATION SHALL BE COORDINATED WITH EXISTING UNDERGROUND UTILITIES.
 - TEMPORARILY PACK PAVEMENT TO GET ROADWAYS BACK IN SERVICE AFTER THE DUCT BANK IS INSTALLED.

- KEYED NOTES:**
- PROVIDE (2) UNDERGROUND CONCRETE ENCASED DUCT BANKS EACH WITH (8) 4" CONDUITS FOR POWER. PROVIDE IN EACH DUCT BANK (2) 2" CONDUITS FOR IT COMMUNICATIONS AND (1) 2" CONDUIT FOR FIRE ALARM COMMUNICATIONS. COORDINATE WITH RESPECTIVE GARAGE A CONSULTANT DRAWINGS FOR FURTHER ROUTING AND DUCT BANK LAYOUT. REFER TO DWG. EP201-900A.
 - CONCRETE ENCASED DUCT BANK FOR GARAGE FEEDERS. STUB DAY ONE POWER CONDUITS INTO NEW ELECTRICAL ENCLOSURE DIRECTLY INTO THE MAIN SWITCHGEAR. SEE DRAWING ES3-0-0102 FOR SWITCHGEAR ELEVATION. STUB FUTURE POWER CONDUITS INTO THE CORNER IN THE MAIN ELECTRICAL ENCLOSURE 6" AFF. CAP AND LABEL. COORDINATE CONDUIT STUB UPS WITH THE SWITCHGEAR LOCATION AND ELEVATION. REFER TO GARAGE B & C DRAWINGS FOR CONDUIT ROUTING, NUMBER AND SIZE.
 - COORDINATE WITH LOW VOLTAGE CONSULTANT AND FIRE ALARM CONSULTANT DRAWINGS FOR FURTHER ROUTING OF THE CONDUITS FOR LOW VOLTAGE AND FIRE ALARM COMMUNICATIONS.
 - PROVIDE (2) UNDERGROUND CONCRETE ENCASED DUCT BANKS EACH WITH (4) 4" CONDUITS FOR POWER. PROVIDE IN EACH DUCT BANK (2) 2" CONDUITS FOR IT COMMUNICATIONS AND (1) 2" CONDUIT FOR FIRE ALARM COMMUNICATIONS. COORDINATE WITH RESPECTIVE GARAGE B CONSULTANT DRAWINGS FOR FURTHER ROUTING AND DUCT BANK LAYOUT. REFER TO DWG. EP201-900B.
 - PROVIDE DEDICATED AND SEPARATE PULLBOXES FOR EACH: POWER DAY 1 AND FOR POWER FUTURE, LOW VOLTAGE AND FIRE ALARM. TOTAL 4 PULLBOXES.

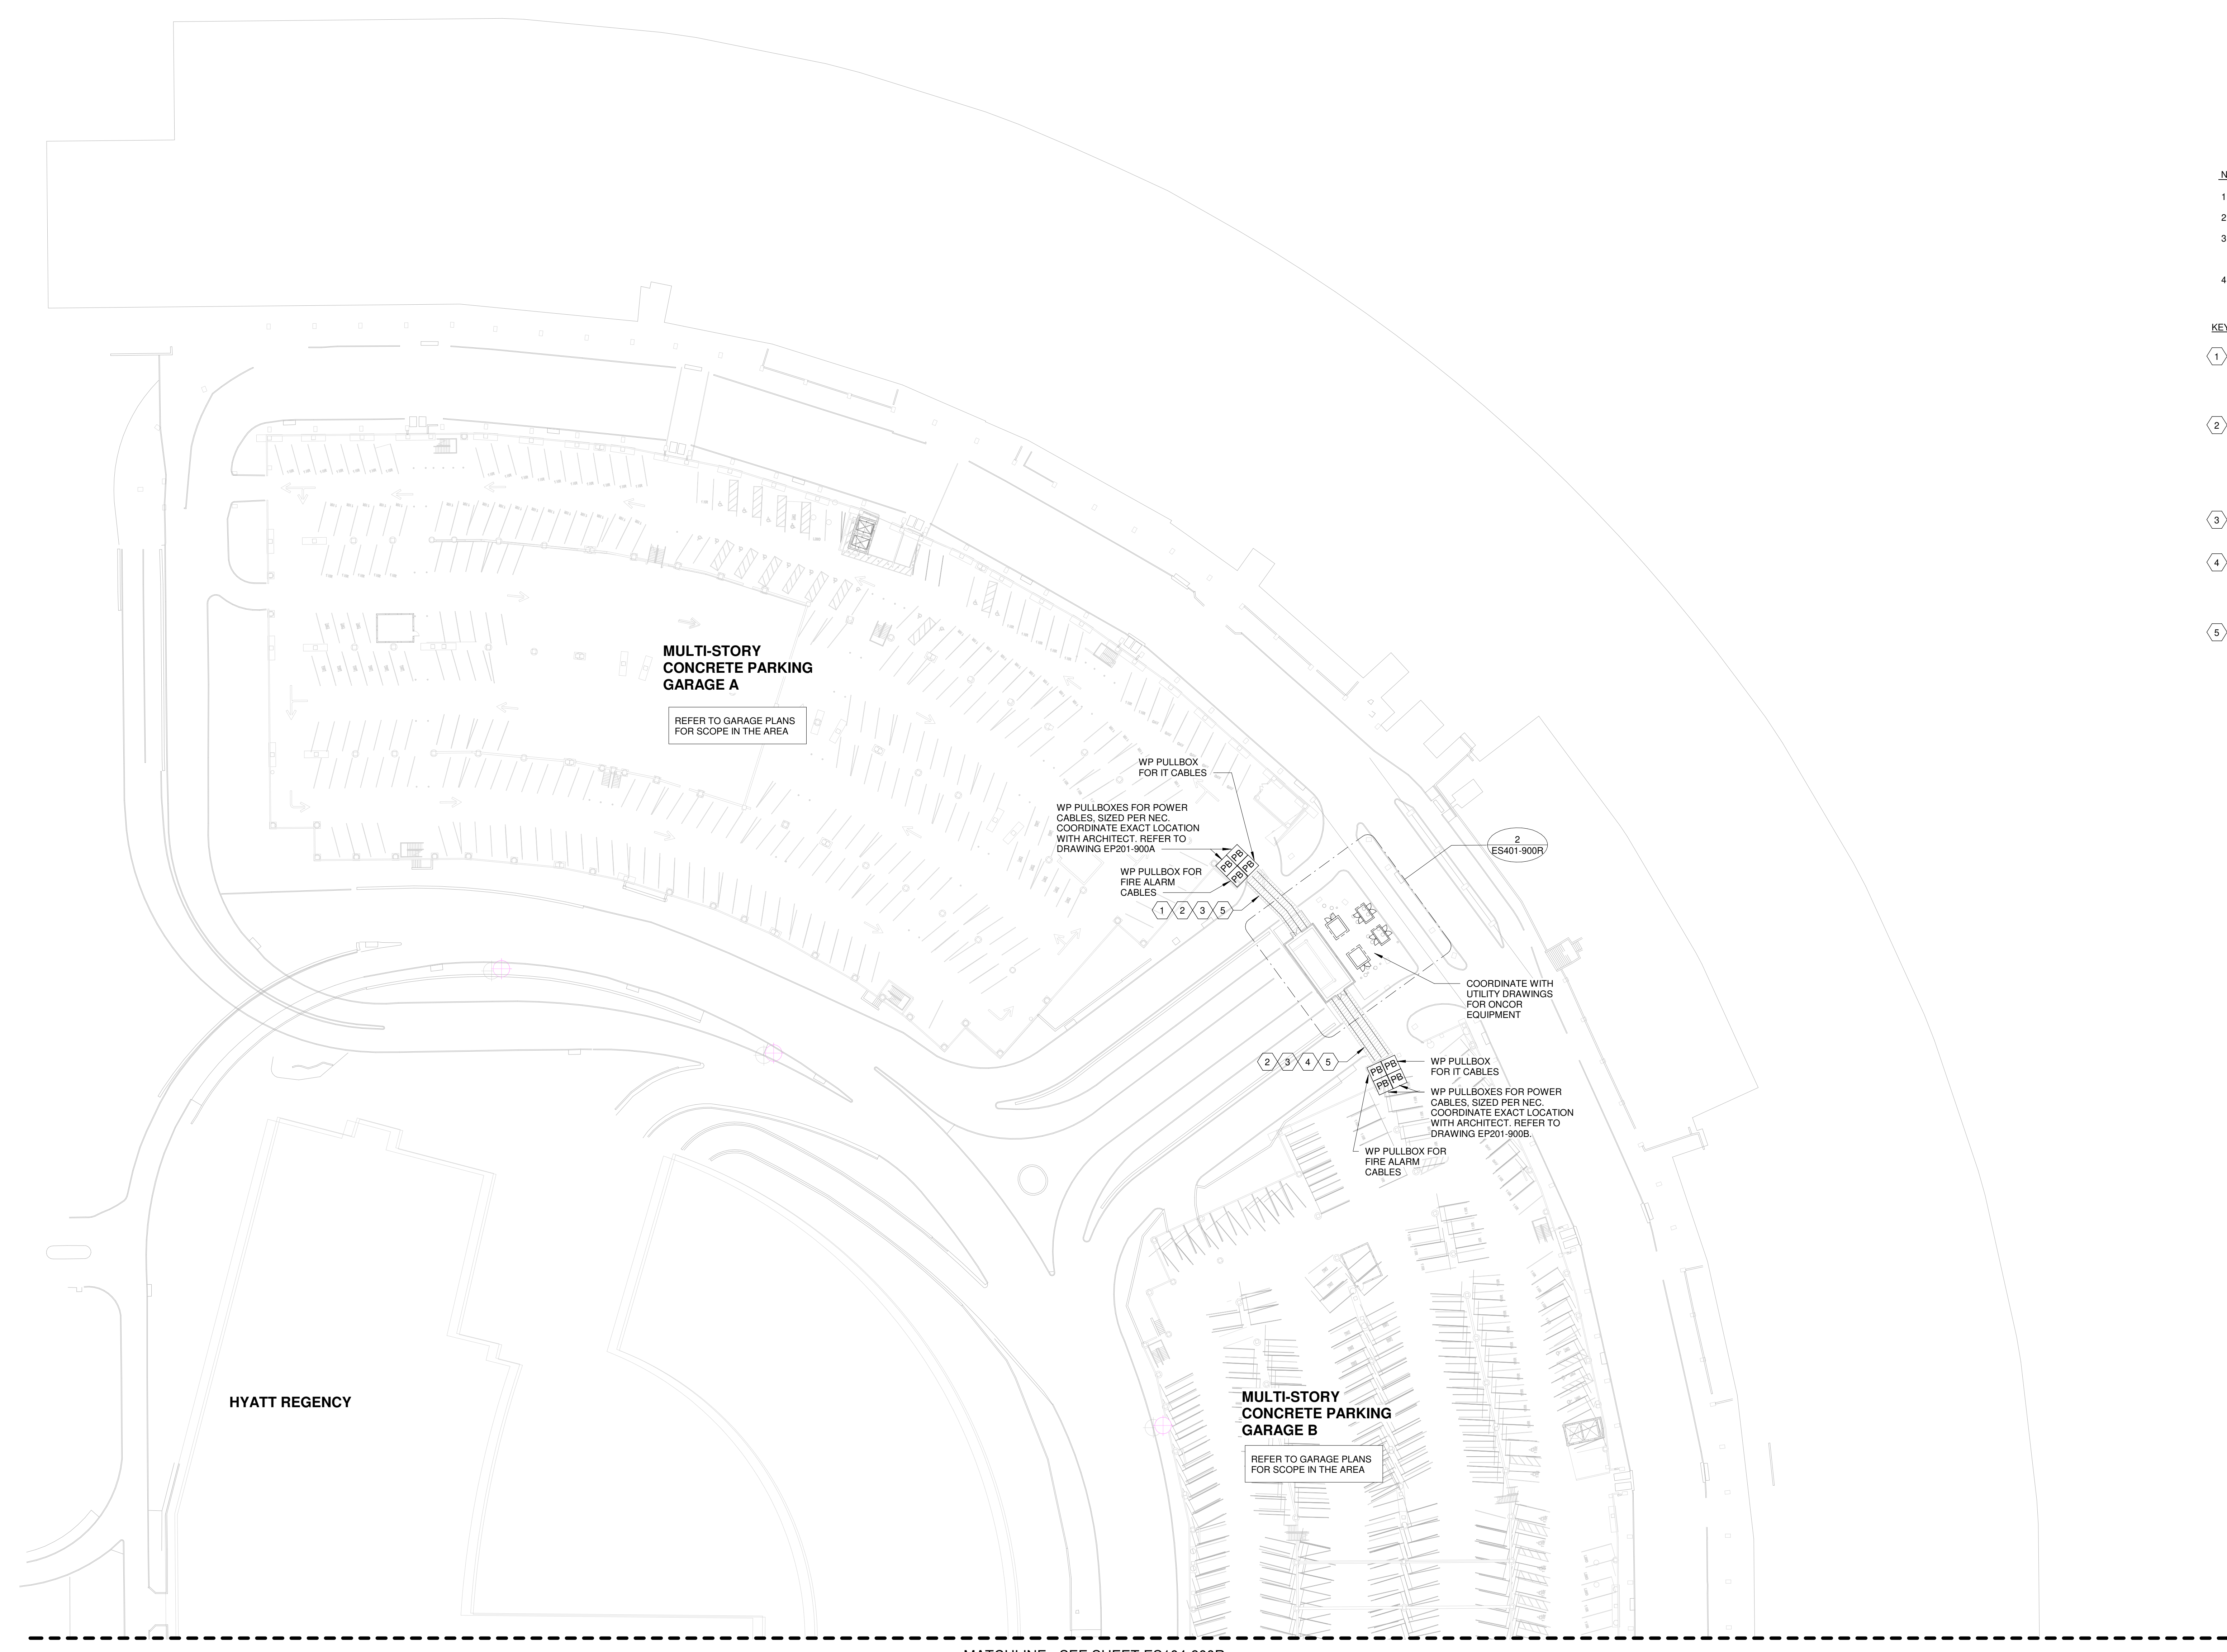


MATCHLINE - SEE SHEET ES104-900R

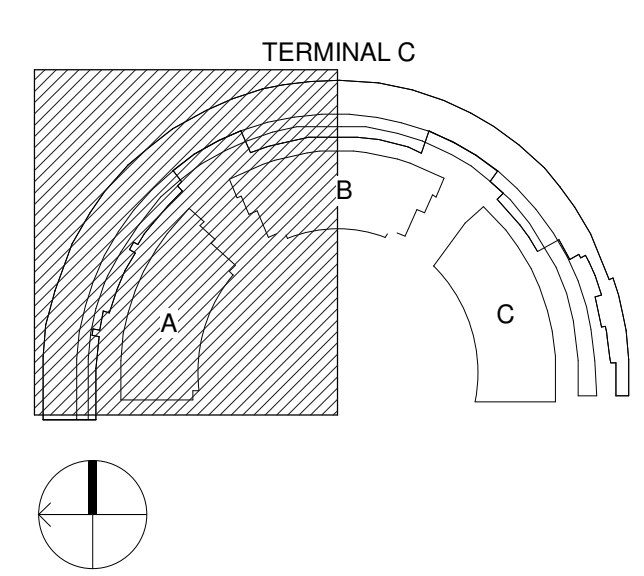

1 LOWER ROADWAY - ELECTRICAL - NORTH
1" = 40'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

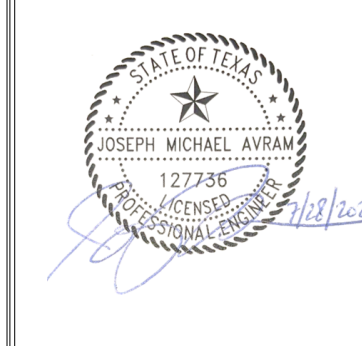

h+k **Primera**

Joseph Michael Avram
12738
Dallas, TX 75201
1-214-722-6000

Primera Engineers, LLC
3000 Easton Trail
Suite 214
Coppell, TX 75011
1-972-899-9910

PROJECT NUMBER: TFD007

DRAWN BY: BMAY
APPROVED BY: RL/DS
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-29	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE AND ROADWAYS
ELECTRICAL NEW WORK - LOWER ROADWAY, NORTH

PROJECT NUMBER: TFD-007

PERMIT NUMBER: A21-188B, B22-0021, B22-0022

SHEET NUMBER
ES103-900R

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

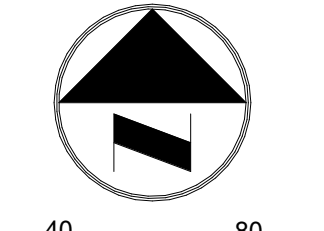

0 20 40 80 120
GRAPHIC SCALE IN FEET
1" = 40'

GENERAL NOTES:

- ALL LIGHTING CIRCUITS FOR PHASE III SHALL BE FED FROM GARAGE A. UNO. NORMAL LIGHTING WILL BE FED FROM FIRST FLOOR POWER PANEL "A-DP-A-107" AND THIRD FLOOR PANEL "A-DP-C-307" (CCTS. A2-42). EMERGENCY LIGHTING WILL BE FED FROM FIRST FLOOR INVERTER "INVB1" (CCTS. EM-1-2).
- ALL LIGHTING CIRCUITS FOR PHASE II SHALL BE FED FROM GARAGE B. UNO. NORMAL LIGHTING WILL BE FED FROM FIRST FLOOR POWER PANEL "B-DP-A-104" AND THIRD FLOOR PANEL "B-DP-C-306" (CCTS. B2-42). EMERGENCY LIGHTING WILL BE FED FROM FIRST FLOOR INVERTER "INVB2" (CCTS. EM-1-2).
- NOT USED.
- MINIMUM CONDUIT SIZE IS 3/4".
- WIRING SIZE IS #10 AWG.
- MINIMUM HANDHOLE SIZE IS 24"x24".
- EM CIRCUITS SHALL HAVE DEDICATED WIRING AND CONDUIT. PHYSICALLY SEPARATE FROM THE NORMAL POWER DISTRIBUTION.
- ALL SITE LIGHTING SHALL BE BROUGHT TO PULLBOXES AT ENTRANCE TO GARAGE STRUCTURE. FROM THE PULLBOX TO THE ELECTRICAL ROOM. REFER TO GARAGE PLANS FOR EXACT ROUTING.
- LIGHTING CONTROL COMPONENTS FOR PHASE III SHALL BE HOUSED IN GARAGE A ELECTRICAL ROOM.
- LIGHTING CONTROL COMPONENTS FOR PHASE II SHALL BE HOUSED IN GARAGE B ELECTRICAL ROOM.




KEYED NOTES:

- COORDINATE LOCATION OF LIGHT WITH EXISTING LARGE GROWTH TREES.
- NOT USED
- EXISTING HID FLOODS FOR ROADWAY SIGNAGE SHALL BE REMOVED AND REPLACED IN FULL. CONDUIT AND WIRING SHALL BE REMOVED AND REPLACED IN FULL.
- EXISTING DOWNLIGHTS EMBEDDED IN OVERPASS SHALL BE RETROFITTED WITH LED RETROFIT KITS. ASSUME (6) FOR PRICING
- EXISTING WALL PACK WALL MOUNTED ON COLUMN LOCATED UNDERNEATH RAMP.
- RELOCATION REQUIRED. COORDINATE THE RELOCATION OF EXISTING WALL PACK WITH NEW ELECTRICAL ENCLOSURE.
- SURFACE MOUNT LIGHTS AND CONDUIT ON EXISTING STRUCTURES AT THIS LOCATION.
- CONCRETE ENCASE ALL CONDUITS PASSING BELOW ROADWAYS, DRIVE PATHS, AND PARKING AREAS. EXTEND ENCASEMENT 3' PAST CURBS ON EITHER SIDE.

NOTE TO REVIEWER:
PHASING PLANS WILL REQUIRE ADDITIONAL COORDINATION BETWEEN GARAGE AND TERMINAL WORK PRIOR TO 100% SUBMITTAL.

FEEDER SCHEDULE				
TAG	FEEDER SIZE	CONDUIT	MOUNTING	SPARES
A	(2) #10s, #10 GRD	1" C	SURFACE	-
B	(3) #10s, #10 GRD	1" C	SURFACE	-
C	(4) #10s, #10 GRD	1" C	SURFACE	-
D	(5) #10s, #10 GRD	1" C	SURFACE	-
E	(6) #10s, #10 GRD	1" C	SURFACE	-
F	(9) #10s, #10 GRD	1" C	SURFACE	-
G	(2) #6s, #8 GRD	1" C	SURFACE / BELOW GRADE	-
H	(2) #6s, (2) #10s, #8 GRD	1" C	SURFACE / BELOW GRADE	1" C
I	(4) #6s, #8 GRD	1-1/2" C	SURFACE / BELOW GRADE	1-1/2" C

*based on XHHW and RGS

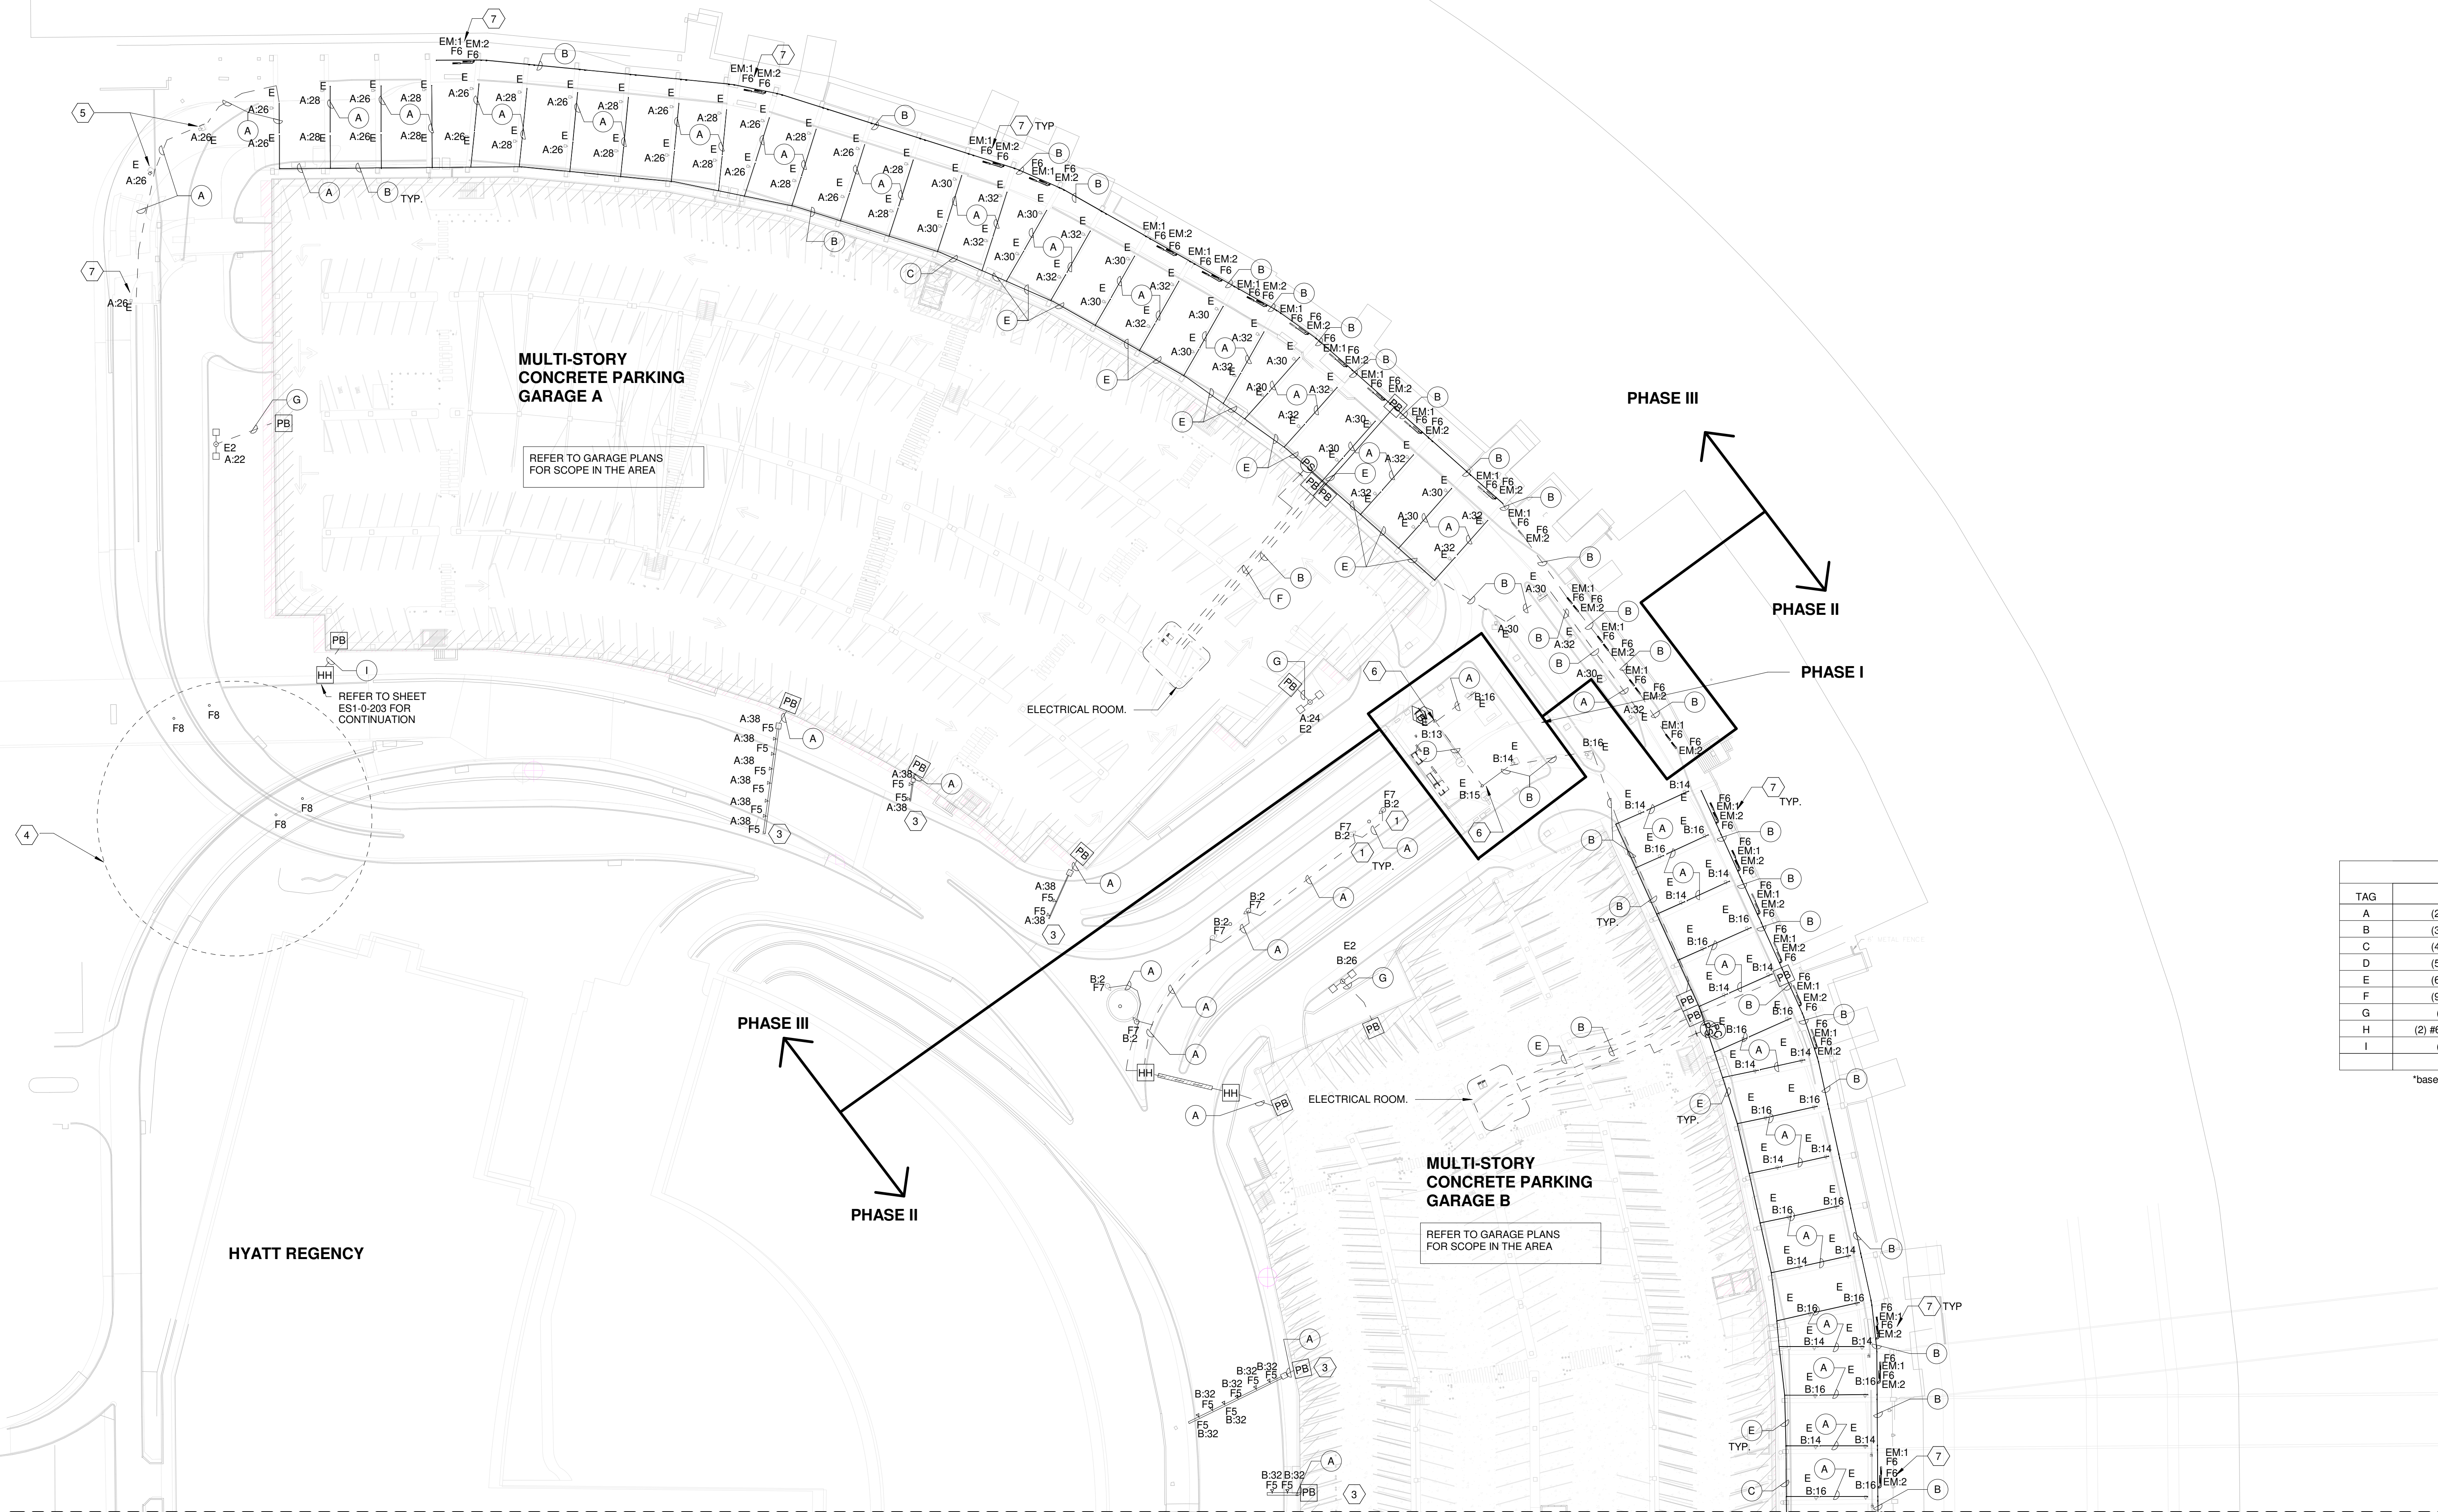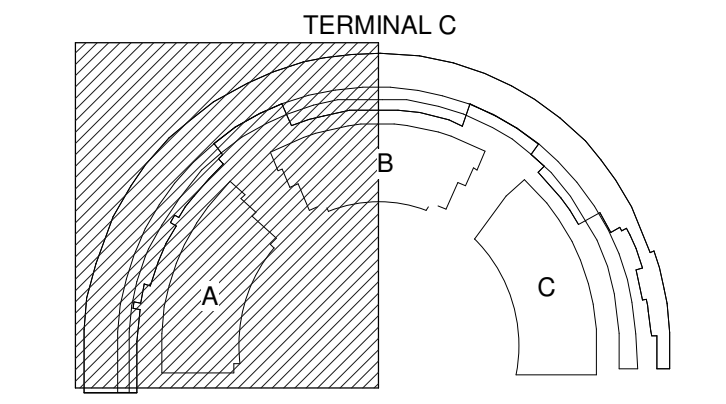

1 LOWER ROADWAY - LIGHTING - NORTH
1" = 40'-0"

MATCHLINE - SEE SHEET ES106-900R

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k **Primera**
Heidolph, Clark & Rosenbaum, Inc.
717 North Meadows Drive
Suite 200, LB #
Dallas, TX 75201
1-214-728-6000

Primera Engineers, LLC
3000 Texas Toll
Suite 214
Coppell, TX 75011
1-214-939-9910

PROJECT NUMBER: TFD007

DRAWN BY: BMAY
APPROVED BY: RL/DLS
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-29	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


PROJECT NUMBER: TFD-007

TERMINAL C GARAGE AND ROADWAYS
LIGHTING NEW WORK - LOWER ROADWAY, NORTH

PERMIT NUMBER: A21-188B, B22-0021, B22-0022, B22-0023

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


SHEET NUMBER
ES105-900R

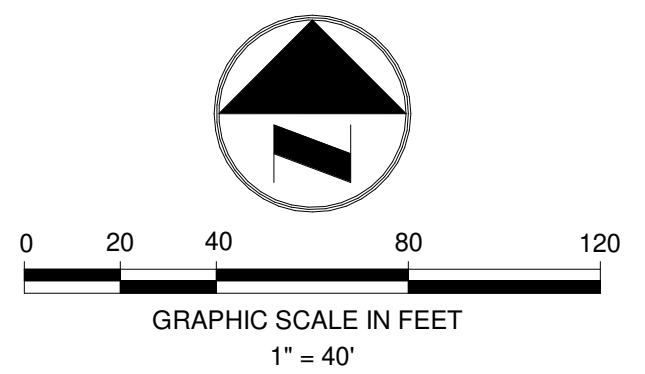

- GENERAL NOTES:**
- ALL LIGHTING CIRCUITS FOR PHASE II SHALL BE FED FROM GARAGE A. UNO. NORMAL LIGHTING WILL BE FED FROM FIRST FLOOR POWER PANEL "A-1BH1" (CCTS. A-2-42).
 - ALL LIGHTING CIRCUITS FOR PHASE II SHALL BE FED FROM GARAGE B. UNO. NORMAL LIGHTING WILL BE FED FROM FIRST FLOOR POWER PANEL "B-1BH1" (CCTS. B-2-42).
 - MINIMUM CONDUIT SIZE IS 3/4" C.
 - MINIMUM WIRING SIZE IS #10 AWG.
 - LIGHTING CONTROL COMPONENTS FOR PHASE III SHALL BE HOUSED IN GARAGE A ELECTRICAL ROOM.
 - LIGHTING CONTROL COMPONENTS FOR PHASE II SHALL BE HOUSED IN GARAGE B ELECTRICAL ROOM.
 - REFER TO GARAGE PLANS FOR ANY PARKING LIGHTING THAT MAY BE MOUNTED TO LIGHT POLES HEREIN.
 - COORDINATE INSTALLATION OF LIGHT POLES ON GARAGES A AND B WITH EXISTING LIGHTNING PROTECTION SYSTEM. WHERE CONFLICTS ARISE, ADJUST LIGHTNING PROTECTION CABLES AROUND NEW POLES.


- KEYED NOTES:**
- LIGHT POLE SHALL BE MOUNTED ON EXISTING GARAGE A STRUCTURE. STRUCTURAL ENGINEER TO DETERMINE PHYSICAL TIE-IN CONDITIONS AND STRUCTURAL LOADING. LIGHT FIXTURE SHALL BE INSTALLED AT 5' ABOVE ELEVATED ROAD FINISHED GRADE.
 - LIGHT POLE SHALL BE MOUNTED ON EXISTING GARAGE B STRUCTURE. STRUCTURAL ENGINEER TO DETERMINE PHYSICAL TIE-IN CONDITIONS AND STRUCTURAL LOADING. LIGHT FIXTURE SHALL BE INSTALLED AT 5' ABOVE ELEVATED ROAD FINISHED GRADE.
 - EXISTING LIGHTS MOUNTED TO SHADE AND CONCRETE STRUCTURES ON TERMINAL BUILDING SIDE ARE NOT IN SCOPE. REFER TO TERMINAL RENOVATIONS.
 - ROADWAY LIGHTING SHALL COORDINATE WITH FUTURE TERMINAL CANOPY DESIGN IN THIS LOCATION.
 - EXISTING DOWNLIGHTS EMBEDDED IN OVERPASS SHALL BE RETROFITTED WITH LED RETROFIT KITS.
 - CONCRETE ENCASE ALL CONDUITS PASSING BELOW ROADWAYS, DRIVE PATHS, AND PARKING AREAS. EXTEND ENCASEMENT 3' PAST CURBS ON EITHER SIDE.
 - SURFACE MOUNT LIGHTS AND CONDUIT ON EXISTING STRUCTURES AT THIS LOCATION.
 - RE-USE EXISTING POLE LOCATION AND ANCHOR BOLTS. SEE DETAIL 2-ESS03-900R.

NOTE TO REVIEWER:
PHASING PLANS WILL REQUIRE ADDITIONAL COORDINATION BETWEEN GARAGE AND TERMINAL WORK PRIOR TO 100% SUBMITTAL.

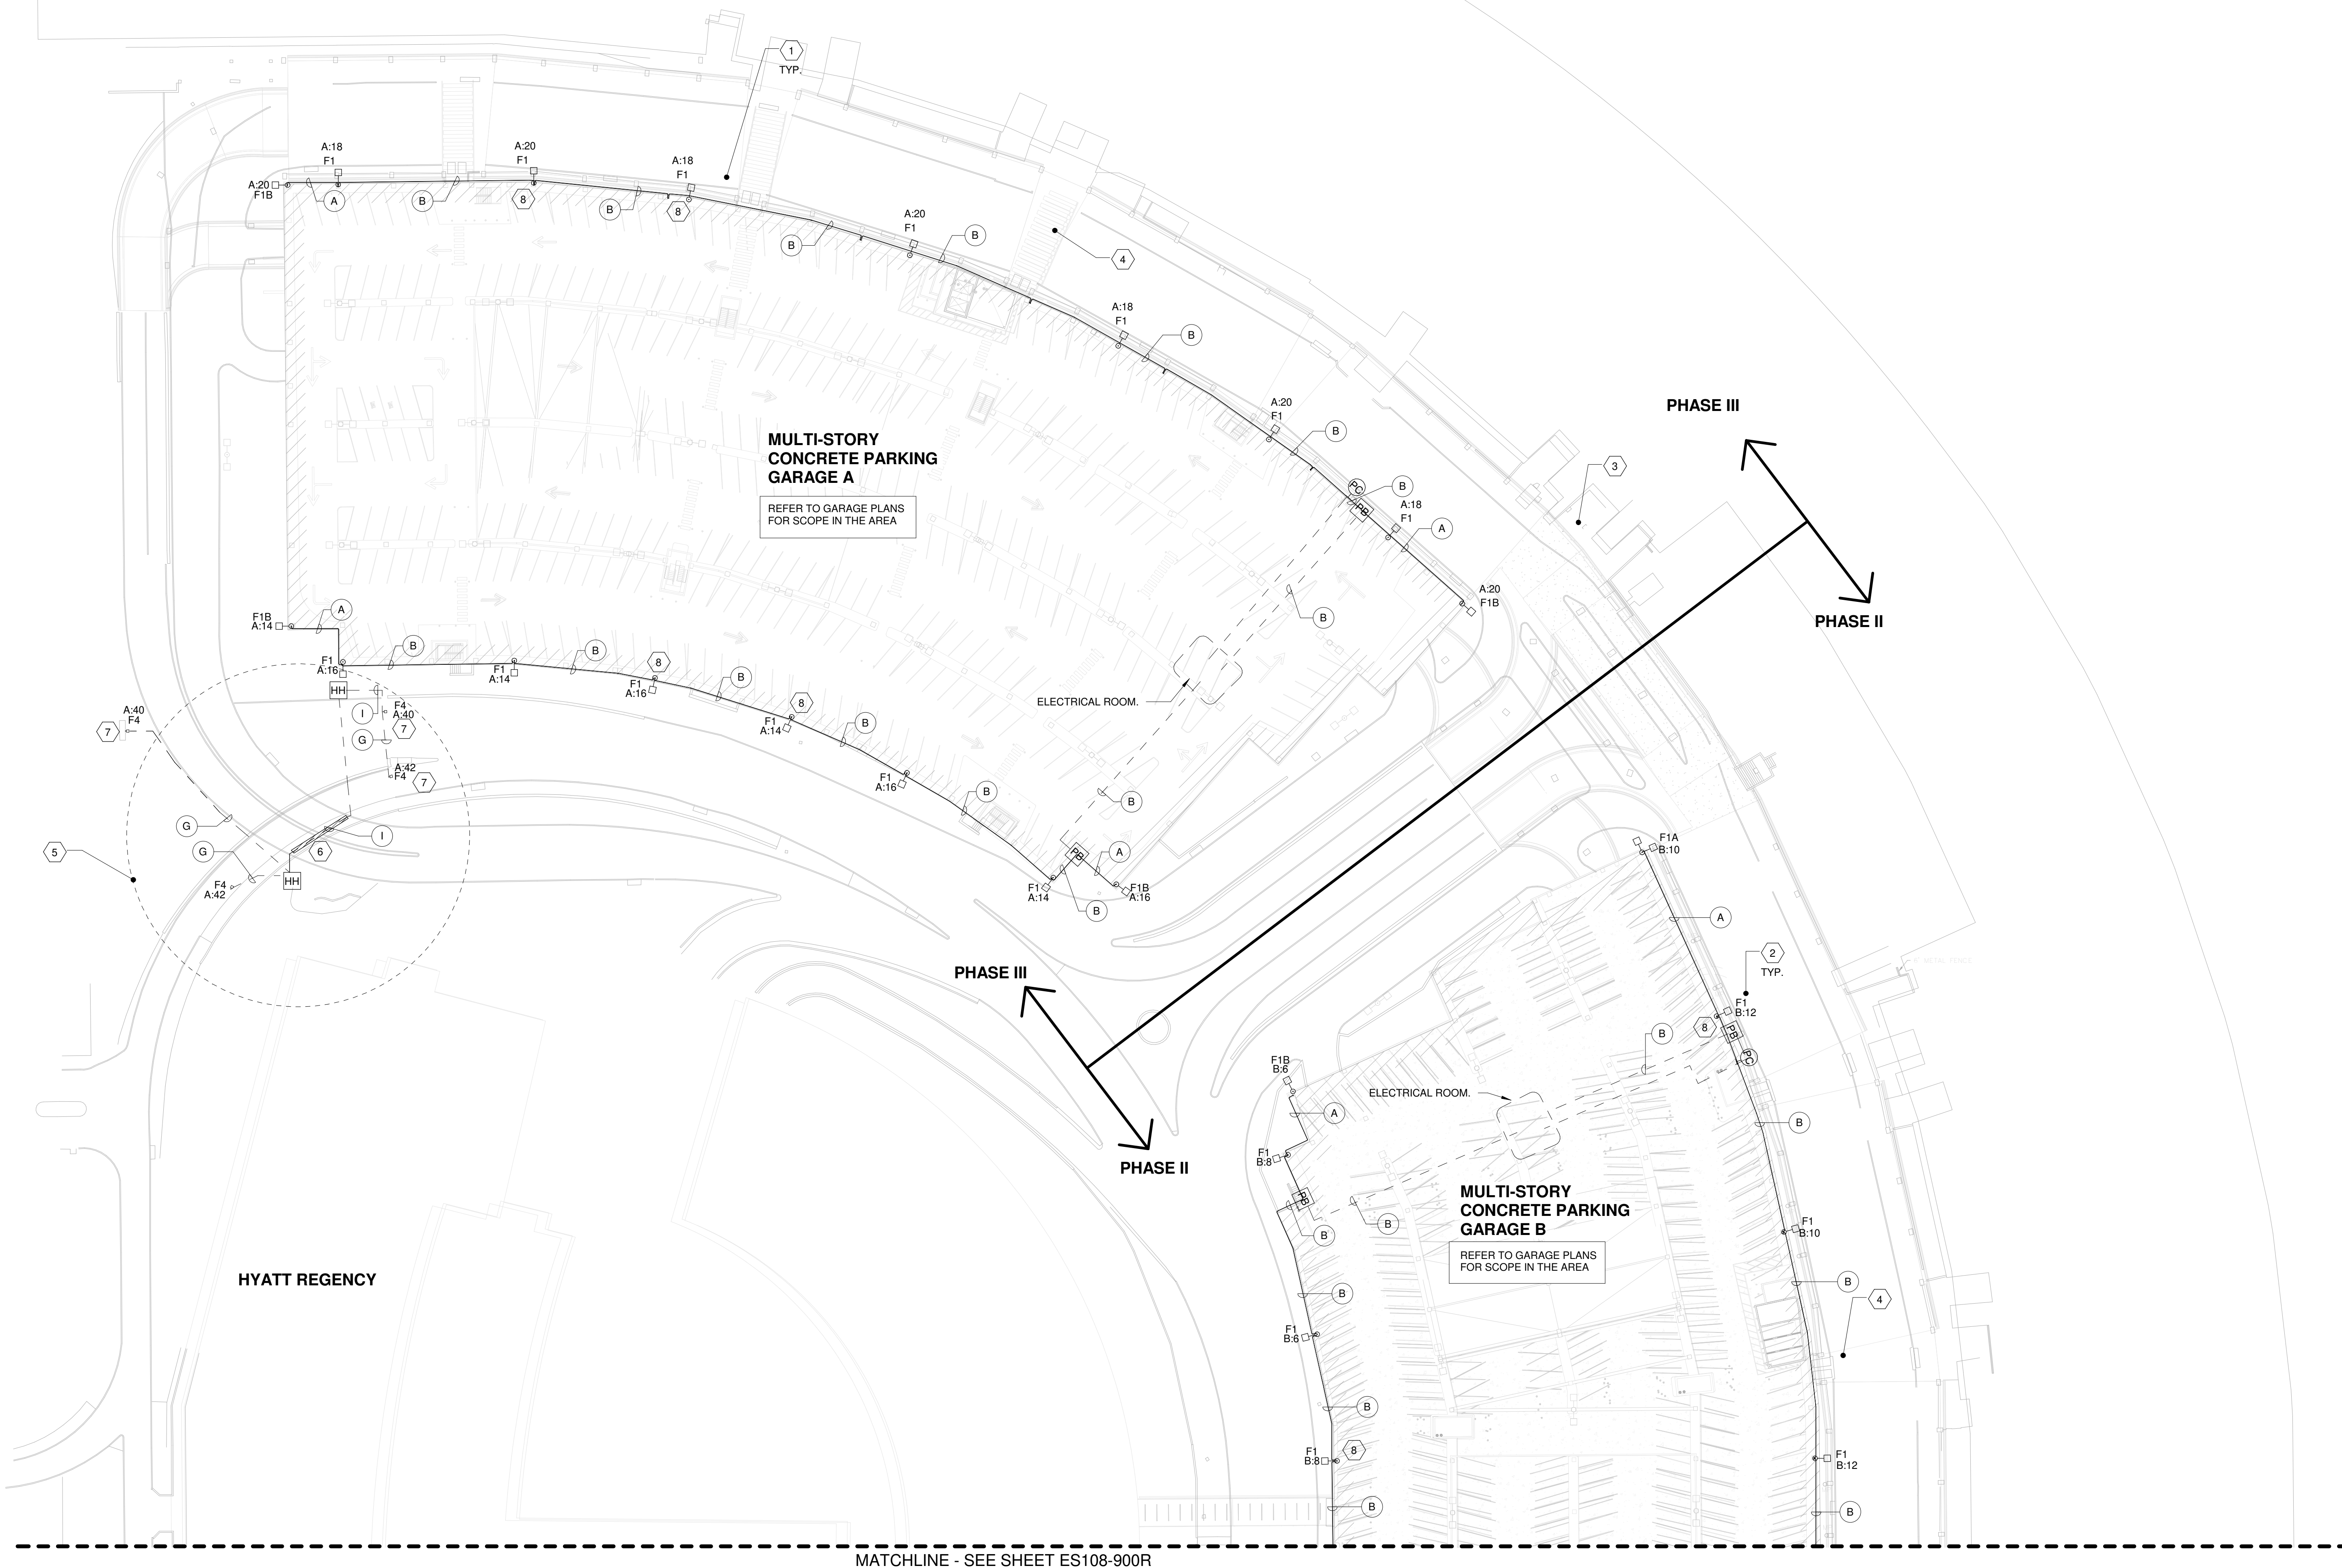

FEEDER SCHEDULE				
TAG	FEEDER SIZE	CONDUIT	MOUNTING	SPARES
A	(2) #10's, #10 GRD	1" C	SURFACE	-
B	(3) #10's, #10 GRD	1" C	SURFACE	-
C	(4) #10's, #10 GRD	1" C	SURFACE	-
D	(5) #10's, #10 GRD	1" C	SURFACE	-
E	(6) #10's, #10 GRD	1" C	SURFACE	-
F	(8) #10's, #10 GRD	1" C	SURFACE	-
G	(2) #6's, #8 GRD	1" C	SURFACE / BELOW GRADE	-
H	(2) #6's, (2) #10's, #8 GRD	1" C	SURFACE / BELOW GRADE	1" C
I	(4) #6's, #8 GRD	1-1/2" C	SURFACE / BELOW GRADE	1-1/2" C

*based on XHHW and RGS

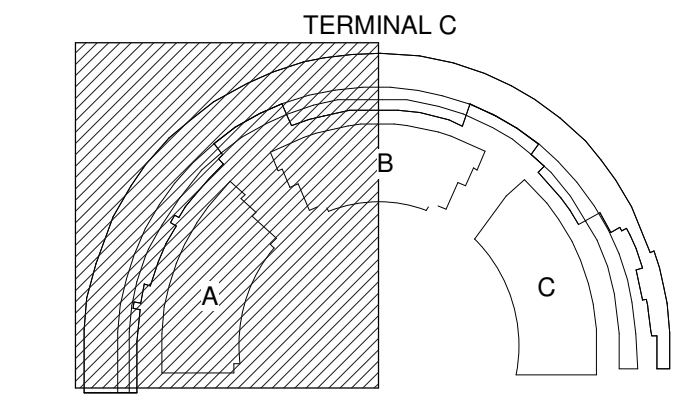

1 UPPER ROADWAY - LIGHTING - NORTH
1" = 40'-0"

MATCHLINE - SEE SHEET ES108-900R

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

PROJECT NUMBER: TFD007

DRAWN BY: BMAY
APPROVED BY: RL/DOS
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-28	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE AND ROADWAYS
LIGHTING NEW WORK - UPPER ROADWAY, NORTH

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0021, B22-0022, B22-0023

SHEET NUMBER
ES107-900R


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

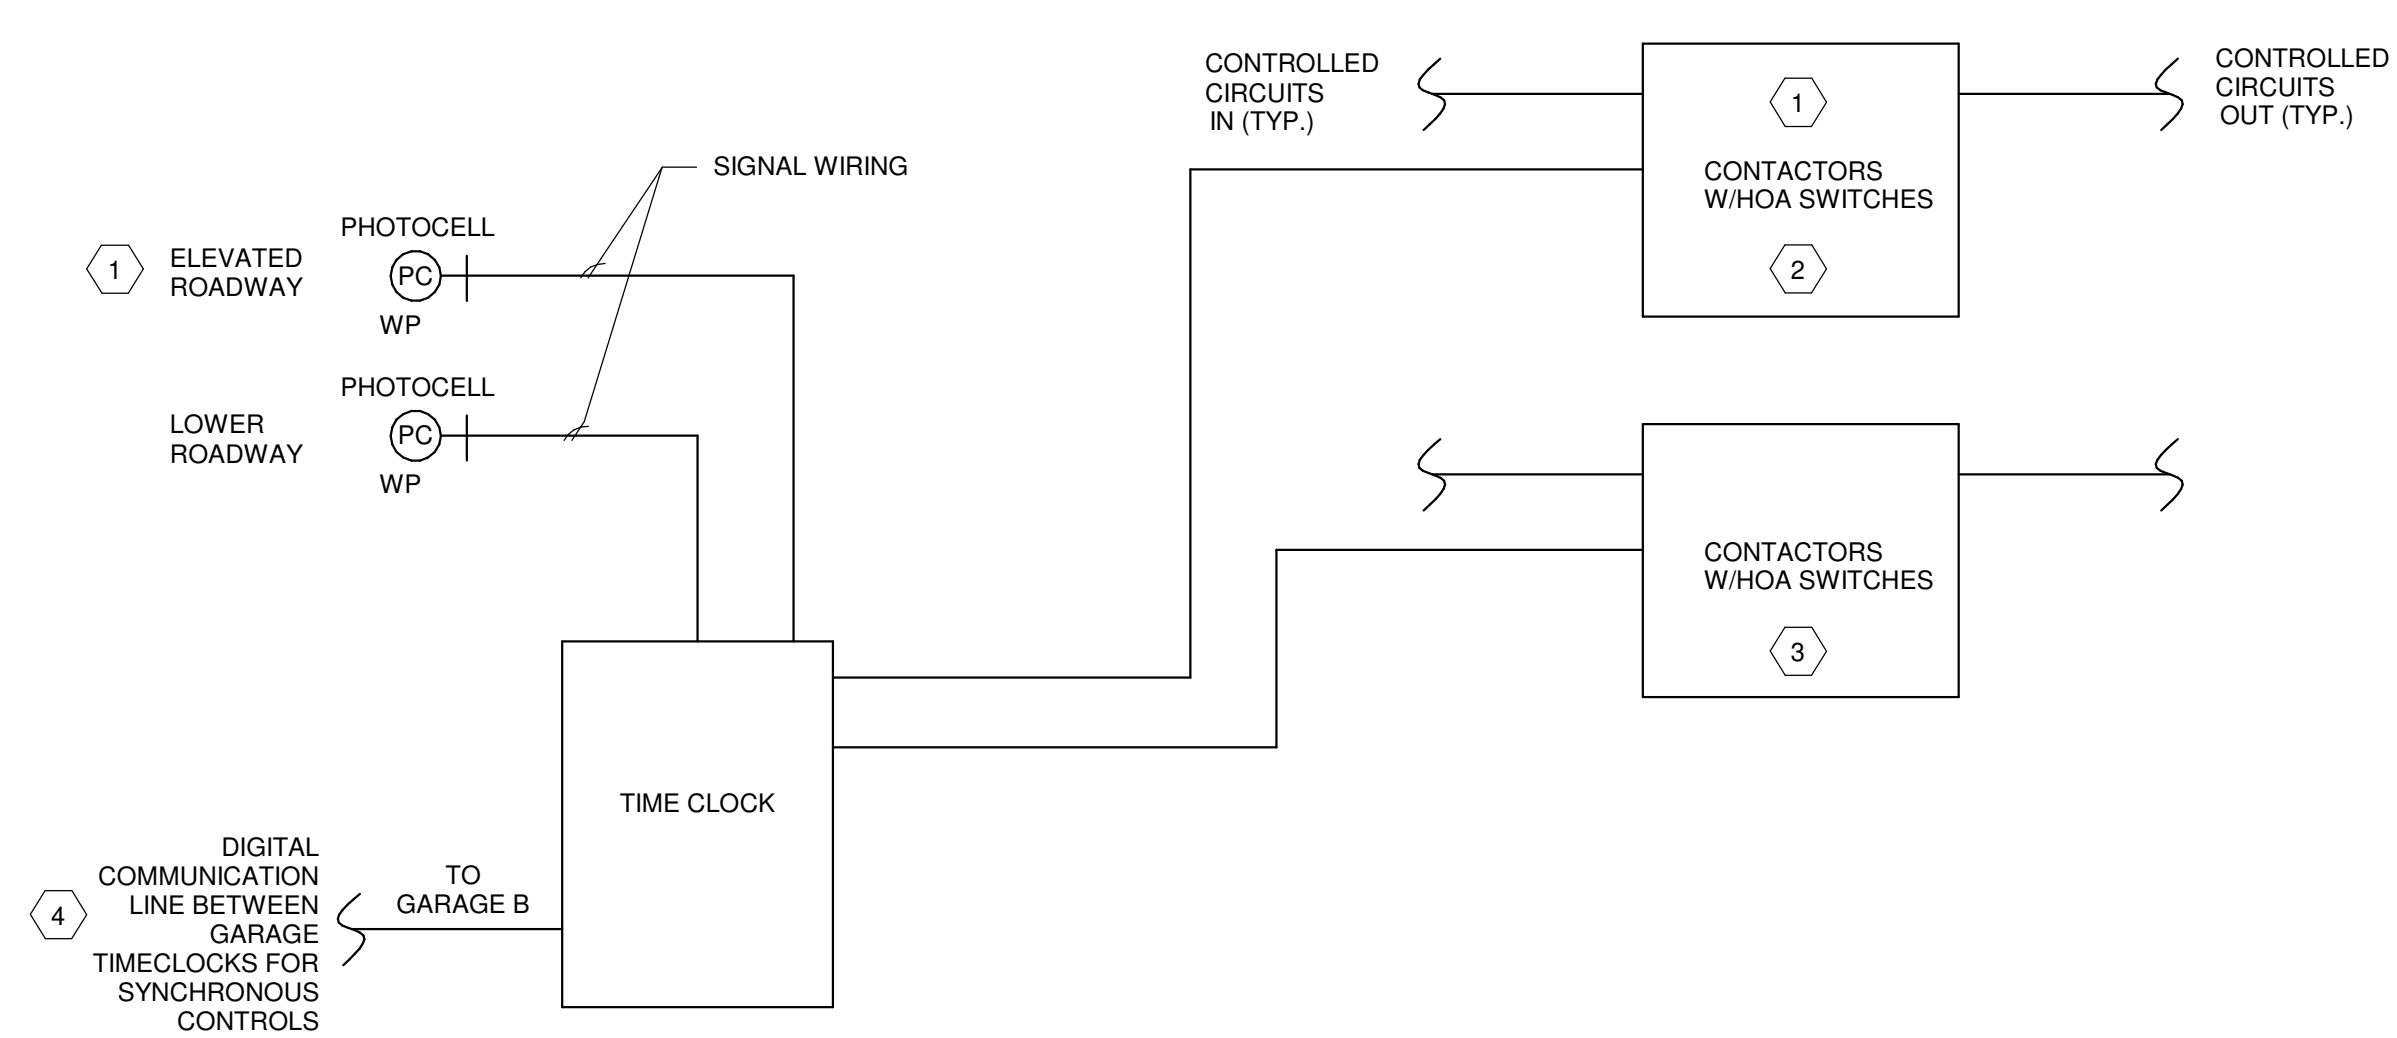

- NOTES:
1. THIS DETAIL IS TYPICAL FOR LIGHTING CONTROLS. ALL CONTROL DEVICES SHALL BE PROGRAMMED TO COMPLY WITH IECC 2015 REQUIREMENTS
 2. TIME CLOCK SHALL INTERFACE WITH PHOTOCELL FOR ON/OFF CONTROL.
 3. TIME CLOCK SHALL BE ELECTRONIC WITH ASTRONOMIC SETTINGS.
 4. TIME CLOCK SHALL HAVE MULTI-CHANNEL CONTROLS.
 5. TIME CLOCK SHALL BE FULLY COMPLIANT WITH ALL IECC 2015 REQUIREMENTS.

- DETAIL KEYED NOTES:
- 1 LOCATED ON ELEVATED ROAWAY LEVEL.
 - 2 CONTACTORS FOR (4) POLES, MINIMUM.
 - 3 PROVIDE (2) SEPARATE CONTACTORS: 1 FOR EM AND 1 FOR NORMAL POWER. EM SHALL BE (4) POLES, MINIMUM. NORMAL SHALL BE (16) POLES, MINIMUM.
 - 4 ROUTE INTERCONNECTION BETWEEN GARAGES ALONG SIDE ELEVATED ROAD. CONTROL SIGNALING SHALL BE IN DEDICATED CONDUIT.


1 LIGHTING CONTROLS RISER DIAGRAM - GARAGE A
NTS

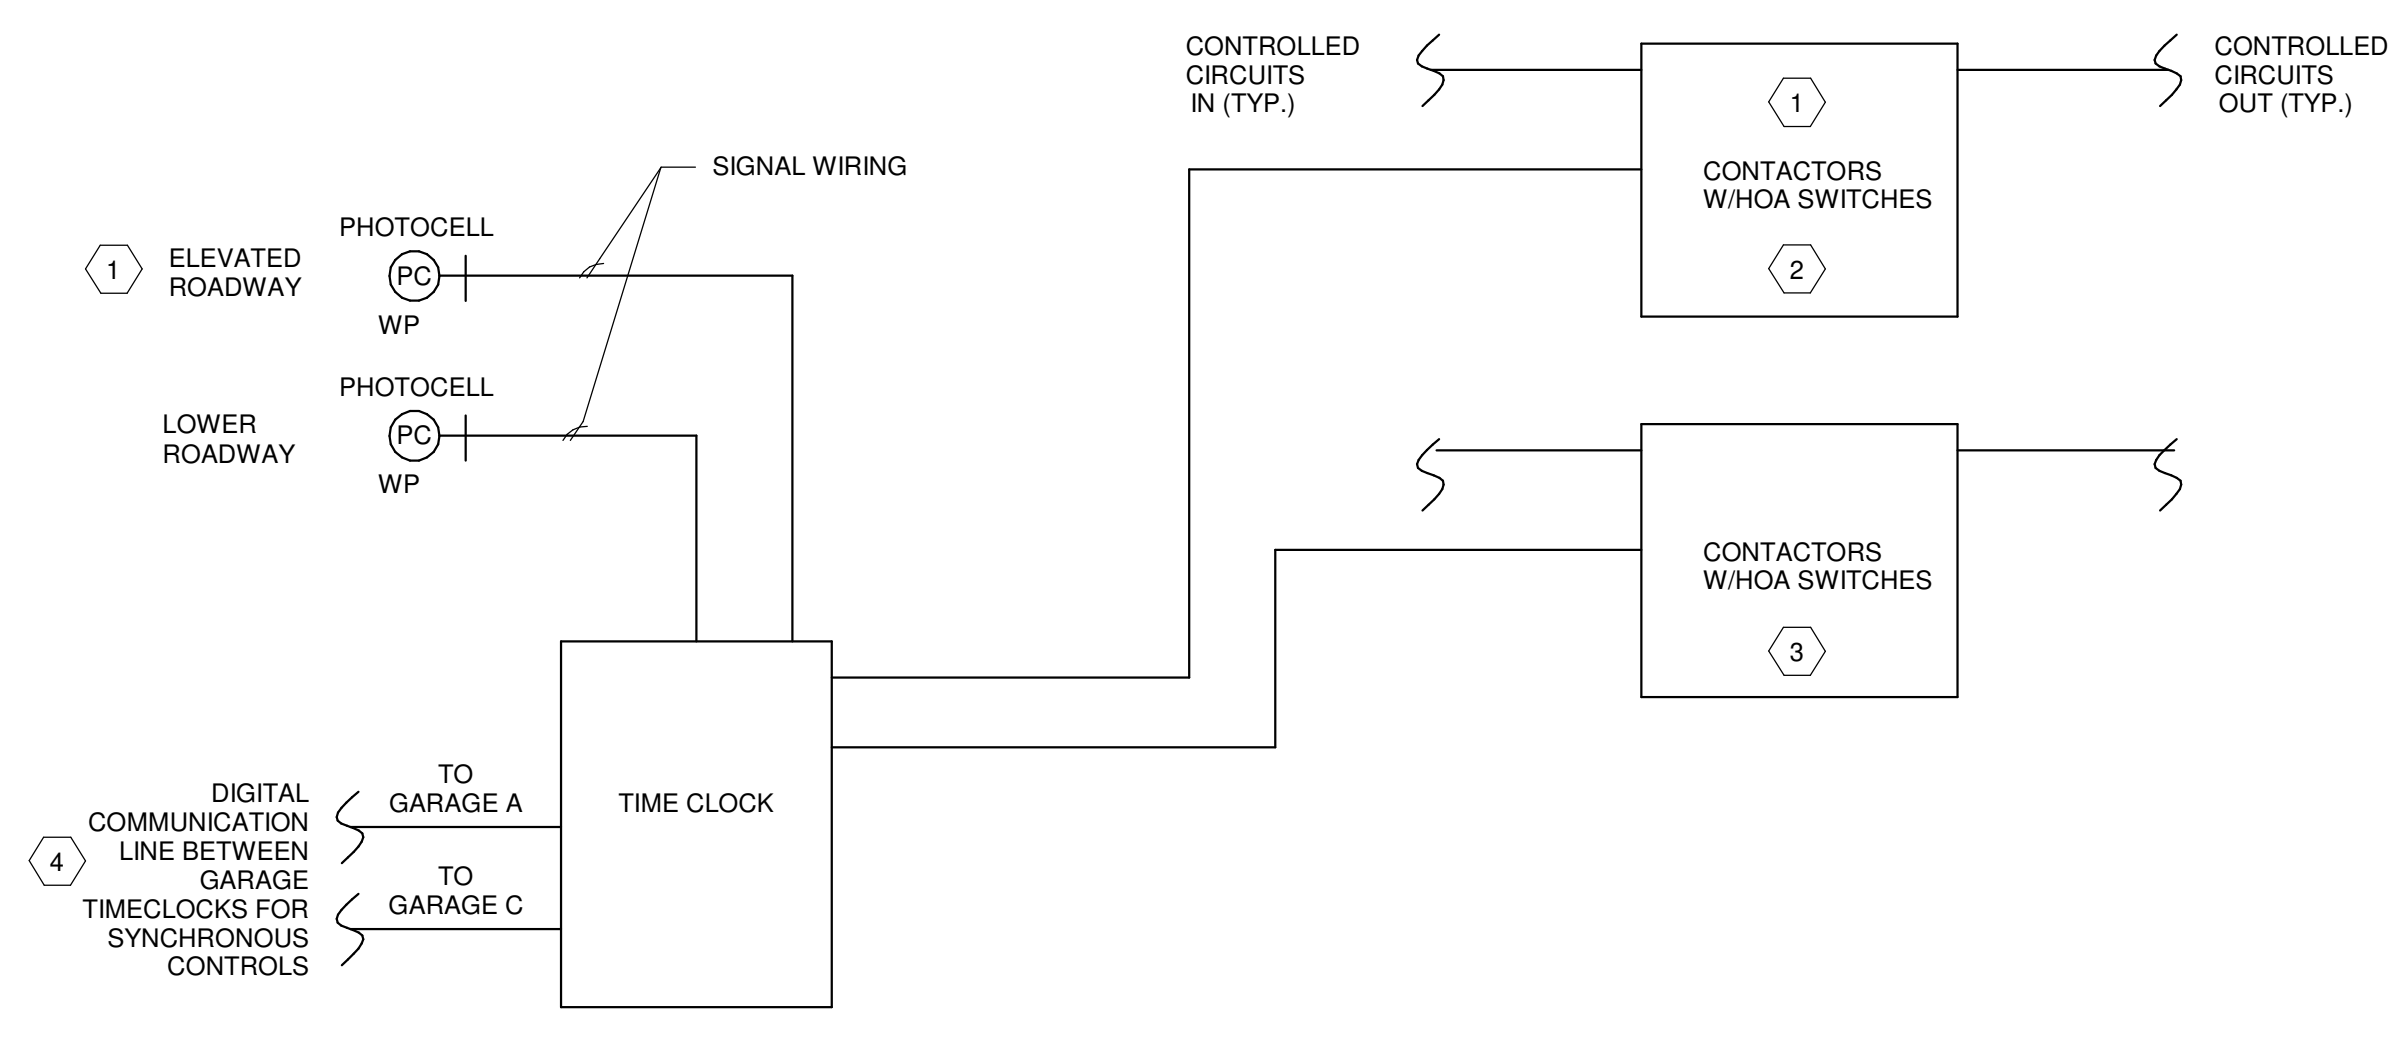

- NOTES:
1. THIS DETAIL IS TYPICAL FOR LIGHTING CONTROLS. ALL CONTROL DEVICES SHALL BE PROGRAMMED TO COMPLY WITH IECC 2015 REQUIREMENTS
 2. TIME CLOCK SHALL INTERFACE WITH PHOTOCELL FOR ON/OFF CONTROL.
 3. TIME CLOCK SHALL BE ELECTRONIC WITH ASTRONOMIC SETTINGS.
 4. TIME CLOCK SHALL HAVE MULTI-CHANNEL CONTROLS.
 5. TIME CLOCK SHALL BE FULLY COMPLIANT WITH ALL IECC 2015 REQUIREMENTS.

- DETAIL KEYED NOTES:
- 1 LOCATED ON ELEVATED ROAWAY LEVEL.
 - 2 CONTACTORS FOR (4) POLES, MINIMUM.
 - 3 PROVIDE (2) SEPARATE CONTACTORS: 1 FOR EM AND 1 FOR NORMAL POWER. EM SHALL BE (4) POLES, MINIMUM. NORMAL SHALL BE (16) POLES, MINIMUM.
 - 4 ROUTE INTERCONNECTION BETWEEN GARAGES ALONG SIDE ELEVATED ROAD. CONTROL SIGNALING SHALL BE IN DEDICATED CONDUIT.


2 LIGHTING CONTROLS RISER DIAGRAM - GARAGE B
NTS

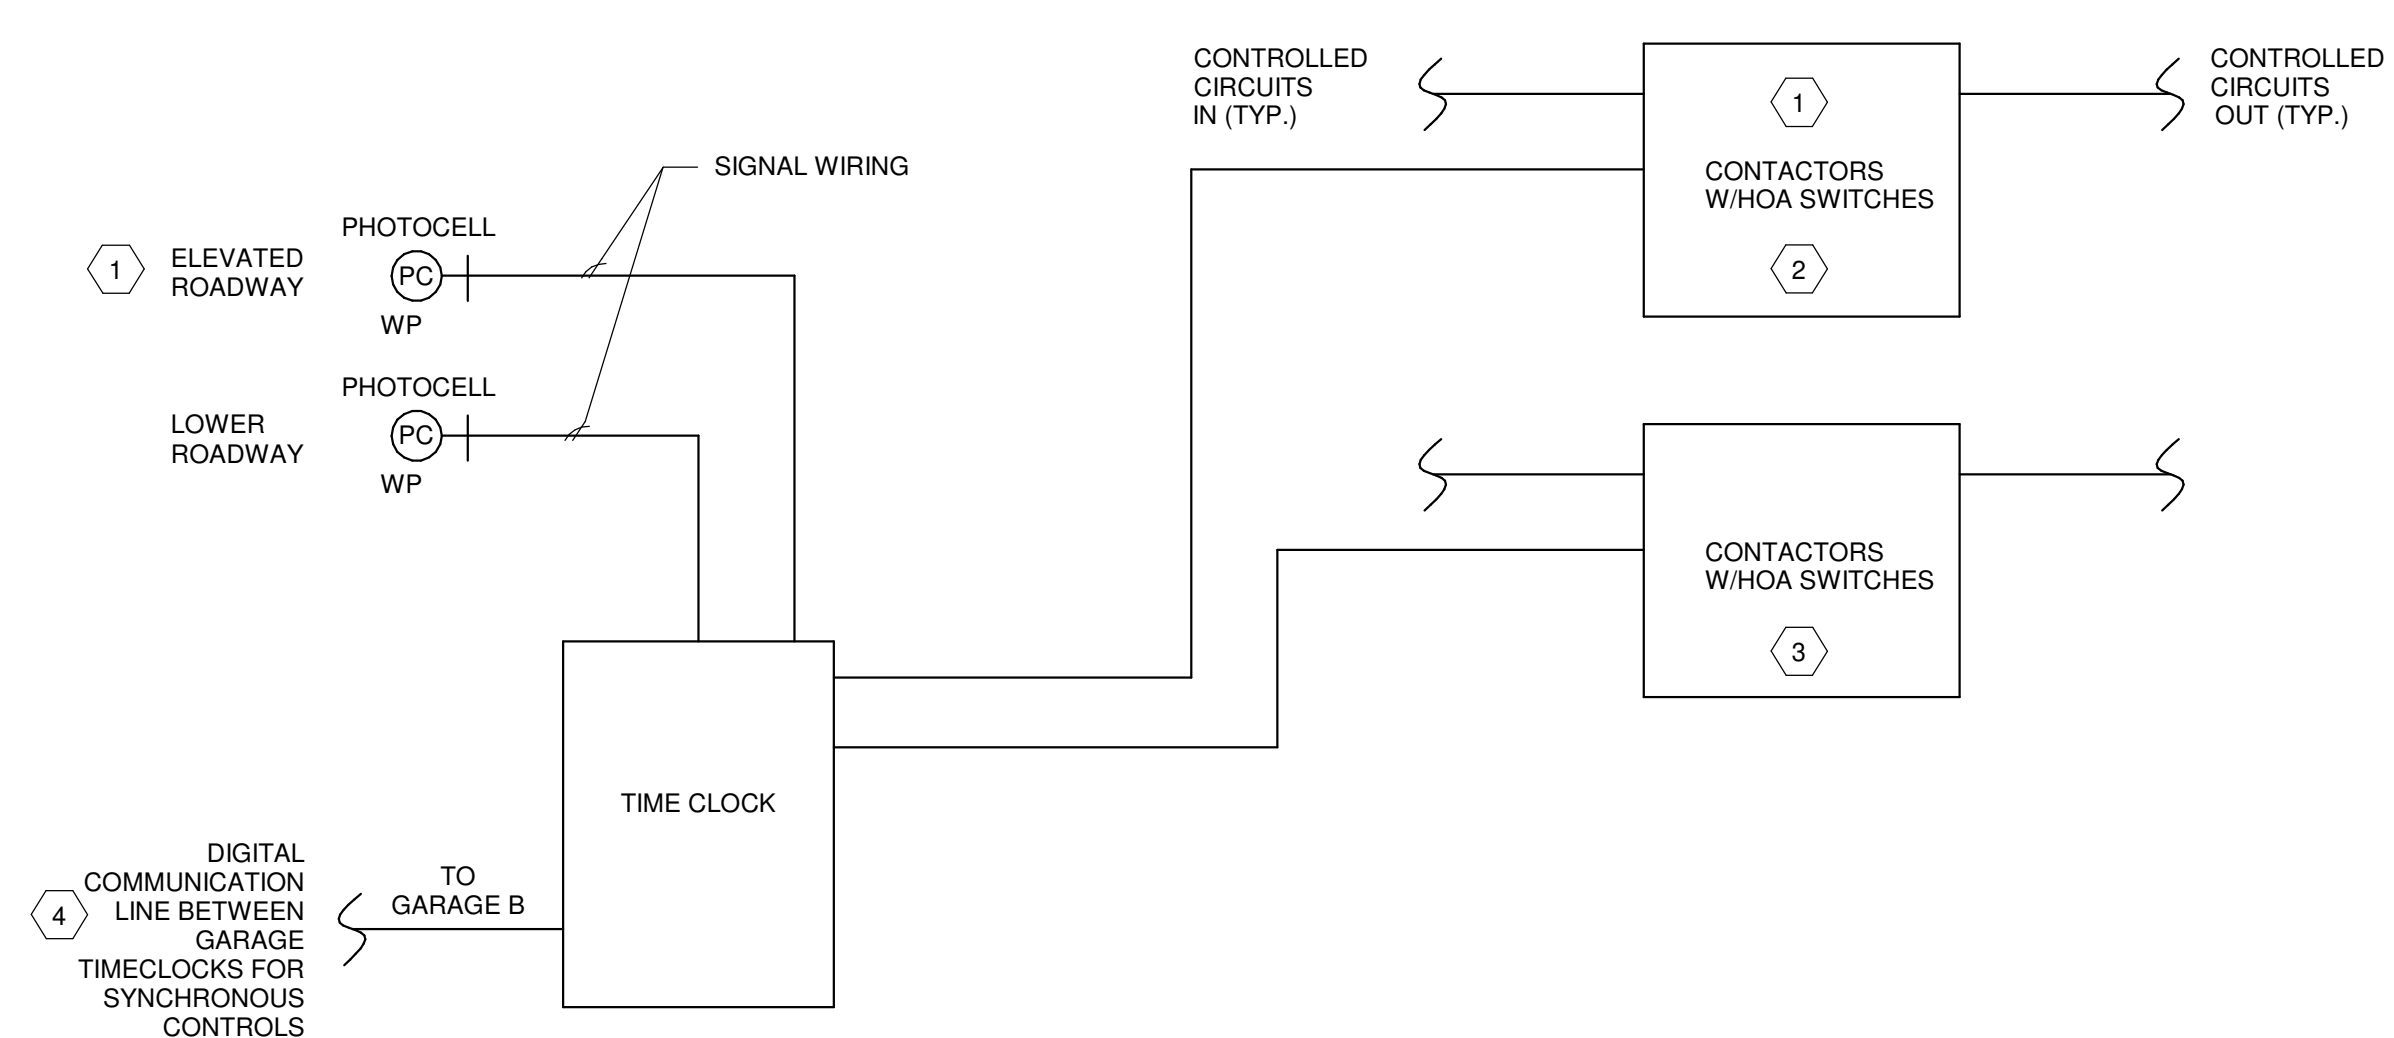

- NOTES:
1. THIS DETAIL IS TYPICAL FOR LIGHTING CONTROLS. ALL CONTROL DEVICES SHALL BE PROGRAMMED TO COMPLY WITH IECC 2015 REQUIREMENTS
 2. TIME CLOCK SHALL INTERFACE WITH PHOTOCELL FOR ON/OFF CONTROL.
 3. TIME CLOCK SHALL BE ELECTRONIC WITH ASTRONOMIC SETTINGS.
 4. TIME CLOCK SHALL HAVE MULTI-CHANNEL CONTROLS.
 5. TIME CLOCK SHALL BE FULLY COMPLIANT WITH ALL IECC 2015 REQUIREMENTS.

- DETAIL KEYED NOTES:
- 1 LOCATED ON ELEVATED ROAWAY LEVEL.
 - 2 CONTACTORS FOR (4) POLES, MINIMUM.
 - 3 PROVIDE (2) SEPARATE CONTACTORS: 1 FOR EM AND 1 FOR NORMAL POWER. EM SHALL BE (4) POLES, MINIMUM. NORMAL SHALL BE (16) POLES, MINIMUM.
 - 4 ROUTE INTERCONNECTION BETWEEN GARAGES ALONG SIDE ELEVATED ROAD. CONTROL SIGNALING SHALL BE IN DEDICATED CONDUIT.

3 LIGHTING CONTROLS RISER DIAGRAM - GARAGE C
NTS

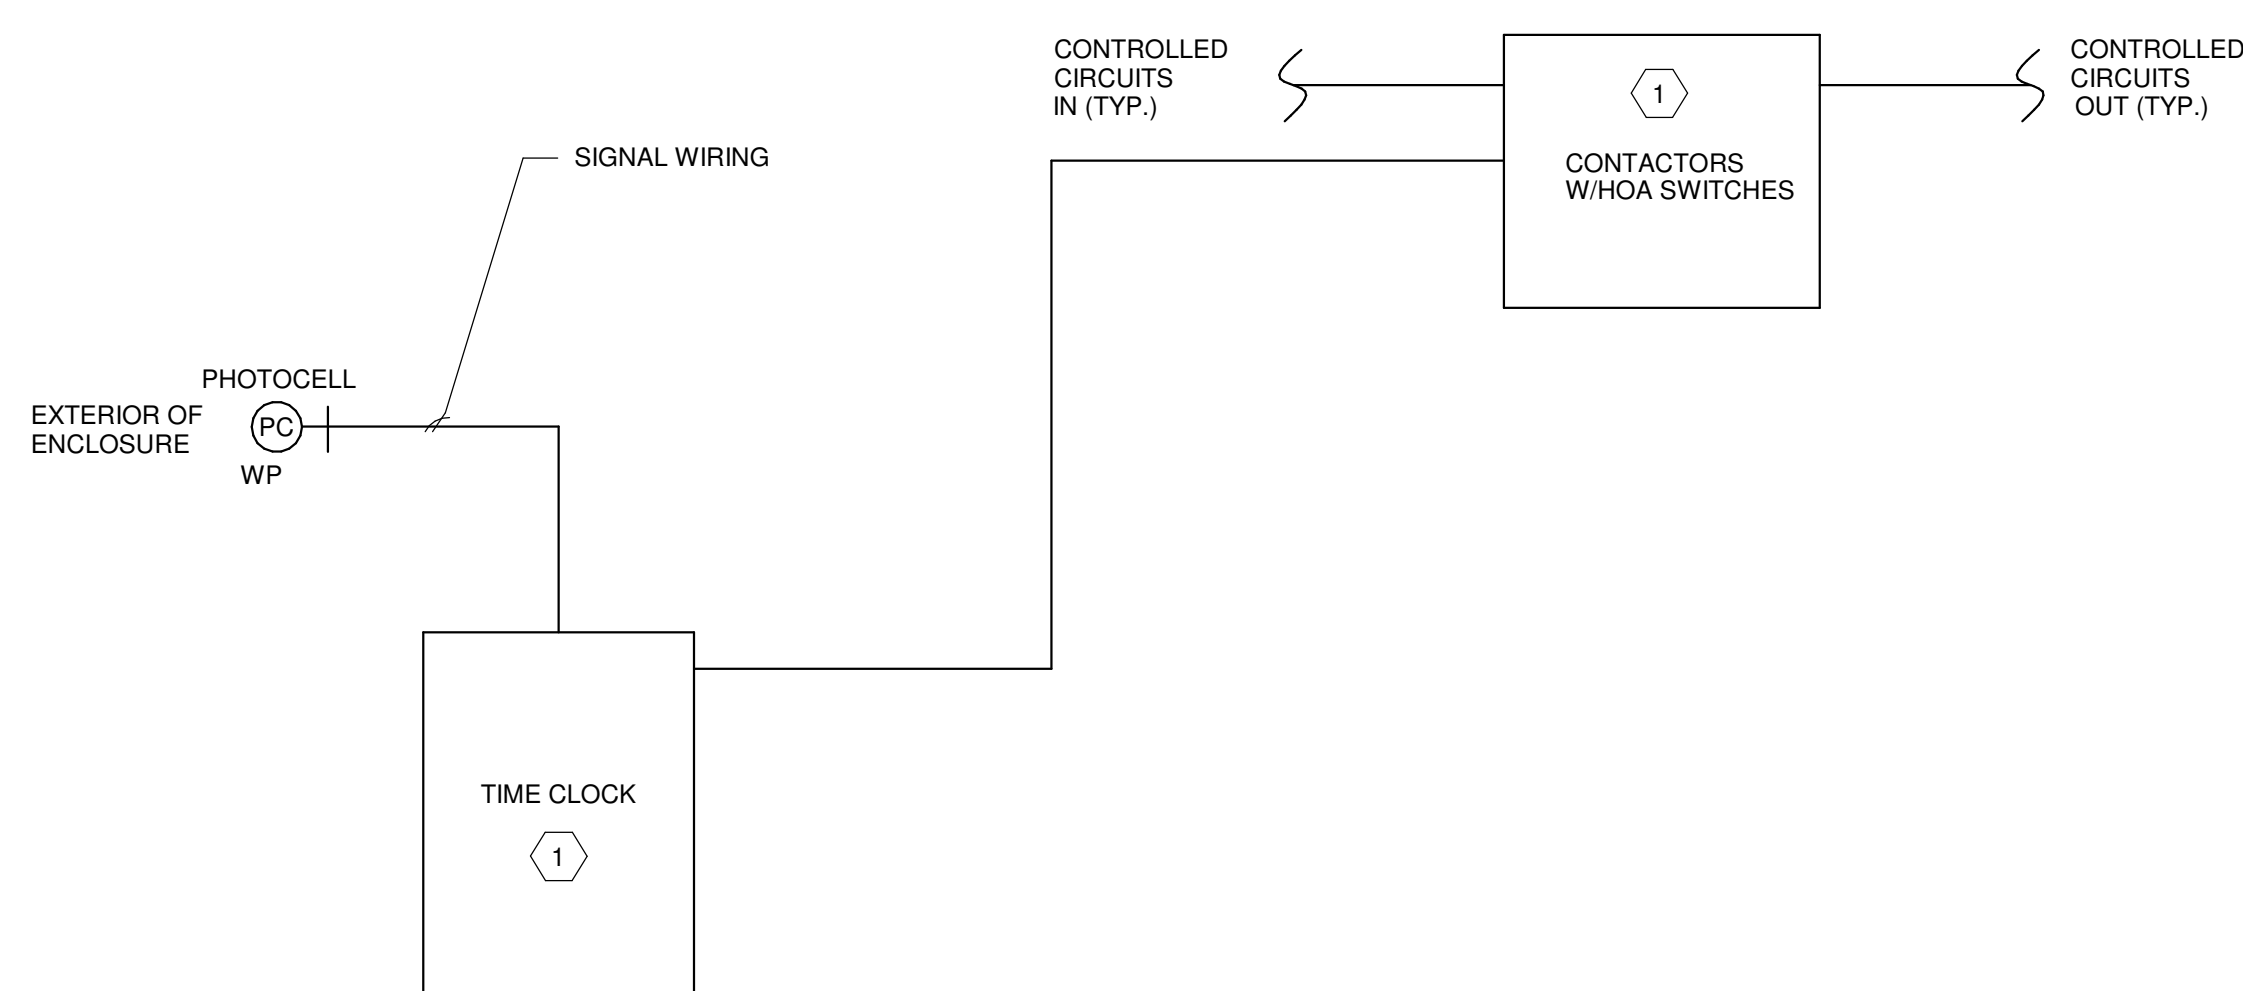

- NOTES:
1. THIS DETAIL IS TYPICAL FOR LIGHTING CONTROLS. ALL CONTROL DEVICES SHALL BE PROGRAMMED TO COMPLY WITH IECC 2015 REQUIREMENTS
 2. TIME CLOCK SHALL INTERFACE WITH PHOTOCELL FOR ON/OFF CONTROL.
 3. TIME CLOCK SHALL BE ELECTRONIC WITH ASTRONOMIC SETTINGS.
 4. TIME CLOCK SHALL HAVE MULTI-CHANNEL CONTROLS.
 5. TIME CLOCK SHALL BE FULLY COMPLIANT WITH ALL IECC 2015 REQUIREMENTS.

- DETAIL KEYED NOTES:
- 1 LOCATED NEAR PANEL LP-1A IN ENCLOSURE A/B & NEAR LP-1C IN ENCLOSURE C.

4 LIGHTING CONTROLS RISER DIAGRAM - ENCLOSURE EXTERIOR
NTS


NO.	DATE	DESCRIPTION
2021-10-29	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

LUMINAIRE SCHEDULE														
TAG	DESCRIPTION	MANUFACTURER	MODEL	DRIVER TYPE	LAMP TYPE	CCT	MIN. CRI	VOLTAGE	FIXTURE WATTS	DELIVERED LUMENS	BUG RATING	MOUNTING	FINISH	REMARKS
F1	COBRA HEAD ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE (GARAGES A,B) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-R2S-UNV POLE: 21' ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161	19,092	B3-U0-G2	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH
F1A	COBRA DUAL-HEADED ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE (GARAGE A,B) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-4-UNV (FACING RAMPS) ROADFOCUS RFM-160W48LED-3K-G2-4-UNV (FACING RAMPS) POLE: 21' ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, VALMONT, 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161 EACH HEAD	19,092 18,187	B3-U0-G2 B3-U0-G3	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH.
F1B	COBRA HEAD ROADWAY LUMINAIRE MOUNTED ON CUSTOM POLE FACING RAMPS (GARAGE A,B) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-4-UNV POLE: 21' ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, VALMONT, 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161	18,187	B3-U0-G3	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH
F2	NOT USED	--	--											
F3	COBRA HEAD ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE (GARAGE C) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-R2S-UNV POLE: 9'-0" ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, VALMONT 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161	19,092	B3-U0-G2	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH
F3A	COBRA DUAL-HEADED ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE (GARAGE C) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-R2S-UNV POLE: 9'-0" ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, VALMONT, 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161 EACH HEAD	19,092	B3-U0-G2	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH
F3B	COBRA HEAD ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE FACING RAMPS (GARAGE C) UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	ROADFOCUS RFM-160W48LED-3K-G2-4-UNV POLE: 9'-0" ROUND, TAPERED STEEL POLE, VALMONT DS90, DESIGNATION #xxxx POLE ARM: 6' ROUND, TAPERED STEEL, 5 YR WARRANTY	INTEGRAL	LED ARRAY	3000K	70	UNIVERSAL	161	18,187	B3-U0-G3	POLE	GALVANIZED, SILVER	FIXTURE SHALL BE 50' ABOVE ROADWAY. POLE HEIGHT SHALL VARY BASED ON GARAGE ELEVATION. SEE NOTE #9 AND #10. FINISH/COLOR PER ARCHITECT. 5 YR WARRANTY POLE FINISH.
F4	LED WALLPACK, DIE-CAST ALUMINUM, GLASS LENS, SURFACE MOUNTED, HIGH-TEMPERATURE SILICONE GASKETS, 70 CRI, 15,000 LUMENS UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	RAB LIGHTING OR ENGINEER APPROVED EQUAL	WP3LED-150L-750-W-U	INTEGRAL	LED	4000K	73	UNIVERSAL	110	15,150			SURFACE WALL	
F5	SIGNAGE COMPACT LED FLOOD LIGHT, 80 DEGREE WIDE FLOOD 7x7 DISTRIBUTION, 12,000 LUMENS, *ARM MOUNT UL WET LOCATION AND EXTERIOR RATED	GE CURRENT OR ENGINEER APPROVED EQUAL	EVOLVE EFC101-0-12-77-7-30-X-X-XX	INTEGRAL	LED	3000K	70	UNIVERSAL	88	11,500			SURFACE	*RE-USE EXISTING ARM MOUNT
F6	4' INDUSTRIAL LED LINEAR STRIP, VAPORPROOF UL WET LOCATION AND EXTERIOR RATED, DLC LISTED	SIGNIFY OR ENGINEER APPROVED EQUAL	VAPORLUME LED V3W-435L-830-UNV	INTEGRAL	LED	3000K	80	UNIVERSAL	25	3,500			SURFACE	
F7	IN-GRADE HIGH OUTPUT LED FLOOD LIGHT, NARROW SPOT DISTRIBUTION, INTERNALLY ADJUSTABLE AIMING, WITH LOCKABILITY PROVIDE WITH DOUBLE LENS AND GLARE SHIELDS, UL WET LOCATION AND EXTERIOR RATED, IP 68, DLC LISTED	HYDREL OR ENGINEER APPROVED EQUAL	M9720C-A-LED-P3-30K-MVOLT-NSP-FLC-XX-GS-XX-DNA	INTEGRAL	LED	3000K	80	UNIVERSAL	50	5,100			GROUND	FOR FLAG POLE UPLIGHTING, AIM IN FIELD WITH ARCHITECT OR LIGHTING DESIGNER.
F8	ROUND LED DOWNLIGHT RETROFIT, WET LOCATION UL WET LOCATION AND EXTERIOR RATED	ACUITY OR ENGINEER APPROVED EQUAL	LRT6 SERIES OR LRT8 SERIES	INTEGRAL	LED	3000K		UNIVERSAL	75				RECESSED CEILING	CONTRACTOR TO CONFIRM SIZE IN FIELD. CONTRACTOR TO VERIFY AND PROVIDE COMPATIBLE RETROFIT KIT.
E	EXISTING FIXTURE LED WALLPACK, DIE-CAST ALUMINUM, GLASS LENS, SURFACE MOUNTED, HIGH-TEMPERATURE SILICONE GASKETS, 70 CRI, 15,000 LUMENS UL WET LOCATION AND EXTERIOR RATED	RAB LIGHTING OR ENGINEER APPROVED EQUAL	EXISTING FIXTURE WP3LED-110W	INTEGRAL	LED	4000K		UNIVERSAL	110				SURFACE WALL	
E2	EXISTING FIXTURE AND POLE 40' COBRA DUAL-HEADED ROADWAY LUMINAIRE, MOUNTED ON CUSTOM POLE UL WET LOCATION AND EXTERIOR RATED	SIGNIFY LUMEC OR ENGINEER APPROVED EQUAL	EXISTING FIXTURE AND POLE ROADFOCUS RFM-160W48LED-4K-G2-R2M-UNV	INTEGRAL	LED ARRAY	3000K		UNIVERSAL	165 EACH HEAD				POLE	
EX1	LED, EDGE-LIT STYLE RED-LETTERS ON WHITE BACKGROUND EXIT SIGN WITH INTEGRAL BATTERY BACKUP AND SELF-TEST/DIAGNOSTIC FEATURES	DUAL-LITE OR ENGINEER APPROVED EQUAL	LES-W-S-R-X-W-E-I-W		LED								SURFACE WALL	
EBU	UNIT BATTERY PACK WITH (2) INTEGRAL ADJUSTABLE OPTICS HEADS, 300 LUMENS EACH, INTEGRAL TEST SWITCH/INDICATOR LAMP, SELF-DIAGNOSTIC TESTING AND MINIMUM 4-HOUR OUTPUT, MUST SUPPORT REMOTE HEAD	SURE-LITES OR ENGINEER APPROVED EQUAL	MAIN UNIT: SELM50R14SD REMOTE HEAD: APWR-2		LED			UNIVERSAL	1.7	300 EACH HEAD			SURFACE WALL	PROVIDE REMOTE HEADS AS INDICATED ON PLANS

- NOTES:
- REFER TO SPECIFICATIONS FOR ADDITIONAL LIGHTING FIXTURE REQUIREMENTS.
 - NOT USED
 - ALL DIMENSIONS LISTED ABOVE ARE NOMINAL SIZES. SLIGHT VARIATIONS IN SHAPE OR SIZE WILL BE CONSIDERED BASED ON THE PROJECT REQUIREMENTS.
 - NOT USED
 - NOT USED
 - MOD USED WITHIN ANY CATALOG NUMBER IDENTIFIES AN OPTION NOT LISTED ON A STANDARD CUTSHEET. REFER TO DEFINITION WITHIN FIXTURE DESCRIPTION AND CATALOG NUMBER COLUMN FOR FIXTURE MODIFICATION REQUIREMENTS.
 - ALL FIXTURES SHALL BE UL LISTED. ALL DAMP AND WET LOCATION UL REQUIREMENTS ARE LISTED IN THE FIXTURE DESCRIPTION.
 - WHERE DIMMING OR INTEGRAL FIXTURE CONTROLS ARE SPECIFIED, COMPATIBILITY OF FIXTURE AND CONTROLS, COMPONANETS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO ORDERING OF EITHER SYSTEM.
 - COORDINATE BOLT PATTERNS WITH EXISTING STRUCTURAL TIE-INS. MODIFICATIONS MAY BE REQUIRED.
 - MANUFACTURER SHALL PROVIDE POLE DIAMETER, THICKNESS, HEIGHT AND MIN. YIELD STRENGTH BASED ON POLE HEIGHT, EPA AND WIND LOADS. PROVIDE CALCULATION AND POLE SPECS VIA SHOP DRAWINGS FOR ENGINEER AND LIGHTING DESIGNER REVIEW.



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

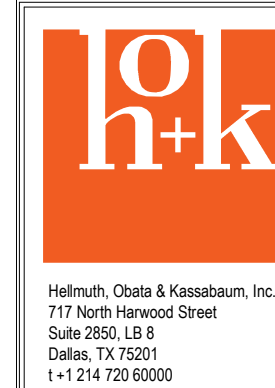

Primera

Joseph Michael Avram
127346
Dallas, TX 75201
1-214-728-6000

Primera Engineers, LLC
3000 East
Suite 214
Coppell, TX 75011
1-972-999-9910

PROJECT NUMBER: TFD007

DRAWN BY: BMAY
APPROVED BY: RL/OS
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-29	30% DESIGN	
2022-01-06	70% DESIGN	
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007

TERMINAL C GARAGE AND ROADWAYS
ELECTRICAL SCHEDULES

PERMIT NUMBER: A21-188B, B22-0021, B22-0022, B22-0023

SHEET NUMBER

ES604-900R

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

LIGHTING CONTACTOR SCHEDULE							
TAG	CONTROLLED CIRCUITS	NUMBER OF POLES	AREA CONTROLLED	CONTROL GROUP	VOLTAGE	CIRCUITS ARE FED FROM	REMARKS
LC-01	14,16,18,20	8	ELEVATED ROAD - GARAGE A	R-E	277V	A-1BH1	
LC-02	10,12	8	ELEVATED ROAD - GARAGE B	R-E	277V	B-1BH1	
LC-03	18,20	8	ELEVATED ROAD - GARAGE C	R-E	277V	C-1BH1	
LC-04	26,28,30,32	4	LOWER ROADWAY - A	R-U	277V	A-1BH1	
LC-05	14,16,18,20	4	LOWER ROADWAY - B	R-U	277V	B-1BH1	
LC-06	26,28,30,32	4	LOWER ROADWAY - C	R-U	277V	C-1BH1	
LC-07	1,2	4	EM LIGHTING - A	R-U	277V	INVAB	
LC-08	1,2	4	EM LIGHTING - B	R-U	277V	INVCB	
LC-09	1,2	4	EM LIGHTING - C	R-U	277V	INVCB	
LC-10	40,42	10	CAROUSEL ROADWAY - A	R-C	277V	A-1BH1	
LC-11	6,8	4	CAROUSEL ROADWAY - B	R-C	277V	B-1BH1	
LC-12	14,16	4	CAROUSEL ROADWAY - C	R-C	277V	C-1BH1	
LC-13	2	2	FLAG LIGHTS	F	277V	B-1BH1	
LC-14	38	2	ROAD SIGNAGE - A	R-S	277V	A-1BH1	
LC-15	30,32	2	ROAD SIGNAGE - B	R-S	277V	B-1BH1	
LC-16	38	2	ROAD SIGNAGE - C	R-S	277V	C-1BH1	

*LETTERS CORRESPOND TO DIFFERENT CONTROL GROUPS**, DESIGNATED AS FOLLOWS:

R-E ROADWAY - ELEVATED
R-U ROADWAY - UNDERPASS
R-C ROADWAY - CAROUSEL
F FLAG POLES
R-S ROADWAY - SIGNAGE

**GROUPS SUBJECT TO CHANGE PER OWNER'S REQUIREMENTS

LIGHTING CONTROLS SUMMARY												
AREA	ZONE NAME	FUNCTION DESCRIPTION	DIMMING INTEGRAL TO FIXTURE	PHOTO CELL	DIMMING AS PART OF CONTROL SYSTEM	LOCAL MANUAL SWITCHING	MASTER SWITCH	MASTER SWITCH OVERRIDE	TIME SWEEP ON/OFF		GROUP TAG	
									YES-NO	GROUP TAG		
ELEVATED ROADWAY												
GARAGE A	ELEVATED ROADWAY - A	ORIENTATION / SECURITY		X			HOA		YES		R-E	
GARAGE B	ELEVATED ROADWAY - B	ORIENTATION / SECURITY		X			HOA		YES		R-E	
GARAGE C	ELEVATED ROADWAY - C	ORIENTATION / SECURITY		X			HOA		YES		R-E	
GARAGE A	INTERCONNECTING RAMP - A	ORIENTATION / SECURITY		X			HOA		YES		R-E	
GARAGE B	INTERCONNECTING RAMP - B	ORIENTATION / SECURITY		X			HOA		YES		R-E	
GARAGE C	INTERCONNECTING RAMP - C	ORIENTATION / SECURITY		X			HOA		YES		R-E	
LOWER ROADWAY												
GARAGE A	LOWER ROADWAY - A	ORIENTATION / SECURITY		X			HOA		YES		R-U	
GARAGE B	LOWER ROADWAY - B	ORIENTATION / SECURITY		X			HOA		YES		R-U	
GARAGE C	LOWER ROADWAY - C	ORIENTATION / SECURITY		X			HOA		YES		R-U	
GARAGE A	LOWER ROADWAY EM - A	EGRESS					HOA		NO		R-U	
GARAGE B	LOWER ROADWAY EM - B	EGRESS					HOA		NO		R-U	
GARAGE C	LOWER ROADWAY EM - C	EGRESS					HOA		NO		R-U	
CAROUSEL ROADWAY												
GARAGE A	CAROUSEL ROADWAY - A	ORIENTATION / SECURITY		X			HOA		YES		R-C	
GARAGE B	CAROUSEL ROADWAY - B	ORIENTATION / SECURITY		X			HOA		YES		R-C	
GARAGE C	CAROUSEL ROADWAY - C	ORIENTATION / SECURITY		X			HOA		YES		R-C	
GARAGE B	FLAG LIGHTS	DECORATIVE		X			HOA		YES		F	
GARAGE A	OVERPASS DOWNLIGHTS	ORIENTATION / SECURITY		X			HOA		YES		R-C	
GARAGE A	ROAD SIGNAGE - A	ORIENTATION		X			HOA		YES		R-S	
GARAGE B	ROAD SIGNAGE - B	ORIENTATION		X			HOA		YES		R-S	
GARAGE C	ROAD SIGNAGE - C	ORIENTATION		X			HOA		YES		R-S	

NOTES:
1. LOCAL HOA SWITCHES SHALL CONTROL ALL CIRCUITS AS INDICATED BY THIS SCHEDULE AND CIRCUITING SHOWN ON PLANS.
2. THERE SHALL BE A REGULAR-USE TIME OF DAY SCHEDULE. TIMER = TIME CLOCK
3. SECURITY EXTERIOR LIGHTING SHALL BE ON AT FULL THROUGHOUT THE NIGHT. DECORATIVE EXTERIOR LIGHTING SHALL TURN OFF FROM MIDNIGHT TO 6AM. AT 6AM, THEY RETURN TO FULL BRIGHTNESS.
4. ALL CONTROLS SETTINGS AND SCENES SHALL BE REVIEWED WITH THE LIGHTING DESIGNER AND OWNER WITH THE PROGRAMMER IN THE FIELD. ALTERATIONS MAY BE MADE AT THAT TIME.
5. THERE SHALL BE A PRE-PROGRAMMING MEETING TO REVIEW INTENT AND REQUIREMENTS PRIOR TO ANY ON-SITE PROGRAMMING BEING DONE. THERE SHALL BE A POST-PROGRAMMING MEETING IN THE FIELD TO CONFIRM SCENES AND SETTINGS WITH BOTH THE LIGHTING DESIGNER AND OWNER. CONTRACTOR IS RESPONSIBLE FOR COORDINATING BOTH MEETINGS.

OS # = OCCUPANCY SENSOR
PC = PHOTOCCELL
OC SWITCH = OCCUPANCY SENSOR WITH MANUAL SWITCH OVERRIDE
TIMER = TIME CLOCK
DC = DC DIMMING
ML = MULTI-LEVEL SWITCHING
SL = SINGLE-LEVEL SWITCHING
PSC = PRE-SET SCENE CONTROLLER
SLDO = SINGLE-LEVEL SWITCHING WITH DIMMING
MLDO = MULTI-LEVEL SWITCHING WITH DIMMING
MLTO = MULTI-LEVEL SWITCHING WITH LOCAL OVERRIDE OF TIME-SWEEP
SLK = SINGLE LEVEL KEYED SWITCH
SL-O = SINGLE LEVEL OVERRIDE SWITCH
HOA = HAND-OFF/AUTO SWITCH

OS # = OVERRIDE SWITCH NAME
MS # = MASTER SWITCH NAME

TAG: PP-1A VOLTAGE: 480/277 Wye.3 NEUTRAL: 100%													
MTG: SURFACE BUS: 225 A GROUND: 100%													
RM: SWITCH ROOM 130 MOCIP: 225 A MCB REMARKS: 65KAIC													
CKT	DESCRIPTION	TYPE	P	VA	A	B	C	VA	P	TYPE	DESCRIPTION	CKT	
1		L		3820	0			20 A	1	--	SPARE	2	
3	TR-1A	Sp	3	50 A		6160	0	20 A	1	--	SPARE	4	
5		Sp	3				2960	0	20 A	1	SPARE	6	
7	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	8	
9	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	10	
11	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	12	
13	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	14	
15	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	16	
17	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	18	
19	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	20	
21	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	22	
23	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	24	
TOTAL VA PHASE A				3820 VA	TOTAL CONNECTED AMPS				16 A				
TOTAL VA PHASE B				6160 VA	TOTAL CONNECTED VA				12960 VA				
TOTAL VA PHASE C				2960 VA	TOTAL DESIGN AMPS				16 A				

TAG: PP-1C VOLTAGE: 480/277 Wye.3 NEUTRAL: 100%													
MTG: SURFACE BUS: 225 A GROUND: 100%													
RM: SWITCH ROOM 131 MOCIP: 225 A MCB REMARKS: 65KAIC													
CKT	DESCRIPTION	TYPE	P	VA	A	B	C	VA	P	TYPE	DESCRIPTION	CKT	
1		L		3940	0			20 A	1	--	SPARE	2	
3	TR-1C	Sp	3	50 A		5830	0	20 A	1	--	SPARE	4	
5		Sp	3				3080	0	20 A	1	SPARE	6	
7	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	8	
9	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	10	
11	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	12	
13	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	14	
15	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	16	
17	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	18	
19	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	20	
21	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	22	
23	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	24	
TOTAL VA PHASE A				3940 VA	TOTAL CONNECTED AMPS				15 A				
TOTAL VA PHASE B				5830 VA	TOTAL CONNECTED VA				12850 VA				
TOTAL VA PHASE C				3080 VA	TOTAL DESIGN AMPS				16 A				

TAG: LP-1A VOLTAGE: 120/208 Wye.3 NEUTRAL: 100%													
MTG: SURFACE BUS: 100 A GROUND: 100%													
RM: SWITCH ROOM 130 MOCIP: 100 A MCB REMARKS: 10KAIC													
CKT	DESCRIPTION	TYPE	P	VA	A	B	C	VA	P	TYPE	DESCRIPTION	CKT	
1	LIGHTING	L	1	20 A	560	0		20 A	1	--	SPARE	2	
3	REC	R	1	20 A		180	2400	25 A	2	H	OUI/U-4	4	
5	REC	R	1	20 A		180	2400	25 A	2	H	OUI/U-2	6	
7	REC	R	1	20 A	360	2400		25 A	2	H	OUI/U-3	8	
9	EXTERIOR REC	R	1	20 A		180	2400	25 A	2	H	OUI/U-1	10	
11	EXTERIOR REC	R	1	20 A			180	0	20 A	1	SPARE	12	
13	***FCP	E	1	20 A	500	0		20 A	1	--	SPARE	14	
15	***DATA RACK	R	1	20 A		1000	0	20 A	1	--	SPARE	16	
17	EXTERIOR LTG	L	1	20 A			220	0	20 A	1	SPARE	18	
19	SPARE	--	1	20 A	0	0		20 A	1	--	SPARE	20	
21	SPARE	--	1	20 A		0	0	20 A	1	--	SPARE	22	
23	SPARE	--	1	20 A			0	0	20 A	1	SPARE	24	
25	SPARE	--	1	20 A	0	0		20 A	1	--	SPARE	26	
27	SPARE	--	1	20 A		0	0	20 A	1	--	SPARE	28	
29	SPARE	--	1	20 A			0	0	20 A	1	SPARE	30	
31	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	32	
33	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	34	
35	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	36	
37	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	38	
39	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	40	
41	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	42	
TOTAL VA PHASE A				3820 VA	TOTAL CONNECTED AMPS				36 A				
TOTAL VA PHASE B				6160 VA	TOTAL CONNECTED VA				12960 VA				
TOTAL VA PHASE C				2960 VA	TOTAL DESIGN AMPS				37 A				

***PROVIDE CIRCUIT BREAKER WITH RED HANDLE, LOCKED IN "ON" POSITION

TAG: LP-1C VOLTAGE: 120/208 Wye.3 NEUTRAL: 100%												
MTG: SURFACE BUS: 100 A GROUND: 100%												
RM: SWITCH ROOM 131 MOCIP: 100 A MCB REMARKS: 10KAIC												
CKT	DESCRIPTION	TYPE	P	VA	A	B	C	VA	P	TYPE	DESCRIPTION	CKT
1	REC	R	1	20 A	360	0		20 A	1	--	SPARE	2
3	REC	R	1	20 A		360	2400	25 A	2	H	OUI/U-2	4
5	EXTERIOR REC	R	1	20 A		180	2400	25 A	2	H	OUI/U-1	6
7	EXTERIOR REC	R	1	20 A	180	2400		25 A	2	H	OUI/U-1	8
9	LIGHTING	L	1	20 A		450	2400	25 A	2	H	OUI/U-1	10
11	***FCP	E	1	20 A			500	0	20 A	1	SPARE	12
13	***DATA RACK	R	1	20 A	1000	0		20 A	1	--	SPARE	14
15	EXTERIOR LTG	L	1	20 A		220	0	20 A	1	--	SPARE	16
17	SPARE	--	1	20 A			0	0	20 A	1	SPARE	18
19	SPARE	--	1	20 A	0	0		20 A	1	--	SPARE	20
21	SPARE	--	1	20 A		0	0	20 A	1	--	SPARE	22
23	SPARE	--	1	20 A			0	0	20 A	1	SPARE	24
25	SPARE	--	1	20 A	0	0		20 A	1	--	SPARE	26
27	SPARE	--	1	20 A		0	0	20 A	1	--	SPARE	28
29	SPARE	--	1	20 A			0	0	20 A	1	SPARE	30
31	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	32
33	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	34
35	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	36
37	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	38
39	PROVISION	--	1	--	--	--	--	--	1	--	PROVISION	40
41												

CONCRETE MIX:

CM1 PROVIDE CONCRETE MEETING FOLLOWING:

CONCRETE MIX DESIGN SCHEDULE						
USE	28-DAY STRENGTH (PSI)	MAX. WATER-CEMENT RATIO	MAX. CURED DENSITY (PCF)	MAX. AGGREGATE SIZE (IN)	CEMENT TYPE	% AIR ENTRAINMENT
PIERS	4,000	0.50	150	1 1/2	I/II	40
GRADE BEAMS	4,500	0.45	150	1	I/II	3-6
BEAMS & ELEVATED SLAB	5,000	0.45	150	1	I/II	3-6
WALLS	4,500	0.45	150	1	I/II	30
SLAB FOR EQUIPMENT PADS	4,500	0.45	150	1	I/II	3-6
SLAB-ON-GRADE	4,500	0.45	150	1	I/II	3-6
NON-COMPOSITE TOPPING SLAB	4,000	0.45	150	1/2	I/II	-

CM2 CHANGING APPROVED MIX DESIGN REQUIRES A NEW MIX DESIGN SUBMITTAL. USE ADMIXTURES PLACED IN CONCRETE MIX IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND INCLUDE IN SUBMITTED CONCRETE MIX DESIGN FOR APPROVAL.

CM3 DO NOT PLACE CONCRETE WHEN AMBIENT AIR TEMPERATURE IS OUTSIDE LIMITS PROVIDED ON APPROVED MIX DESIGNS. USE OF CHLORIDES IN ANY ADMIXTURE IS NOT PERMITTED.

CM4 PROVIDE PORTLAND CEMENT CONFORMING TO ASTM C150, OF TYPES NOTED IN SCHEDULE. PROVIDE NORMAL WEIGHT AGGREGATE CONFORMING TO ASTM C33.

CM5 FLY ASH IS ALLOWED IN CONCRETE UP TO MAXIMUM PERCENTAGE LISTED ABOVE. ADD WEIGHT OF FLY ASH TO WEIGHT OF CEMENT IN CALCULATION OF WATER CEMENT RATIO. CONFIRM IN MIX DESIGN SUBMITTAL THAT USE OF FLY ASH WILL NOT INTERFERE WITH PERFORMANCE OF OTHER PRODUCTS AND MATERIALS THAT WILL BE IN CONTACT WITH CONCRETE.

CM6 AIR ENTRAINMENT IS REQUIRED ONLY IN NORMAL WEIGHT CONCRETE PERMANENTLY EXPOSED TO WEATHER CONDITIONS. PERCENT AIR ENTRAINMENT LISTED IS PLUS/MINUS 1.5 %. DO NOT AIR-ENTRAIN INTERIOR FLOOR SLABS THAT RECEIVE HARD TROWEL FINISH.

CM7 MIX FOR TOPPING SLABS THAT ARE LESS THAN TWO INCHES THICK SHALL CONTAIN SIKAFIBERMESH - 150 FIBERS OR EQUIVALENT WITH A DOSAGE OF 1.5 POUNDS PER CUBIC YARD.

CM8 PROVIDE CONCRETE IN ELEVATED SLABS AND BEAMS WITH A SHRINKAGE LIMIT OF 0.045% AT 28 DAYS MEASURED IN ACCORDANCE WITH ASTM C157. SUBMIT LABORATORY TEST RESULTS TO ARCHITECT PRIOR TO CONSTRUCTION.

CM9 NON-CHLORIDE ACCELERATING ADMIXTURE MAY BE USED IN CONCRETE SLABS PLACED AT AMBIENT TEMPERATURES BELOW 50 DEGREES FAHRENHEIT AT CONTRACTOR'S OPTION.

CM10 USE CALCIUM NITRITE AT A RATE OF TWO GALLONS/CUBIC YARD IN EXPOSED PARKING GARAGE STRUCTURES AND EXTERIOR TOPPING SLABS.

CM11 SUBMIT MIX DESIGN SUBMITTALS TO PROJECT'S TESTING LABORATORY PRIOR TO SUBMITTING TO ARCHITECT. A SUBMITTAL WITHOUT TESTING LABORATORY'S APPROVAL WILL BE REJECTED.

CM12 PROPORTION CONCRETE MIXES WITH SLUMPS SUITABLE TO PROPERLY PLACE, CONSOLIDATE, AND FINISH CONCRETE IN ACCORDANCE WITH ACI 318 AND CONTRACT DOCUMENTS.

CONCRETE REINFORCING:

CR1 PROVIDE REINFORCING STEEL CONFORMING TO ASTM A615, GRADE 60 USING NEW OR RECYCLED DOMESTIC BILLET STEEL OF A DOMESTIC MANUFACTURE.

CR2 PROVIDE REINFORCING STEEL SPECIFIED TO BE WELDED CONFORMING TO ASTM A706, WITH GRADES AS INDICATED ON DRAWINGS OR AS PERMITTED. WELD IN ACCORDANCE WITH AWS D1.4. WELDING OF REINFORCING STEEL FOR USE IN STRUCTURAL CONCRETE OR STRUCTURAL MASONRY IS PERMITTED ONLY WHERE SPECIFICALLY DESIGNATED ON DRAWINGS.

CR3 PROVIDE ELECTRICALLY-WELDED WIRE REINFORCEMENT (WWR) OF COLD-DRAWN WIRE (70,000 PSI YIELD) CONFORMING TO ASTM A185, OF SIZE INDICATED ON DRAWINGS.

CR4 WELD HEADED STUDS AND DEFORMED BAR ANCHORS (DBA) BY FULL-FUSION WELDING, AS FURNISHED BY TRW NELSON STUD WELDING DIVISION OR EQUIVALENT.

CR5 DETAIL CONCRETE REINFORCING AND ACCESSORIES IN ACCORDANCE WITH ACI 315.

CR6 PROVIDE CLEAR CONCRETE COVER MEASURED TO OUTERMOST BAR, STIRRUP OR TIE AS FOLLOWS:

EXPOSURE CONDITION	BAR SIZE OR USE	MINIMUM COVER
CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH (WITH OR WITHOUT VAPOR RETARDER):	ALL	3"
EXPOSED TO EARTH OR WEATHER	#6 BAR AND SMALLER	1 1/2"
	#6 BAR AND LARGER	2"
NOT EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND. (TYPICAL INTERIOR CONDITIONS AND UNDERSIDE OF PARKING FLOORS ARE IN THIS CATEGORY)	SLABS AND WALLS	1"
	BEAMS	1 1/2"

CR7 SPECIFIC COVER REQUIREMENTS ARE AS FOLLOWS (REF TABLE ABOVE IF SPECIFIC CASE IS NOT LISTED)

EXPOSURE CONDITION	BAR SIZE OR USE	MINIMUM COVER
GRADE BEAMS, TOP, BOTTOM AND SIDES WHEN THREE SIDES FORMED-OTHERWISE REF ABOVE	ALL	2"
SLAB BOTTOMS OVER VOID FORMS	ALL	2"
SLAB-ON-GRADE	ALL	2"
PIERS	ALL	3"

CR8 FOR BARS IN UNSCHEDULED CONCRETE MEMBERS WITHOUT A SPECIFIED BAR TYPE, SHAPE OR LENGTH, DETAIL BARS CONTINUOUSLY WITH HOOKS AT DISCONTINUOUS ENDS. SPLICE TOP BARS AT MIDSPAN BETWEEN SUPPORTS AND BOTTOM BARS DIRECTLY OVER SUPPORTS USING CLASS A SPLICES.

CR9 PROVIDE DOWELS TO MATCH WALL VERTICAL REINFORCEMENT.

CR10 INSTALL WELDED WIRE FABRIC IN LONGEST PRACTICABLE LENGTHS ON BAR SUPPORTS SPACED TO MINIMIZE SAGGING. LAP EDGES AND ENDS OF ADJOINING SHEETS. MEASURE LENGTH OF LAP BETWEEN OUTERMOST CROSS WIRES OF EACH FABRIC SHEET AND PROVIDE LAP NOT LESS THAN ONE SPACING OF THE CROSS WIRES PLUS 2 INCHES. LACE OVERLAPS WITH WIRE.

CAST-IN-PLACE CONCRETE:

CP1 PROVIDE CONCRETE CONSTRUCTION IN ACCORDANCE WITH MORE STRINGENT REQUIREMENT OF EITHER LOCAL BUILDING CODE OR ACI STANDARD BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE (ACI 318).

CP2 CONSTRUCTION JOINTS:

A. PERMITTED ONLY WHERE INDICATED ON DRAWINGS.

B. WHERE NOT SPECIFICALLY INDICATED ON DRAWINGS, LOCATE JOINTS AS FOLLOWS:

- LOCATE JOINTS NOT INDICATED TO LEAST IMPUR STRAIGHT AND APPEARANCE OF STRUCTURE. LOCATE VERTICAL JOINTS IN MIDDLE THIRD OF SPANS OF NON-POST-TENSIONED SLABS, BEAMS OR GIRDERS. UNLESS A BEAM INTERSECTS A GIRDER AT MIDDLE LOCATION, IN WHICH CASE OFFSET JOINTS IN GIRDERS TWICE WIDTH OF BEAM. LOCATE VERTICAL JOINTS WITHIN END THIRD OF SPANS OF POST-TENSIONED CONTINUOUS SLABS, BEAMS OR GIRDERS WHERE TENDON PROFILE IS AT OR NEAR CENTROID OF CONCRETE CROSS SECTION.
- LOCATE HORIZONTAL JOINTS IN WALLS AND COLUMNS AT UNDERSIDE OF SUPPORTED ELEMENTS AT TOP OF WALL OR COLUMN AND AT TOP OF FOOTINGS OR FLOOR SLABS AT BOTTOM OF WALL OR COLUMN. ROUGHEN SURFACE OF HORIZONTAL OR NEARLY HORIZONTAL CONSTRUCTION JOINTS SO THAT AGGREGATE IS EXPOSED UNIFORMLY, LEAVING NO LAITANCE, LOOSENED PARTICLES OR DAMAGED CONCRETE.

C. REFER TO PLANS FOR JOINTS IN GRADE SUPPORTED SLABS.

D. JOINTS ARE NOT ALLOWED BETWEEN PILASTERS AND WALL.

E. SUBMIT CONSTRUCTION JOINT LAYOUT PLANS FOR APPROVAL BY ARCHITECT PRIOR TO CONSTRUCTION.

CP3 CONDUITS, PIPES AND SLEEVES

A. VARIOUS CONDUITS, PIPES AND SLEEVES WHICH ARE NOT INDICATED ON STRUCTURAL DRAWINGS MAY BE REQUIRED BY EQUIPMENT SUPPLIERS OR ARCHITECTURAL, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS. COORDINATE AND INSTALL THESE ITEMS INTO CONCRETE WORK OBSERVING FOLLOWING GUIDELINES:

- COMPLY WITH ACI 318 AND THESE NOTES FOR ALL CONDUITS, PIPES AND SLEEVES EMBEDDED IN CONCRETE. THESE NOTES SHALL GOVERN WHERE THEY ARE IN CONFLICT WITH ACI. ALUMINUM EMBEDDED ITEMS ARE NOT PERMITTED.
- HORIZONTAL CONDUITS AND PIPES EMBEDDED IN SLABS:
 - DO NOT USE CONDUITS AND PIPES LARGER IN OUTSIDE DIAMETER THAN 1/3 OVERALL THICKNESS OF SLAB.
 - PROVIDE CLEAR DISTANCE BETWEEN CONDUITS AND PIPES NOT LESS THAN 3 OUTSIDE DIAMETERS OR 6 INCHES, WHICHEVER IS GREATER.
 - PLACE CONDUITS AND PIPES WITHIN MIDDLE THIRD OF SLAB THICKNESS.
 - DO NOT REINFORCE SUFFICIENTLY TO RESIST DAMAGE FROM FORMWORK REMOVAL OPERATIONS.
 - NO HORIZONTAL CONDUIT OR PIPE IS PERMITTED TO BE EMBEDDED IN SLAB WITHOUT PRIOR WRITTEN APPROVAL FROM ARCHITECT.
- HORIZONTAL SLEEVES, CONDUITS OR PIPES EMBEDDED IN BEAMS OR JOISTS:
 - PLACE HORIZONTAL CONDUITS, PIPES AND SLEEVES AT RIGHT ANGLES TO SIDES OF MEMBER DO NOT PLACE LONGITUDINALLY WITHIN MEMBER.
 - VERTICAL CONDUITS, PIPES AND SLEEVES EMBEDDED IN CONCRETE BEAMS OR JOISTS.
 - NO VERTICAL CONDUITS, PIPES AND SLEEVES ARE PERMITTED TO BE EMBEDDED IN CONCRETE BEAMS WITHOUT PRIOR WRITTEN APPROVAL FROM ARCHITECT OR UNLESS SPECIFICALLY DETAILED OTHERWISE.
- CONDUITS, PIPES AND SLEEVES DETAILED IN STRUCTURAL DRAWINGS, ARE NOT ALLOWED IN PILASTERS OR COLUMNS WITHOUT PRIOR WRITTEN APPROVAL FROM ARCHITECT.

CP4 WET CURE ALL CONCRETE THAT WILL BE COLORED OR STAINED.

CP5 REMOVAL OF FORMWORK:

A. EXCEPT AS HEREIN SPECIFIED, REMOVE FORMWORK AND RESHORE IN ACCORDANCE WITH ACI 301 AND RECOMMENDATIONS OF ACI 347 TO ENSURE COMPLETE SAFETY OF FORMWORK AND STRUCTURE.

B. FORMWORK FOR COLUMNS, WALLS, SIDES OF BEAMS AND OTHER PARTS NOT SUPPORTING WEIGHT OF CONCRETE MAY BE REMOVED AFTER CONCRETE IS HARDENED SUFFICIENTLY TO RESIST DAMAGE FROM FORMWORK REMOVAL OPERATIONS.

C. RETAIN FORMS AND SHORING FOR ALL HORIZONTAL WORK UNTIL CONCRETE HAS ACHIEVED AT LEAST 75% OF ITS DESIGNATED 28-DAY COMPRESSIVE STRENGTH AND WILL SAFELY SUPPORT ITS OWN WEIGHT AND UNTIL ALL COLUMNS ABOVE HAVE BEEN CAST AND HARDENED. RESHORE AS HEREIN SPECIFIED.

D. RETAIN FORMS AND SHORING FOR POST-TENSIONED GIRDERS, BEAMS, AND SLABS UNTIL MEMBER HAS BEEN FULLY TENSIONED, TENDON ELONGATIONS HAVE BEEN REVIEWED AND APPROVED BY ARCHITECT, AND UNTIL ALL COLUMNS ABOVE HAVE BEEN CAST AND HARDENED. RESHORE AS HEREIN SPECIFIED.

CP6 RESHORING:

A. NO CONSTRUCTION LOADS OR LIVE LOADS ARE PERMITTED ON FLOOR DURING STRIPPING AND UNTIL RESHORING IS COMPLETE.

B. BEGIN RESHORING AFTER FORMS AND SHORES HAVE BEEN REMOVED FROM A LARGE ENOUGH AREA SUCH THAT FLOOR DEFLECTS AND SUPPORTS ITS OWN WEIGHT. COMPLETE RESHORING NO LATER THAN END OF WORKING DAY ON WHICH STRIPPING OCCURS.

C. PLACE RESHORES SNUG AGAINST SOFFIT OF FLOOR ABOVE. DO NOT TIGHTEN RESHORES AS TO PRELOAD FLOOR BELOW.

D. LOCATE SHORES AND RESHORES ONLY ABOVE WHERE RESHORES ARE LOCATED BELOW. WHERE SHORES OR RESHORES ARE NOT ALIGNED WITH RESHORES BELOW, SUBMIT DESIGN CALCULATIONS, PERFORMED AND SEALED BY A STRUCTURAL ENGINEER LICENSED TO PRACTICE IN STATE IN WHICH PROJECT IS LOCATED, INDICATING THAT INDUCED STRESSES DO NOT EXCEED CAPACITY OF SLAB.

E. EXTEND RESHORING OVER A SUFFICIENT NUMBER OF FLOORS TO DISTRIBUTE WEIGHT OF NEWLY PLACED CONCRETE, FORMWORK AND CONSTRUCTION LIVE LOADS IN SUCH A MANNER THAT SPECIFIED DESIGN LIVE LOADS (TAKING INTO ACCOUNT APPLICABLE LIVE LOAD REDUCTION) OF FLOORS BELOW ARE NOT EXCEEDED. NUMBER OF FLOORS REQUIRED TO SUPPORT WET CONCRETE SHALL BE DETERMINED BY CONTRACTOR'S LICENSED ENGINEER.

F. DO NOT REMOVE RESHORES SUPPORTING ROOFS UNTIL CONCRETE HAS ACHIEVED 100% OF ITS SPECIFIED 28-DAY STRENGTH OR 21 DAYS, WHICHEVER IS LONGER.

CP7 PROVIDE A MINIMUM 4 INCH THICK HOUSE KEEPING PAD BELOW MEP EQUIPMENT. REFERENCE MEP OR ARCH PLANS FOR LOCATIONS AND SIZES OF PADS.

CP8 UNLESS SPECIFICALLY NOTED OTHERWISE, PROVIDE A FLAT AND LEVEL TROWELED FINISH TOP OF CONCRETE SURFACES THAT SUPPORT PRECAST, MASONRY, CURTAIN WALL SYSTEMS, ETC.

CP9 WATERSTOPS:

A. PROVIDE WATERSTOPS AT ALL SUBGRADE CONSTRUCTION JOINTS IN CONCRETE ELEMENTS WHERE EARTH SUBGRADE AT JOINT IS ON ONE SIDE OF CONCRETE MEMBER ONLY. PROVIDE WATERSTOPS AT OTHER LOCATIONS AS INDICATED IN DOCUMENTS.

CP10 LATERALLY BRACE GRADE BEAMS OR WALLS AT DOCKS AND SIMILAR CONDITIONS (BOTH EXTERIOR AND INTERIOR) WHERE BACKFILL IS PLACED UP TO OR NEAR TOP OF BEAM OR WALL ON ONE SIDE AND GRADE ON OTHER SIDE OF BEAM OR WALL IS MORE THAN 2'-0" LOWER FROM LOW SIDE TO PLACING FILL ON OTHER SIDE. BRACING SHALL REMAIN UNTIL FLOOR SLAB AT TOP OF BEAM OR WALL HAS BEEN CONSTRUCTED AND HAS ATTAINED ITS SPECIFIED 28 DAY STRENGTH.

CP11 PROVIDE SLAB SURFACE WITH TROWEL FINISH. RAMPS SHALL BE A BROOM FINISH.

EMBEDDED HEADED STUD CONNECTORS & DEFORMED BAR ANCHORS (DBA):

SC1 PROVIDE HEADED STUD CONNECTORS (SC) CONFORMING TO ASTM A108, AISI C-1015 THROUGH C-1020, HEADED STUD TYPE, COLD FINISHED CARBON STEEL, AWS D1.1, TYPE B (MINIMUM TENSILE STRENGTH 65,000 PSI), AUTOMATICALLY END WELD STUDS IN SHOP OR IN FIELD.

SC2 PROVIDE DEFORMED BAR ANCHORS (DBA) CONFORMING TO ASTM 1064-18 AND AWS D1.1, TYPE C (MINIMUM TENSILE STRENGTH 80,000PSI), AUTOMATICALLY END WELD DBA IN SHOP OR FIELD.

POST-INSTALLED CONCRETE ANCHORS:

PA1 USE POST-INSTALLED ANCHORS ONLY WHERE SPECIFIED ON CONSTRUCTION DOCUMENTS. OBTAIN APPROVAL FROM ARCHITECT PRIOR TO INSTALLING POST-INSTALLED ANCHORS IN PLACE OF MISSING OR MISPLACED CAST-IN-PLACE ANCHORS.

PA2 DRILL AND CLEAN HOLES IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS.

PA3 PROVIDE POST INSTALLED CONCRETE ANCHORS OF SIZE, TYPE, AND QUANTITY AS NOTED ON DETAILS AS MANUFACTURED BY HLTI OR EQUIVALENT.

PA4 USE ONLY ANCHORS FROM ONE MANUFACTURER ON THIS PROJECT.

PA5 PROVIDE HOLES IN CONNECTION PLATES FOR EXPANSION BOLTS NOT MORE THAN 1/16" LARGER THAN BOLT DIAMETER. IF FIELD CONDITIONS OR TOLERANCES REQUIRE LARGER HOLES, PROVIDE PLATE WASHERS WITH BOLTS HOLES 1/16" LARGER THAN BOLT DIAMETER THAT ARE WELDED TO CONNECTION PLATE. SIZE PLATE WASHERS AND WELDS TO TRANSFER SHEAR AND TENSION CAPACITY OF EXPANSION BOLT.

PA6 INSTALL POST INSTALLED BOLTS IN ACCORDANCE WITH MANUFACTURER'S WRITTEN RECOMMENDATIONS.

PA7 PRIOR TO DRILLING FOR ANCHORS, USE A PACHOMETER OR ANOTHER APPROVED METHOD TO LOCATE EXISTING REINFORCING TO ENSURE THERE IS NO CONFLICT. IF A CONFLICT EXISTS, ANCHOR POSITION CAN BE ADJUSTED BY NO MORE THAN 1 INCH. IF A LARGER DEVIATION IS NECESSARY, CONTACT ARCHITECT. FILL ABANDONED OR UNUSED HOLES WITH EPOXY GROUT.

PA8 ONCE FINAL POSITION OF THE ANCHORS IS SET, USE TEMPLATES TO TRANSFER FINAL LOCATION OF BOLT GROUP ON TO CONNECTION PLATE.

PA9 CONSTRUCTION OF POST INSTALLED ANCHORS REQUIRES CONTINUOUS INSPECTION BY TESTING AGENCY TO ENSURE PROPER EMBEDMENT AND INSTALLATION PER MANUFACTURER'S SPECIFICATIONS.

PA10 USE ONLY PERSONNEL CERTIFIED BY ACI/CRS ADHESIVE ANCHOR INSTALLER PROGRAM TO INSTALL ANCHORAGE SYSTEM IN A HORIZONTAL OR UPWARDLY INCLINED ORIENTATION AND WHERE SUPPORTING SUSTAINED TENSION LOADS.

POST-TENSIONED CONCRETE:

PT1 AFTER TENDONS ARE PLACED AND FIRMLY SUPPORTED, INSPECT TENDONS FOR DAMAGE AND REPAIR AND TAPE IN ACCORDANCE WITH PROJECT SPECIFICATIONS.

PT2 PROVIDE 1/2" NCH DIAMETER, SEVEN-WIRE, STRESS RELIEVED STRAND CONFORMING TO ASTM A 416. *SPECIFICATION FOR UNCOATED SEVEN-WIRE LOW RELAXATION STRAND FOR PRESTRESSED CONCRETE* WITH A MINIMUM GUARANTEED ULTIMATE TENSILE STRENGTH OF 270,000 PSI BASED ON NOMINAL AREA OF STRAND. STRAND SHALL BE FREE OF DIRT, CORROSION OR INJURIOUS MARKS, UNDUDE SEGREGATION, LAMINATION, EXCESSIVE DIE MARKS, SCRATCHES, SEAMS, AND SHARP KINKS.

PT3 TENDON FORCES INDICATED ON STRUCTURAL DRAWINGS ARE EFFECTIVE FORCES AFTER ALL IMMEDIATE AND LONG-TERM LOSSES. SUBMIT LOSS CALCULATIONS PER SPECIFICATIONS, UNLESS OTHERWISE INDICATED. EFFECTIVE FORCE APPLIES AT POINT ALONG TENDON CALCULATED TO HAVE LEAST FORCE (GREATEST CUMULATIVE LOSSES). FORCE AVERAGING IS NOT PERMITTED.

PT4 DO NOT USE GROUT OR CONCRETE CONTAINING CHLORIDES, OR OTHER SUBSTANCES DETRIMENTAL TO PRESTRESSING STEEL, REINFORCING, AND EMBEDS.

PT5 PROFILE DIMENSIONS INDICATED ON STRUCTURAL DRAWINGS LOCATE CENTER OF GRAVITY OF TENSION STEEL OR TENDON GROUP MEASURED FROM MEMBER SOFFIT. PLACE TENDONS CONFORMING TO CONTROL POINTS INDICATED ON STRUCTURAL DRAWINGS AND WITH PARABOLIC DRAPE BETWEEN SUPPORTS, UNLESS NOTED OTHERWISE. PLACE HARPED TENDONS STRAIGHT BETWEEN CONTROL POINTS. PLACE LOW POINTS AT MID SPAN UNLESS OTHERWISE INDICATED OR NOTED.

PT6 ADD TENDONS AT MID-DEPTH IN ONE WAY SLABS PERPENDICULAR TO MAIN TENDONS, IN ORDER TO MAINTAIN UNIFORM COMPRESSION STRESS OF 150 PSI.

PT7 SHOW SEQUENCE OF STRESSING IN SHOP DRAWINGS. STRESS SLAB BEFORE JOISTS, JOISTS BEFORE BEAMS, AND BEAMS BEFORE GIRDERS. STRESS UNIFORMLY DISTRIBUTED TENDONS BEFORE CONCRETES BEAM STRIP (BANDED) TENDONS.

PT8 PROVIDE MINIMUM CONCRETE COVER OVER TENDONS IN PARKING GARAGES AS FOLLOWS:

- INTERIOR SLAB SPANS: TOP: 1 1/2"
- INTERIOR SLAB SPANS: BOTTOM: 3/4"
- SLAB END SPANS AND CANTILEVERS: 1 1/2"
- INTERIOR BEAM OR JOIST SPANS: 1 1/2"
- BEAM OR JOIST END SPANS AND CANTILEVERS: 2"

PT9 PROVIDE MINIMUM CLEAR SPACING BETWEEN INDIVIDUAL OR BUNDLED TENDONS OF 2".

PT10 DO NOT COMMENCE STRESSING OF TENDONS UNLESS IT IS DEMONSTRATED THAT CONCRETE HAS REACHED 75% OF ITS DESIGN STRENGTH.

STRUCTURAL CONCRETE UNIT MASONRY:

SM1 THESE NOTES APPLY ONLY TO MASONRY INDICATED ON STRUCTURAL FRAMING PLANS. MASONRY NOT INDICATED ON STRUCTURAL FRAMING PLANS IS NOT PART OF STRUCTURAL FRAME AND IS CONSIDERED ARCHITECTURAL (NON-STRUCTURAL) MASONRY.

SM2 PROVIDE MASONRY STRENGTH (FM) = 2,000 PSI, MINIMUM.

SM3 PROVIDE HOLLOW LOAD BEARING MASONRY UNITS CONFORMING TO ASTM C 90, LIGHTWEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI ON NET AREA OF BLOCK. UNLESS NOTED OTHERWISE, USE RUNNING BOND CONSTRUCTION.

SM4 PROVIDE MORTAR CONFORMING TO ASTM C 270, TYPE S WITH A MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI WITH PROPORTIONS BY VOLUME OF 1 PART PORTLAND CEMENT, 1/2 PART HYDRATED LIME, AND 3 1/2 TO 4 1/2 PARTS FINE AGGREGATE. DO NOT USE AIR ENTRAINING LIME, MASONRY CEMENT OR ADMIXTURES. MEASURE MATERIALS WITH A BATCHING BOX. DO NOT MEASURE MATERIALS WITH A SHOVEL.

SM5 PROVIDE COARSE GROUT CONFORMING TO ASTM C 476, WITH A MAXIMUM FINE AGGREGATE SIZE OF 3/8" A MAXIMUM COARSE AGGREGATE SIZE OF 1/2" AND A MINIMUM COMPRESSIVE STRENGTH OF 2,500 PSI WITH PROPORTIONS BY VOLUME OF 1 PART PORTLAND CEMENT, 0 TO 1/10 PART LIME, 2 1/4 TO 3 PARTS FINE AGGREGATE AND 1 TO 2 PARTS COARSE AGGREGATE AND SLUMP OF 8" TO 11".

SM6 FOR REINFORCING IN GROUTED COLUMNS, PILASTERS AND BEAMS. PROVIDE CLEAR GROUT COVER OF 1" MEASURED TO OUTERMOST BAR, STIRRUP OR TIE.

SM7 CONTINUOUS HORIZONTAL JOINT REINFORCING:

- SINGLE WYTHE WALLS:
 - PROVIDE GALVANIZED CONTINUOUS HORIZONTAL WALL JOINT REINFORCING FOR SINGLE WYTHE WALLS, EXTRA HEAVY DUTY TRUSS TYPE "DURA-WAL", OR EQUAL AT 16" ON CENTER, VERTICALLY, TYPICAL, UNLESS NOTED OTHERWISE.
 - PROVIDE CONTINUITY AT CORNERS AND INTERSECTIONS WITH PREFABRICATED CORNER AND TIE UNITS.
 - SPlice EXTRA HEAVY DUTY HORIZONTAL WALL JOINT WIRE REINFORCING 14" AND CUT CROSS WIRES WITHIN THE SPLICE TO ALLOW SIDE RODS TO LAP SIDE BY SIDE IN THE MORTAR JOINT.
 - PROVIDE COVER FROM JOINT REINFORCING TO EDGE OF MORTAR OF 5/8".

SM8 PROVIDE SHOP DRAWINGS SHOWING DETAILS OF BENDING AND PLACEMENT OF MASONRY REINFORCING BARS. COMPLY WITH ACI 315, "DETAILS AND DETAILING OF CONCRETE REINFORCEMENT" INCLUDE ELEVATIONS OF REINFORCED WALLS AT CORNERS AND AT LOCATIONS WHERE SPECIFIED REINFORCING IS MORE INVOLVED THAN SIMPLE VERTICAL BARS AT A SPECIFIED SPACING.

SM9 UNGROUTED MASONRY WALL CELLS MAY BE REQUIRED TO BE FILLED WITH SAND, VERMICULITE OR PERLITE FOR FIRE RATING, SOUNDPROOFING OR OTHER PURPOSES. REFER TO ARCHITECTURAL DRAWINGS FOR REQUIREMENTS.

SM10 WHERE NOT INDICATED IN STRUCTURAL DRAWINGS, PROVIDE 3/8" VERTICAL THROUGH-WALL CONTROL JOINTS AT 5'-0" TO 12'-6" FROM CORNERS AND AT 25'-0" MAX. IN BETWEEN. CUT ALL HORIZONTAL REINFORCING AT CONTROL JOINTS, TYPICAL UNLESS NOTED OTHERWISE. PROVIDE GROUTED CELLS AND REINFORCING AT EACH SIDE OF JOINT THE SAME AS AT END WALL. SUBMIT JOINT LAYOUT TO ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO STARTING WALL CONSTRUCTION. FOR STRUCTURAL MASONRY WALLS THAT ARE INDICATED IN STRUCTURAL DRAWINGS, THE CRITERIA FOR CONTROL JOINT LOCATIONS TAKES PRIORITY OVER JOINT LOCATIONS THAT MAY OR MAY NOT BE INDICATED IN ARCHITECTURAL DRAWINGS FOR STRUCTURAL MASONRY WALLS.

SM11 PLACE GROUT IN ACCORDANCE WITH TMS 402 AND TMS 602. LIMIT GROUT POURS TO 12 FEET IN HEIGHT FOR 8" AND THICKER WALLS AND 5 FEET IN HEIGHT FOR 6" THICK WALLS. BETWEEN GROUT POURS, FORM CONSTRUCTION JOINT BY LEAVING GROUT 1 1/2 INCHES BELOW MORTAR JOINT (1/2 INCH AT BOND BEAMS).

SM12 CLEANOUTS ARE REQUIRED FOR GROUT POURS OVER 5 FT. PROVIDE CLEANOUTS IN BOTTOM COARSE OF GROUT POUR AT EVERY VERTICAL BAR MINIMUM. PROVIDE CLEANOUTS ON NON-FINISHED SIDE OF MASONRY CONSTRUCTION.

METAL ROOF DECKING:

MD1 COMPLY WITH CURRENT STEEL DECK INSTITUTE SPECIFICATIONS. METAL ROOF DECKING SIZES ARE INDICATED ON STRUCTURAL DRAWINGS AND WITH FOLLOWING MINIMUM PROPERTIES:

METAL ROOF DECK SCHEDULE									
TYPE	GAUGE	PROFILE	DEPTH (IN)	MOMENT OF INERTIA (+) (IN4)	MOMENT OF INERTIA (-) (IN4)	SECTION MODULUS (+) (IN3)	SECTION MODULUS (-) (IN3)	YIELD STRENGTH (KSI)	NRC
1.5WR	20	WIDE RIB	1.5	0.201	0.222	0.234	0.247	80	-

MD2 REFER TO ROOF DIAPHRAGM FASTENER DIAGRAM AND SCHEDULE FOR REQUIRED ATTACHMENT PATTERN.

MD3 METAL ROOF DECK IS DESIGNED TO BE CONTINUOUS OVER TWO OR MORE SPANS UNLESS FEWER THAN THREE SPANS ARE INDICATED ON STRUCTURAL DRAWINGS.

MD4 PROVIDE METAL ROOF DECKING: GALVANIZED WITH G90 COATING CONFORMING TO ASTM A924 AND POWDER-COATED SURFACE.

MD5 COORDINATE METAL DECK LENGTHS WITH FINAL JOIST AND BEAM LAYOUT. FINAL JOIST AND BEAM LAYOUT CAN BE DIFFERENT THAN THAT INDICATED IN STRUCTURAL DRAWINGS DEPENDING ON WHETHER JOIST BEARING SEATS ARE BUTTED OR STAGGERED. JOIST LOCATIONS INDICATED IN STRUCTURAL DRAWINGS DO NOT ACCOUNT FOR SMALL DIFFERENCE IN JOIST LOCATION DUE TO VARIOUS JOIST BEARING CONDITIONS THAT COULD EXIST IN THE FIELD.

MD6 DO NOT SUSPEND APPURTENANCES SUCH AS LIGHT FIXTURES, DUCTS AND OTHER UTILITIES FROM METAL ROOF DECK.

STEEL OPEN WEB JOIST AND JOIST GIRDER FRAMING:

SJ1 COMPLY WITH CURRENT EDITION OF THE STEEL JOIST INSTITUTE'S STANDARD SPECIFICATIONS (SJI) AND APPLICABLE OSHA STANDARD. PROVIDE HOT ROLLED OR COLD FORMED DOUBLE ANGLE CHORDS.

SJ2 WHERE JOISTS WITH DIFFERENT SEAT DEPTHS BUT SAME TOP OF JOIST ELEVATION BEAR ON SAME SUPPORT ELEMENT, PROVIDE DEEPER JOIST SEAT FOR ALL JOIST BEARING ON THAT ELEMENT UNLESS SPECIFICALLY DETAILED OTHERWISE IN STRUCTURAL DRAWINGS.

SJ3 UNLESS INDICATED OTHERWISE IN STRUCTURAL DRAWINGS, WELD ALL JOIST AND JOIST GIRDER SEATS TO THE SUPPORTING STRUCTURAL STEEL OR TO BEARING PLATES IN CONCRETE OR MASONRY AS FOLLOWS:

- K-SERIES JOISTS: 1/8" X 1/2" LONG FILLET WELDS EACH SIDE OF JOIST SEAT.

SJ4 PROVIDE JOIST BRIDGING IN COMPLIANCE WITH CURRENT EDITION OF STEEL JOIST INSTITUTE'S STANDARD SPECIFICATIONS, UNLESS A MORE STRINGENT REQUIREMENT FOR BRIDGING IS REQUIRED BY CONTRACT DOCUMENTS.

- WHERE SPECIFIED WIND UPLIFT LOAD (REF CANOPY SHEET NOTES) RESULTS IN COMPRESSION IN JOIST BOTTOM CHORD, PROVIDE ADDITIONAL BRIDGING AS REQUIRED TO BRACE BOTTOM CHORD.
- COORDINATE BRIDGING WITH REQUIREMENTS OF OTHER TRADES SUCH AS MECHANICAL DUCTS, LIGHTING, FIRE SUPPRESSION SYSTEM, ETC. IF NECESSARY FOR COORDINATION WITH OTHER TRADES, PROVIDE ADDITIONAL ROWS OF BRIDGING ABOVE MINIMUM REQUIREMENTS OF STEEL JOIST INSTITUTE'S STANDARD SPECIFICATIONS.
- AT LOCATIONS WHERE BOTTOM CHORD HORIZONTAL BRIDGING IS DISCONTINUED FOR ONE JOIST SPACING FOR ANY REASON, PROVIDE DIAGONAL BRIDGING BETWEEN ADJACENT TWO JOISTS ON EACH SIDE.

SJ5 CENTER LOADS HANGING FROM JOIST BOTTOM CHORD ON JOIST CHORD AND ATTACHED TO BOTH ANGLES. CLAMP TYPE HANGERS ARE NOT ALLOWED UNLESS SPECIFICALLY AUTHORIZED BY JOIST MANUFACTURER'S ENGINEER.

SJ6 DESIGN STEEL JOISTS FOR AN ADDITIONAL 350 POUNDS OF TRAVELING PROVISIONAL LOAD, OF WHICH ONE CONCENTRATED LOAD OF 300 POUNDS MAY BE PLACED BETWEEN ANY TWO TOP CHORD PANEL POINTS AND A CONCENTRATED LOAD OF 50 POUNDS MAY BE PLACED BETWEEN ANY TWO BOTTOM CHORD PANEL POINTS.

SJ7 DESIGN JOISTS TO RESIST NET WIND UPLIFT LOADS PROVIDED IN STRUCTURAL DRAWINGS.

SJ8 STAGGER JOIST SEATS IF SUPPORTING STEEL BEAM OR EMBEDDED BEARING PLATE IN CONCRETE/MASONRY WALL IS NOT WIDE ENOUGH TO ALLOW BUTTED SEATS AND MEET MINIMUM STEEL JOIST INSTITUTE SPECIFICATIONS FOR MINIMUM BEARING LENGTH. COORDINATE FINAL JOIST LOCATIONS AND METAL DECK SPANS.

STRUCTURAL STEEL FRAMING:

SS1 PROVIDE STRUCTURAL STEEL MEETING FOLLOWING MINIMUM YIELD STRENGTHS AND ASTM SPECIFICATIONS.

STRUCTURAL STEEL TYPE	YIELD STRESS, Fy	TENSILE STRESS, Fu	ASTM SPECIFICATION
WIDE FLANGE AND WT SHAPES	50 KSI	65 KSI	A992
HOLLOW STRUCTURAL SECTIONS	46 KSI ROUND 50 KSI RECTANGULAR	62 KSI	A500, GRADE C
PIPES	35 KSI	60 KSI	A53 TYPE E, GRADE B
ANGLES	36 KSI	58 KSI	A36
CHANNELS	36 KSI	58 KSI	A36
BARNS	36 KSI	58 KSI	A36
PLATES	36 KSI	58 KSI	A36
BOLTS (HEAVY-HEX)	50 KSI	65 KSI	A572, GRADE 50
NUTS (HEAVY-HEX)	92 KSI	120 KSI	A563, GRADE DH
WASHERS	36 KSI	58 KSI	F436
ANCHOR RODS	36 KSI	58 KSI	F1554, GRADE 36
	55 KSI	75 KSI	F1554, GRADE 55, S1
SHEAR-STUD CONNECTORS	105 KSI	125 KSI	F1554, GRADE 105
	50 KSI	65 KSI	A108
RAISED-PATTERN FLOOR PLATE	-	-	A786, COMMERCIAL GRADE

SS2 DRAWINGS INDICATE VARIOUS NON-PRIMARY STRUCTURAL FRAME ELEMENTS SUCH AS SHELF ANGLES, LINTELS, SUPPORT MEMBERS FOR CURTAIN WALLS OR MASONRY, AND EDGE ANGLES FOR OPENINGS AND PERMETER CONDITIONS WHICH ARE INTENDED TO SUPPORT OR BE COORDINATED WITH MATERIALS FURNISHED BY OTHER TRADES. WHERE THESE NON-PRIMARY STRUCTURAL FRAME ELEMENTS ARE INDICATED TO BE WELDED IN DRAWINGS, CONTRACTOR SHALL HAVE FINAL RESPONSIBILITY FOR DETERMINING IF WELDS SHOULD BE MADE IN SHOP OR FIELD IN ORDER TO ACHIEVE PROPER FIT-UP OF VARIOUS COMPONENTS OF FRAMING AND FOR MEETING TOLERANCES REQUIRED BY OTHER TRADES.

SS3 CONTRACTOR IS RESPONSIBLE FOR PROPER FIT-UP OF VARIOUS COMPONENTS OF FRAMING AND FOR MEETING TOLERANCES REQUIRED BY OTHER TRADES, WHICH MAY BE MORE STRINGENT THAN A.I.S.C. TOLERANCES FOR STRUCTURAL STEEL.

SS4 USE

ELEVATOR FRAMING:

- EP1 SUBMIT ELEVATOR SHOP DRAWINGS WITH SHAFT AND SUPPORT REQUIREMENTS PRIOR TO FABRICATING AND CONSTRUCTING ANY PORTION OF SHAFT AND SUPPORTING STRUCTURE. SHAFT AND SUPPORTING STRUCTURE WAS DESIGNED BASED ON INFORMATION PROVIDED DURING DESIGN PHASE AND SHALL BE VERIFIED TO HAVE ADEQUATE CAPACITY AND APPROPRIATE CONFIGURATION TO ACCOMMODATE SELECTED ELEVATED MANUFACTURER'S EQUIPMENT. COST ASSOCIATED WITH MODIFICATIONS TO DESIGN TO ACCOMMODATE SELECTED ELEVATOR MANUFACTURER'S EQUIPMENT SHALL BE INCLUDED IN BID.
EP2 COORDINATE ELEVATOR PIT DIMENSIONS AND ROUGH FLOOR OPENINGS AND CLEAR HEIGHTS FOR ELEVATORS WITH FINAL FRAMING SHOP DRAWINGS. CLEARLY INDICATE CHANGES TO DIMENSIONS INDICATED ON STRUCTURAL DRAWINGS ON FRAMING SHOP DRAWINGS.
EP3 CONFIRM ELEVATOR REACTIONS INDICATED ON STRUCTURAL DRAWINGS WITH FINAL ELEVATOR SHOP DRAWINGS. CLEARLY INDICATE ON SHOP DRAWINGS ANY CHANGES TO REACTIONS INDICATED ON STRUCTURAL DRAWINGS.
EP4 COORDINATE REQUIRED ELEVATOR EMBEDS WITH ELEVATOR MANUFACTURER PRIOR TO CONSTRUCTION.
EP5 PROVIDE HEAVY OR REINFORCED GUIDE RAILS WHICH DO NOT REQUIRE INTERMEDIATE STRUCTURAL SUPPORT WHERE FLOOR TO FLOOR DISTANCE IS GREATER THAN ALLOWABLE SPAN FOR ELEVATOR'S STANDARD RAILS. IF REINFORCED RAILS ARE NOT POSSIBLE, PROVIDE ALLOWANCE FOR SUPPLEMENTAL STEEL SPANNING BETWEEN FLOORS AS TYPICAL ELEVATOR RAILING SUPPORT. DESIGN THIS SUPPLEMENTAL STEEL, AS A DELEGATED DESIGN, BY A STRUCTURAL ENGINEER LICENSED TO PRACTICE IN STATE IN WHICH PROJECT IS LOCATED. IF ELEVATOR RAIL SUPPORT FRAMING APPEARS IN STRUCTURAL DRAWINGS, IT'S INTENT IS DIAGRAMATIC ONLY. REFER TO ELEVATOR DRAWINGS FOR EXACT NUMBER OF ELEVATOR RAILS.

CAST-IN-PLACE PARKING GARAGE CONSTRUCTION NOTES:

- CIP11 IF HAND TROWEL FINISH ON SLAB CANNOT BE AVOIDED, DO NOT USE TROWEL ON SLAB UNTIL THE BLEED WATER EVAPORATES. A MEDIUM BROOM OR A FLOAT SWIRL FINISH IS PREFERRED OVER SURFACES WITH A SLOPE OF LESS THAN 10%. PROVIDE A RAKED FINISH WITH GROOVES PARALLEL TO SLOPE ON SURFACES THAT HAVE A SLOPE OF GREATER THAN 10%.
CIP22 WET CURE CONCRETE FOR AT LEAST 7 DAYS. IF A CURING COMPOUND IS USED INSTEAD, SUBMIT A CERTIFICATION THAT CURING COMPOUNDS YIELD RESULTS EQUAL TO THAT FROM WET CURING. CERTIFY THAT CURING COMPOUND IS COMPATIBLE WITH CONCRETE SEALERS BEING USED ON PROJECT.
CIP23 PREPARE AND SEAL FLOOR CONSTRUCTION JOINTS WITH A TRAFFIC RATED SILICONE BASED SEALANT PER SPECIFICATIONS.
CIP24 SEAL EXPOSED PARKING LEVELS OF GARAGE WITH A 40% (MIN) SILANE BASED (PENETRATING) SEALER.
CIP25 INSTALL SEALANTS STRICTLY PER MANUFACTURER'S RECOMMENDATIONS.
CIP26 REFER TO SPECIFICATIONS FOR FLOOR LEVELNESS AND FLATNESS REQUIREMENTS.
CIP27 DESIGN PRECAST SPANDREL PANELS, WALLS, AND RAILING WHERE A CAR IMPACT LOAD COULD BE SUSTAINED TO WITHSTAND FORCES REQUIRED BY BUILDING CODE.
CIP28 PROVIDE GALVANIZED GARAGE BARRIER CABLES CONSISTING OF 1/2" DIA SEVEN WIRE STRAND CONFORMING TO ASTM A416 WITH A MINIMUM BREAKING LOAD OF 33,000 POUNDS AND MINIMUM WEIGHT OF ZINC COATING OF 3.85 OZ. OF ZINC PER SQUARE FOOT. PROVIDE GALVANIZED ANCHORAGES, WEDGES, COUPLERS, BEARING PLATES AND OTHER MISCELLANEOUS HARDWARE AS MANUFACTURED BY POST-TENSIONING SUPPLIER GALVANIZED WITH A MINIMUM OF 1.8 OZ. OF ZINC PER SQUARE FOOT.
CIP29 SUBMIT SHOP DRAWINGS FOR LOCATIONS AT WHICH BARRIERS ARE INDICATED ON STRUCTURAL DRAWINGS. INDICATE AND LOCATE TERMINAL AND INTERMEDIATE SUPPORTS, CONNECTION OF INTERMEDIATE SUPPORTS TO STRUCTURE, PRE-STRESSING HARDWARE, EMBEDDED SLEEVES, AND STRESSING PROCEDURES AND SEQUENCE.
CIP30 SUBMIT TO ARCHITECT A RECORD OF STRESSING OPERATIONS INCLUDING CALCULATED AND ACTUAL MEASURED ELONGATION FOR EACH JACKING POINT FOR EACH STRAND. AGREEMENT BETWEEN GAUGE READINGS AND MEASURED ELONGATION AND BETWEEN MEASURED ELONGATION AND CALCULATED ELONGATION WITHIN 5% IS REQUIRED FOR SATISFACTORY INSTALLATION. DO NOT CUT OFF STRAND ENDS UNTIL STRANDS HAVE BEEN SATISFACTORILY STRESSED AND ELONGATION RECORDS REVIEWED AND APPROVED BY ARCHITECT.

NON-COMPOSITE TOPPING SLABS:

- NC11 WHERE INDICATED IN CONTRACT DOCUMENTS PROVIDE MINIMUM 3 INCH THICK NON-COMPOSITE TOPPING SLAB REINFORCED WITH 4 LBS/CYD STRUX 9040 STRUCTURAL FIBER OR EQUIVALENT REINFORCING, UNLESS NOTED OTHERWISE.
NC12 PROVIDE BASE CONCRETE SURFACE BELOW TOPPING WITH A SMOOTH TROWELED FINISH. PLACE BOND BREAKER BETWEEN BASE CONCRETE SURFACE AND TOPPING SLAB.
NC13 PROVIDE JOINT PATTERN INDICATED IN ARCHITECTURAL DRAWINGS BUT DO NOT EXCEED JOINT SPACING OF 5 FEET ON CENTER IN EITHER DIRECTION. PROVIDE 1/2 INCH DEEP JOINTS TOOLED OR SAWED WITHIN 4 HOURS OF CONCRETE PLACEMENT.
NC14 WET CURE TOPPING SLABS.

GARAGE REPAIR NOTES:

- GR1 ALL WORK INCLUDING BUT NOT LIMITED TO REPAIR PROCEDURES, QUALITY CONTROL, QUALITY ASSURANCE, TESTING FREQUENCY AND INSPECTIONS, MUST BE PERFORMED TO MEET THE REQUIREMENTS SET IN THE MANUFACTURER'S SPECIFICATIONS.
GR2 ALL EXPANSION JOINT SEALANTS IN THE GARAGES SHALL BE REMOVED AND REPLACED:
A. JOINT SEALANT AT TRAFFIC AND PEDESTRIAN AREAS SHALL BE REPLACED WITH NYSTROM EJ-PDM FOAM JOINT SEAL TO MATCH EXISTING SIZE.
B. JOINT SEALANT AT OTHER AREAS SHALL BE REPLACED WITH A PERFORMED SEAL TO MATCH EXISTING SIZE. REFER TO ARCHITECTURAL SPECIFICATIONS.
C. INSTALLATION SHALL BE DONE STRICTLY PER THE MANUFACTURER'S SPECIFICATIONS.
GR3 PREPARATION, FINISHING, AND CURING FOR ALL REPAIRS SHALL BE AS PER THE MANUFACTURER'S SPECIFICATIONS.
GR4 SPALL CATEGORIES ARE DEFINED AS FOLLOWS AND THE CONTRACTOR SHALL FIELD VERIFY THE SPALL TYPE PRIOR TO PROCEEDING WITH THE APPLICABLE REPAIR:
A. MINOR SPALLS: DAMAGE IS LESS THAN 1 INCH DEEP AND IT COVERS AN AREA LESS THAN 12 SQ IN. HOWEVER, IF THE MAJORITY OF THE SPALL (MORE THAN 50%) OF A REINFORCING BAR OR STRAND CIRCUMFERENCE IS EXPOSED DUE TO INADEQUATE COVER, THEN THE SPALL SHALL BE CLASSIFIED AS INTERMEDIATE EVEN IF IT IS LESS THAN 1" DEEP.
B. INTERMEDIATE SPALLS: THE DAMAGE EXPOSES A MAJORITY (MORE THAN 50%) OF THE OUTER REINFORCING BAR OR STRAND CIRCUMFERENCE, OR THE DAMAGE IS GREATER THAN 2 INCHES DEEP, MAXIMUM DEPTH OF AN INTERMEDIATE SPALL IS 8 INCHES.
C. MAJOR SPALLS: THE DAMAGE EXTENDS WELL BEYOND THE OUTER LAYER OF REINFORCEMENT.
GR5 CRACK REPAIR PROCEDURES EITHER BY EPOXY INJECTION OR BY SURFACE SEALING SHALL BE PERFORMED STRICTLY PER THE MANUFACTURER'S SPECIFICATIONS. CONTACTOR SHALL FIELD VERIFY THE WIDTH OF EACH CRACK TO BE REPAIRED, AND ALL CRACKS LESS THAN 0.016 INCHES (16 MILS) NEED ONLY BE SURFACE SEALED PER THE SPECIFICATIONS. ALL CRACKS LARGER THAN 0.016 INCHES (16 MILS) SHALL BE EPOXY INJECTED TO MEET THE REQUIREMENTS IN THE TxDOT SPECIFICATIONS.

CRACK REPAIR VIA PRESSURE-INJECTED EPOXY

- MATERIALS:
1. CRACK INJECTION MATERIAL SHALL BE A TWO-PART LOW-VISCOSITY EPOXY RESIN (ASTM C 881 TYPE IV, GRADE 1). PRODUCT SHALL BE ONE OF THE FOLLOWING:
A. CE110 BY CORNERSTONE CONSTRUCTION MATERIALS
B. J-58 SLY BY DAYTON SUPERIOR
C. SIKADUR 35 HM LV BY SIKA
D. SIKADUR 52 BY SIKA
E. SIKADUR 85SLV BY SIKA
F. EPOXY 9 BY TEXAS POLYMER SYSTEMS
G. PROPOXY 50 BY UNITEX
SURFACE PREPARATION:
2. DRILL HOLES TO PERMIT INSTALLATION OF THE INJECTION PORTS OR MOUNT THE PORTS ON THE SURFACE AS REQUIRED BY THE MANUFACTURER. SPACE THE PORTS AT APPROPRIATE INTERVALS AS OUTLINED IN THE APPLICATION SECTION THAT FOLLOWS.
3. CLEAN THE INTERIOR OF THE CRACKS USING EITHER COMPRESSED AIR OR VACUUM SYSTEMS TO REMOVE ALL LOOSE MATERIALS ENTRAPPED IN THE CRACKS.
4. REMOVE CONTAMINANTS WHERE THE SURFACE SEAL WILL BE APPLIED, INCLUDING LAITANCE, OIL, DUST, DEBRIS, OR OTHER FOREIGN PARTICLES.
MIXING:
5. USE PORTABLE INJECTION EQUIPMENT CAPABLE OF AUTOMATICALLY MIXING THE LIQUID COMPONENTS AT THE PROPER PROPORTION DURING THE PRESSURE INJECTION OPERATION.
APPLICATION:
6. INSTALL THE INJECTION PORTS DIRECTLY ON THE CRACK OR IN DRILLED HOLES THAT INTERSECT THE CRACK.
7. INSTALL THE INJECTION PORTS AT APPROPRIATE INTERVALS ALONG THE CRACK.
8. THE PORT SPACING SHOULD NOT EXCEED THE DEPTH OF THE CRACK. IF THE DEPTH OF THE CRACK IS NOT KNOWN, SPACE THE PORTS AS RECOMMENDED BY THE RESIN MANUFACTURER.
9. IF THE CRACK PROJECTS THROUGH THE ENTIRE CONCRETE SECTION, THE INTERVALS BETWEEN PORTS SHOULD NOT EXCEED THE SECTION DEPTH.
10. ENSURE THAT THE PORTS ARE PLACED IN LOCATIONS WHERE THE CRACK IS NOT TOO NARROW OR CLOGGED WITH DEBRIS TO PERMIT ADEQUATE FLOW OF THE EPOXY RESIN. ANCHOR THE INJECTION PORTS AND SEAL THE SURFACE OF THE CRACK BETWEEN PORTS USING A SEALER AS REQUIRED BY THE RESIN MANUFACTURER.
11. ALLOW SUFFICIENT TIME FOR THE SEALER TO CURE BEFORE COMMENCING THE CRACK INJECTION.
12. APPLY SEALER OVER THE SURFACE OF THE CRACK ON THE BACKSIDE IF THE CRACK EXTENDS COMPLETELY THROUGH THE CONCRETE SECTION.
13. PRESSURE-INJECT THE EPOXY RESIN INTO THE CRACK THROUGH THE PORTS.
14. START INJECTING AT THE LOWEST PORT AND WORK UPWARDS.
15. MAINTAIN THE PRESSURE UNTIL RESIN EMERGES FROM THE ADJACENT PORT. IF RESIN DOES NOT EMERGE FROM THE ADJACENT PORT, STOP THE WORK AND REEVALUATE THE CRACK.
16. REMOVE THE INJECTION PORTS AND SURFACE SEALER AFTER THE EPOXY RESIN HAS BEEN GIVEN ADEQUATE TIME TO CURE. RESIN MATERIAL SHOULD NOT FLOW FROM THE CRACK AFTER THE SURFACE SEALER IS REMOVED.
FINISHING:
17. GRIND AWAY ANY EPOXY RESIN OR SURFACE SEALER RESIDUE THAT IS LEFT ON THE CONCRETE SURFACE AFTER THE INJECTED MATERIAL HAS HAD SUFFICIENT TIME TO CURE.

CRACK REPAIR VIA SURFACE SEALANT

- MATERIALS:
1. SHEP SILICONE SELECT LOW MODULUS NON-SAG BY CMC CONSTRUCTION SERVICES
B. DS8 800 BY D. S. BROWN CO.
C. DOW CORNING 888 BY DOW CORNING CORP.
D. TREMCO SPECTREM 800 BY TREMCO, INC.
E. SIKASIL 728 NS BY SIKA CORP.
2. SURFACE PREPARATION, INSTALLATION, AND CURING SHALL BE DONE STRICTLY PER THE MANUFACTURER'S SPECIFICATIONS.
MINOR SPALL REPAIR:
MATERIALS:
1. MINOR SPALLS SHALL BE BUILT UP USING TWO-PART EPOXY MORTAR (ASTM C 881 TYPE I OR IV) COMBINED IN THE RATIO REQUIRED BY THE MANUFACTURER. PRODUCT SHALL BE ONE OF THE FOLLOWING:
A. ULTRABOND 2100-1 BY ADHESIVE TECHNOLOGY
B. T-8 BY INDUSTRIAL COATINGS
C. EPOXY 8 BY TEXAS POLYMER SYSTEMS
2. FOLLOW THE REQUIREMENTS FROM THE MANUFACTURER'S TECHNICAL DATA SHEETS WHEN PROPORTIONING THE AGGREGATES AND TO ADD TO THE NEAT EPOXY.
3. IF THE PATCH WILL BE VISIBLE, USE OF A COMBINATION OF GRAY AND WHITE AGGREGATE/SAND TO MAKE THE EPOXY MORTAR MATERIAL CLOSELY RESEMBLE THE SURROUNDING CONCRETE.
SURFACE PREPARATION:
4. REMOVE ANY DAMAGED OR LOOSE CONCRETE. USE ONLY HAND TOOLS OR POWER-DRIVEN CHIPPING HAMMERS (15-LB. CLASS MAXIMUM) TO REMOVE CONCRETE.
5. IF THE DAMAGE OCCURS AT THE END OF A MEMBER AND PRESTRESSING STRAND IS EXPOSED, RECESS THE STRANDS A MINIMUM 3/8-INCH USING A TORCH OR OTHER APPROVED METHOD. DO NOT OVERHEAT OR DAMAGE THE SURROUNDING CONCRETE.
6. ENSURE SUBSTRATES ARE CLEAN AND SOUND. REMOVE ANY CONTAMINANTS, INCLUDING LAITANCE, OIL, DUST, DEBRIS, OR OTHER FOREIGN PARTICLES.
7. DO NOT INSTALL DOWELS OR PROVIDE OTHER MECHANICAL ANCHORAGE IN APPLICATIONS UP TO 1 1/2" THICK, UNLESS NOTED OTHERWISE.
MIXING:
8. BRUSH, ROLL, OR SCRUB THE MATERIAL INTO THE PREPARED SUBSTRATE TO ENSURE THAT ALL SMALL VOIDS ARE FILLED.
9. COVER THE ENTIRE DAMAGED AREA, INCLUDING EXPOSED STEEL REINFORCEMENT AND DOWELS WHEN APPLICABLE, WITH AT LEAST 10 MILS OF THE NEAT EPOXY COMPOUND.
EPOXY MORTAR APPLICATION:
10. TROWEL-APPLY THE EPOXY MORTAR INTO THE REPAIR AREA WHILE THE BONDING LAYER IS STILL TACKY. IF THE BONDING LAYER LOSES ITS TACKINESS PRIOR TO PATCHING, CLEAN THE EPOXY SURFACE AND APPLY ADDITIONAL NEAT EPOXY BEFORE PROCEEDING.
11. LIMIT REPAIR DEPTH TO 1 INCH WHEN USING EPOXY MORTAR UNLESS OTHERWISE APPROVED BY THE ENGINEER.
12. IN MULTIPLE LIFT APPLICATIONS WAIT UNTIL PREVIOUS LIFT HAS CURED SUFFICIENTLY TO PREVENT SAGGING PRIOR TO APPLYING THE NEXT LIFT. APPLY A BONDING LAYER OF NEAT EPOXY BETWEEN EACH LIFT.

INTERMEDIATE SPALL REPAIR:

- MATERIALS:
1. FOR PATCHING VERTICAL AND OVERHEAD SPALLS THAT ARE LESS THAN 3" DEEP, USE ONE OF THE FOLLOWING MATERIALS:
A. MASTEREMACO S 8000 BY BASF
B. MASTEREMACO T 545 HT BY BASF
C. MASTEREMACO T 1000 BY BASF
D. RAPID SET LOW P BY CTS CEMENT MANUFACTURING CORP.
E. VERSASPEED LS BY EUCLID
F. REPCON 928 BY SPECICHEM
G. STR MORTAR BY US SPEC
H. FASTRAC 300 BY WESTERN MATERIALS
2. FOR PATCHING VERTICAL AND OVERHEAD SPALLS UP TO 6" DEEP, USE ONE OF THE FOLLOWING PRODUCTS:
A. SL BY CERATECH
B. QUADRASET BY OLDCASTLE APG WEST
C. SIKACRETE 321 FS BY SIKA
D. LIGHTNINGCRETE BY TEXAS POLYMER SYSTEMS
E. FUTURA-45 EXTENDED BY W. E. MEADOWS
F. FASTRAC 225FO BY WESTERN MATERIALS
G. FASTRAC 246 BY WESTERN MATERIALS
3. IF THE PATCH WILL BE VISIBLE, USE OF A COMBINATION OF GRAY AND WHITE AGGREGATE/SAND TO MAKE THE EPOXY MORTAR MATERIAL CLOSELY RESEMBLE THE SURROUNDING CONCRETE.
SURFACE PREPARATION:
4. REMOVE ANY DAMAGED OR LOOSE CONCRETE. USE ONLY HAND TOOLS OR POWER-DRIVEN CHIPPING HAMMERS (15-LB. CLASS MAXIMUM) TO REMOVE CONCRETE.
5. IF THE DAMAGE OCCURS AT THE END OF A MEMBER AND PRESTRESSING STRAND IS EXPOSED, RECESS THE STRANDS A MINIMUM 3/8-INCH USING A TORCH OR OTHER APPROVED METHOD. DO NOT OVERHEAT OR DAMAGE THE SURROUNDING CONCRETE.
6. IF MORE THAN 1/2 THE PERIMETER OF ANY MILD REINFORCEMENT IS EXPOSED OR IF THE EXPOSED BAR EXHIBITS SIGNIFICANT CORROSION, REMOVE THE CONCRETE FROM AROUND THE ENTIRE BAR.
7. PROVIDE 3/4 INCH CLEARANCE OR 1.5 TIMES THE LARGEST SIZED AGGREGATE IN THE REPAIR MATERIAL, WHICHEVER IS GREATER, BETWEEN THE STEEL AND SURROUNDING CONCRETE TO PERMIT ADEQUATE FLOW OF THE REPAIR MATERIAL.
8. SAW-CUT THE PATCH PERIMETERS TO ELIMINATE FEATHERED EDGES AND TO ENSURE THAT THE REPAIR MATERIAL WILL BE APPLIED IN DEPTHS NO LESS THAN 1/2 INCH.
9. DO NOT OVER-CUT THE PATCH PERIMETERS AT THE CORNERS OF THE REPAIR AREAS.
10. ROUGHEN THE SUBSTRATE TO ENSURE THAT THERE WILL BE A MECHANICAL BOND BETWEEN THE PATCH MATERIAL AND THE PARENT CONCRETE. ATTAIN A MINIMUM SURFACE ROUGHNESS PROFILE OF 1/8" OR CSP 6 PER ICRI.
11. WHEN NO REINFORCING BAR IS EXPOSED, INSTALL ANCHORS AT NO MORE THAN 4 INCHES ON CENTER EACH WAY OR AS SHOWN IN THE DETAILS. THE ANCHORS SHALL BE REBAR OR TREATED STAINLESS STEEL PINS (1/2-INCH DIAMETER MINIMUM) ANCHORED IN PLACE USING STRUCTURAL EPOXY. REMOVE ANY EPOXY THAT LEAKS ONTO THE PATCH SUBSTRATE AFTER THE ANCHOR IS PLACED. SEE "POST-INSTALLED ANCHORS" NOTES.
12. SUBSTRATES MUST BE CLEAN AND SOUND. REMOVE ANY CONTAMINANTS, INCLUDING LAITANCE, OIL, DUST, DEBRIS, OR OTHER FOREIGN PARTICLES.
MIXING:
13. DO NOT MIX MATERIALS UNTIL THE SURFACE PREPARATION IS COMPLETE AND THE SUBSTRATE IS READY FOR APPLICATION OF THE REPAIR MATERIAL.
14. MIX ONLY THE AMOUNT OF MATERIAL NECESSARY FOR IMMEDIATE APPLICATION.
APPLICATION:
15. APPLY OVER A BONDING LAYER, WHICH CONSISTS OF A SCRUB COAT BRUSHED INTO THE SSD SUBSTRATE.
16. APPLY THE REPAIR MATERIAL WHILE THE BONDING LAYER IS STILL WET.
17. FOR MULTIPLE LIFT APPLICATIONS, ROUGHEN THE SURFACE OF THE PRECEDING LIFT BEFORE IT HAS REACHED INITIAL SET.
18. FOR VERTICAL AND OVERHEAD REPAIRS, LIMIT LIFT THICKNESS TO 2" OR THE MAXIMUM PERMITTED BY THE REPAIR MATERIAL SUPPLIER, WHICHEVER IS LESS.
19. IT IS PARAMOUNT TO THE LONG-TERM SUCCESS OF THE REPAIR THAT PROPER MOIST CURING COMMENCE AS SOON AS POSSIBLE AFTER APPLICATION OF THE REPAIR MATERIAL, AND THAT IT CONTINUE FOR A SUFFICIENT AMOUNT OF TIME THEREAFTER.
20. DO NOT ALLOW CONCRETE SURFACES TO BECOME DRY DURING THE SPECIFIED MOIST CURING PERIOD. ENSURE THAT WET MATS ARE KEPT WET DURING THE ENTIRE CYCLE.
FINISH:
21. IF REPAIR WILL REMAIN EXPOSED, ENSURE THAT THE PATCHES CLOSELY RESEMBLE THE SURROUNDING CONCRETE.

MAJOR SPALL REPAIR AND CONCRETE REPLACEMENT

- MATERIALS:
1. USE BATCHED CONCRETE FOR PATCHING LARGE SPALLS AND DEFECTS IN CONCRETE MEMBERS, OR WHEN REMOVING AND REPLACING LARGE CONCRETE COMPONENTS.
2. IF THE PATCH WILL BE VISIBLE, USE OF A COMBINATION OF GRAY AND WHITE AGGREGATE/SAND TO MAKE THE REPAIR MATERIAL CLOSELY RESEMBLE THE SURROUNDING CONCRETE.
SURFACE PREPARATION:
3. REMOVE ANY DAMAGED OR LOOSE CONCRETE. USE ONLY HAND TOOLS OR POWER-DRIVEN CHIPPING HAMMERS (15-LB. CLASS MAXIMUM) TO REMOVE CONCRETE.
4. IF MORE THAN 1/2 THE PERIMETER OF ANY MILD REINFORCEMENT IS EXPOSED OR IF THE EXPOSED BAR EXHIBITS SIGNIFICANT CORROSION, REMOVE THE CONCRETE FROM AROUND THE ENTIRE BAR.
5. PROVIDE 3/4 INCH CLEARANCE OR 1.5 TIMES THE LARGEST SIZED AGGREGATE IN THE REPAIR MATERIAL, WHICHEVER IS GREATER, BETWEEN THE STEEL AND SURROUNDING CONCRETE TO PERMIT ADEQUATE FLOW OF THE REPAIR MATERIAL.
6. SQUARE THE PATCH PERIMETERS TO ELIMINATE FEATHERED EDGES AND TO ENSURE THAT THE REPAIR MATERIAL WILL BE APPLIED IN DEPTHS NO LESS THAN 1/2 INCH.
7. ROUGHEN THE SUBSTRATE TO ENSURE THAT THERE WILL BE A MECHANICAL BOND BETWEEN THE PATCH MATERIAL AND THE PARENT CONCRETE. ATTEMPT TO ATTAIN A MINIMUM SURFACE ROUGHNESS PROFILE OF 1/8" OR CSP 6 (CONCRETE SURFACE PROFILE) 6 PER ICRI.
8. WHERE SUPPLEMENTAL REINFORCEMENT IS INSTALLED, ENSURE MINIMUM COVER OF 1".
9. SUBSTRATES MUST BE CLEAN AND SOUND. REMOVE ANY CONTAMINANTS, INCLUDING LAITANCE, OIL, DUST, DEBRIS, OR OTHER FOREIGN PARTICLES.
MIXING:
10. PRODUCE REPAIR MATERIAL IN ACCORDANCE WITH APPROVED METHODS FOR BATCHING CONCRETE.
11. ENSURE THAT CONCRETE IS FLUID ENOUGH WHEN IT IS PLACED THAT IT CAN BE ADEQUATELY CONSOLIDATED AROUND REINFORCING STEEL, ANCHORS, AND OTHER TIGHT PLACES INSIDE THE FORMS.
APPLICATION:
12. APPLY THE REPAIR MATERIAL OVER AN SSD SUBSTRATE.
FORMWORK:
13. PREPARE AND INSTALL THE FORMS PRIOR TO MIXING THE REPAIR MATERIAL. ENSURE THAT FORMS ARE TIGHT ENOUGH TO PREVENT GROUT LEAKAGE.
14. PLACE THE REPAIR MATERIAL IN THE FORMS WHILE THE CONCRETE SUBSTRATE IS STILL SSD. IF THE PARENT CONCRETE IS NO LONGER SSD, REMOVE THE FORMS AND RE-SPRAY THE SURFACE WITH WATER.
15. CONSOLIDATE THE MATERIAL BY RODDING, VIBRATING, AND/OR HAMMERING THE FORMS. DO NOT OVER-VIBRATE THE MIX. OBTAIN CONCRETE TEST CYLINDERS TO DETERMINE THE COMPRESSIVE STRENGTH OF THE PATCH MATERIAL.
CURING:
17. CURE BATCHED CONCRETE REPAIRS FOR A MINIMUM OF 72 HOURS. PLACE WET MATS ON EXPOSED SECTIONS AND OVER THE OPENINGS TO PLACE THE MATERIAL. DO NOT ALLOW CONCRETE SURFACES TO BECOME DRY DURING THE SPECIFIED MOIST CURING PERIOD.

EXTERNALLY BONDED FIBER REINFORCED POLYMER (FRP) FOR SHEAR STRENGTHENING OF CONCRETE BEAMS:

- FRP1 THE FRP SYSTEM INCLUDES THE FRP SHEETS AND THE AGENTS USED TO BOND THE FRP SHEETS TO CONCRETE SURFACES.
FRP2 THE FRP SYSTEMS SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS:
A. ULTIMATE TENSILE STRENGTH IN PRIMARY FIBER DIRECTION 550 KSI BASED ON GROSS-LAMINATE AREA (FIBER-DRY)
B. ULTIMATE TENSILE STRAIN 1.5%
C. TENSILE MODULUS BASED ON GROSS-LAMINATE AREA 34,000 KSI
D. GLASS TRANSITION TEMPERATURE FOR FRP & BONDING AGENT 120 DEG F
E. BOND STRENGTH TO SUBSTRATE CONCRETE 200 PSI
F. FIBER THICKNESS MIN 0.07 IN.
G. COEFFICIENT OF THERMAL EXPANSION 3.0 x 10^-4 IN / IN / DEG F
FRP3 THE FOLLOWING FRP PRODUCTS (UNI-DIRECTIONAL 0°) ARE ACCEPTABLE FOR USE ON THIS PROJECT:
A. SIKA CORP. SIKAWRAP HEX-103C 2X
B. STRUCTURAL TECHNOLOGIES V-WRAP C40H.
FRP4 FIBERS: ALLOWABLE FIBER TYPES INCLUDE CARBON ONLY. THE FIBER MUST OCCUPY 30-70% OF THE MATRIX VOLUME IN THE COMPOSITES.
FRP5 RESINS: RESINS USED TO PRODUCE FRP SHOULD PROVIDE A MATRIX THAT IS ABLE TO TRANSFER LOAD TO FIBERS WITHOUT SIGNIFICANT PULLOUT BEFORE FAILURE. ONLY THERMOSET RESINS ARE ALLOWED, INCLUDING POLYESTERS, EPOXES, VINYL ESTERS, POLYURETHANES, AND PHENOLICS.
FRP6 THE FRP PRODUCER MUST PROVIDE OR SPECIFY THE BONDING AGENT.
FRP7 PACKAGE FRP AND BONDING AGENT MATERIALS IN SUITABLE MOISTURE-RESISTANT CONTAINERS. ALL MATERIALS MUST INDICATE THE BRAND NAME, DATE OF MANUFACTURE, LOT NUMBER, AND MIXING/PLACING INSTRUCTIONS.
FRP8 CONCRETE SURFACE TO WHICH FRP WILL BE APPLIED MUST BE CLEAN AND SOUND. REMOVE DUST, LAITANCE, GREASE, CURING COMPOUNDS, IMPREGNATIONS, WAXES, FOREIGN PARTICLES, AND OTHER BOND-INHIBITING MATERIALS FROM THE SURFACE.
FRP9 EXISTING UNEVEN SURFACES MUST BE FILLED WITH REPAIR MORTAR. MAXIMUM OUT-OF-PLANE VARIATION IS 1/32".
FRP10 THE ADHESIVE STRENGTH OF THE CONCRETE MUST BE VERIFIED AFTER SURFACE PREPARATION BY RANDOM PULL-OFF TESTING (ACI 903R). PERFORM ONE TEST FOR EVERY TWELVE BEAMS REPAIRED. THE MINIMUM TENSILE STRENGTH IS 200 PSI, WITH CONCRETE SUBSTRATE FAILURE. REPAIR AREA AFTER TEST.
FRP11 PREPARE CONCRETE SURFACE BY BLAST CLEAN OR SHOTBLAST TO PROVIDE AN OPEN ROUGHENED TEXTURE (CONCRETE SURFACE PROFILE 9).
FRP12 THE CONCRETE SUBSTRATE SHALL BE BETWEEN A DRY AND SATURATED SURFACE DRY CONDITION.

STATEMENT OF SPECIAL INSPECTIONS:


- SI1 THIS STATEMENT OF SPECIAL INSPECTIONS IS SUBMITTED IN ACCORDANCE WITH THE SPECIAL INSPECTION AND STRUCTURAL TESTING REQUIREMENTS OF THE BUILDING CODE WITH LOCAL AMENDMENTS. IT INCLUDES A SCHEDULE OF SPECIAL INSPECTIONS SERVICES APPLICABLE TO THIS PROJECT.
SI2 THE OWNER SHALL EMPLOY ONE OR MORE QUALIFIED SPECIAL INSPECTORS, APPROVED BY THE BUILDING OFFICIAL, TO PERFORM SPECIAL INSPECTIONS AND TESTS DURING CONSTRUCTION IN ACCORDANCE WITH BUILDING CODE. SPECIAL INSPECTORS SHALL PERFORM ALL DUTIES AND RESPONSIBILITIES AS REQUIRED BY THE BUILDING CODE. JOB SITE VISITS BY THE STRUCTURAL ENGINEER DO NOT CONSTITUTE AND ARE NOT A SUBSTITUTE FOR SPECIAL INSPECTIONS. ALL INSPECTORS SHALL BE QUALIFIED BY TRAINING AND EXPERIENCE FOR THE REQUIRED INSPECTIONS AND TEST PROCEDURES.
SI3 THE SPECIAL INSPECTOR SHALL KEEP RECORDS OF ALL SPECIAL INSPECTIONS AND TESTS AND SHALL SUBMIT REPORTS OF INSPECTIONS AND TESTS TO THE BUILDING OFFICIAL AND THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE. REPORTS SHALL INDICATE THAT WORK INSPECTED OR TESTED WAS OR WAS NOT COMPLETED IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO COMPLETION OF THAT PHASE OF THE WORK. INTERIM TESTING AND INSPECTION REPORTS SHALL BE SUBMITTED ON A DAILY BASIS TO THE BUILDING OFFICIAL AND THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE. A FINAL REPORT DOCUMENTING THE REQUIRED SPECIAL INSPECTIONS AND TESTS, AND CORRECTION OF ANY DISCREPANCIES NOTED IN THE INSPECTIONS OR TESTS, SHALL BE SUBMITTED AT A POINT IN TIME AGREED UPON PRIOR TO THE START OF WORK BY THE OWNER OR THE OWNER'S AUTHORIZED AGENT TO THE BUILDING OFFICIAL.
SI4 IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO ENSURE THE REQUIRED SPECIAL INSPECTIONS AND TESTS ARE PERFORMED IN ACCORDANCE WITH THE BUILDING CODE AND CONSTRUCTION DOCUMENTS. THE SPECIAL INSPECTION PROGRAM DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO COMPLY WITH THE CONTRACT DOCUMENTS. JOB SITE SAFETY AND MEANS AND METHODS OF CONSTRUCTION ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.
SI5 ARCHITECTURAL, MECHANICAL AND ELECTRICAL COMPONENTS REQUIRING SPECIAL INSPECTIONS AND TESTING PER THE BUILDING CODE ARE NOT LISTED HERE. REFER TO ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR SPECIAL INSPECTION REQUIREMENTS FOR THESE COMPONENTS.
SI6 THE FOLLOWING SPECIAL INSPECTIONS AND TESTS SCHEDULE CONTAINS A LIST OF THE MATERIALS, SYSTEMS, COMPONENTS AND WORK REQUIRED TO HAVE SPECIAL INSPECTIONS AND/OR TESTS BY THE SPECIAL INSPECTOR RESPONSIBLE FOR EACH PORTION OF THE WORK. REFER TO THE GENERAL NOTES AND PROJECT SPECIFICATIONS FOR ADDITIONAL INSPECTION AND TESTING REQUIREMENTS, WHERE CONFLICTS OCCUR, THE MOST STRINGENT REQUIREMENT SHALL CONTROL.

Table with 3 columns: CHECK IF APPLICABLE, MATERIALS, SYSTEMS, COMPONENTS AND WORK REQUIRED TO HAVE SPECIAL INSPECTIONS OR TESTS BY THE SPECIAL INSPECTOR RESPONSIBLE FOR EACH PORTION OF THE WORK, SPECIAL INSPECTION SHALL BE PERFORMED IN ACCORDANCE WITH IBC SECTION. Rows include STRUCTURAL STEEL, CONCRETE CONSTRUCTION, MASONRY CONSTRUCTION, WOOD CONSTRUCTION, SOILS, DRIVEN DEEP FOUNDATIONS, CAST-IN-PLACE DEEP FOUNDATIONS, HELICAL PILE FOUNDATIONS, FABRICATED ITEMS, SPECIAL INSPECTIONS FOR WIND RESISTANCE, SPECIAL INSPECTIONS FOR SEISMIC RESISTANCE, TESTING FOR SEISMIC RESISTANCE.

1 GENERAL NOTES
12" = 1'-0"



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

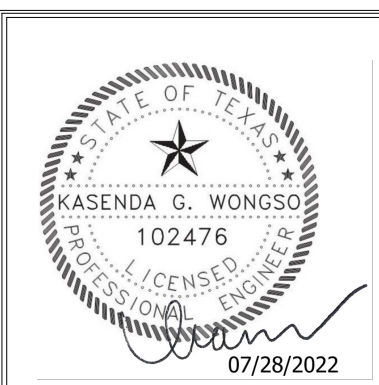

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

Table with 3 columns: NO., DATE, DESCRIPTION. Rows include 2023-02-23 30% DESIGN, 2022-01-09 70% DESIGN, 2022-03-01 100% DESIGN, 2022-07-28 100% REVIEW FOR PERMIT (FRP).

NOT FOR BID OR CONSTRUCTION

DFW TERMINAL C GARAGE AND ROADWAYS

GENERAL NOTES - GARAGE A


SHEET NUMBER

S-003-900A


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

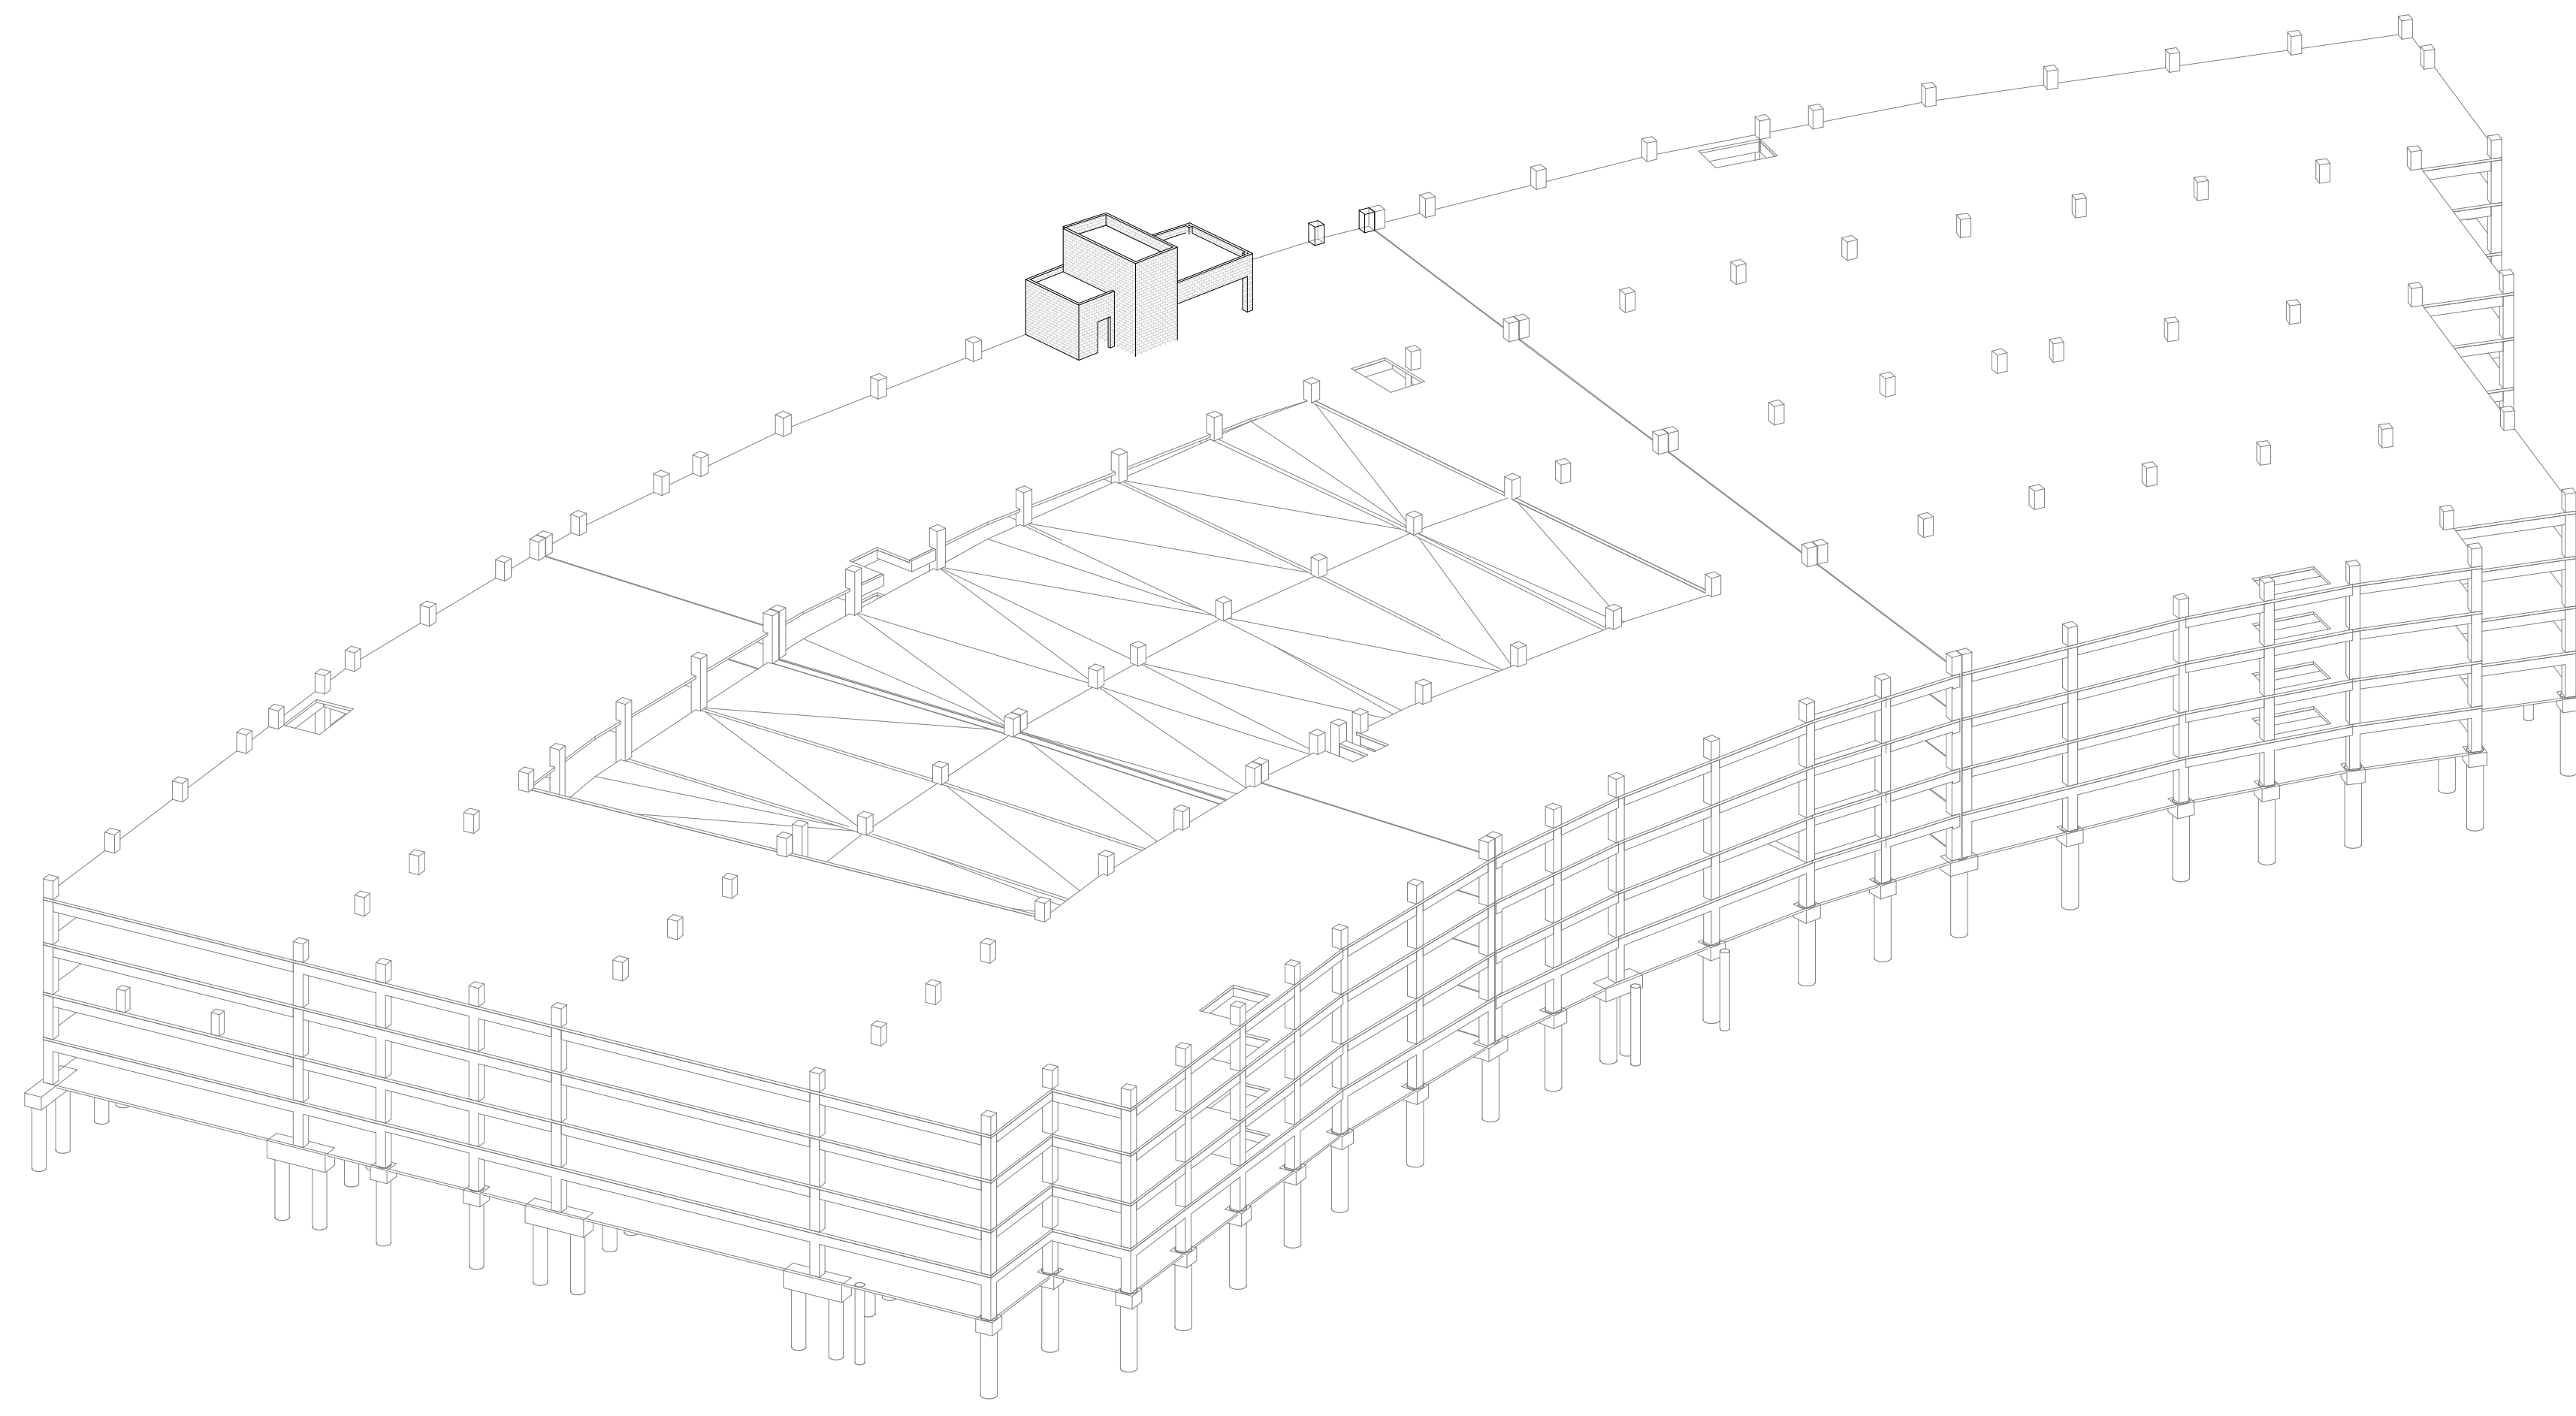

1 GARAGE A OVERALL 3D VIEW


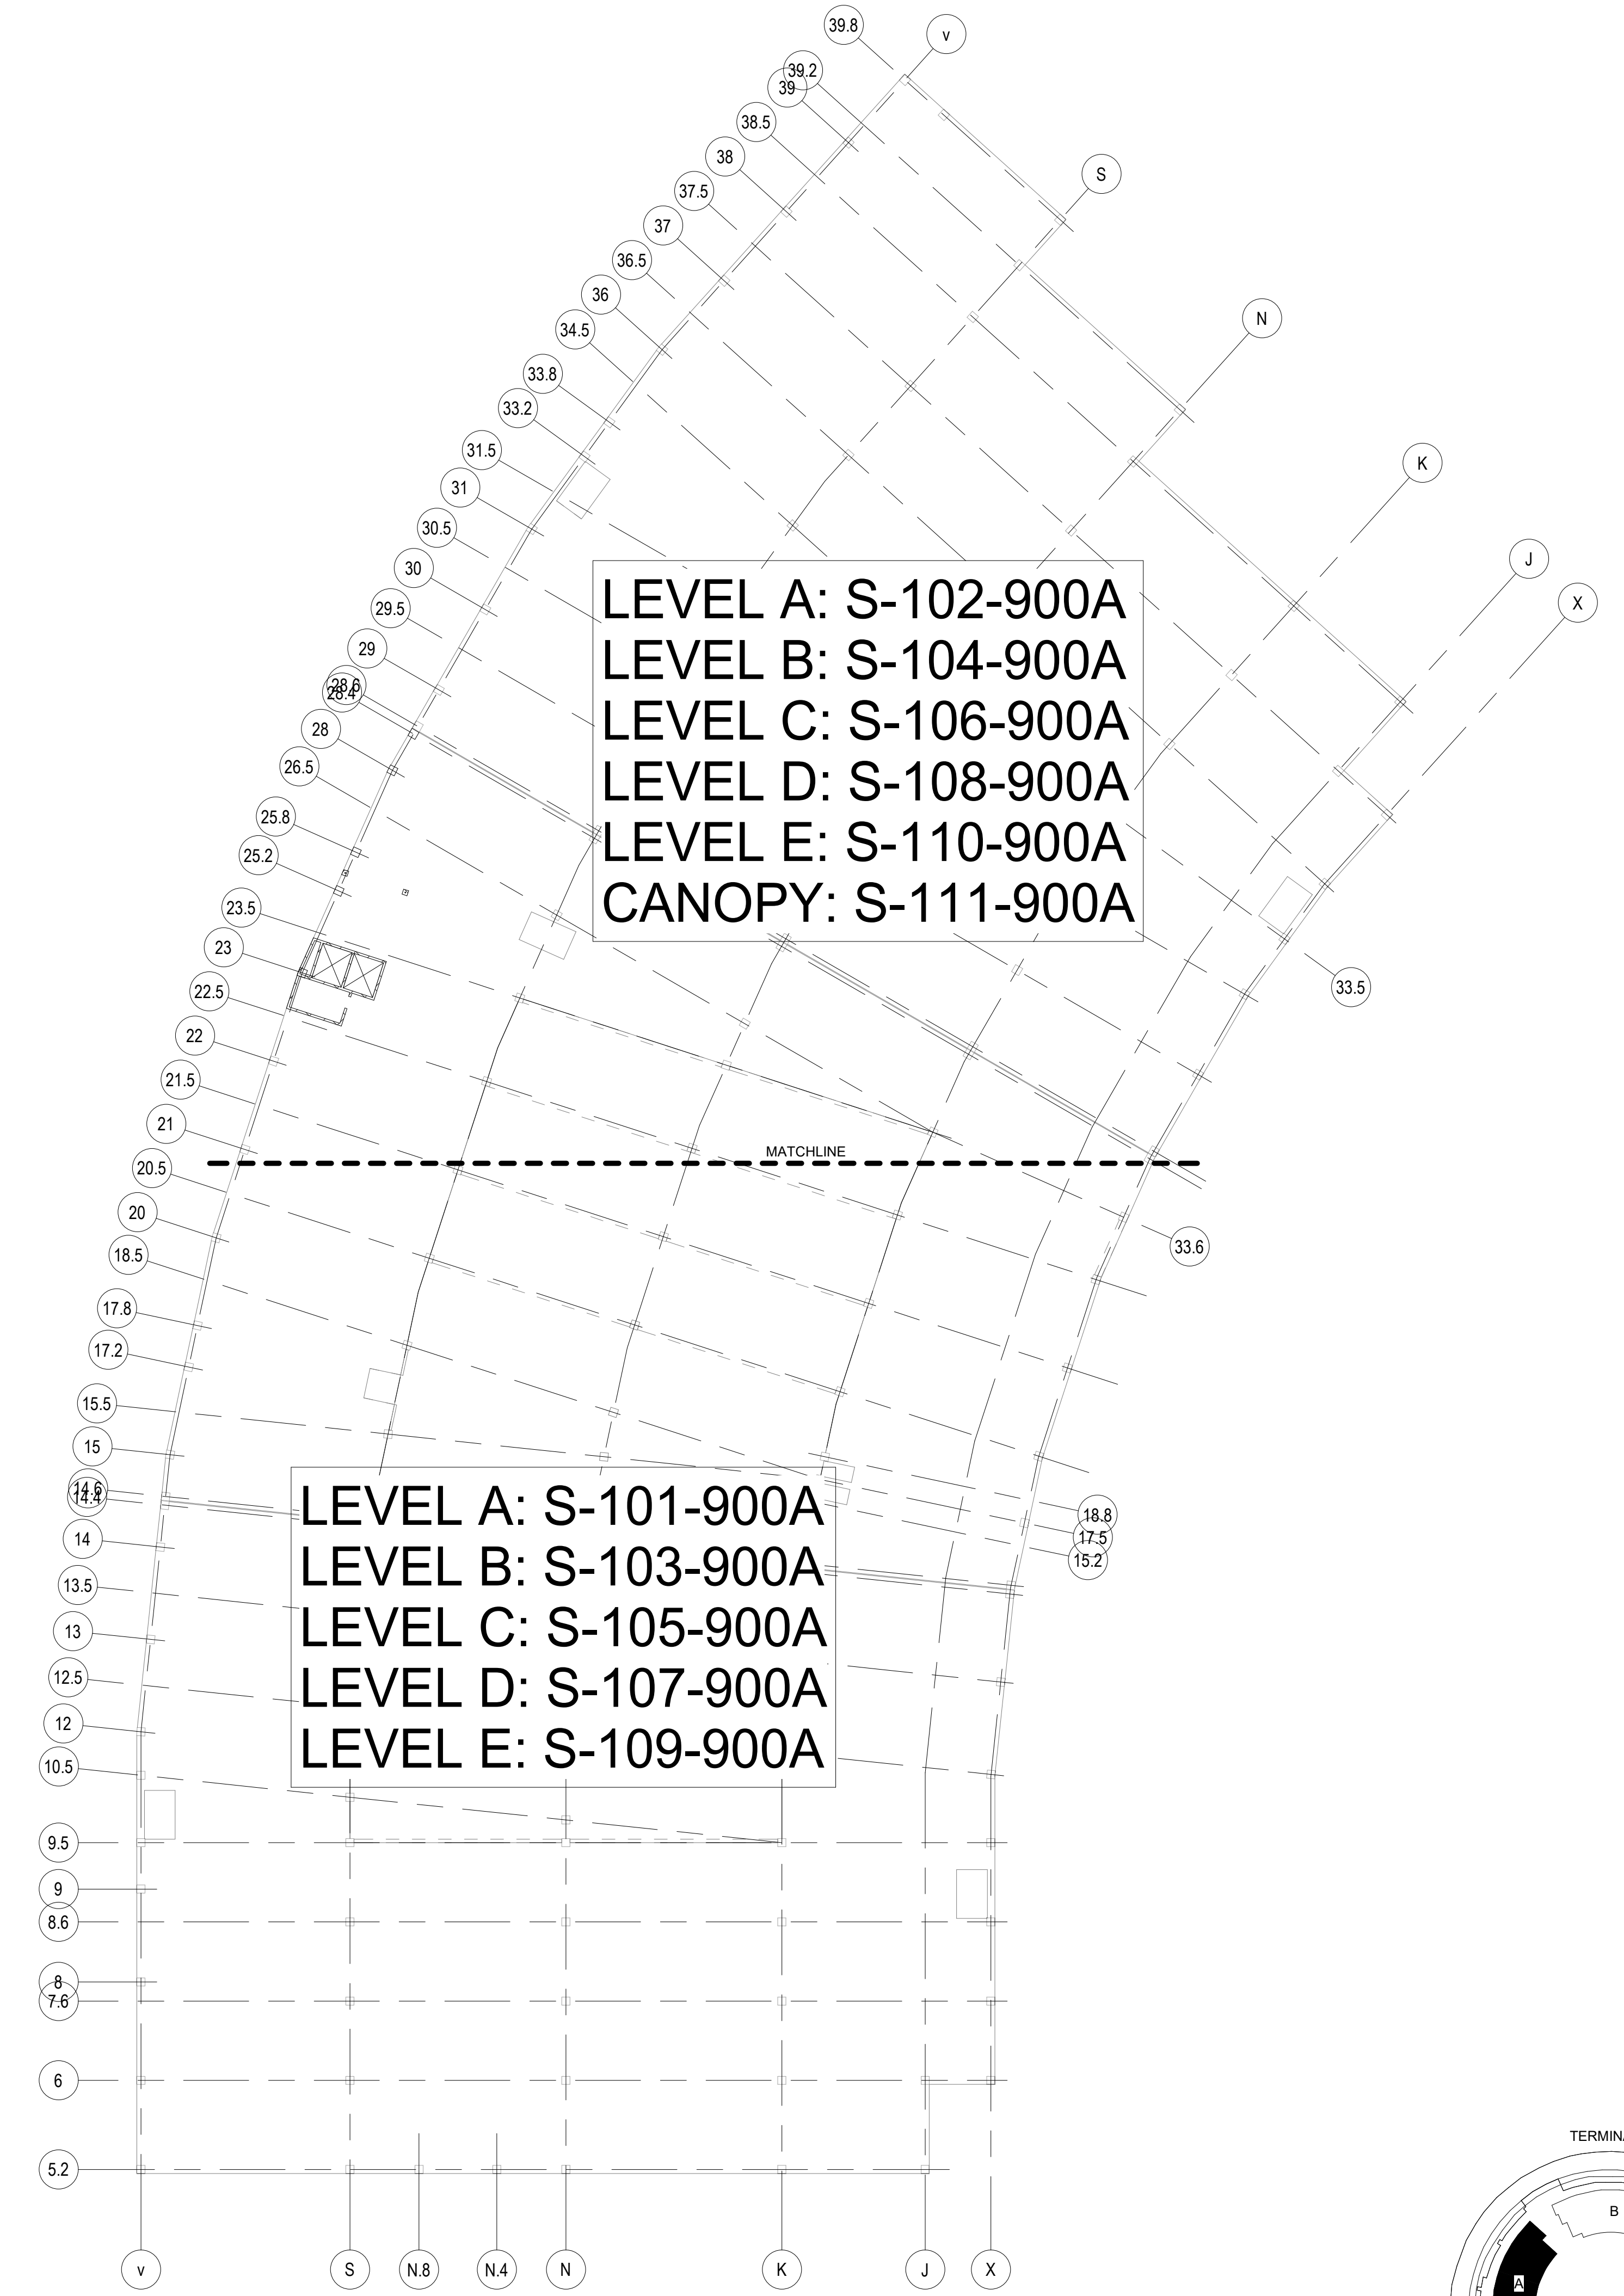


2 GARAGE A OVERALL PLAN
 1" = 30'-0"

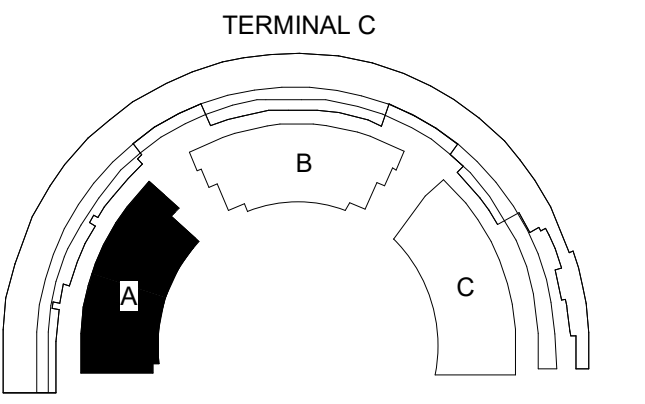

DFW
 DALLAS
 FORT WORTH
 INTERNATIONAL
 AIRPORT

2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

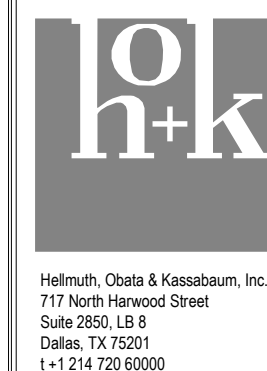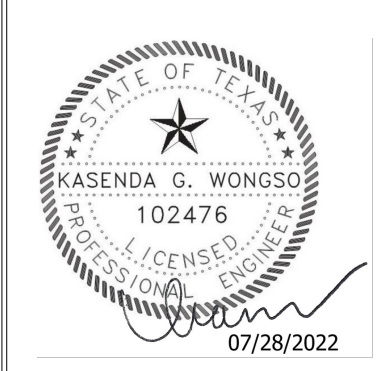

PROJECT # 21084.00000
 15200 Addison Road, Suite 310
 Addison, Texas 75001
 Ph: 214-430-7900
 www.agne.com
 TX REG. NO. F-8439
 Dallas, TX 75201
 1-214-725-6000

DRAWN BY: ADD/GY
 APPROVED BY: KW
 ISSUE DATE: 2022-07-28

**NOT FOR BID OR
 CONSTRUCTION**

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007


DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A OVERALL 3D VIEW & PLAN

PERMIT NUMBER: B22-0022


SHEET NUMBER
S-100-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LA-N-01	WALL SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LA-N-02	CURB SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LA-N-03	HORIZONTAL JOINT SEAL FAILURE	REPAIR JOINT SEAL MATERIAL PER GENERAL NOTES
A-LA-N-04	VERTICAL JOINT SEAL FAILURE	REPAIR JOINT SEAL MATERIAL PER GENERAL NOTES

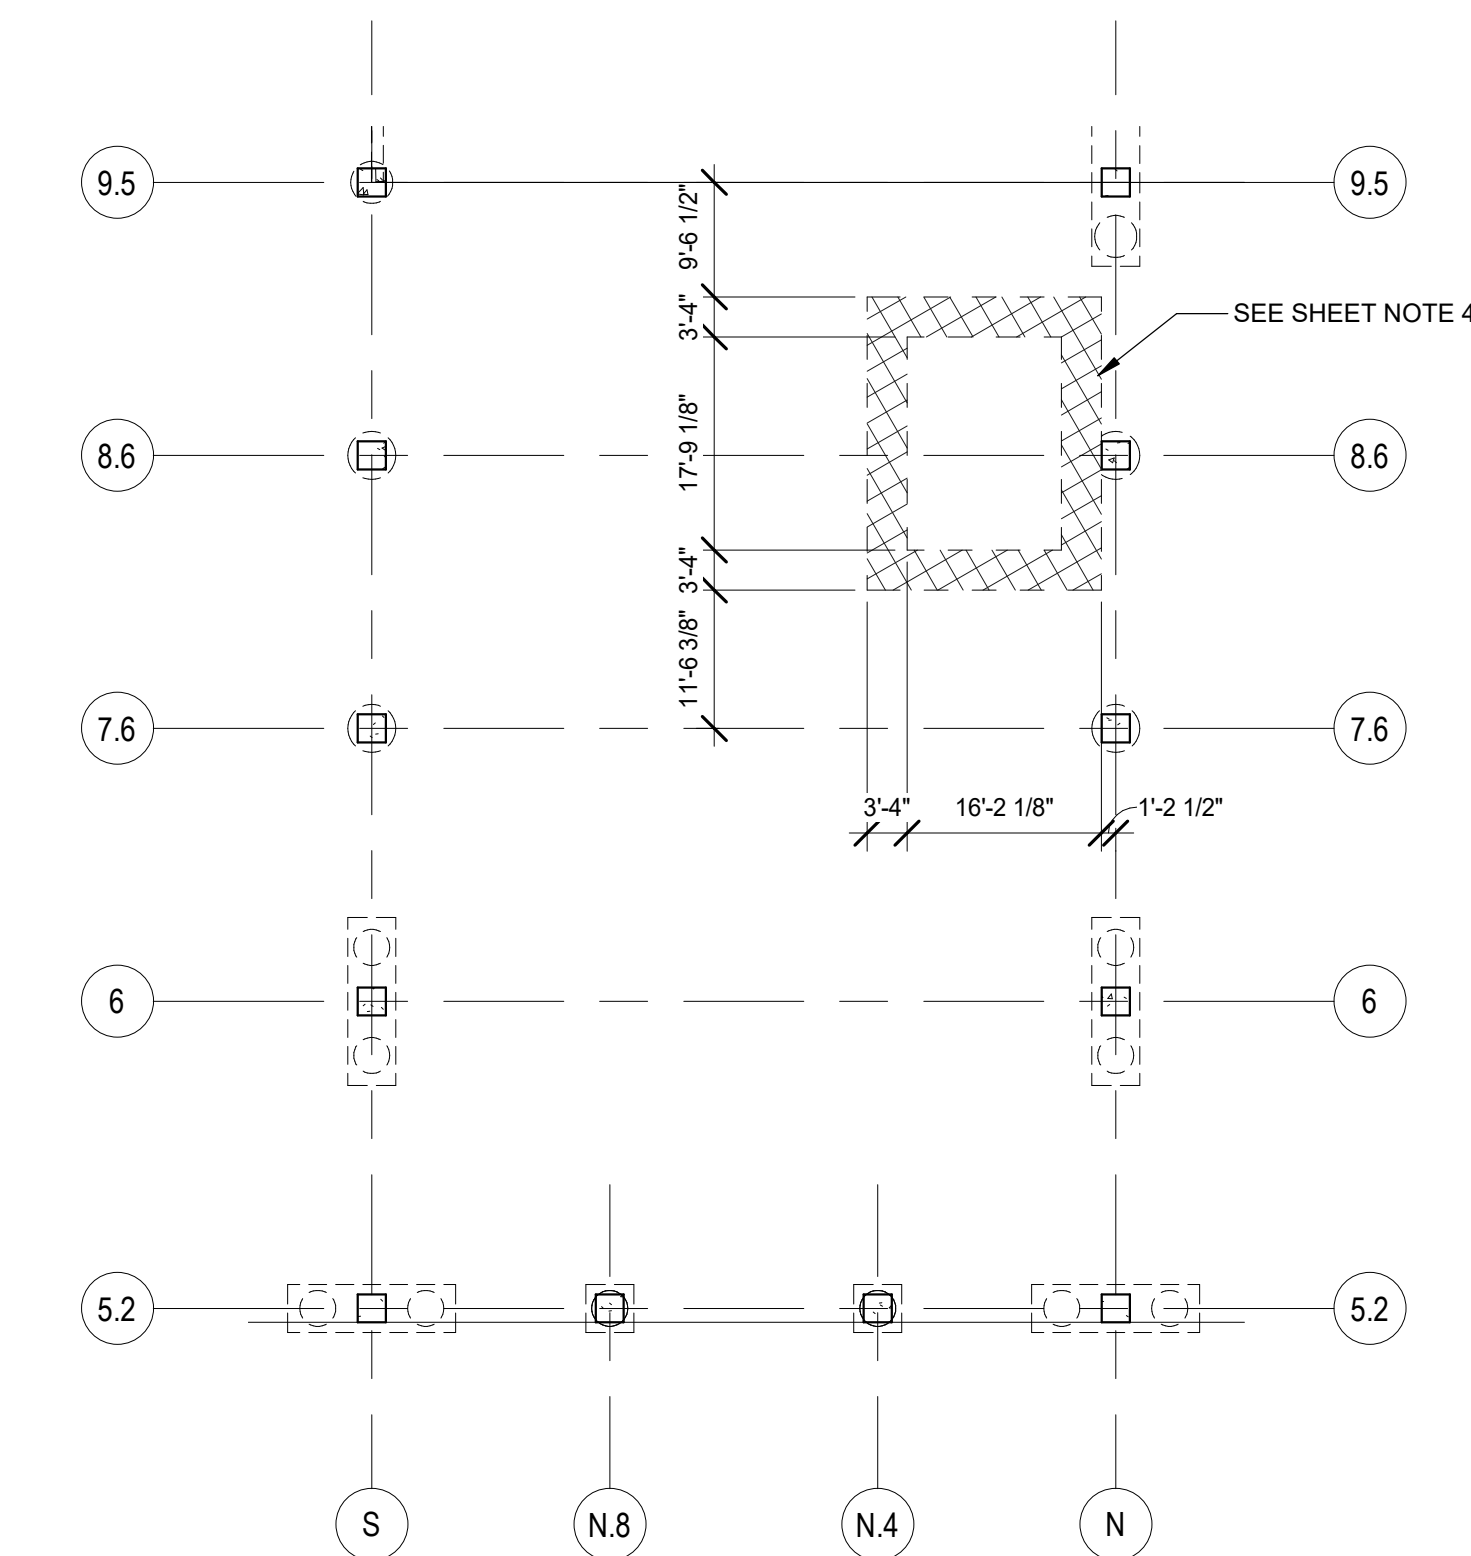


2 GARAGE A LEVEL A - PARTIAL DEMO PLAN AT NORTH ELECTRICAL ROOM
1/16" = 1'-0"

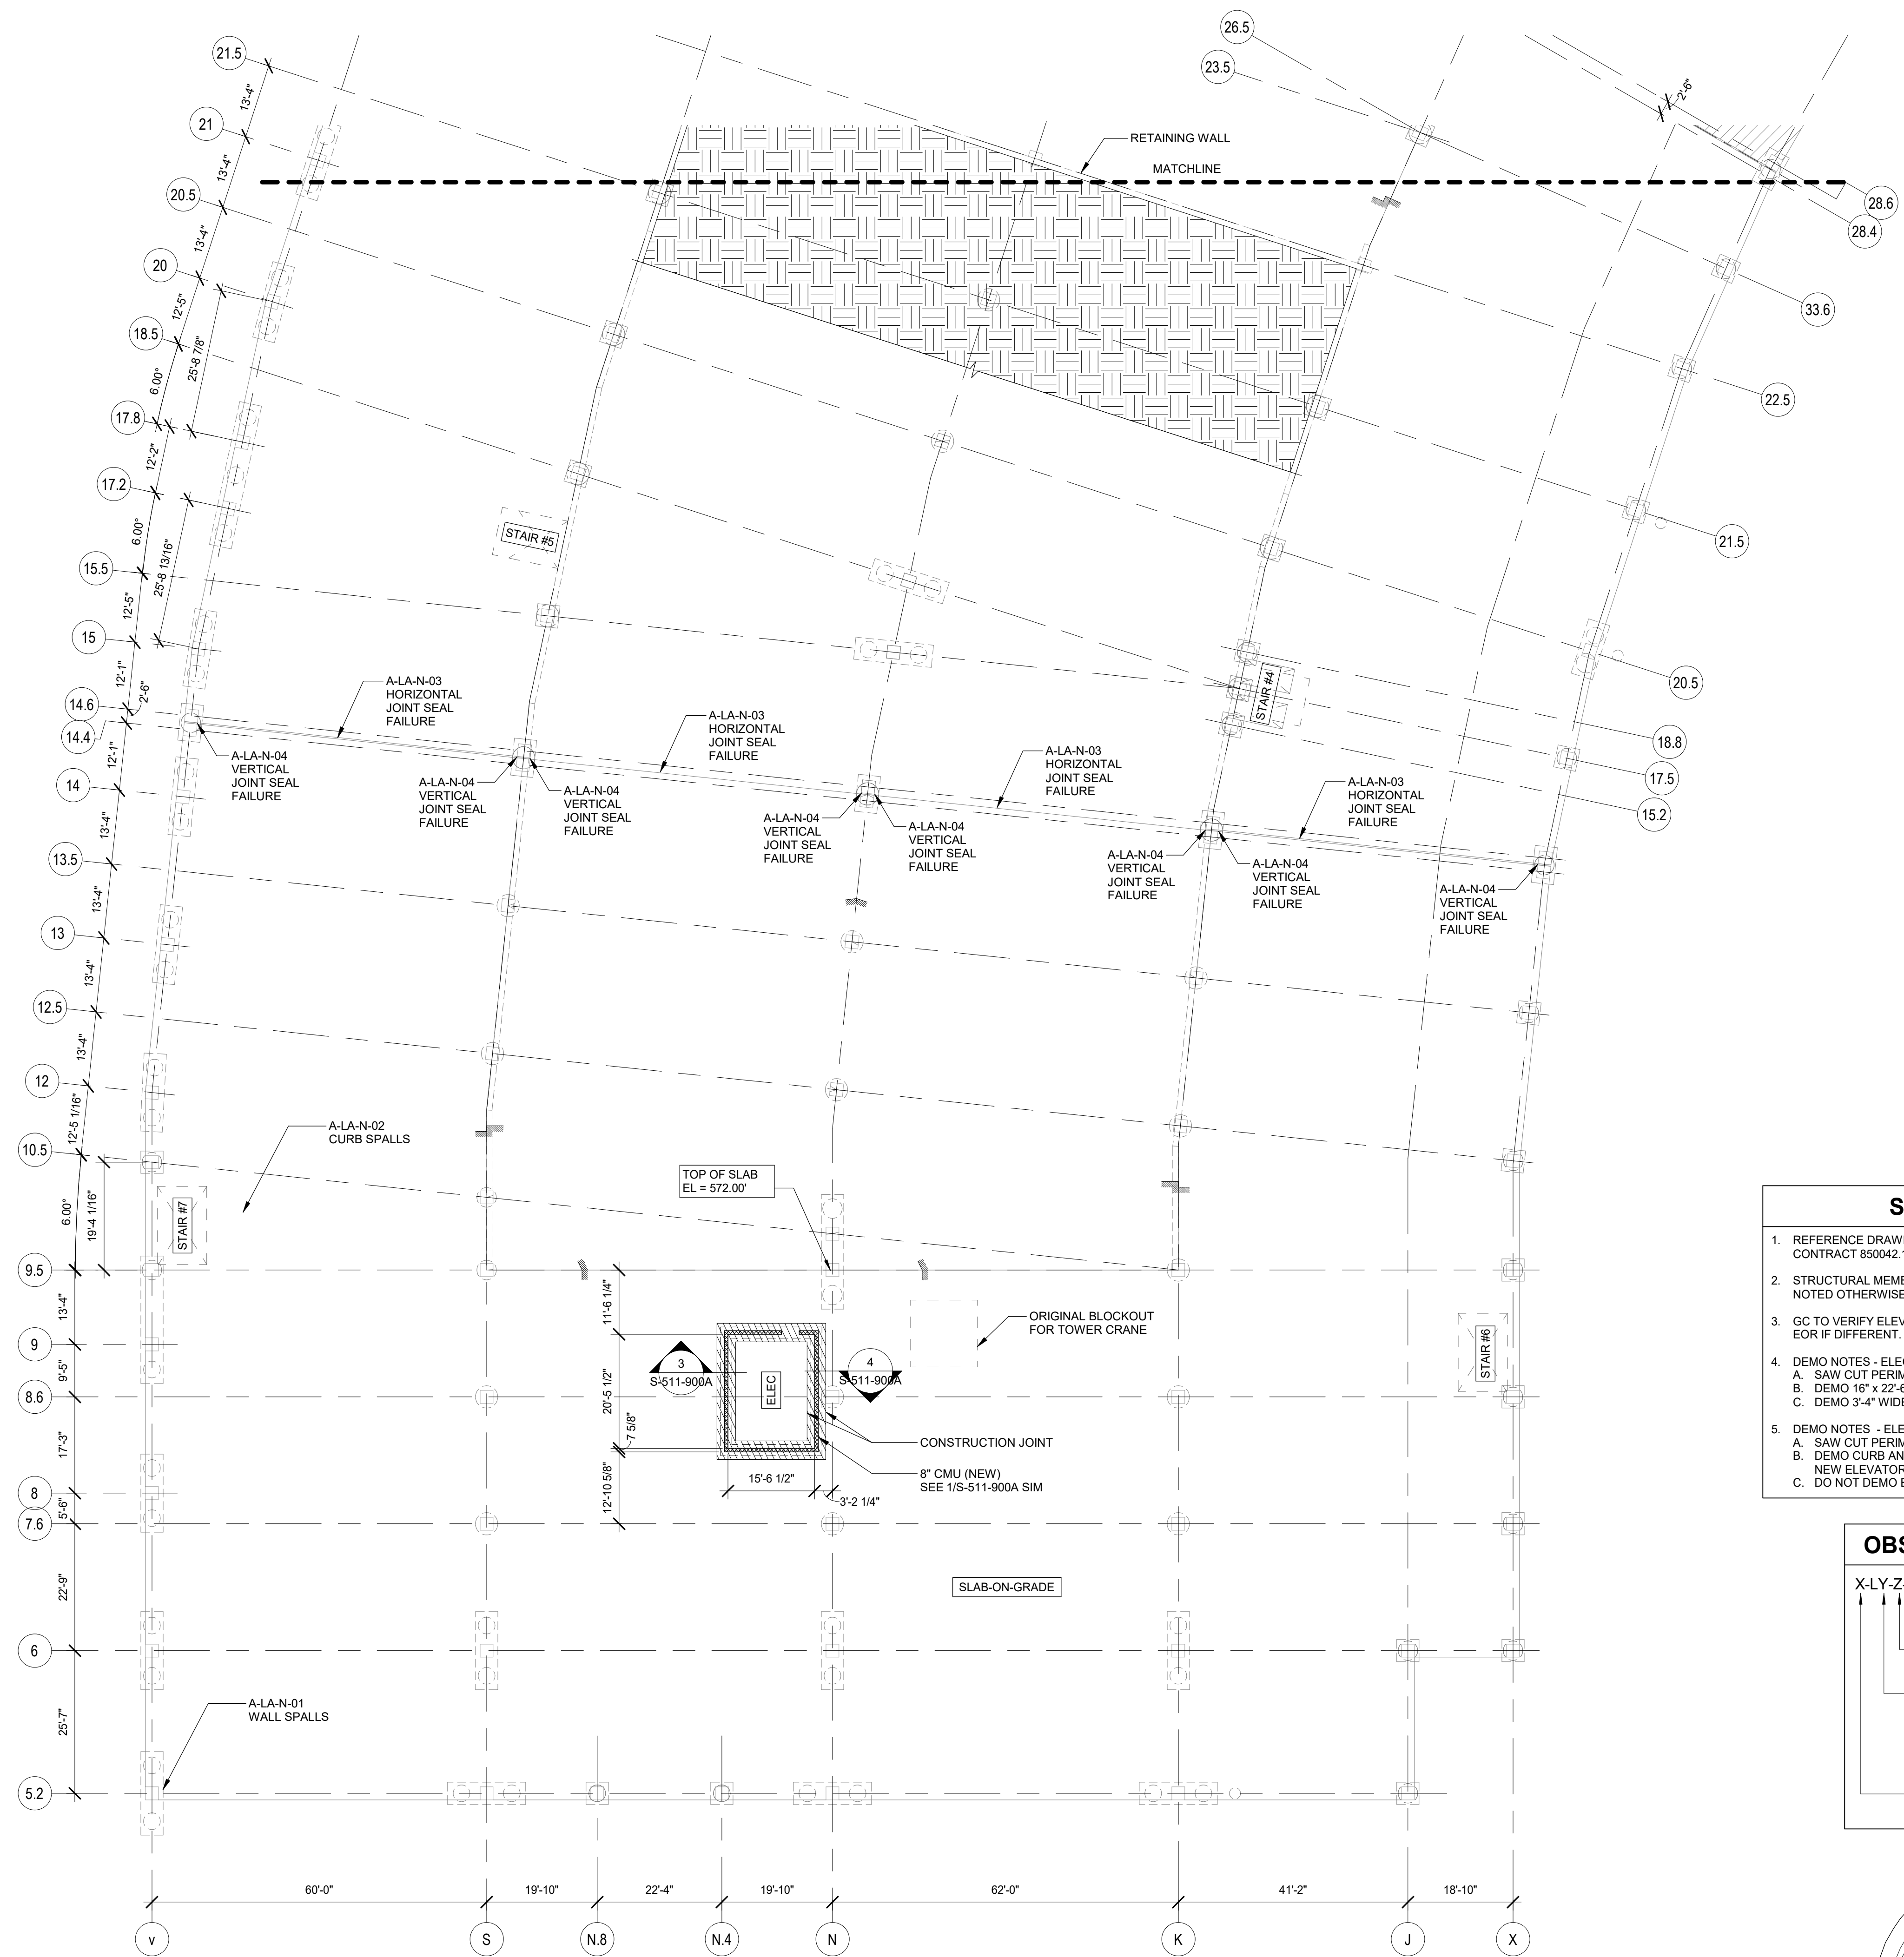

1 GARAGE A LEVEL A FRAMING PLAN - NORTH
1/16" = 1'-0"


- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 850042.12 INVENTORY 37685
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT.
 - DEMO NOTES - ELECTRICAL ROOMS:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DEMO 18" x 22" CURB.
C. DEMO 3'-4" WIDE SLAB-ON-GRADE BELOW NEW CMU WALL.
 - DEMO NOTES - ELEVATORS:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DEMO CURB AND SLAB-ON-GRADE 6'-0" FROM EDGE OF NEW ELEVATOR OPENINGS.
C. DO NOT DEMO EXISTING GRADE BEAMS.

- ### OBSERVATION NOTE KEY
- X-LY-Z-00
- 01-99: OBSERVATION NUMBER
 - N: NORTH HALF OF GARAGE
 - S: SOUTH HALF OF GARAGE
 - A: LEVEL A
 - B: LEVEL B
 - C: LEVEL C
 - D: LEVEL D
 - E: LEVEL E
 - A: GARAGE A
 - B: GARAGE B

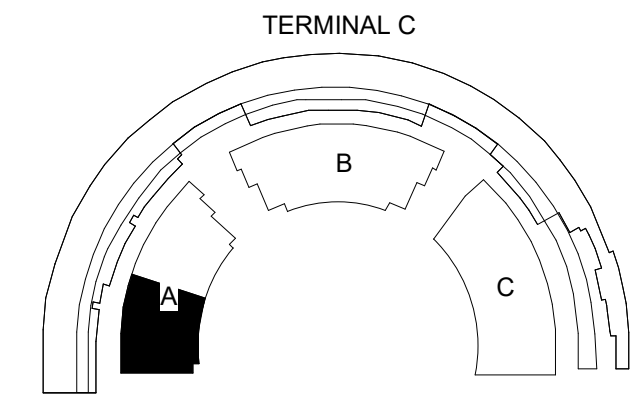


NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LA-S-01	CMU WALL CRACKS	REPAIR CRACKS PER GENERAL NOTES
A-LA-S-02	CMU WALL CRACKS	REPAIR CRACKS PER GENERAL NOTES
A-LA-S-03	WALL SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LA-S-04	WALL SPALLS, EXPOSED REBAR	REPAIR SPALLS PER GENERAL NOTES
A-LA-S-05	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LA-S-06	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES


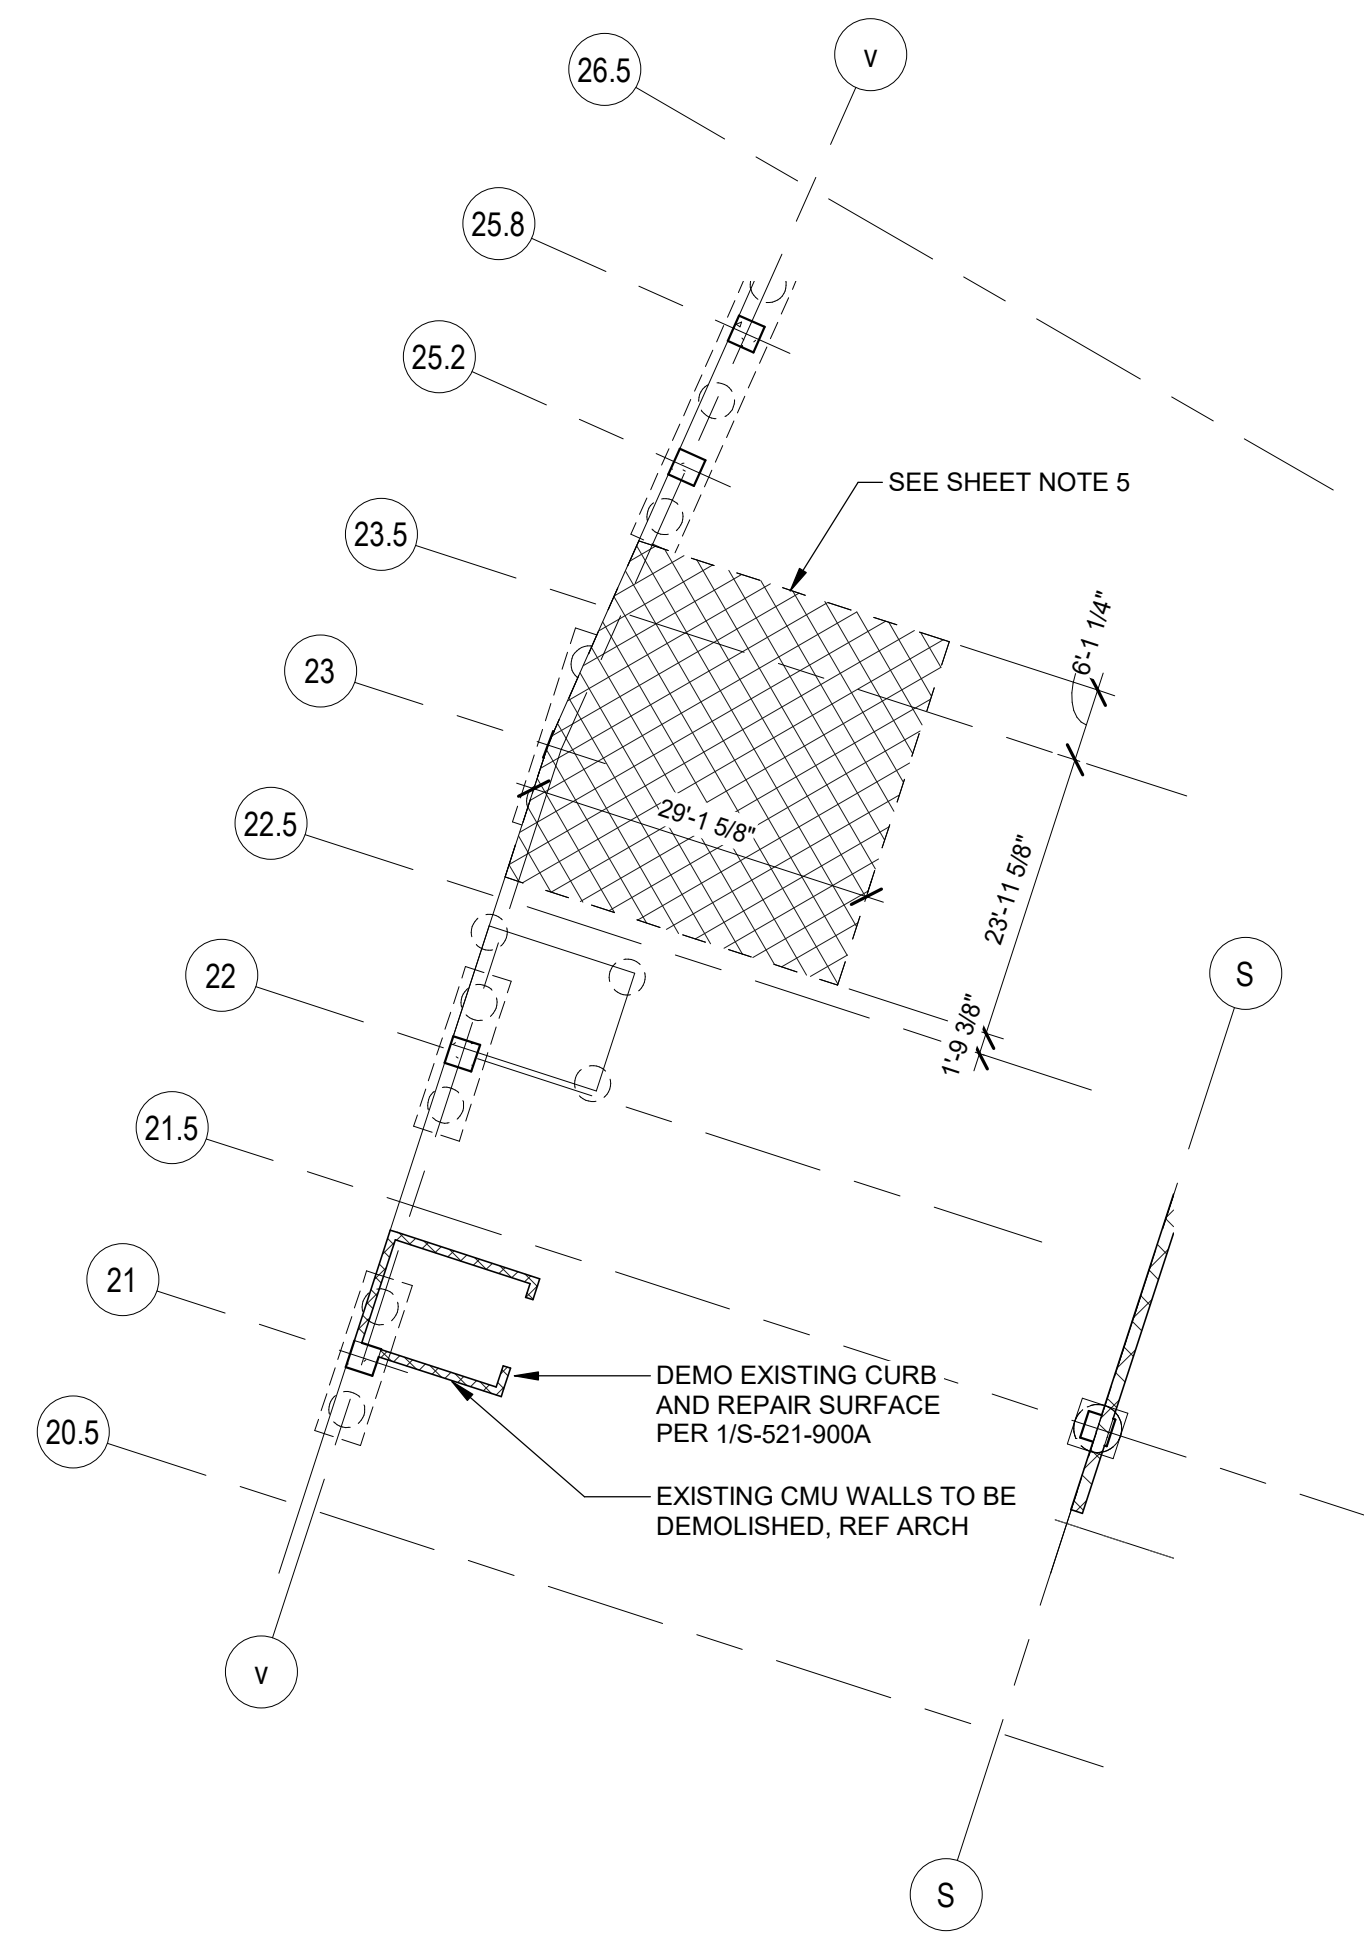


2 GARAGE A LEVEL A - PARTIAL DEMO PLAN AT NEW ELEVATORS
1/16" = 1'-0"

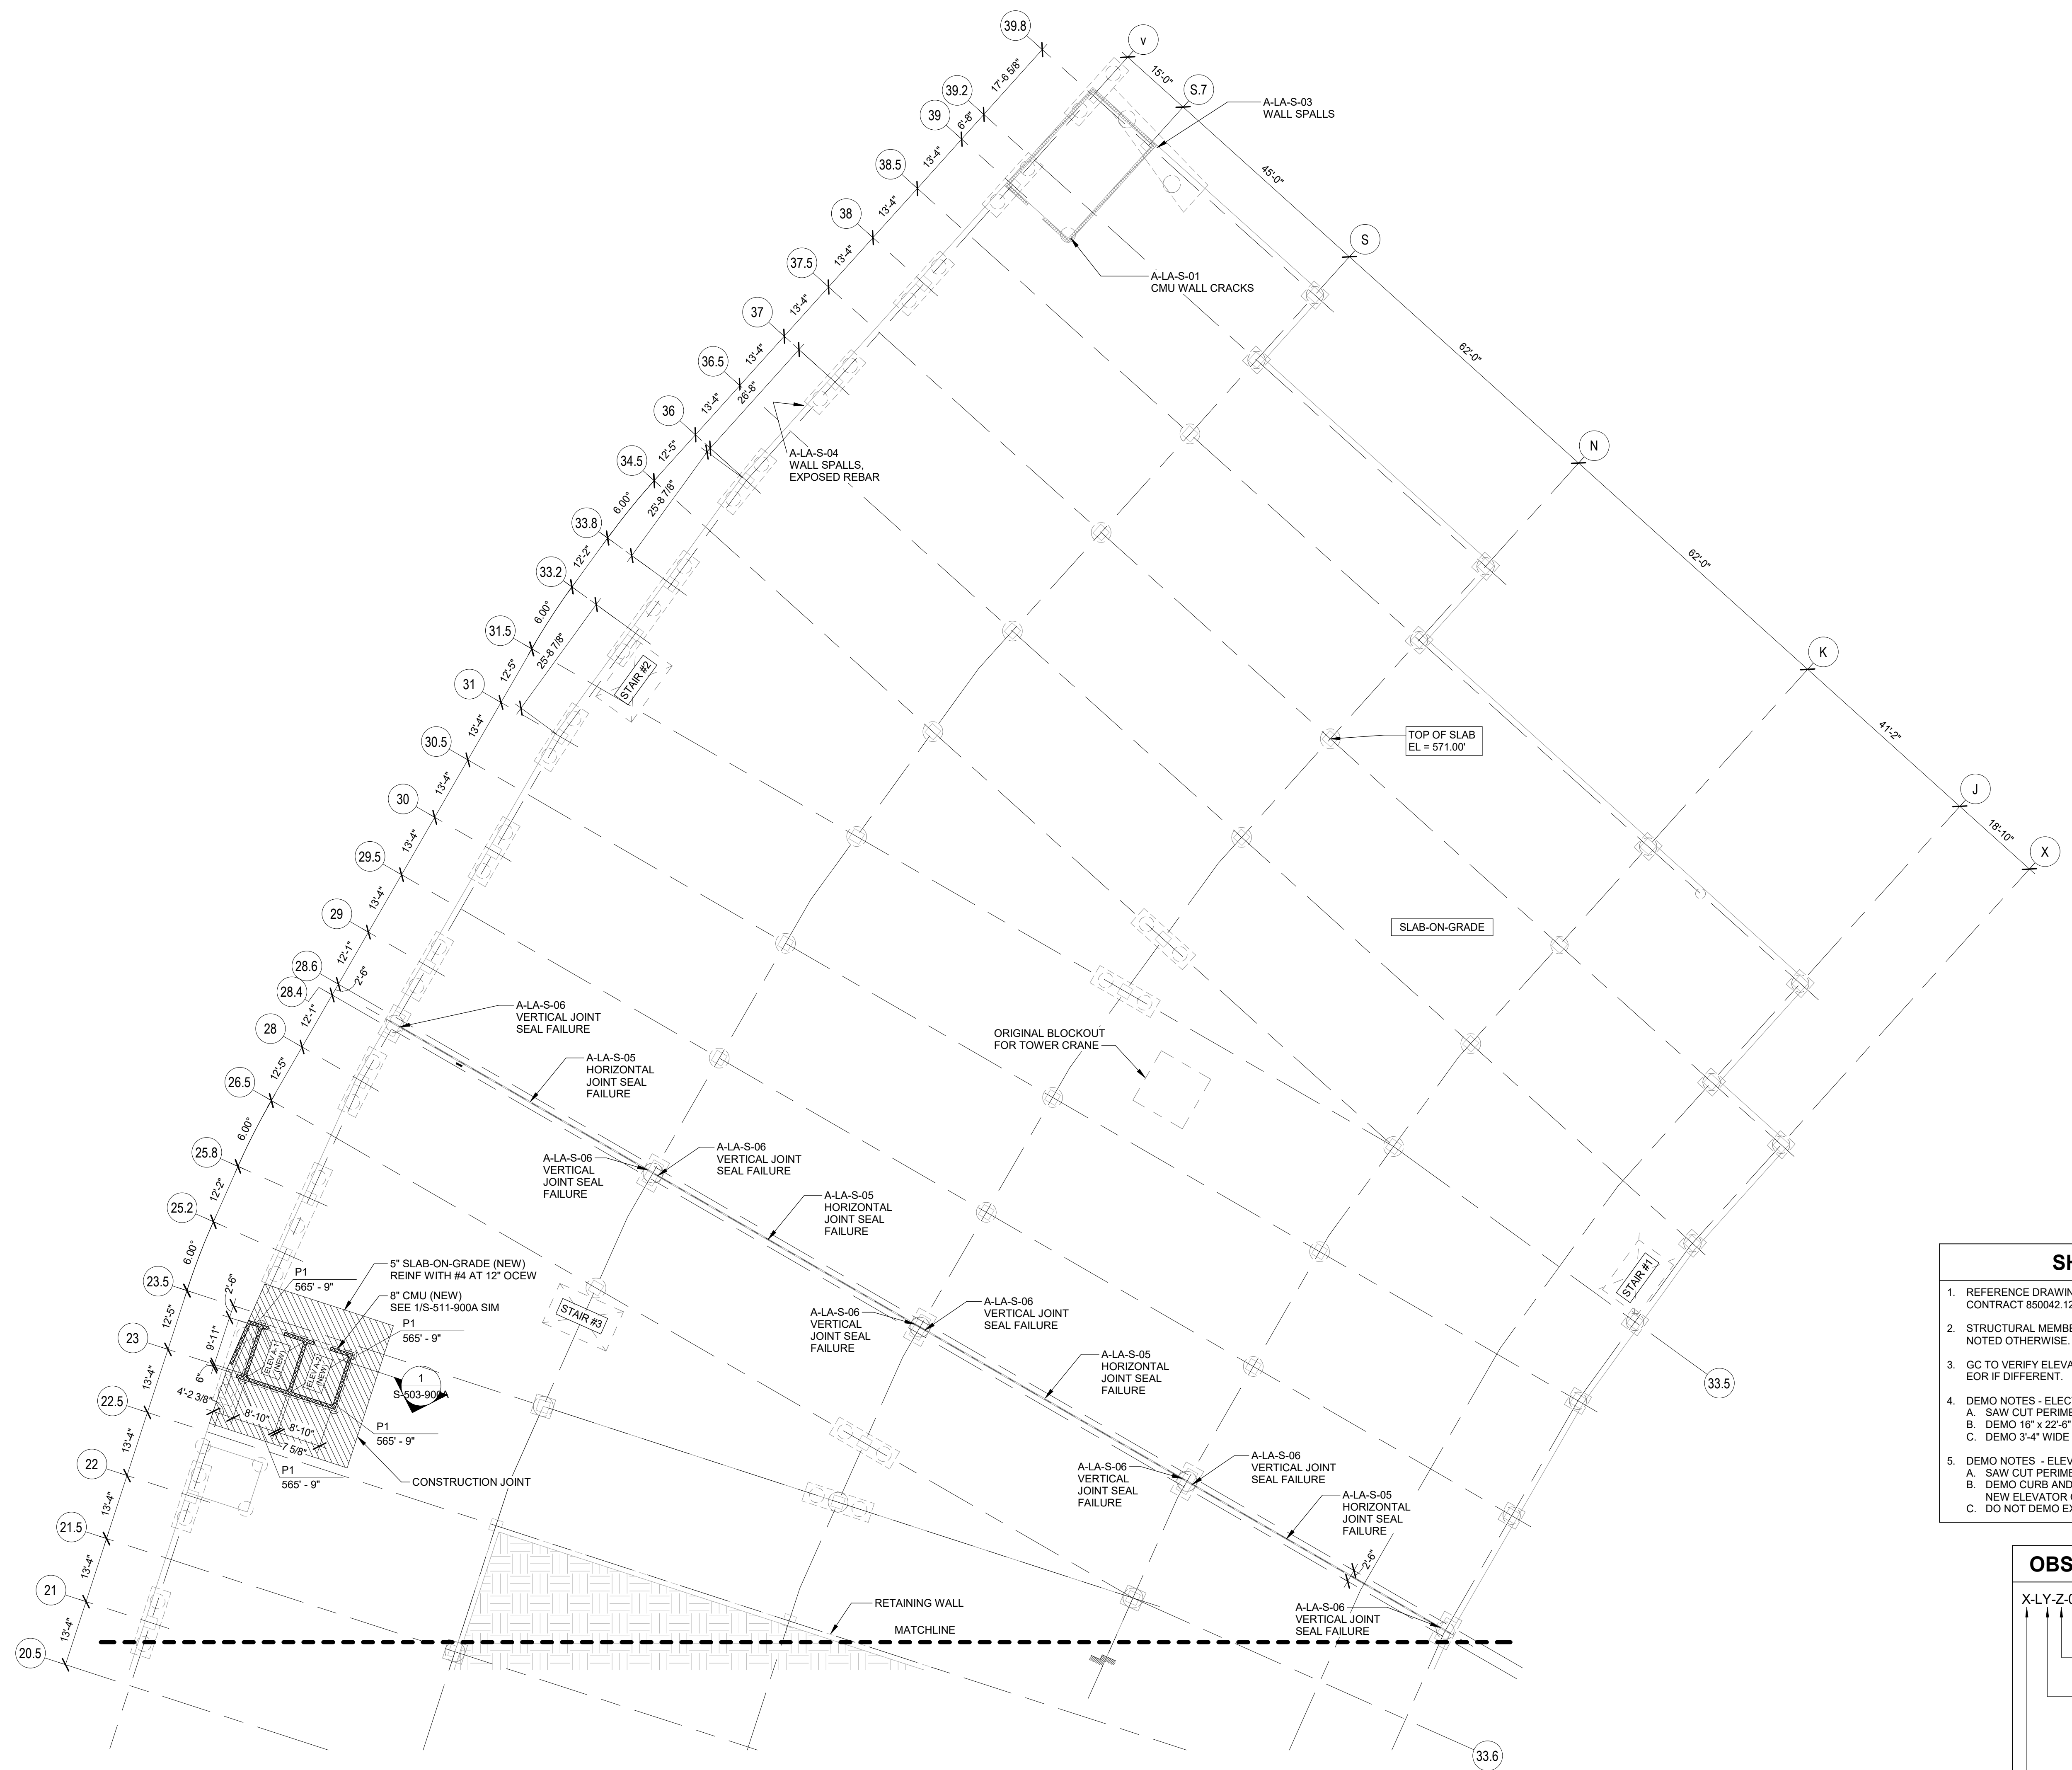


1 GARAGE A LEVEL A FRAMING PLAN - SOUTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 850042.12 INVENTORY 37685
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT.
 - DEMO NOTES - ELECTRICAL ROOMS:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DEMO 16" x 22" CURB.
C. DEMO 3'-4" WIDE SLAB-ON-GRADE BELOW NEW CMU WALL.
 - DEMO NOTES - ELEVATORS:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DEMO CURB AND SLAB-ON-GRADE 6'-0" FROM EDGE OF NEW ELEVATOR OPENINGS.
C. DO NOT DEMO EXISTING GRADE BEAMS.


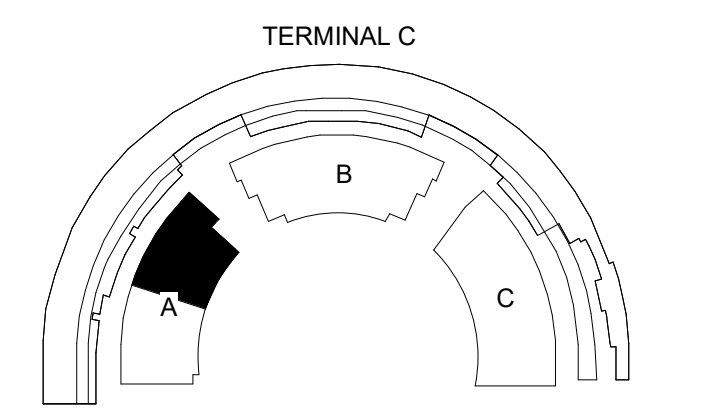
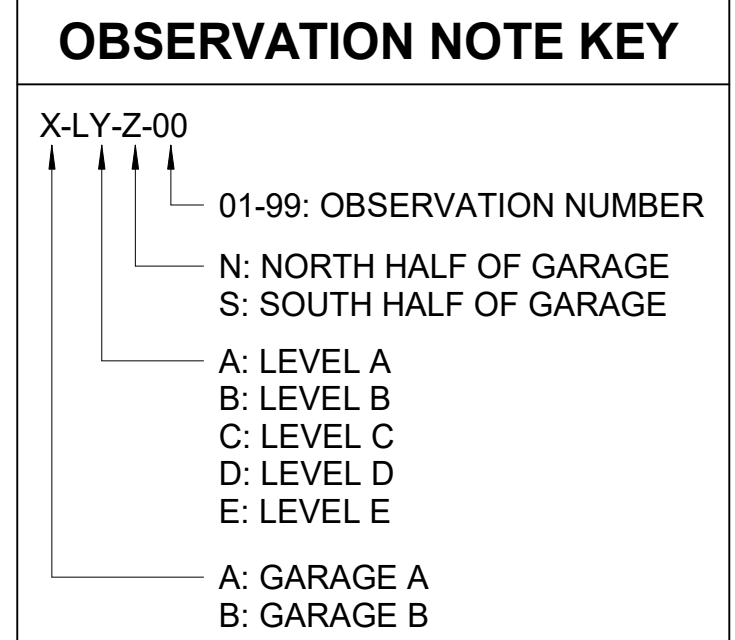


NO.	DATE	DESCRIPTION
2023-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LB-N-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-N-02	PT SLAB (TOP SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-N-03	WALL SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LB-N-04	WALL CRACKS	REPAIR CRACKS PER GENERAL NOTES
A-LB-N-05	STAIR SETTLEMENT	REPLACE BELOW-GRADE CONCRETE STAIR. SEE 3/S-503-900A FOR TYPICAL GRADE STAIR DETAIL.
A-LB-N-06	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LB-N-07	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES

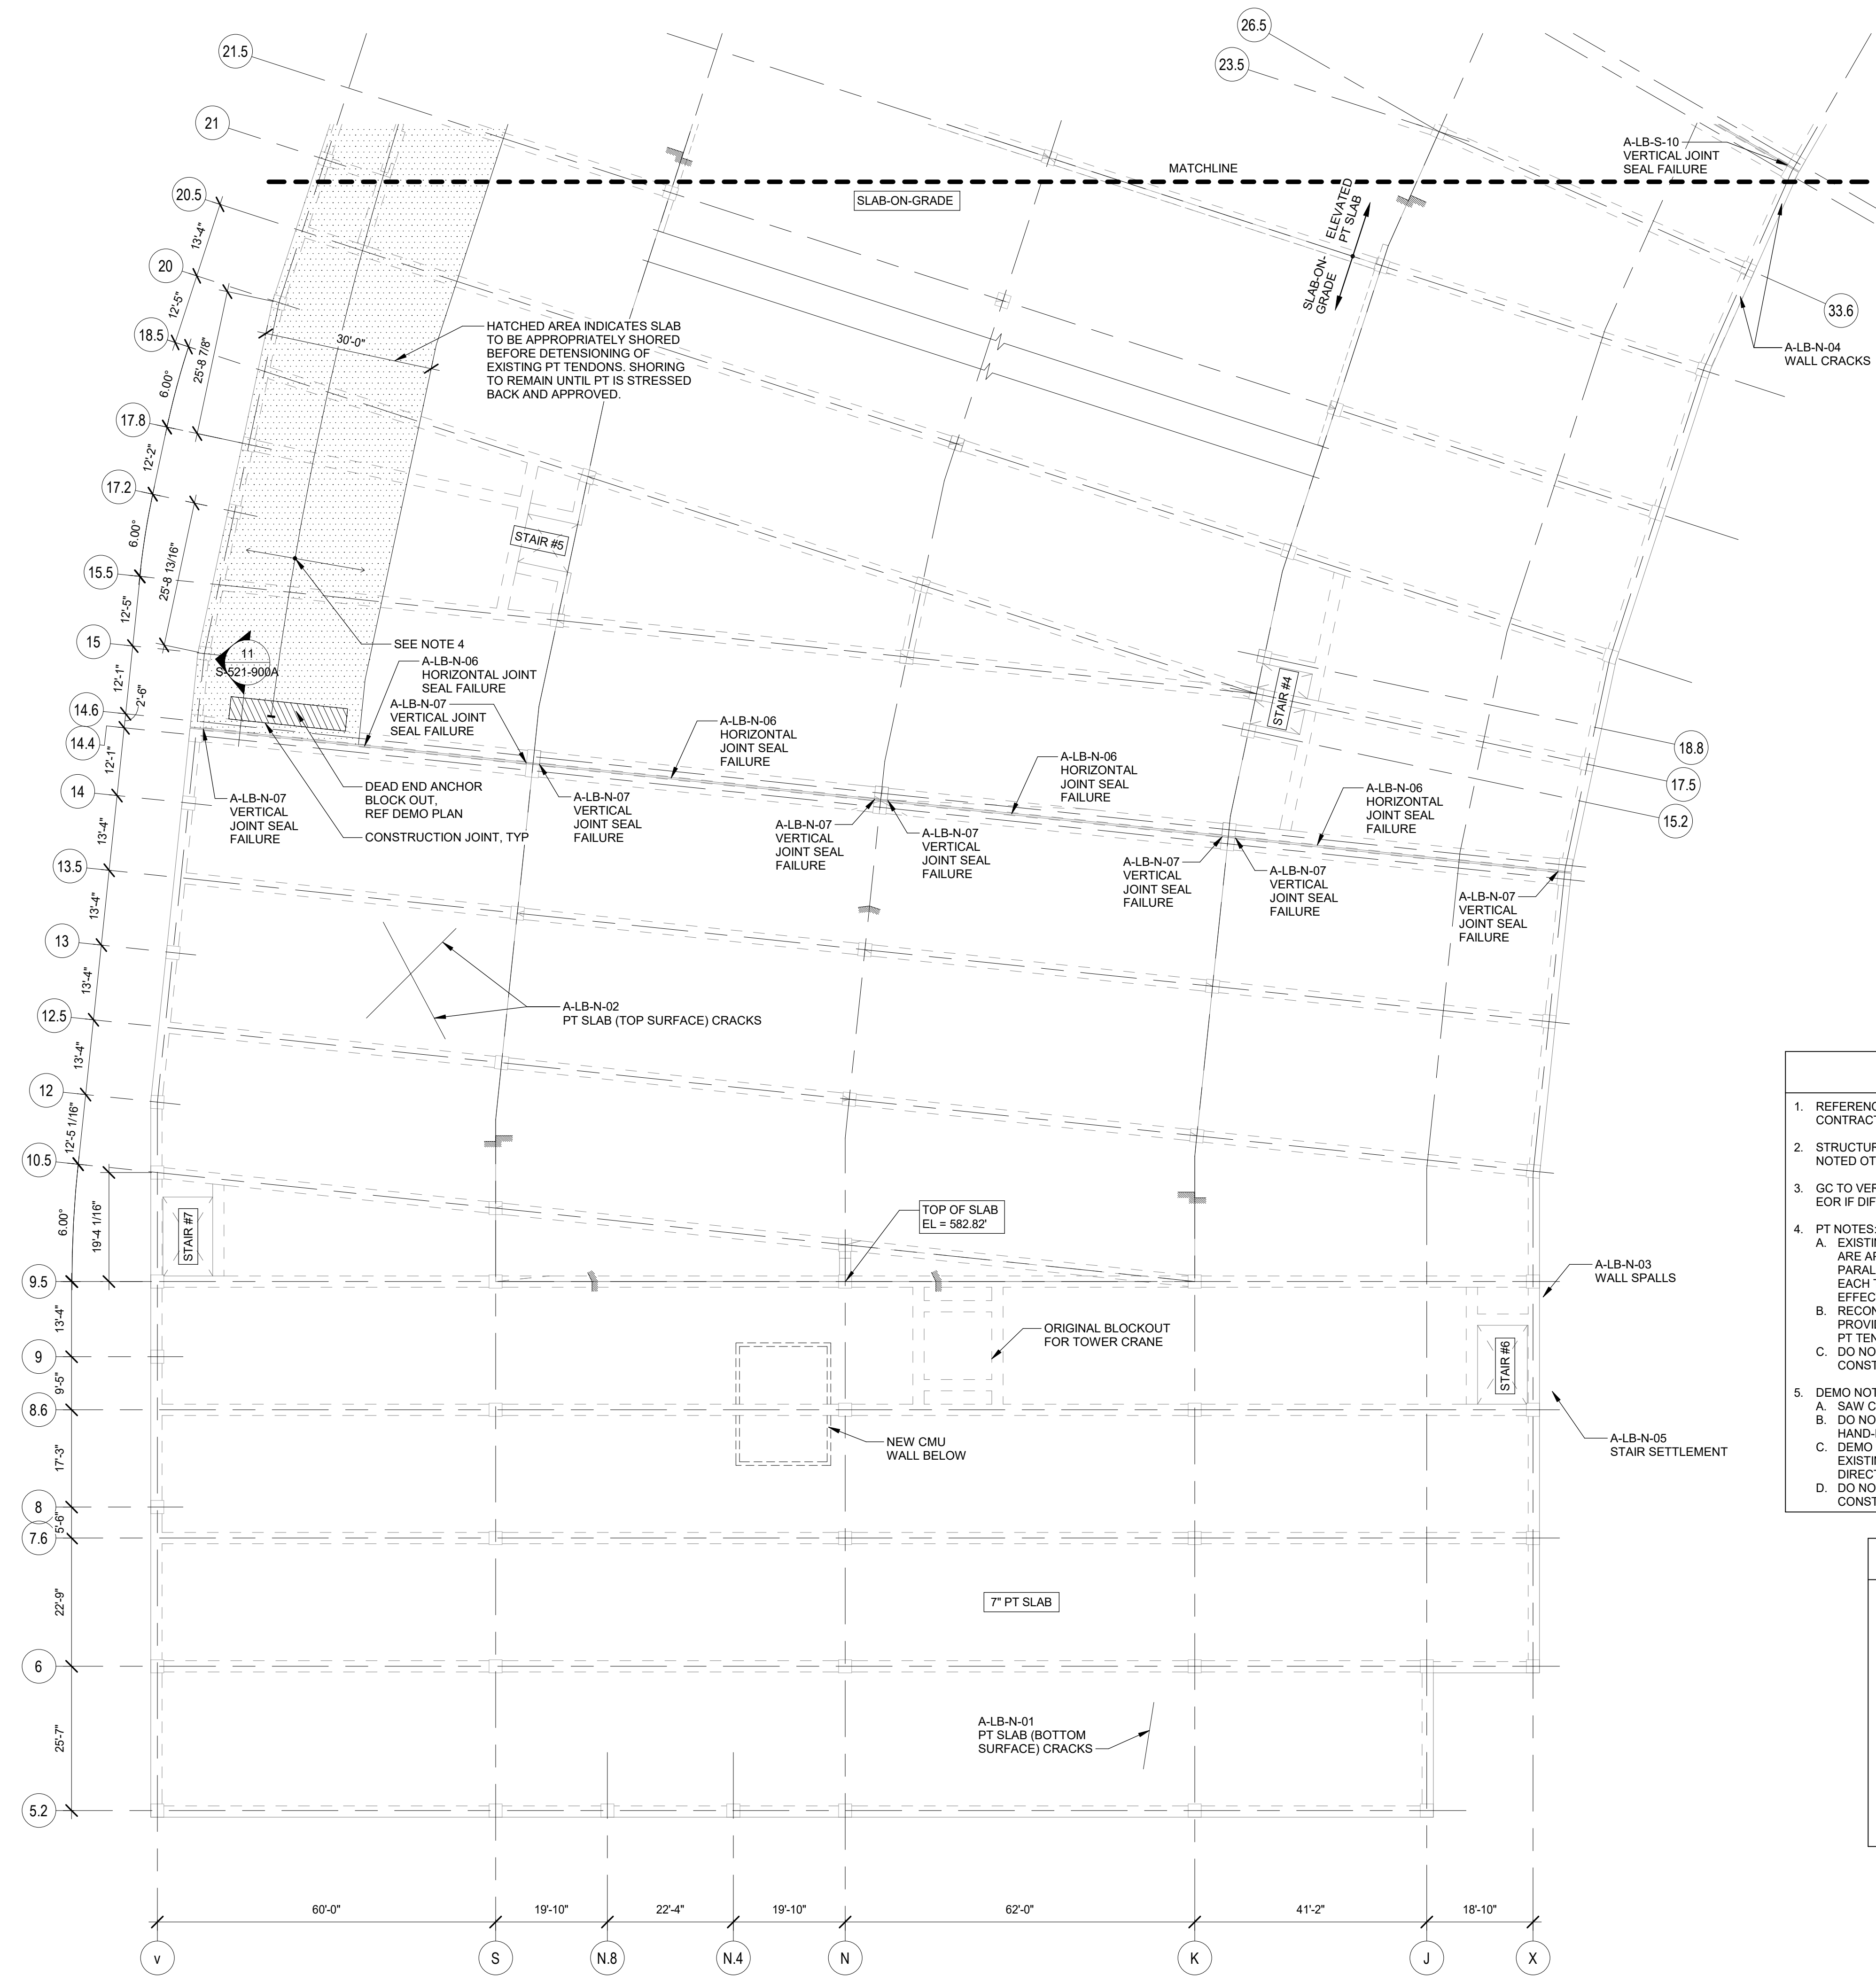

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 850042.12 INVENTORY 37686
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

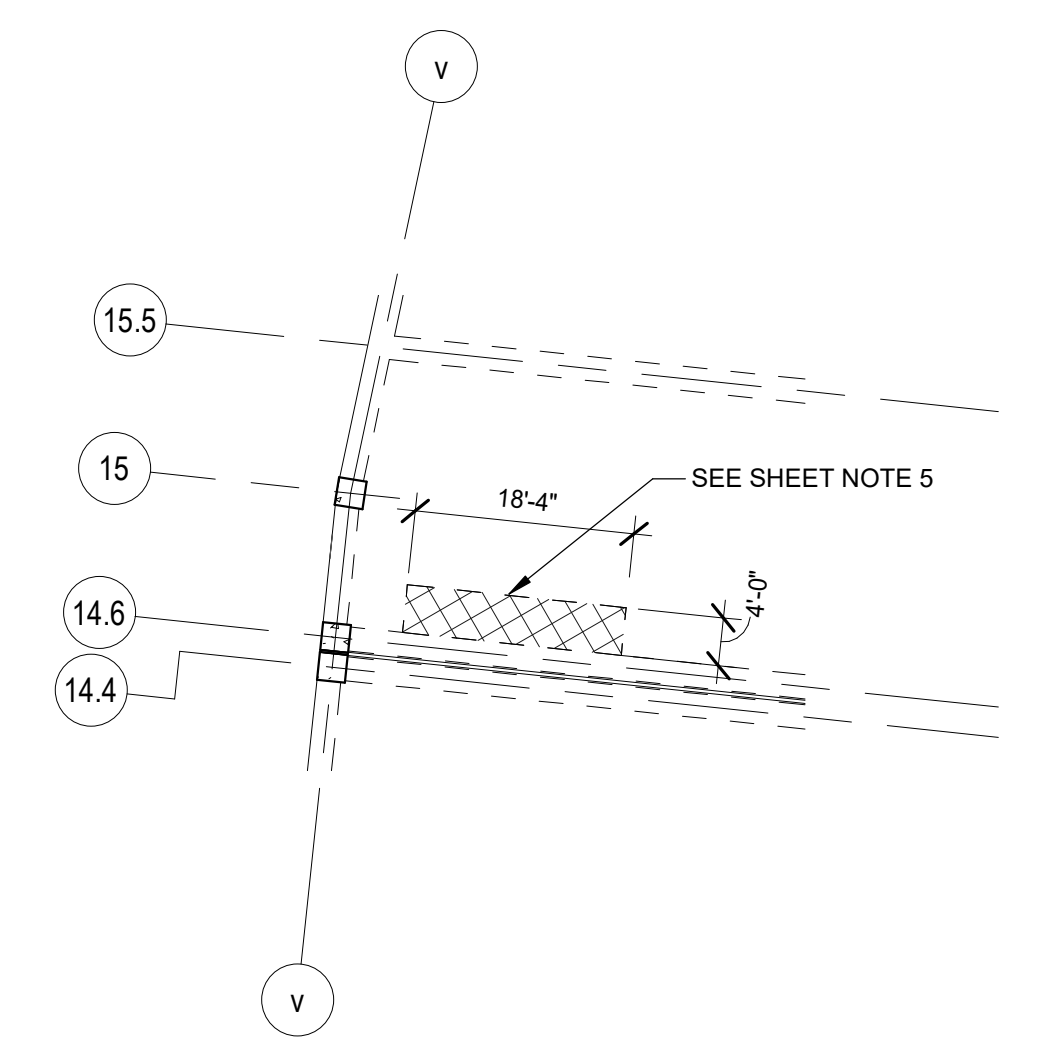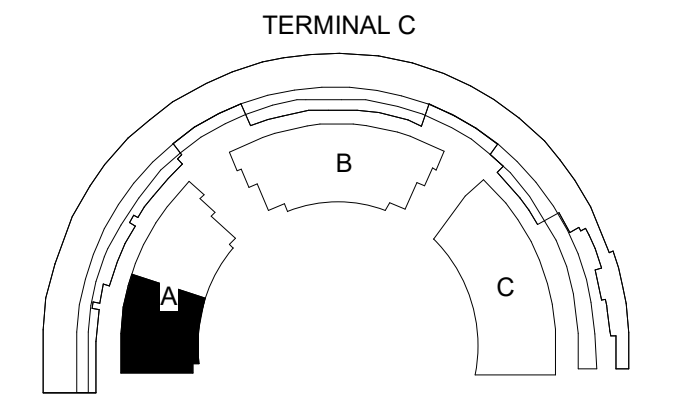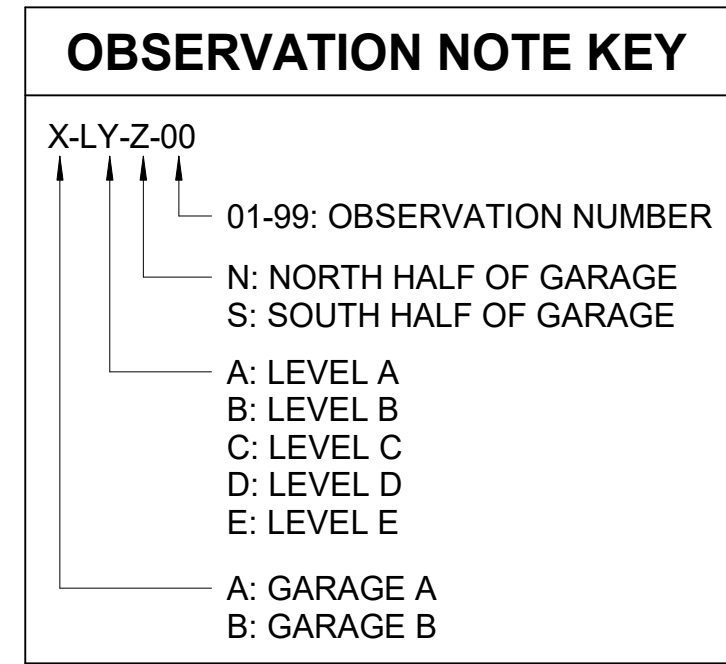


2 GARAGE A LEVEL B - PARTIAL DEMO PLAN AT DEAD END
1/16" = 1'-0"

1 GARAGE A LEVEL B FRAMING PLAN - NORTH
1/16" = 1'-0"



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

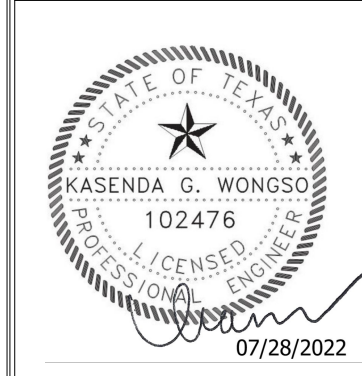

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION



NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL B FRAMING PLAN - NORTH
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
S-103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LB-S-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-02	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-03	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-04	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-05	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-06	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-07	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LB-S-08	WALL SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LB-S-09	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LB-S-10	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES

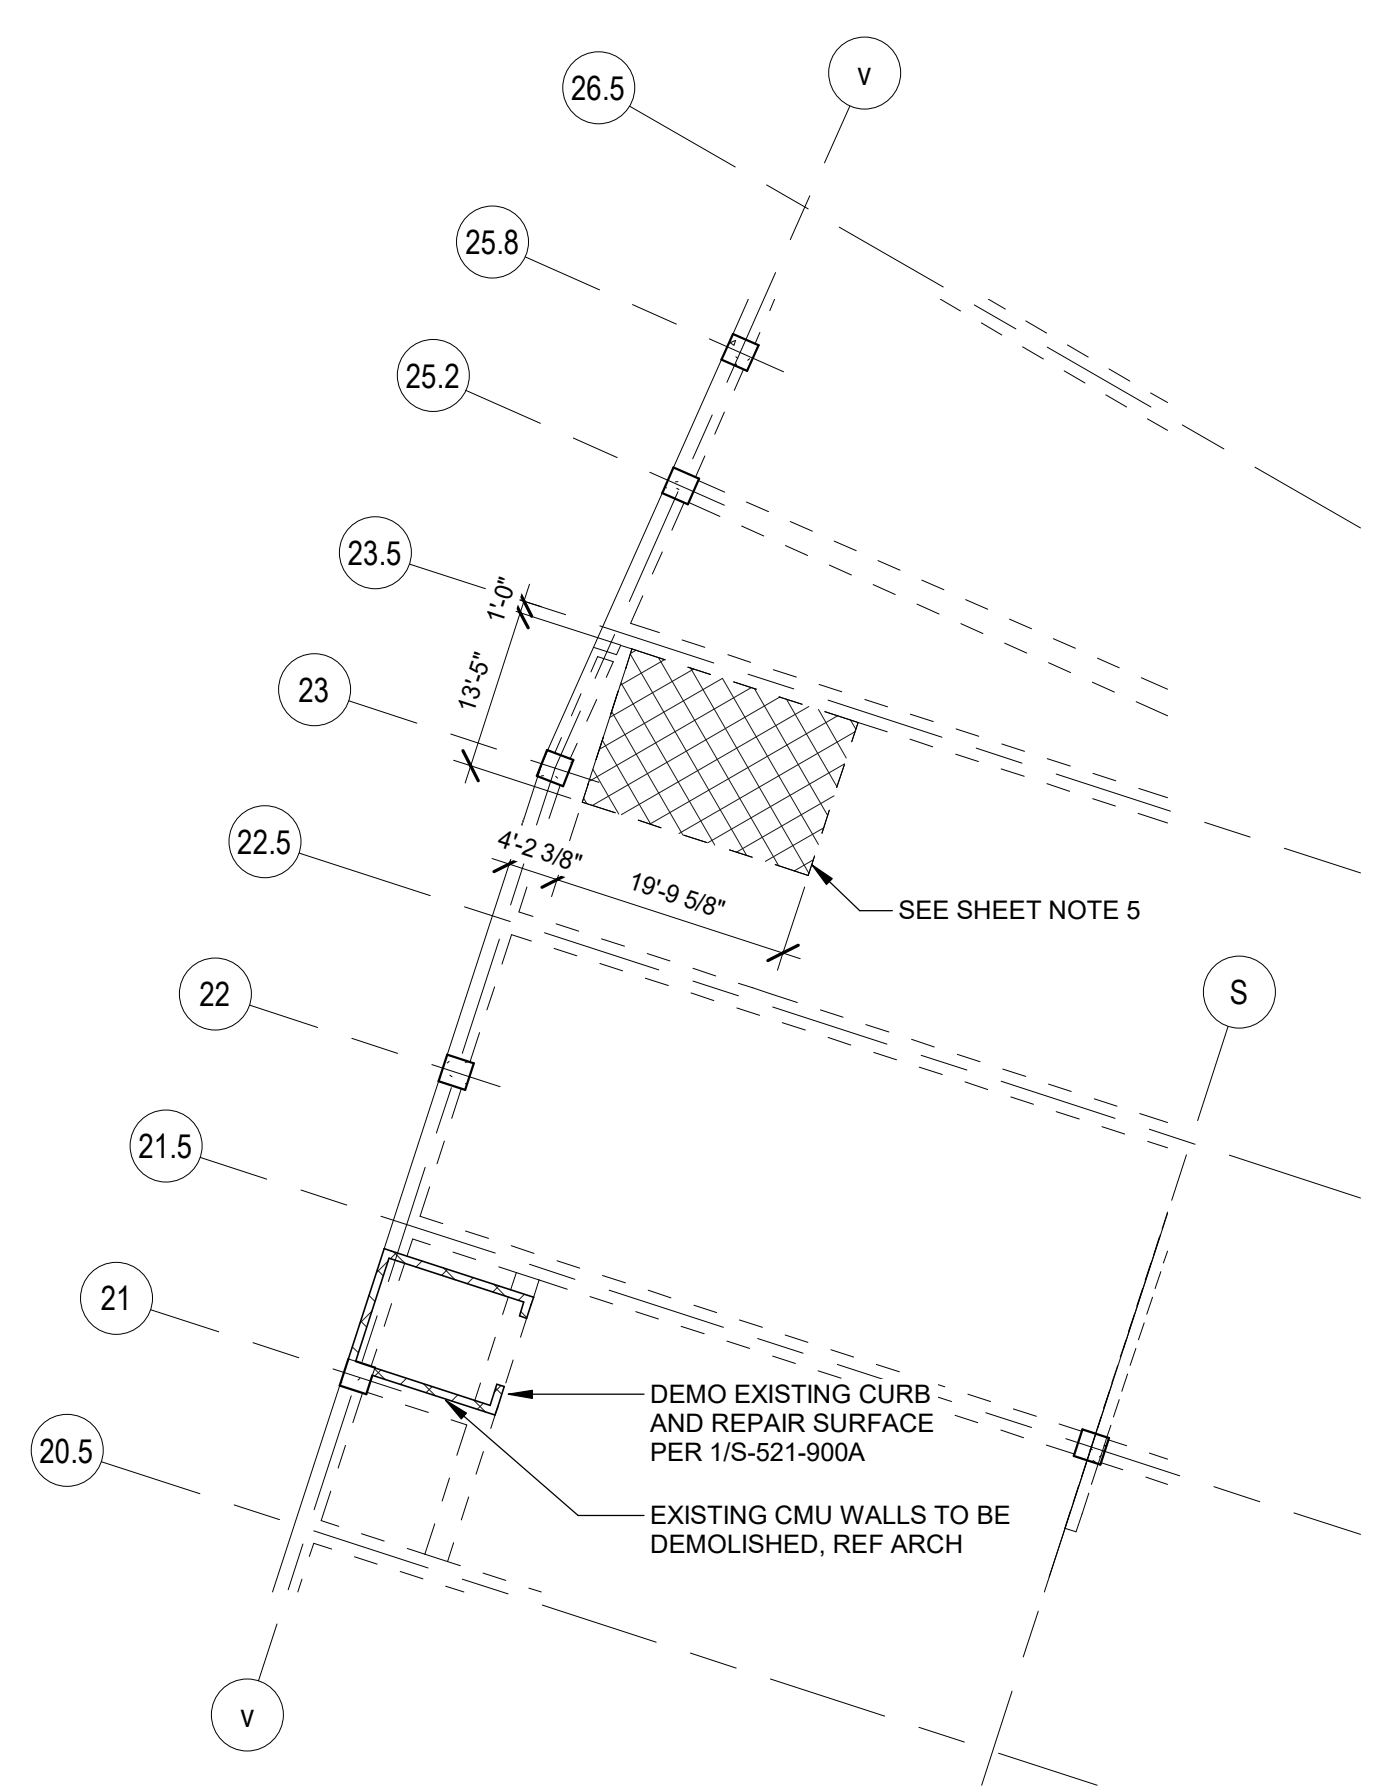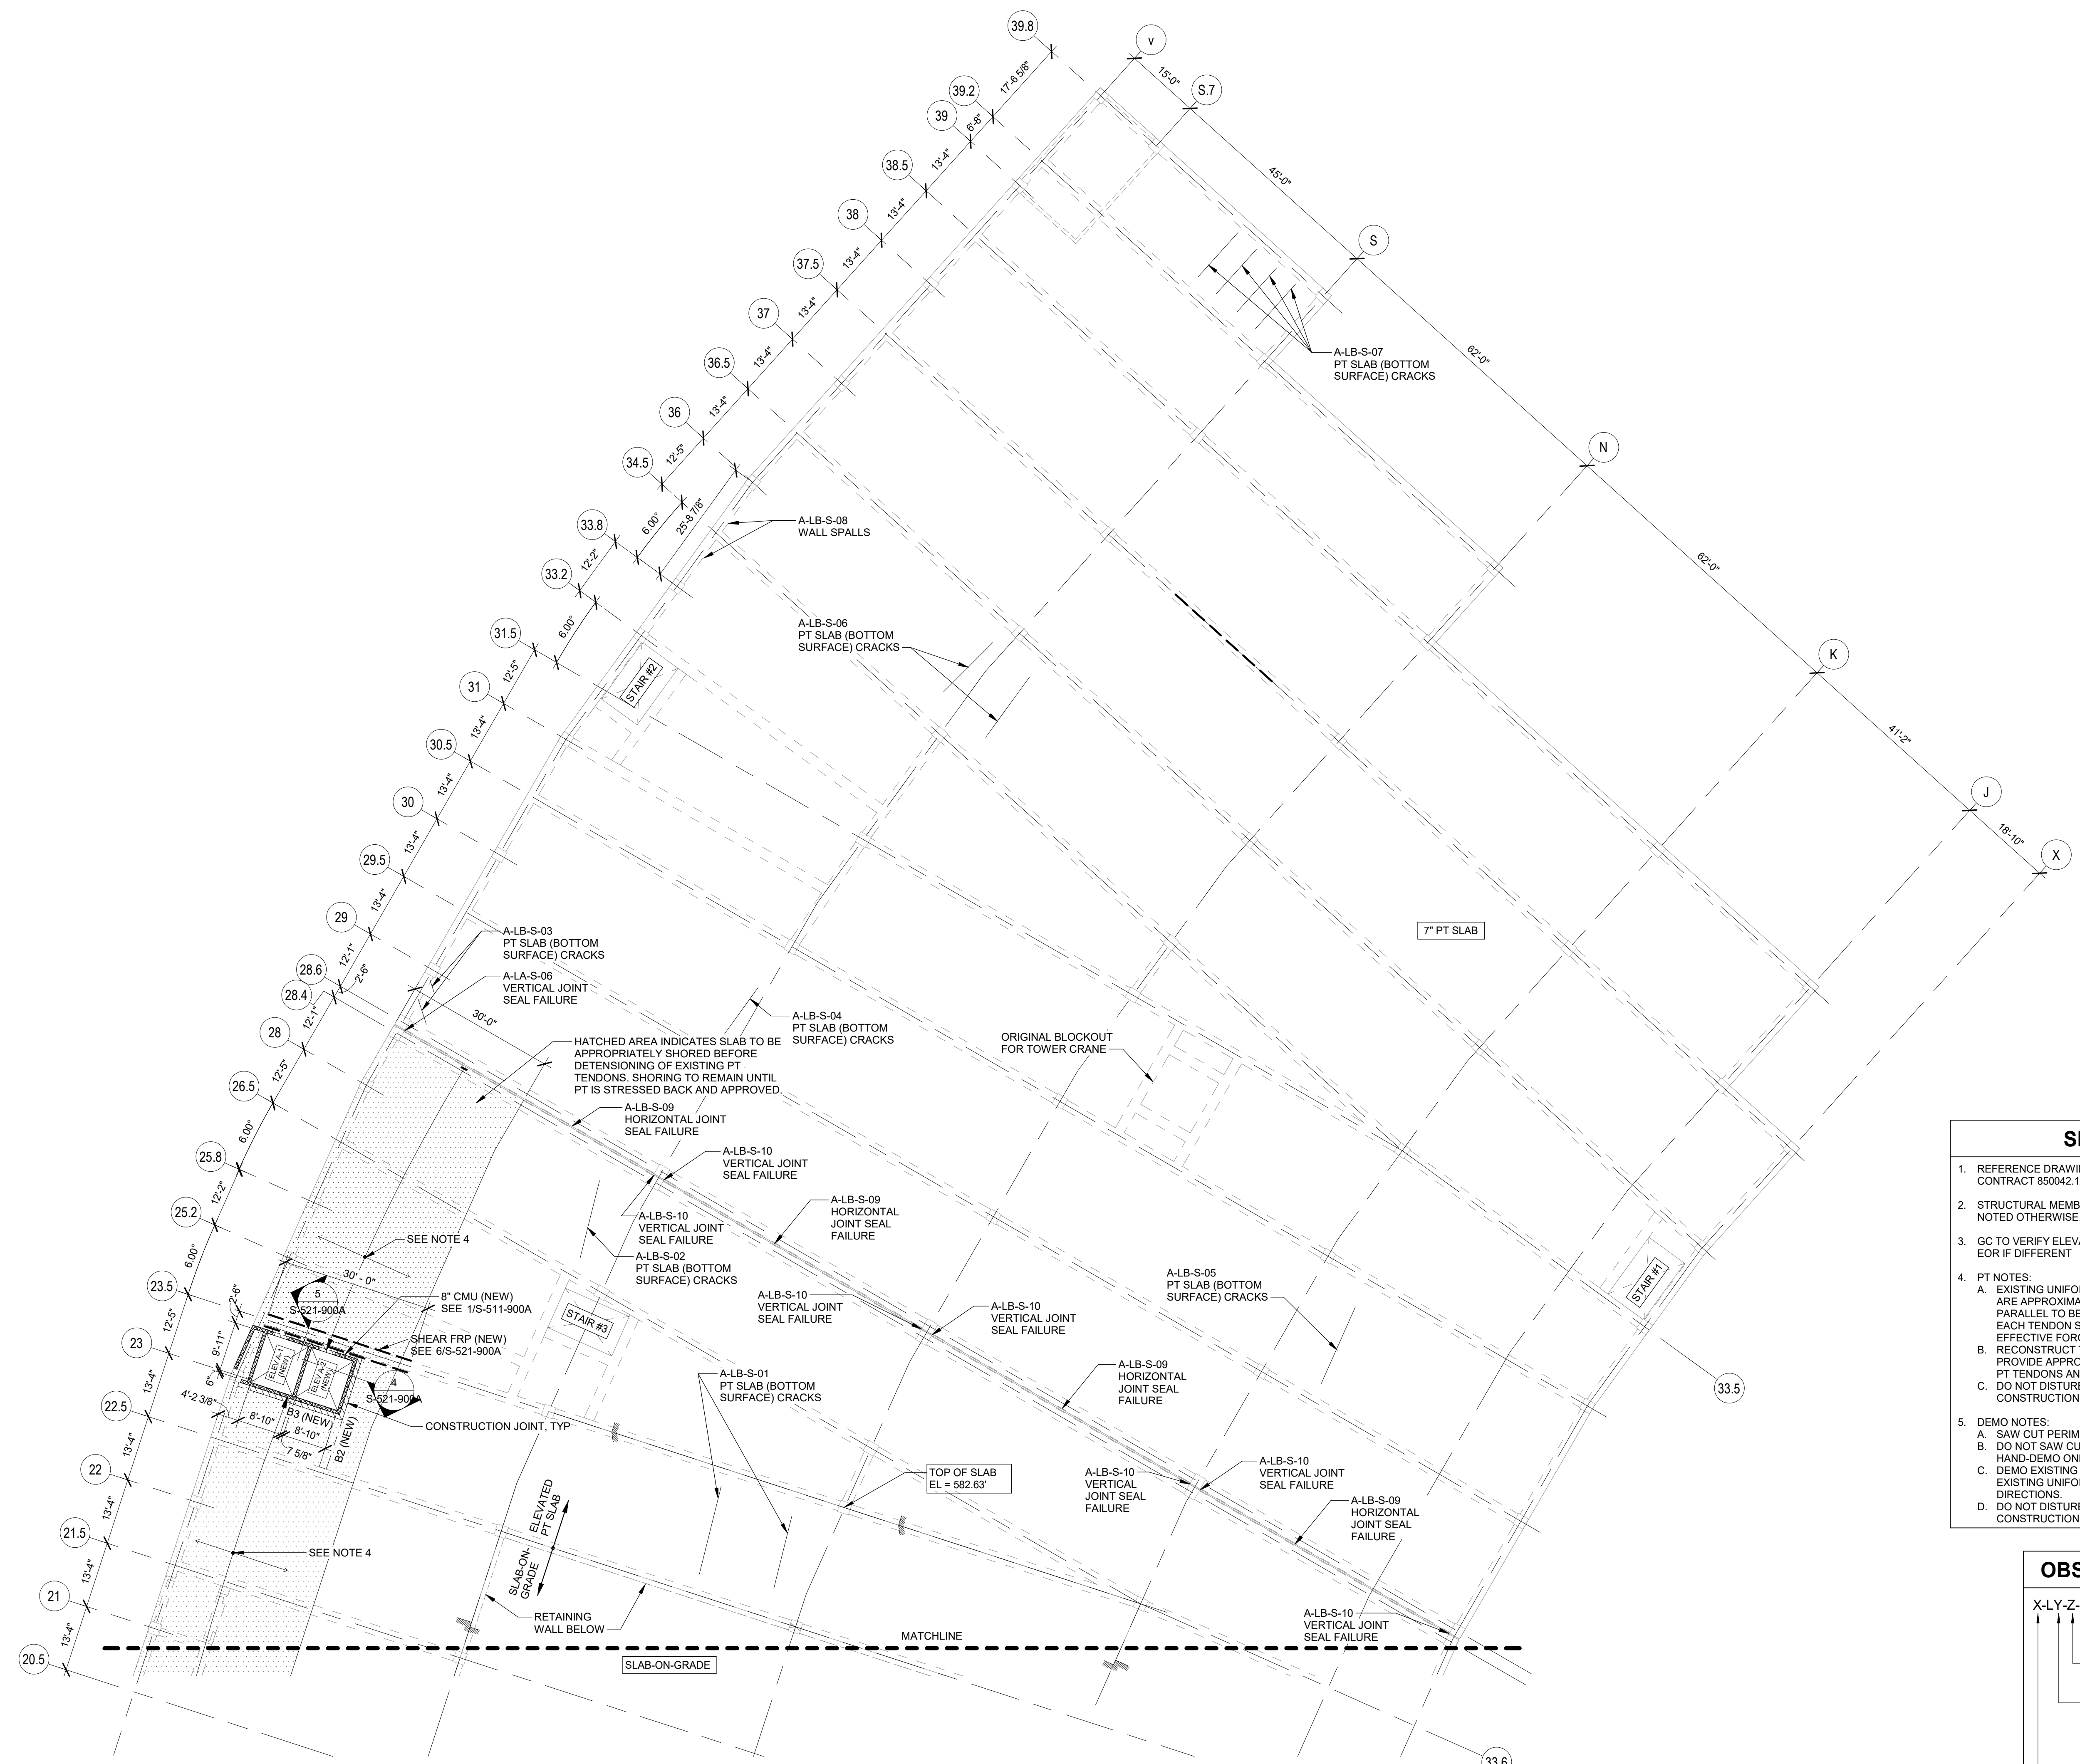


2 GARAGE A LEVEL B - PARTIAL DEMO PLAN AT ELEVATORS
1/16" = 1'-0"

1 GARAGE A LEVEL B FRAMING PLAN - SOUTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 85042.12 INVENTORY 37686
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
HAND-DEMO ONLY.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

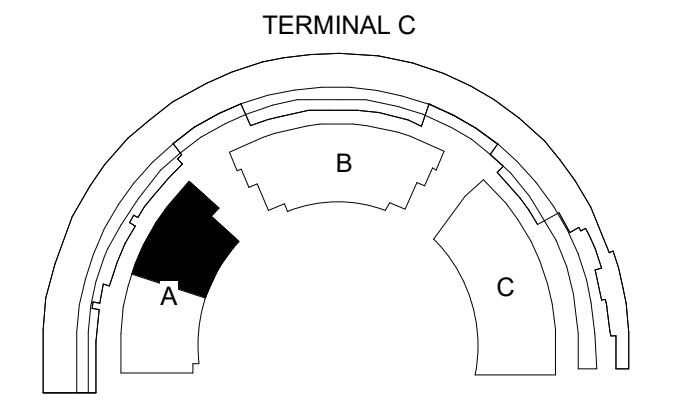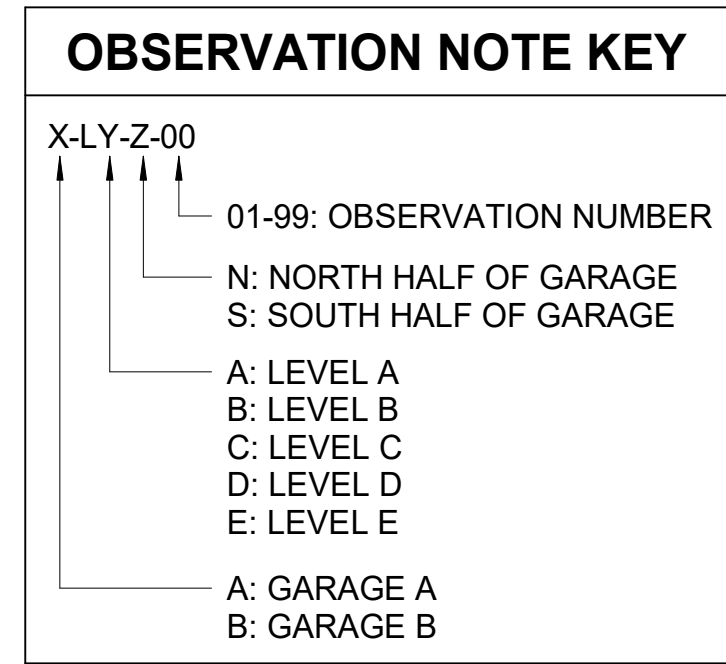

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

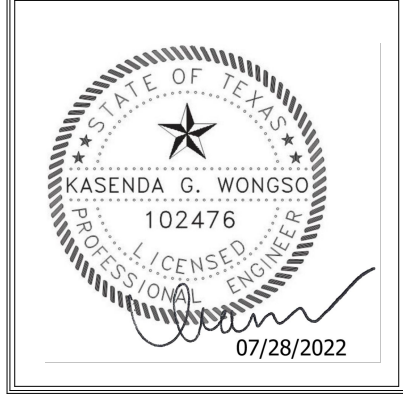

PROJECT # 21084.00000
15200 Addison Road, Suite 310
Addison, Texas 75001
Ph: 214.503.7802
www.ageno.com
TX REG. NO. F-8450

AG & E
Structural Emgenity

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION



NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL B FRAMING PLAN - SOUTH
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
S-104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LC-N-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LC-N-02	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LC-N-03	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES

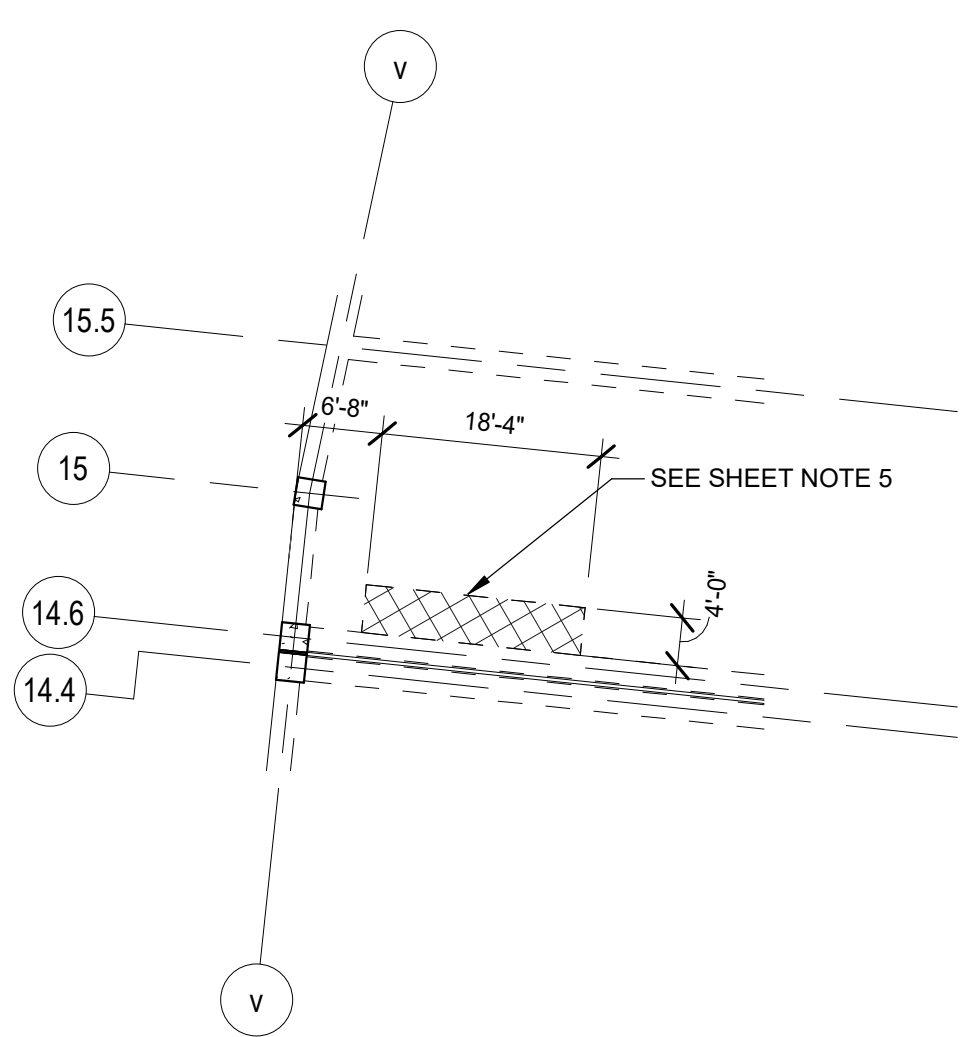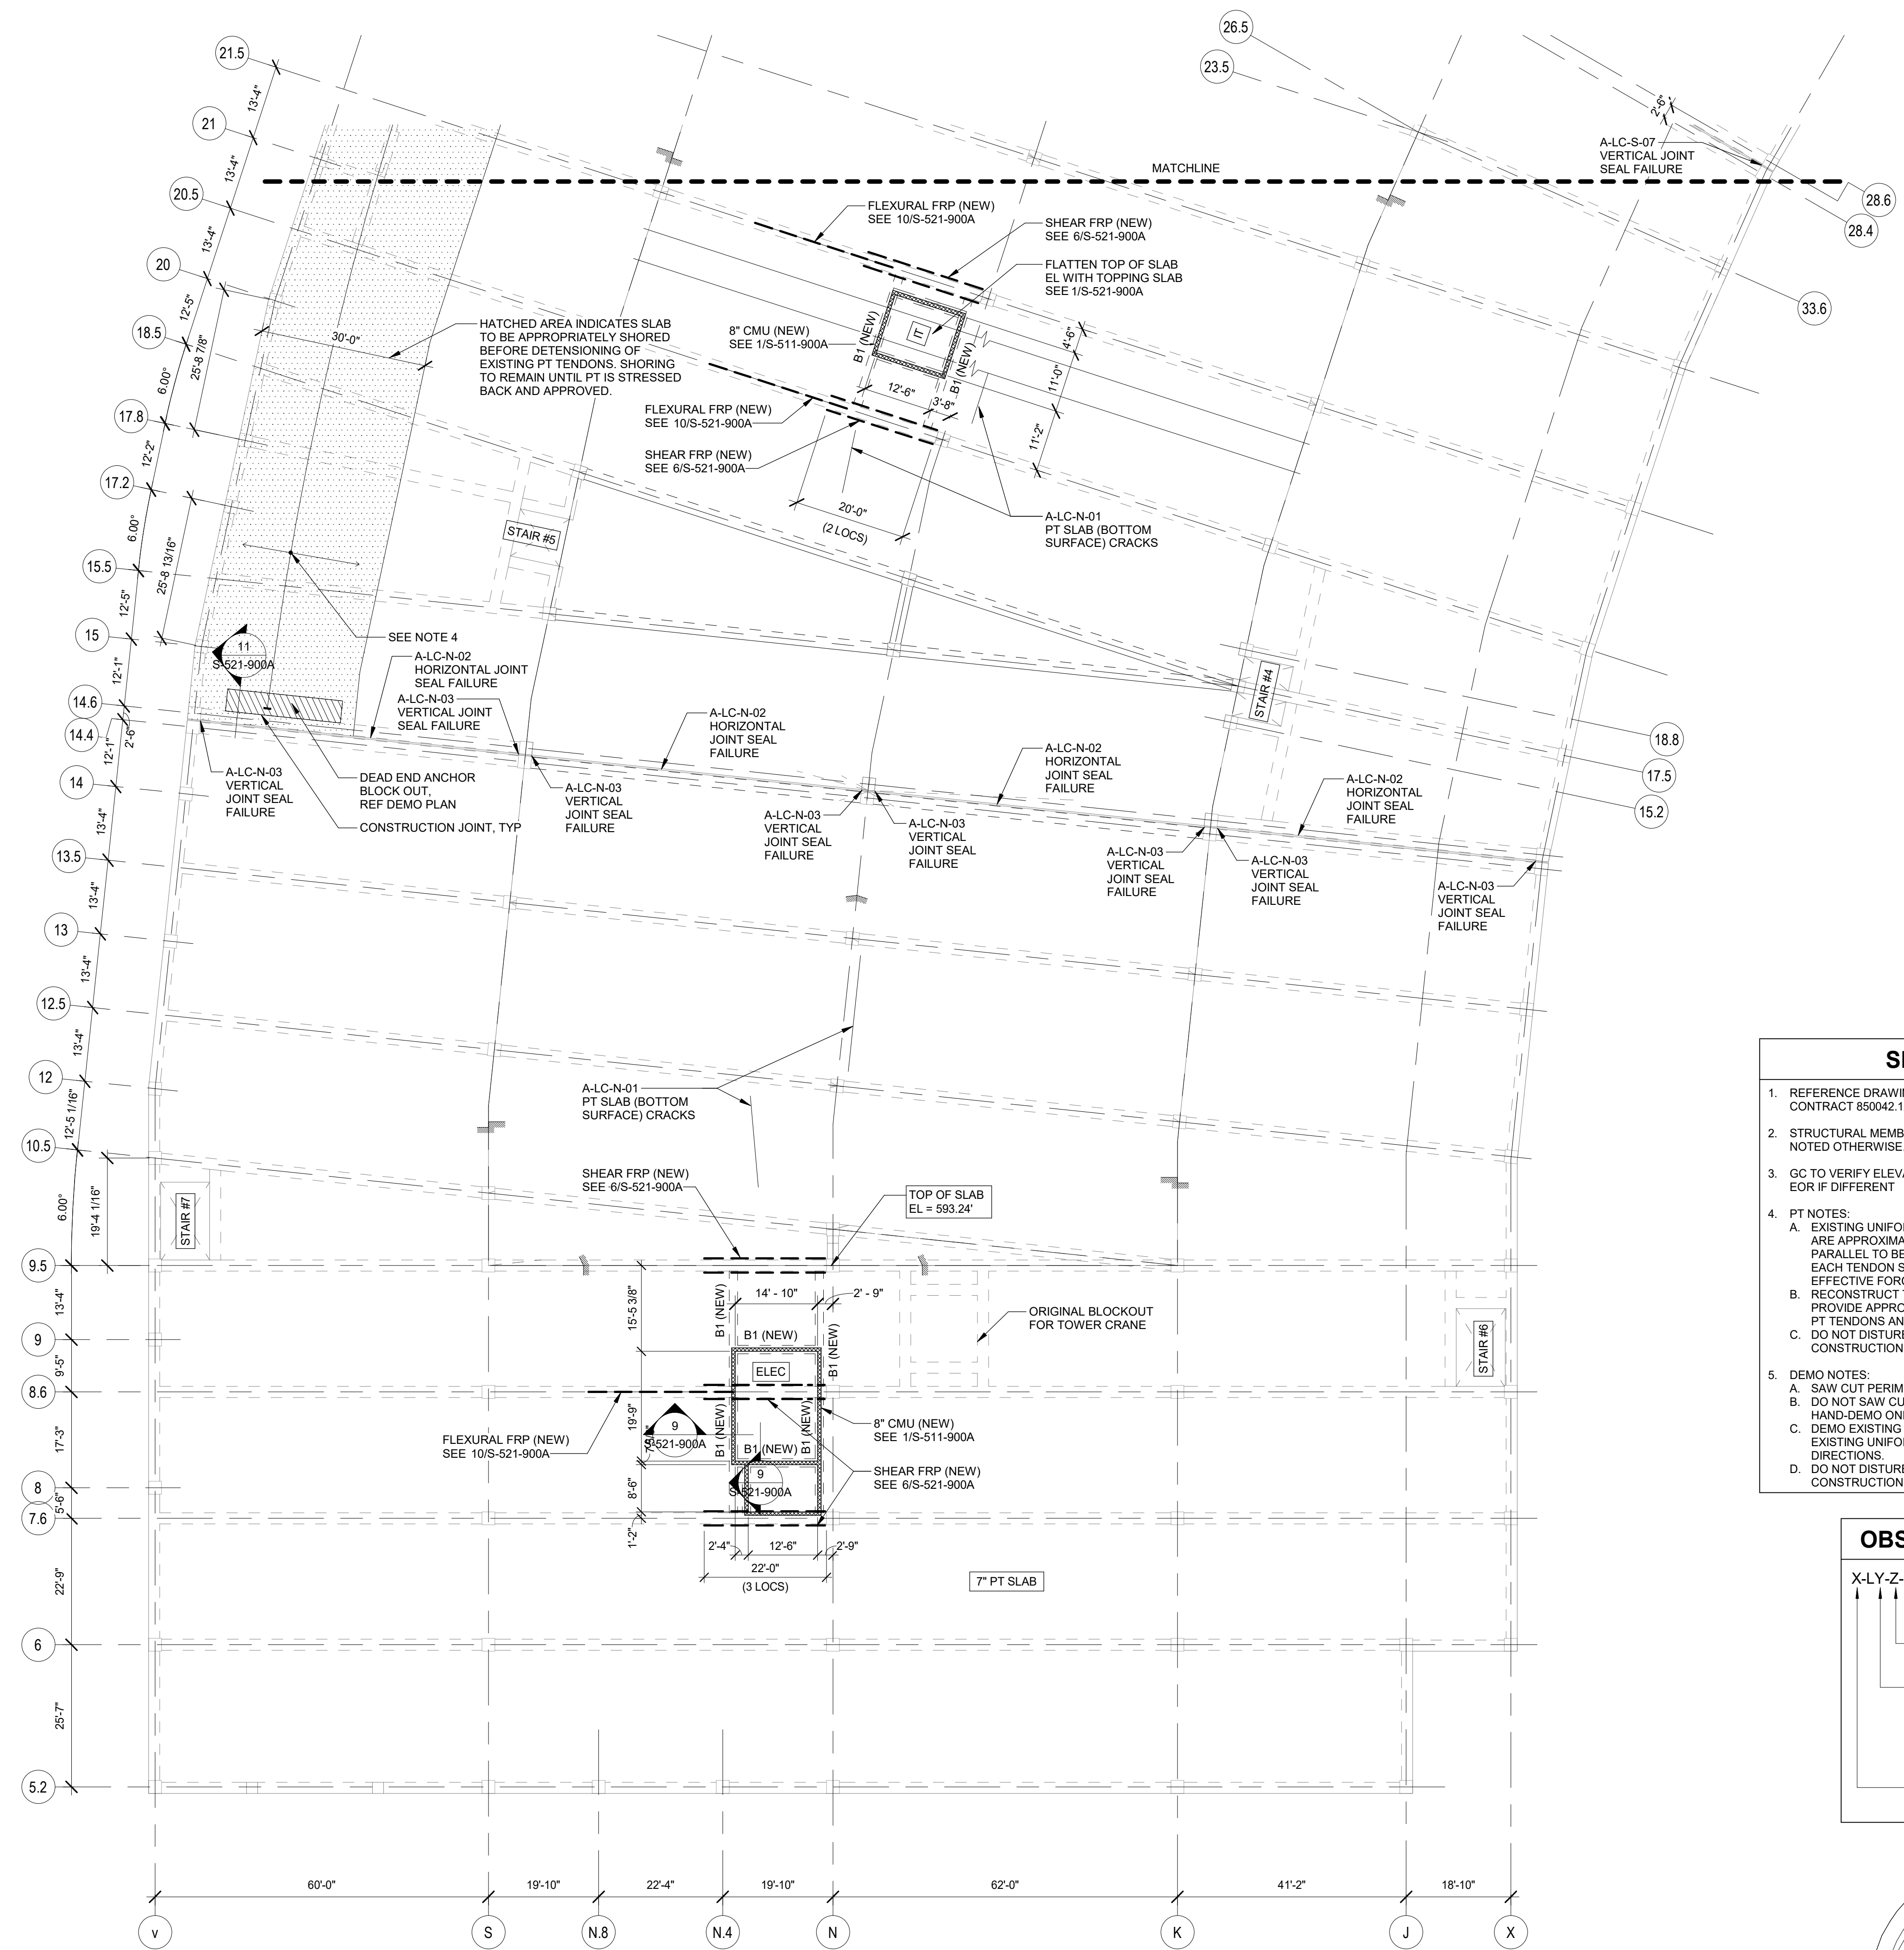


2 GARAGE A LEVEL C - PARTIAL DEMO PLAN AT DEAD END
1/16" = 1'-0"

1 GARAGE A LEVEL C FRAMING PLAN - NORTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 85042.12 INVENTORY 37687
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
HAND-DEMO ONLY.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

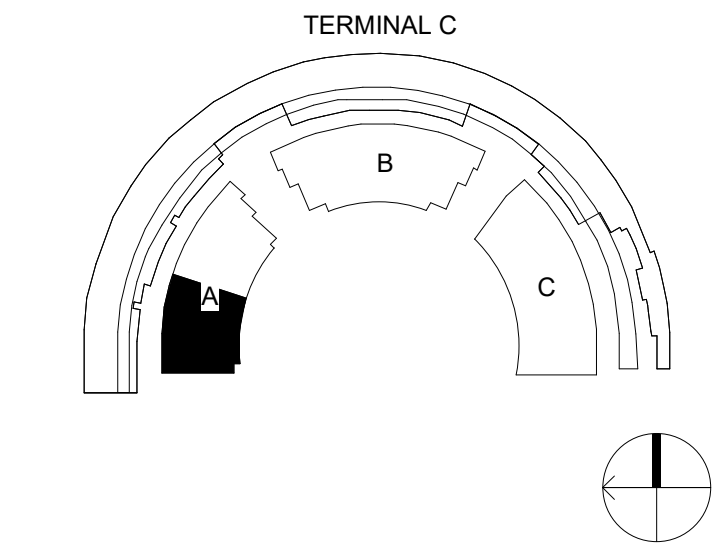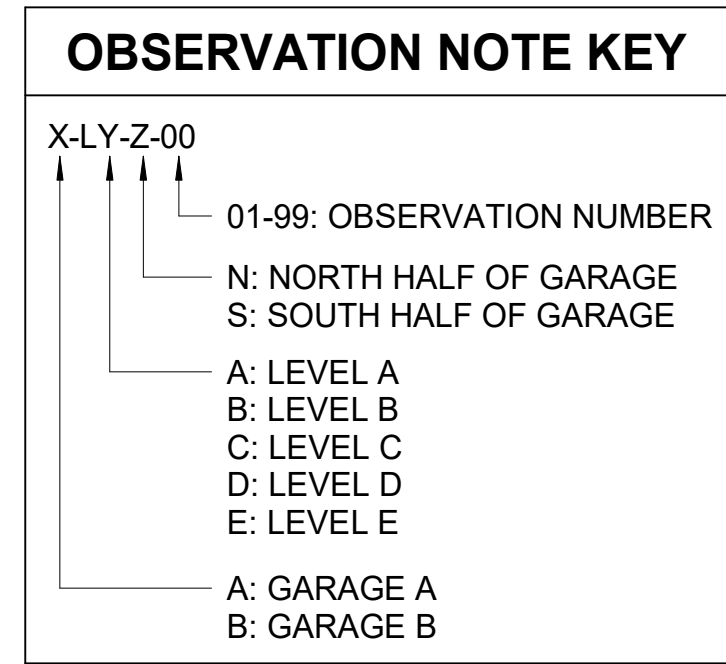

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

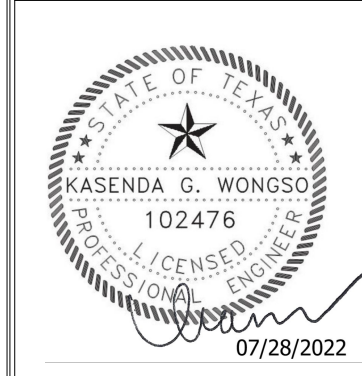

PROJECT # 21084.00000
15200 Addison Road, Suite 310
Addison, Texas 75001
Ph: 214.503.7802
www.agnco.com
TX REG. NO. F-8428
1-214-728-6000

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL C FRAMING PLAN - NORTH
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022


SHEET NUMBER
S-105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LC-S-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LC-S-02	BEAM SHEAR CRACKS	REINFORCE BEAM END USING FRP STRIPS (REF 8/S-521-900A) AFTER CRACK REPAIR PER GENERAL NOTES
A-LC-S-03	BEAM SHEAR CRACKS	REINFORCE BEAM END USING FRP STRIPS (REF 8/S-521-900A) AFTER CRACK REPAIR PER GENERAL NOTES
A-LC-S-04	WALL SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LC-S-05	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LC-S-06	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LC-S-07	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES


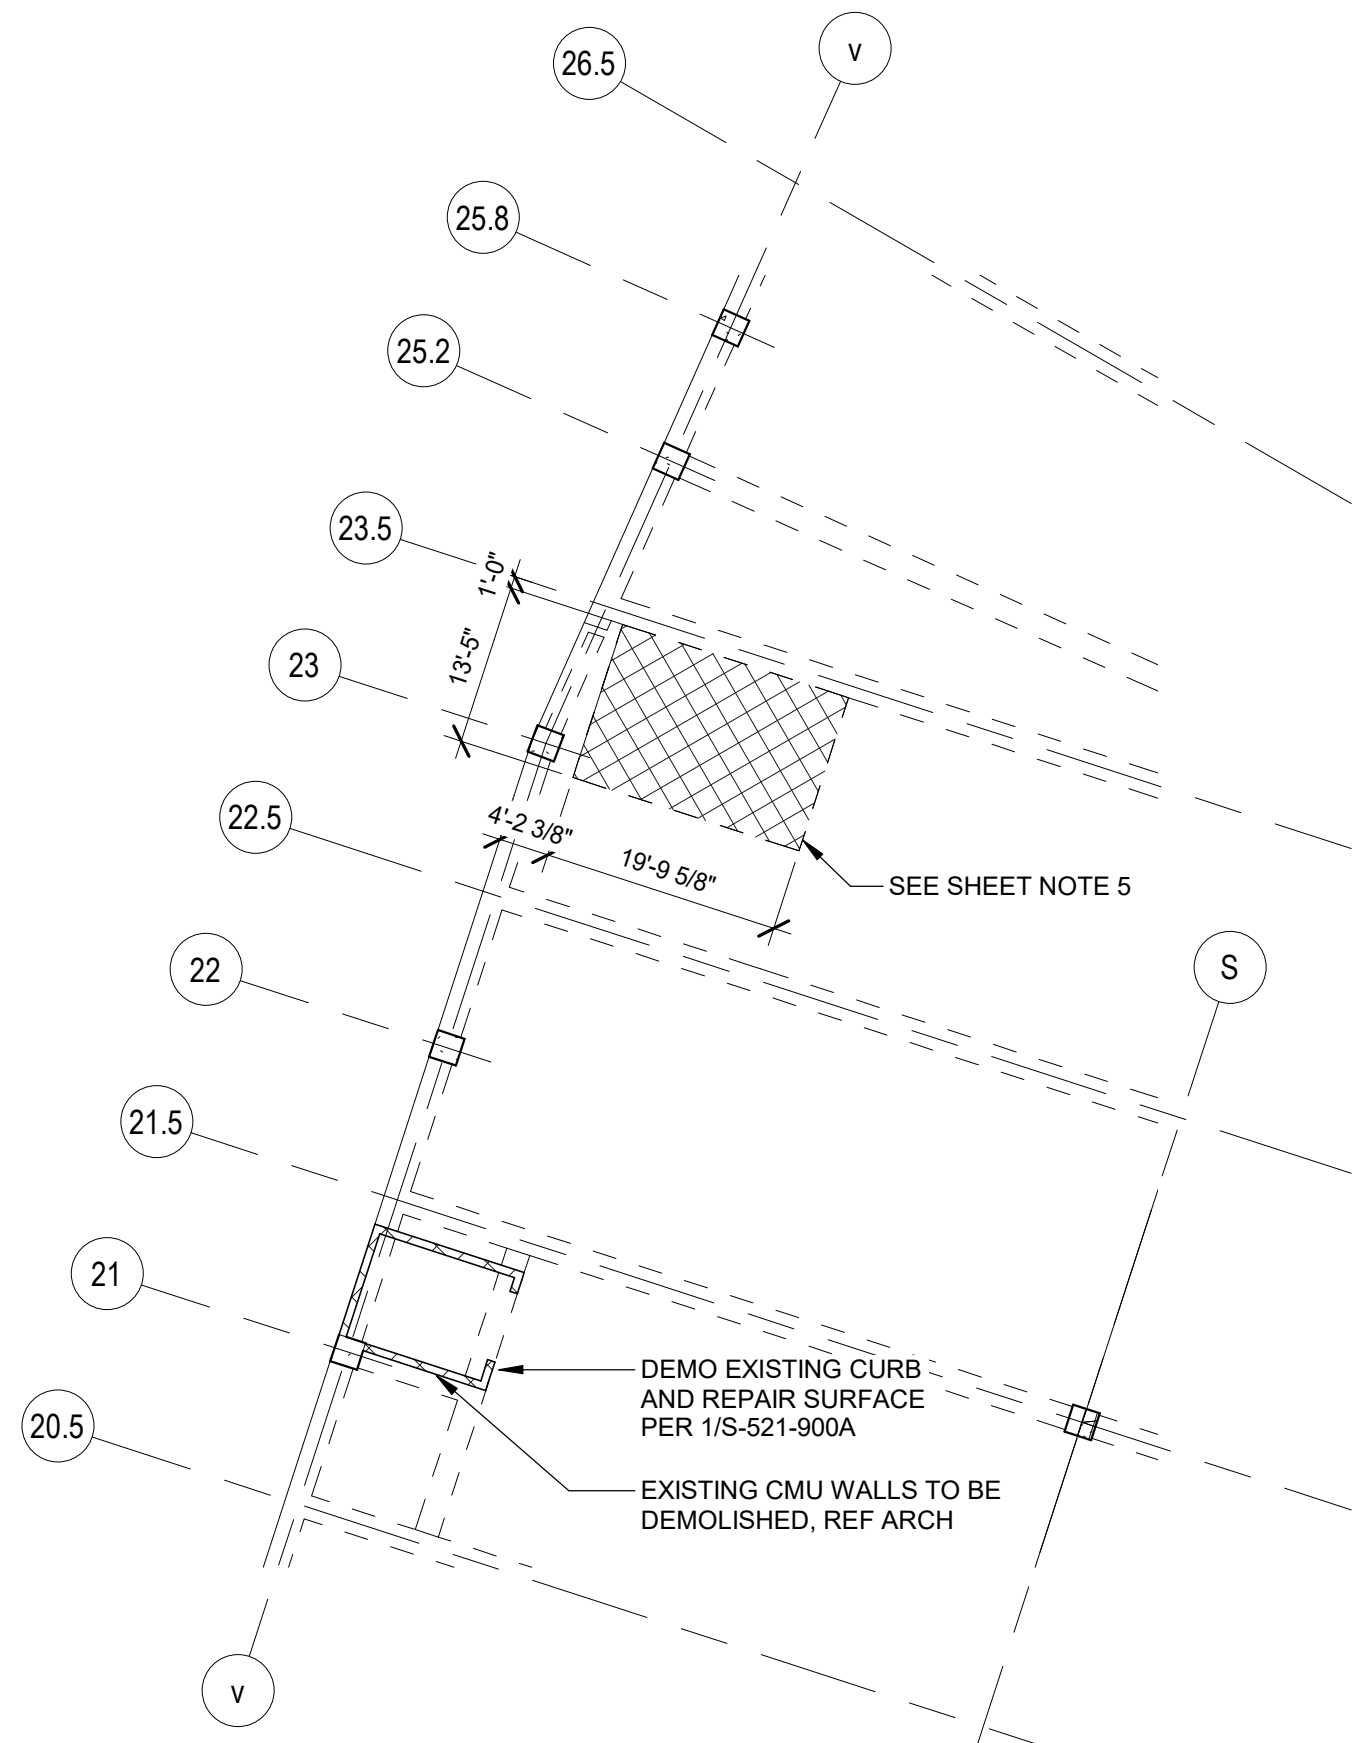


3 GARAGE A LEVEL C - PARTIAL DEMO PLAN AT ELEVATORS
1/16" = 1'-0"


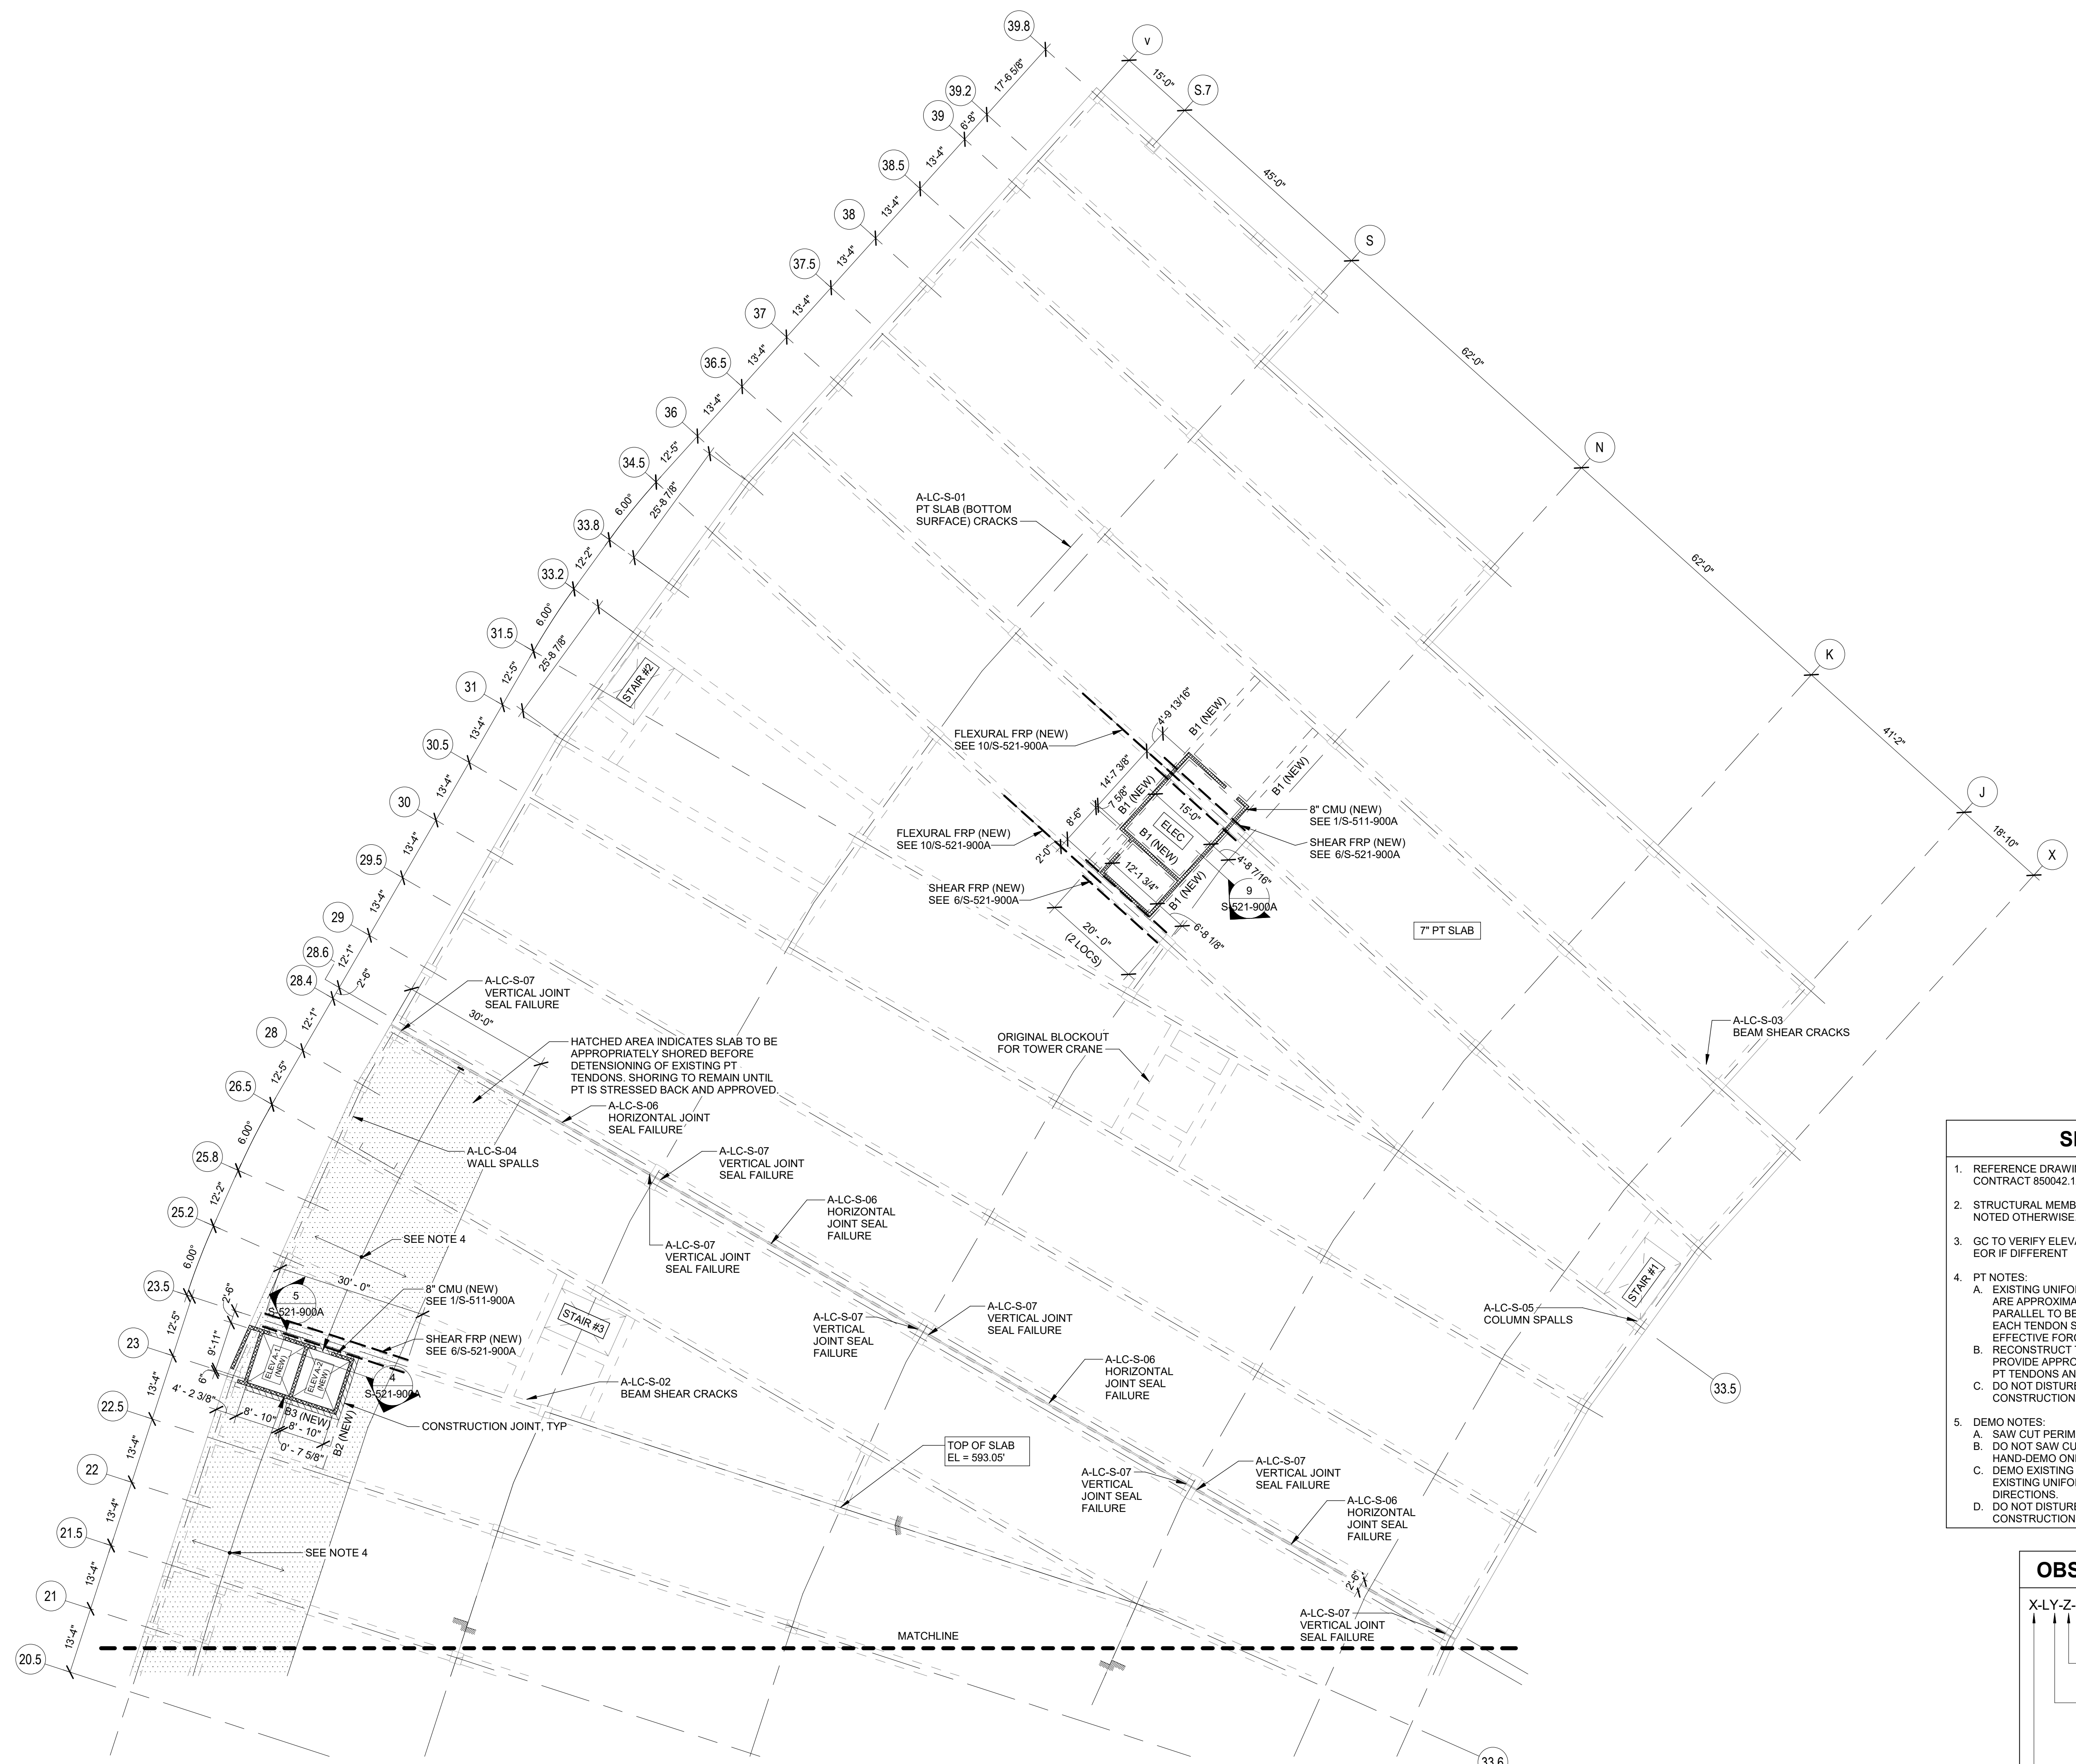


1 GARAGE A LEVEL C FRAMING PLAN - SOUTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 85042.12 INVENTORY 37687
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
HAND-DEMO ONLY.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

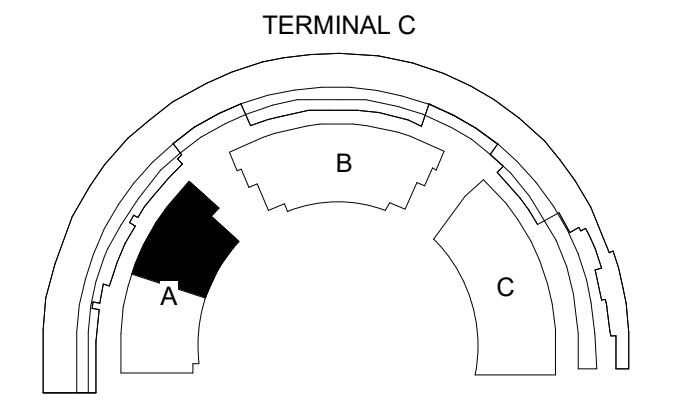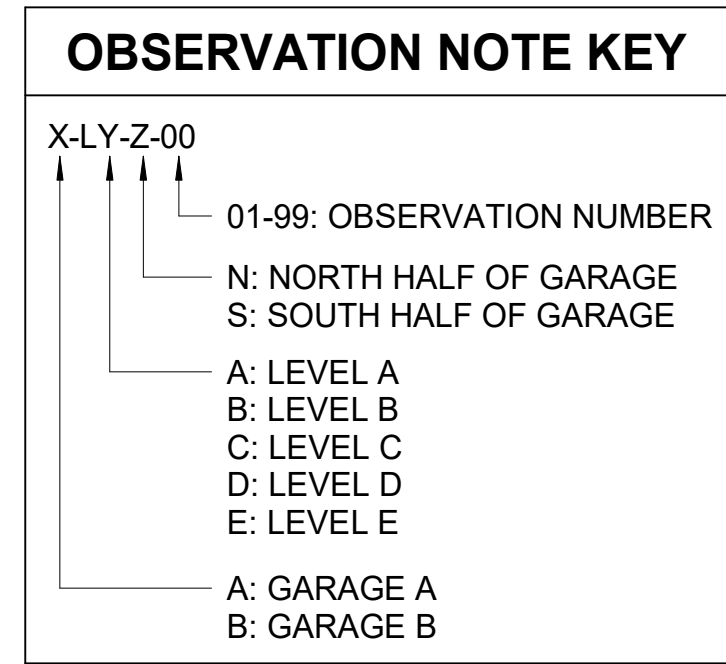

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

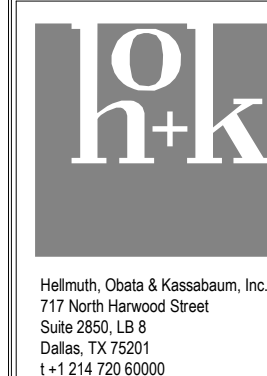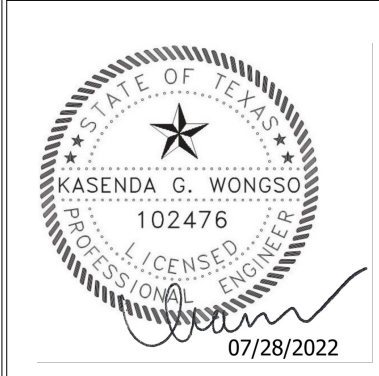

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION



NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL C FRAMING PLAN - SOUTH
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
S-106-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LD-N-01	SLAB SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LD-N-02	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LD-N-03	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES

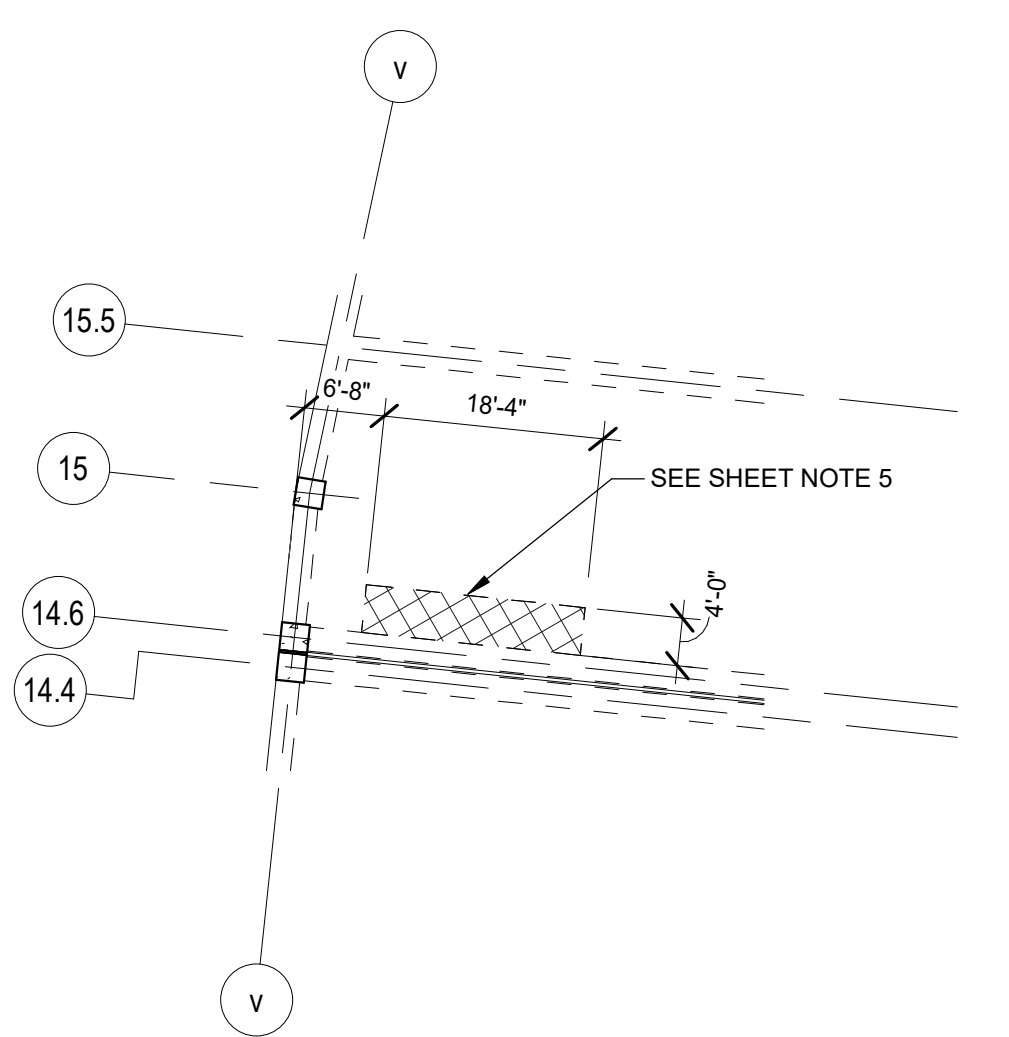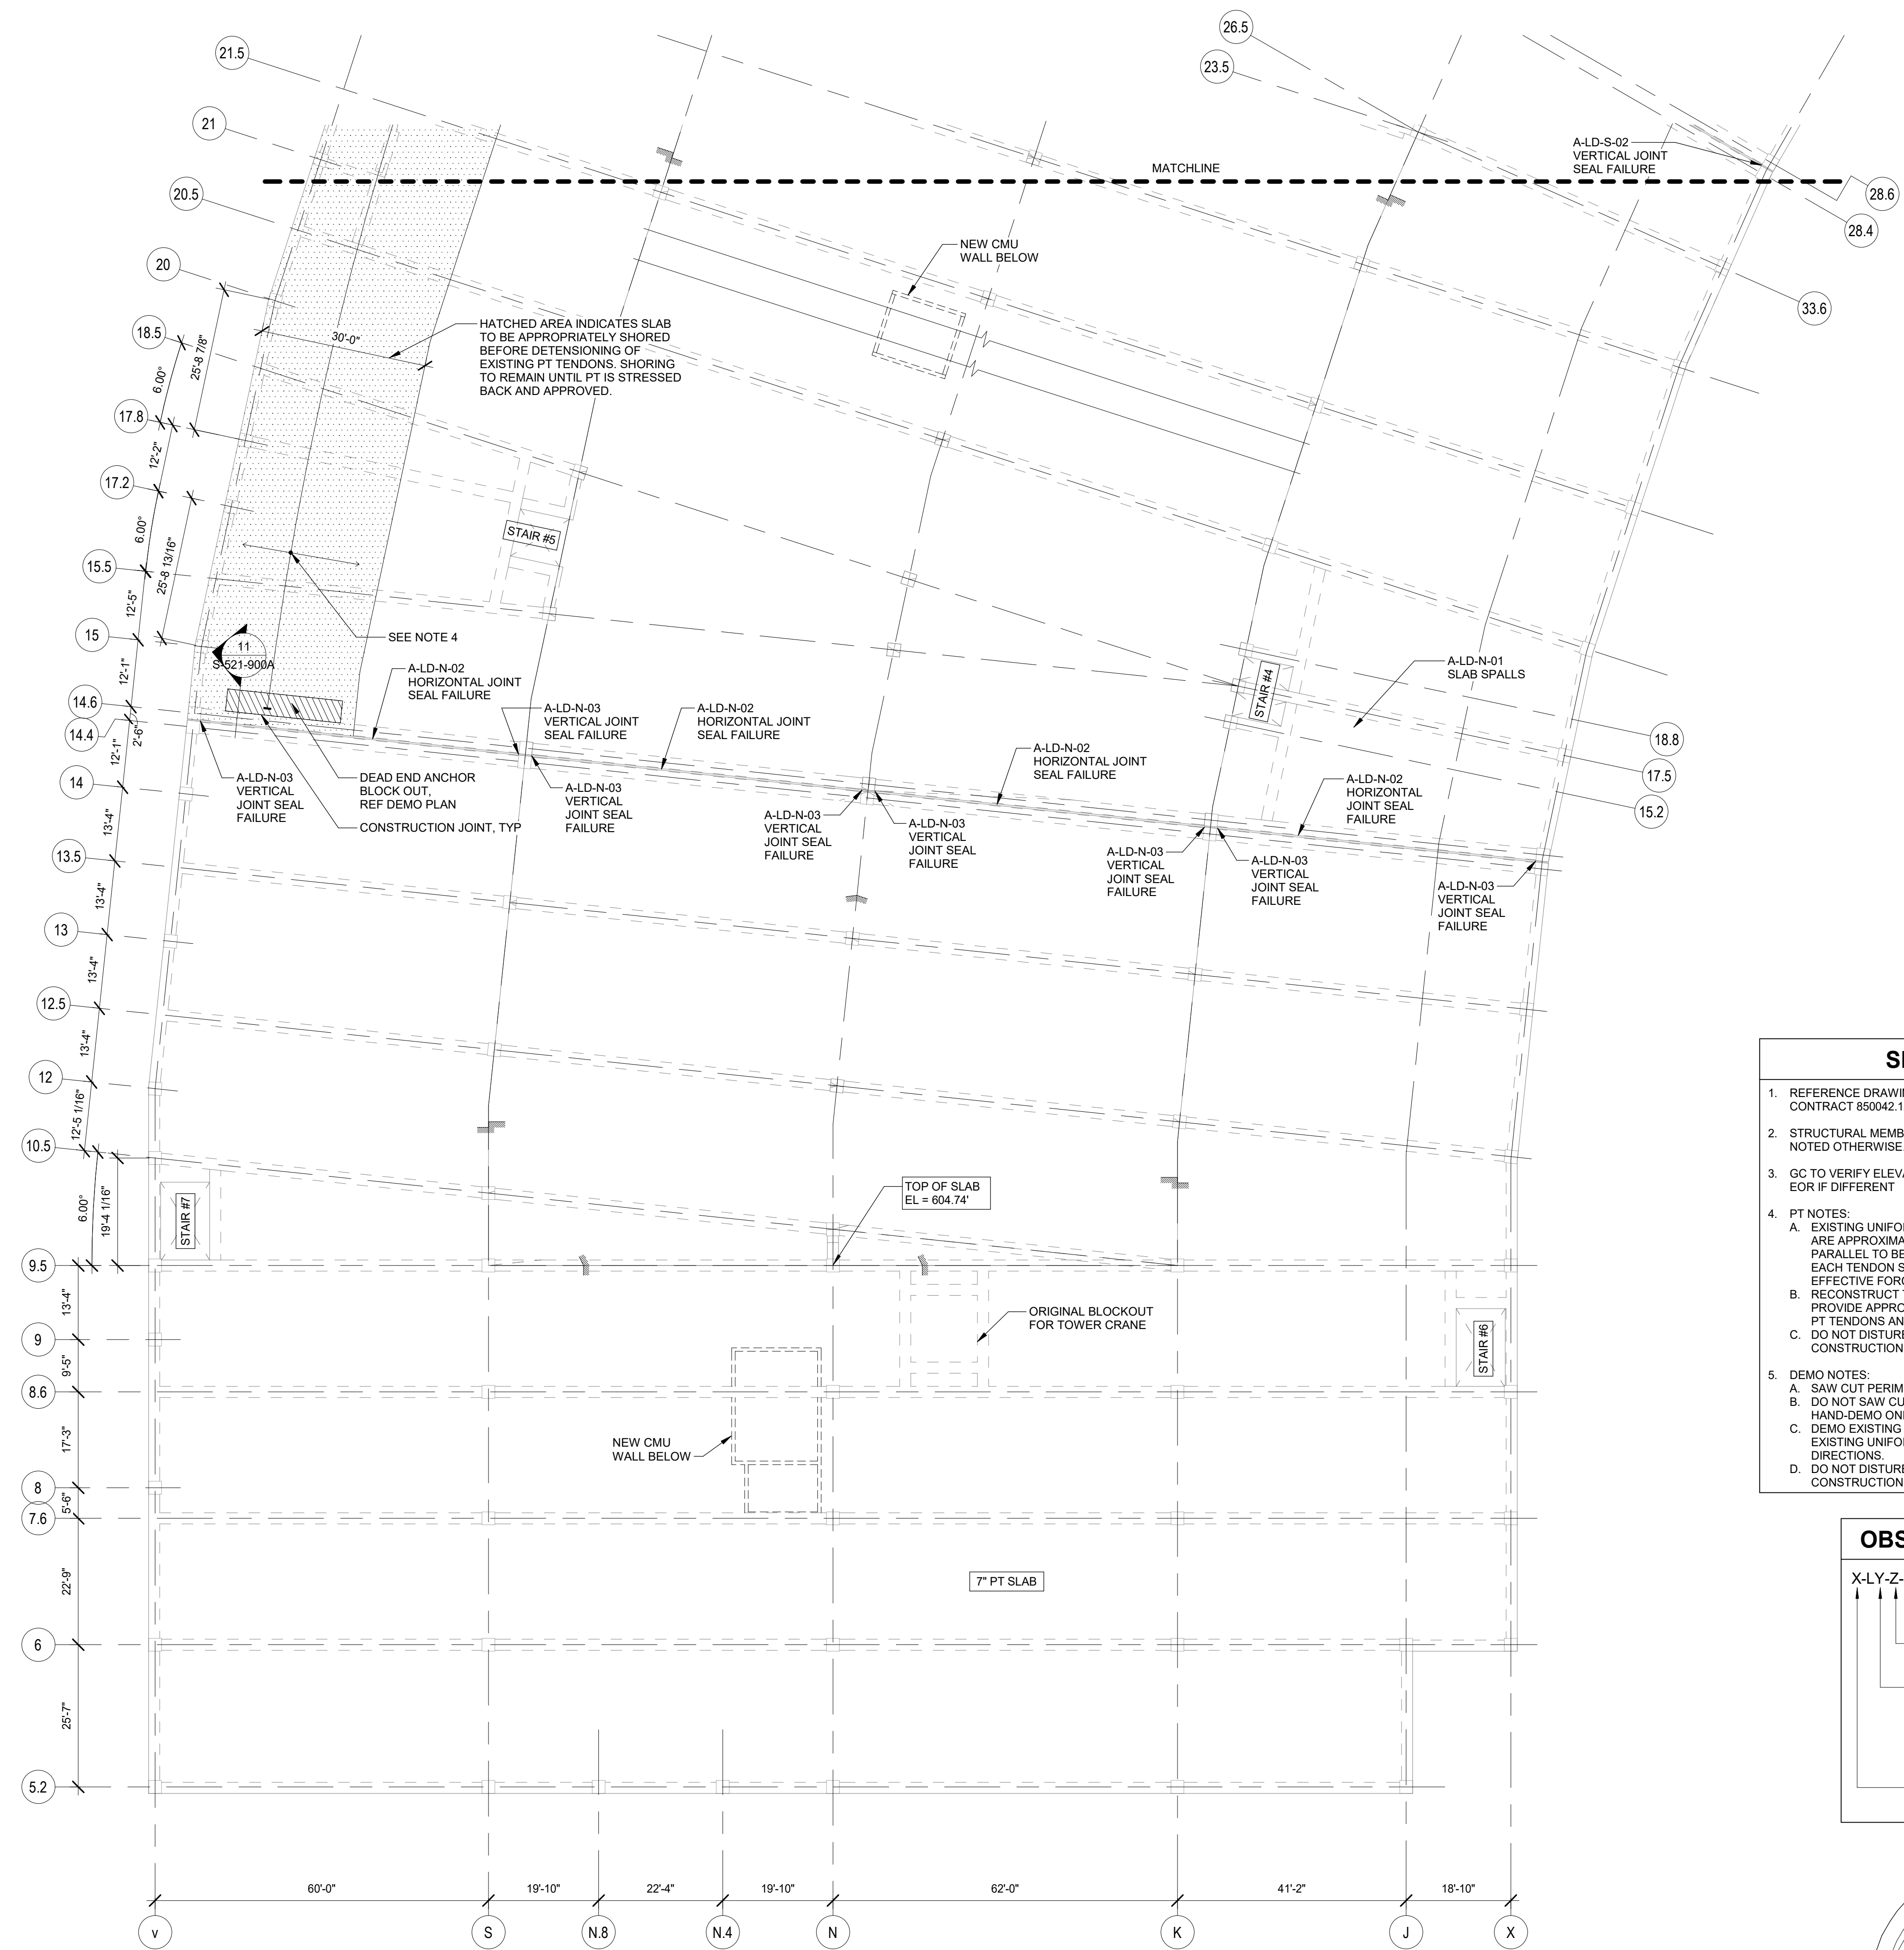


2 GARAGE A LEVEL D - PARTIAL DEMO PLAN AT DEAD END
1/16" = 1'-0"

1 GARAGE A LEVEL D FRAMING PLAN - NORTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 850042.12 INVENTORY 37688
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
HAND-DEMO ONLY.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

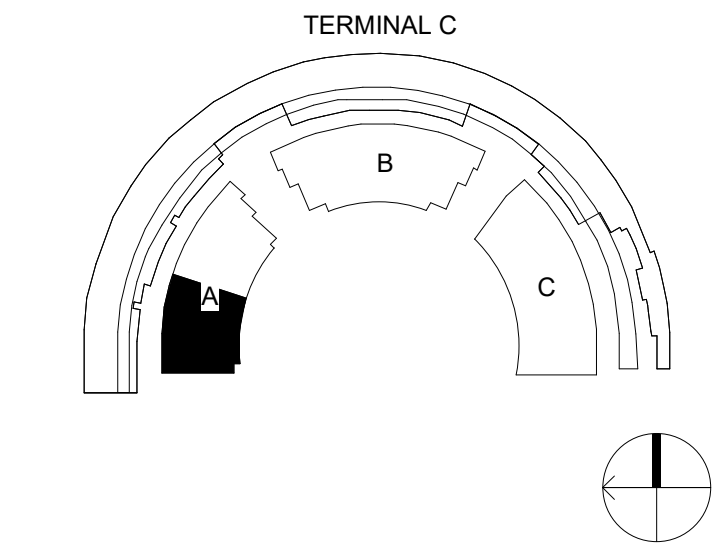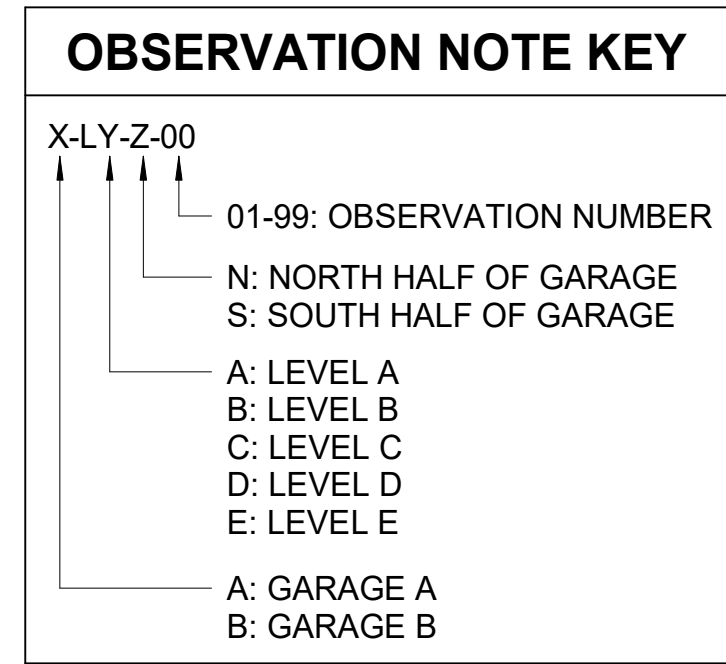

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

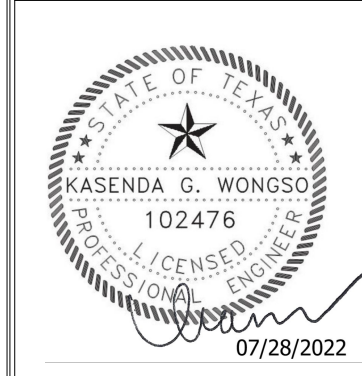

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL D FRAMING PLAN - NORTH
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022


SHEET NUMBER
S-107-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LD-S-01	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LD-S-02	VERTICAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES


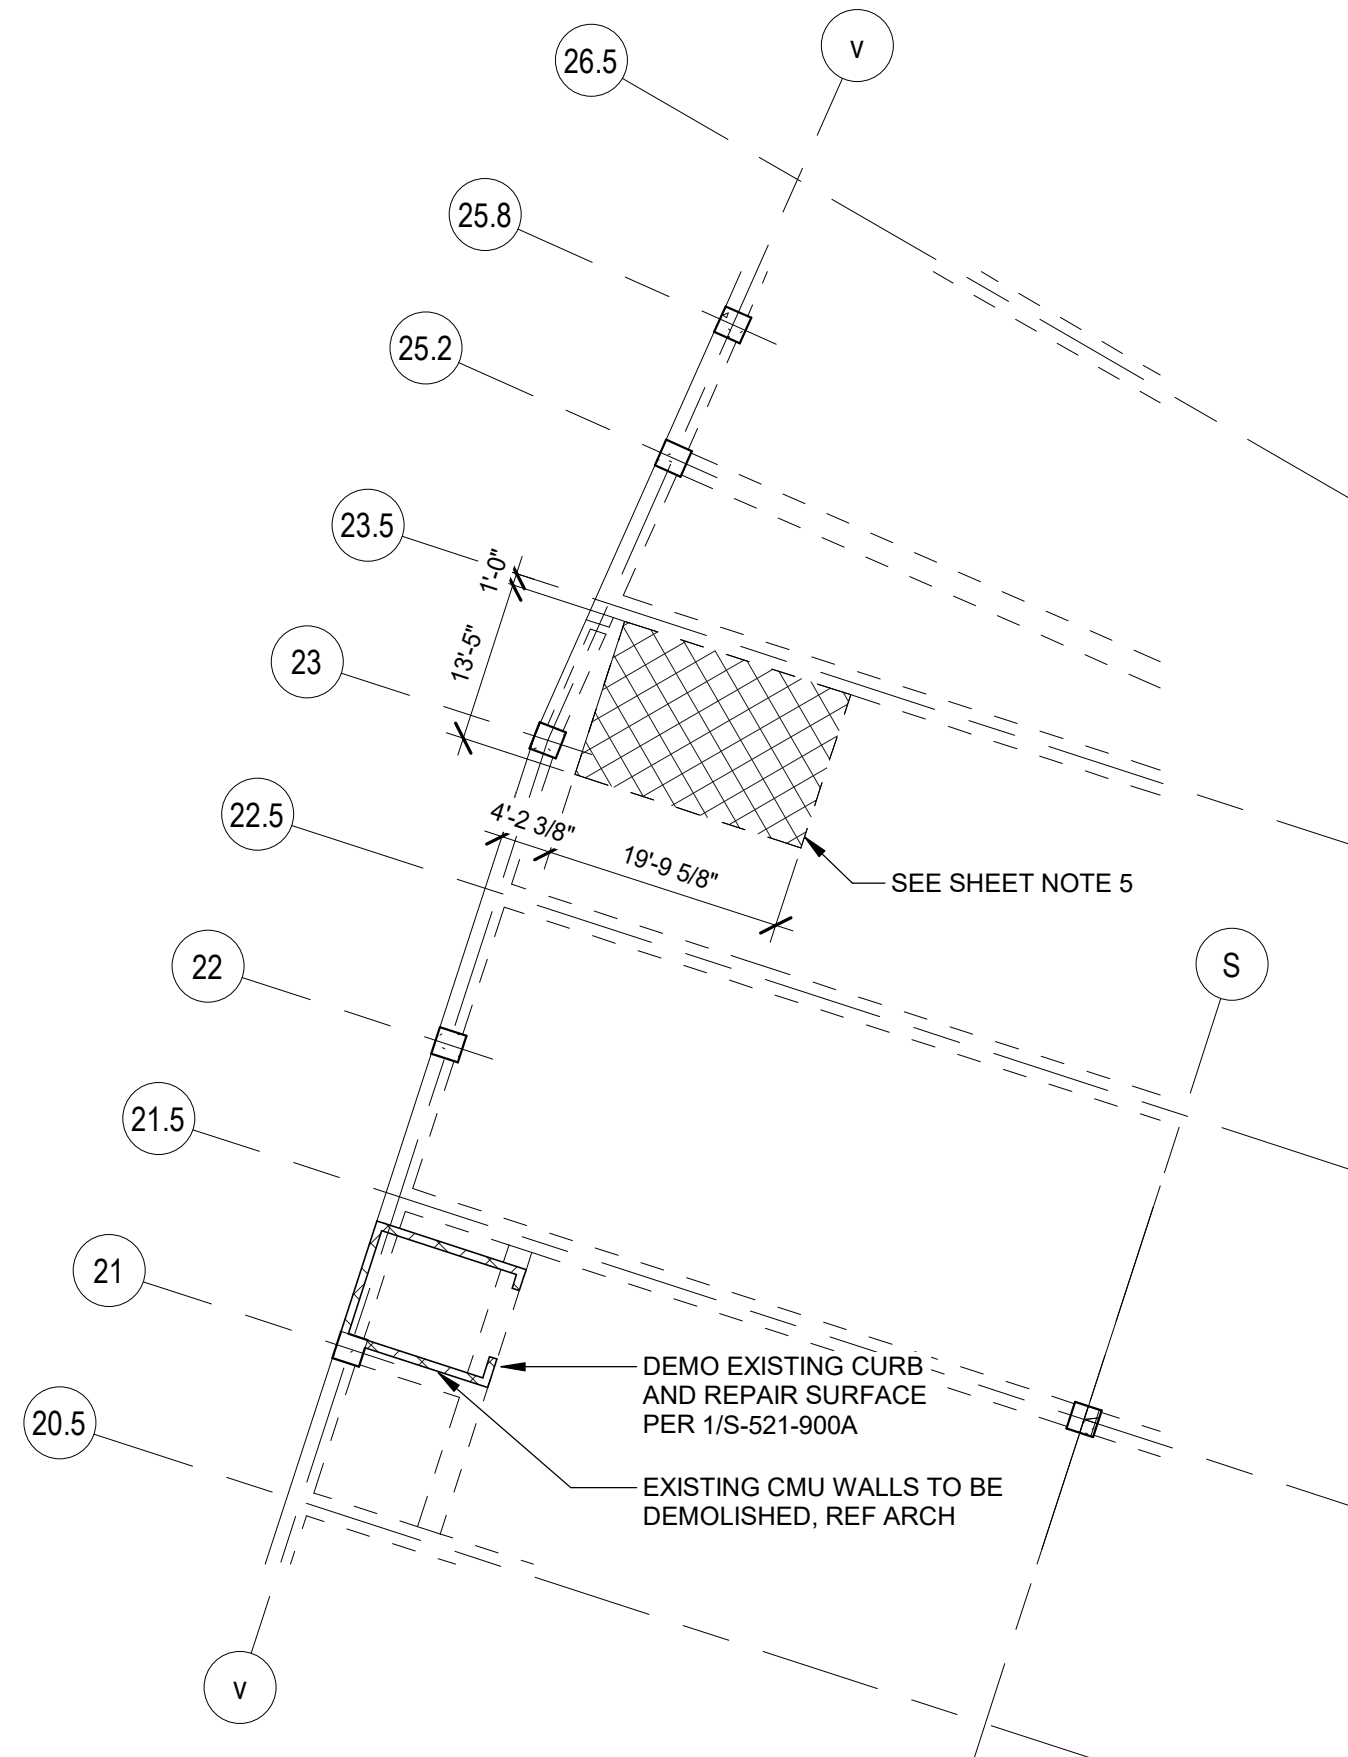


3 GARAGE A LEVEL D - PARTIAL DEMO PLAN AT ELEVATORS
1/16" = 1'-0"

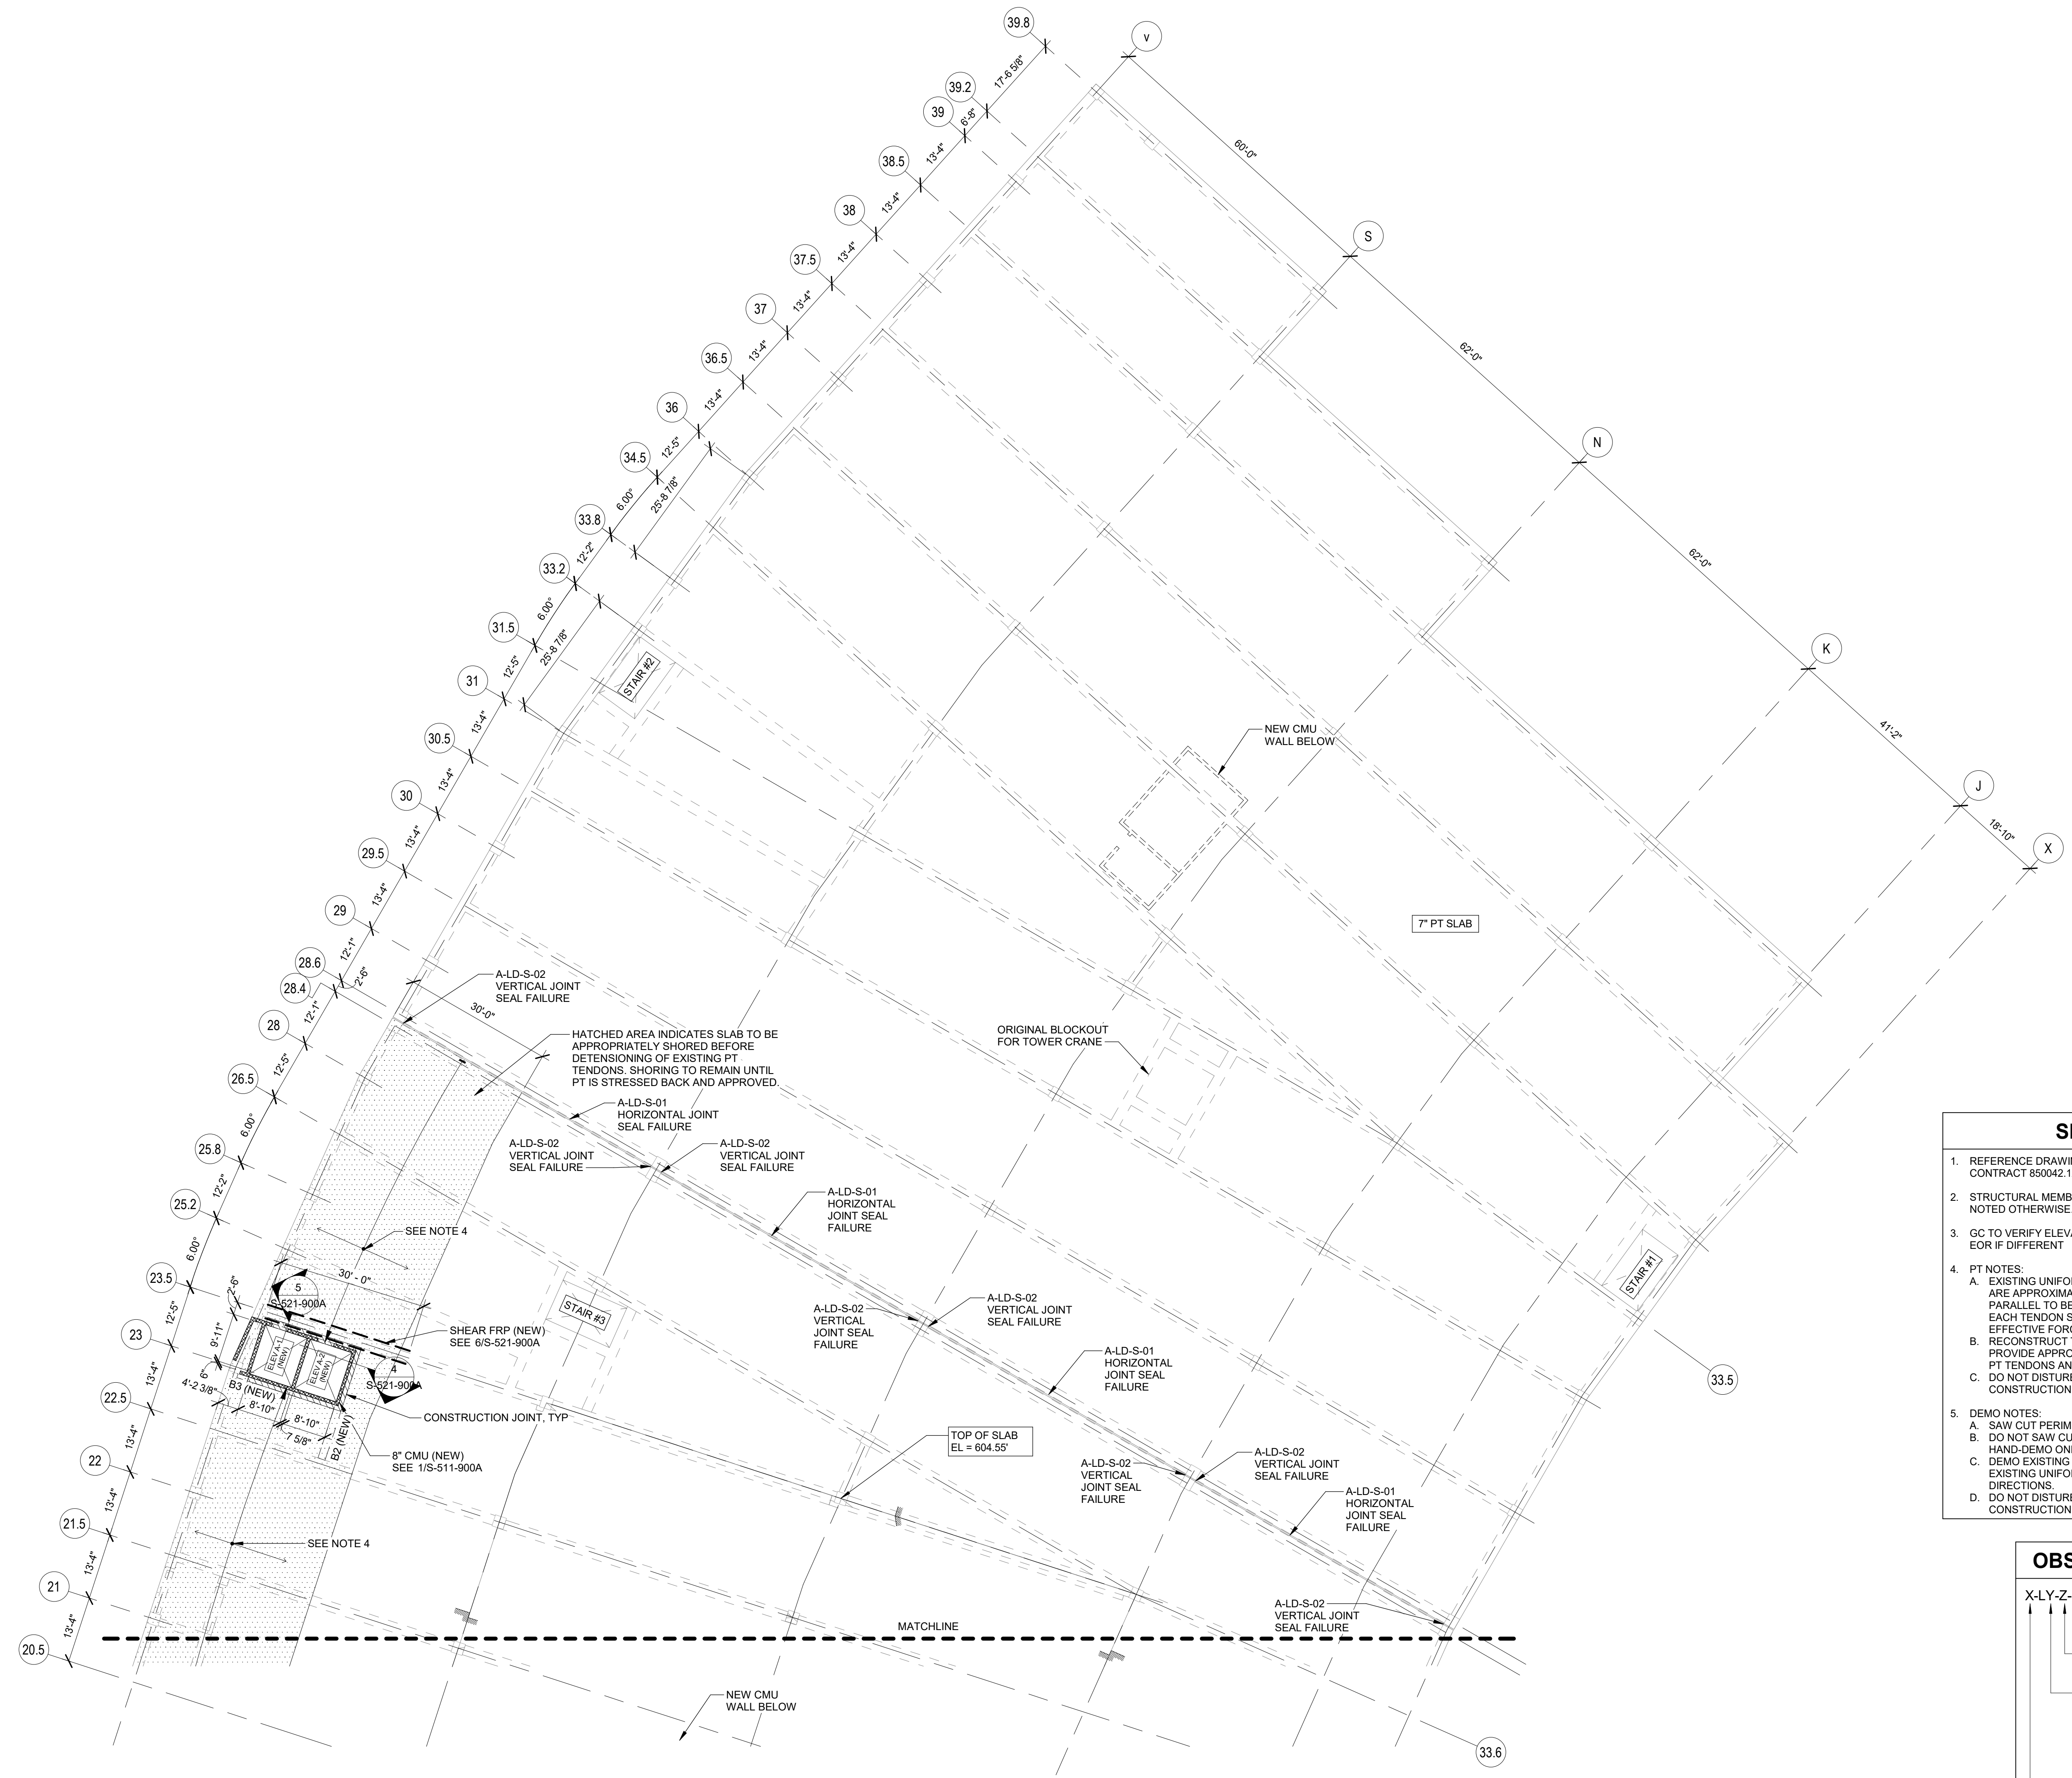


1 GARAGE A LEVEL D FRAMING PLAN - SOUTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 85042.12 INVENTORY 37688
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

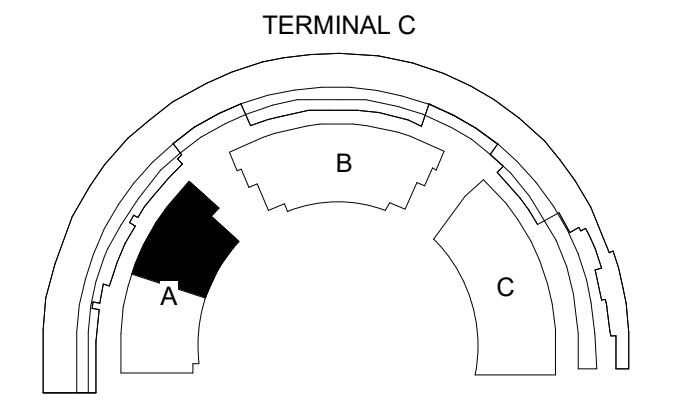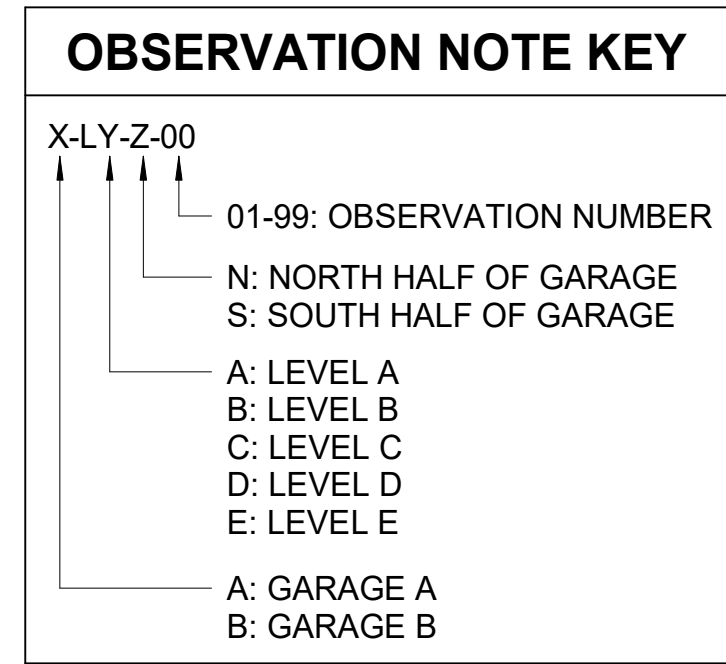

DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

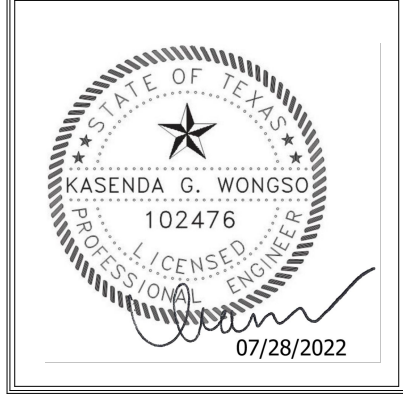

PROJECT # 21084.00000
 15200 Addison Road, Suite 310
 Addison, Texas 75001
 Ph: 214-503-7802
 www.agne.com
 TX REG. NO. F-8439
 1-214-722-6000

DRAWN BY: ADD/GY
 APPROVED BY: KW
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL D FRAMING PLAN - SOUTH
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022




SHEET NUMBER
S-108-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LE-N-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LE-N-02	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-N-03	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LE-N-04	COLUMN STUB JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES

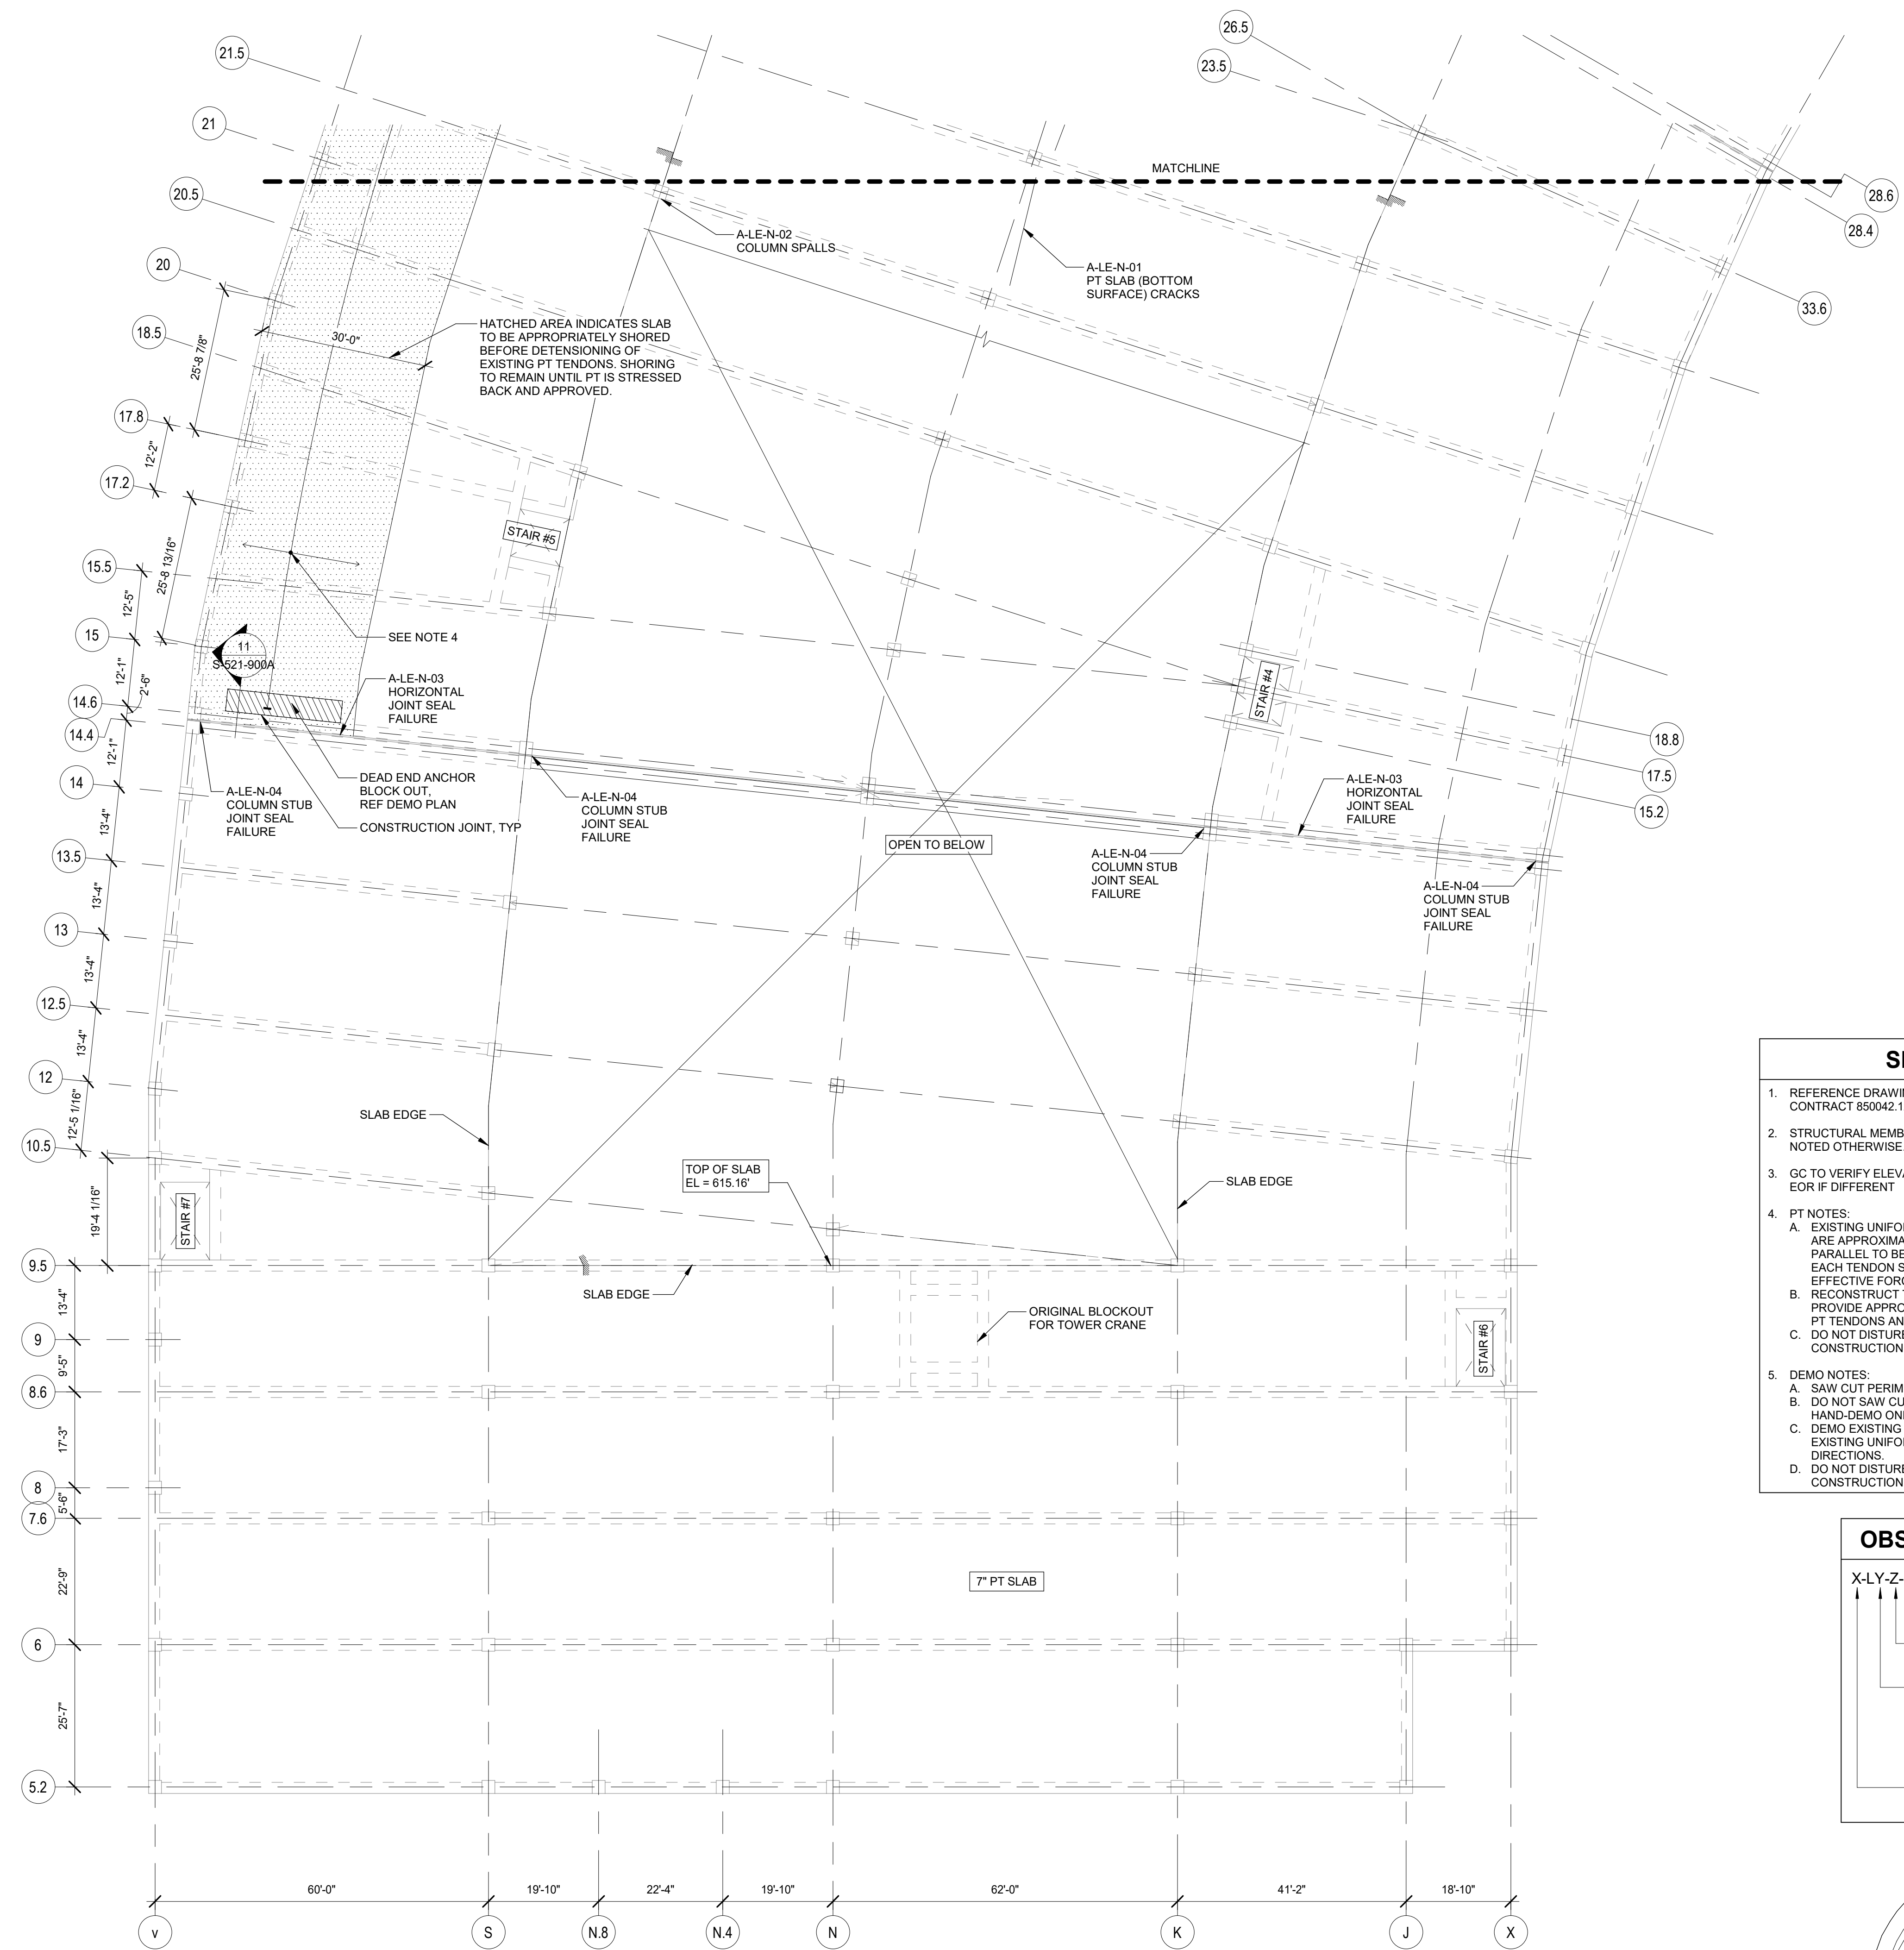

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 850042.12 INVENTORY 37689
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
HAND-DEMO ONLY.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

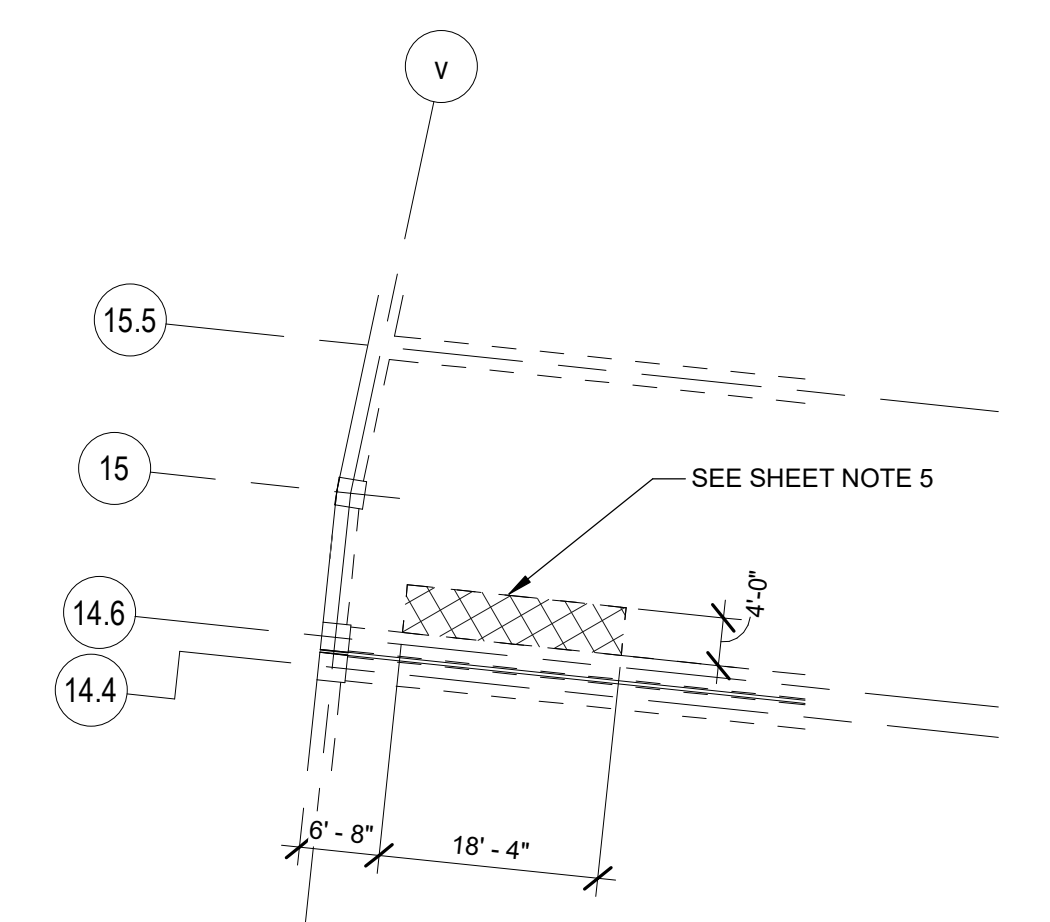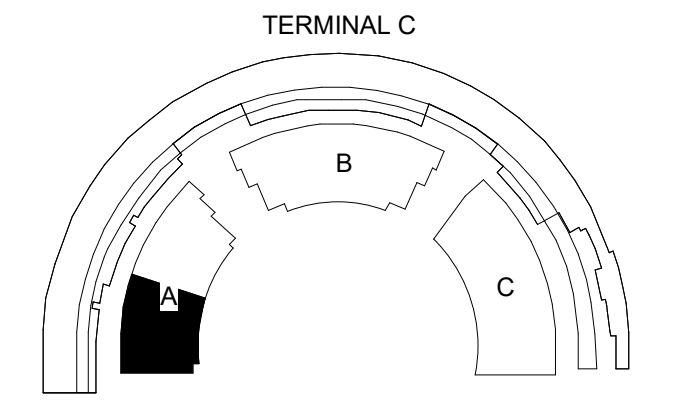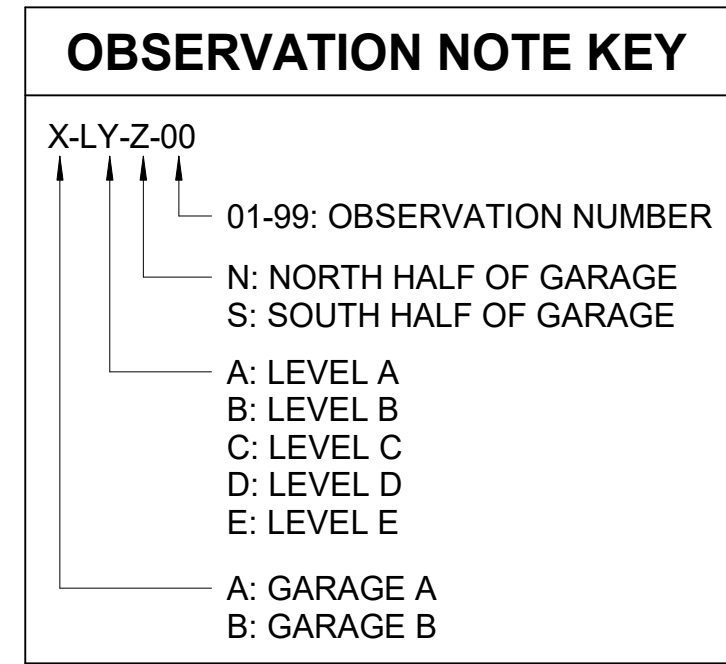


2 GARAGE A LEVEL E - PARTIAL DEMO PLAN AT DEAD END
1/16" = 1'-0"

1 GARAGE A LEVEL E FRAMING PLAN - NORTH
1/16" = 1'-0"



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

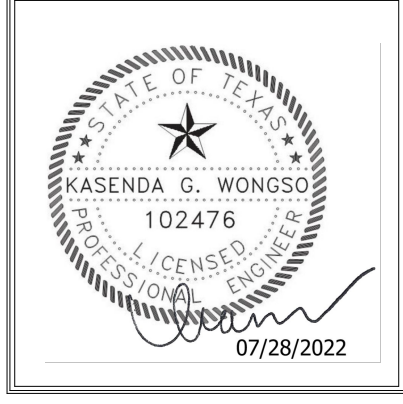

PROJECT # 21084.00000
15200 Addison Road, Suite 310
Addison, Texas 75001
Ph: 214.503.7802
www.agnie.com
TX REG. NO. F-8429
1-214-722-6000

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL E FRAMING PLAN - NORTH
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022


SHEET NUMBER
S-109-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

OBSERVATION NOTE	OBSERVED CONDITION	REPAIR NOTE
A-LE-S-01	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LE-S-02	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LE-S-03	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LE-S-04	PT SLAB (BOTTOM SURFACE) CRACKS	SURFACE SEAL CRACKS PER GENERAL NOTES
A-LE-S-05	BEAM SHEAR CRACKS	REINFORCE BEAM END USING FRP STRIPS (REF 8/S-521-900A) AFTER CRACK REPAIR PER GENERAL NOTES
A-LE-S-06	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-S-07	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-S-08	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-S-09	COLUMN SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-S-10	SLAB SPALLS	REPAIR SPALLS PER GENERAL NOTES
A-LE-S-11	HORIZONTAL JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES
A-LE-S-12	COLUMN STUB JOINT SEAL FAILURE	REPLACE JOINT SEAL MATERIAL PER GENERAL NOTES


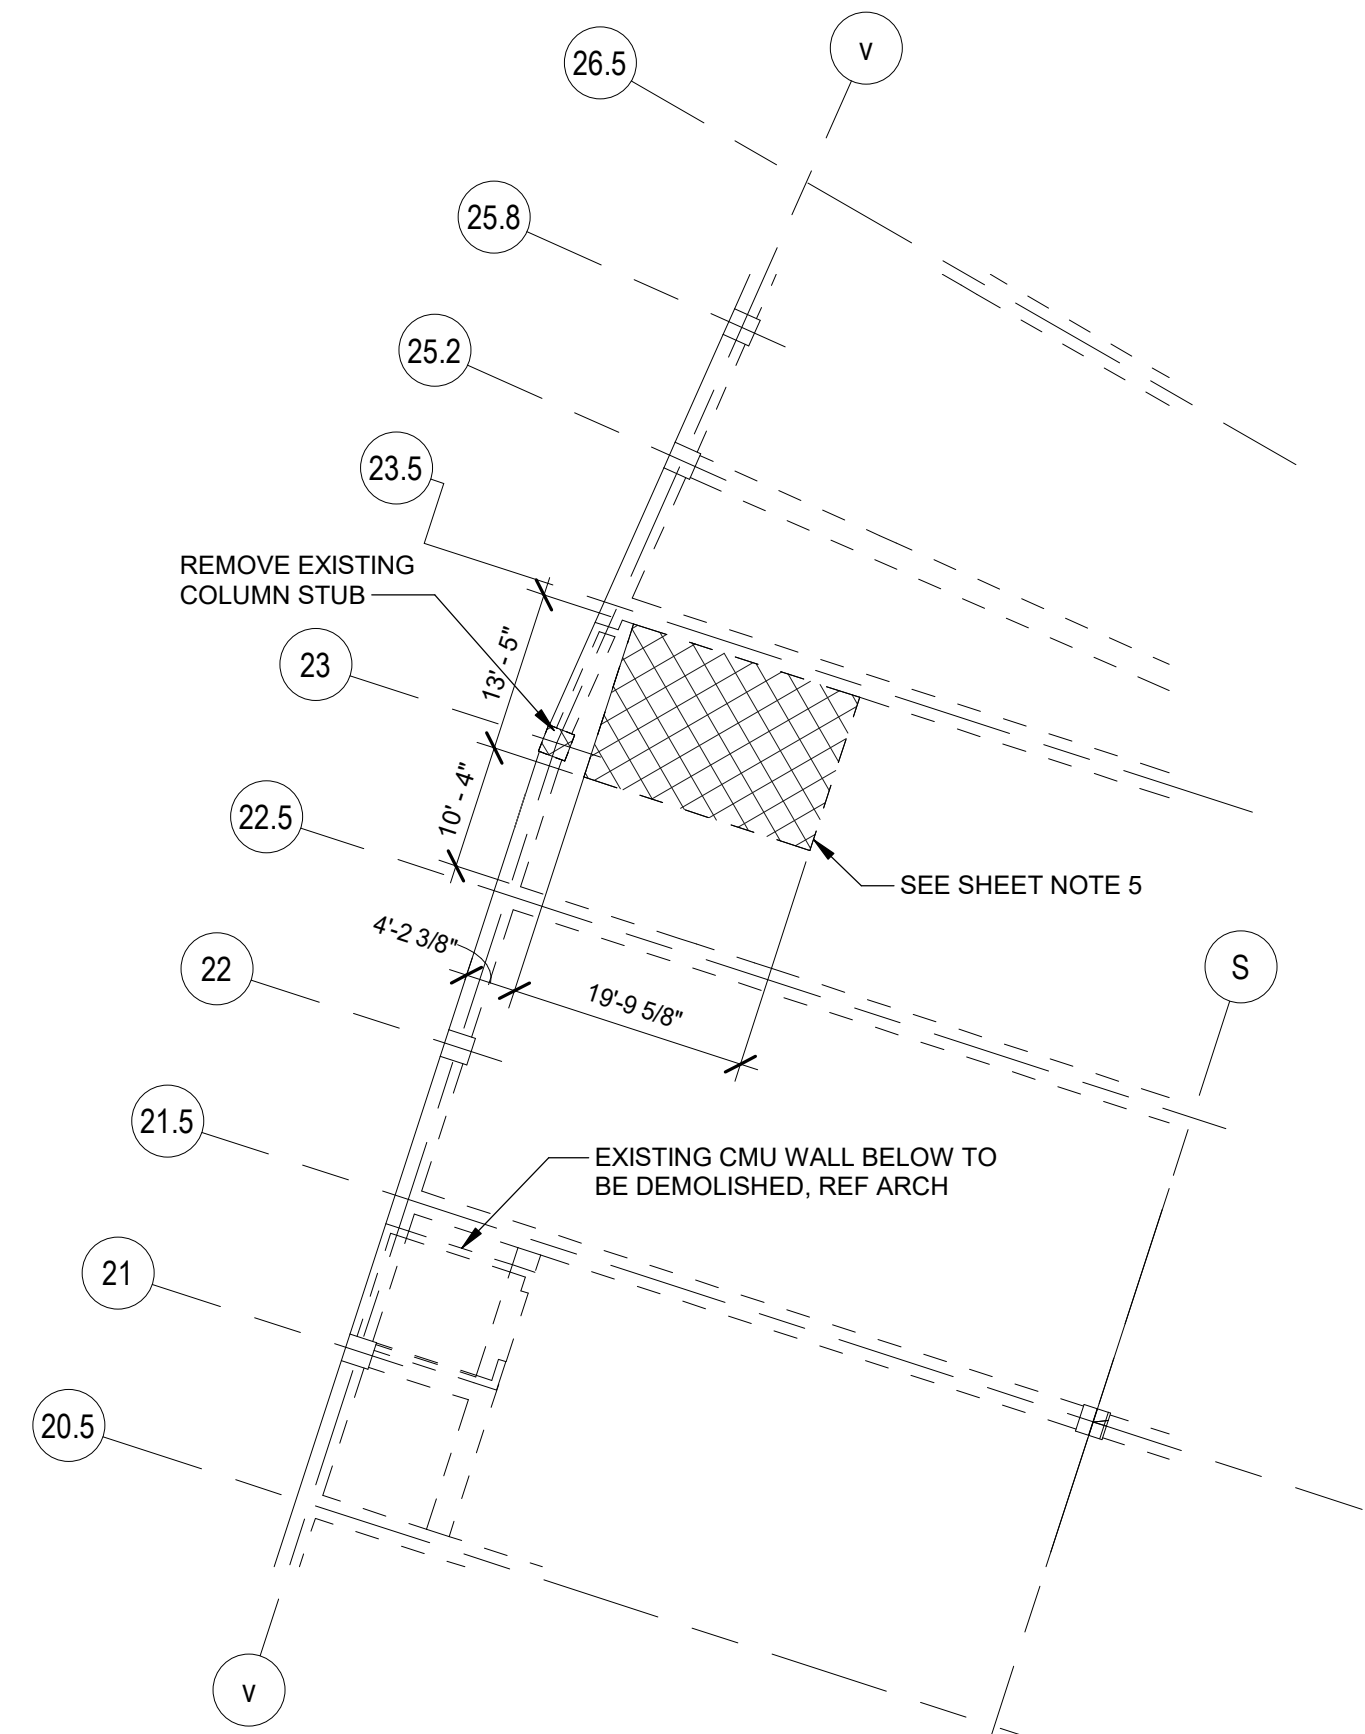


3 GARAGE A LEVEL E - PARTIAL DEMO PLAN AT ELEVATORS
1/16" = 1'-0"

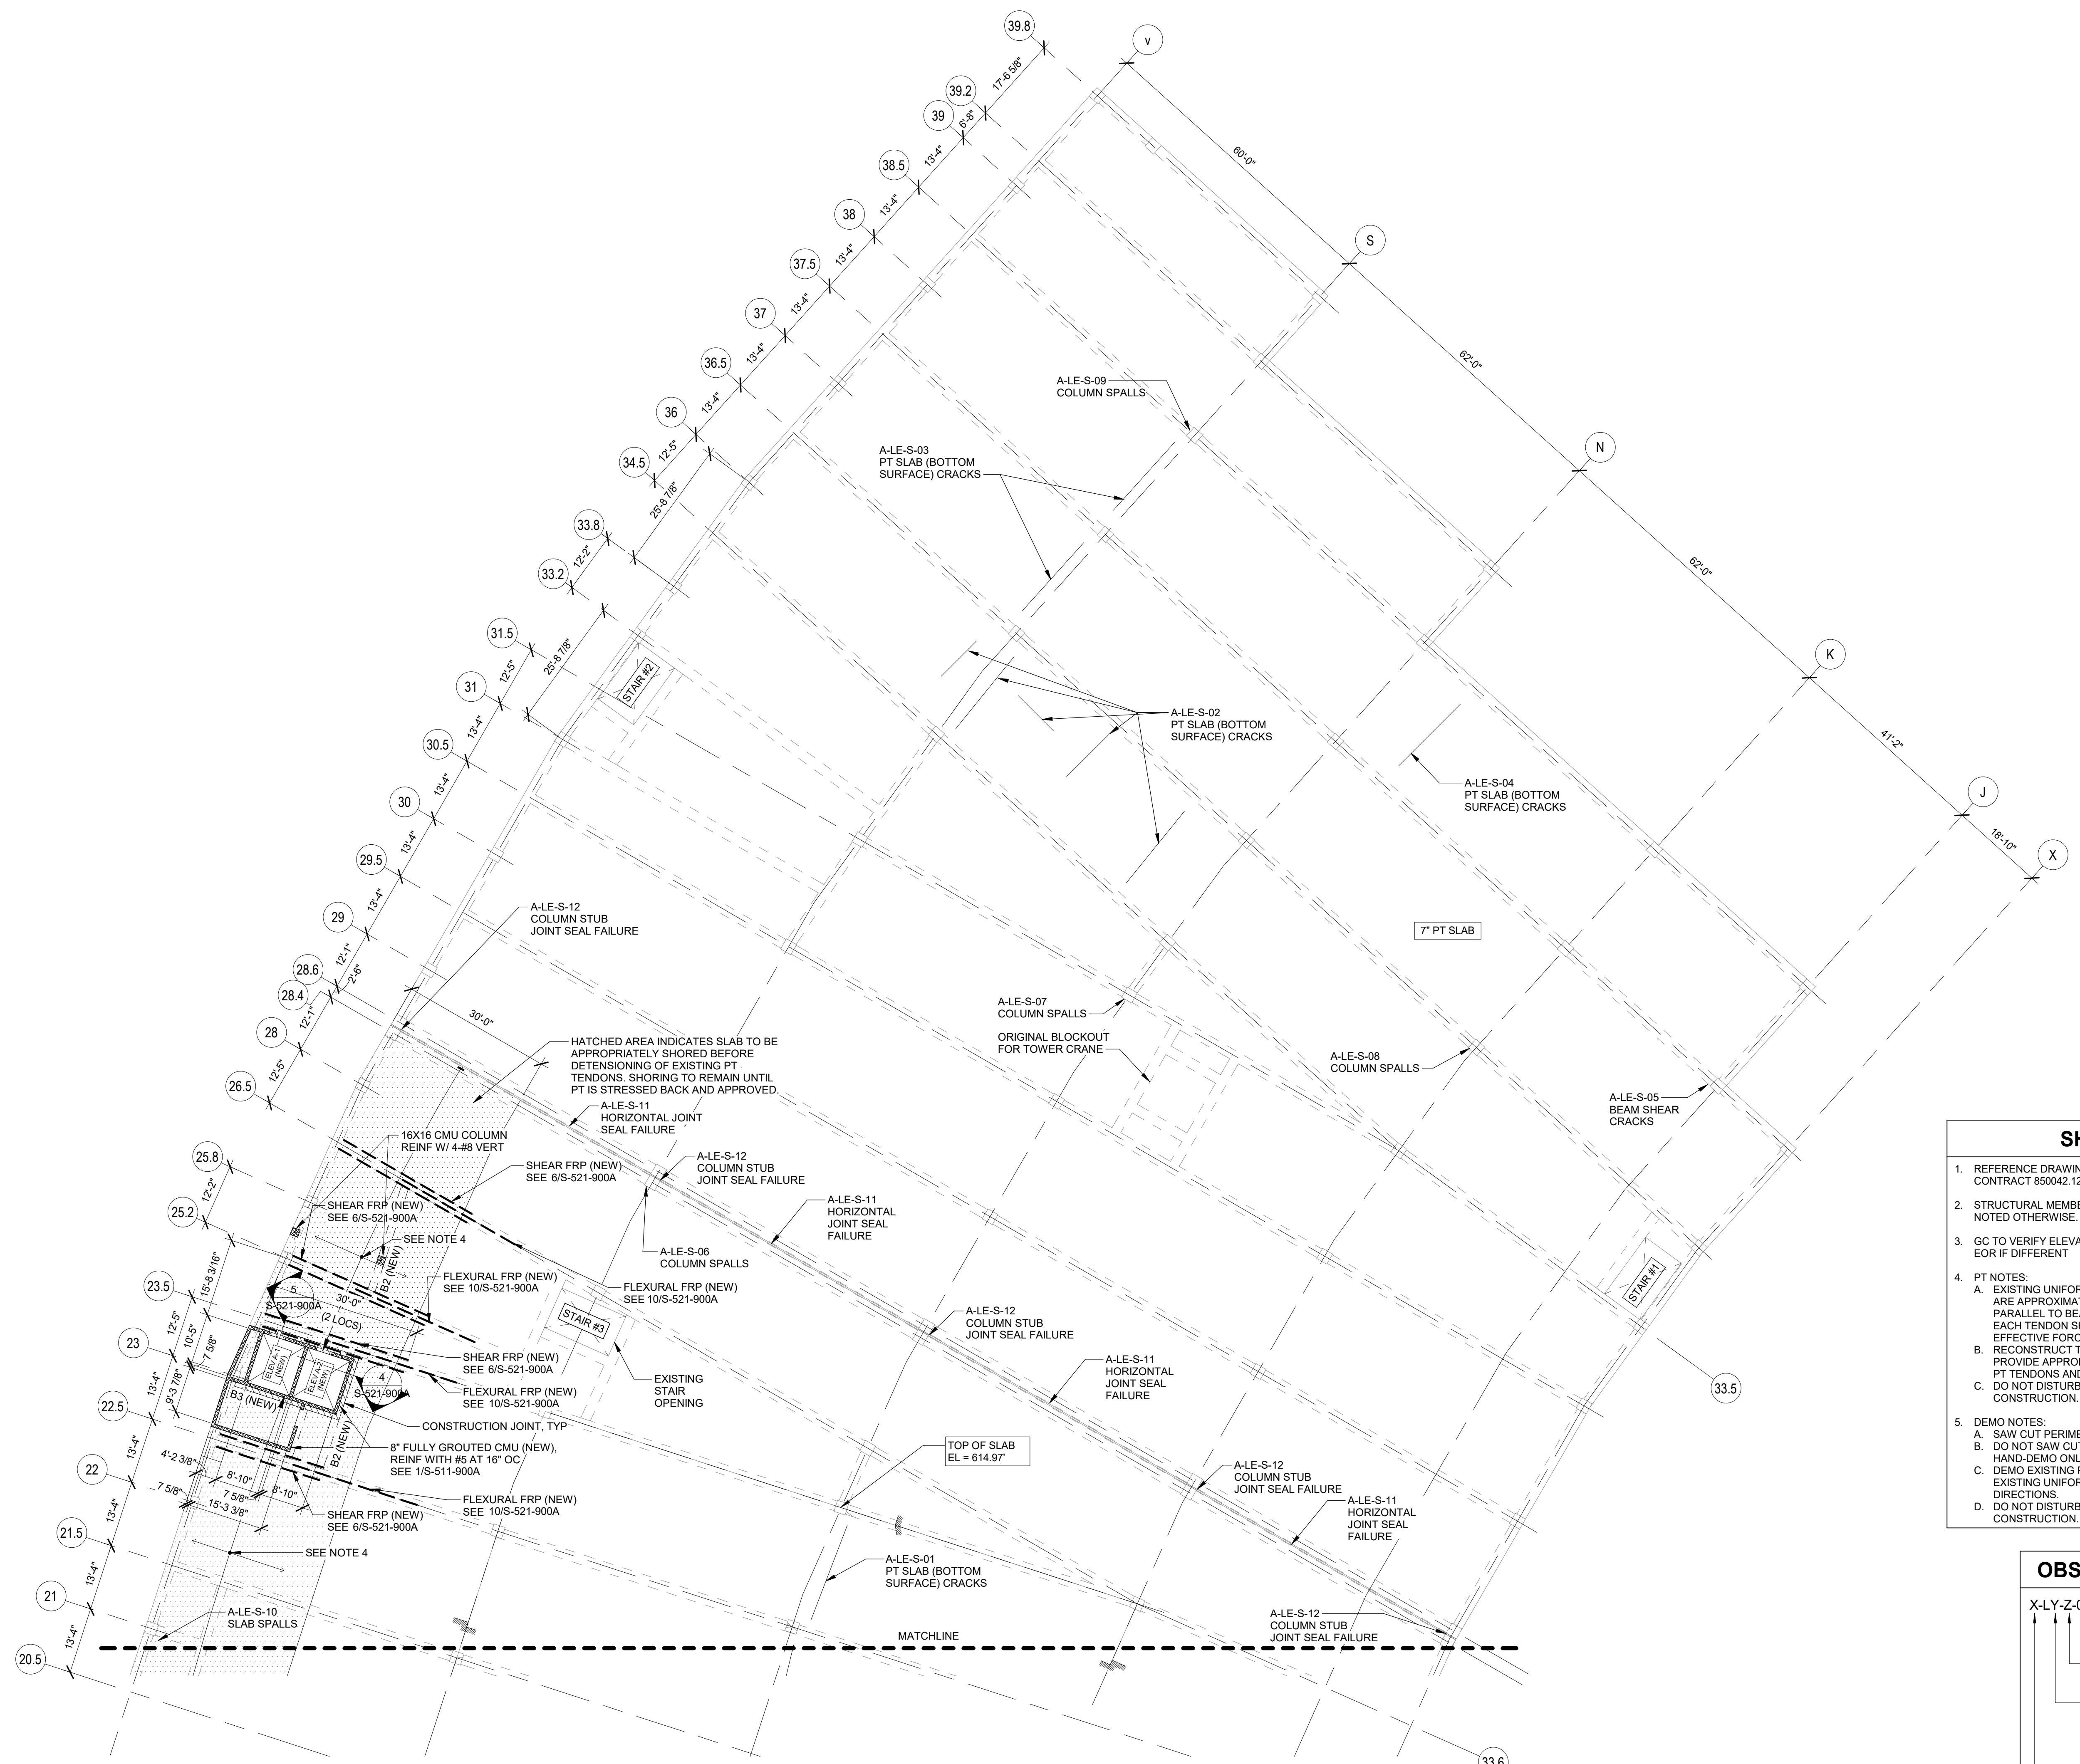


1 GARAGE A LEVEL E FRAMING PLAN - SOUTH
1/16" = 1'-0"

- ### SHEET NOTES
- REFERENCE DRAWING:
CONTRACT 85042.12 INVENTORY 37689
 - STRUCTURAL MEMBERS SHOWN ON PLAN ARE EXISTING, UNLESS NOTED OTHERWISE.
 - GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT
 - PT NOTES:
A. EXISTING UNIFORM TENDONS SPANNING BETWEEN BEAMS ARE APPROXIMATELY 23.7 KLF AND TEMPERATURE TENDONS PARALLEL TO BEAMS ARE SPACED AT 1'-6" MAX. FIELD VERIFY. EACH TENDON SHALL BE STRESSED TO ITS MAXIMUM EFFECTIVE FORCE.
B. RECONSTRUCT THE SLAB TO MATCH EXISTING THICKNESS. PROVIDE APPROPRIATE HARDWARE TO ATTACH TO EXISTING PT TENDONS AND RESTRESS IN BOTH DIRECTIONS.
C. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.
 - DEMO NOTES:
A. SAW CUT PERIMETER AS SHOWN ON PLAN.
B. DO NOT SAW CUT EXISTING REBAR AND PT TENDONS.
C. DEMO EXISTING PT SLAB FOLLOWING THE DETENSIONING OF EXISTING UNIFORM AND TEMPERATURE TENDONS IN BOTH DIRECTIONS.
D. DO NOT DISTURB EXISTING PT BEAMS DURING CONSTRUCTION.

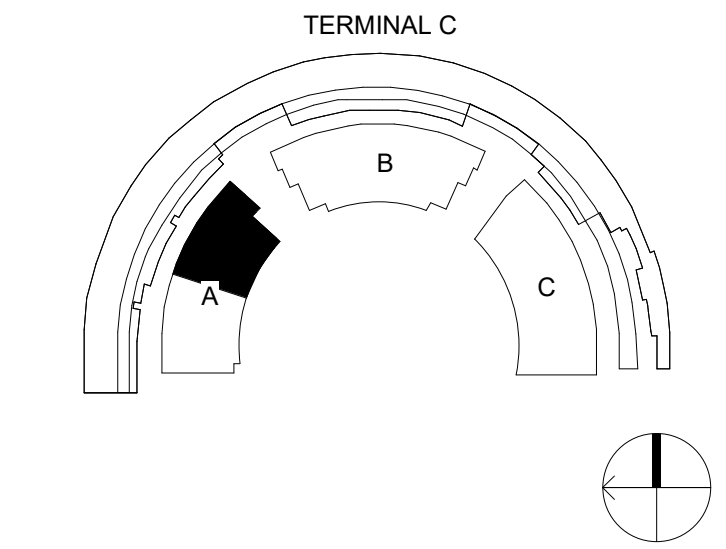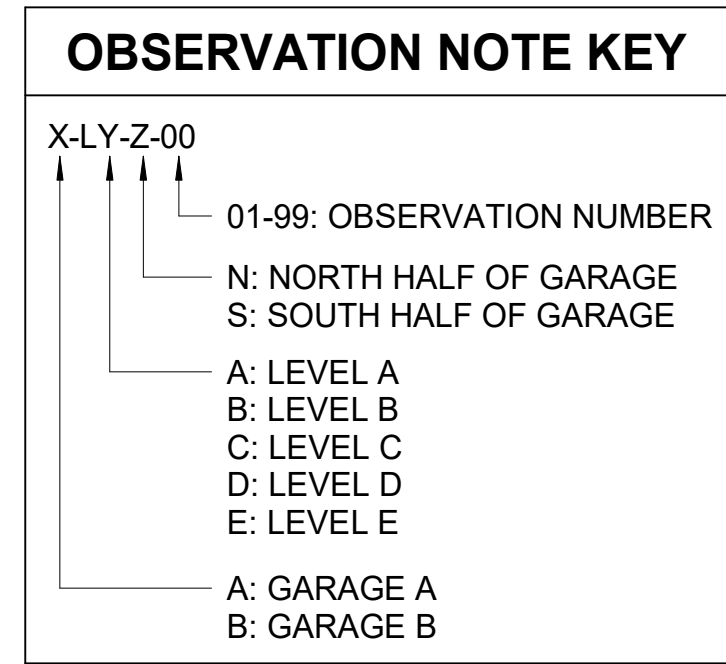

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

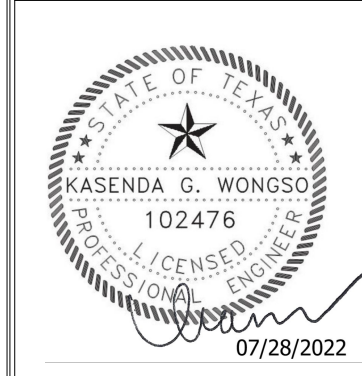

DRAWN BY: ADD/GY
APPROVED BY: KW
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A LEVEL E FRAMING PLAN - SOUTH

SHEET NUMBER
S-110-900A



PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

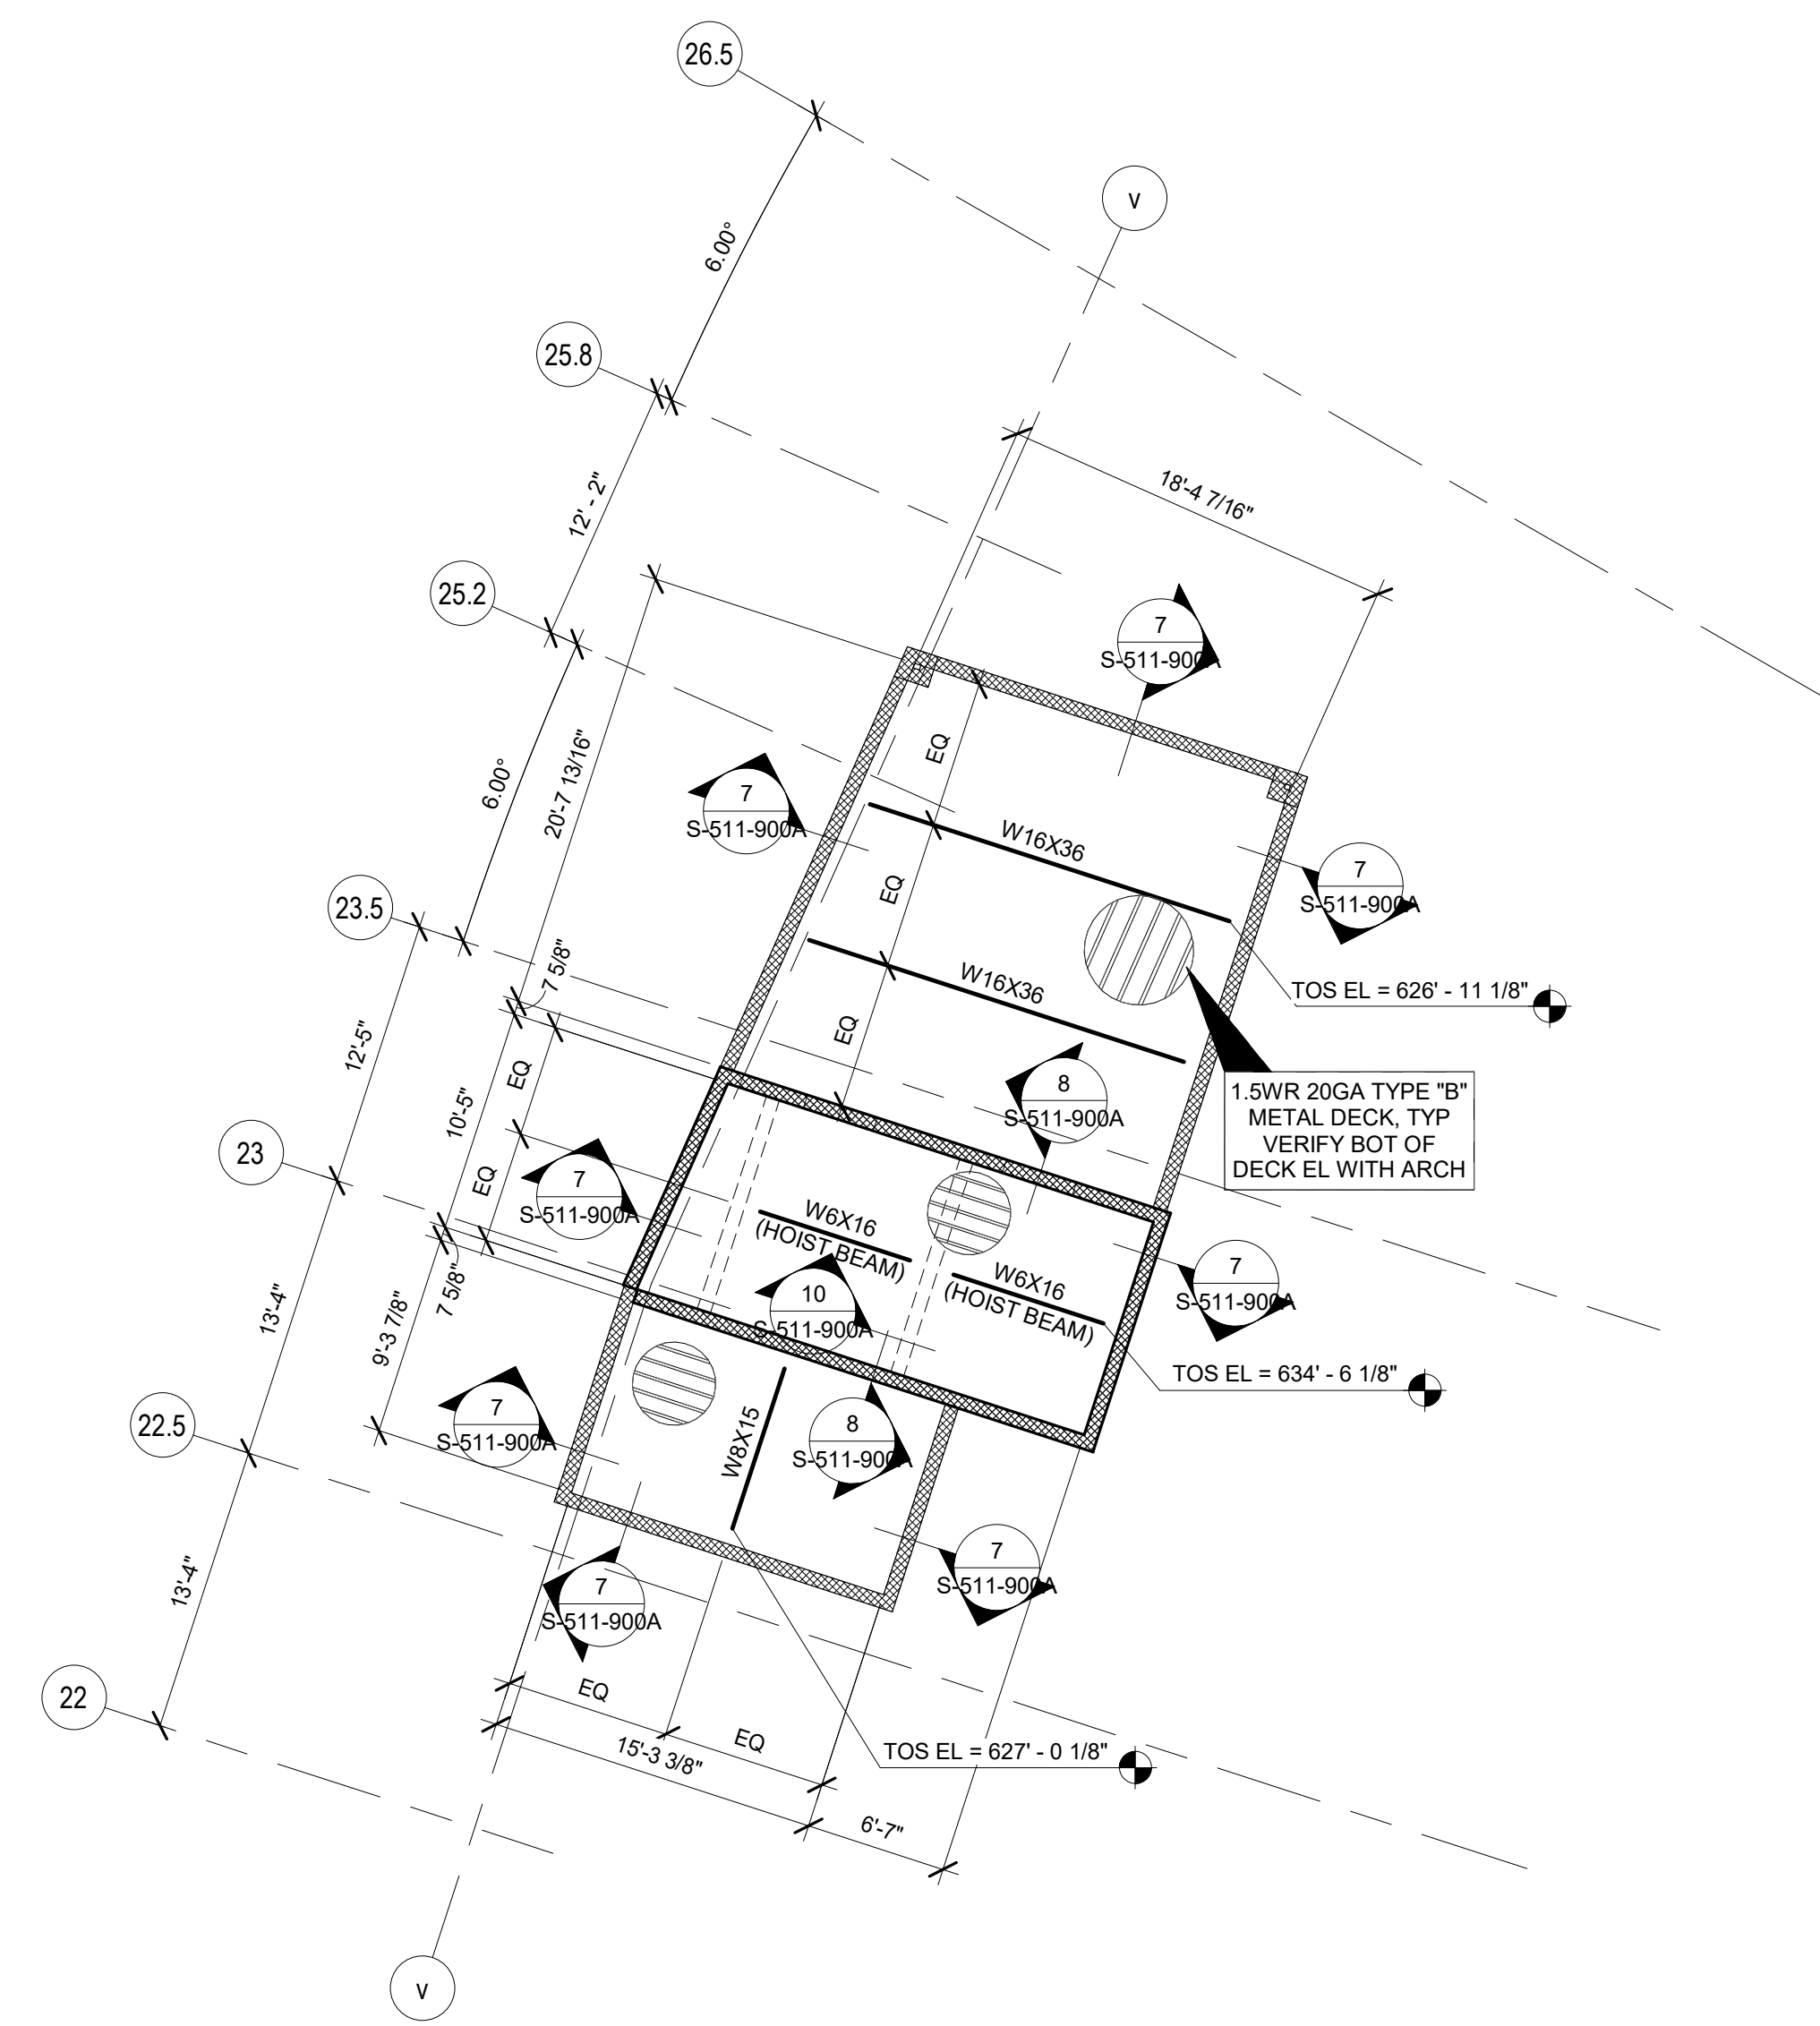


1 GARAGE A CANOPY FRAMING PLAN SOUTH
1/8" = 1'-0"

- SHEET NOTES**
- GC TO VERIFY ELEVATOR SHAFT DIMENSIONS WITH MFR. NOTIFY EOR IF DIFFERENT.
 - REF ARCH FOR TOP OF CMU WALL ELEVATIONS.
 - COORDINATE HOIST BEAM TOS EL WITH GC. MAXIMUM HOIST LOAD = 5,000 LBS. NOTIFY EOR IF DIFFERENT.
 - SERVICE WIND UPLIFT LOAD = 25 PSF

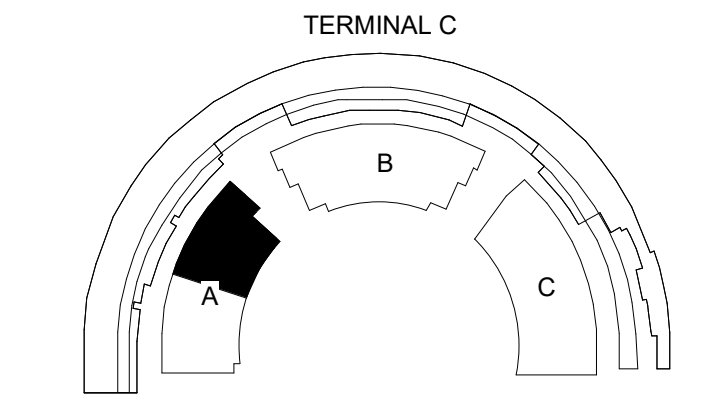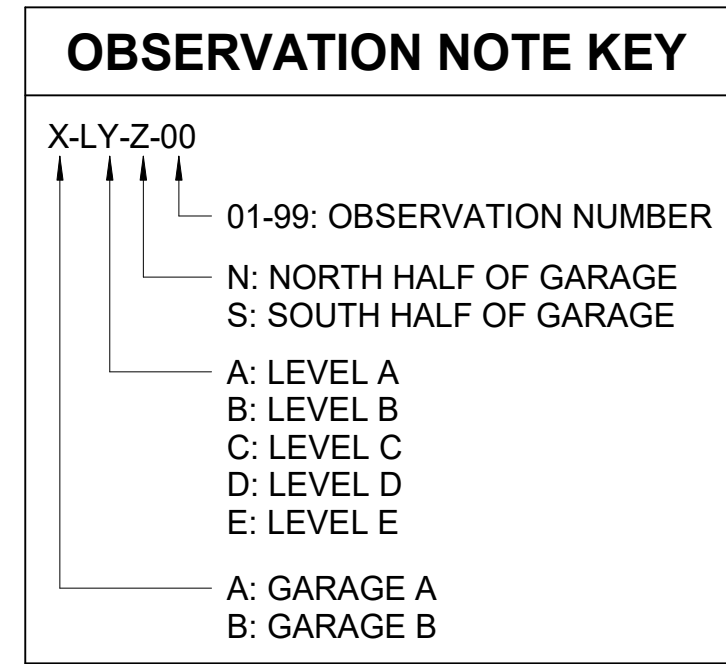

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

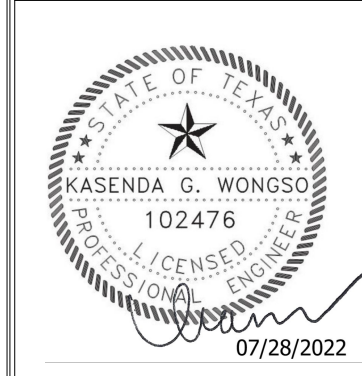

PROJECT # 21084.00000
 15200 Addison Road, Suite 310
 Addison, Texas 75001
 Ph: 214 503 7802
 www.agen-us.com
 TX REG. NO. F-8439
 1-214-722-6000

DRAWN BY: ADD/GY
 APPROVED BY: KW
 ISSUE DATE: 2022-07-28


**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A CANOPY FRAMING PLAN SOUTH
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
S-111-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

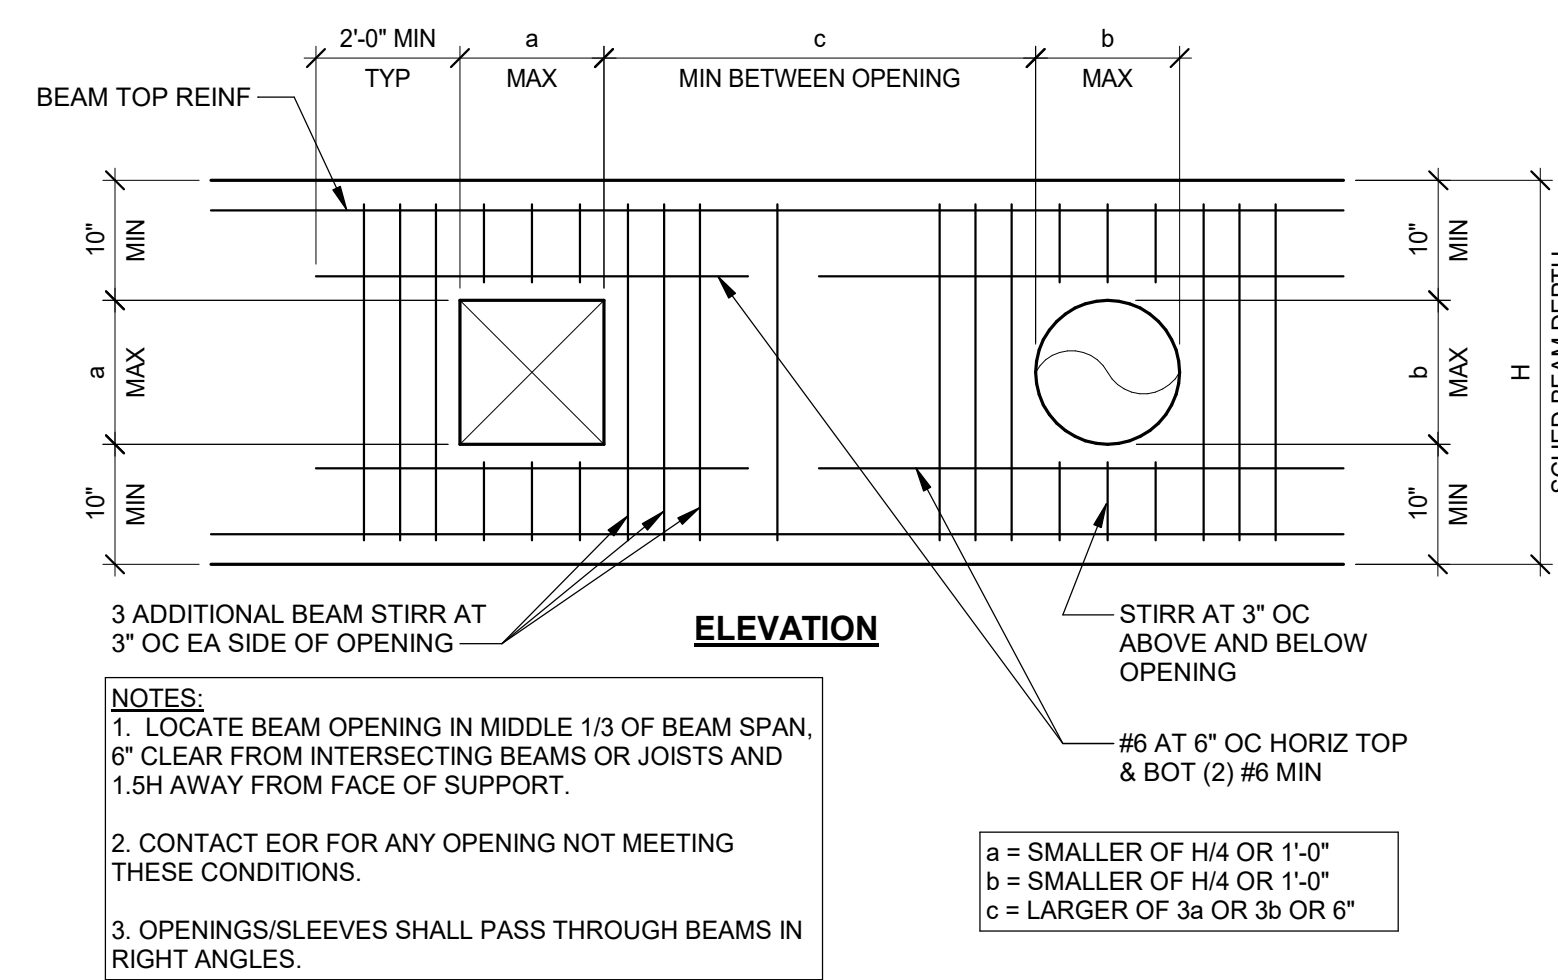


4 TYPICAL HORIZONTAL OPENING IN BEAM
3/4" = 1'-0"

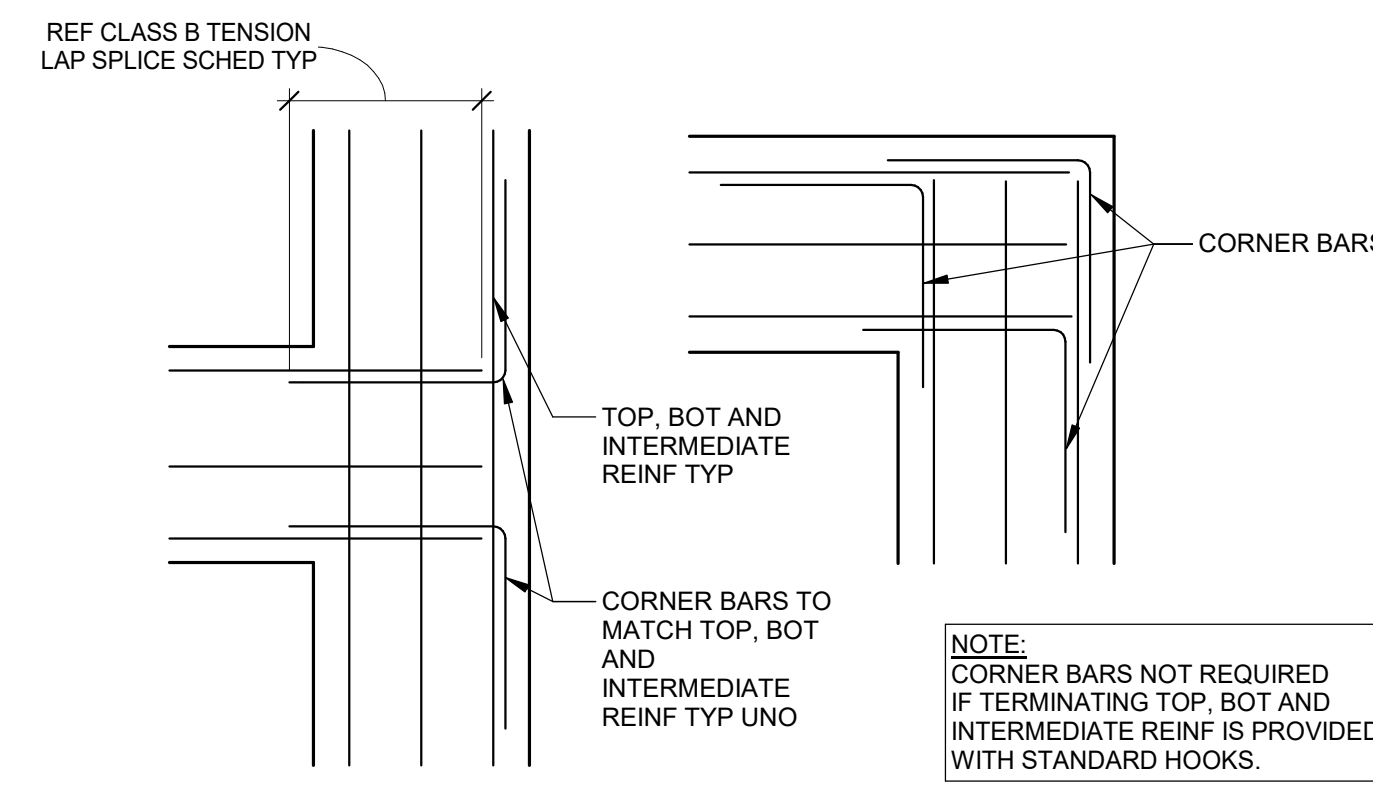


6 TYPICAL CORNER BAR REINFORCING
3/4" = 1'-0"

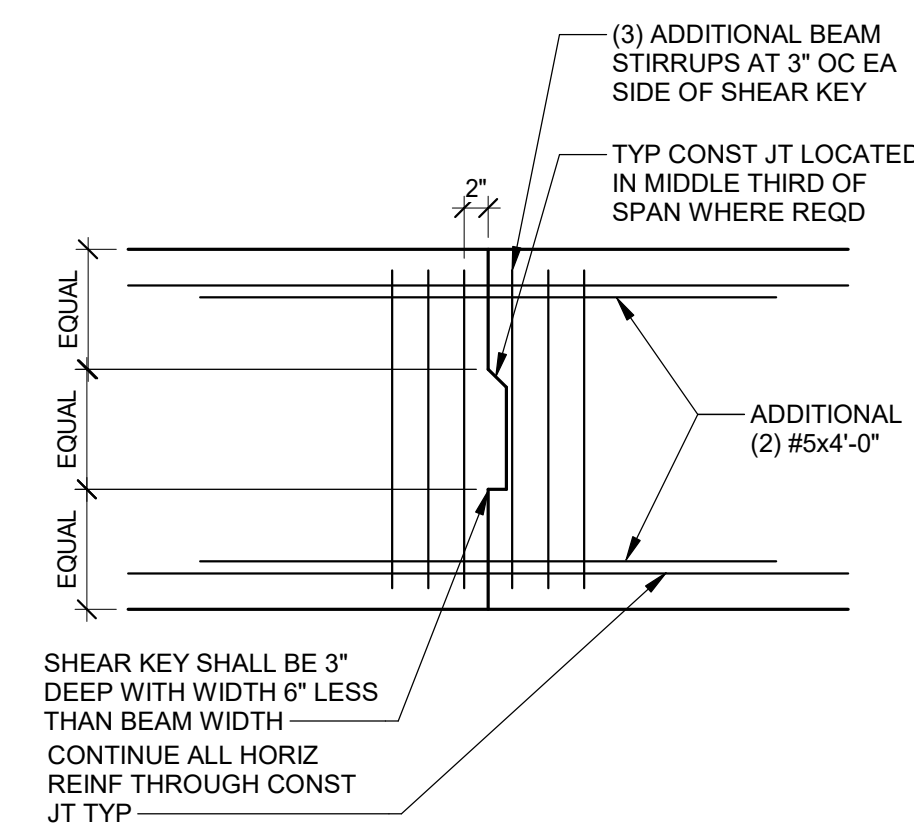



3 TYPICAL BEAM CONST JT
3/4" = 1'-0"

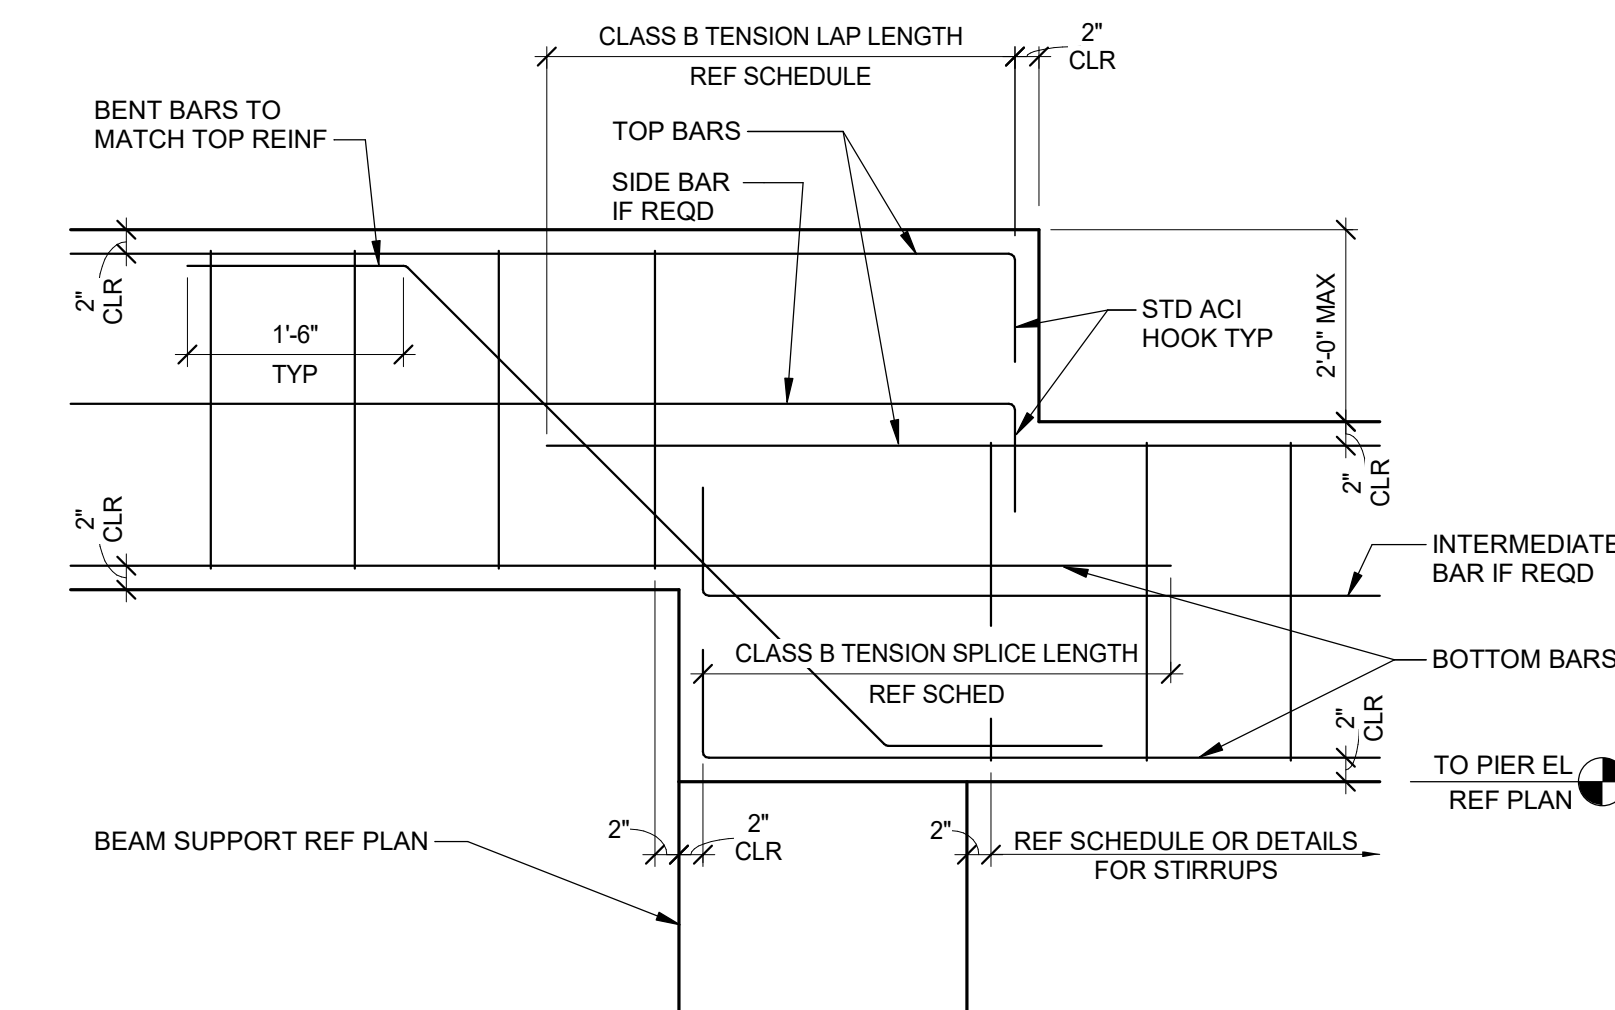


5 TYPICAL BEAM STEP
3/4" = 1'-0"

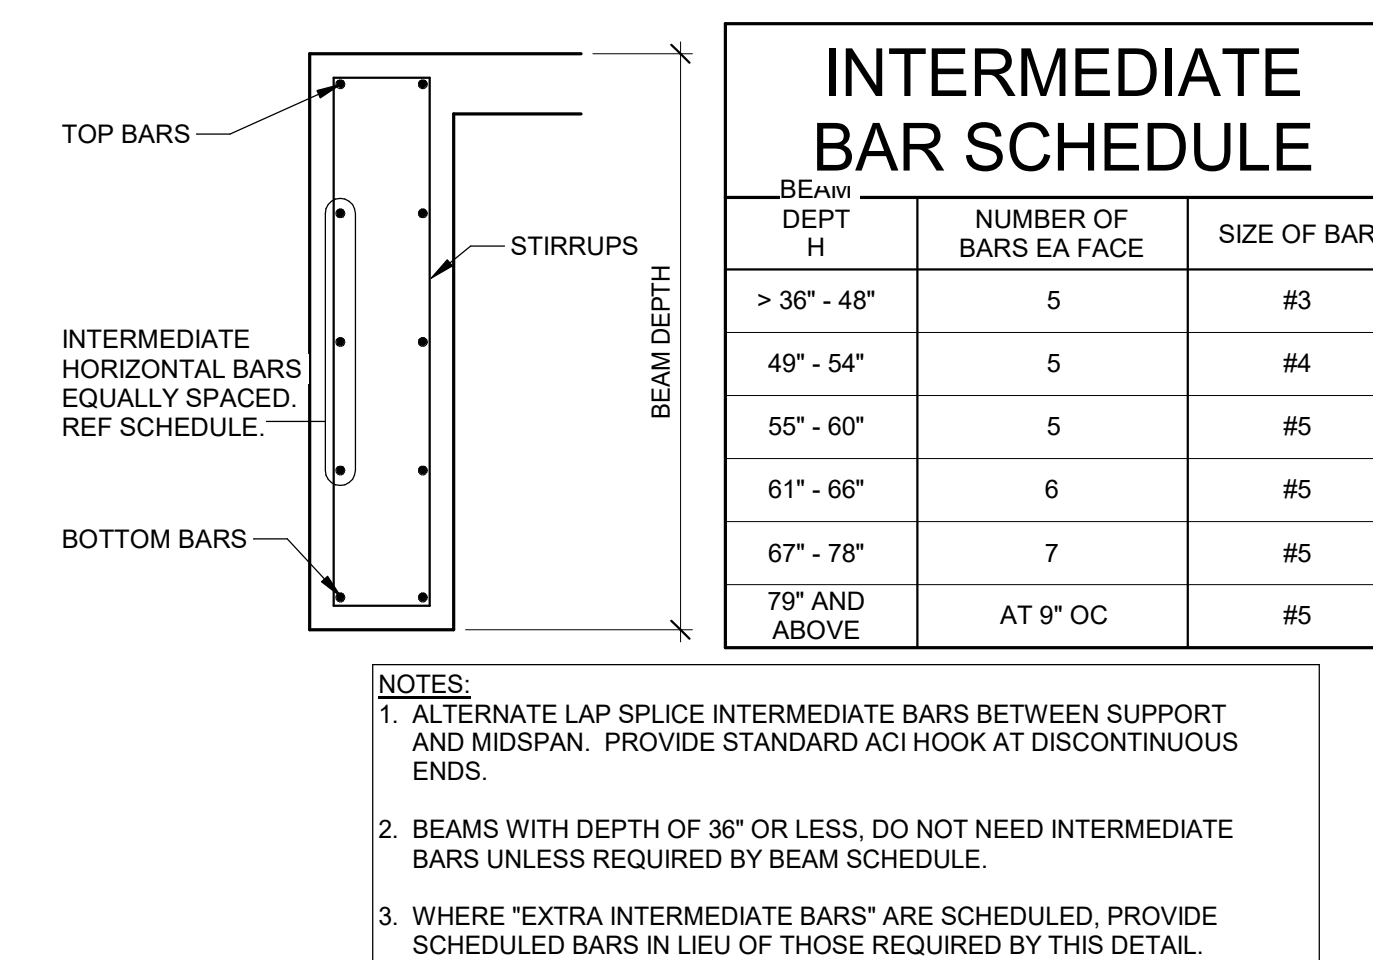


2 TYPICAL INTERMEDIATE BAR SCHEDULE
3/4" = 1'-0"

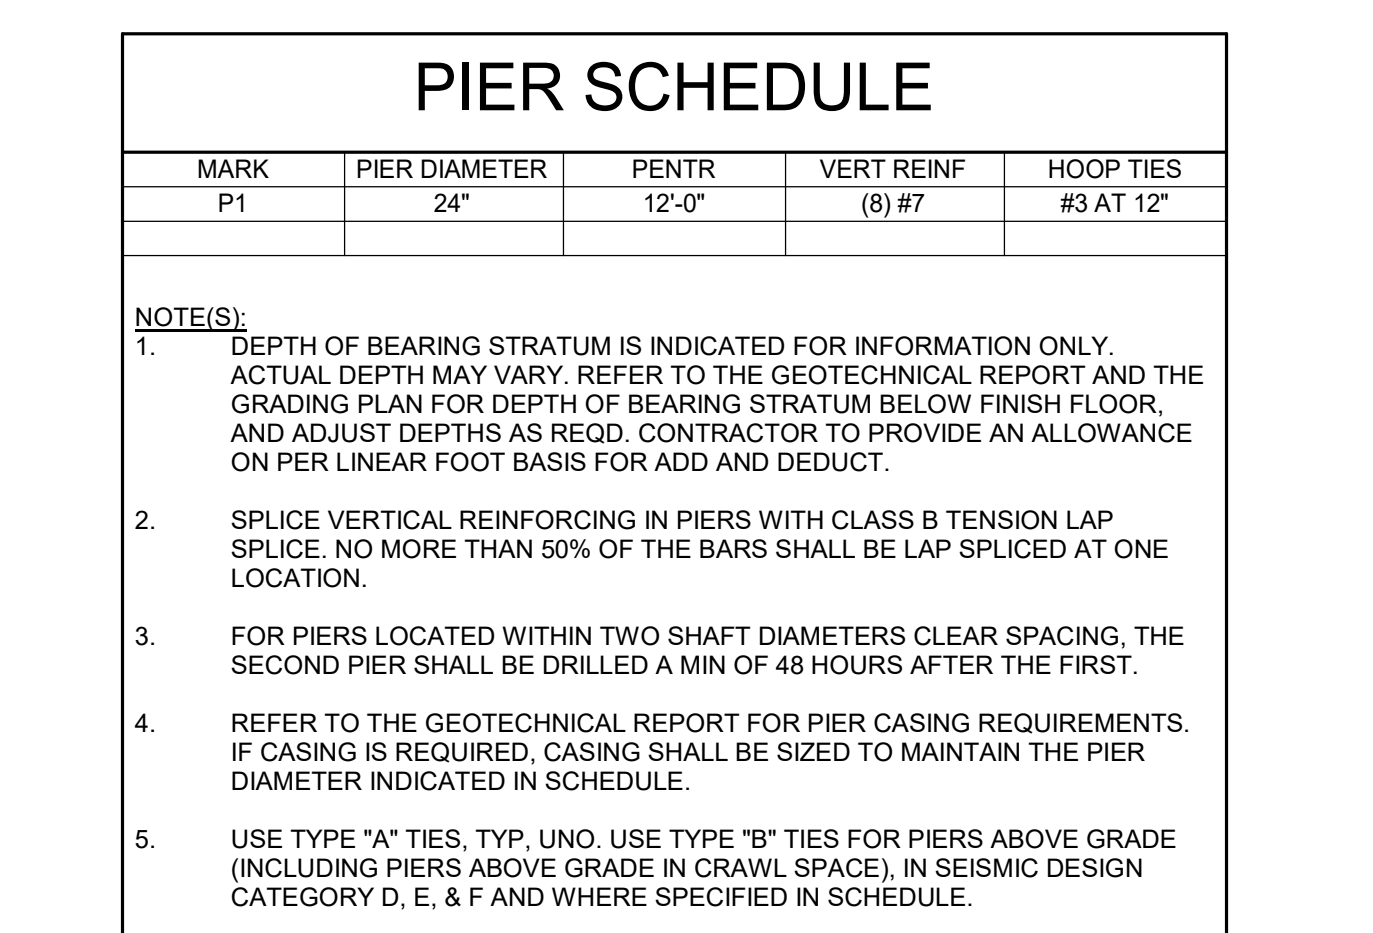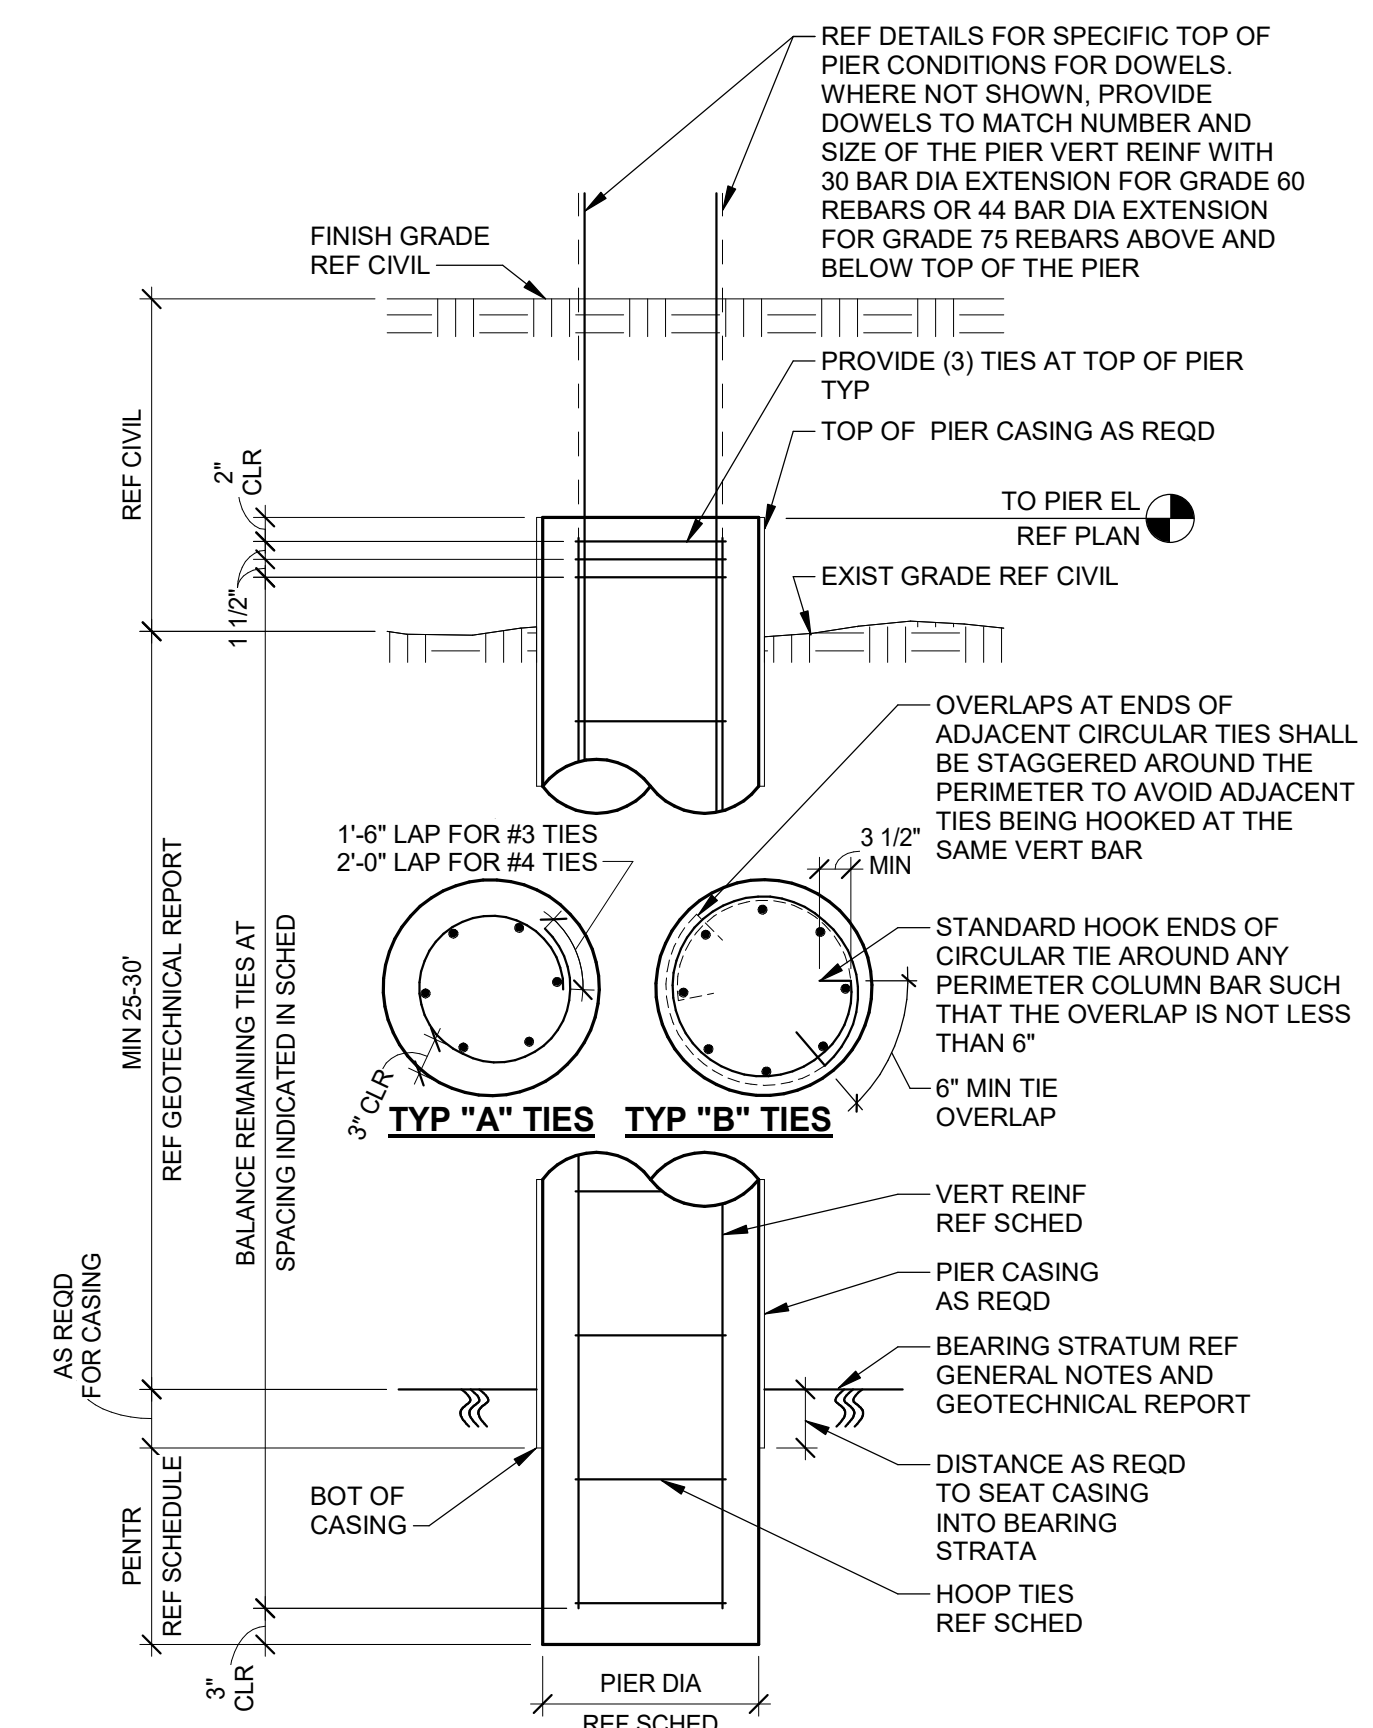


1 TYPICAL PIER REINFORCING DIAGRAM AND SCHEDULE
3/4" = 1'-0"

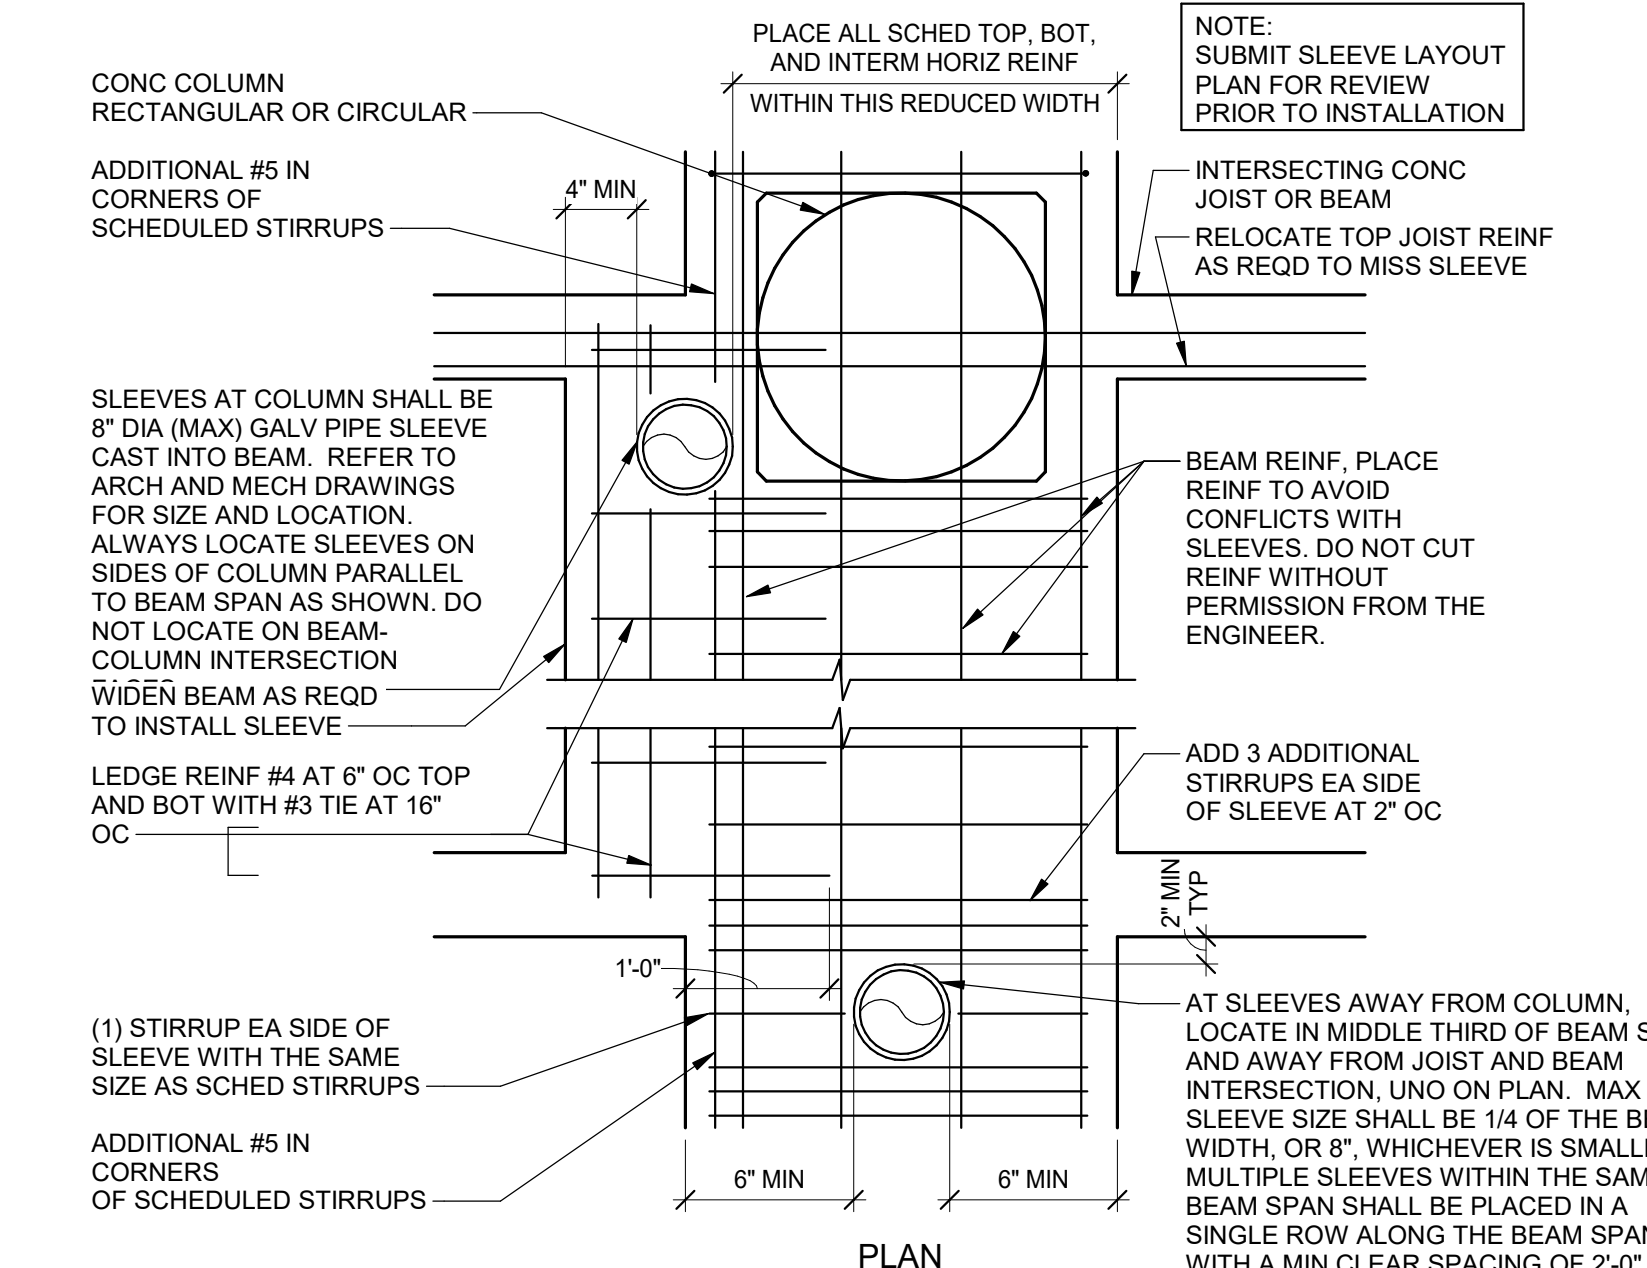


15 TYPICAL VERTICAL SLEEVES IN CONCRETE BEAMS
3/4" = 1'-0"

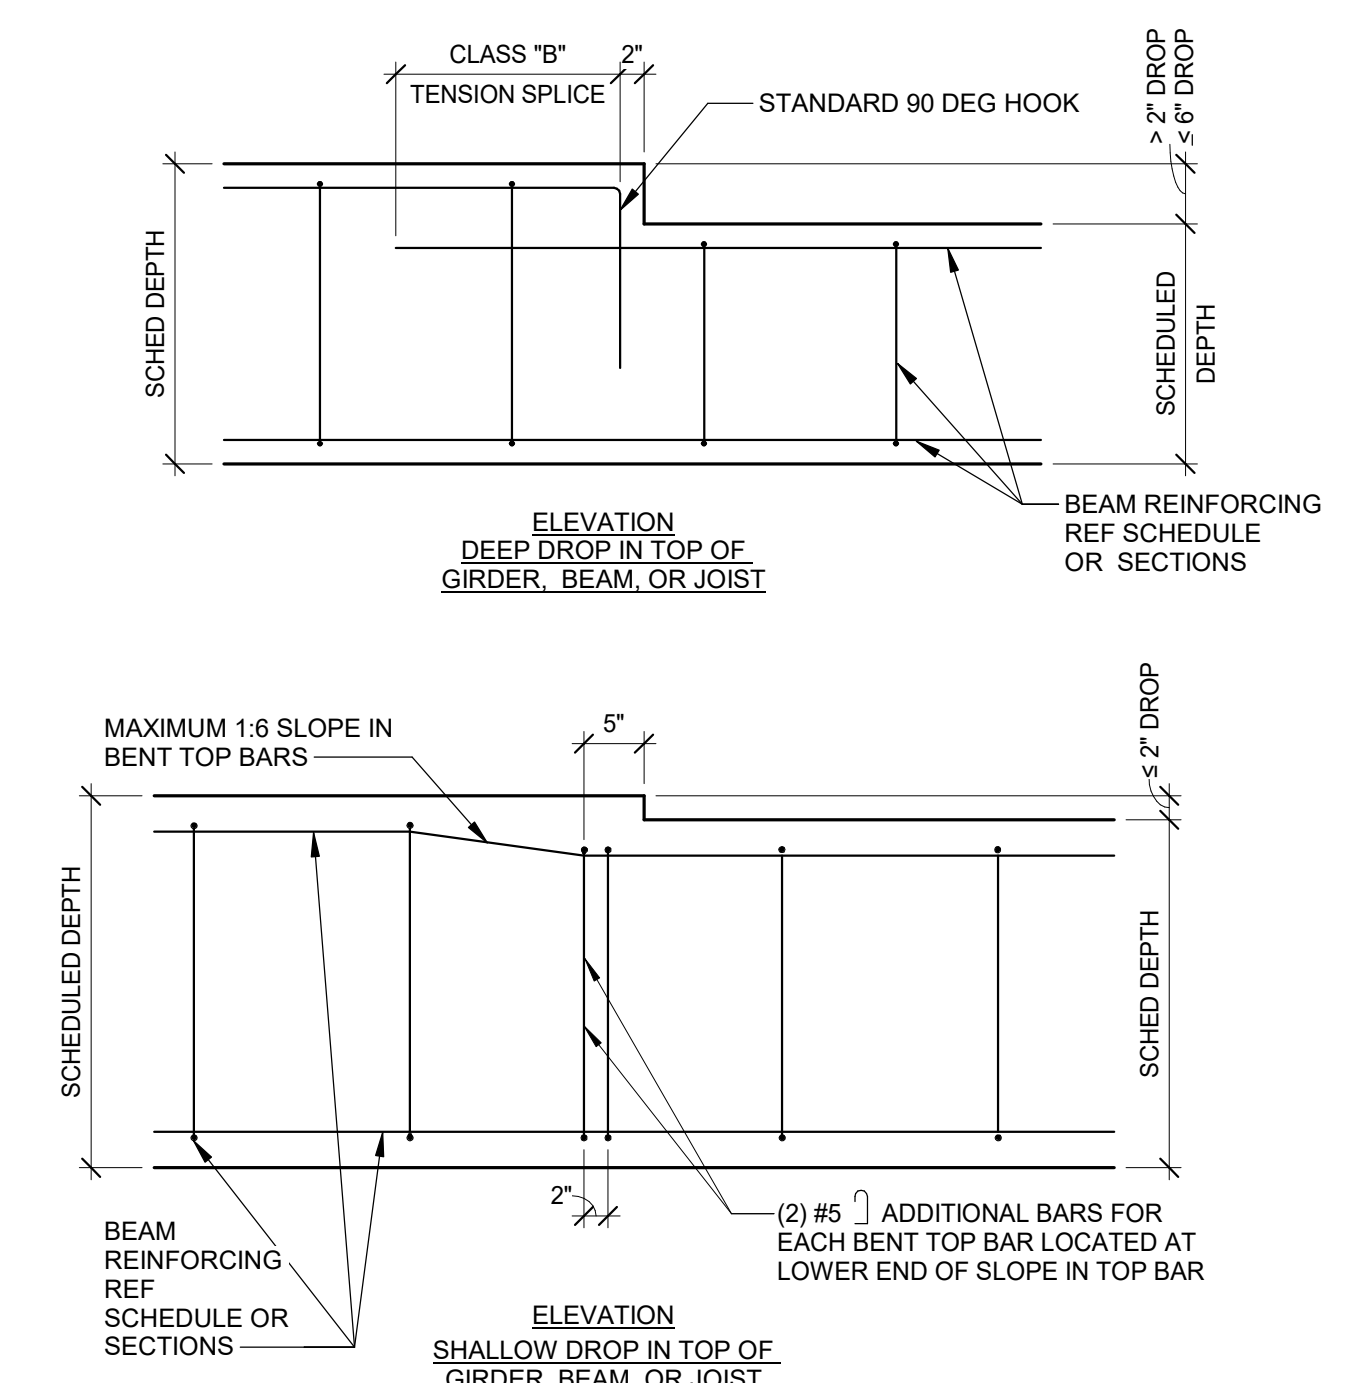


14 TYPICAL DETAIL OF REINFORCING AT SLAB/BEAM STEP
3/4" = 1'-0"

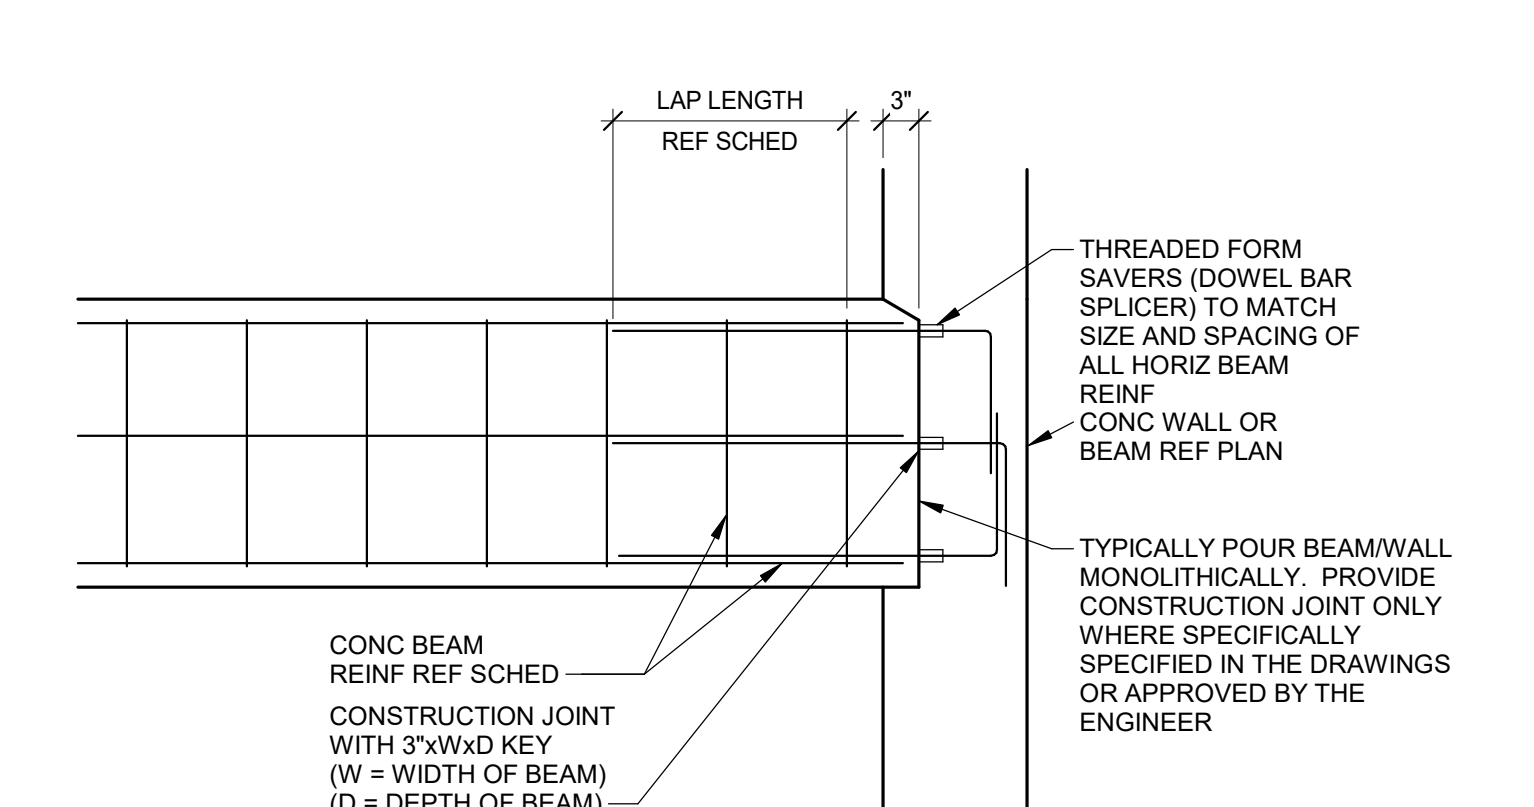


13 CONCRETE BEAM CONNECTION TO WALL OR BEAM
3/4" = 1'-0"

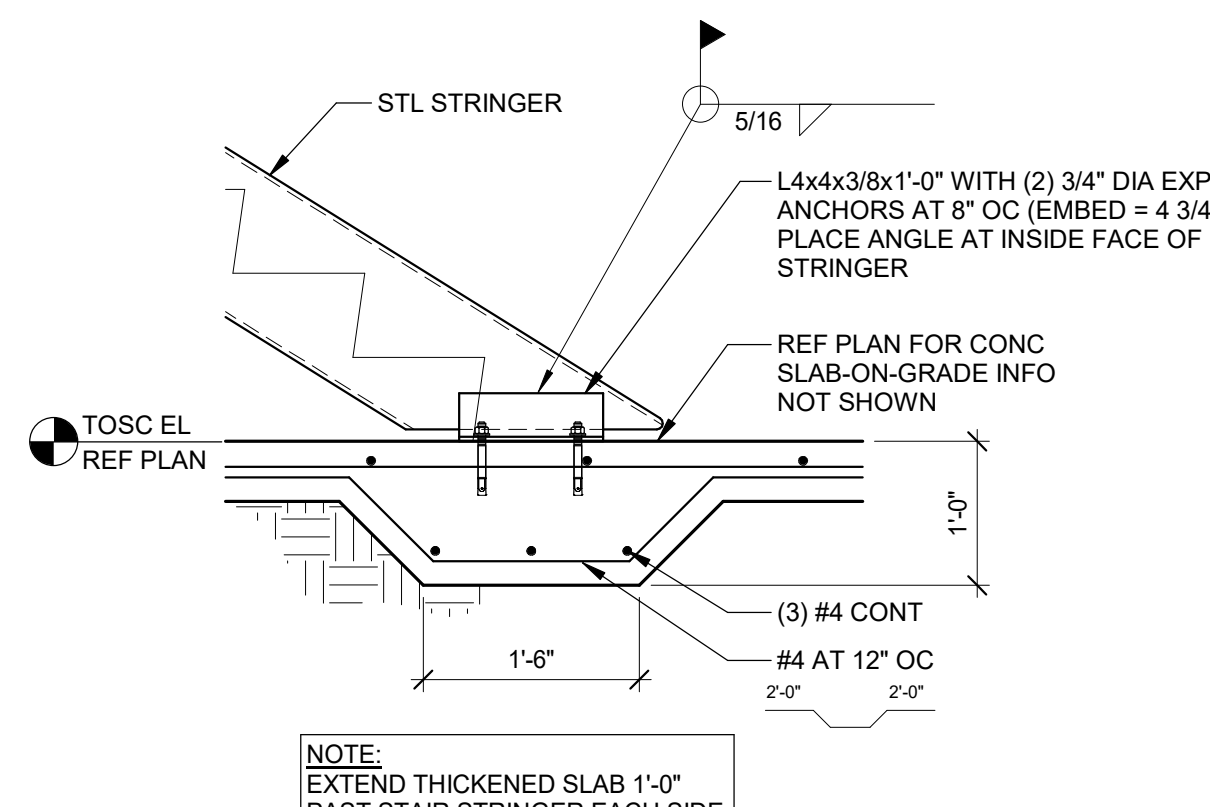


12 TYPICAL MTL STAIR AT SLAB-ON-GRADE
3/4" = 1'-0"

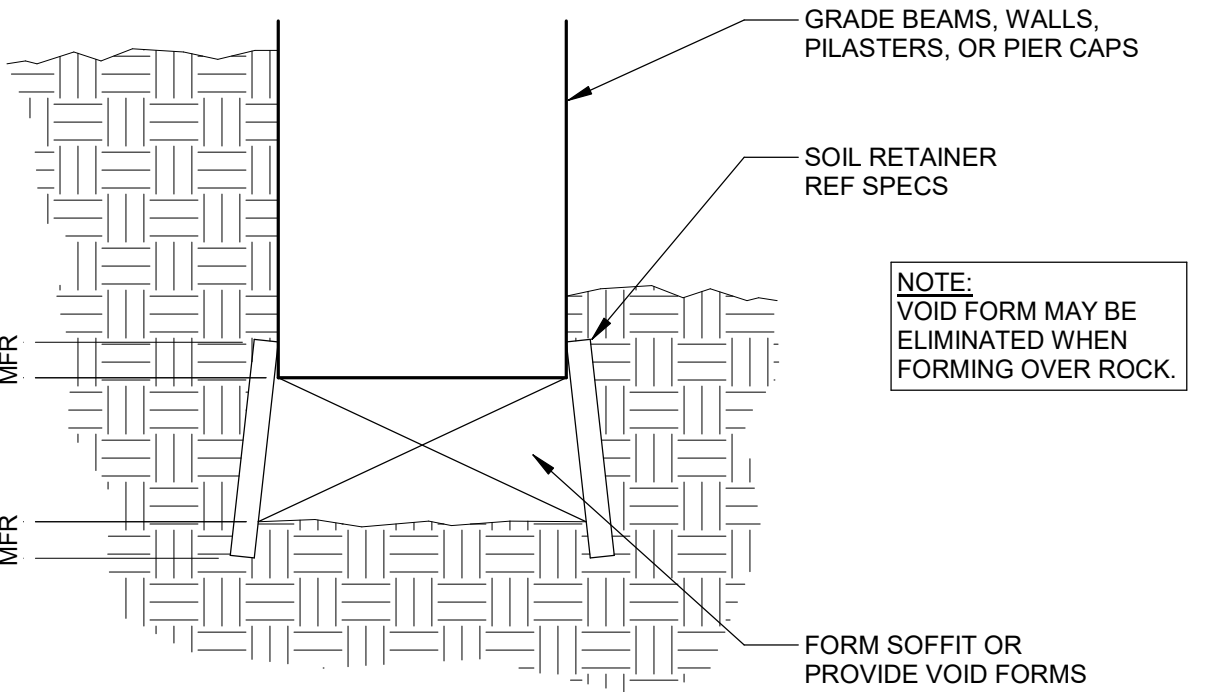


16 TYPICAL GRADE BEAMS/WALLS OVER VOID BOXES
3/4" = 1'-0"

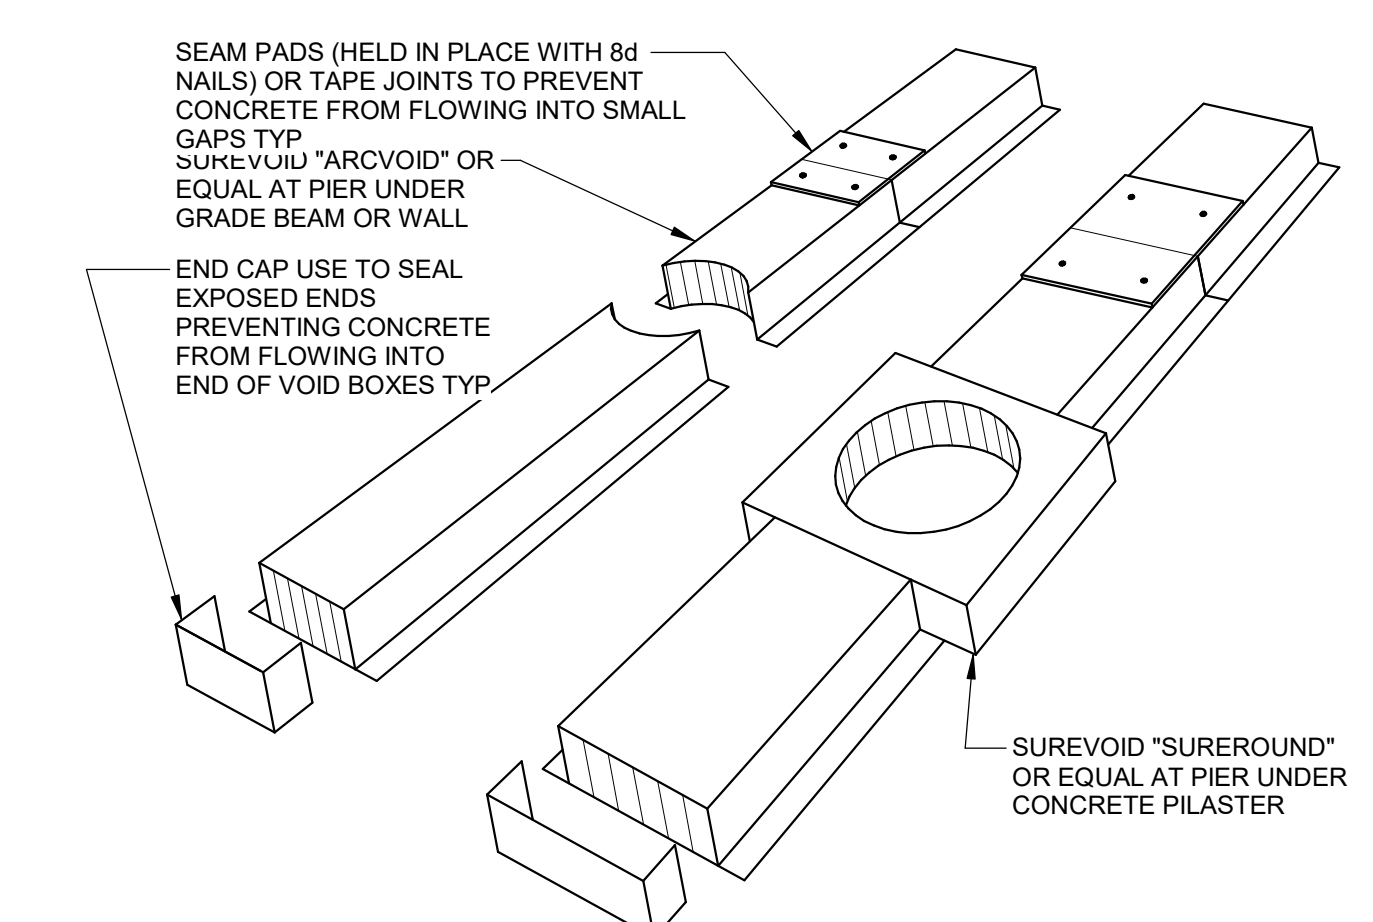


17 TYPICAL VOID FORMS AT PIERS
3/4" = 1'-0"

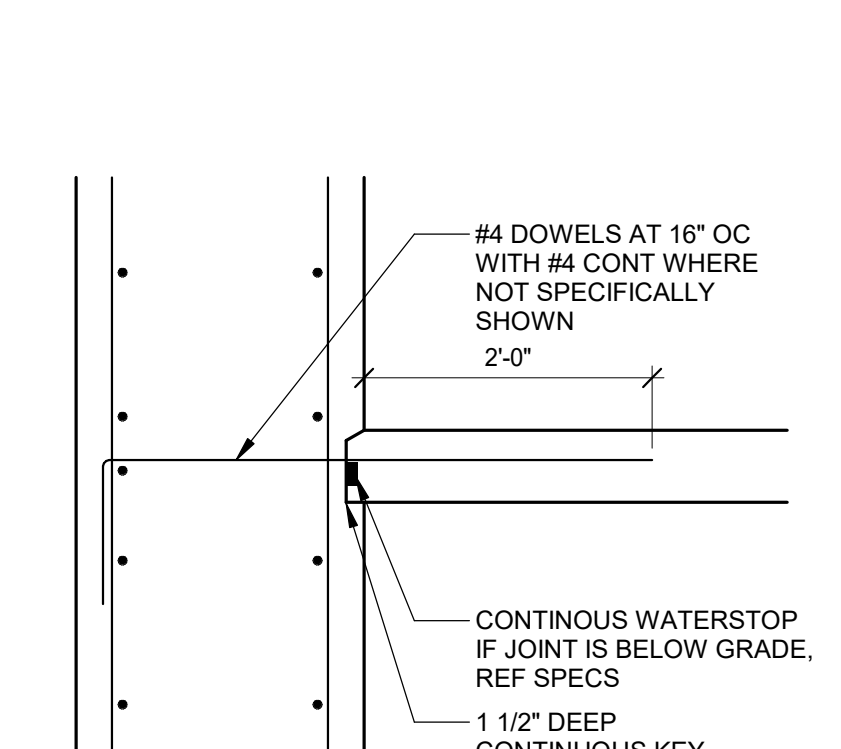


11 TYPICAL SLAB SHEAR KEY TO BEAM OR WALL
3/4" = 1'-0"

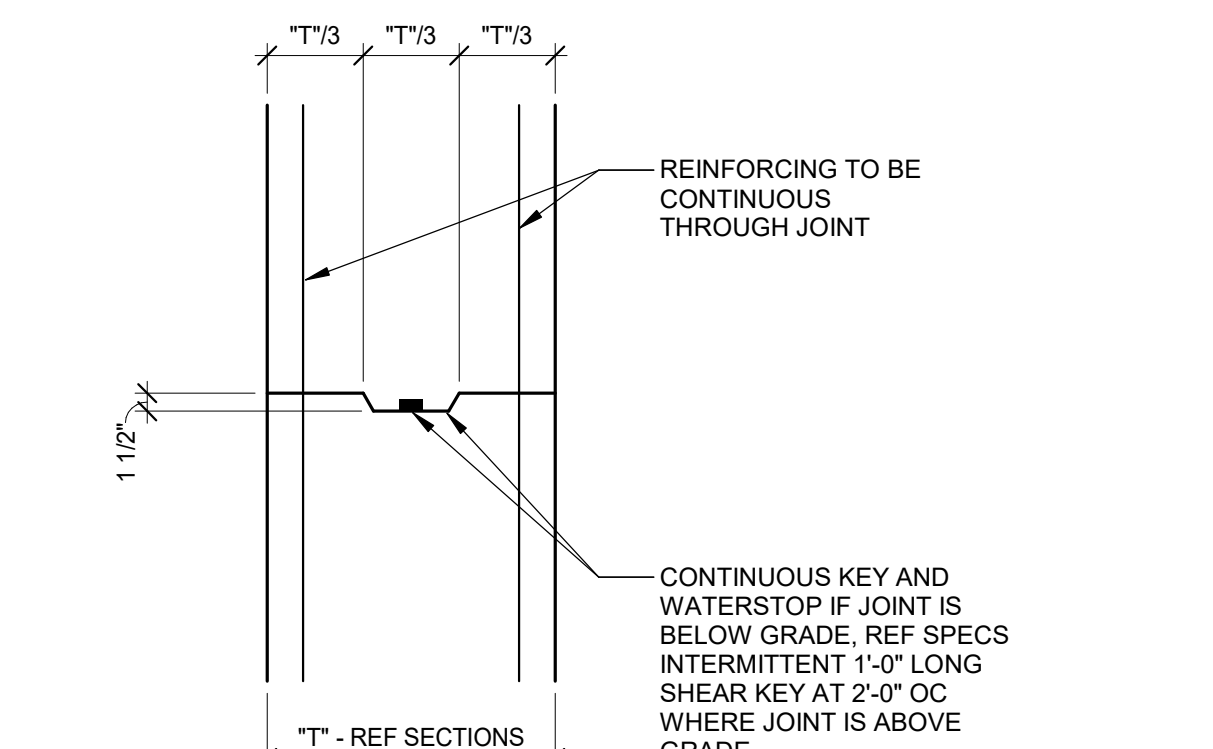


10 TYPICAL HORIZONTAL CONSTRUCTION JOINT IN WALL OR BEAM
3/4" = 1'-0"

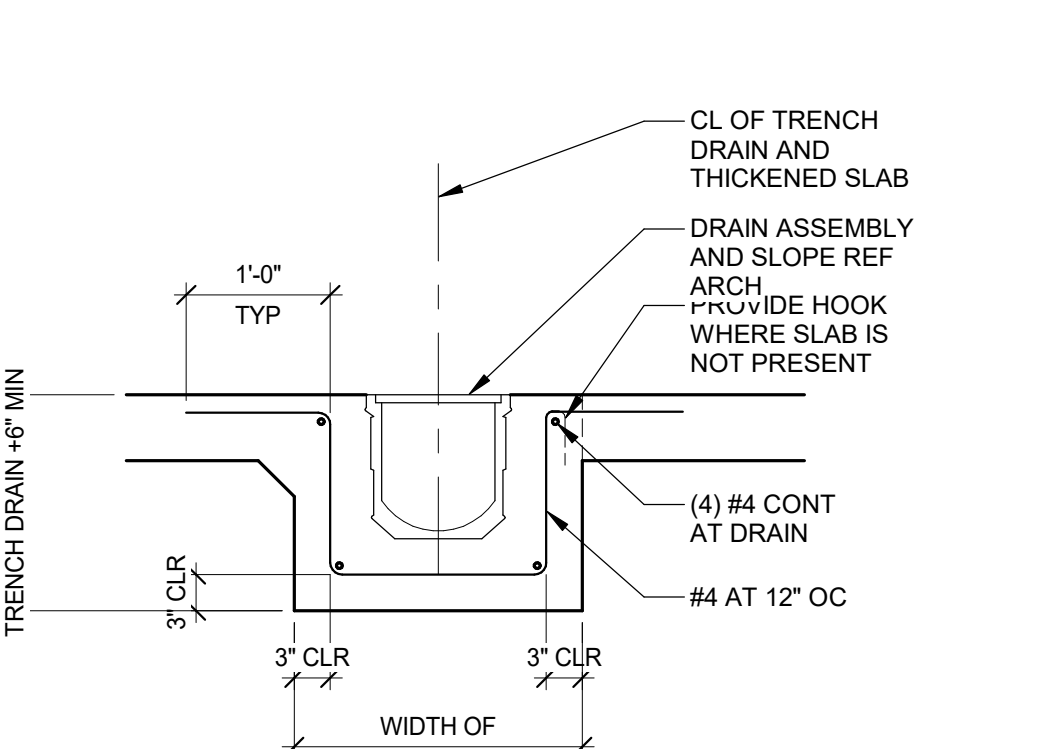


9 TYPICAL TRENCH DRAIN AT SLAB-ON-GRADE
3/4" = 1'-0"

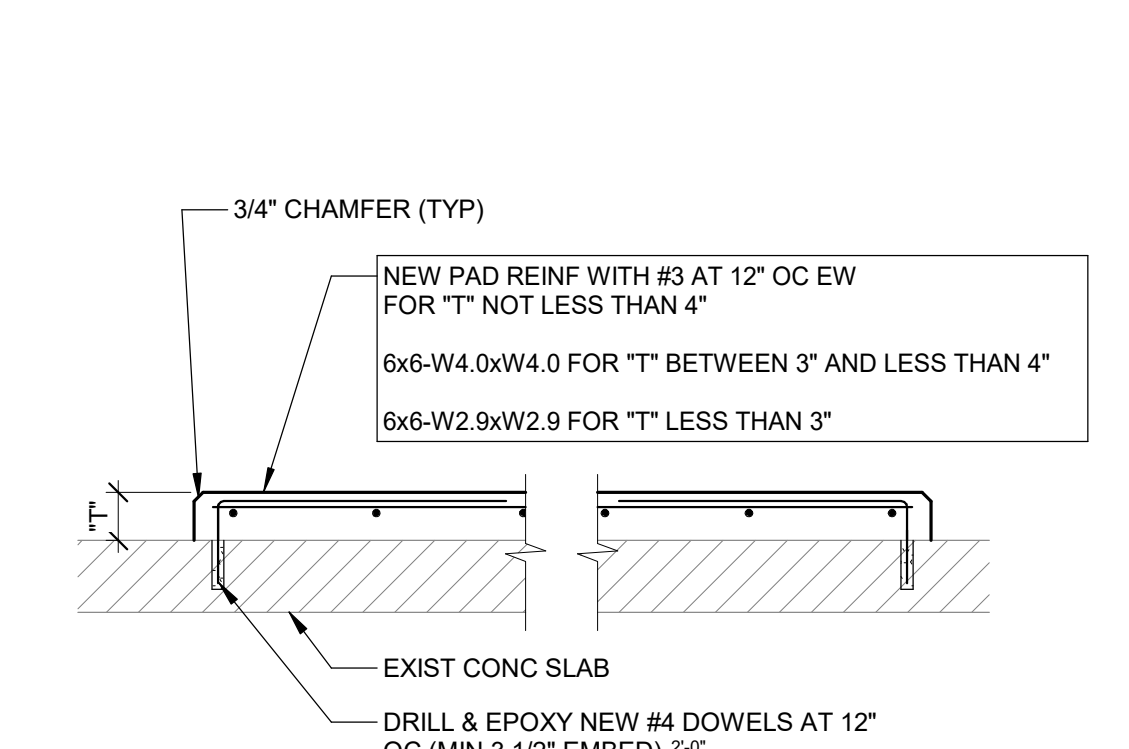


8 TYPICAL HOUSEKEEPING PAD OR TOPPING SLAB
3/4" = 1'-0"

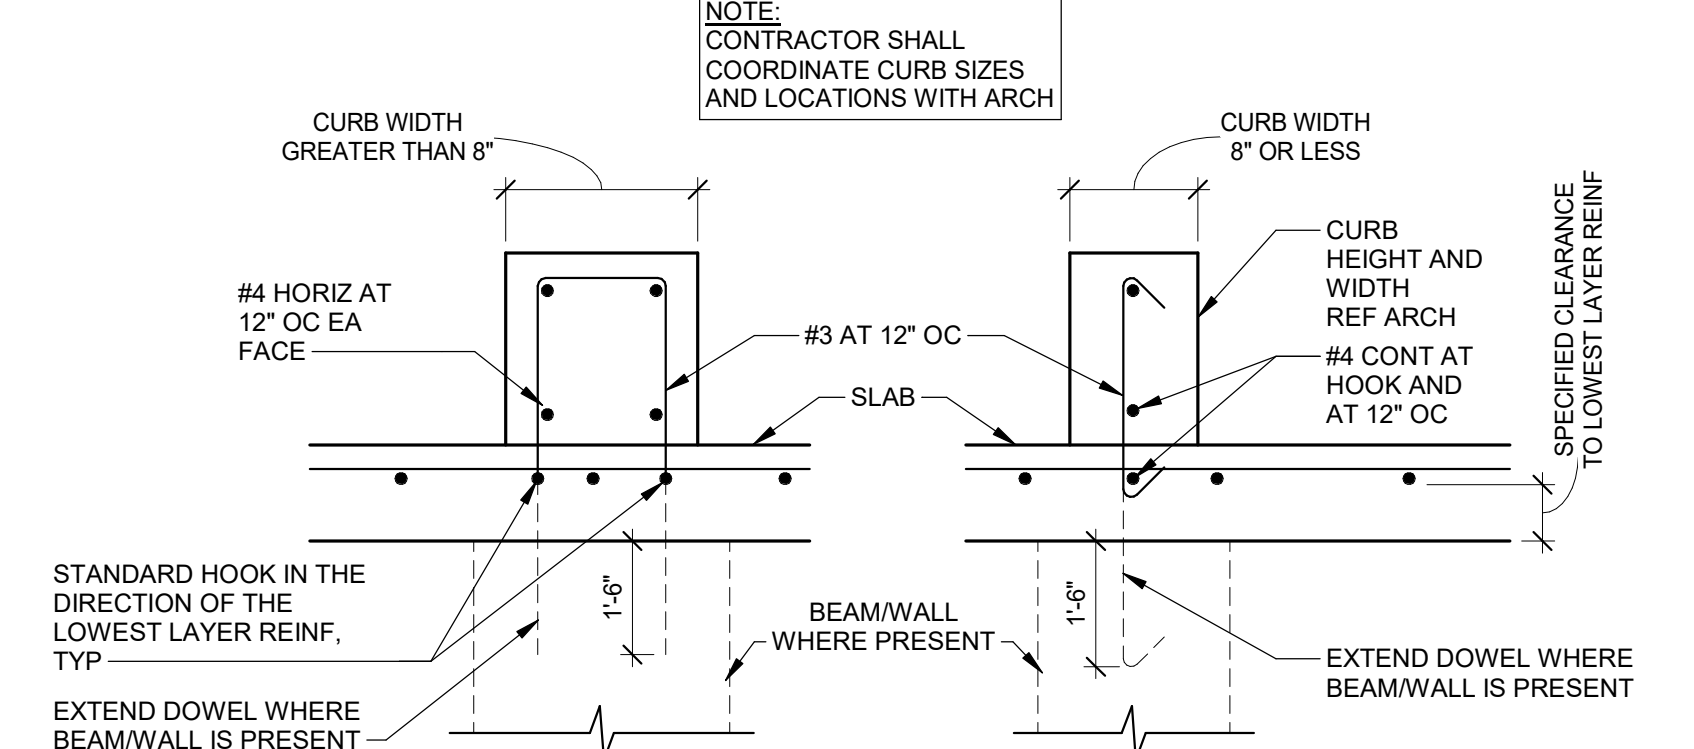


7 TYPICAL CONCRETE CURB
1" = 1'-0"

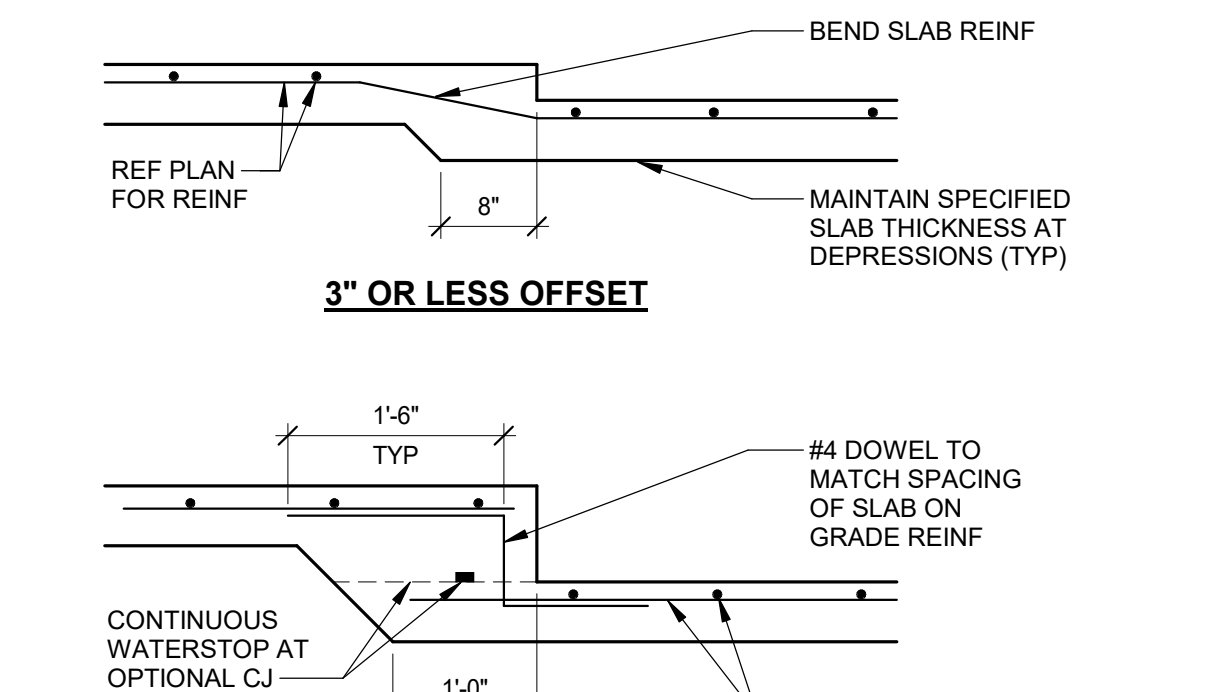


18 3" TO 18" OFFSET
3/4" = 1'-0"

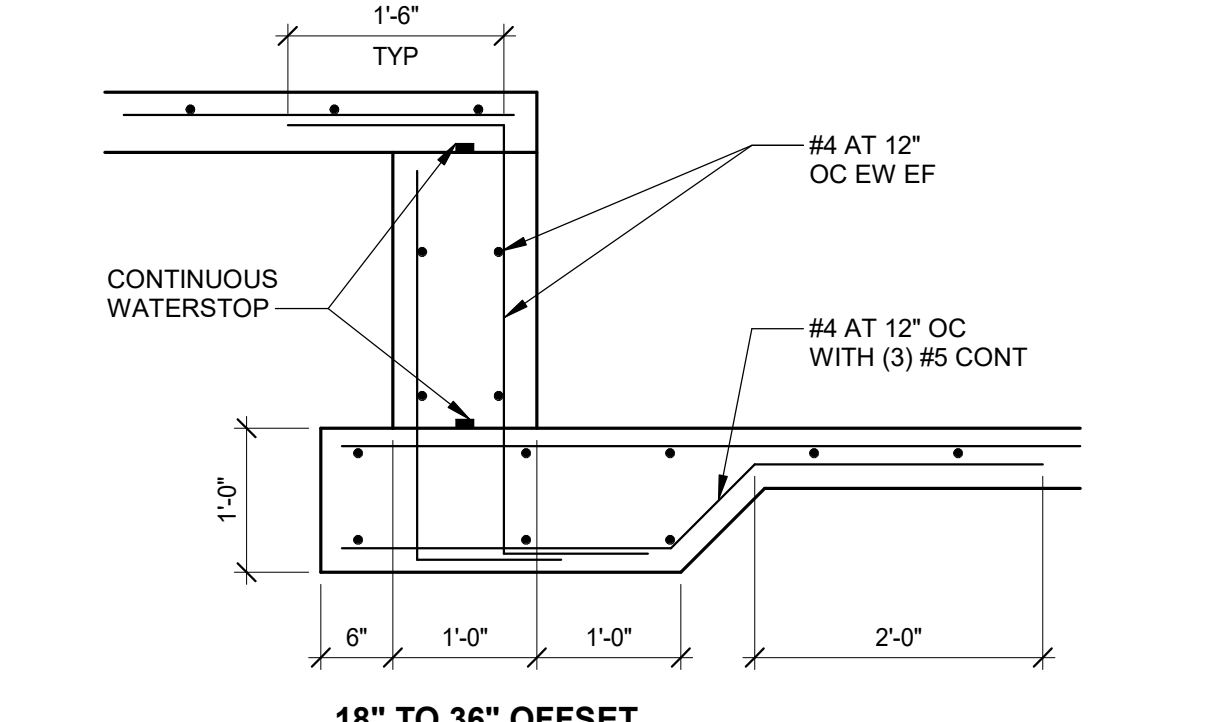


6 TYPICAL OFFSETS IN SLAB-ON-GRADE
3/4" = 1'-0"

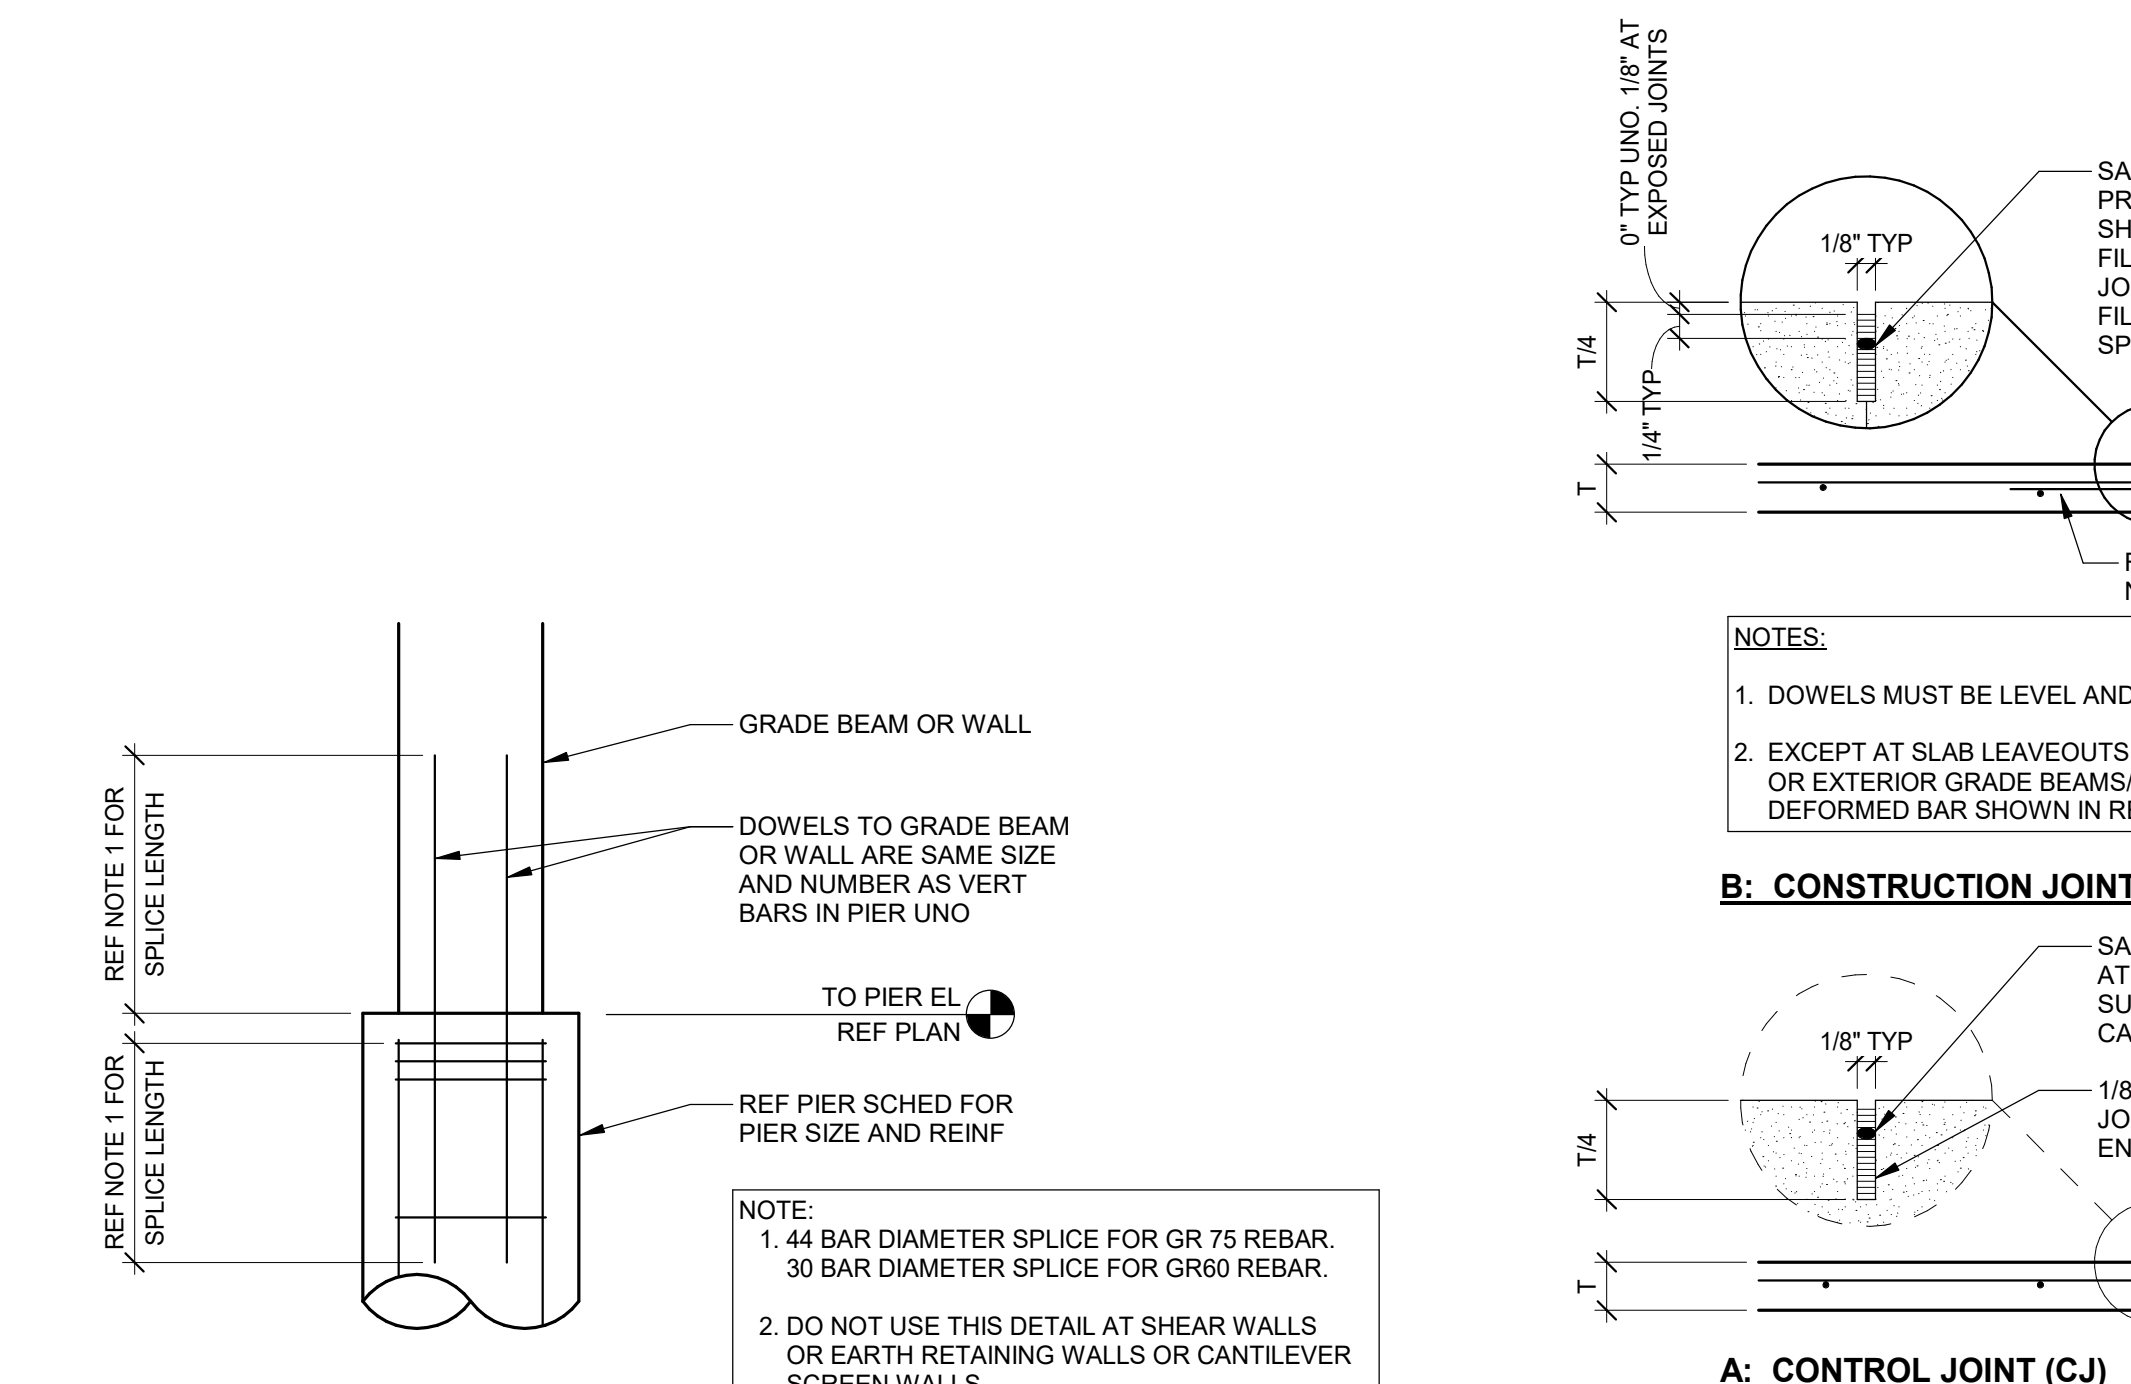

5 TYPICAL DOWELS TO PIER AT CONCRETE WALL OR GRADE BEAM
3/4" = 1'-0"

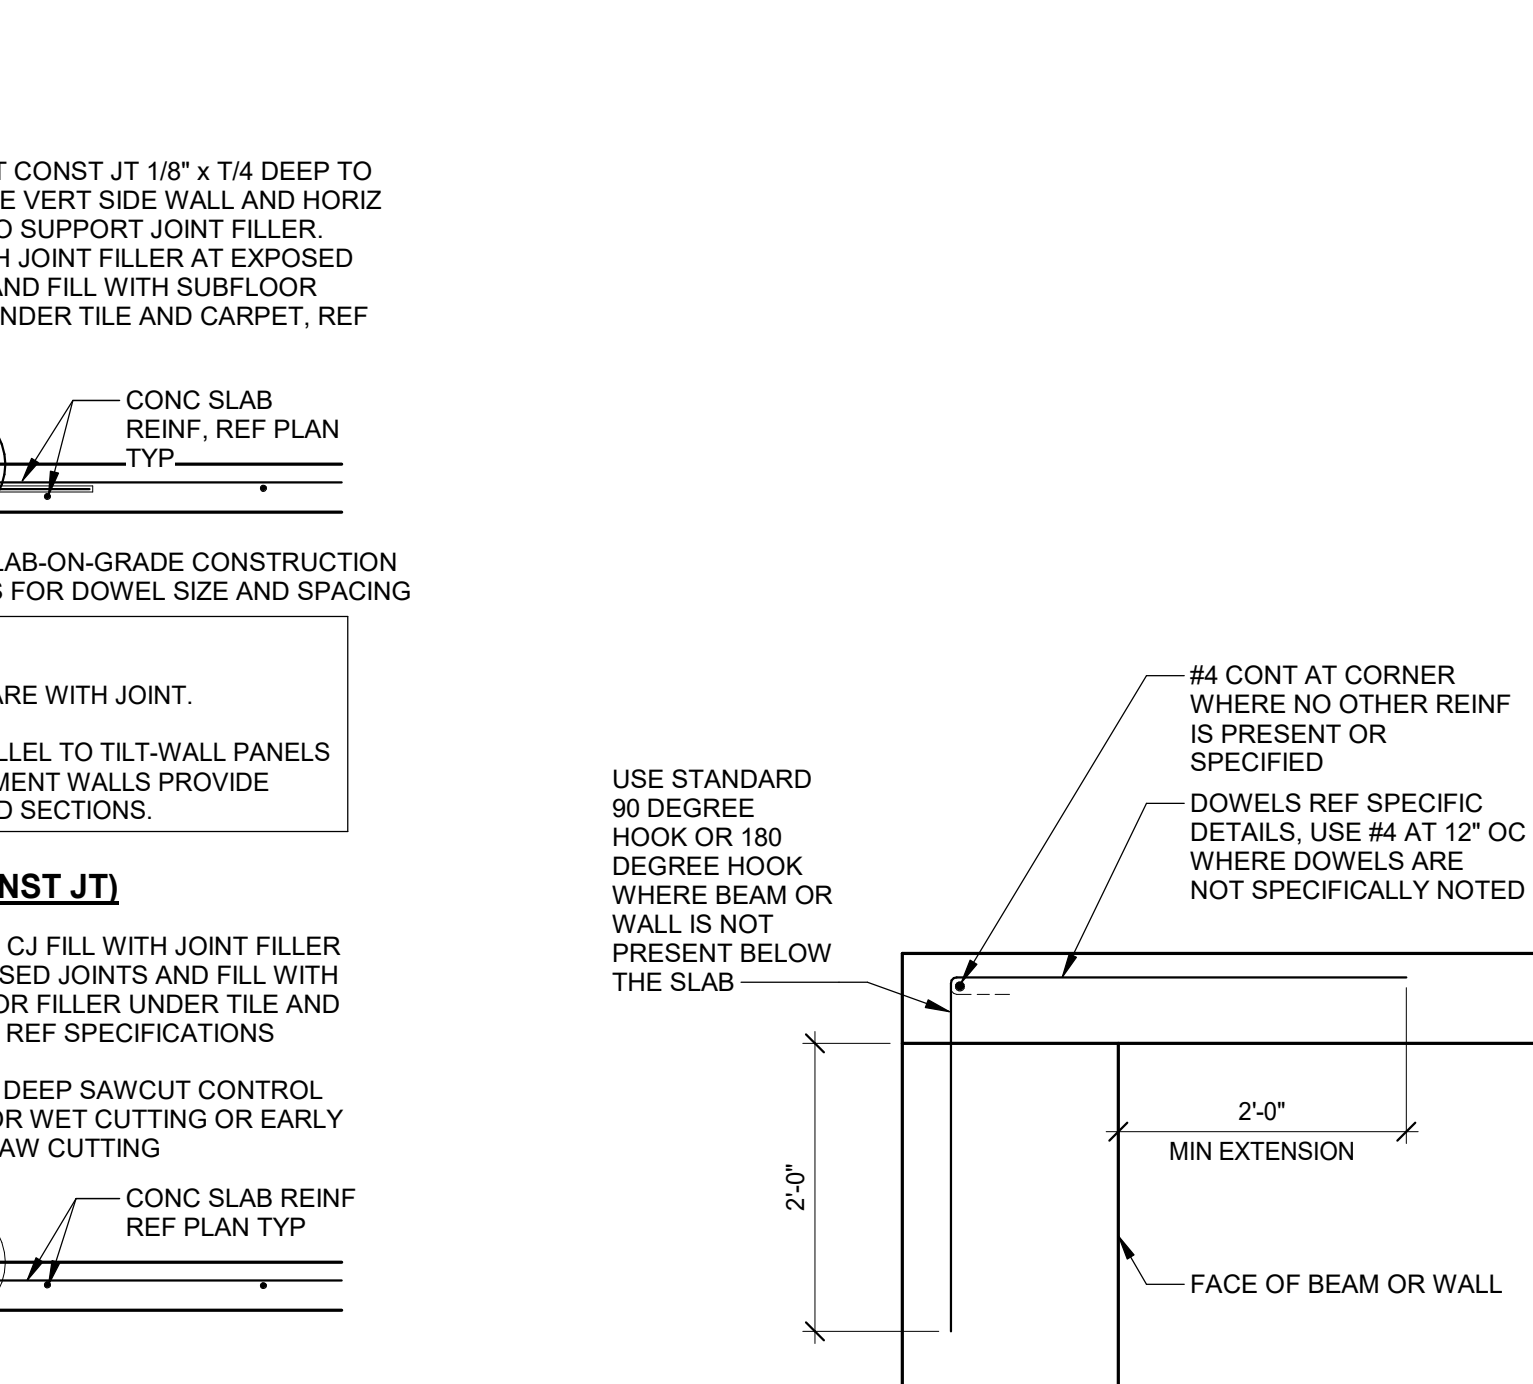


4 TYPICAL SLAB-ON-GRADE JOINTS
3/4" = 1'-0"

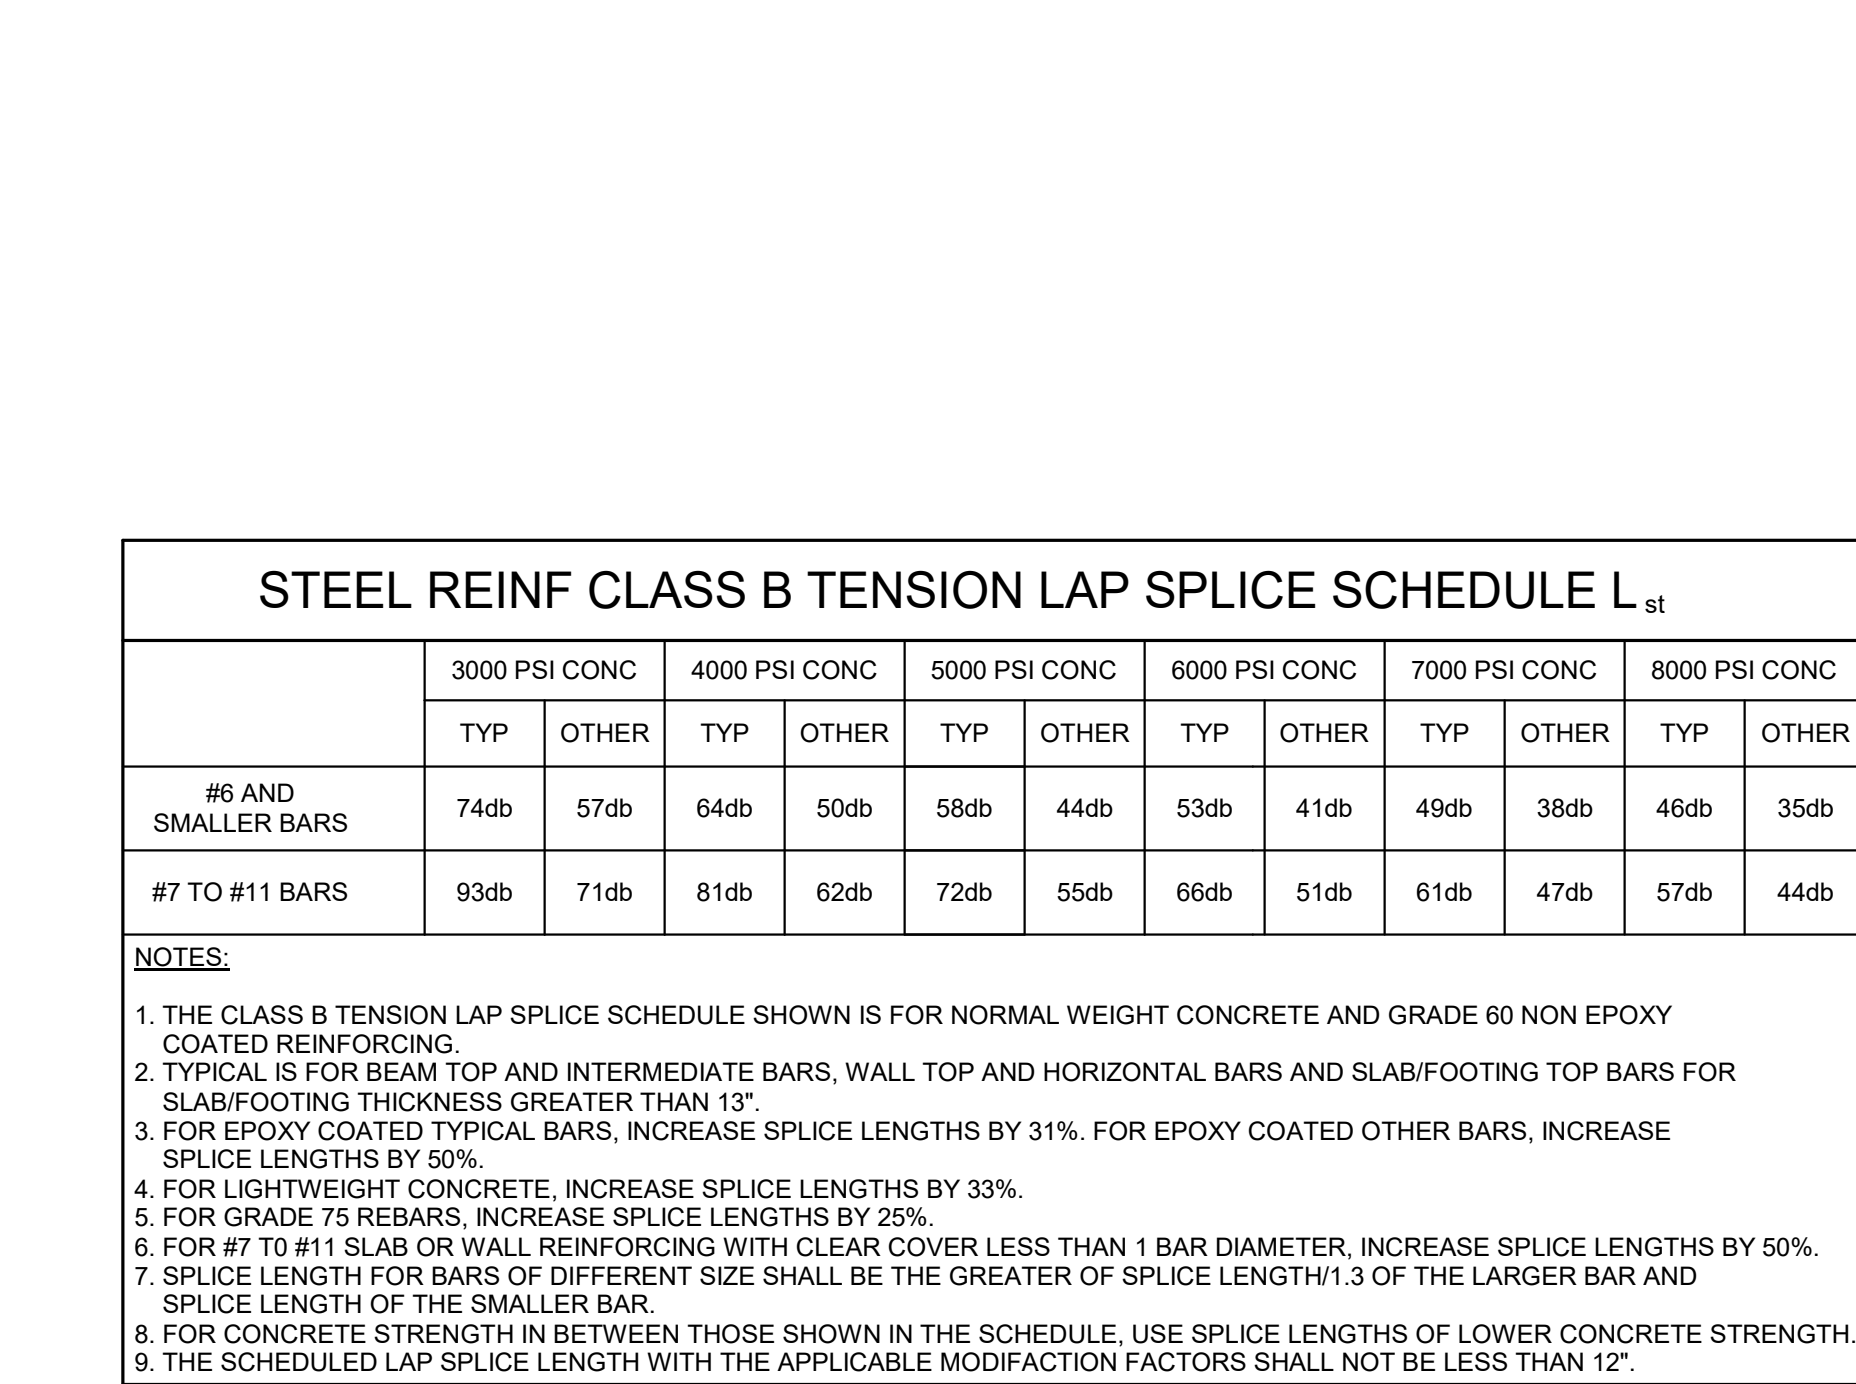










3 TYPICAL SLAB DOWEL
3/4" = 1'-0"

STEEL REIN CLASS B TENSION LAP SPLICE SCHEDULE L _{st}												
	3000 PSI CONC		4000 PSI CONC		5000 PSI CONC		6000 PSI CONC		7000 PSI CONC		8000 PSI CONC	
	TYP	OTHER	TYP	OTHER	TYP	OTHER	TYP	OTHER	TYP	OTHER	TYP	OTHER
#6 AND SMALLER BARS	74db	57db	64db	50db	58db	44db	53db	41db	49db	38db	46db	35db
#7 TO #11 BARS	93db	71db	81db	62db	72db	55db	66db	51db	61db	47db	57db	44db

NOTES:
1. THE CLASS B TENSION LAP SPLICE SCHEDULE SHOWN IS FOR NORMAL WEIGHT CONCRETE AND GRADE 60 NON EPOXY COATED REINFORCING.
2. TYPICAL IS FOR BEAM TOP AND INTERMEDIATE BARS, WALL TOP AND HORIZONTAL BARS AND SLAB/FOOTING TOP BARS FOR SLAB/FOOTING THICKNESS GREATER THAN 13".
3. FOR GRADE 75 REBARS, INCREASE SPLICE LENGTHS BY 25%. FOR EPOXY COATED OTHER BARS, INCREASE SPLICE LENGTHS BY 50%.
4. FOR LIGHTWEIGHT CONCRETE, INCREASE SPLICE LENGTHS BY 33%.
5. FOR #7 TO #11 SLAB OR WALL REINFORCING WITH CLEAR COVER LESS THAN 1 BAR DIAMETER, INCREASE SPLICE LENGTHS BY 50%.
6. SPLICE LENGTH FOR BARS OF DIFFERENT SIZE SHALL BE THE GREATER OF SPLICE LENGTH/1.3 OF THE LARGER BAR AND SPLICE LENGTH OF THE SMALLER BAR.
7. FOR CONCRETE STRENGTH IN BETWEEN THOSE SHOWN IN THE SCHEDULE, USE SPLICE LENGTHS OF LOWER CONCRETE STRENGTH.
8. THE SCHEDULED LAP SPLICE LENGTH WITH THE APPLICABLE MODIFICATION FACTORS SHALL NOT BE LESS THAN 12".

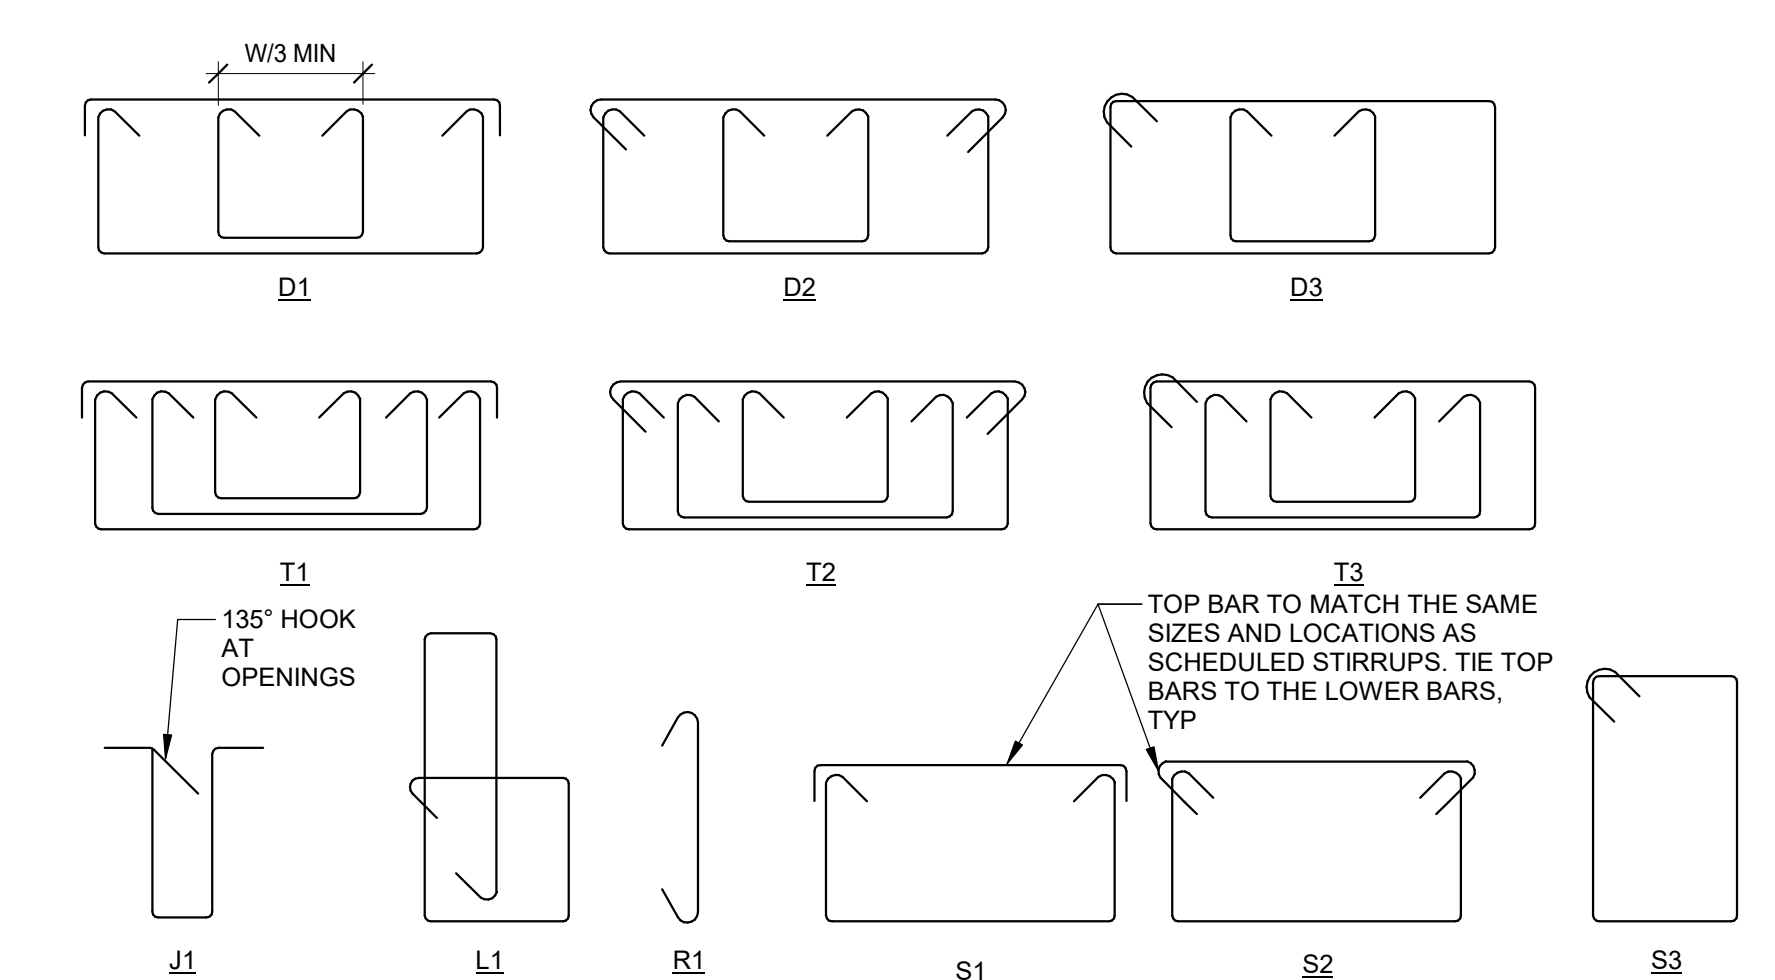


2 TYPICAL STEEL REIN CLASS B TENSION LAP SCHEDULE
3/4" = 1'-0"

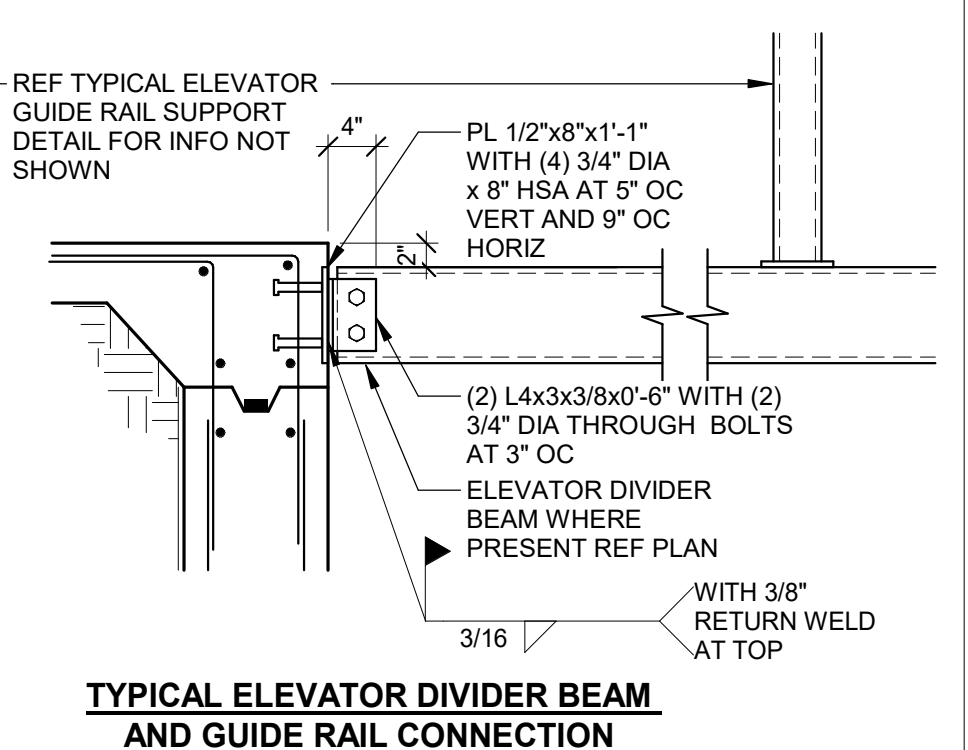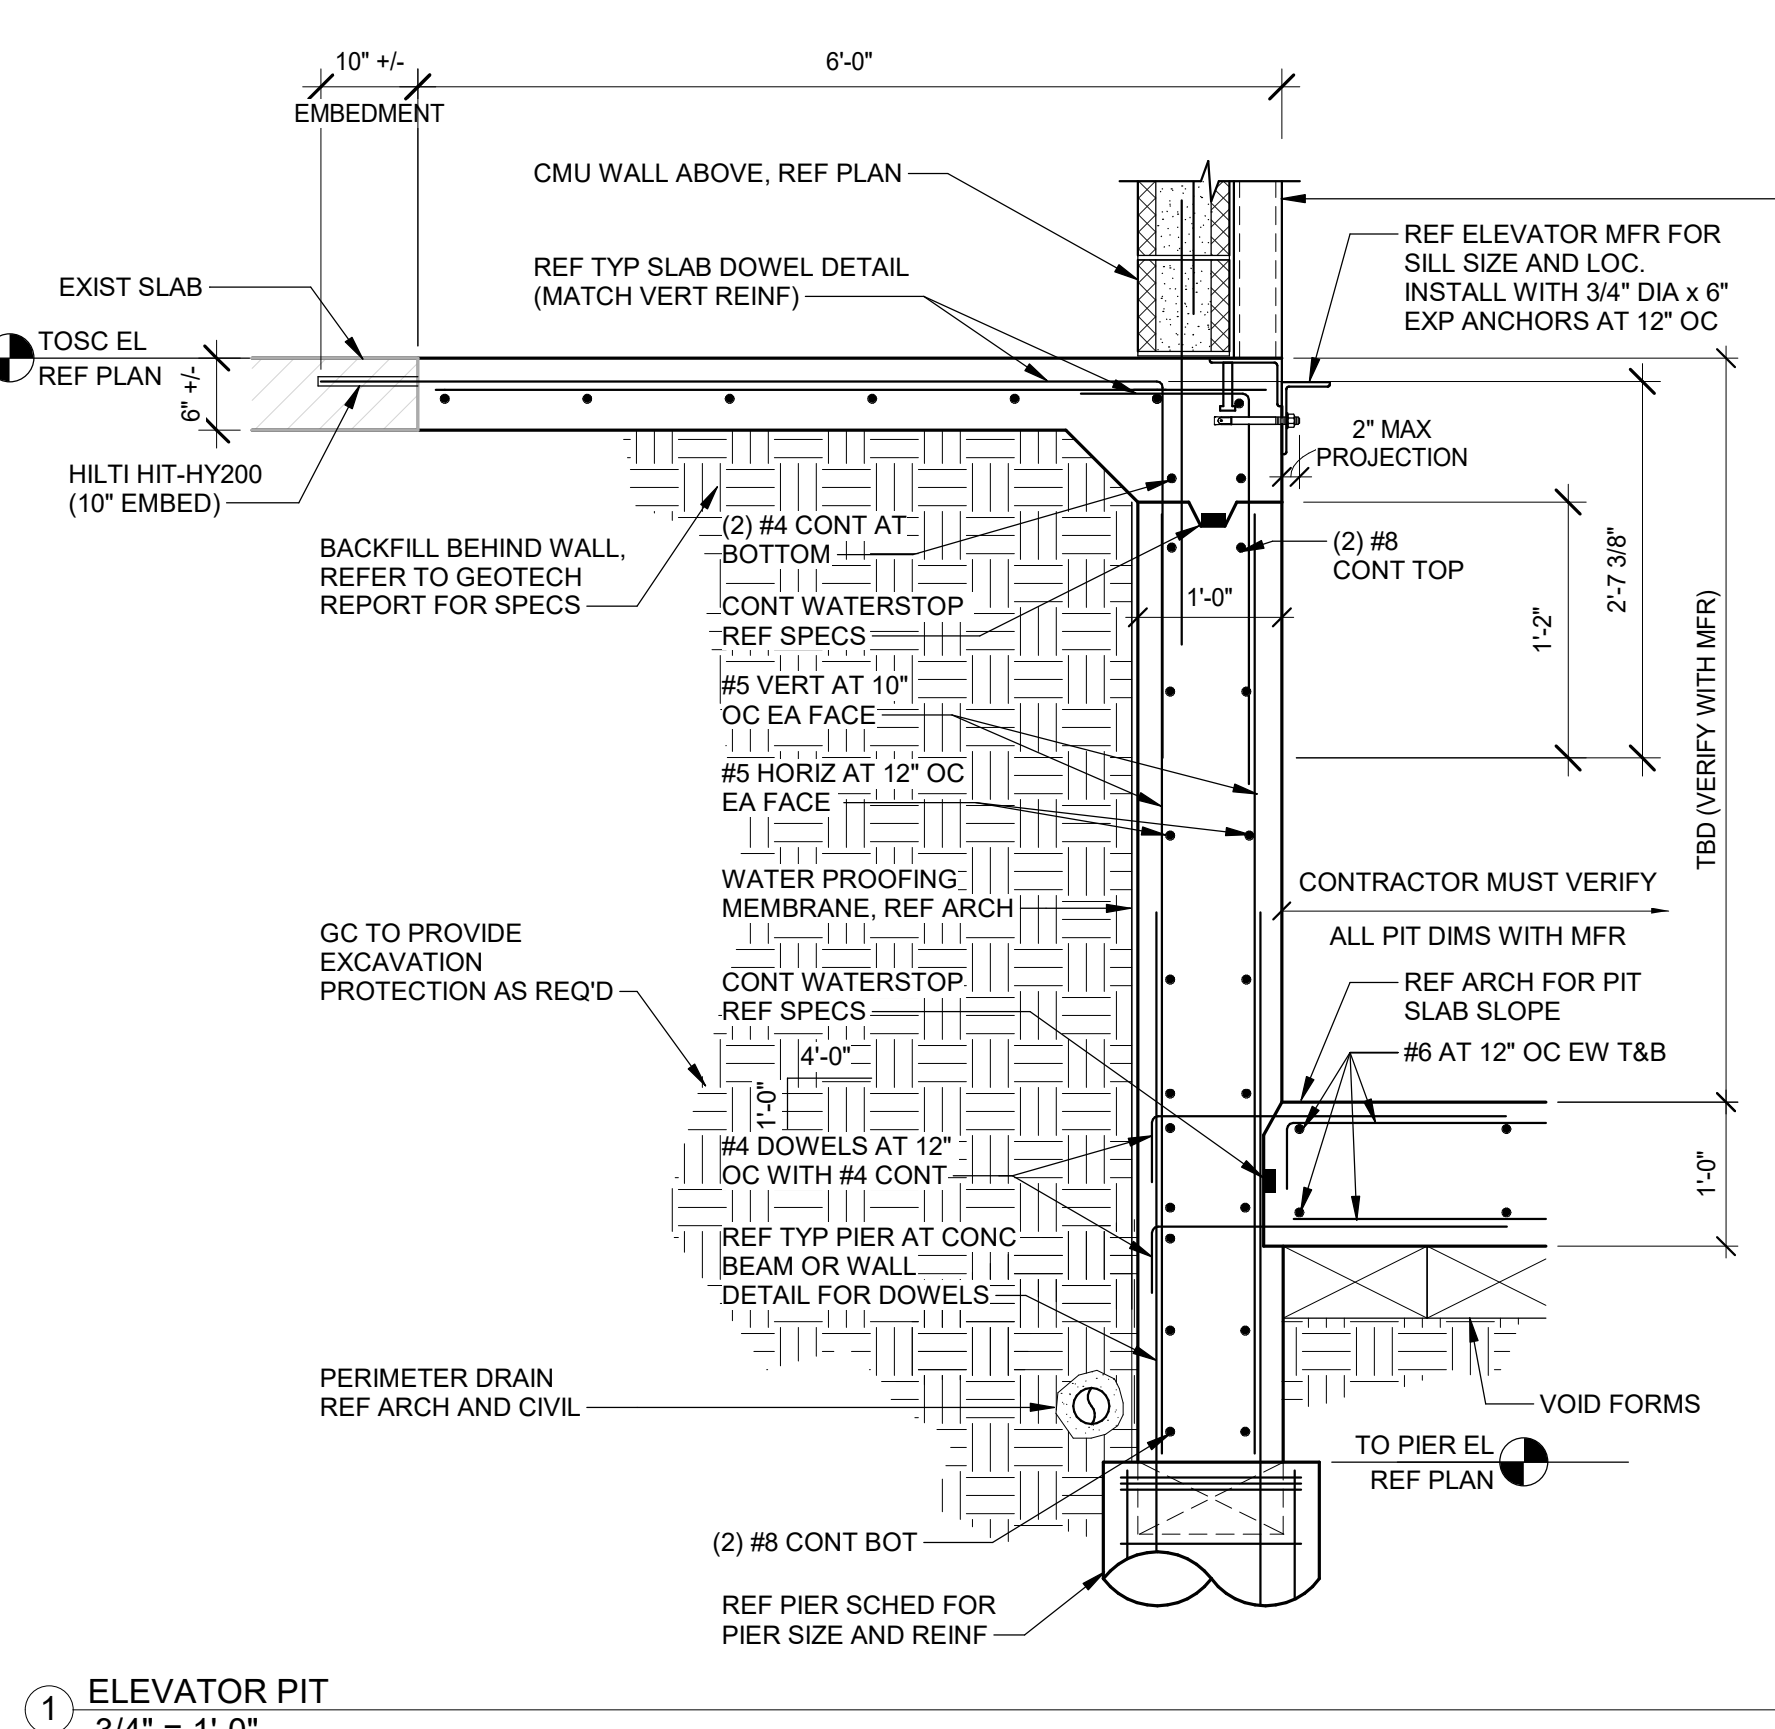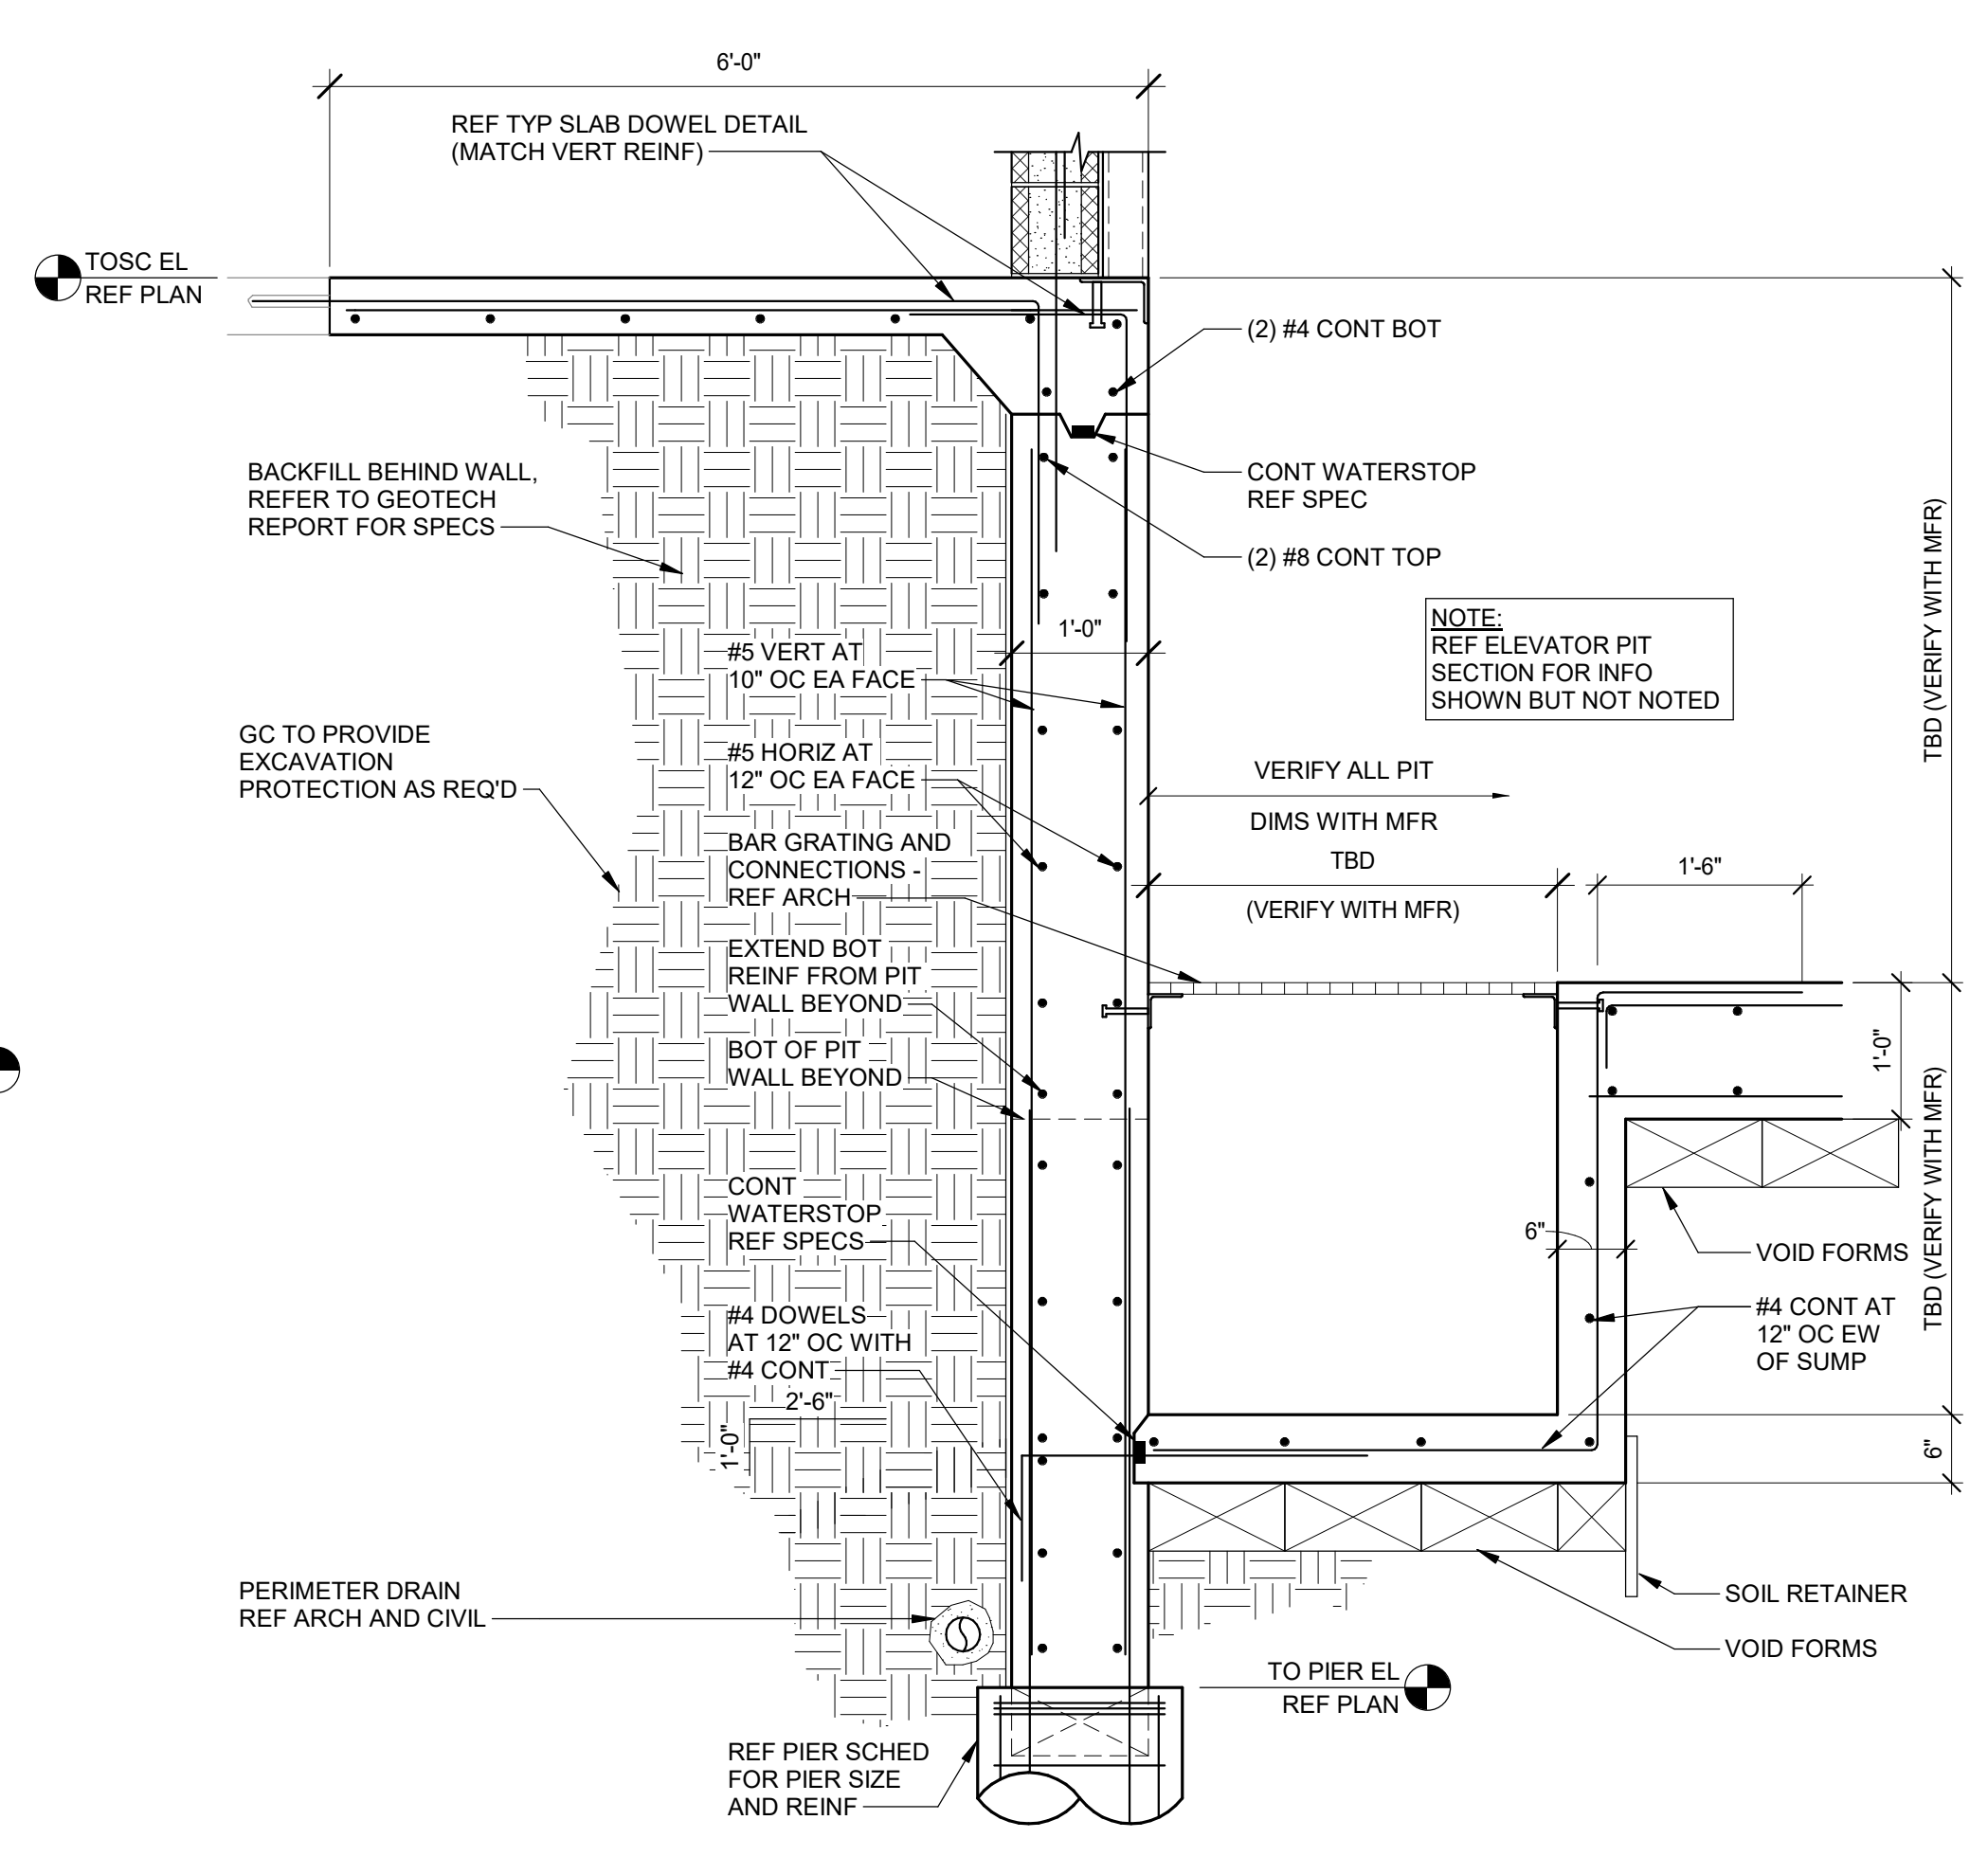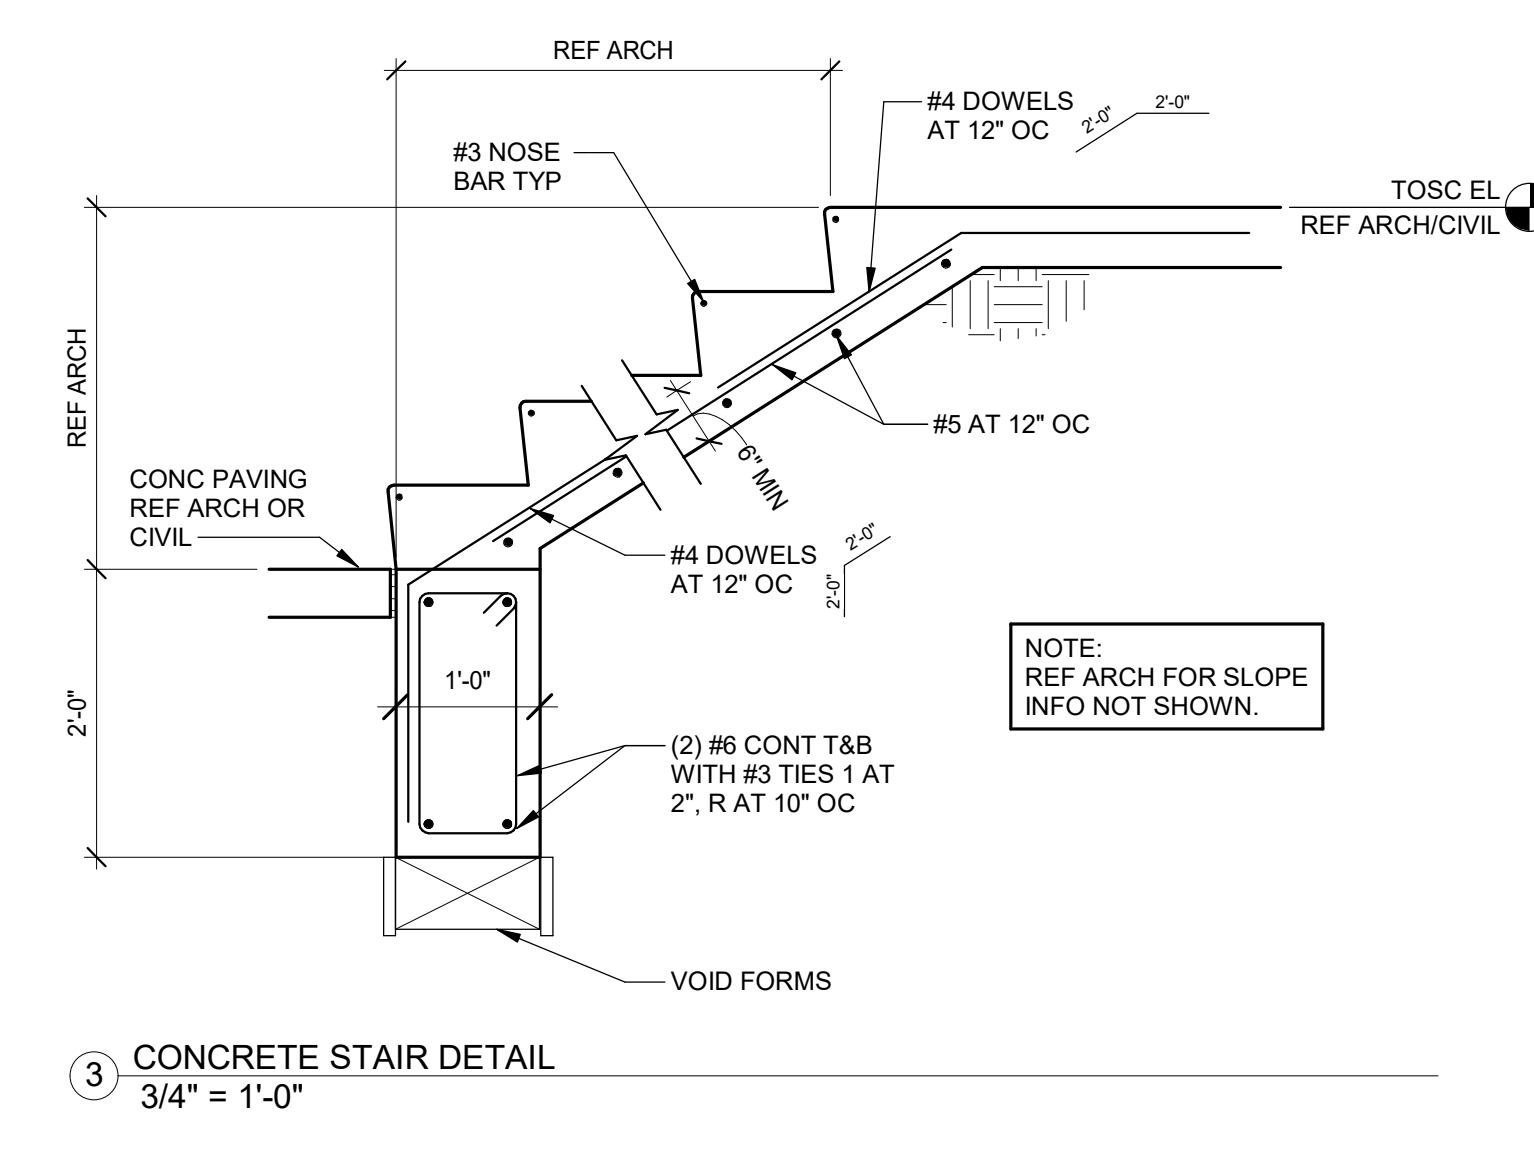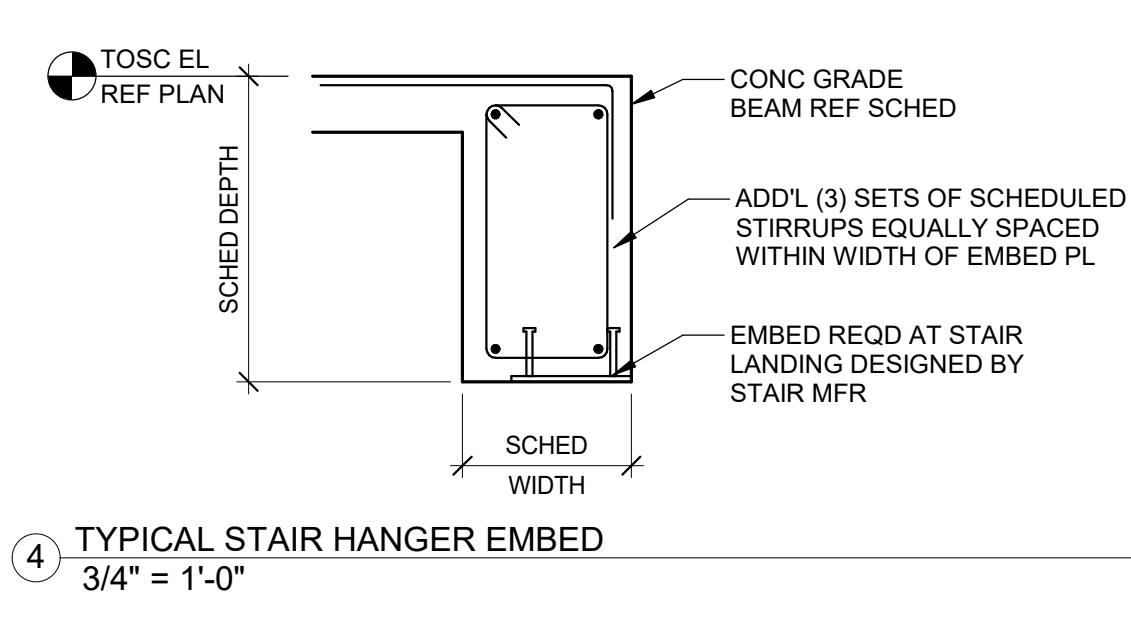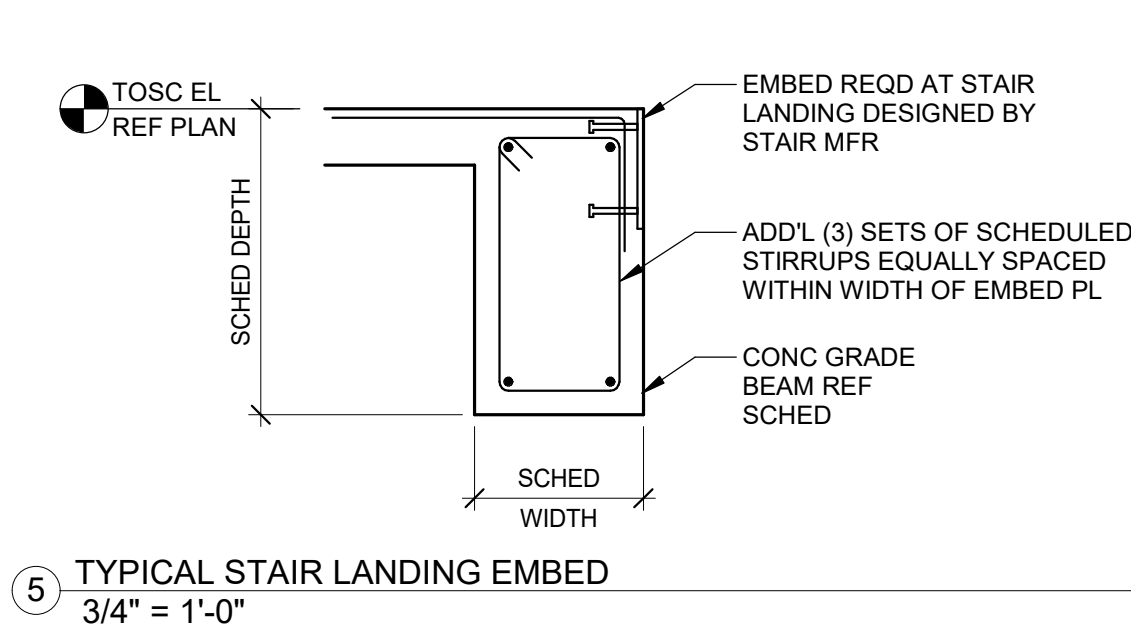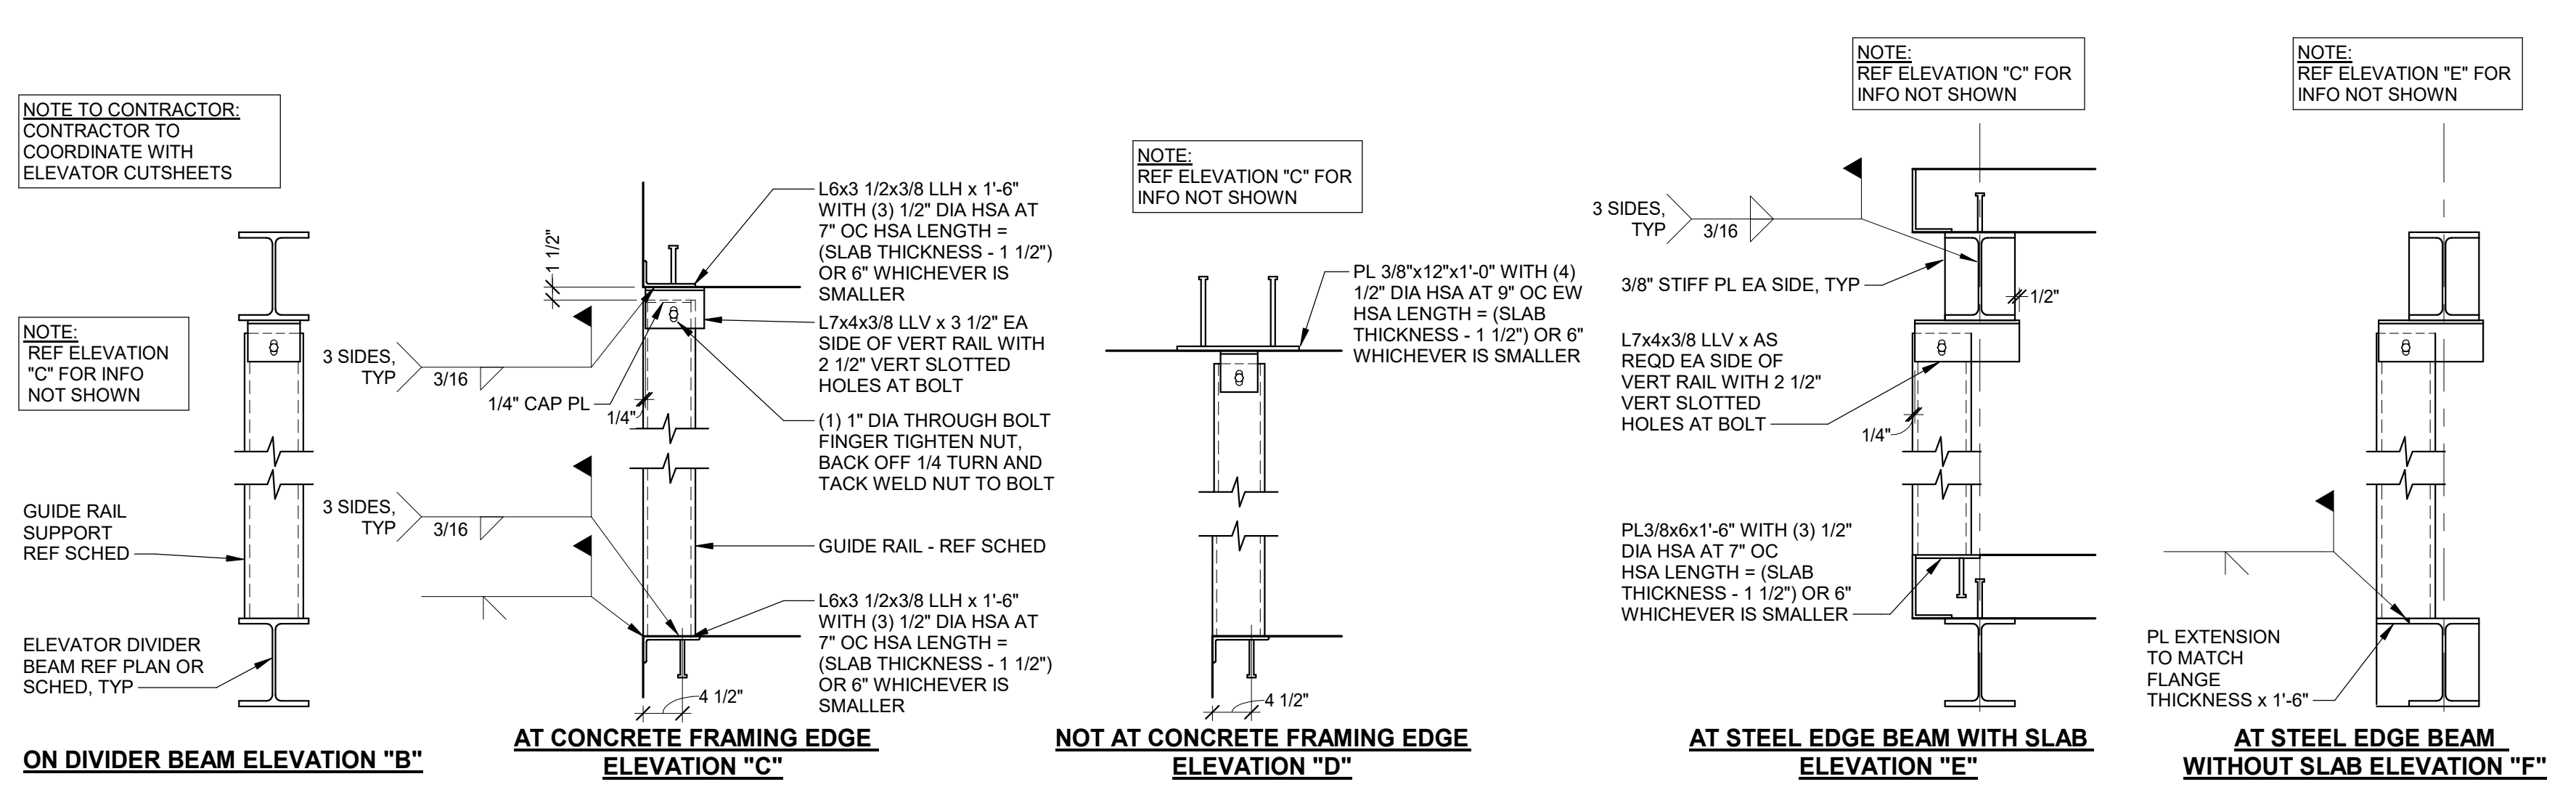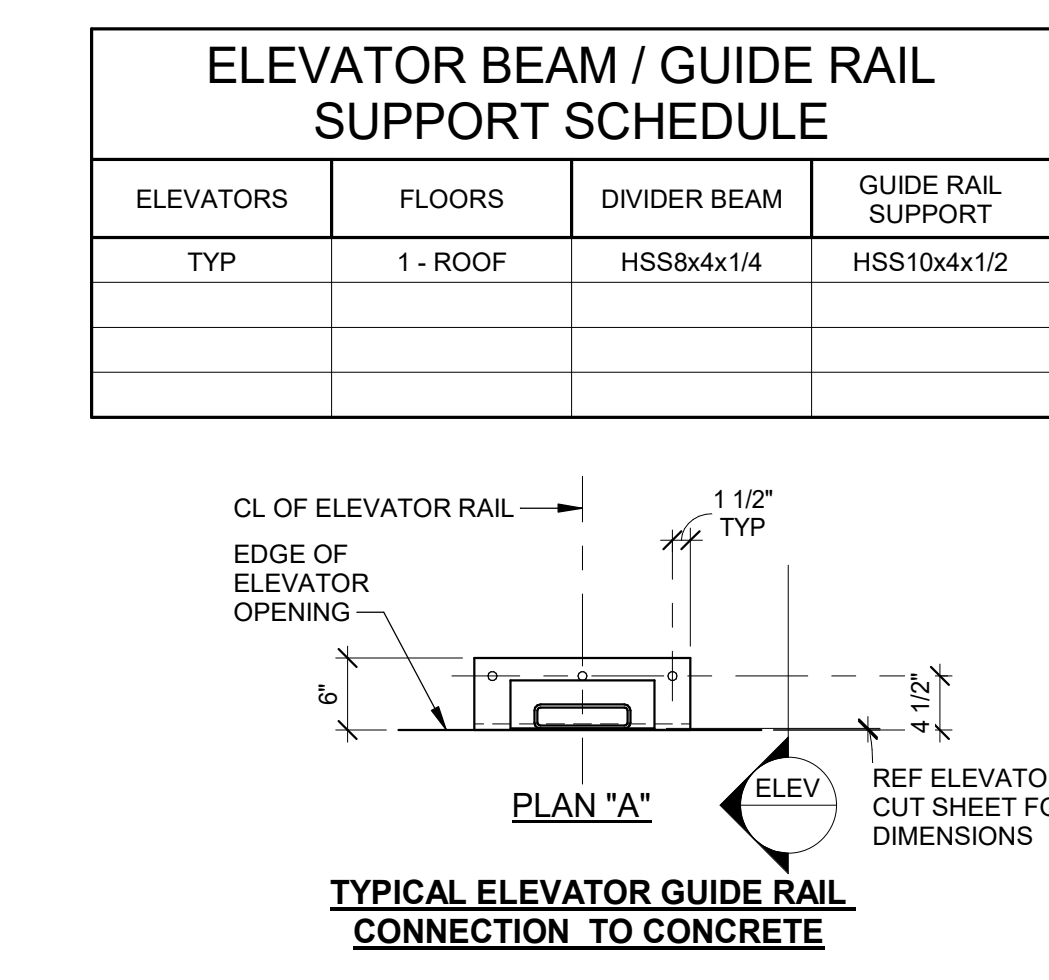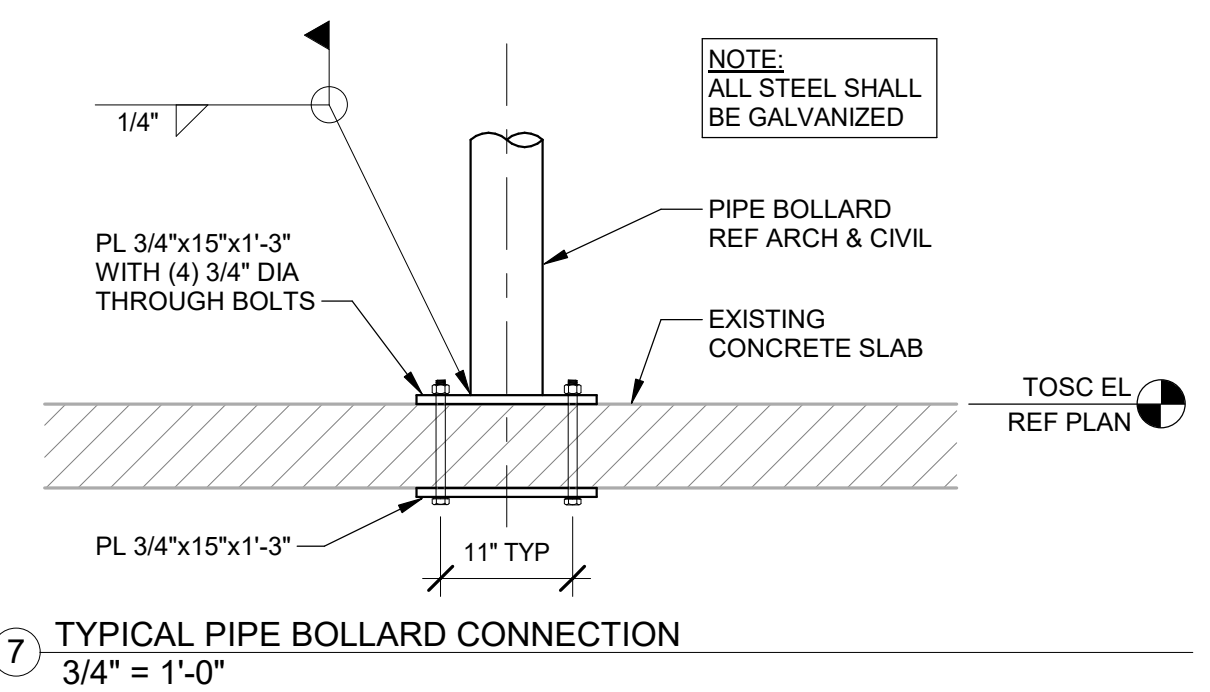


CMU WALL VERTICAL REINFORCING NOTES

- THESE NOTES ONLY APPLIES TO CMU WALLS SHOWN AND DESIGNATED ON THE STRUCTURAL FRAMING PLANS. CMU WALLS NOT SHOWN ON THE STRUCTURAL FRAMING PLANS ARE NOT PART OF THE STRUCTURAL FRAME AND ARE CONSIDERED NON-STRUCTURAL CMU.
- UNLESS NOTED OTHERWISE, REFER TO "TYPICAL WALL REINFORCING DIAGRAM" FOR VERTICAL WALL REINFORCING REQUIREMENTS AT ALL STRUCTURAL CMU WALLS.
- THE STRUCTURAL MASONRY SHOWN ON THE PLANS IS PART OF THE LATERAL LOAD RESISTING SYSTEM OF THE BUILDING. THE STRUCTURAL DETAILS, INCLUDING CLIP ANGLES, DOWELS AND ADDITIONAL SECONDARY FRAMING MEMBERS, ETC. SHOWN ARE CRITICAL TO THE LATERAL PERFORMANCE OF THE BUILDING. THE TEMPORARY STEEL FRAME BRACING PROVIDED DURING CONSTRUCTION SHALL NOT BE REMOVED UNTIL ALL STRUCTURAL LATERAL BRACING SYSTEMS (INCLUDING STRUCTURAL MASONRY WALLS) HAVE BEEN INSTALLED AND CONNECTED TO THE STEEL FRAMING.
- THE FIRST (3) CELLS AT CORNERS (IN EA DIRECTION), ENDS OF WALLS AND EACH SIDE OF THE CONTROL JOINTS SHALL BE REINFORCED WITH THE SAME SIZE AND NUMBER OF REINFORCING BARS AS SPECIFIED FOR THE OTHER REINFORCED CELLS IN THE WALL AND GROUDED FULL.
- FOR REINFORCED CMU WALLS AT OPENINGS, PROVIDE EXTRA REINFORCED FULL HEIGHT CONSECUTIVE CELLS EACH SIDE OF THE OPENING EQUAL TO ONE HALF THE TOTAL NUMBER OF THE CELLS INTERRUPTED BY THE OPENING. REINFORCE EACH CELL WITH THE SAME SIZE AND NUMBER OF BARS AS SPECIFIED FOR THE INTERRUPTED CELLS. PROVIDE A MINIMUM OF (2) REINFORCED GROUDED CELLS EACH SIDE OF OPENING. REFER TO TYPICAL CMU WALL OPENING DIAGRAM AND SCHEDULE FOR ADDITIONAL INFORMATION.
- HOLD VERTICAL REINFORCING IN POSITION AT TOP AND BOTTOM AND AT 8'-0" OC MAXIMUM.
- REFER TO GENERAL NOTES, SPECIFICATIONS AND SECTIONS/DETAILS FOR INFORMATION NOT SHOWN.
- VERTICAL BARS MAY BE SPLICED WITH SPLICE LENGTHS SHOWN IN TENSION LAP SPLICE SCHEDULE FOR STEEL REINFORCING IN CMU. SPLICES LOCATED IN ADJACENT CELLS SHALL BE STAGGERED SUCH THAT NOT MORE THAN 50 PERCENT OF THE BARS ARE SPLICED AT THE SAME LOCATION.

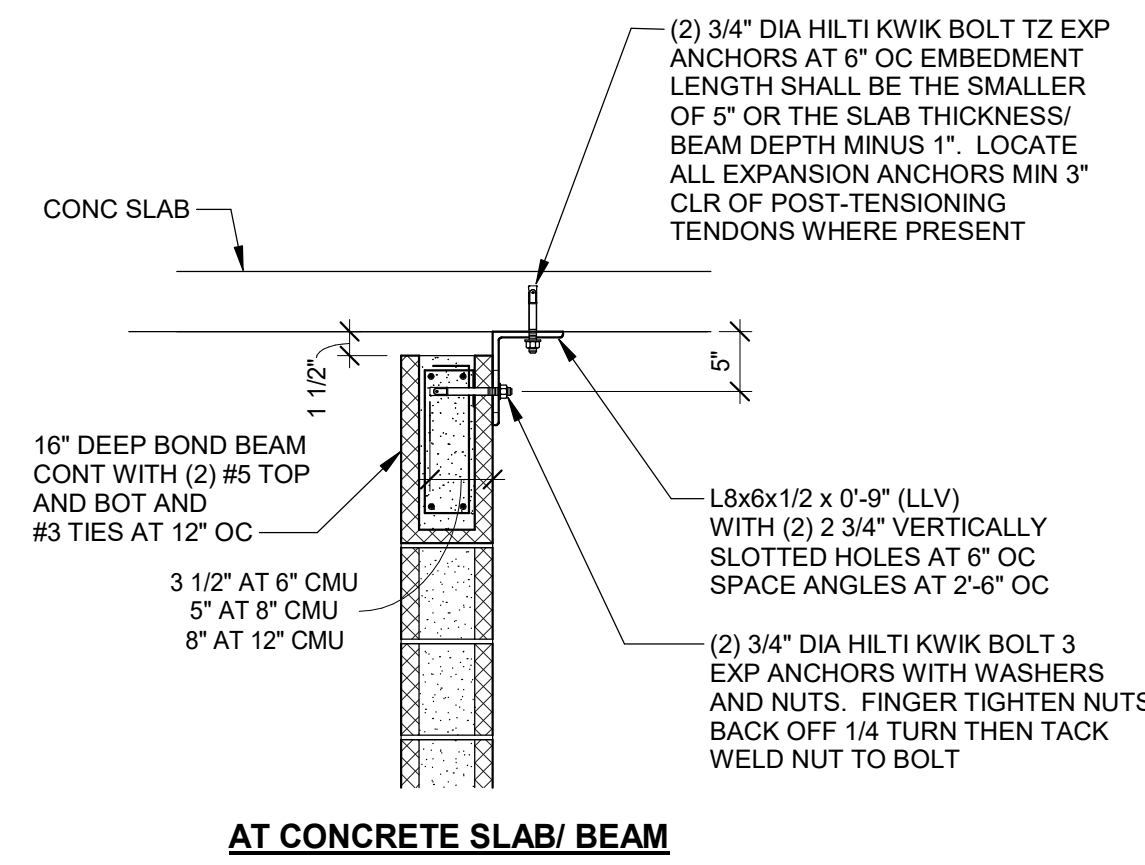


12 TYPICAL BRACING AT TOP OF STRUCTURAL NON-LOAD BEARING CMU WALLS
3/4" = 1'-0"


11 TYPICAL STRUCTURAL CMU WALL VERTICAL REINFORCING SCHEDULE
3/4" = 1'-0"

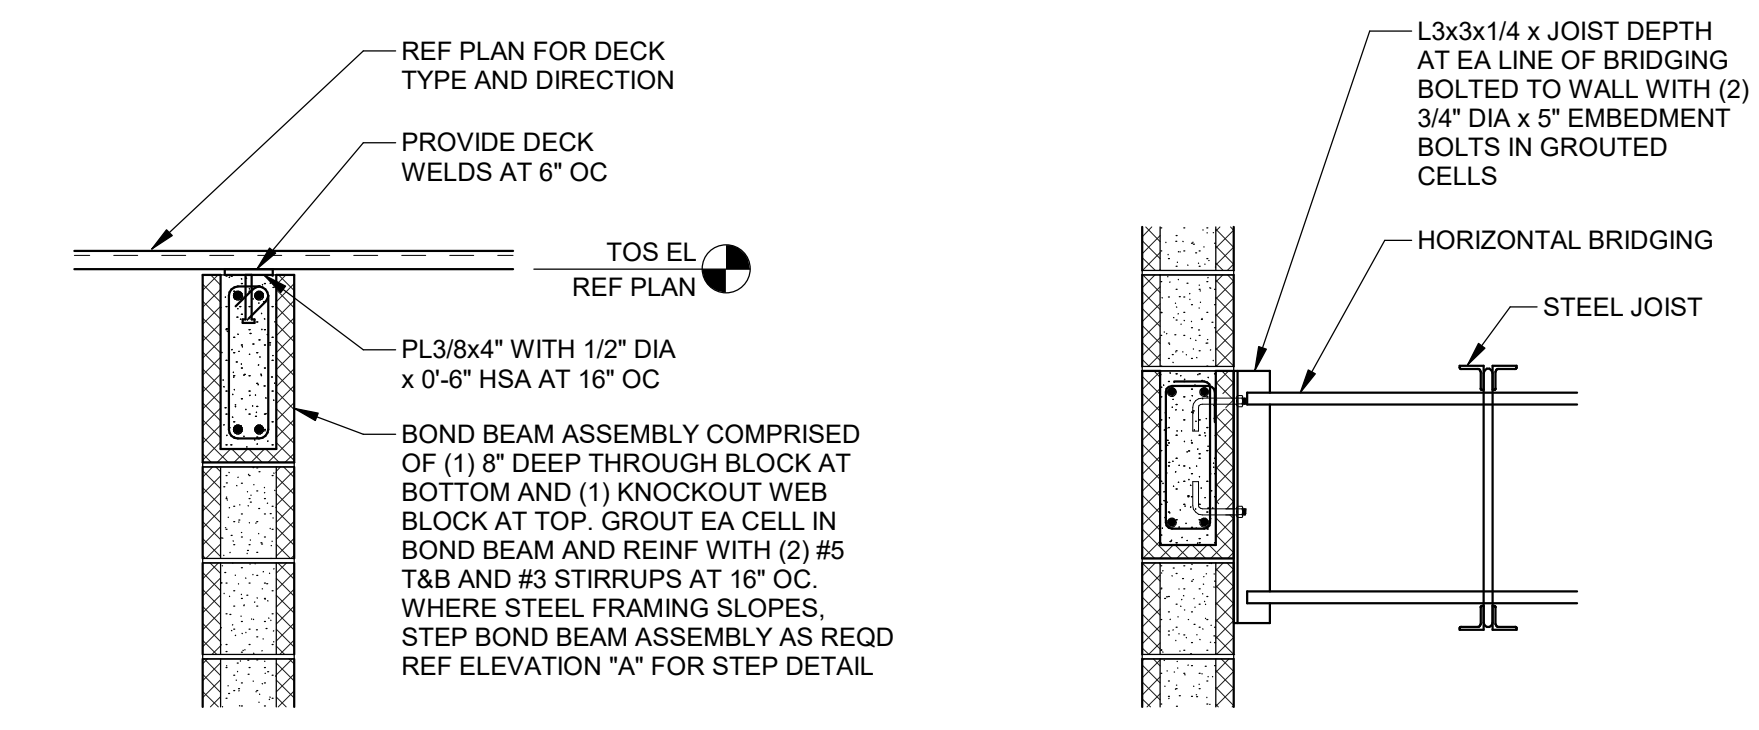


10 DECK BEARING AT INTERIOR MASONRY WALL
3/4" = 1'-0"

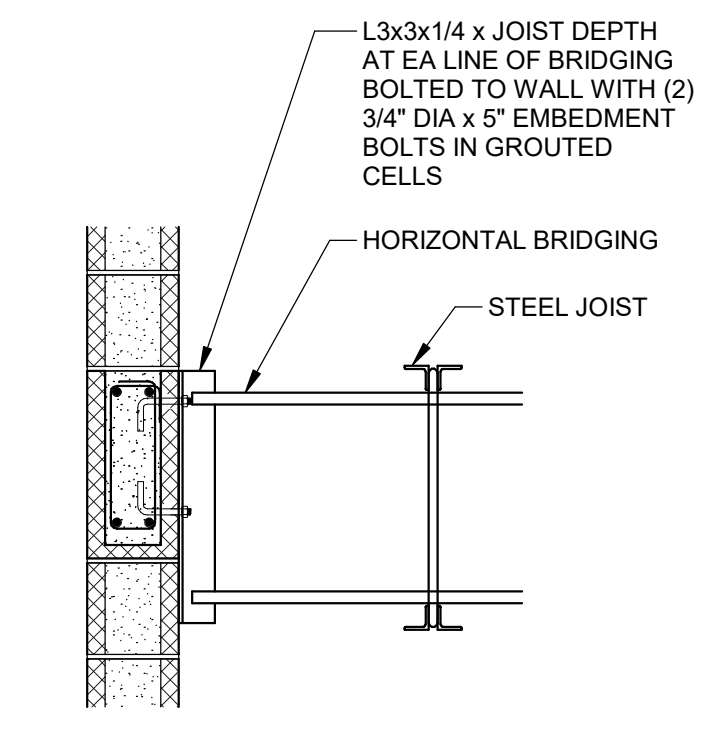


9 JOIST BRIDGING TO MASONRY WALL
3/4" = 1'-0"

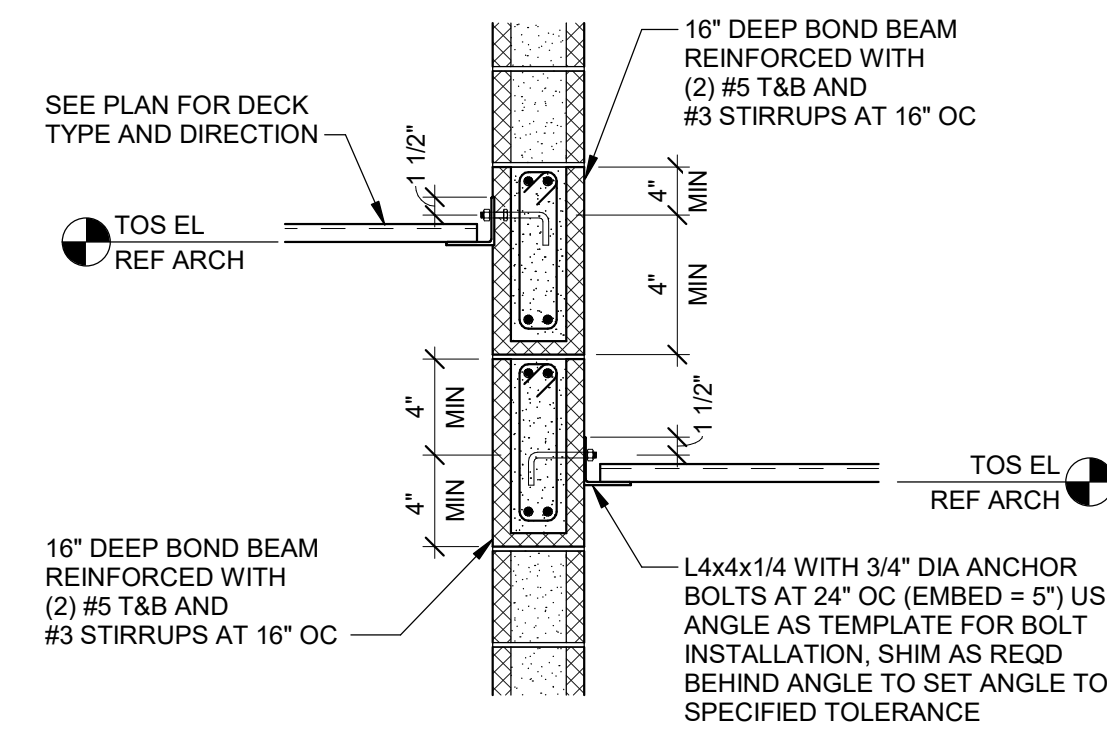


8 DECKS BEARING ON MASONRY WALL
3/4" = 1'-0"

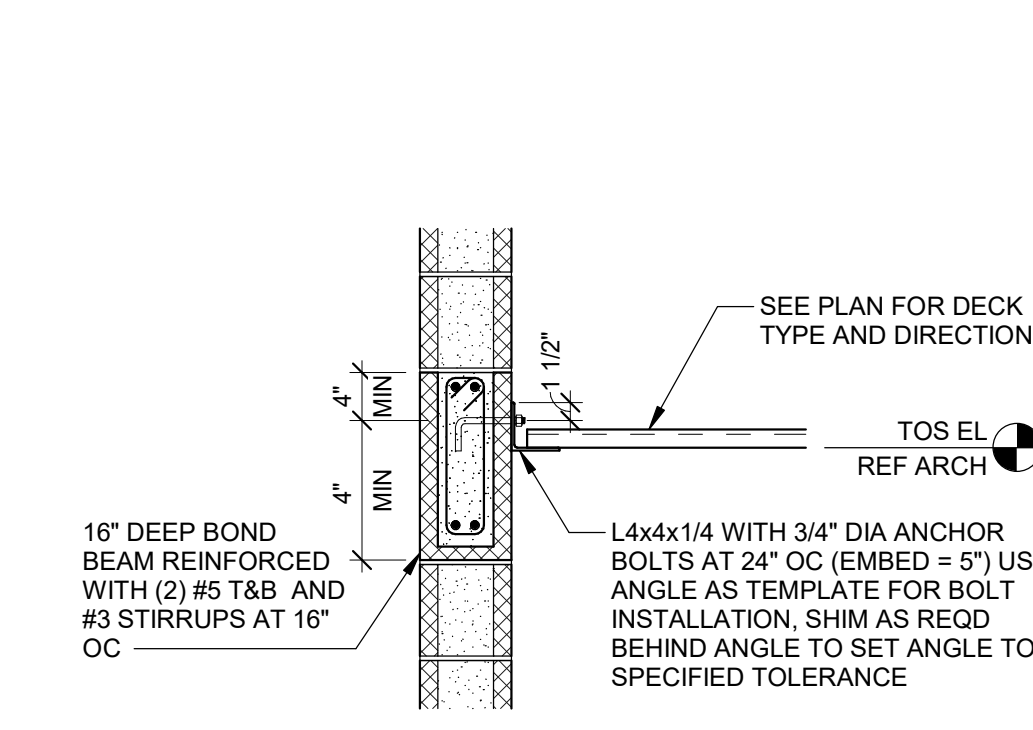

7 DECK BEARING ON MASONRY WALL
3/4" = 1'-0"

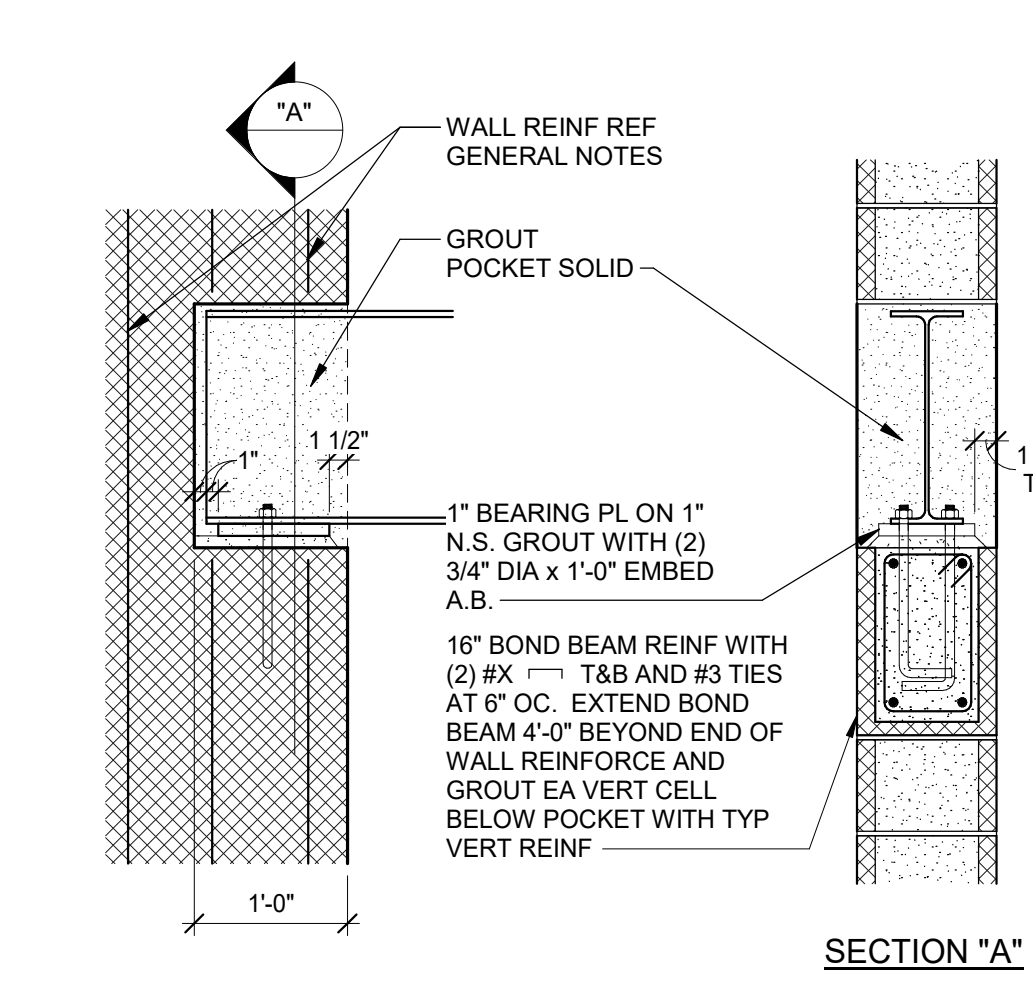


6 STEEL BEAM BEARING AT END OF MASONRY WALL
3/4" = 1'-0"

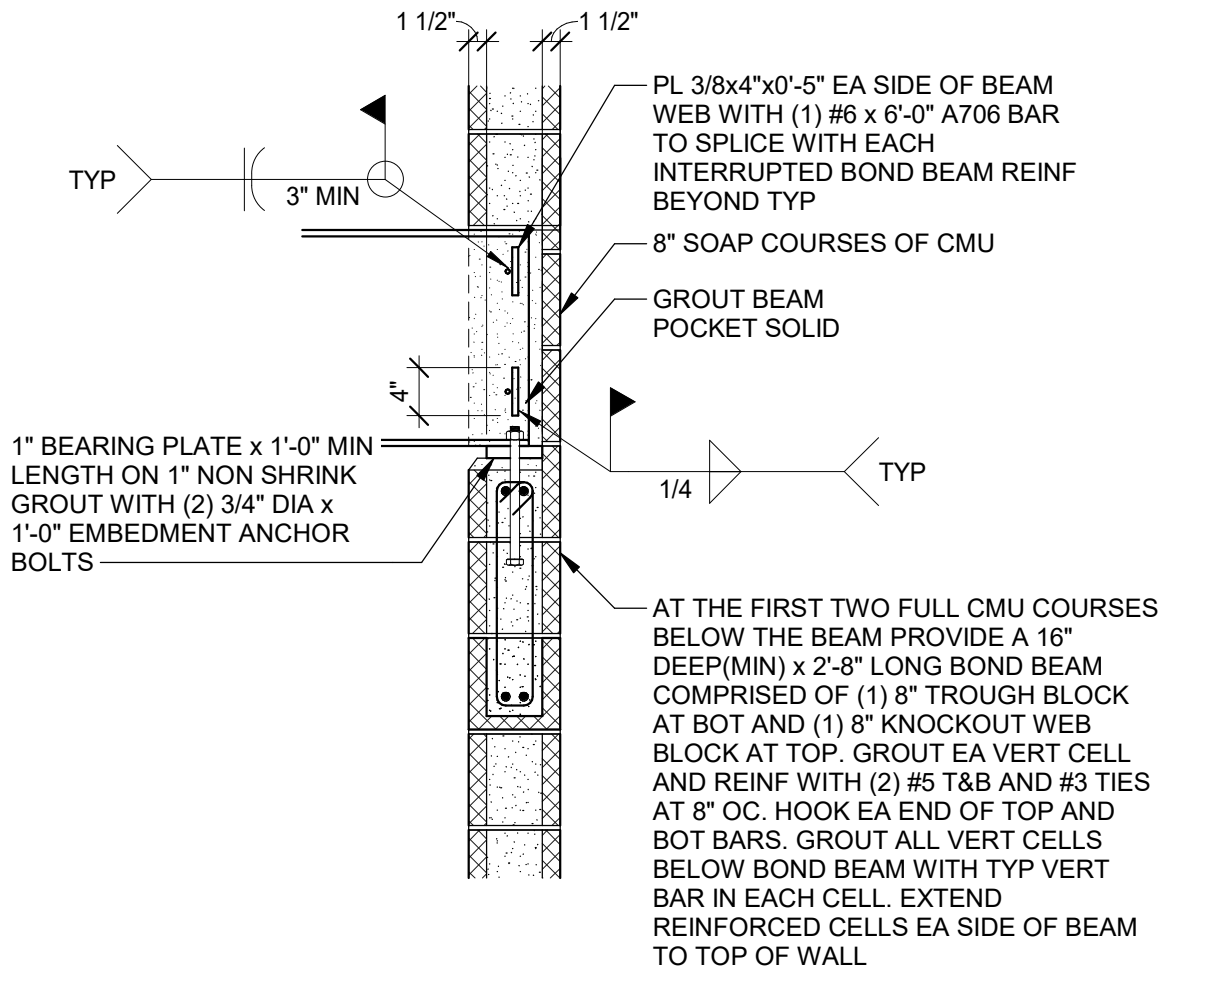


5 STEEL BEAM BEARING ON MASONRY WALL
3/4" = 1'-0"

TYPICAL NON-LOAD BEARING CMU LINTEL SCHEDULE				
WIDTH (W)	DEPTH (D)	CLEAR SPAN	REINF	STIRRUP
8"	8"	UP TO 5'-0"	(2) #4 BOT	-
	16"	UP TO 10'-0"	(2) #6 T&B	#3 AT 12" OC


LOAD BEARING CMU LINTEL SCHEDULE				
WIDTH (W)	DEPTH (D)	CLEAR SPAN	REINF	STIRRUP
8"	16"	UP TO 4'-8" AT ELEVATORS AND IT/COMM ROOMS	(1) #5	-
	16"	UP TO 20'-0" AT ROOF LOBBY	(2) #8	-

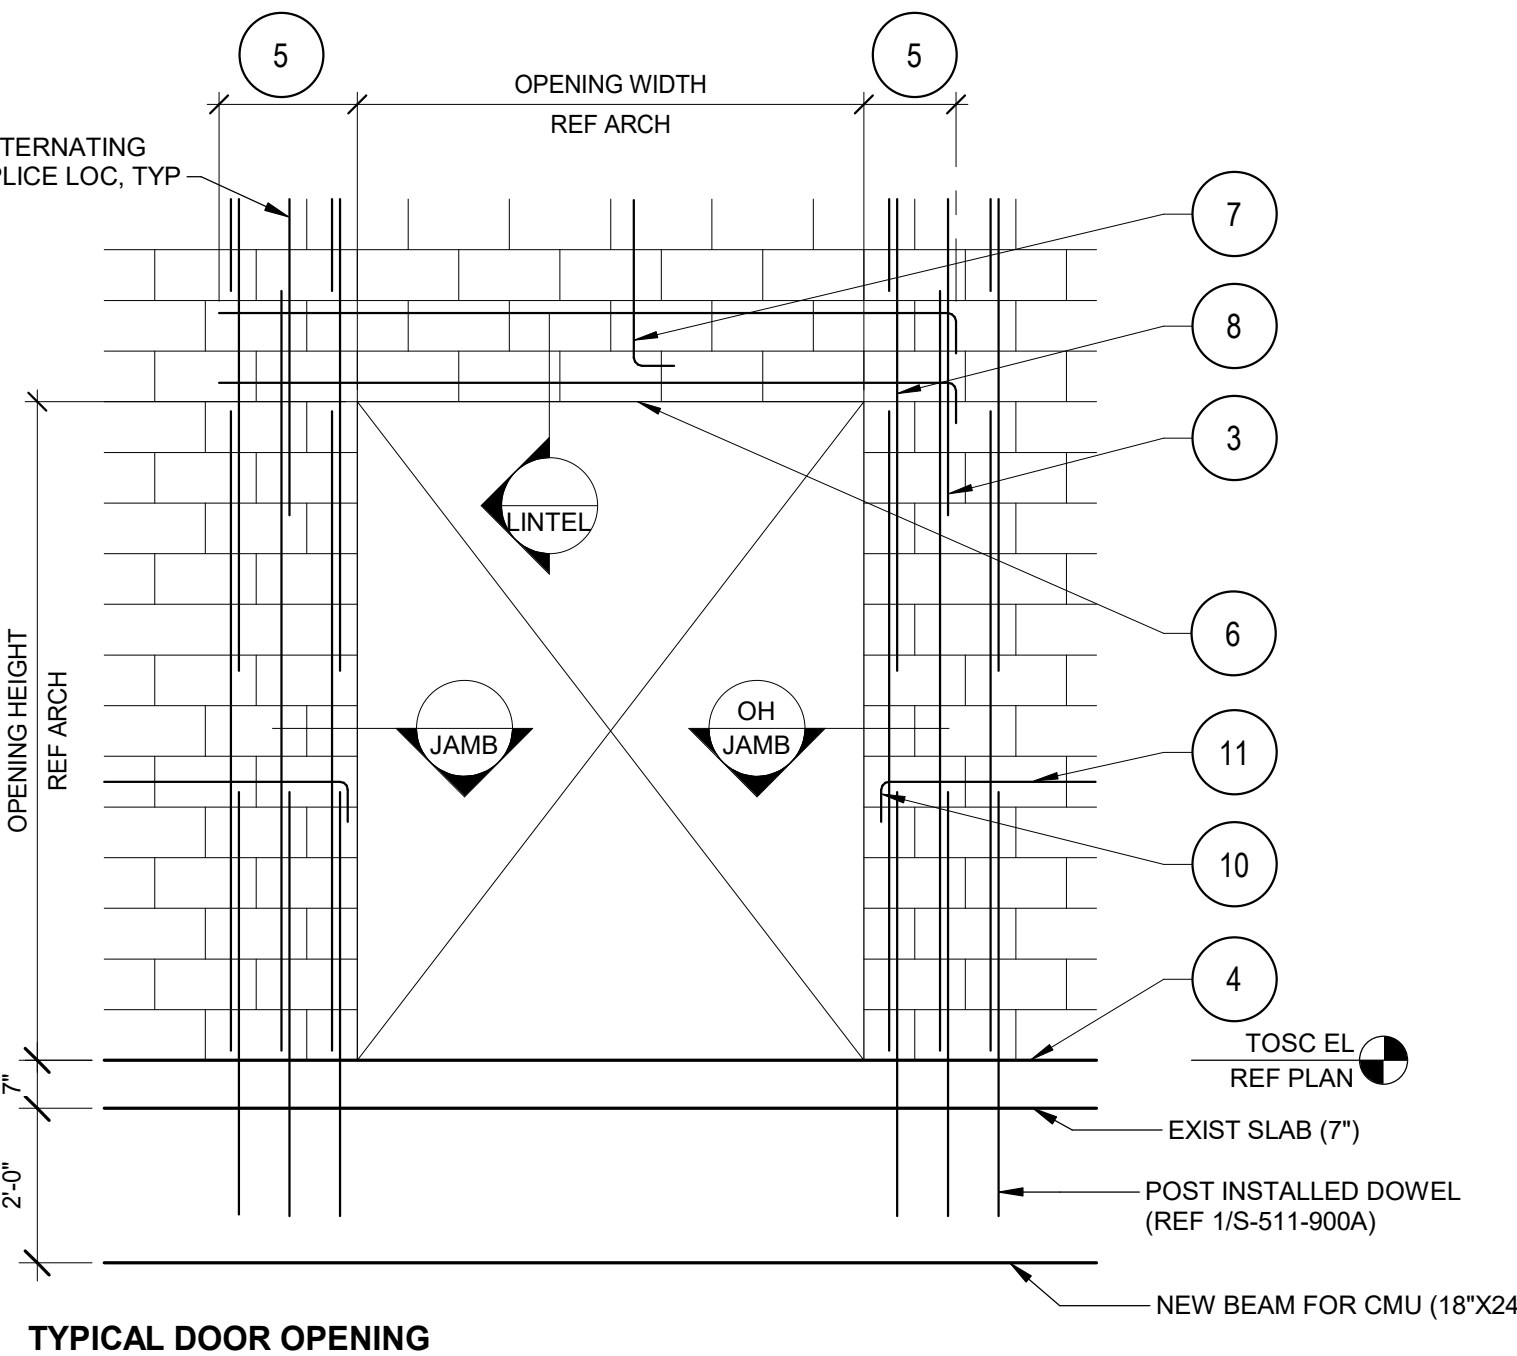

2 TYPICAL CMU WALL OPENING DIAGRAM AND SCHEDULE
1" = 1'-0"

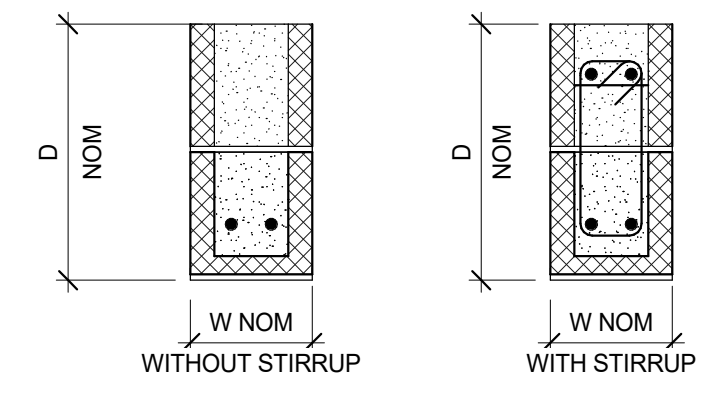


LINTEL

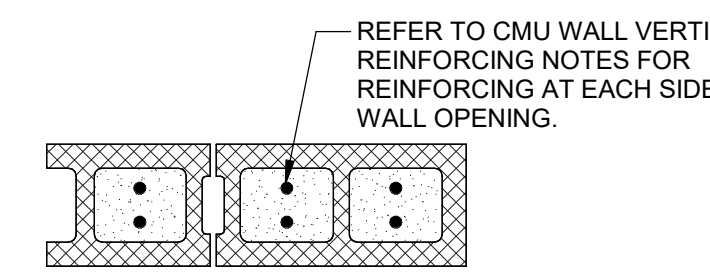


JAMB


- NOTES:
- REFER TO ARCH AND MECH DRAWINGS FOR SIZE AND LOCATION OF OPENINGS.
 - REFER TO SCHEDULES FOR LINTEL AND JAMB REINFORCING UNLESS DETAILED OTHERWISE.
 - SPLICES IN VERT REINF REF CMU WALL REINF DIAGRAM.
 - CMU WALL STARTS ABOVE FLOOR.
 - EXTEND GROUDED LINTEL A MINIMUM OF 2'-0" BEYOND FACE OF OPENING EACH SIDE FOR STRAIGHT LINTEL REINF AND 1'-0" FOR LINTEL REINF WITH STANDARD ACI HOOK.
 - USE LINTEL BLOCKS ONLY FOR BOTTOM COURSE OF LINTEL BEAMS OVER OPENING. LINTEL SHALL REMAIN SHORED UNTIL MASONRY CONSTRUCTION ABOVE HAS REACHED 100% OF THE SPECIFIED 28 DAY COMPRESSIVE STRENGTH.
 - CONTINUE VERT WALL REINF OVER OPENING. ANCHOR VERT REINF INTO LINTEL BEAM WITH STANDARD ACI 90° HOOK.
 - ALL VERT BARS AT DOOR JAMBS TO BE FULL HEIGHT.
 - #5 SILL REINF. SOLID GROUT SILL.
 - WHERE HORIZONTAL REINF IS TERMINATED BY OPENING OR CONTROL JOINT PROVIDE STANDARD ACI HOOK WITH VERT WALL REINF IN THE END CELL.
 - CONTINUOUS BOND BEAM REF CMU WALL REINF DIAGRAM.

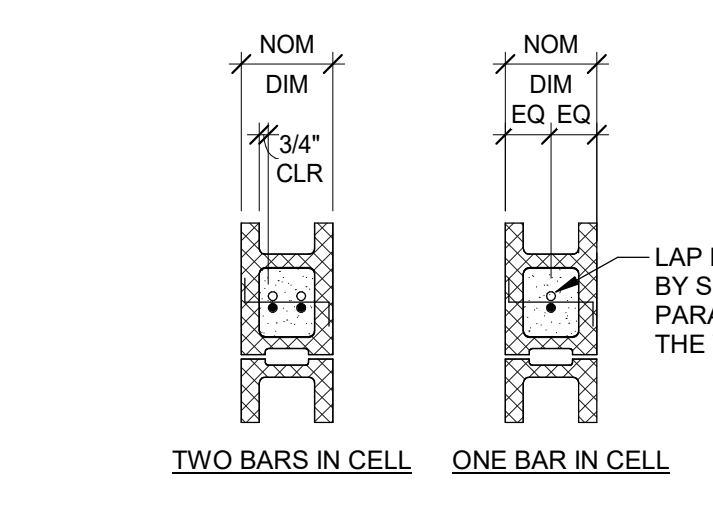


SECTION "A-A"

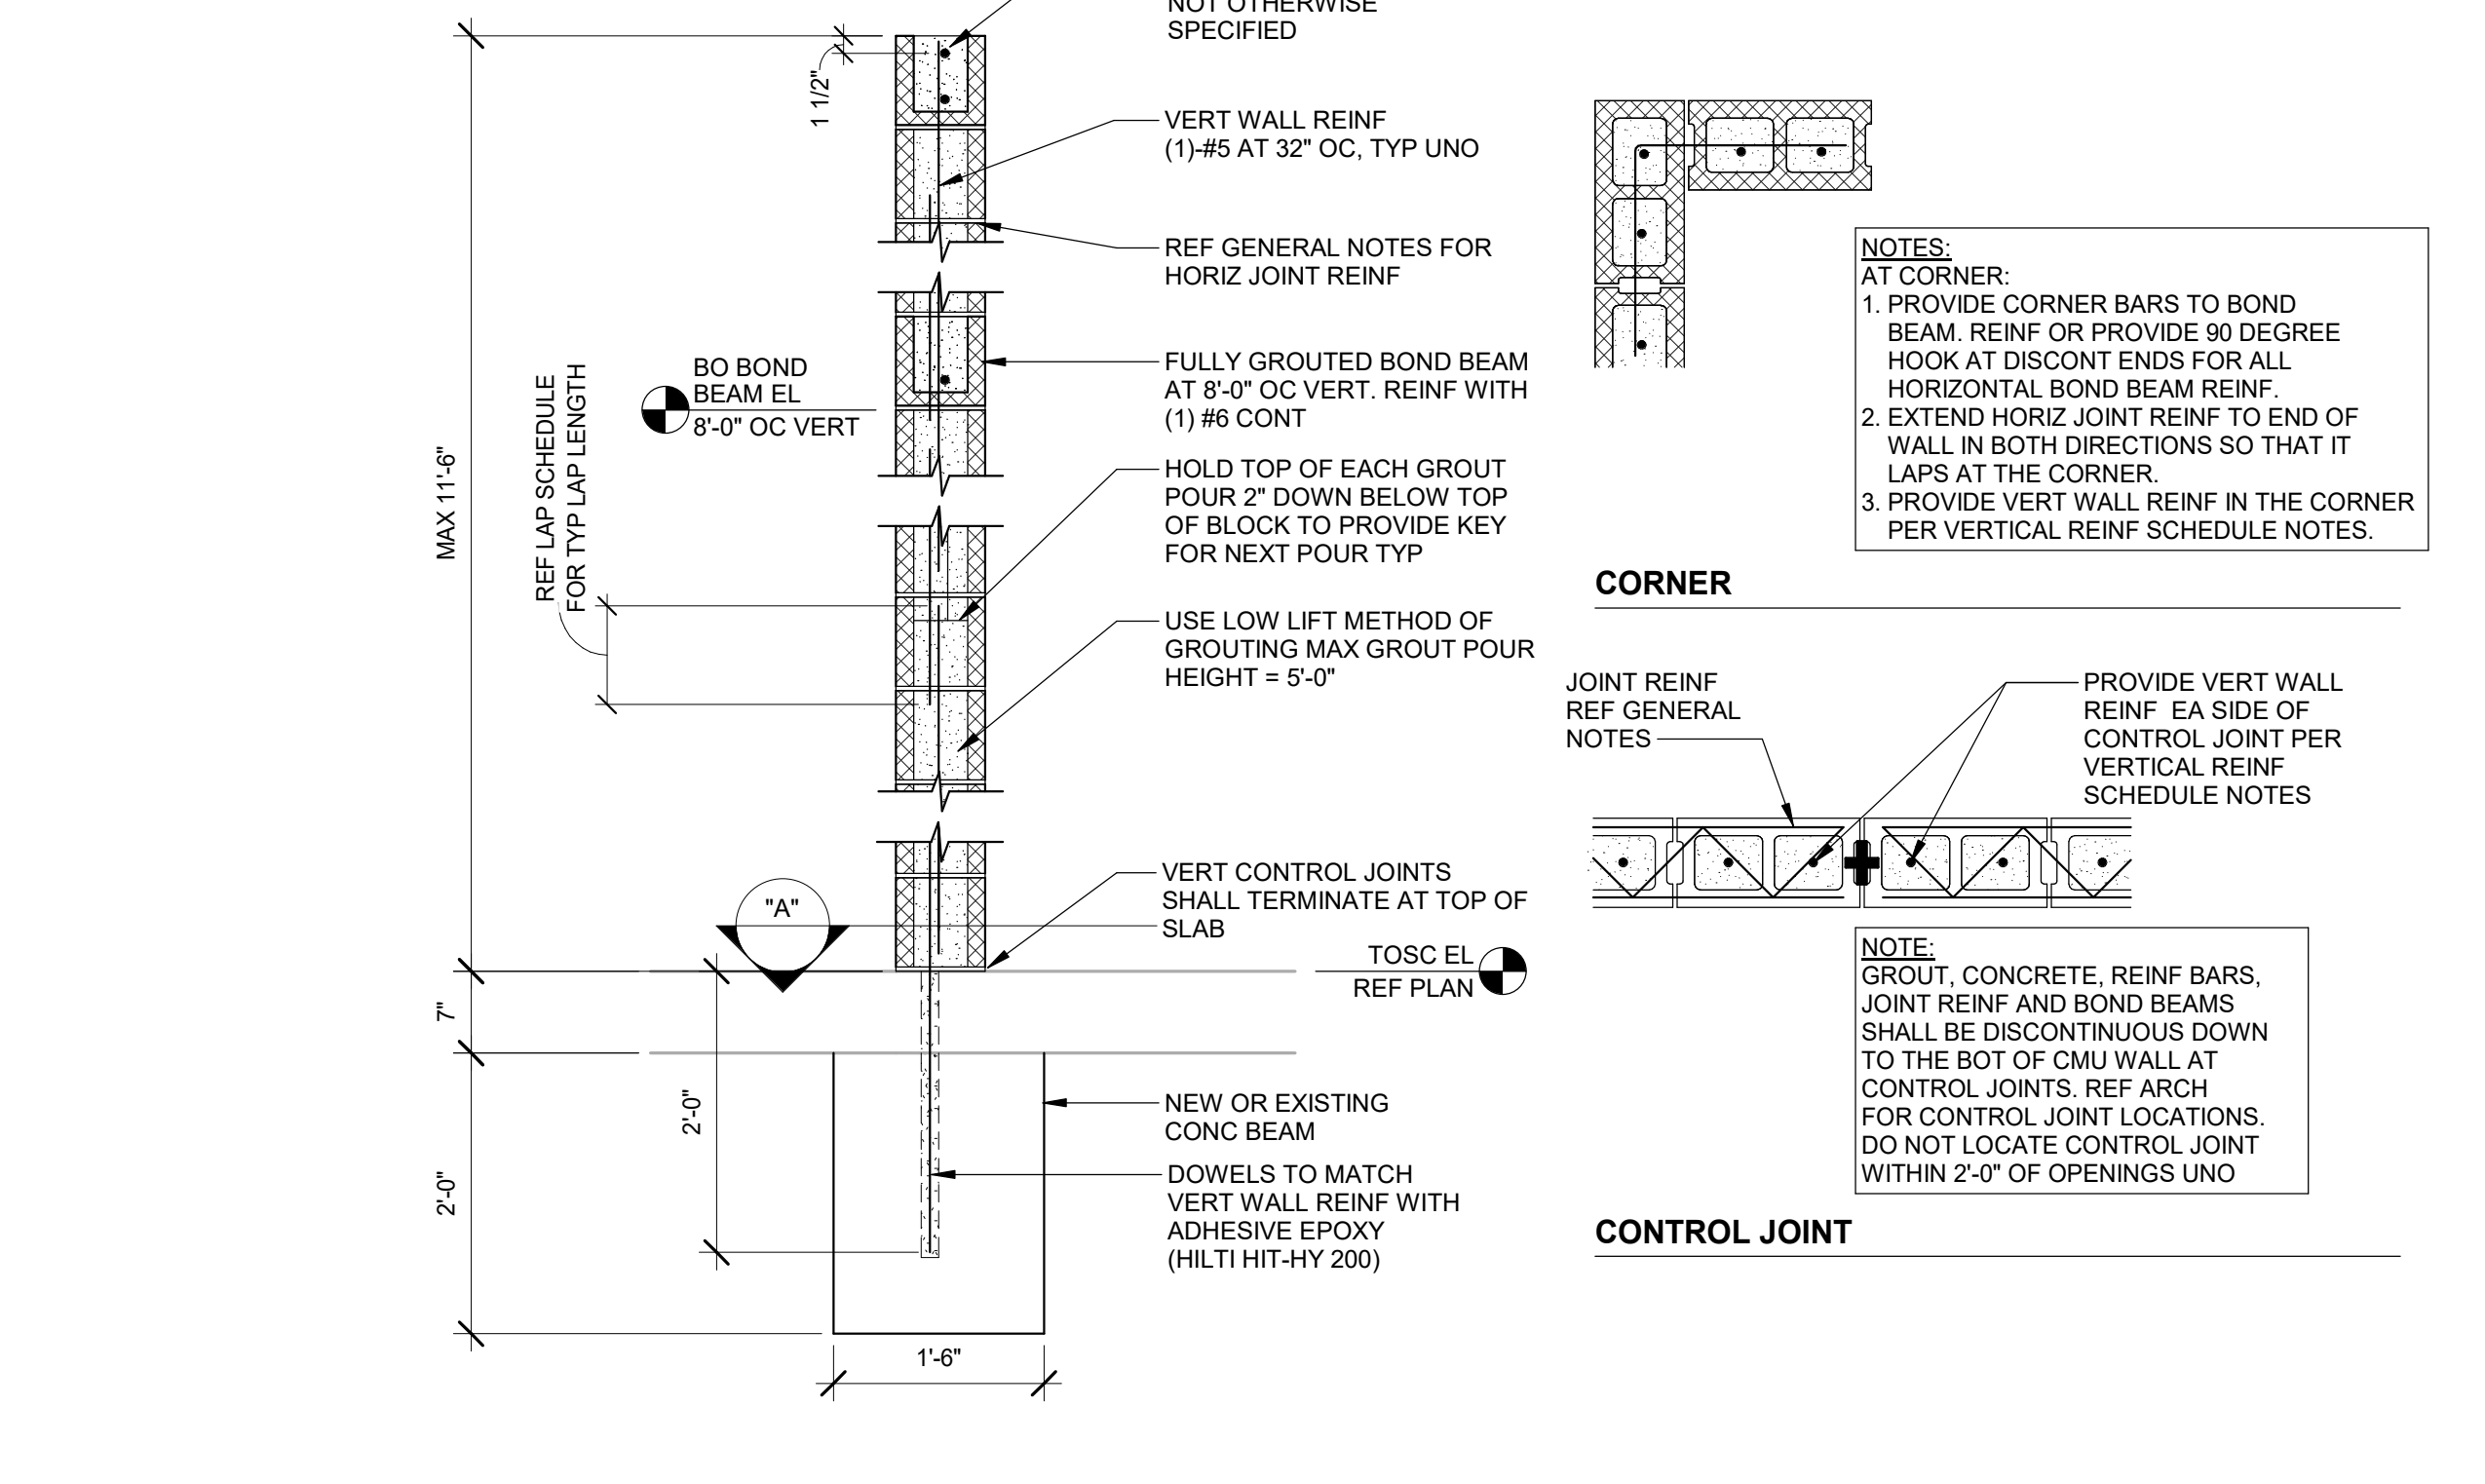

1 TYPICAL CMU WALL REINFORCING DIAGRAM
3/4" = 1'-0"



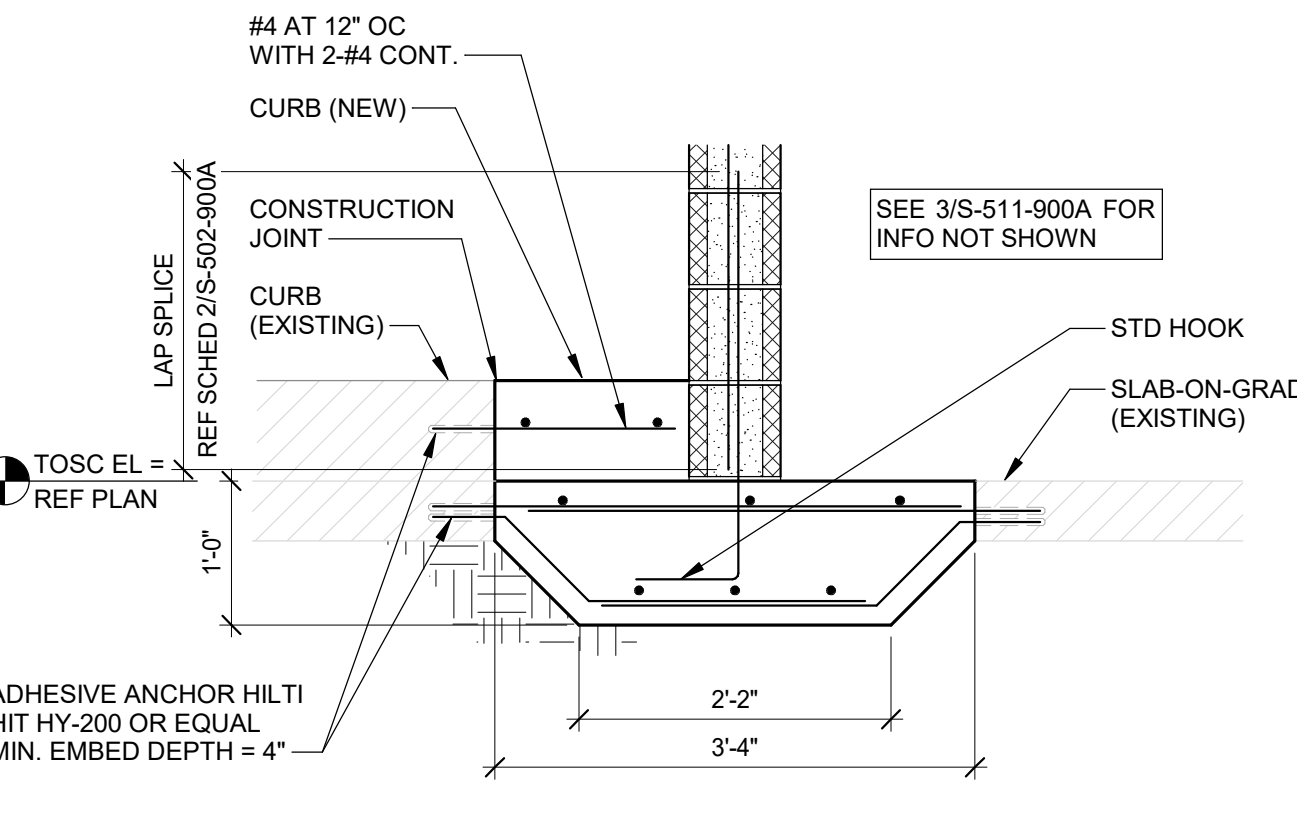


4 CMU ON SLAB-ON-GRADE
3/4" = 1'-0"


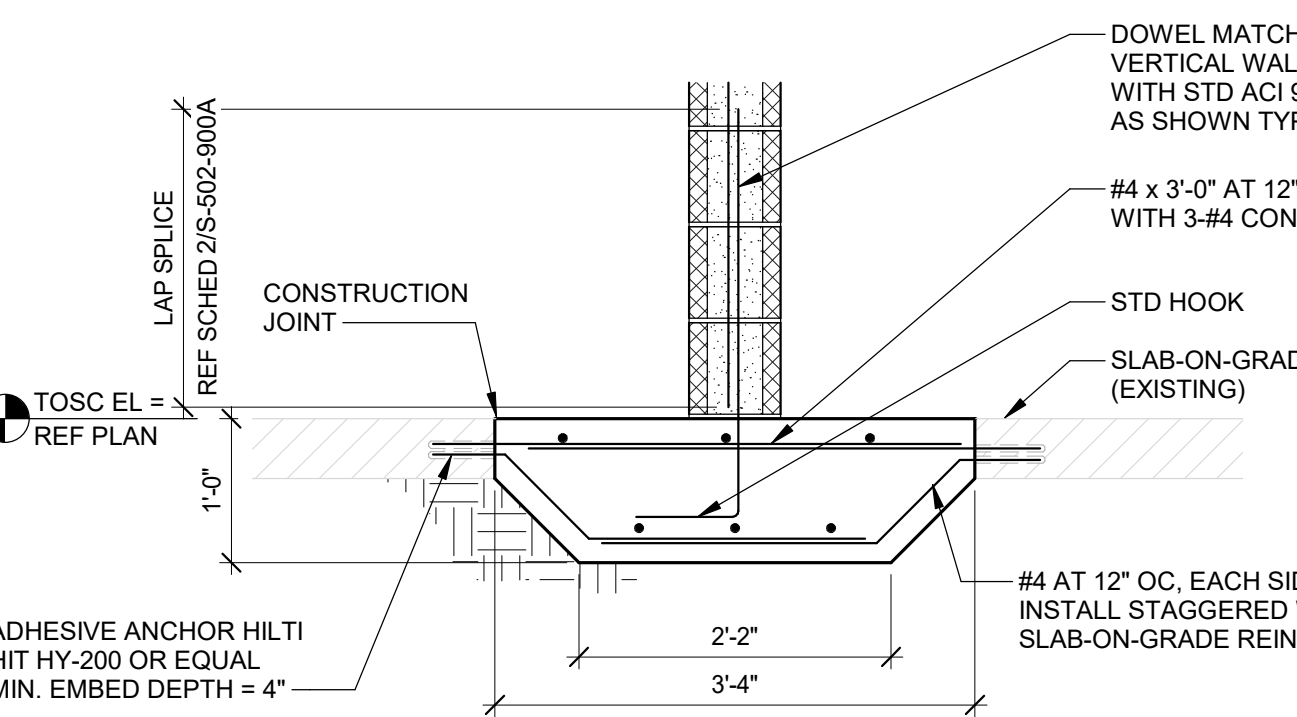


3 CMU ON SLAB-ON-GRADE
3/4" = 1'-0"

NO.	DATE	DESCRIPTION
2023-02-23	30% DESIGN	
2022-01-09	30% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

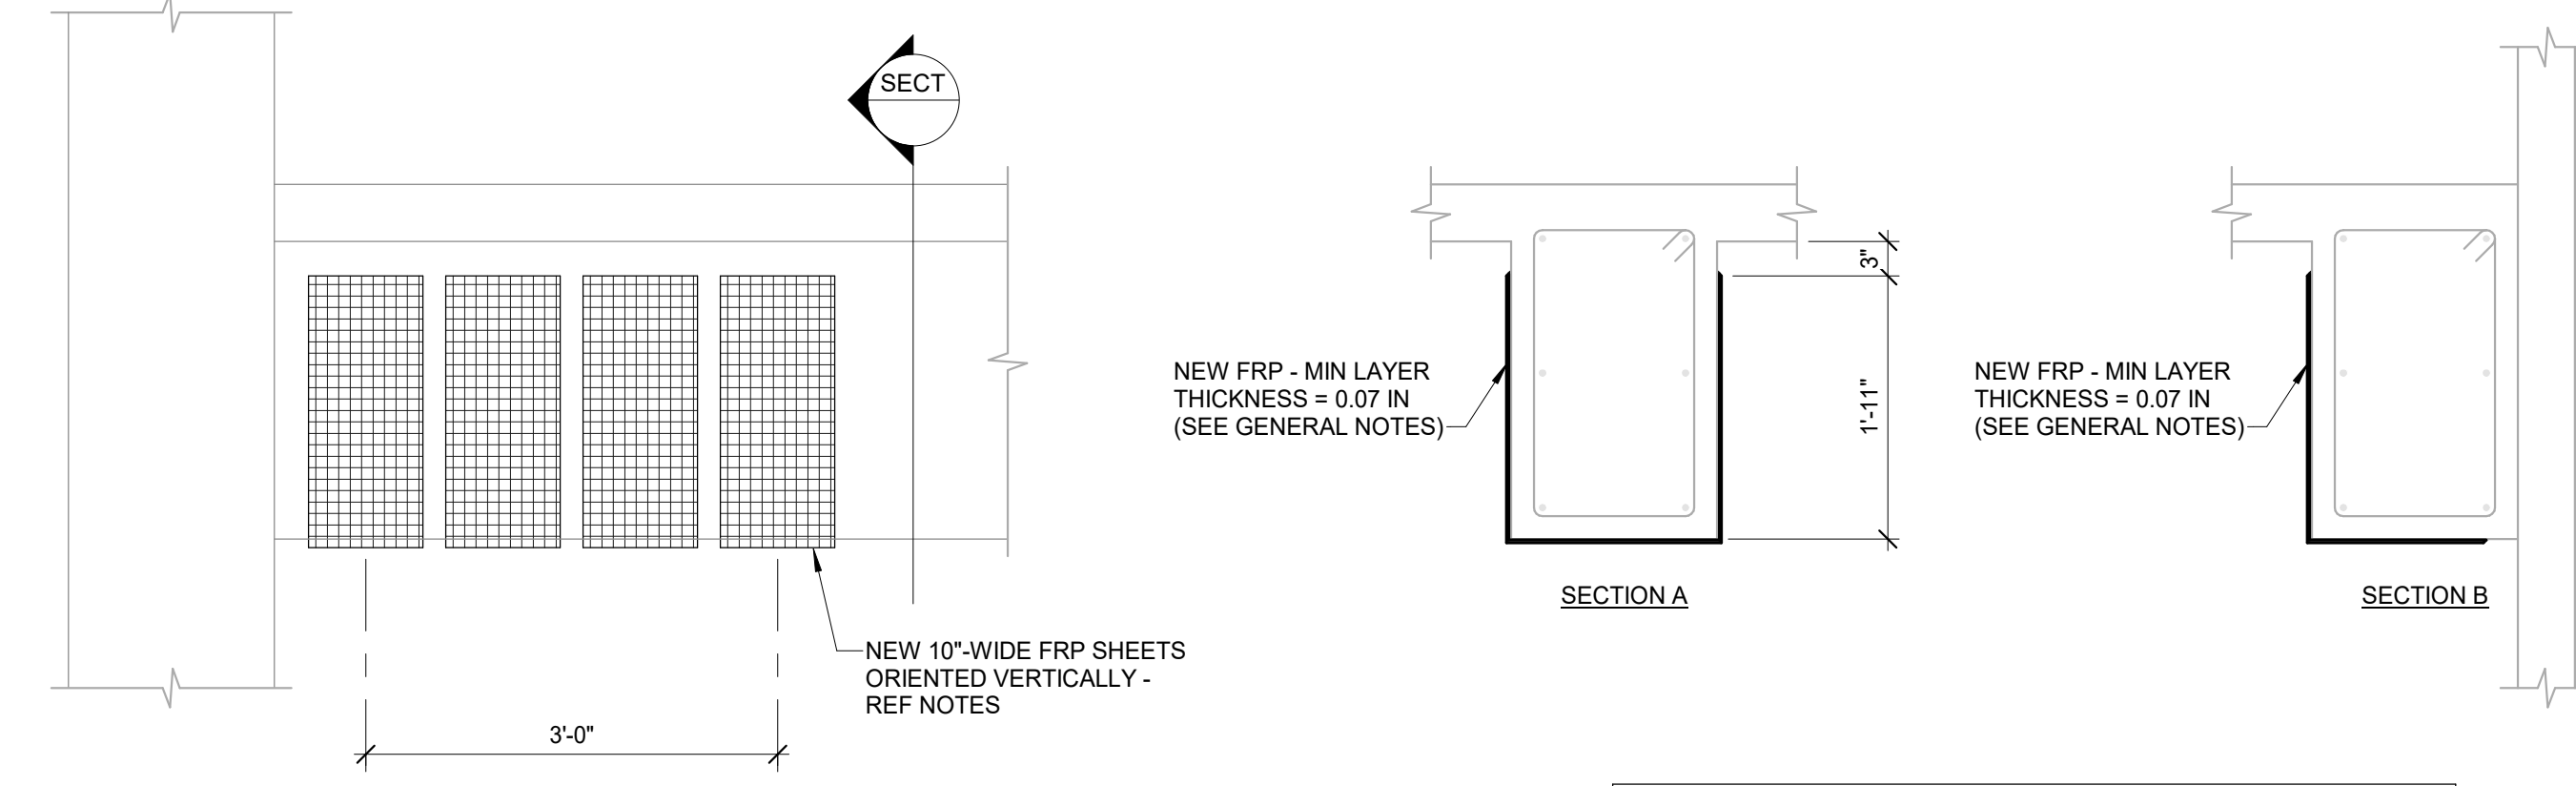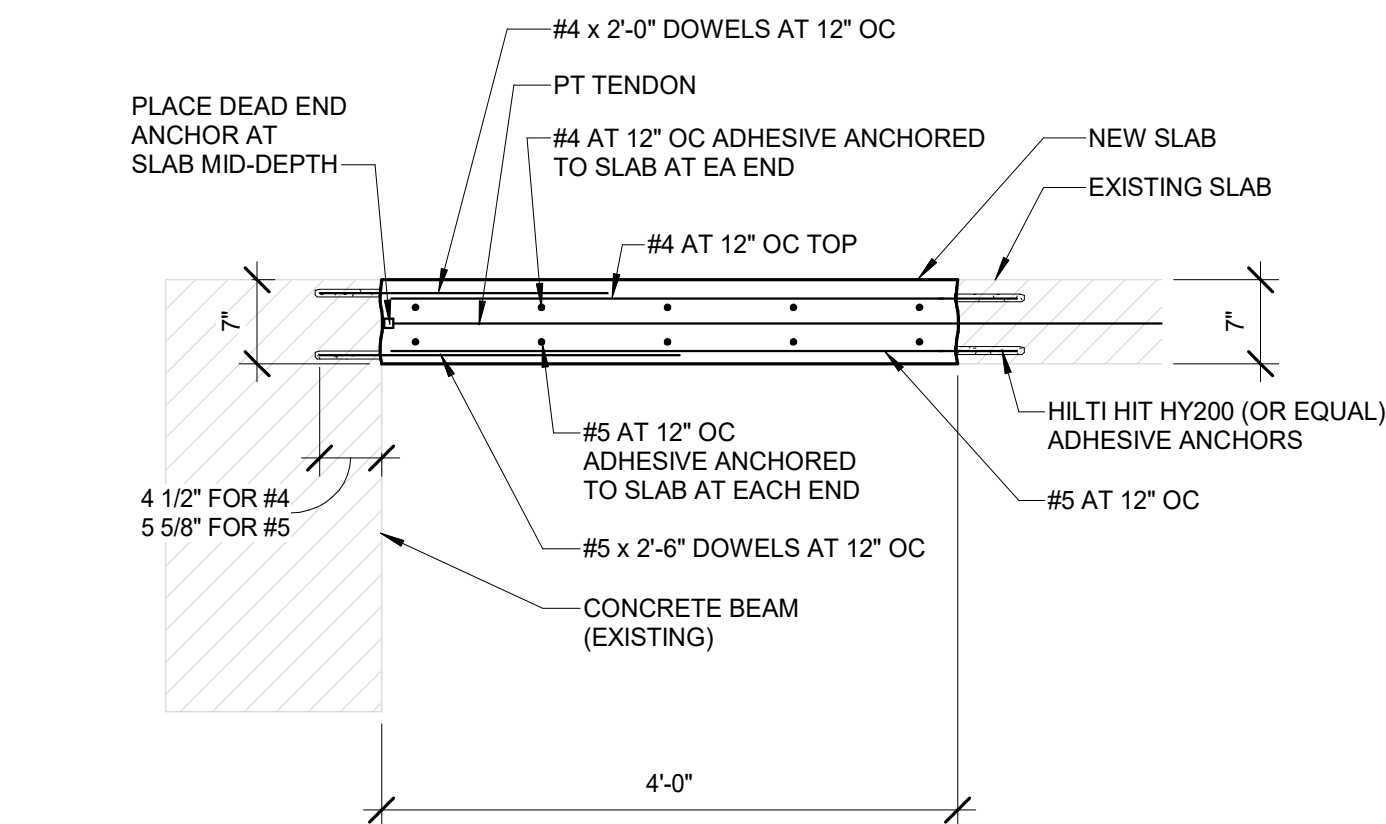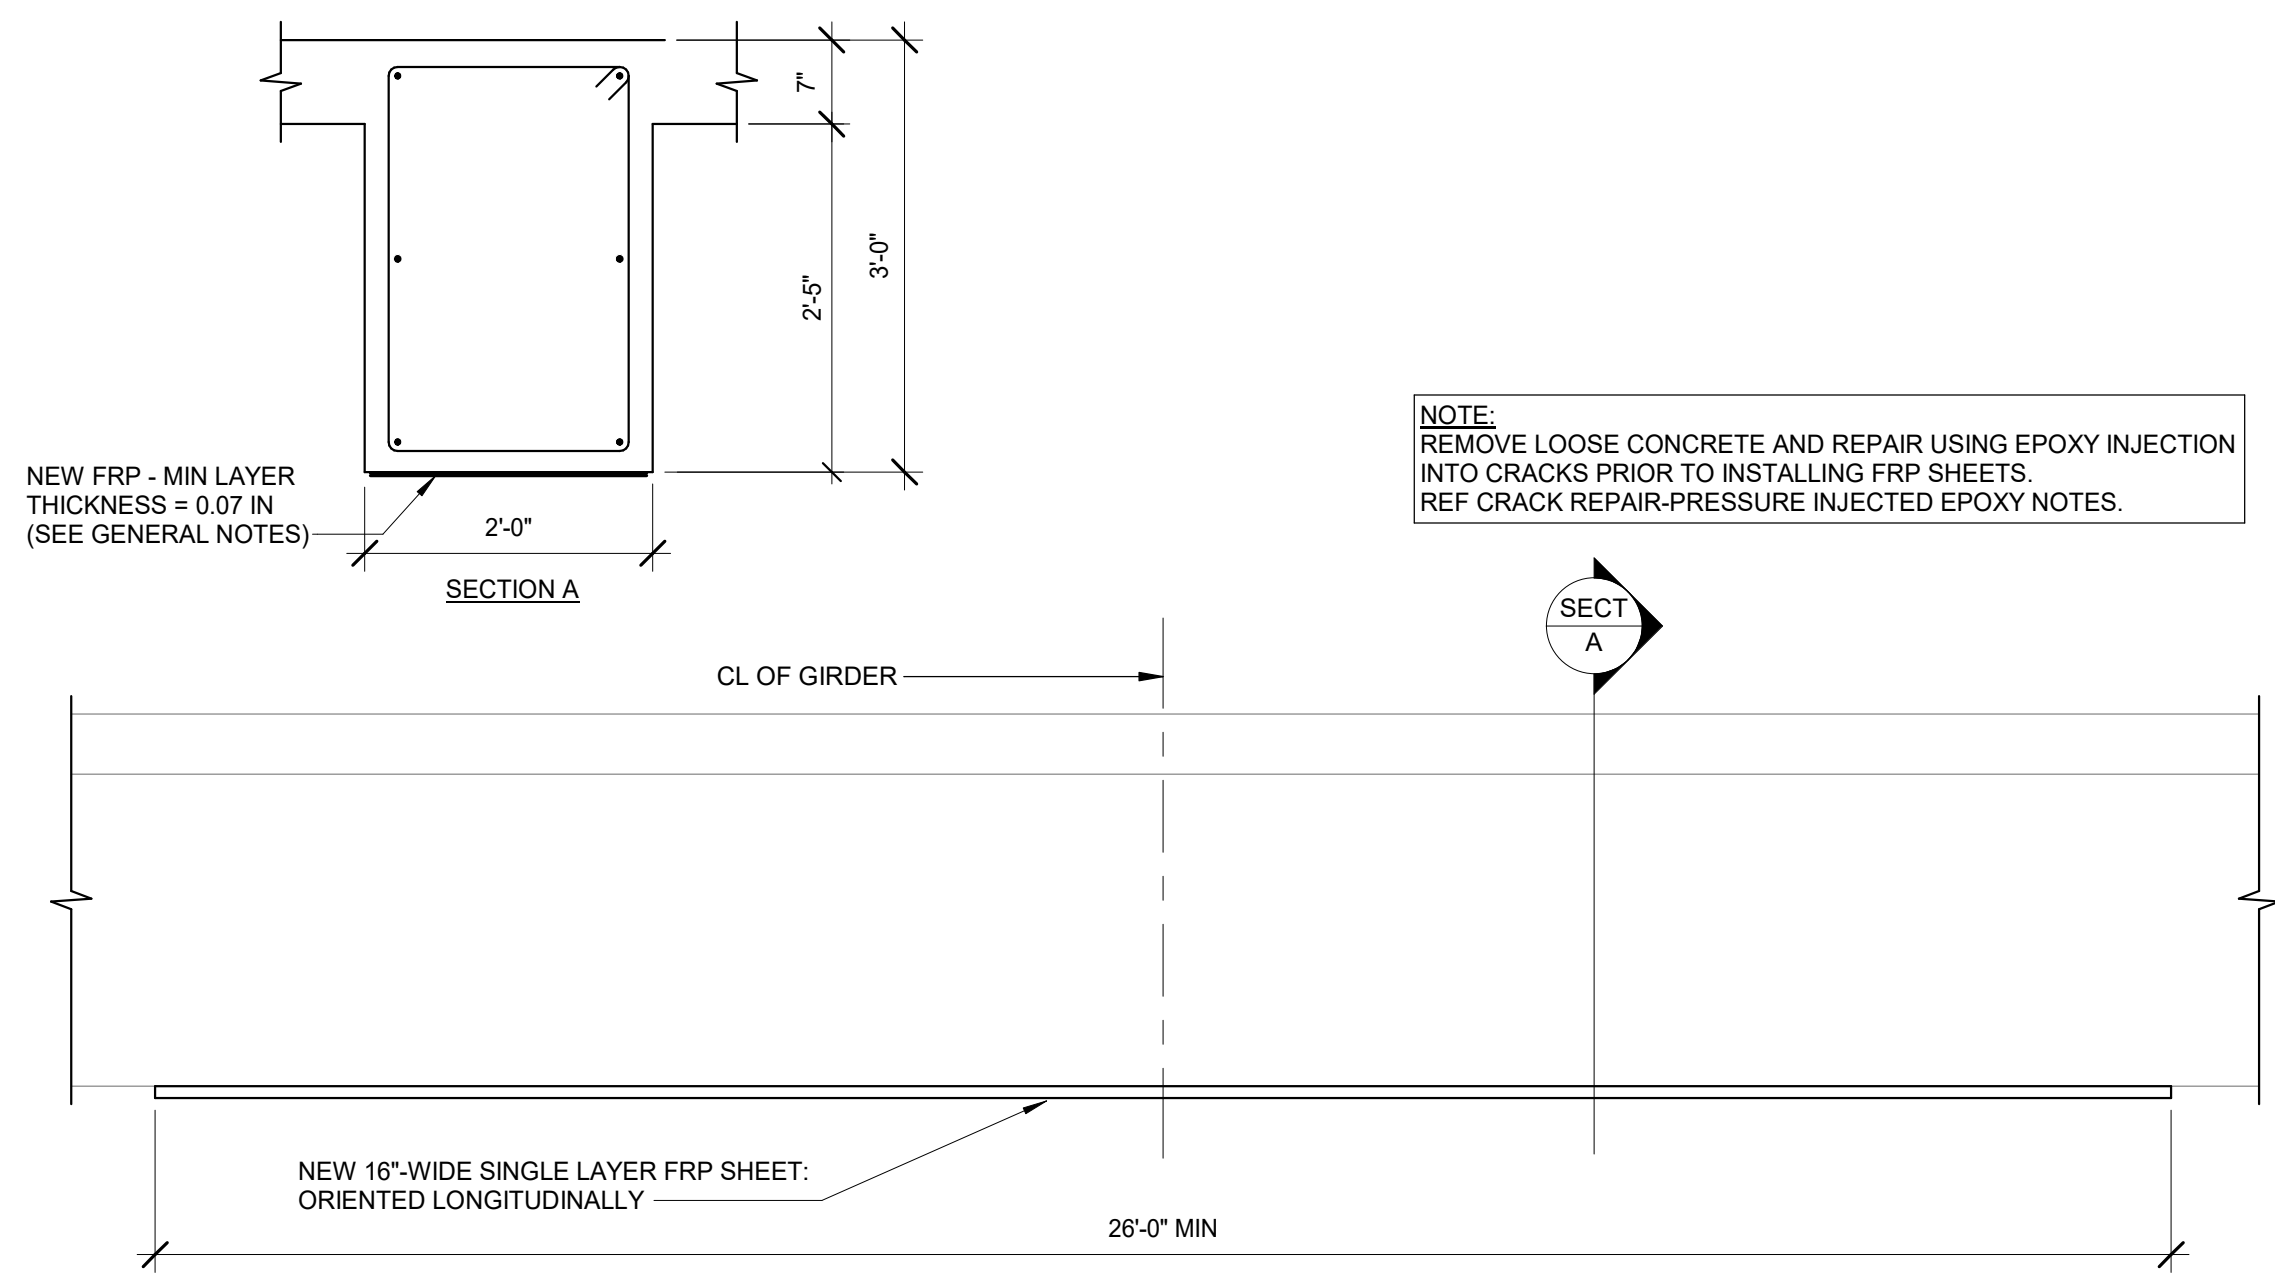








10 CONCRETE BEAM FLEXURAL FRP DETAIL (FOR IT/ELEC. ROOM)
3/4" = 1'-0"

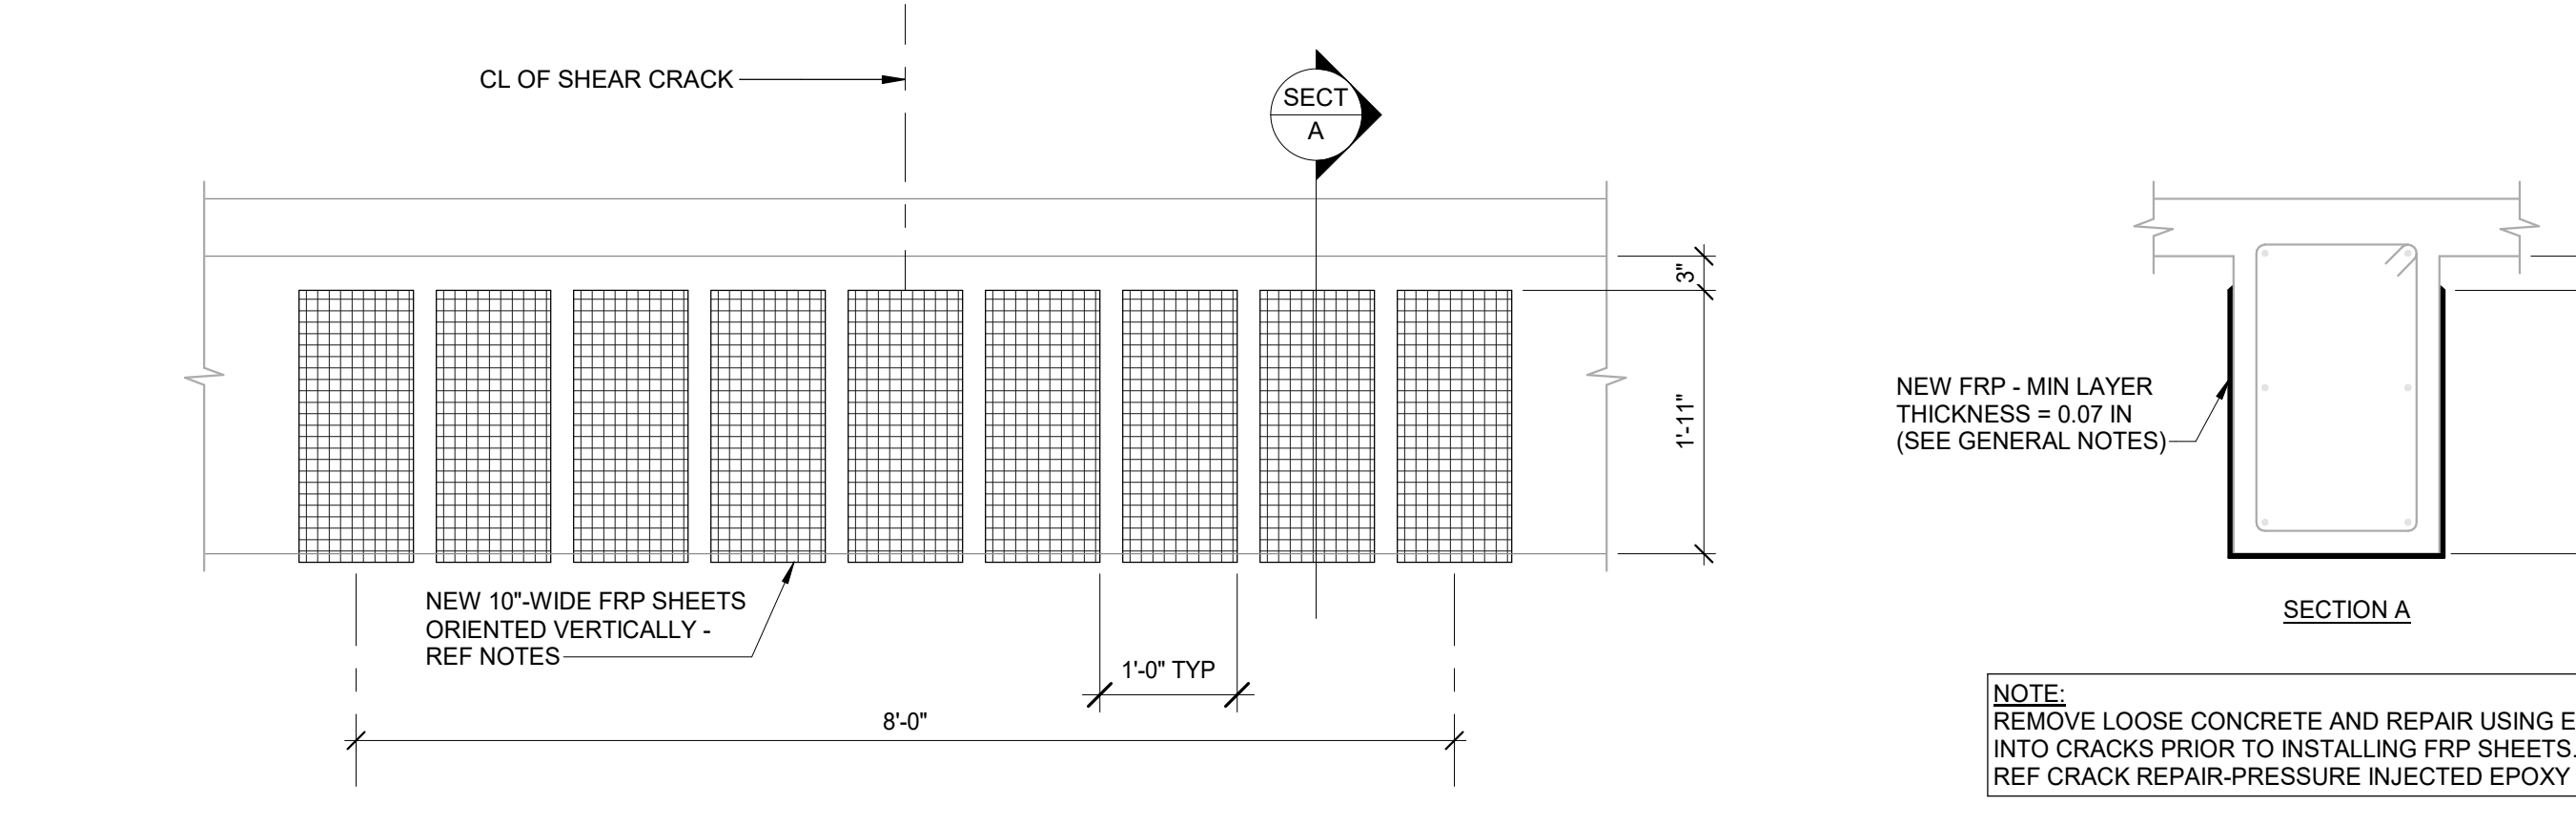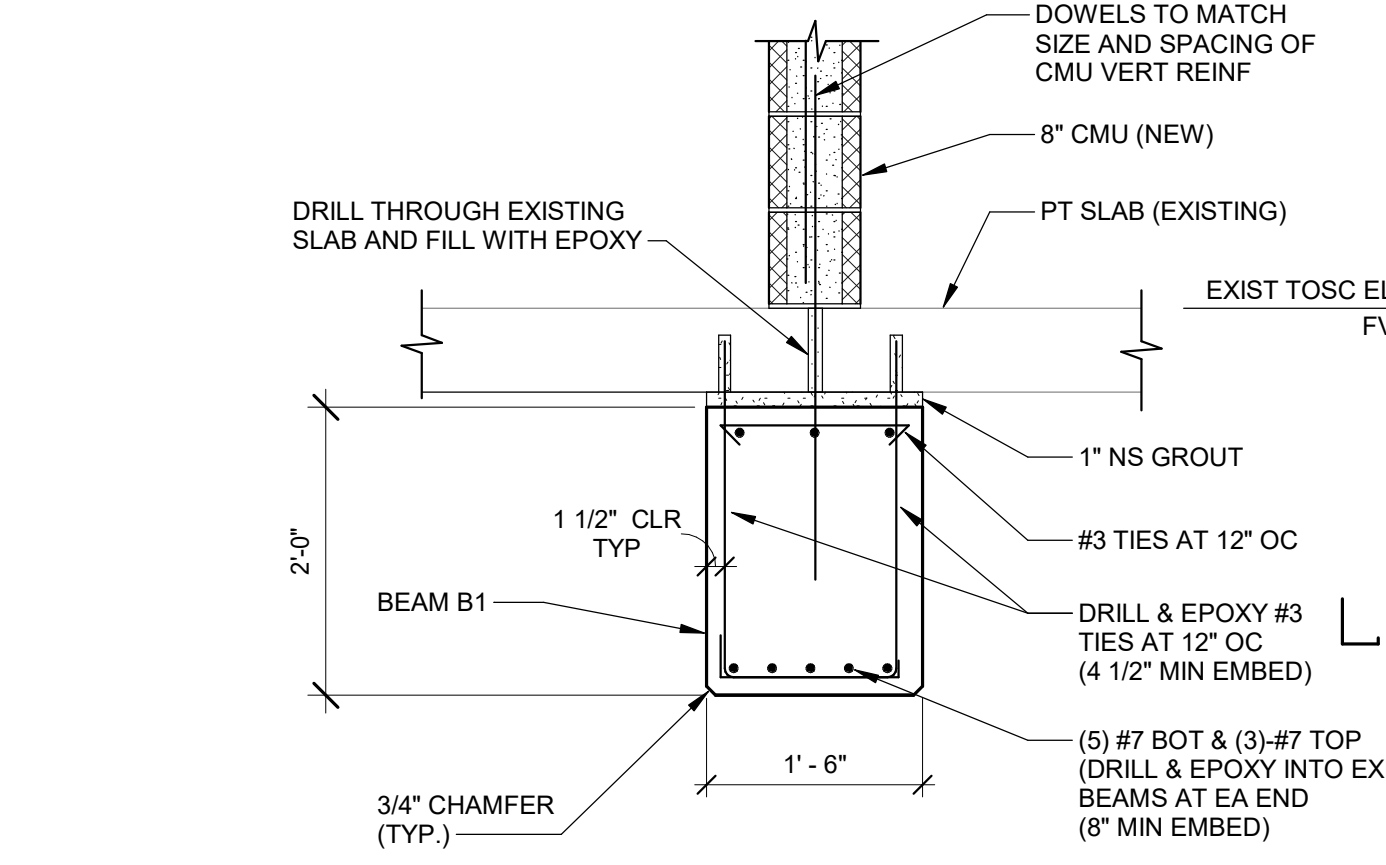


NOTES:
1. BEAM END ANCHOR DRILLS SHALL AVOID BEAM EXISTING PT STRAND AND MILD-REINFORCING. SEE 2/S521-900A
2. INSTALL CONCRETE BEAM PRIOR TO PLACING CMU WALL.


9 CONCRETE BEAM B1 DETAIL (FOR IT/ELEC ROOM)
3/4" = 1'-0"

10 CONCRETE BEAM FLEXURAL FRP DETAIL (FOR IT/ELEC. ROOM)
3/4" = 1'-0"

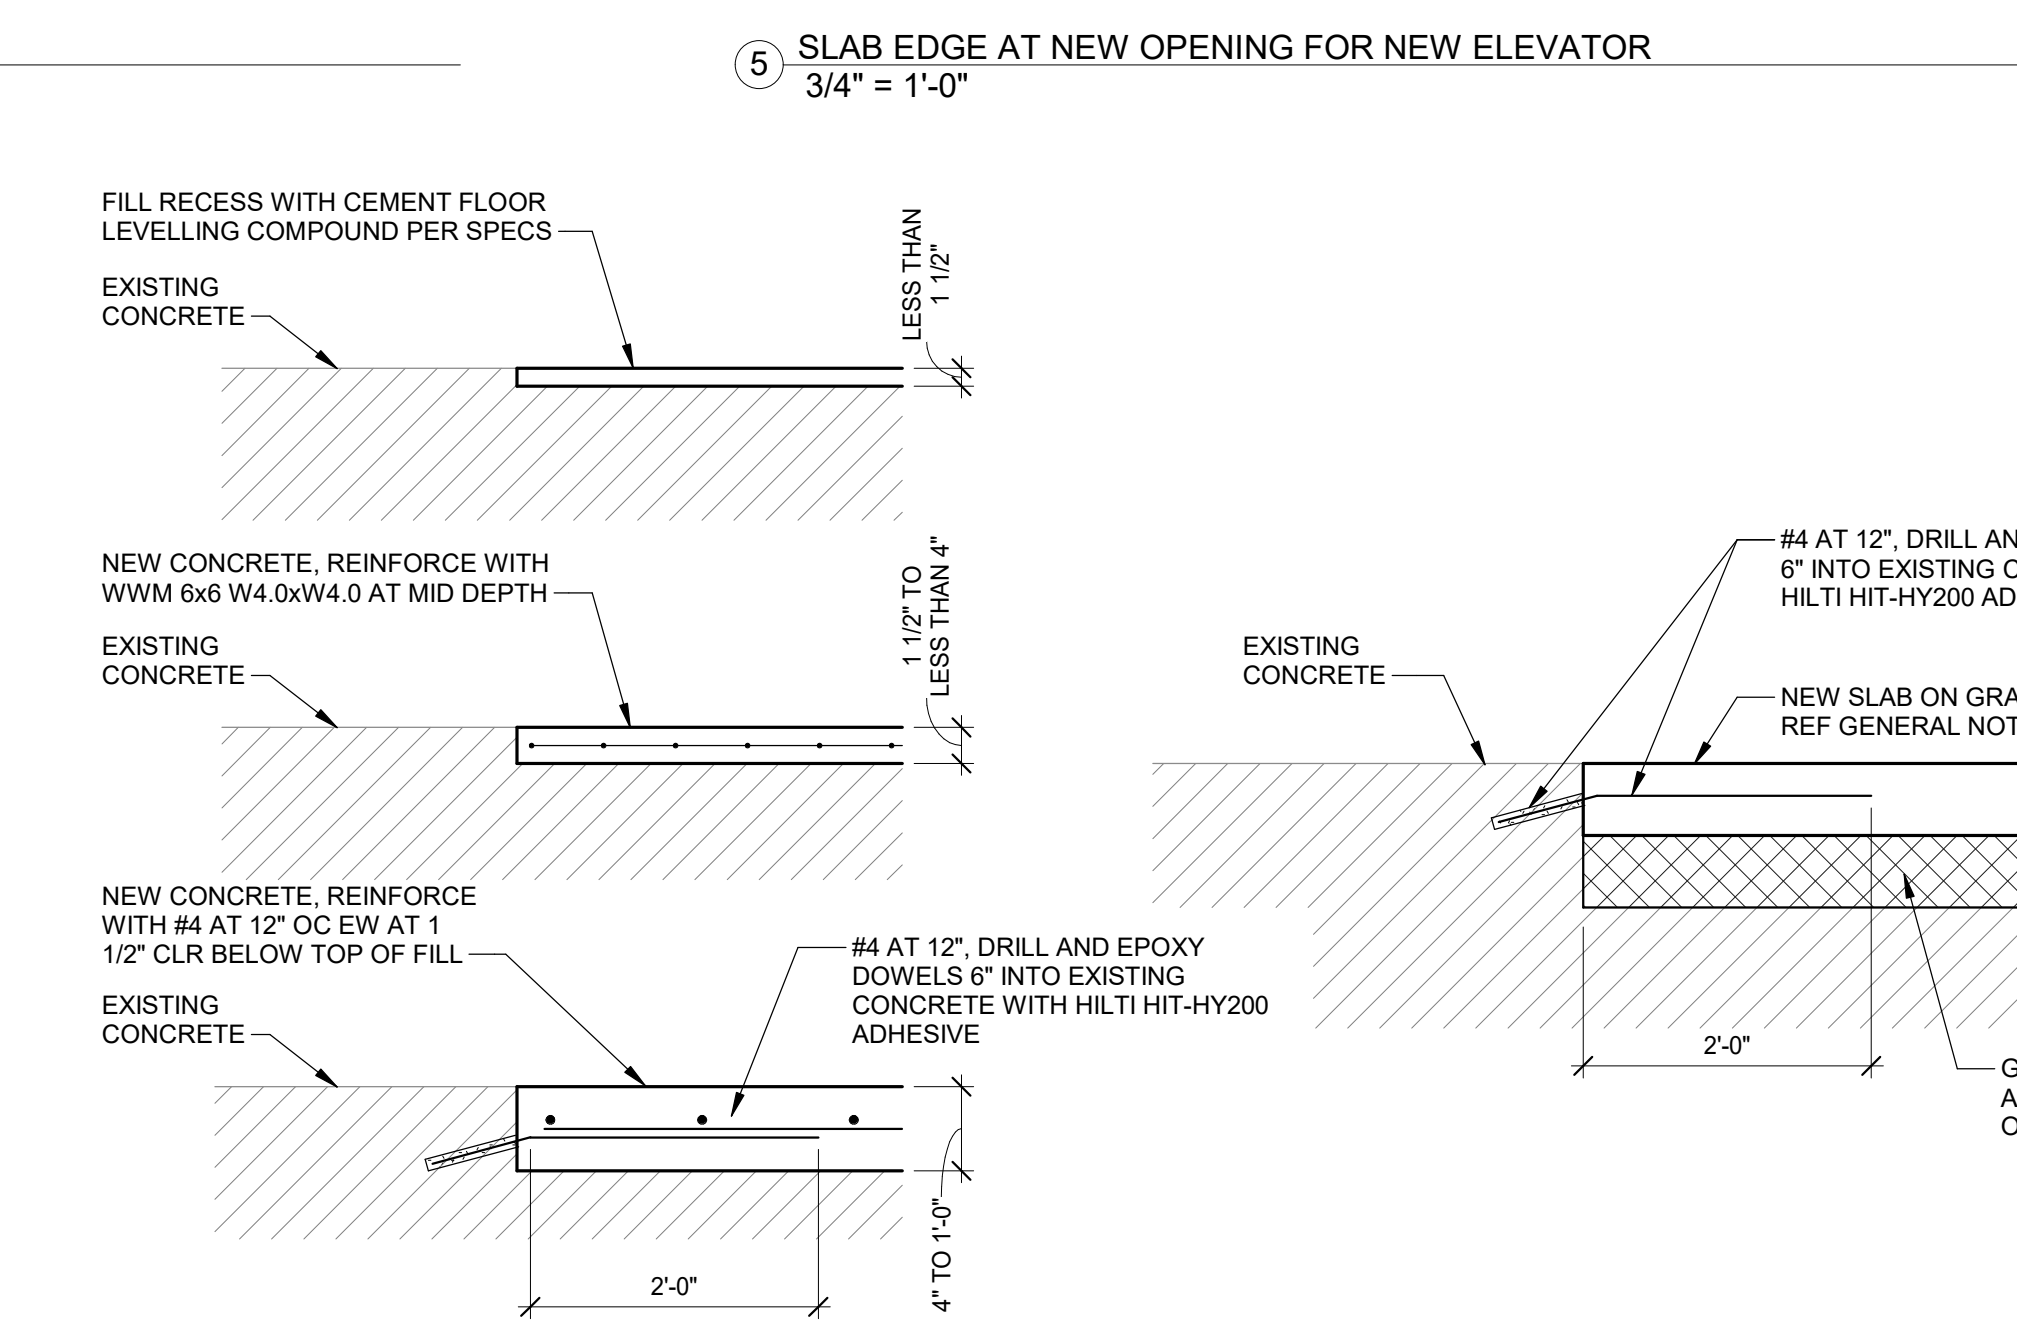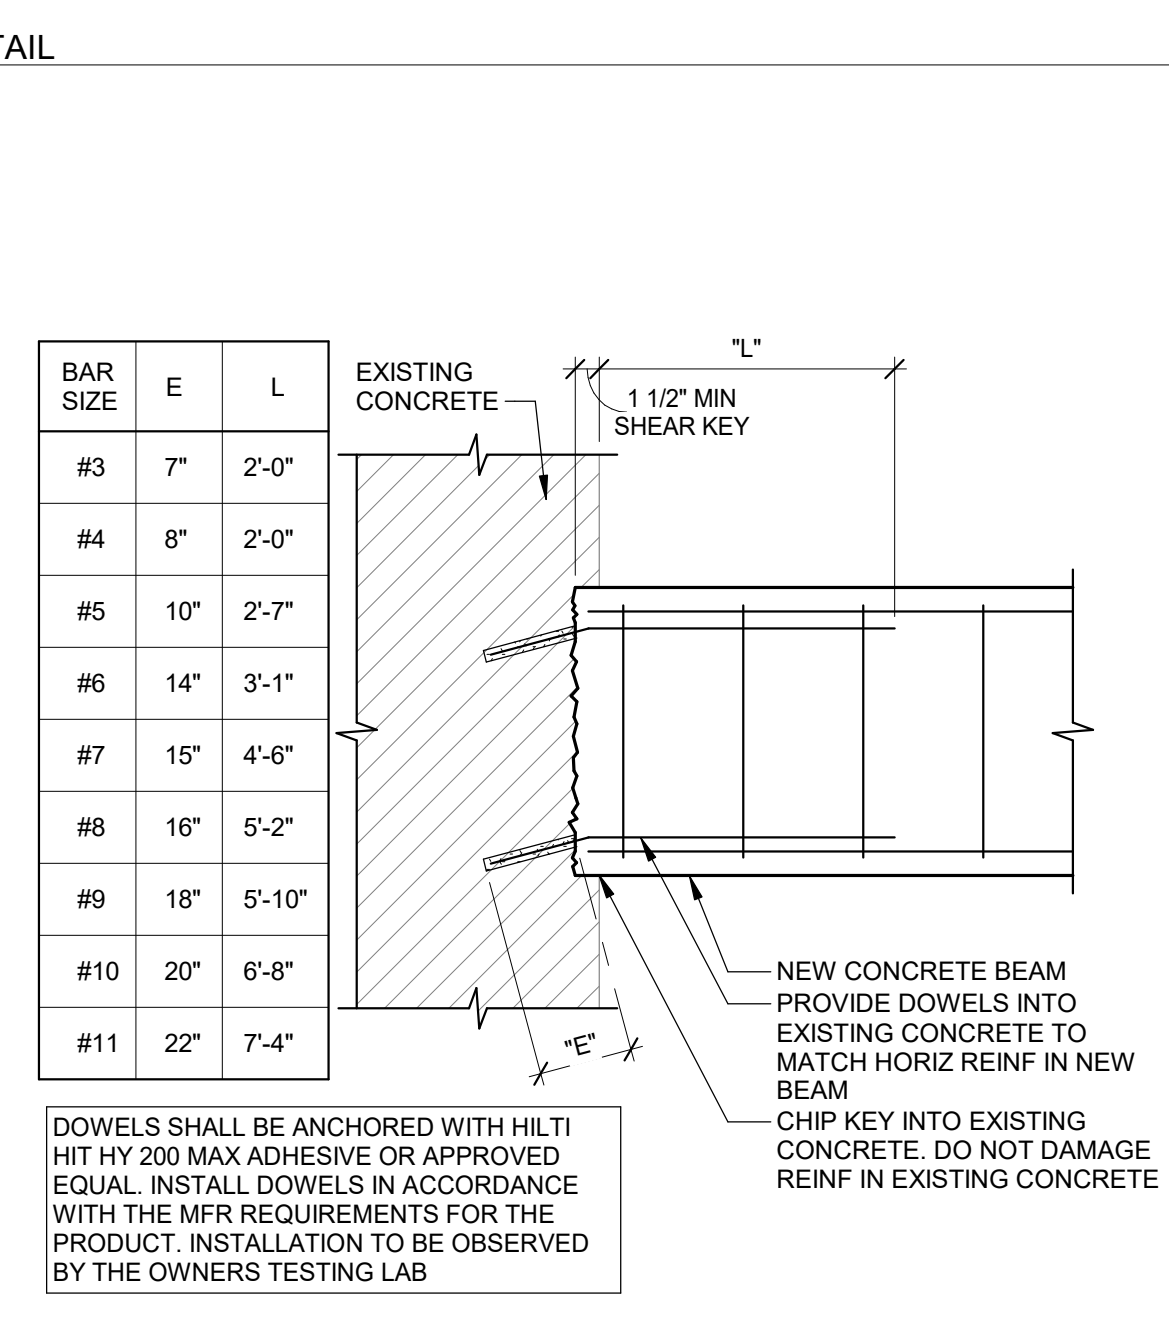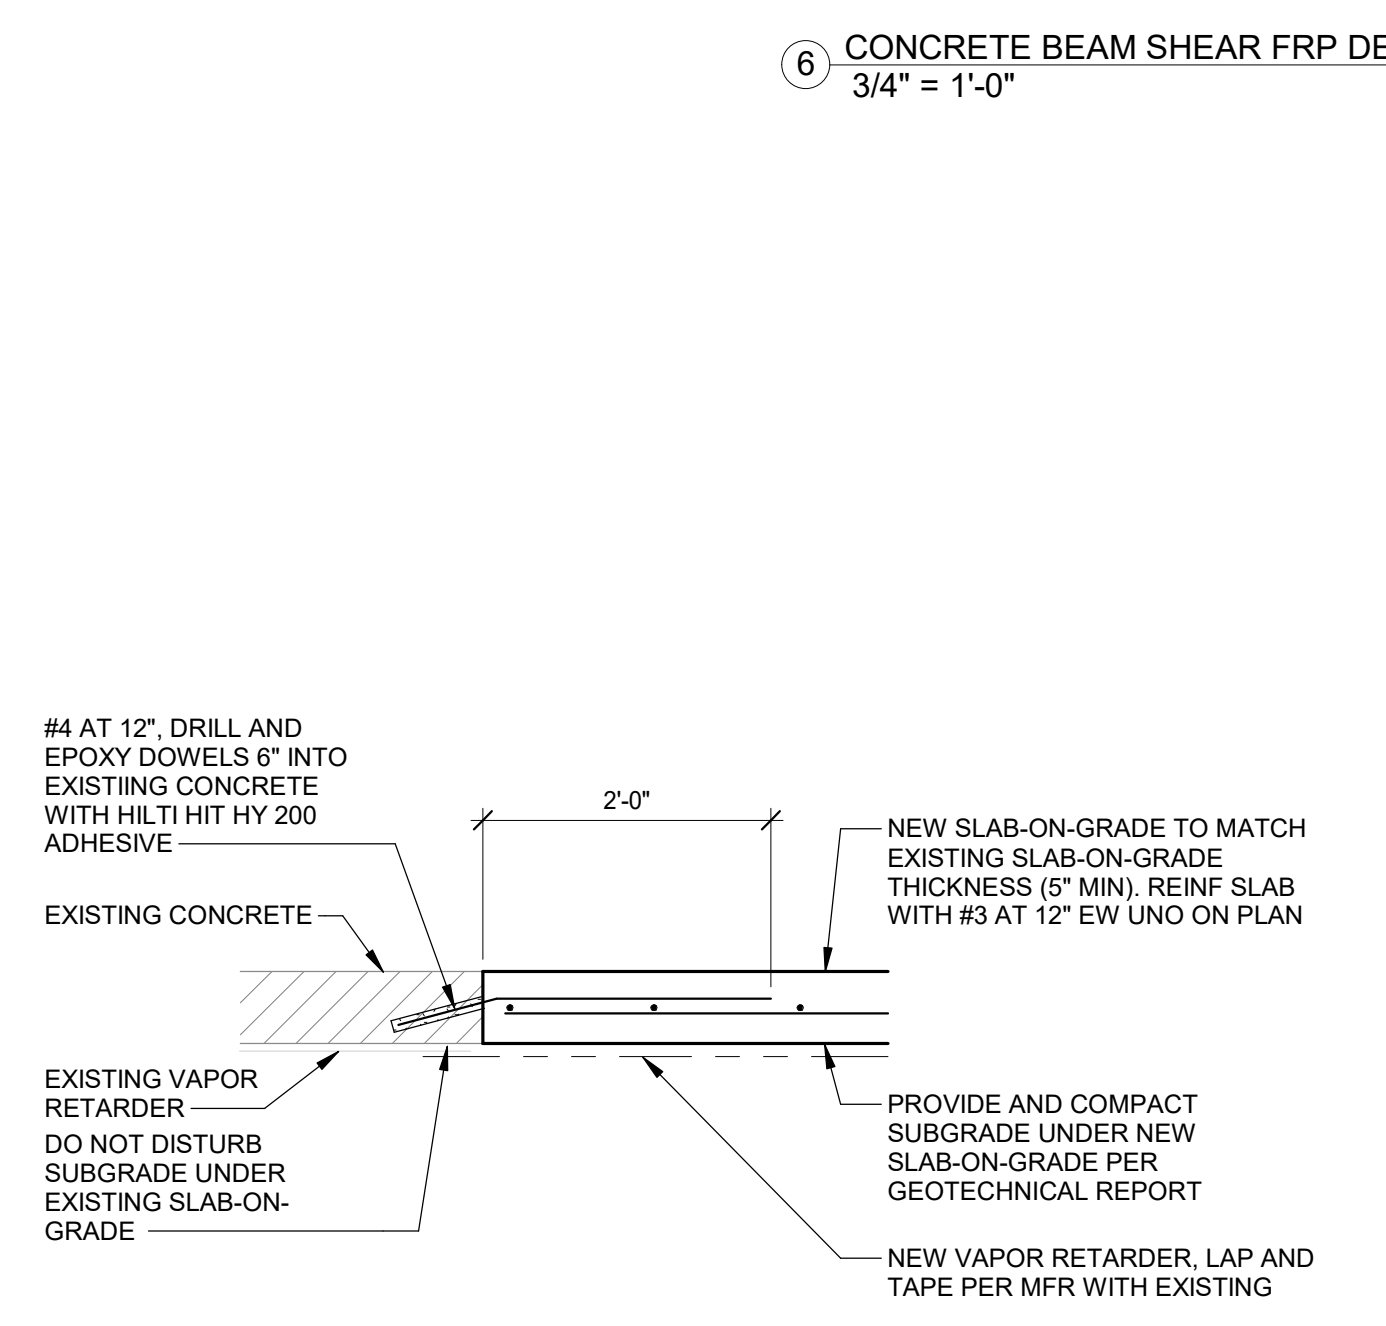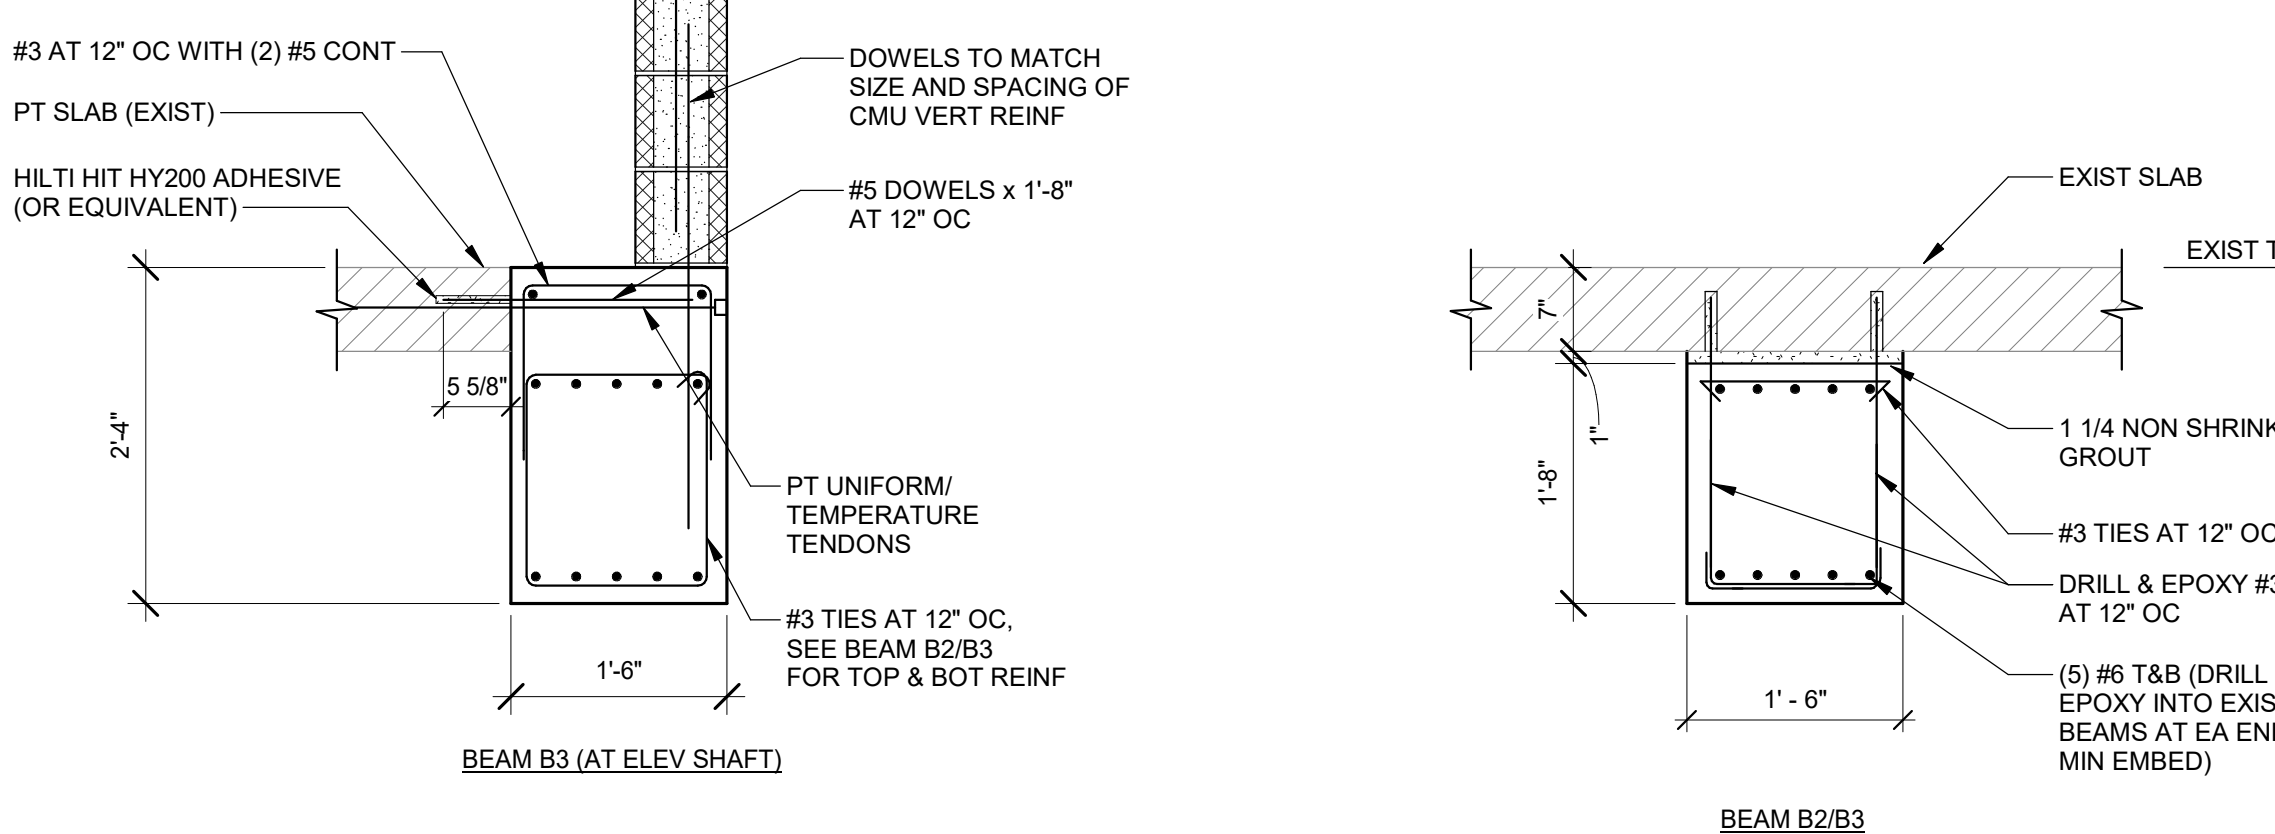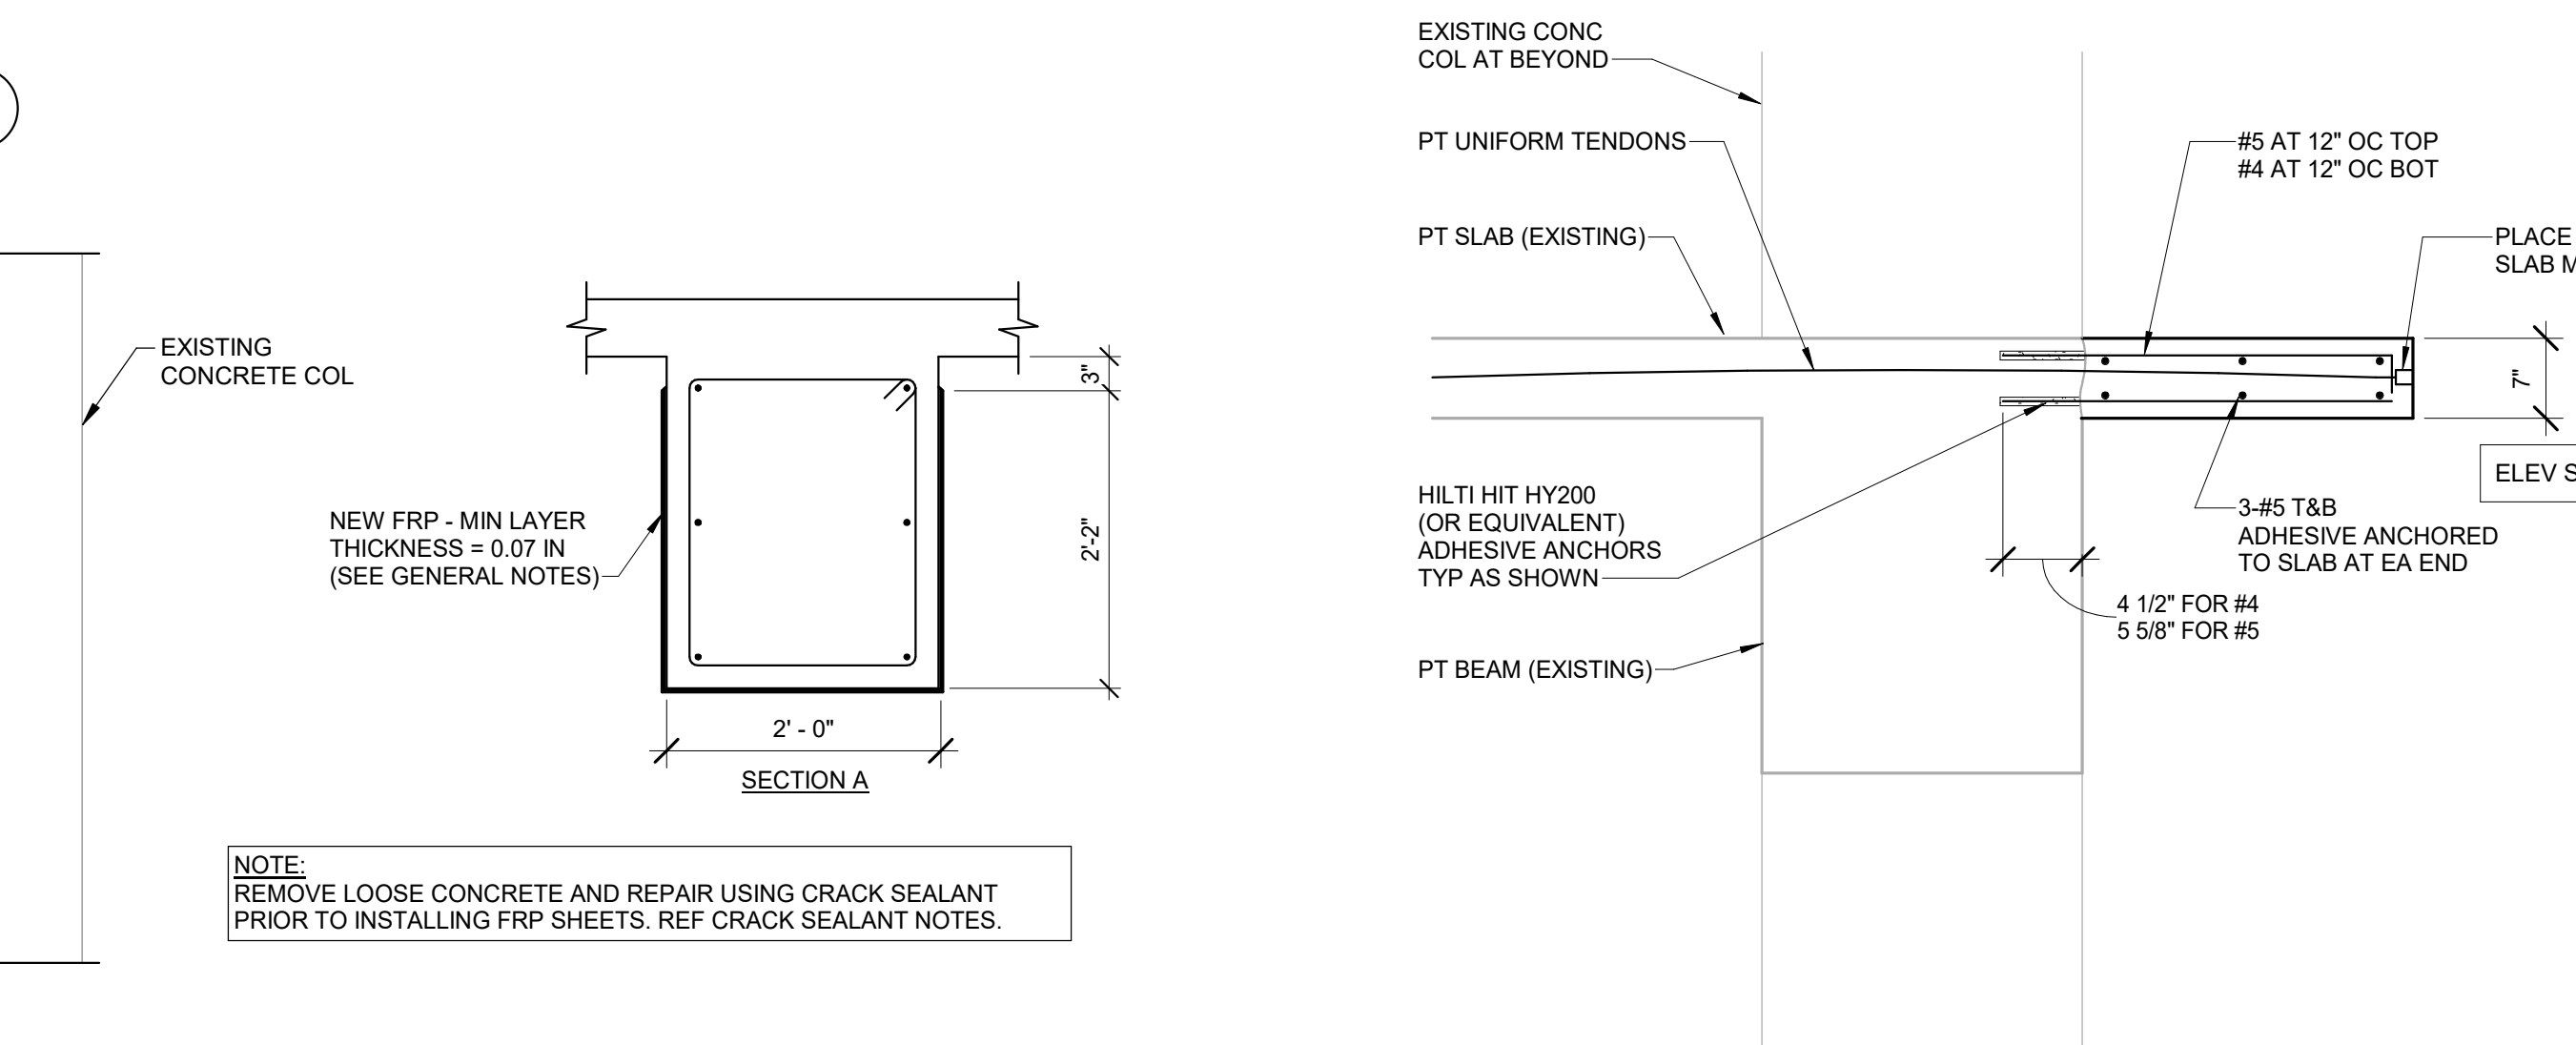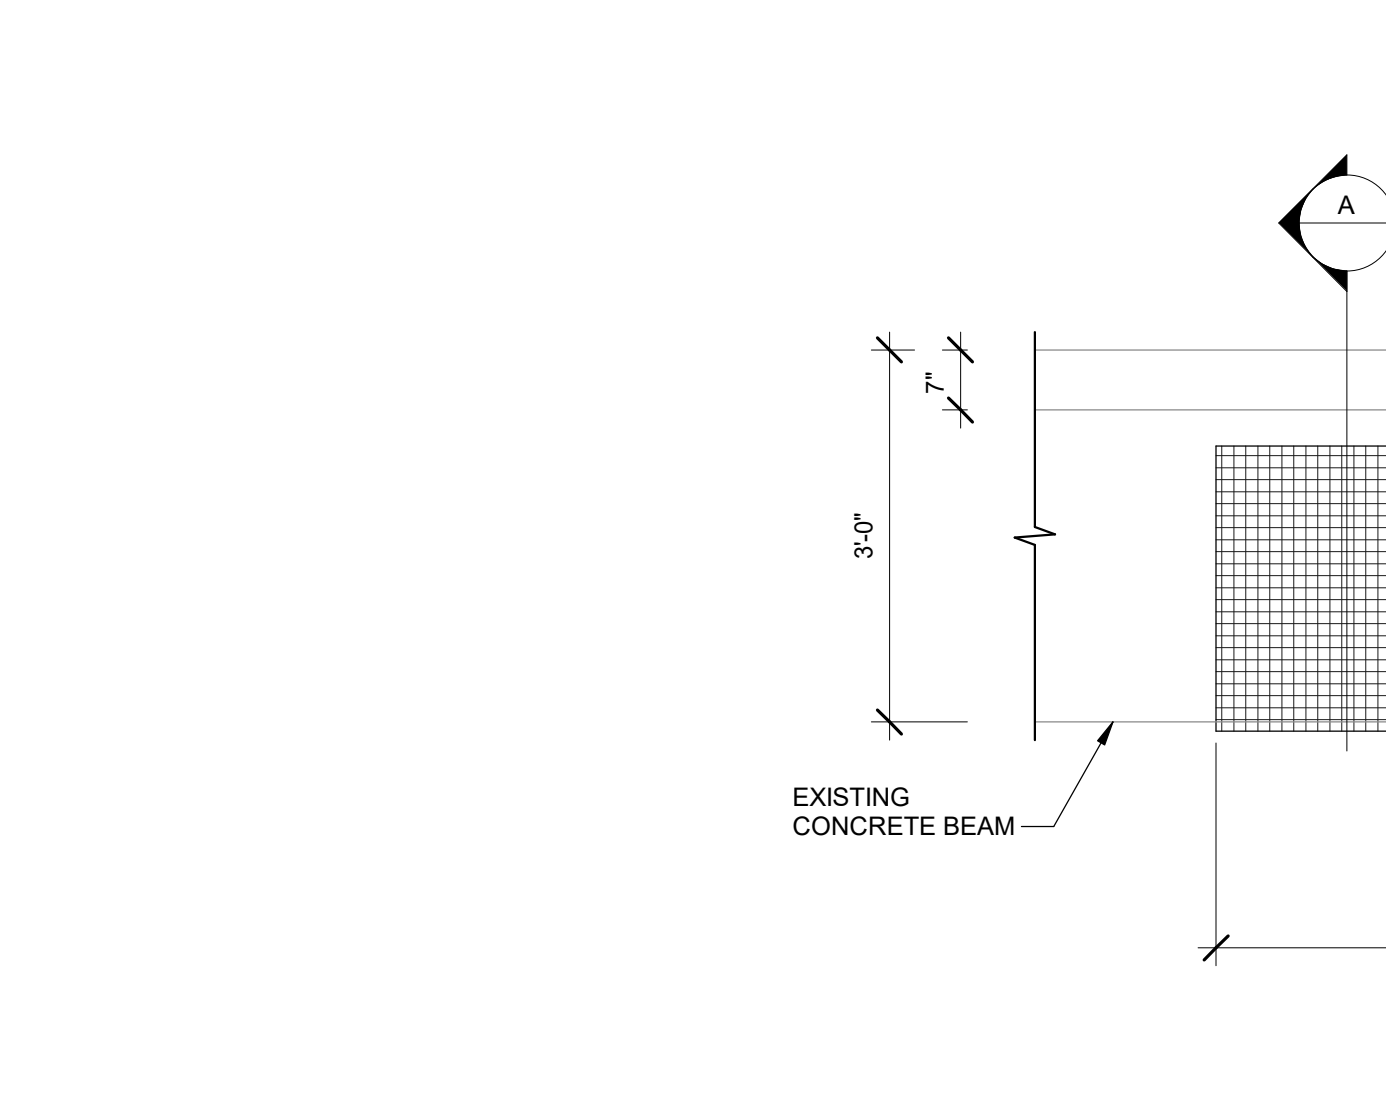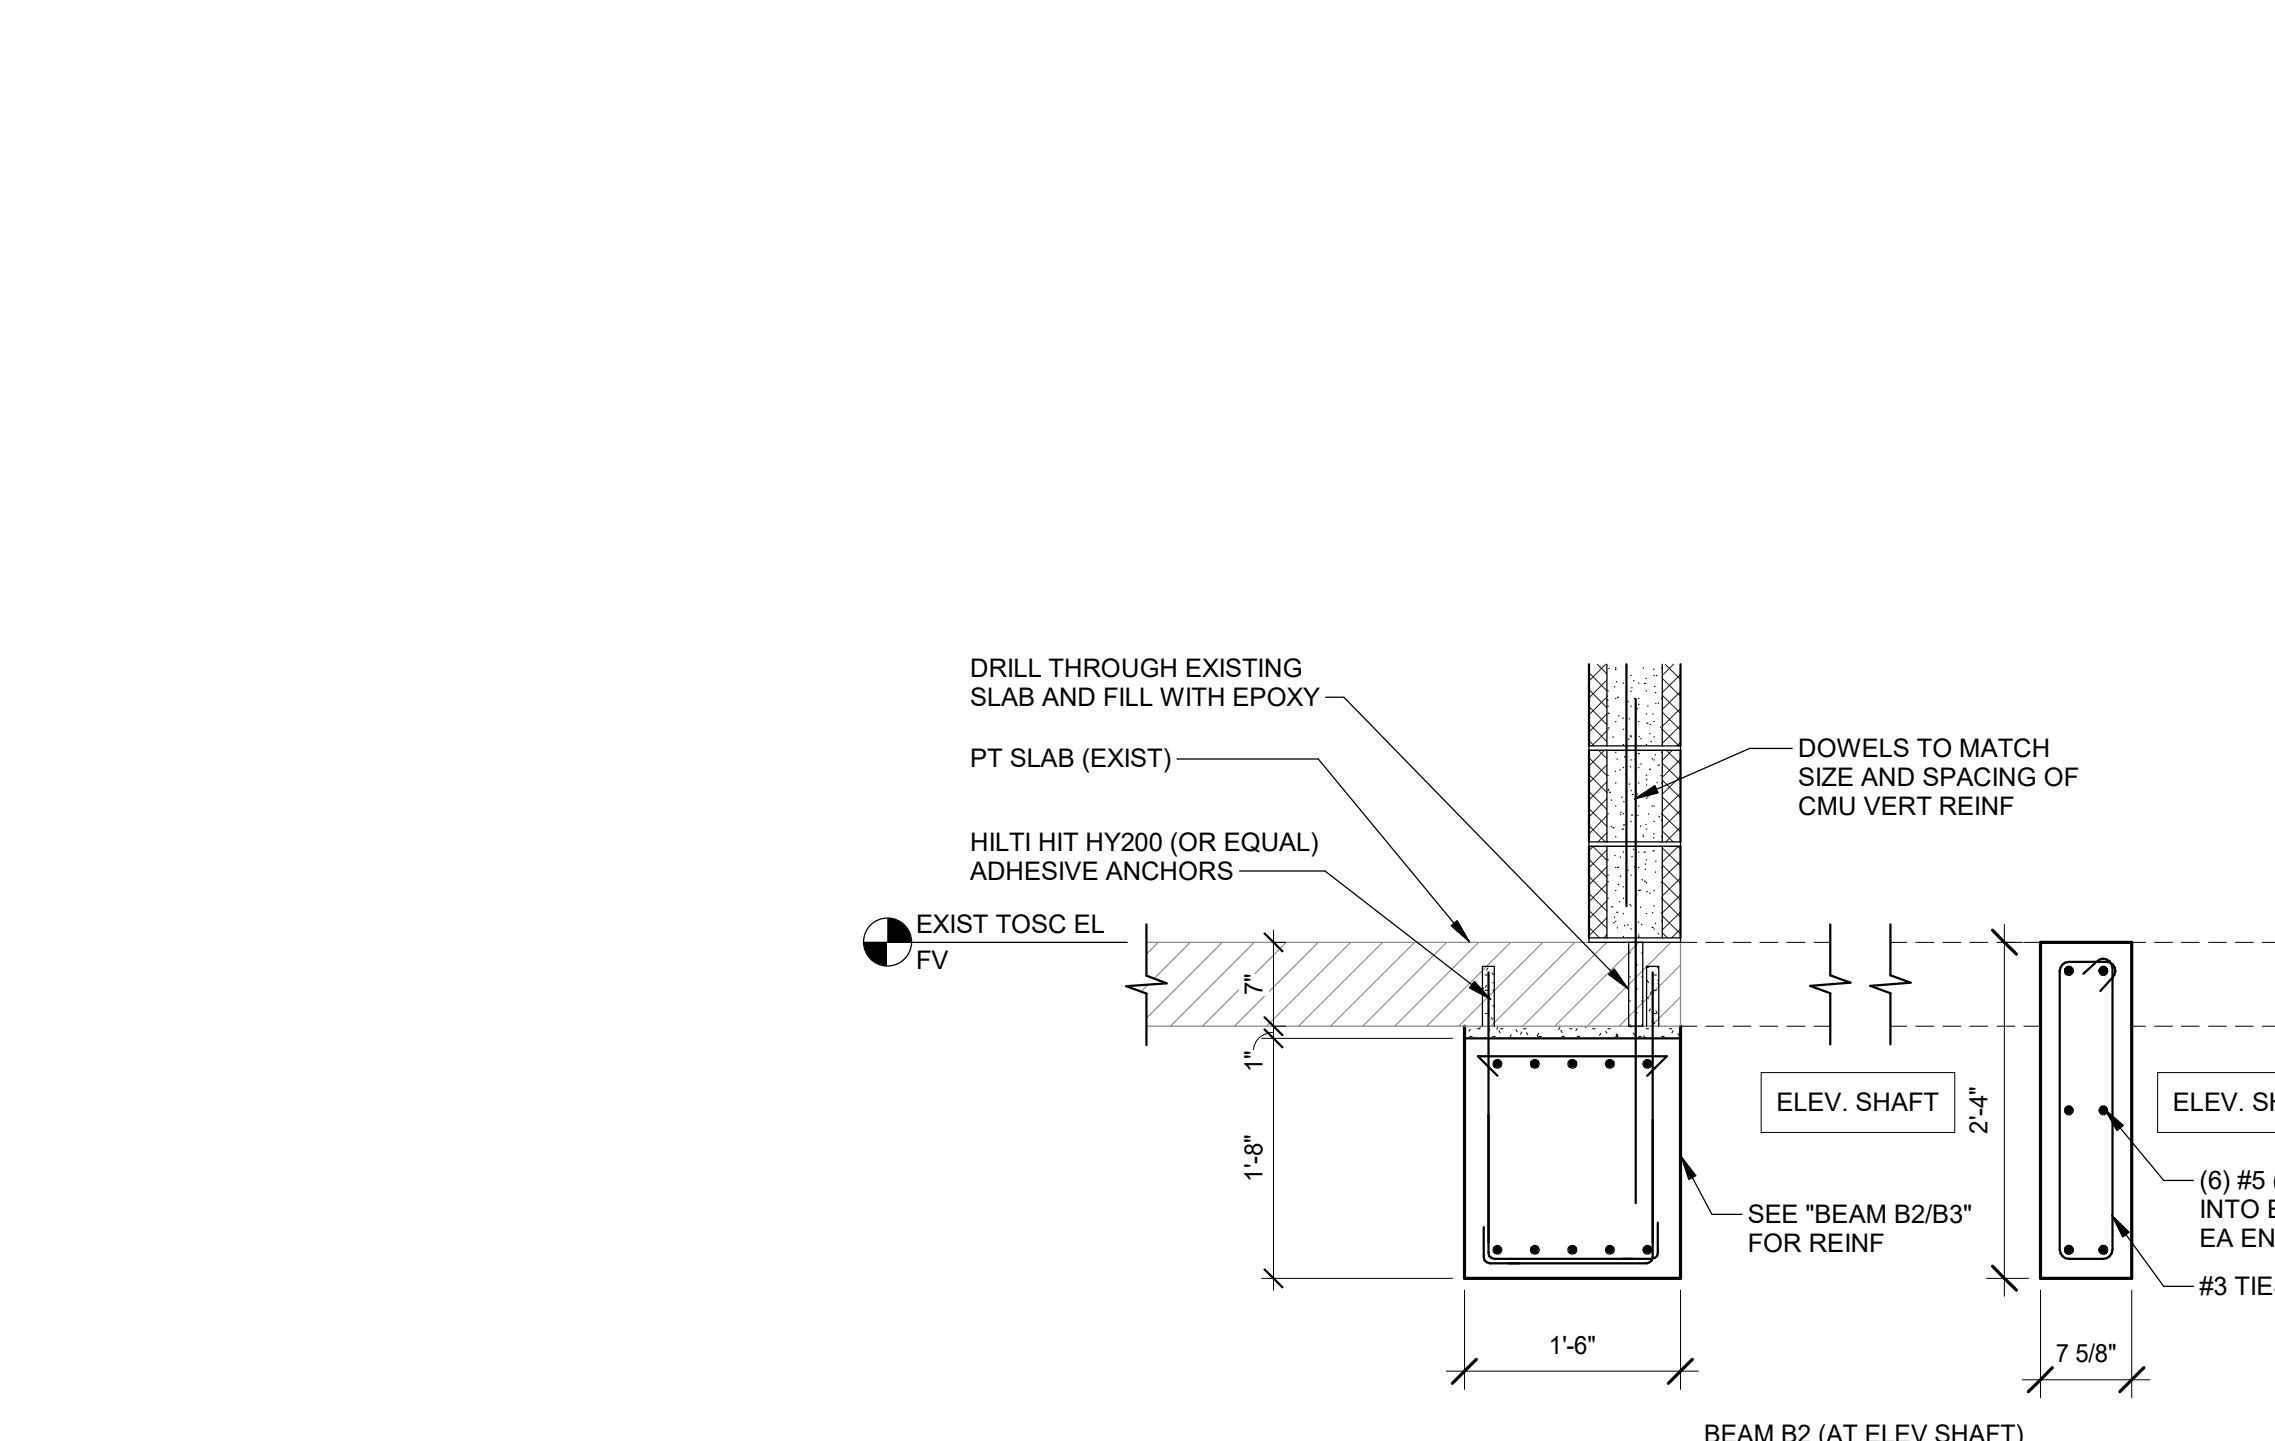


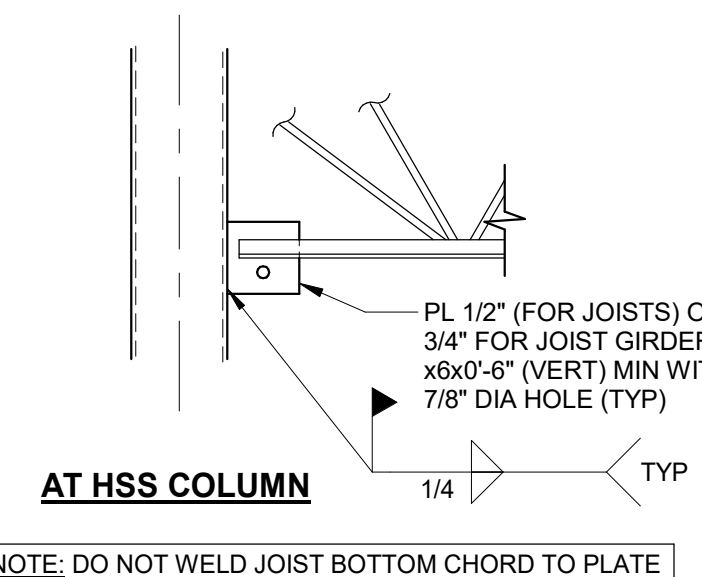


6 TYPICAL JOIST BOTTOM CHORD STABILIZER PLATE AT COLUMN
3/4" = 1'-0"

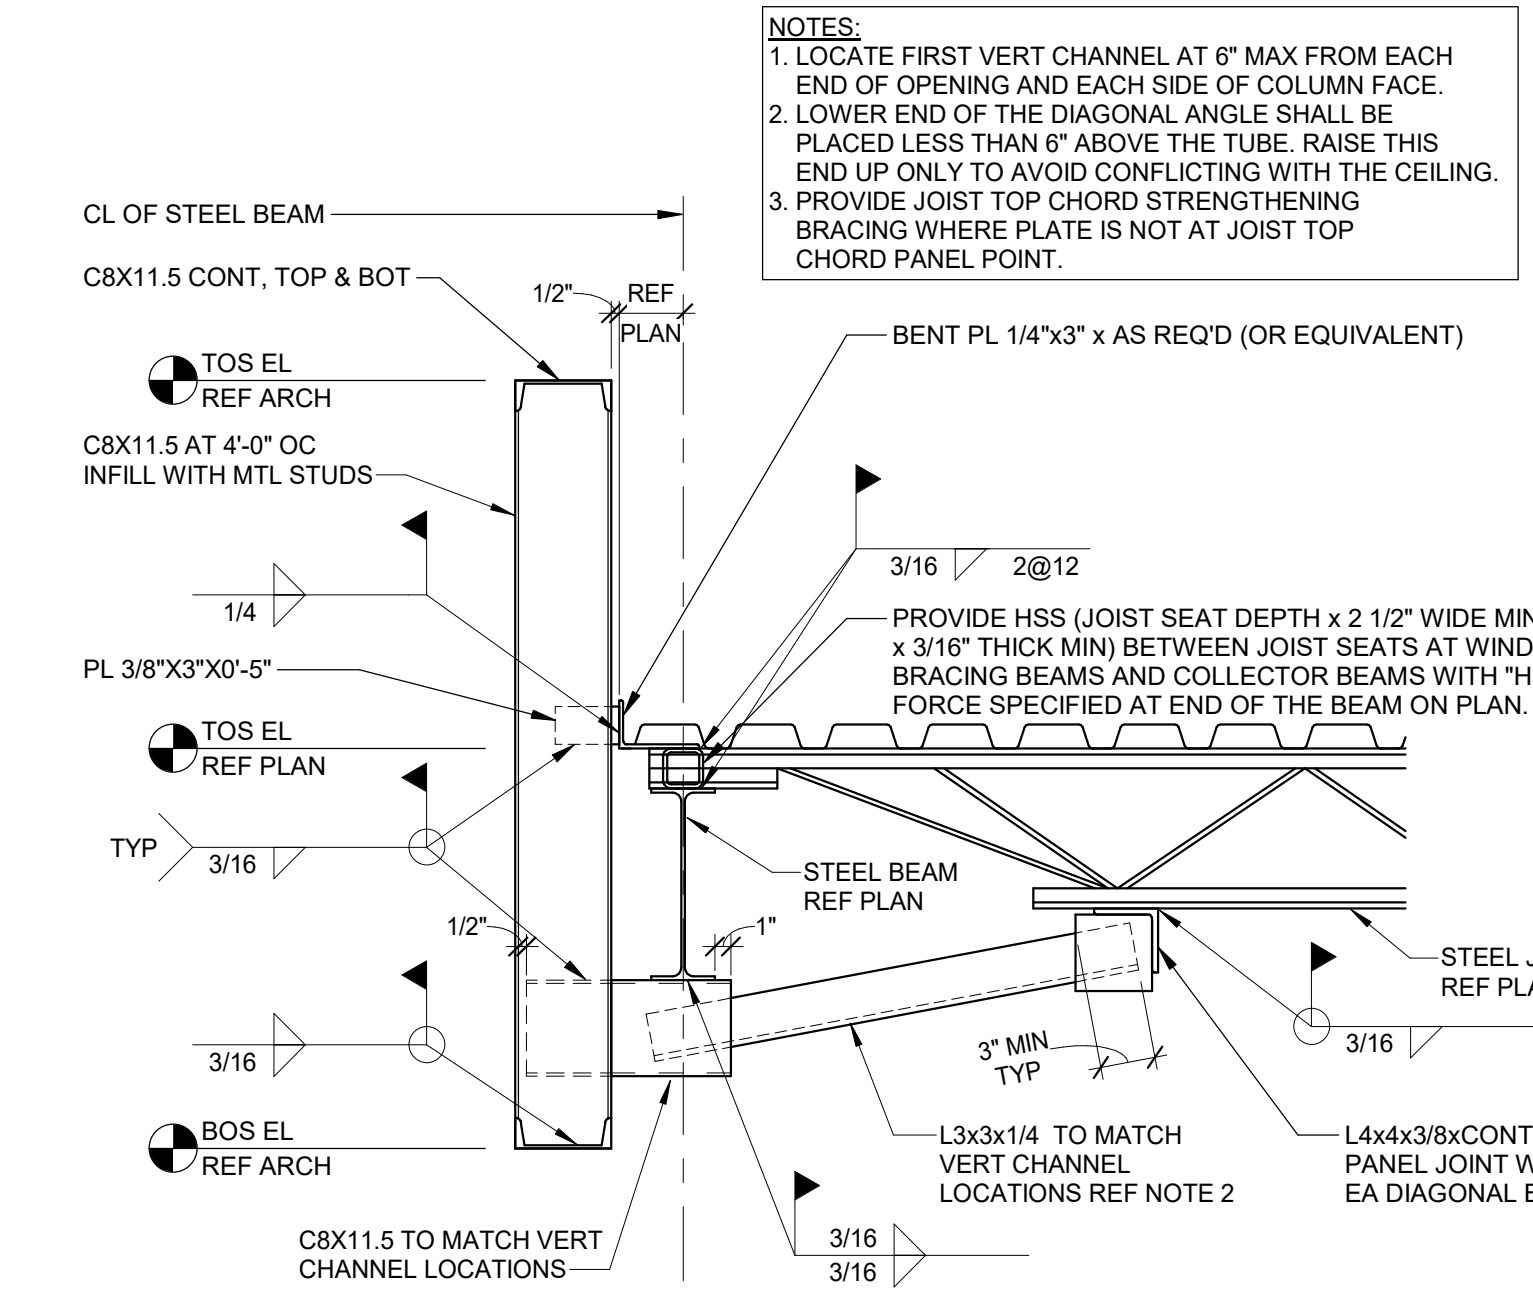


5 BEAM AT CANOPY
1" = 1'-0"

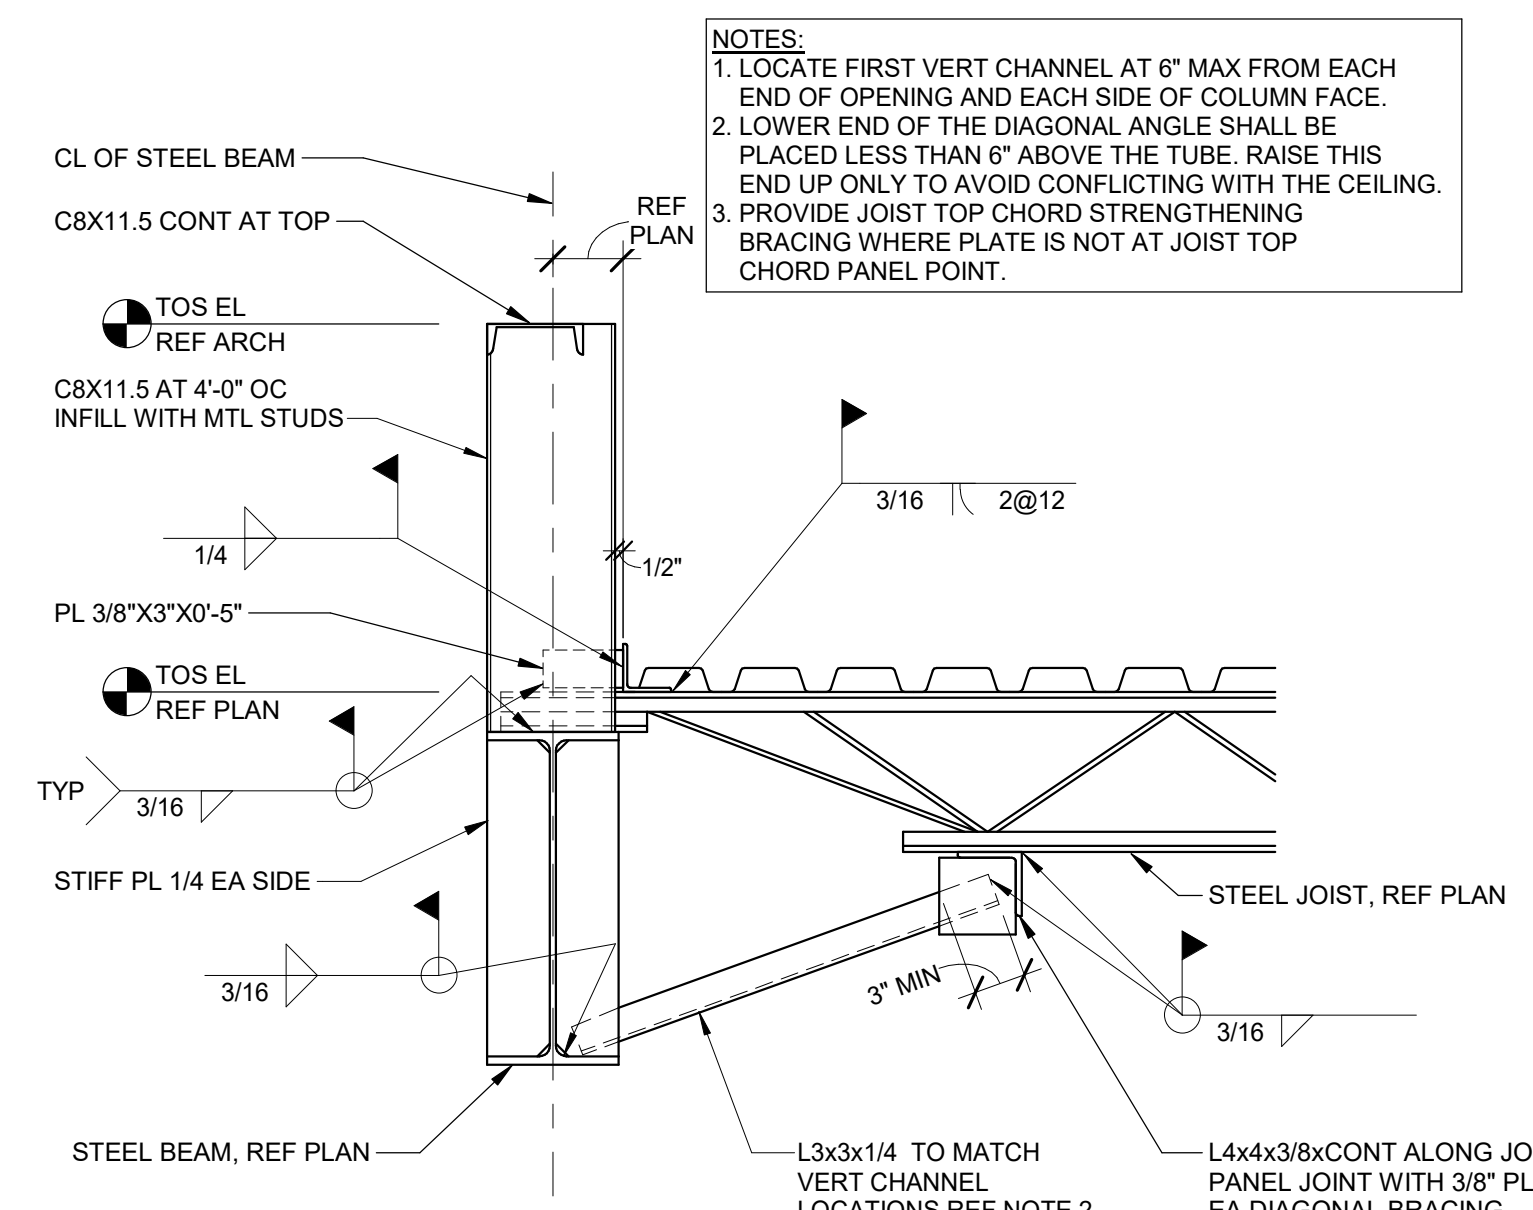


4 BEAM AT CANOPY
1" = 1'-0"

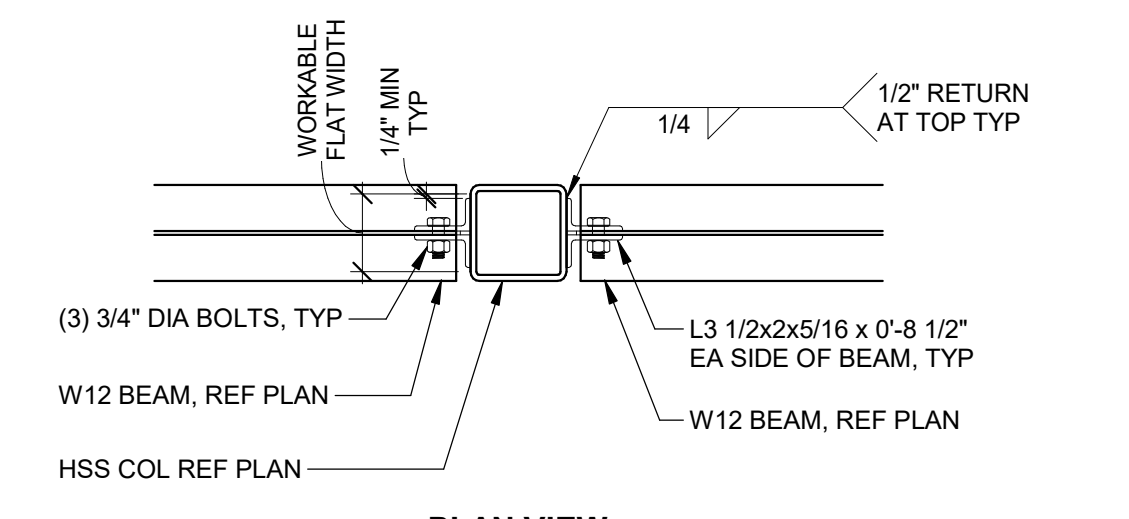

3 WF BEAM TO HSS COL CONN
3/4" = 1'-0"

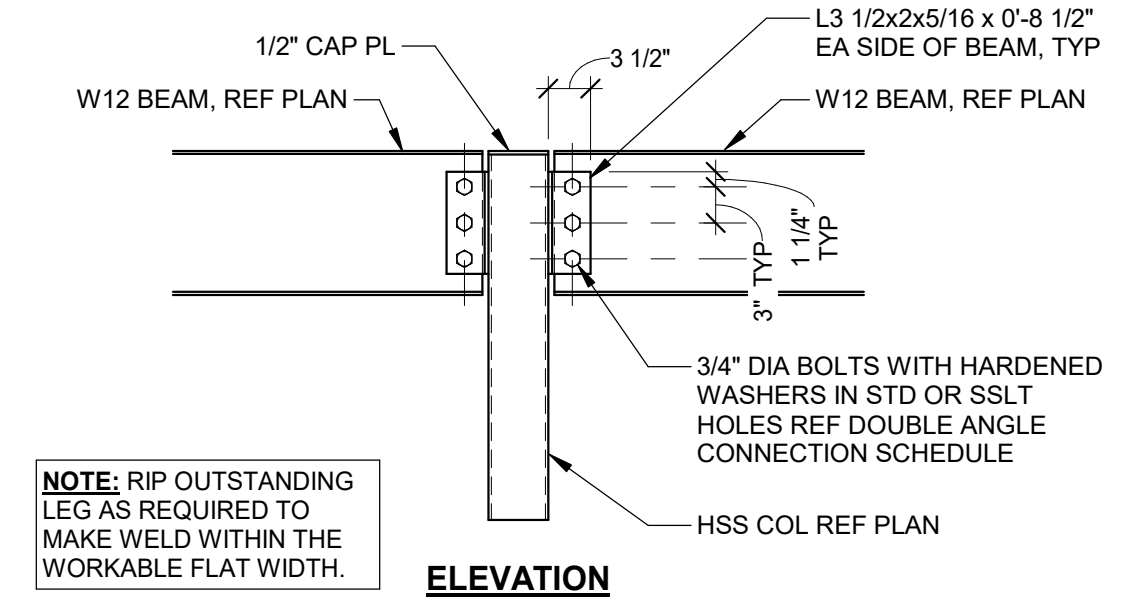

3 WF BEAM TO HSS COL CONN
3/4" = 1'-0"

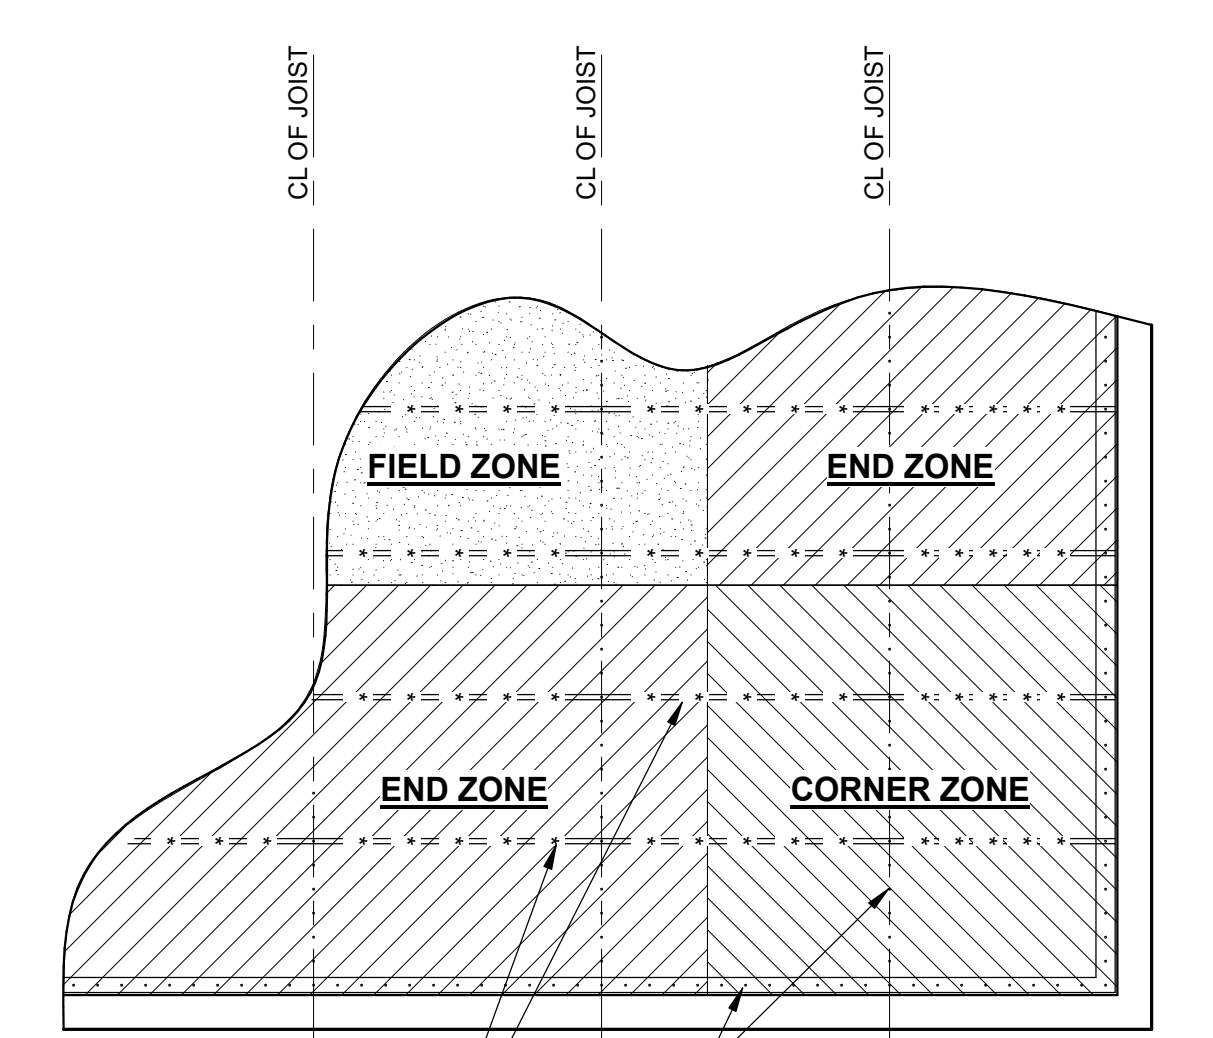


(*) REF SIDELAP FASTENER SCHEDULE FOR TYPE OF SIDELAPS, CONNECTOR, AND NUMBER OF CONNECTORS REQUIRED BETWEEN SUPPORTS


(o) REF FASTENER SCHEDULE FOR TYPE OF FASTENER, AND NUMBER OF REQUIRED SUPPORT FASTENERS TO CONT STEEL MEMBER AT ALL WALLS, JOISTS, AND ALL AROUND OPENINGS

DECK TYPE	GAUGE	ZONE	(o) DECK TO CONTINUOUS MEMBER CONNECTOR TYPE	(*) SIDE LAP FASTENERS
1.5WR	20	ALL	1/2" DIAMETER PUDDLE WELDS 3614 PATTERN	#10 TEK SCREWS AT 48" MAXIMUM SPACING


2 ROOF DIAPHRAGM CONNECTION DIAGRAM AND SCHEDULE
3/4" = 1'-0"

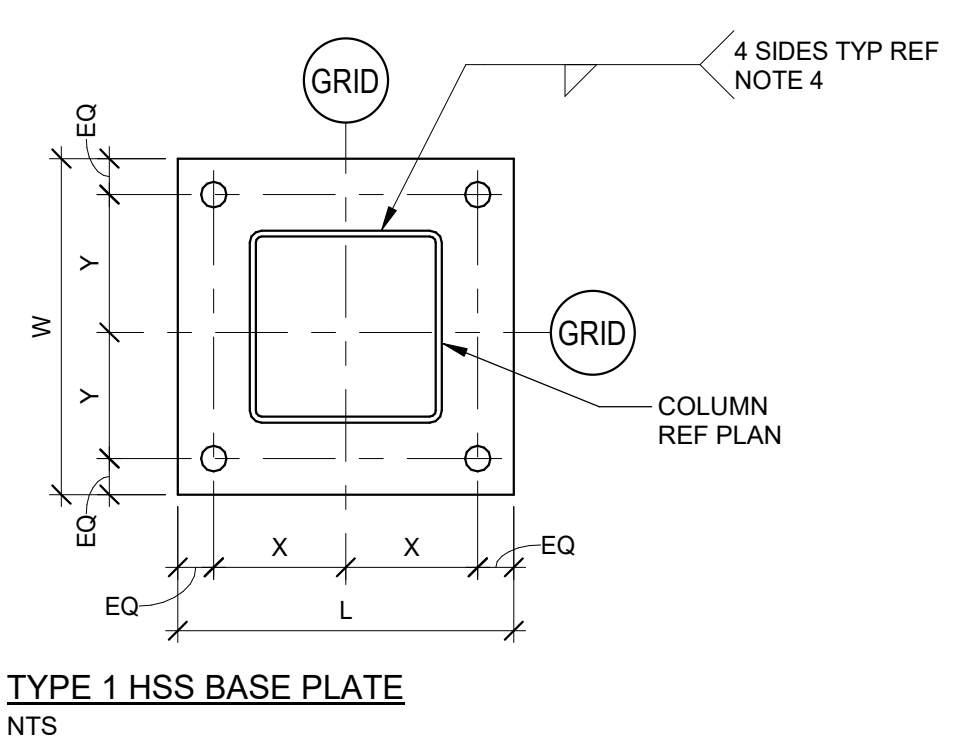

TYPE 1 HSS BASE PLATE
NTS

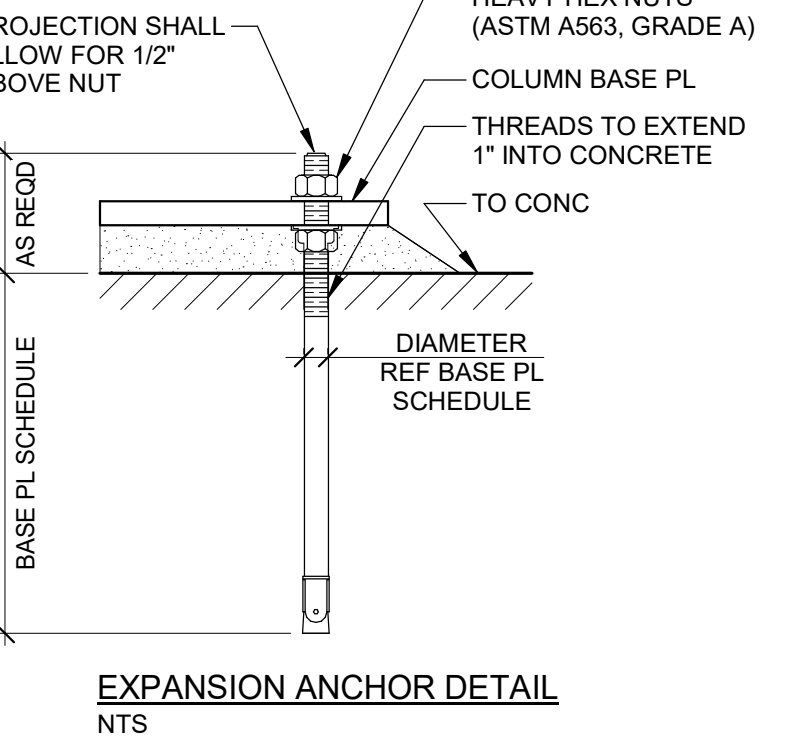

EXPANSION ANCHOR DETAIL
NTS

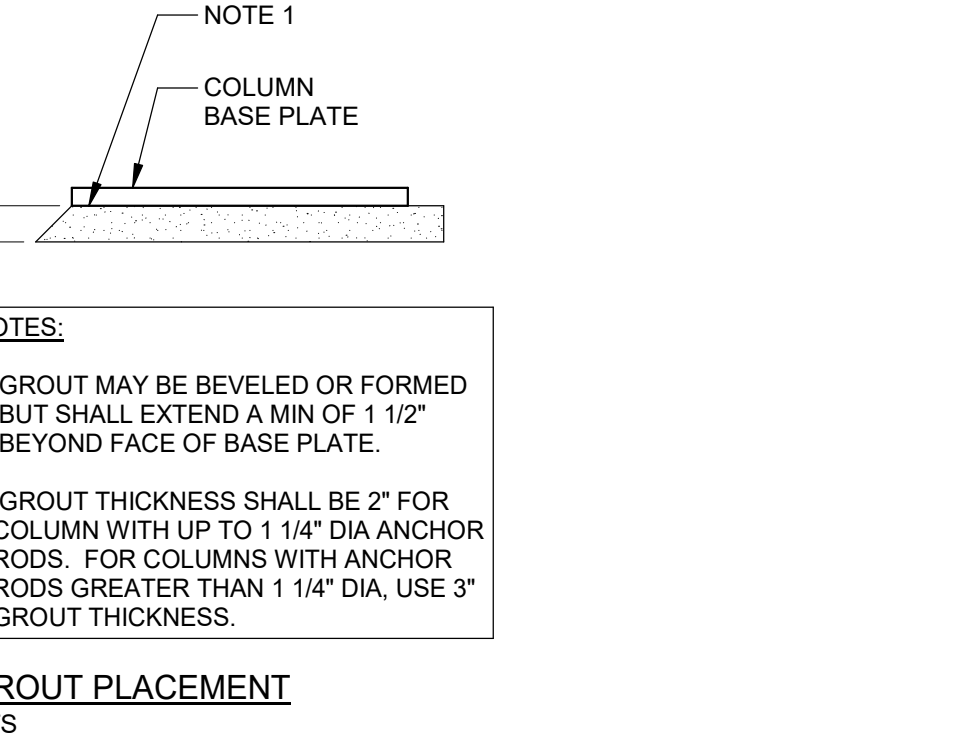

GROUT PLACEMENT
NTS

BASE PLATE AND ANCHOR ROD SCHEDULE AND DETAILS

Type	(L)	(W)	(T)	X	Y	BASE PLATE TYPE	ANCHOR RODS (NUM) DIA x EMBEDMENT	ANCHOR ROD GRADE	COMMENTS

1 COLUMN BASE PLATE AND ANCHOR ROD SCHEDULE AND DETAILS
1 1/2" = 1'-0"


ANCHOR ROD HOLE & WASHER SCHEDULE

ANCHOR ROD DIAMETER	MAX HOLE DIAMETER	MIN WASHER SIZE	MIN WASHER THICKNESS
3/4"	1 1/4"	2"	1/4"
7/8"	1 1/2"	2 1/2"	5/16"
1"	1 3/4"	3"	3/8"
1 1/4"	2"	3"	1/2"
1 1/2"	2 1/4"	3 1/2"	1/2"
1 3/4"	2 1/2"	4"	5/8"
2"	3 1/4"	5"	3/4"
2 1/2"	3 3/4"	5 1/2"	7/8"

1 CIRCULAR OR SQUARE WASHERS MEETING THE SIZE SHOWN ARE ACCEPTABLE.



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

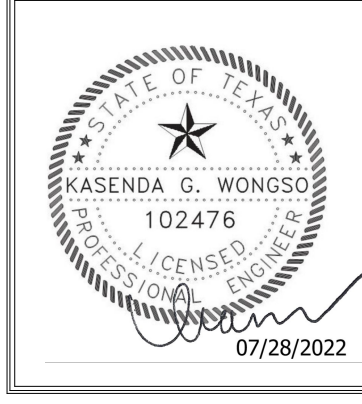

PROJECT # 21084.00000
15200 Addison Road, Suite 310
Addison, Texas 75001
Ph: 214.503.7800
www.agen.com
TX REG. NO. F-8429
2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS
TYPICAL STEEL DETAILS

PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
S-531-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


38

D

C

B

A

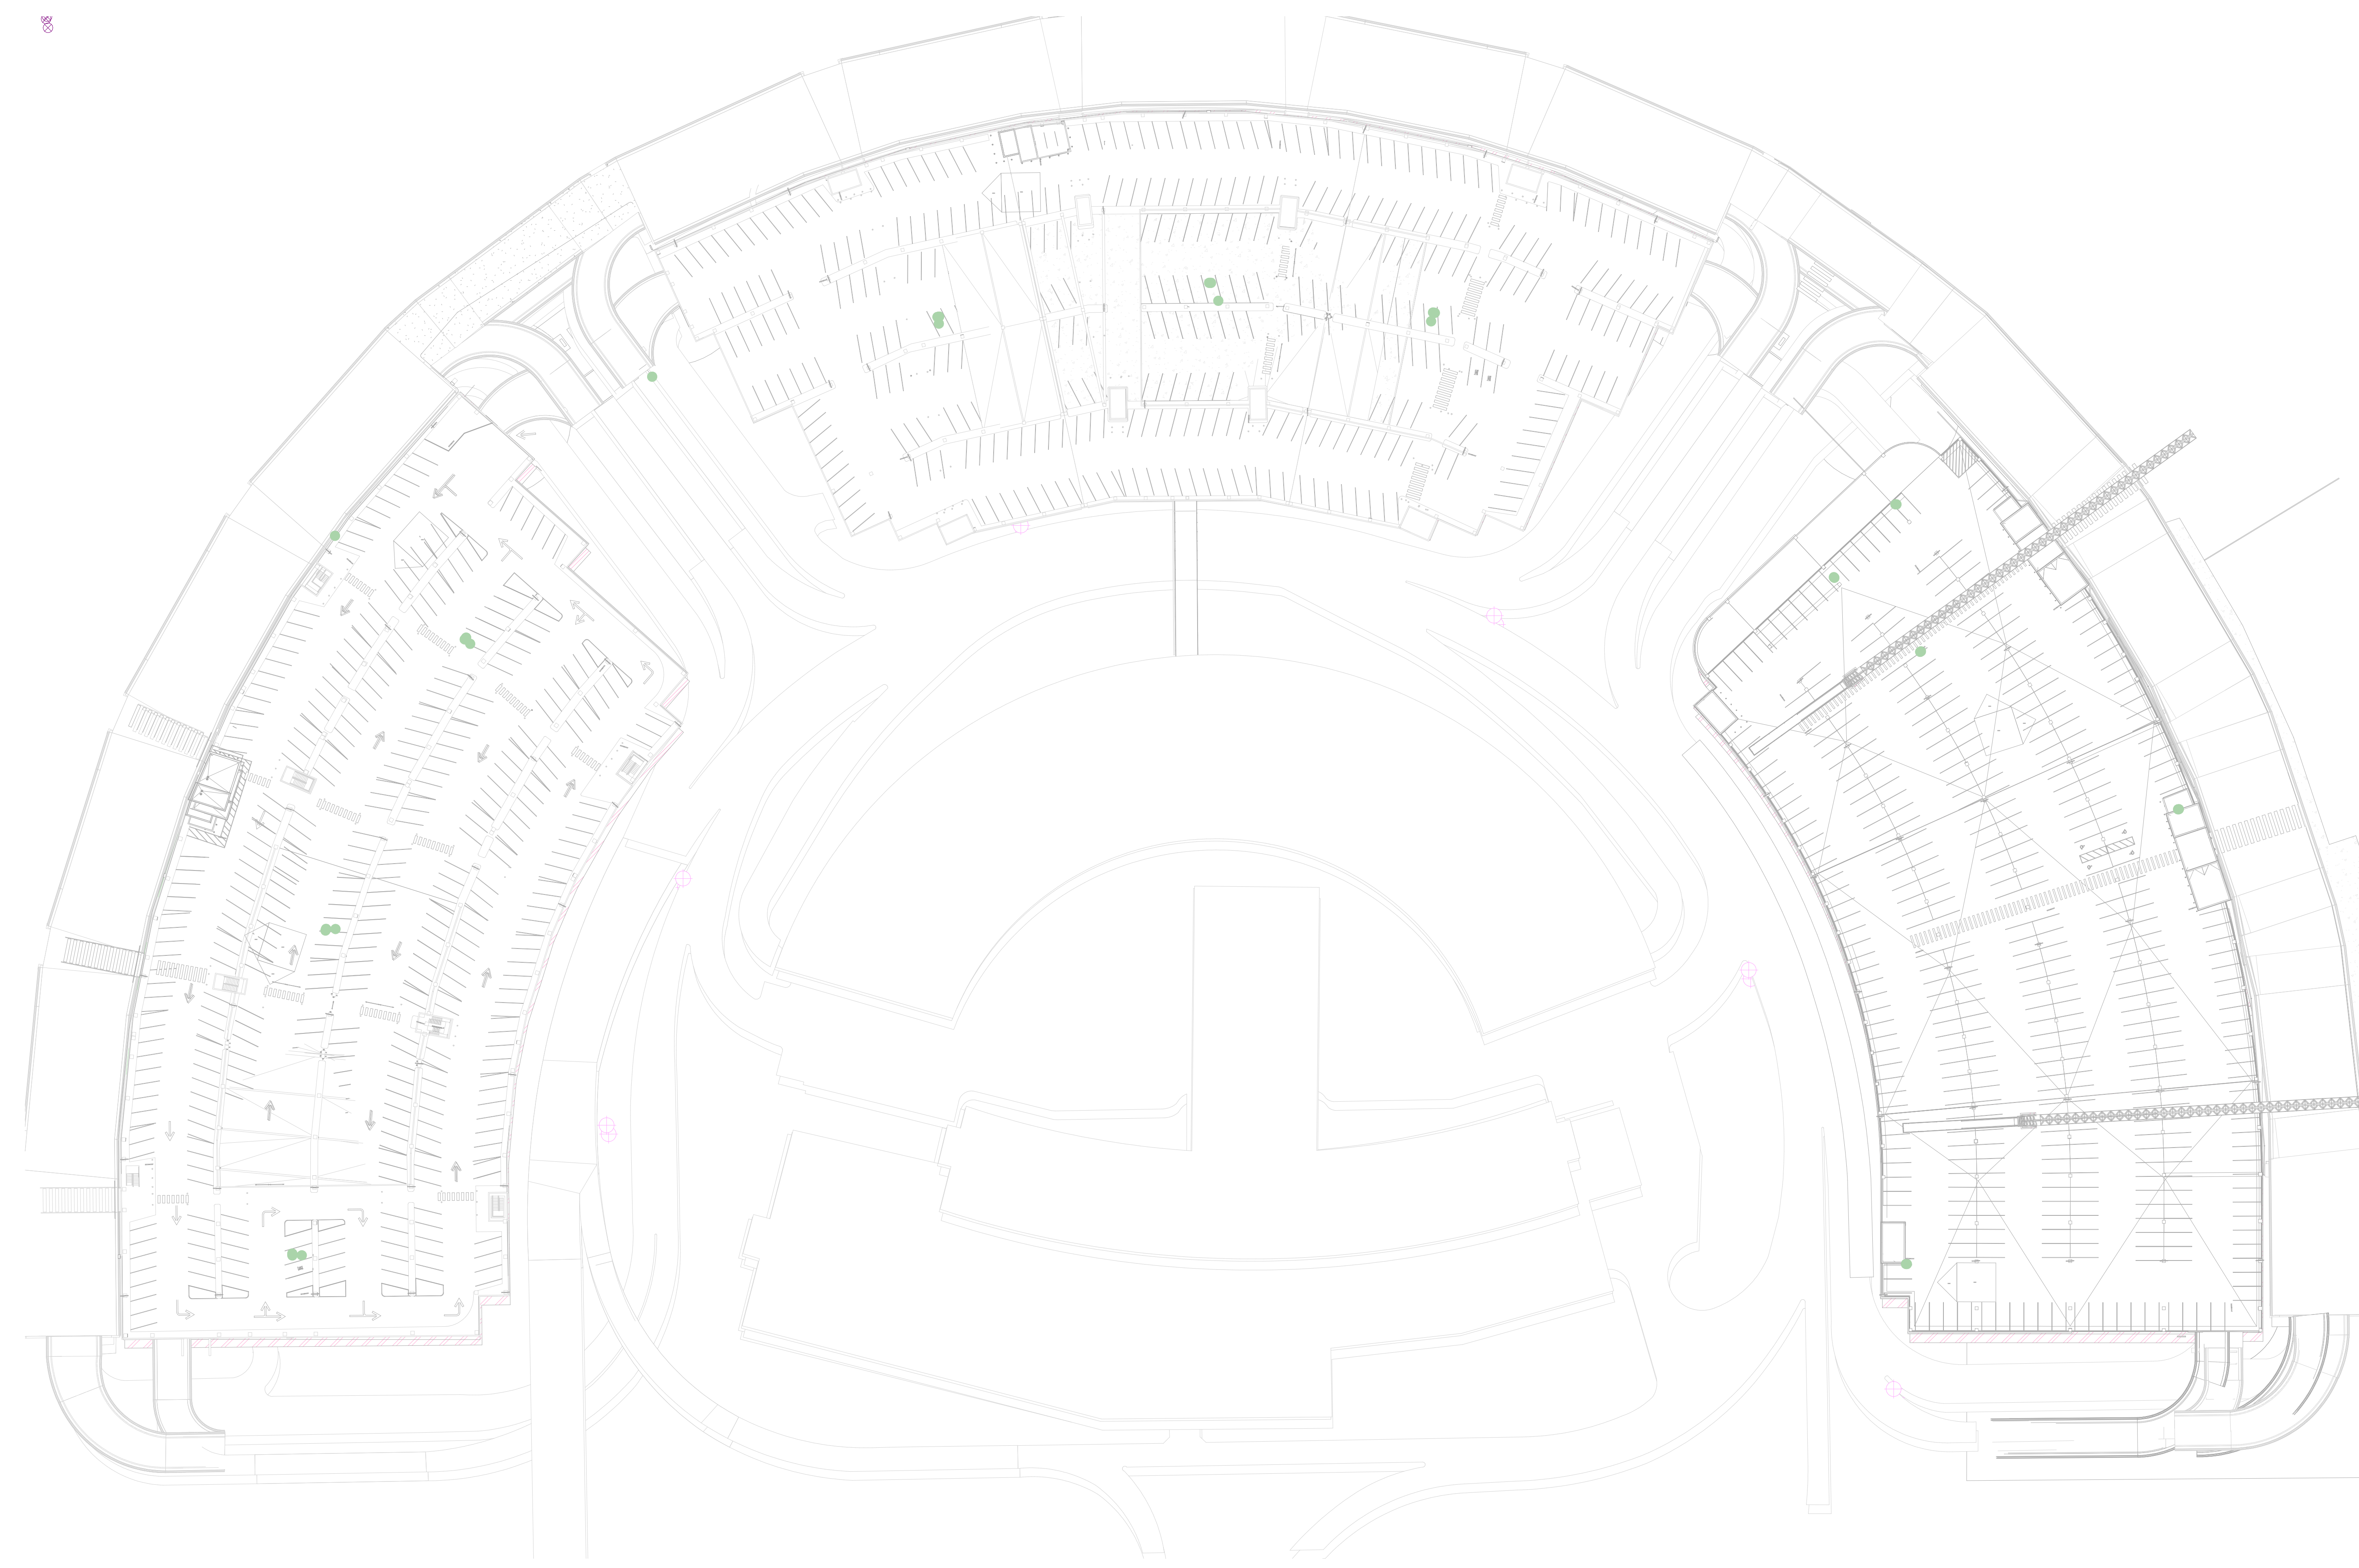


6

SHEET NOTES


1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.

SIGN TYPE LIST

SIGN TAG KEY

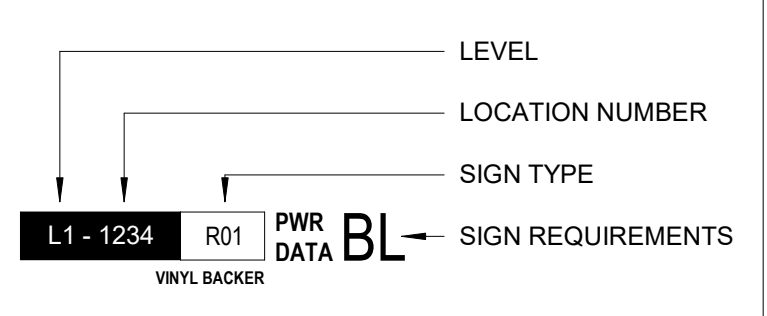


KEY PLAN

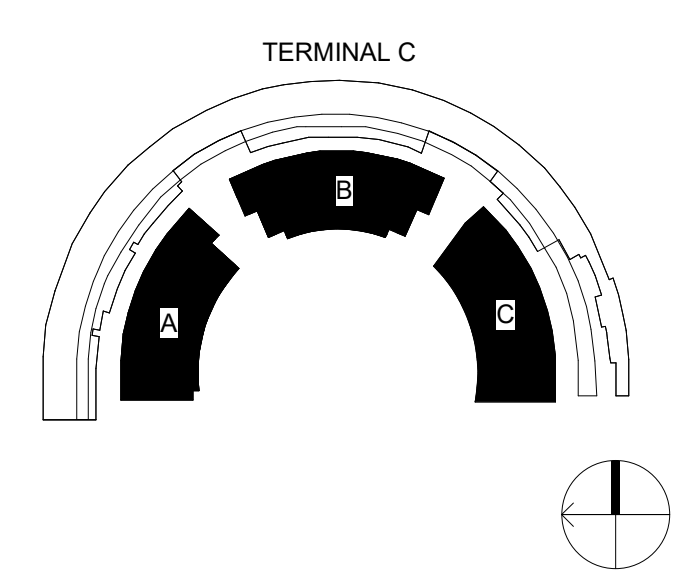

① GARAGES COMPOSITE PLAN
1" = 50'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

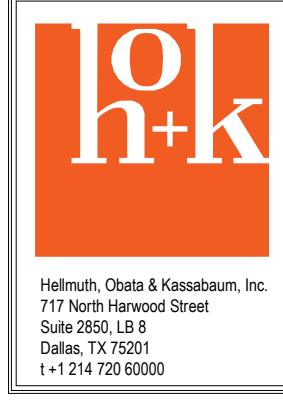

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-10-29	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS

ARCH WAYFINDING GARAGE COMPOSITE PLAN

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
AG100-900

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


GENERAL NOTES

1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.



SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

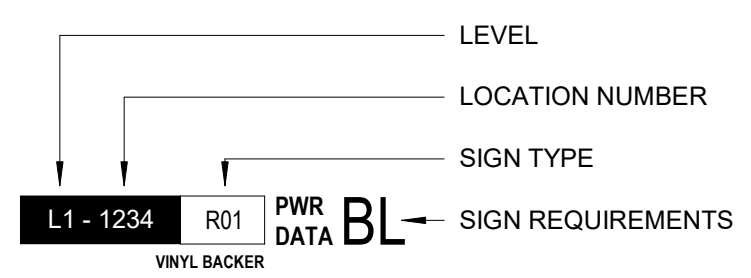


KEY PLAN

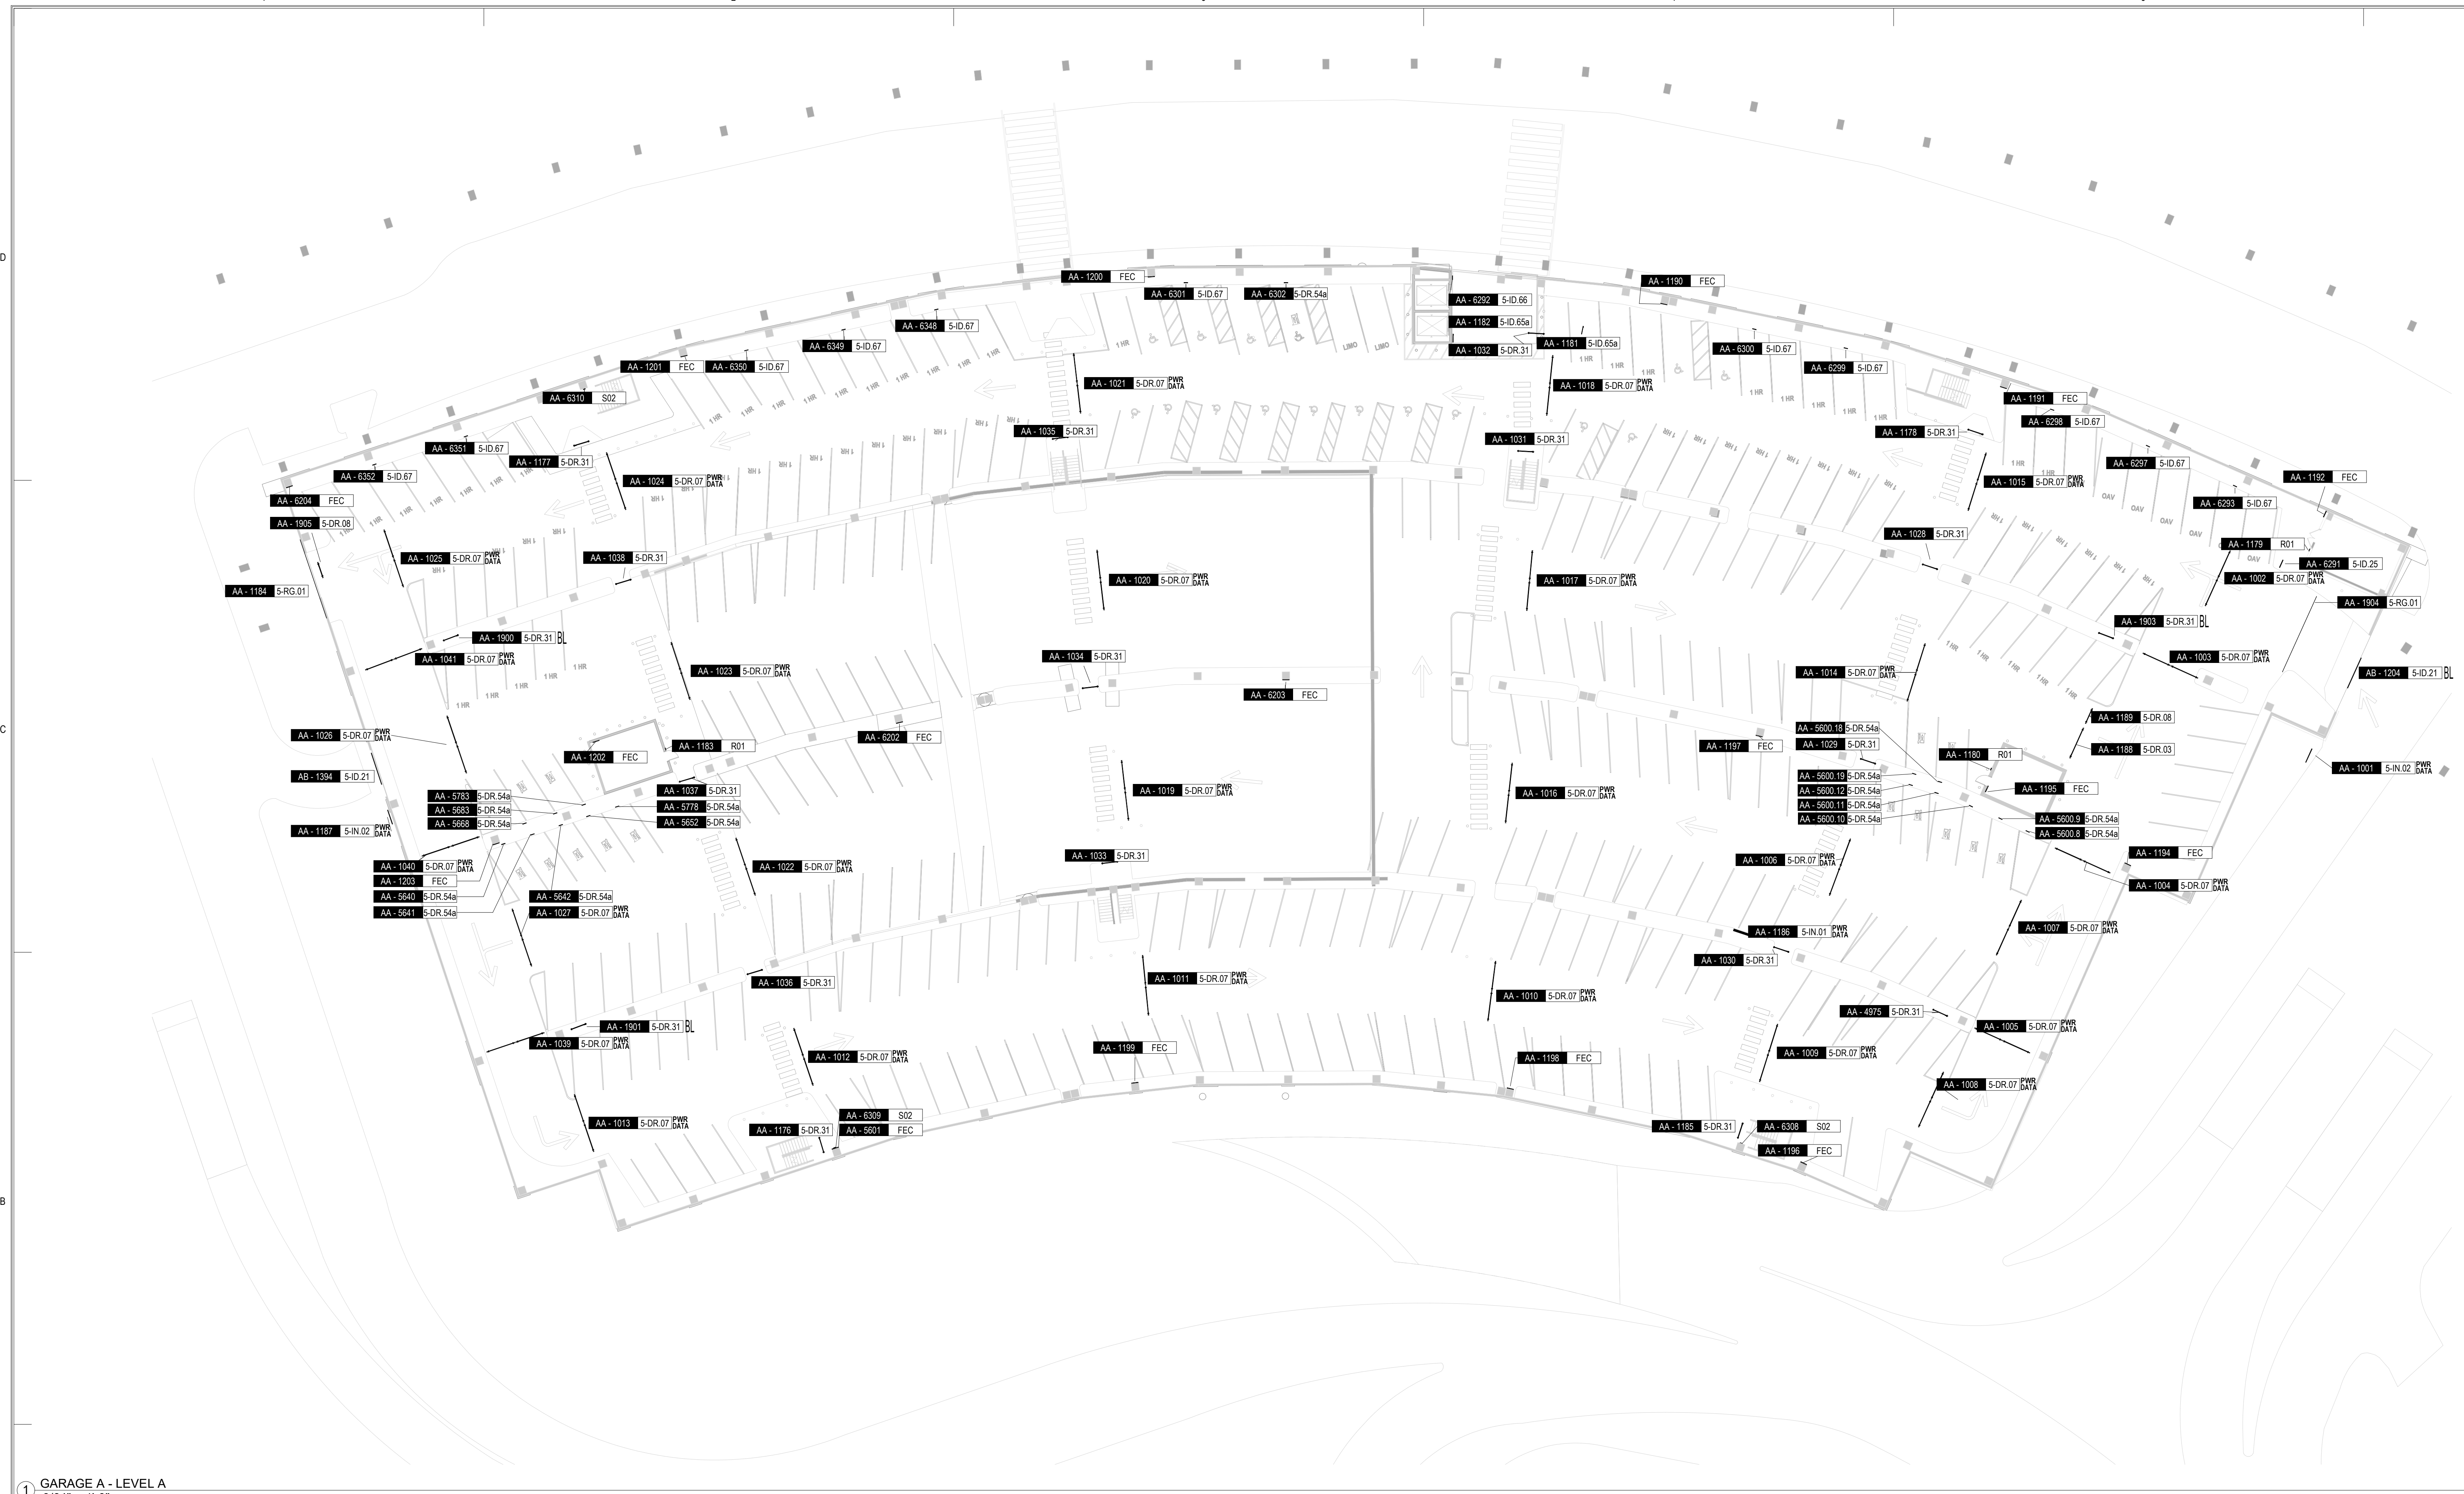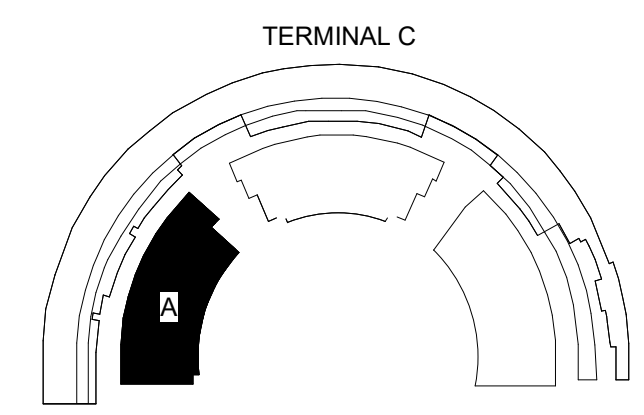

① GARAGE A - LEVEL A
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

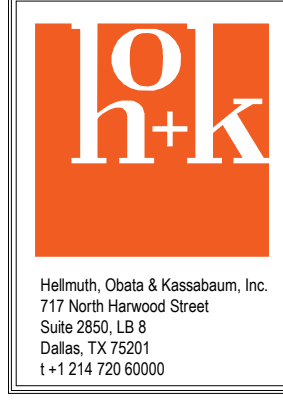

Harkins, Clark & Koenigsmann, Inc.
717 North Memorial Street
Suite 2050, LB #
Dallas, TX 75201
1+1214 722 6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-02-23	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS


ARCH WAYFINDING GARAGE A PLAN - LEVEL A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG101-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

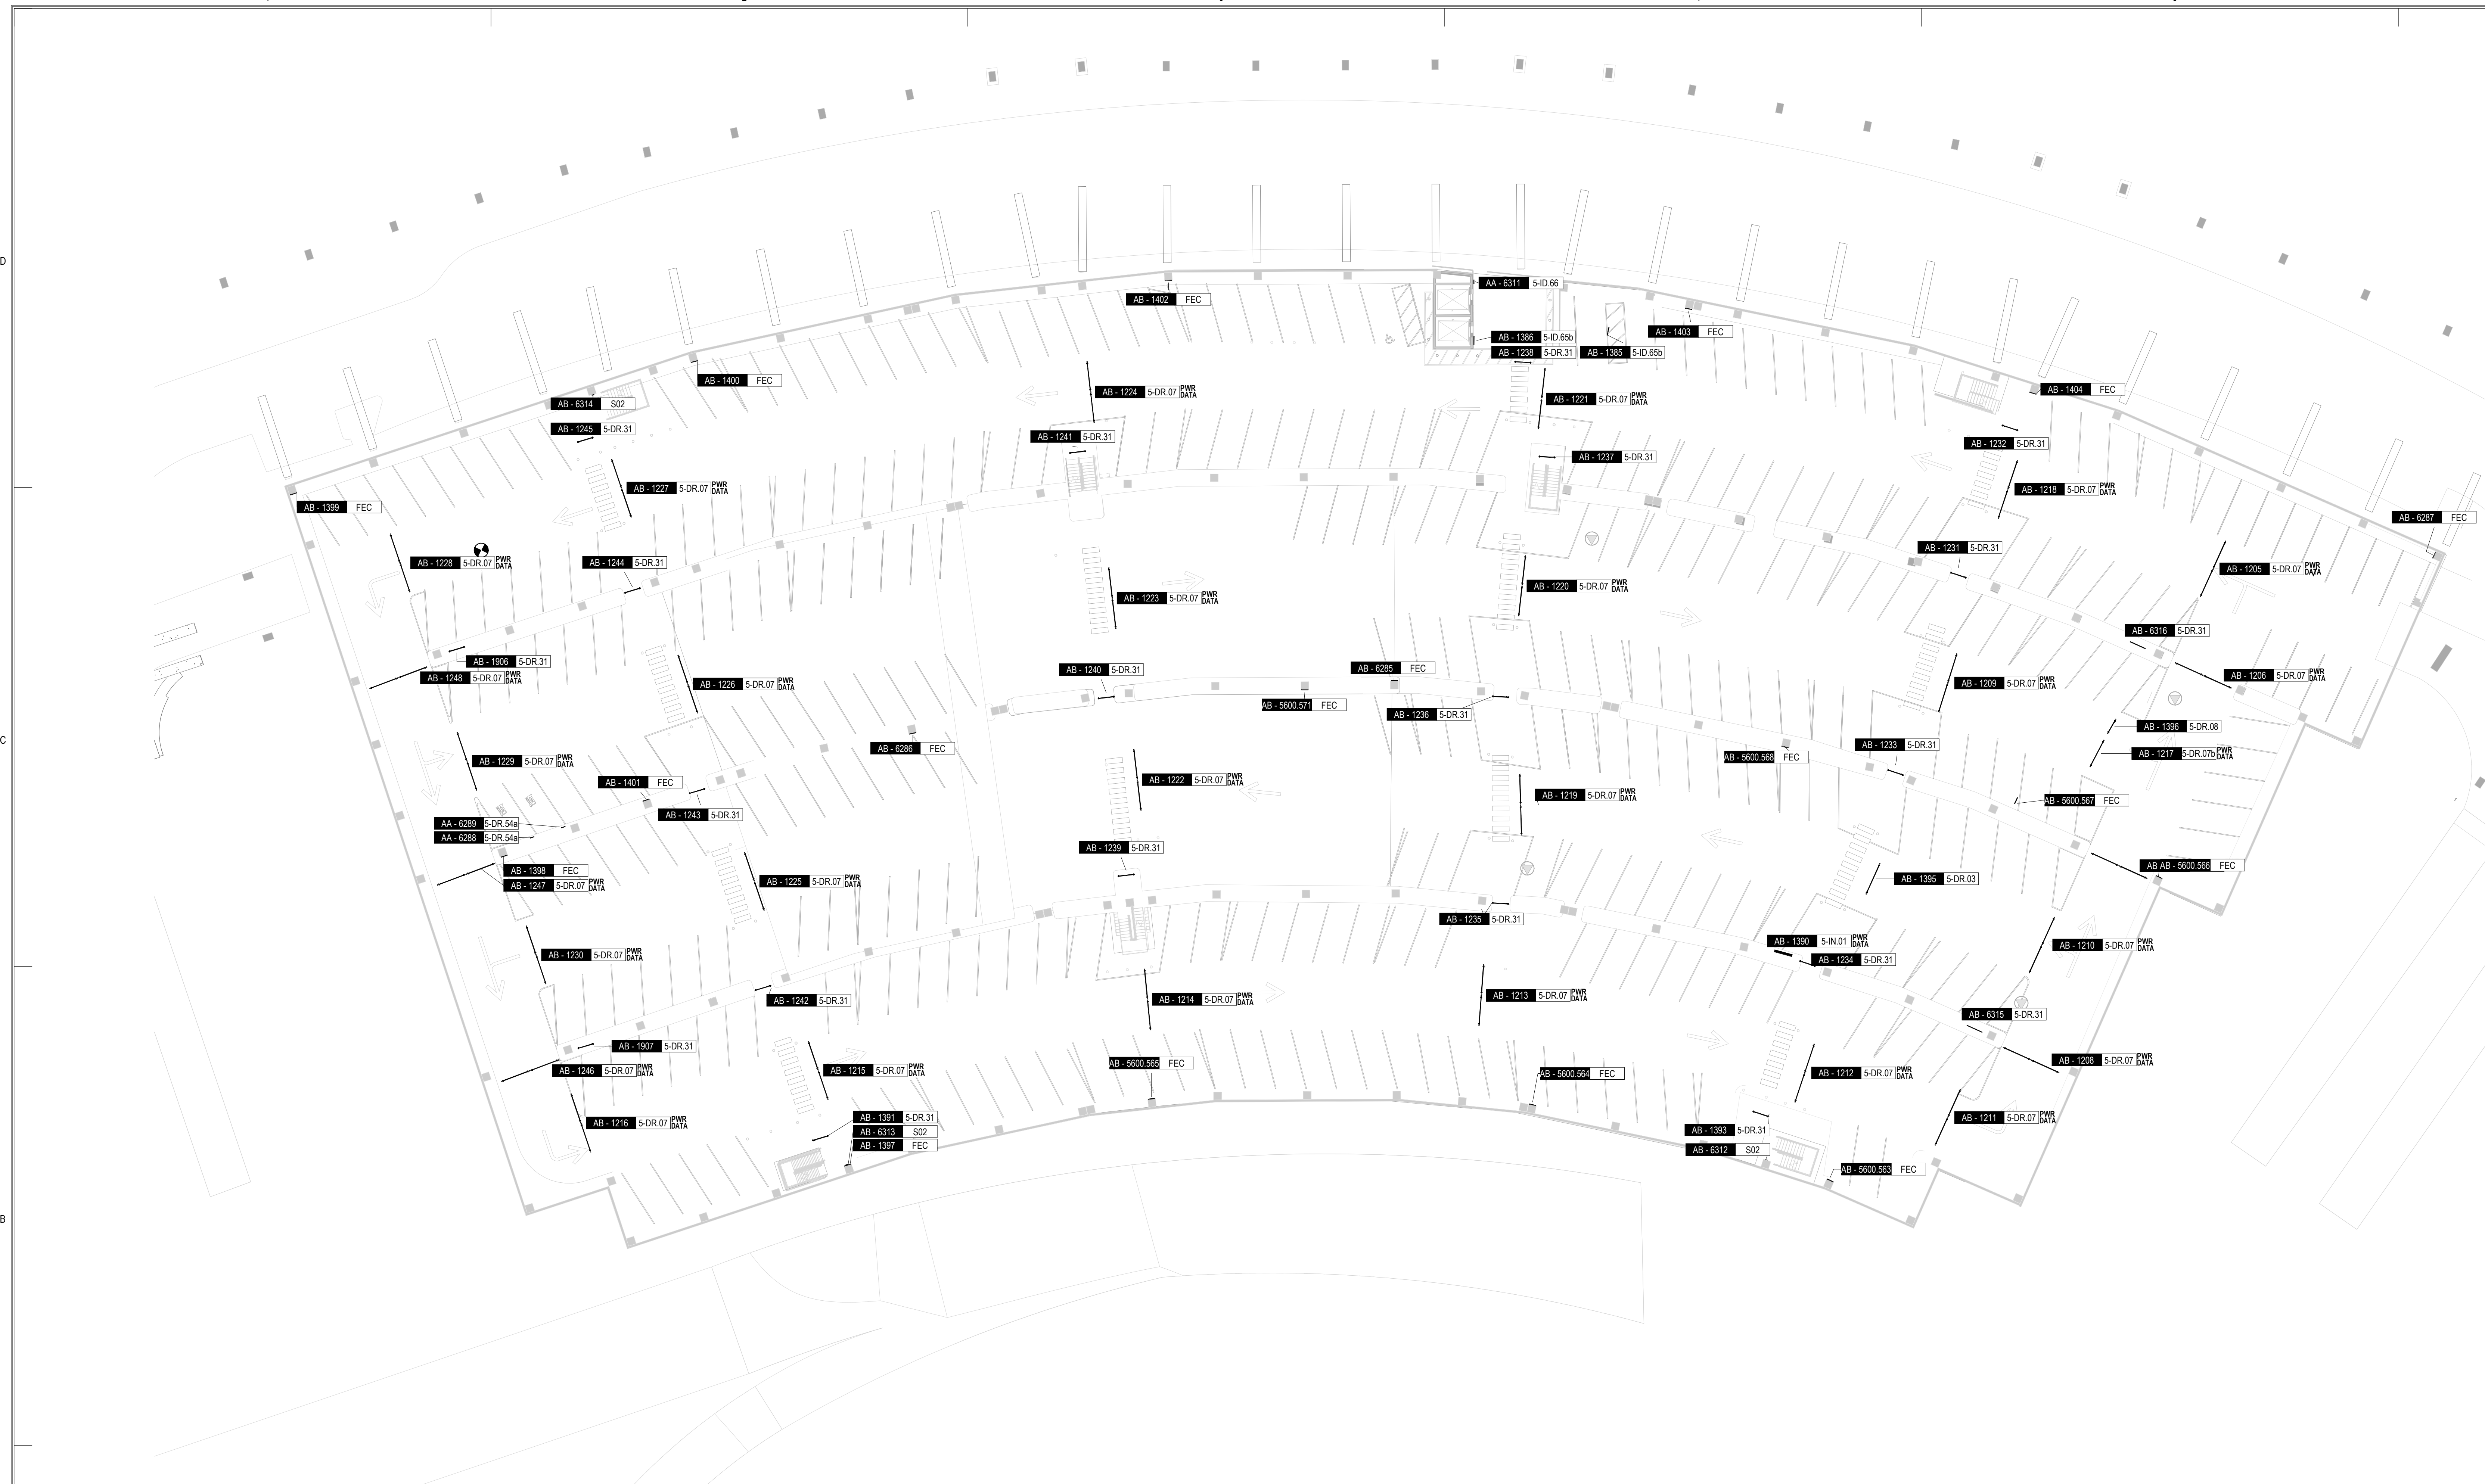


GENERAL NOTES

- REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
- REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.


SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.02	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

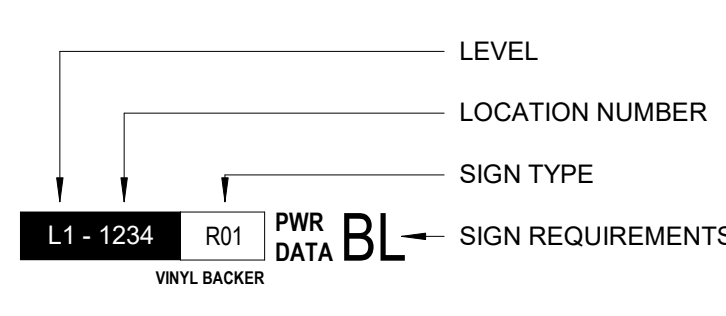


KEY PLAN

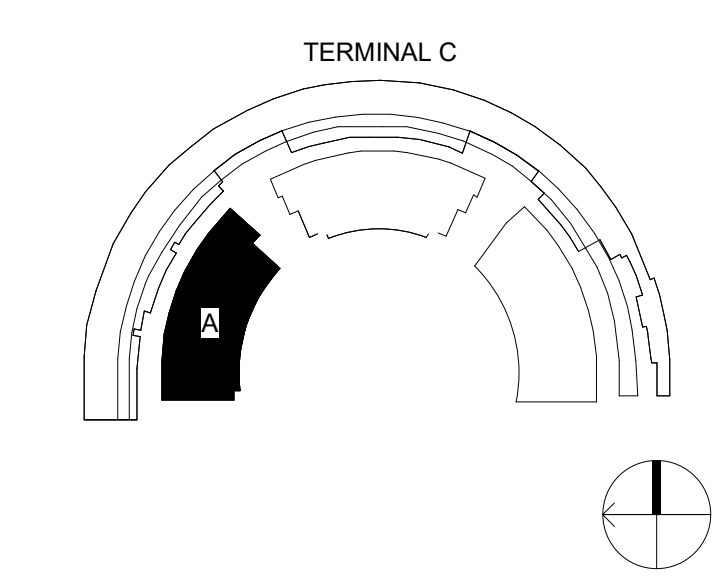

① GARAGE A - LEVEL B
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

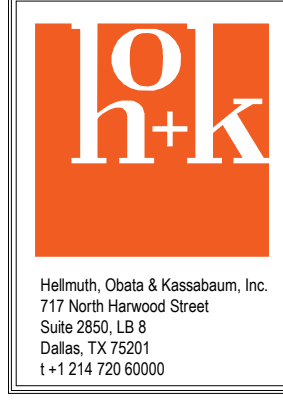

Helmuth, Obata & Kassabaum, Inc.
717 North Memorial Street
Dallas, TX 75201
1+1214 729 6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-02-23	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS

ARCH WAYFINDING GARAGE A PLAN - LEVEL B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


GENERAL NOTES

1. REFER TO A65 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO A66 SERIES FOR MESSAGE SCHEDULES.



SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	VEHICULAR MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TxDOT RFS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

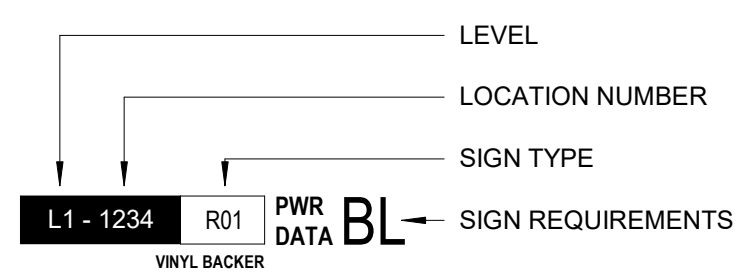


KEY PLAN

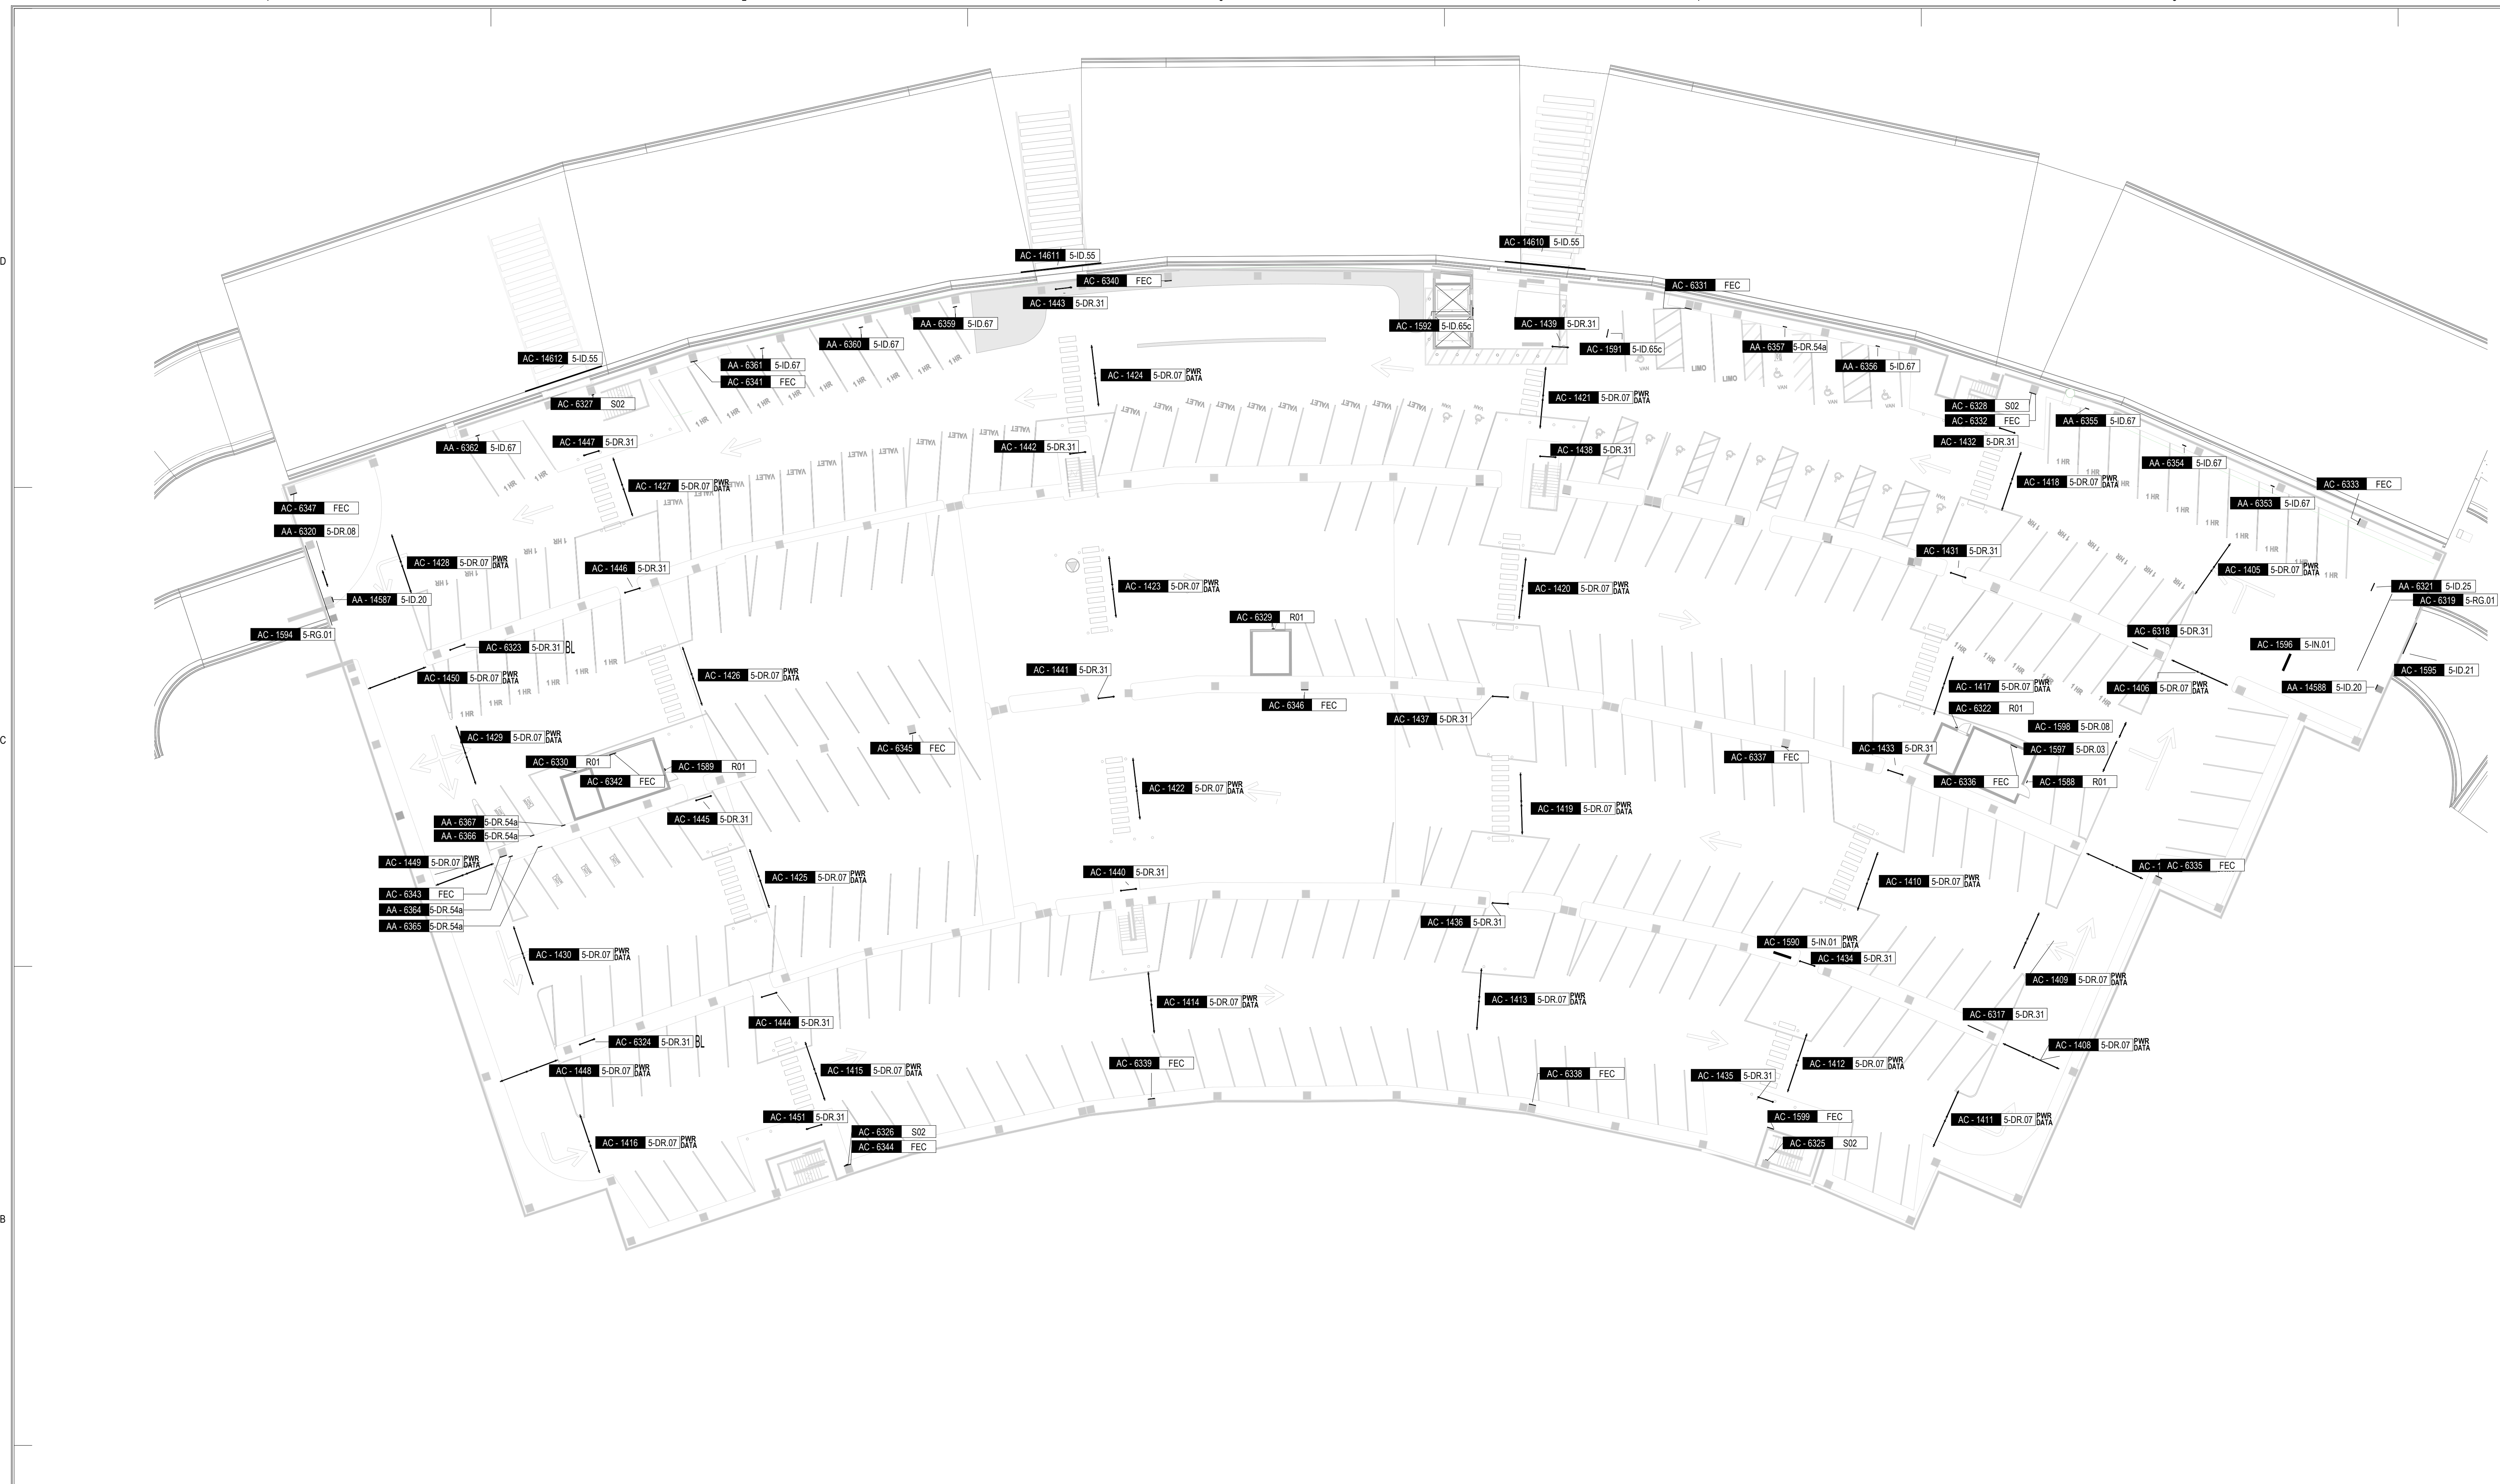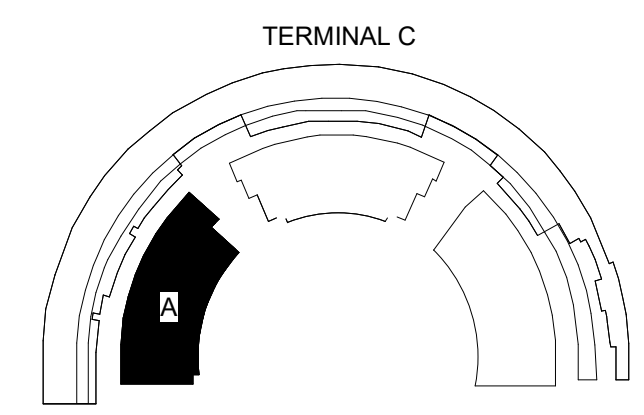

① GARAGE A - LEVEL C
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

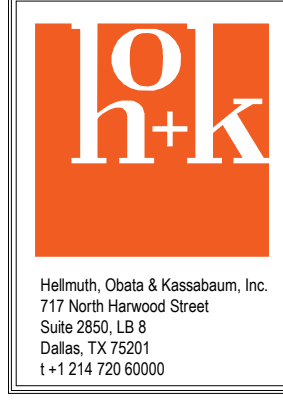

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1.	2021-02-23	30% DESIGN
2.	2021-01-09	70% DESIGN
3.	2022-03-01	100% DESIGN
4.	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS

ARCH WAYFINDING GARAGE A PLAN - LEVEL C

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


GENERAL NOTE

1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.



SHEET NOTE

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

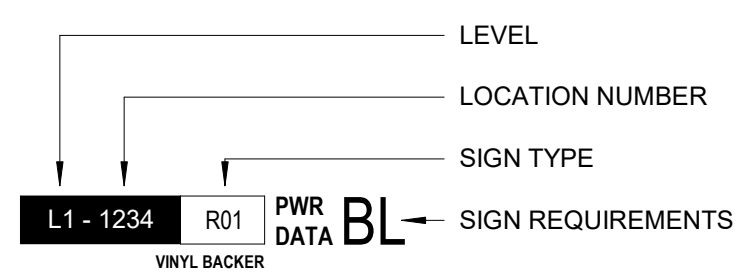


KEY PLAN

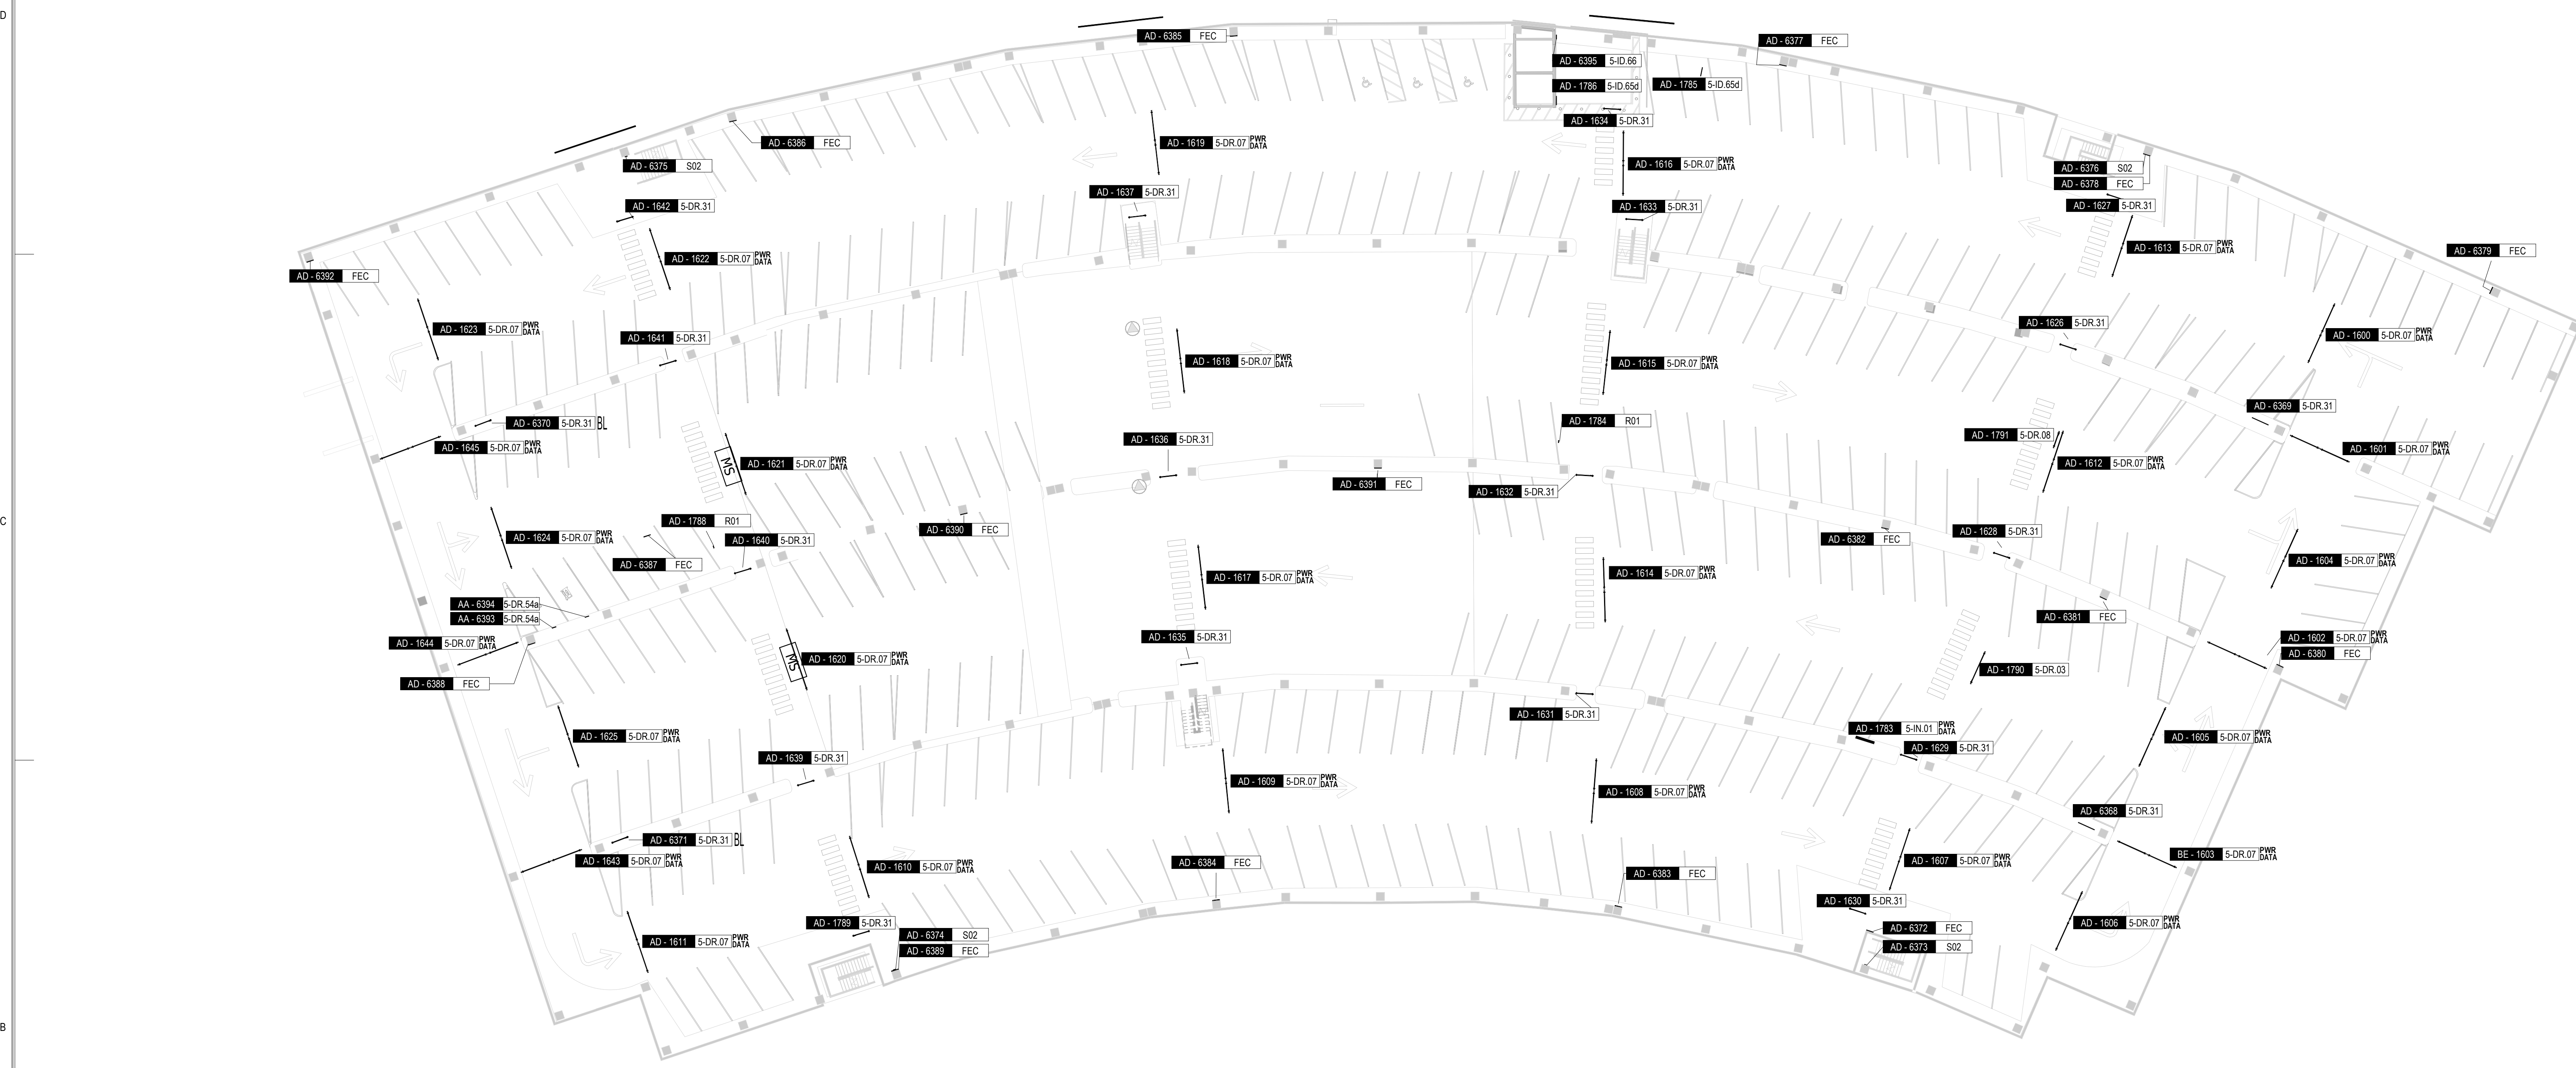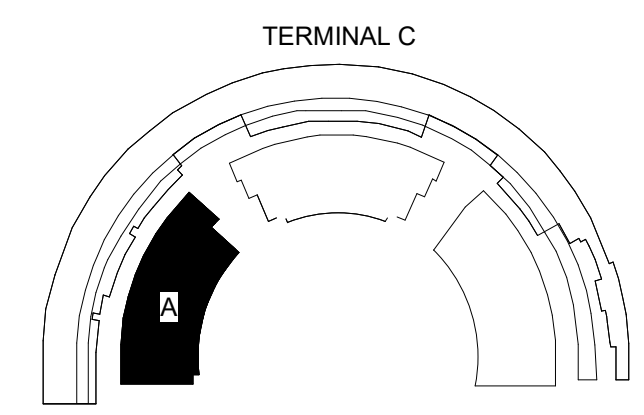

① GARAGE A - LEVEL D
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

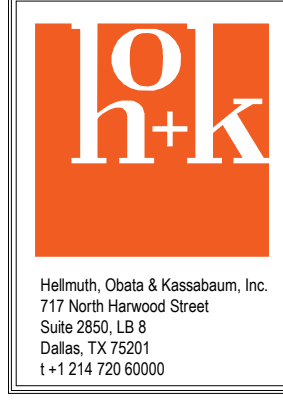

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1.	2021-02-23	30% DESIGN
2.	2021-01-09	70% DESIGN
3.	2022-03-01	100% DESIGN
4.	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS

ARCH WAYFINDING GARAGE A PLAN - LEVEL D


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

D
C
B
A

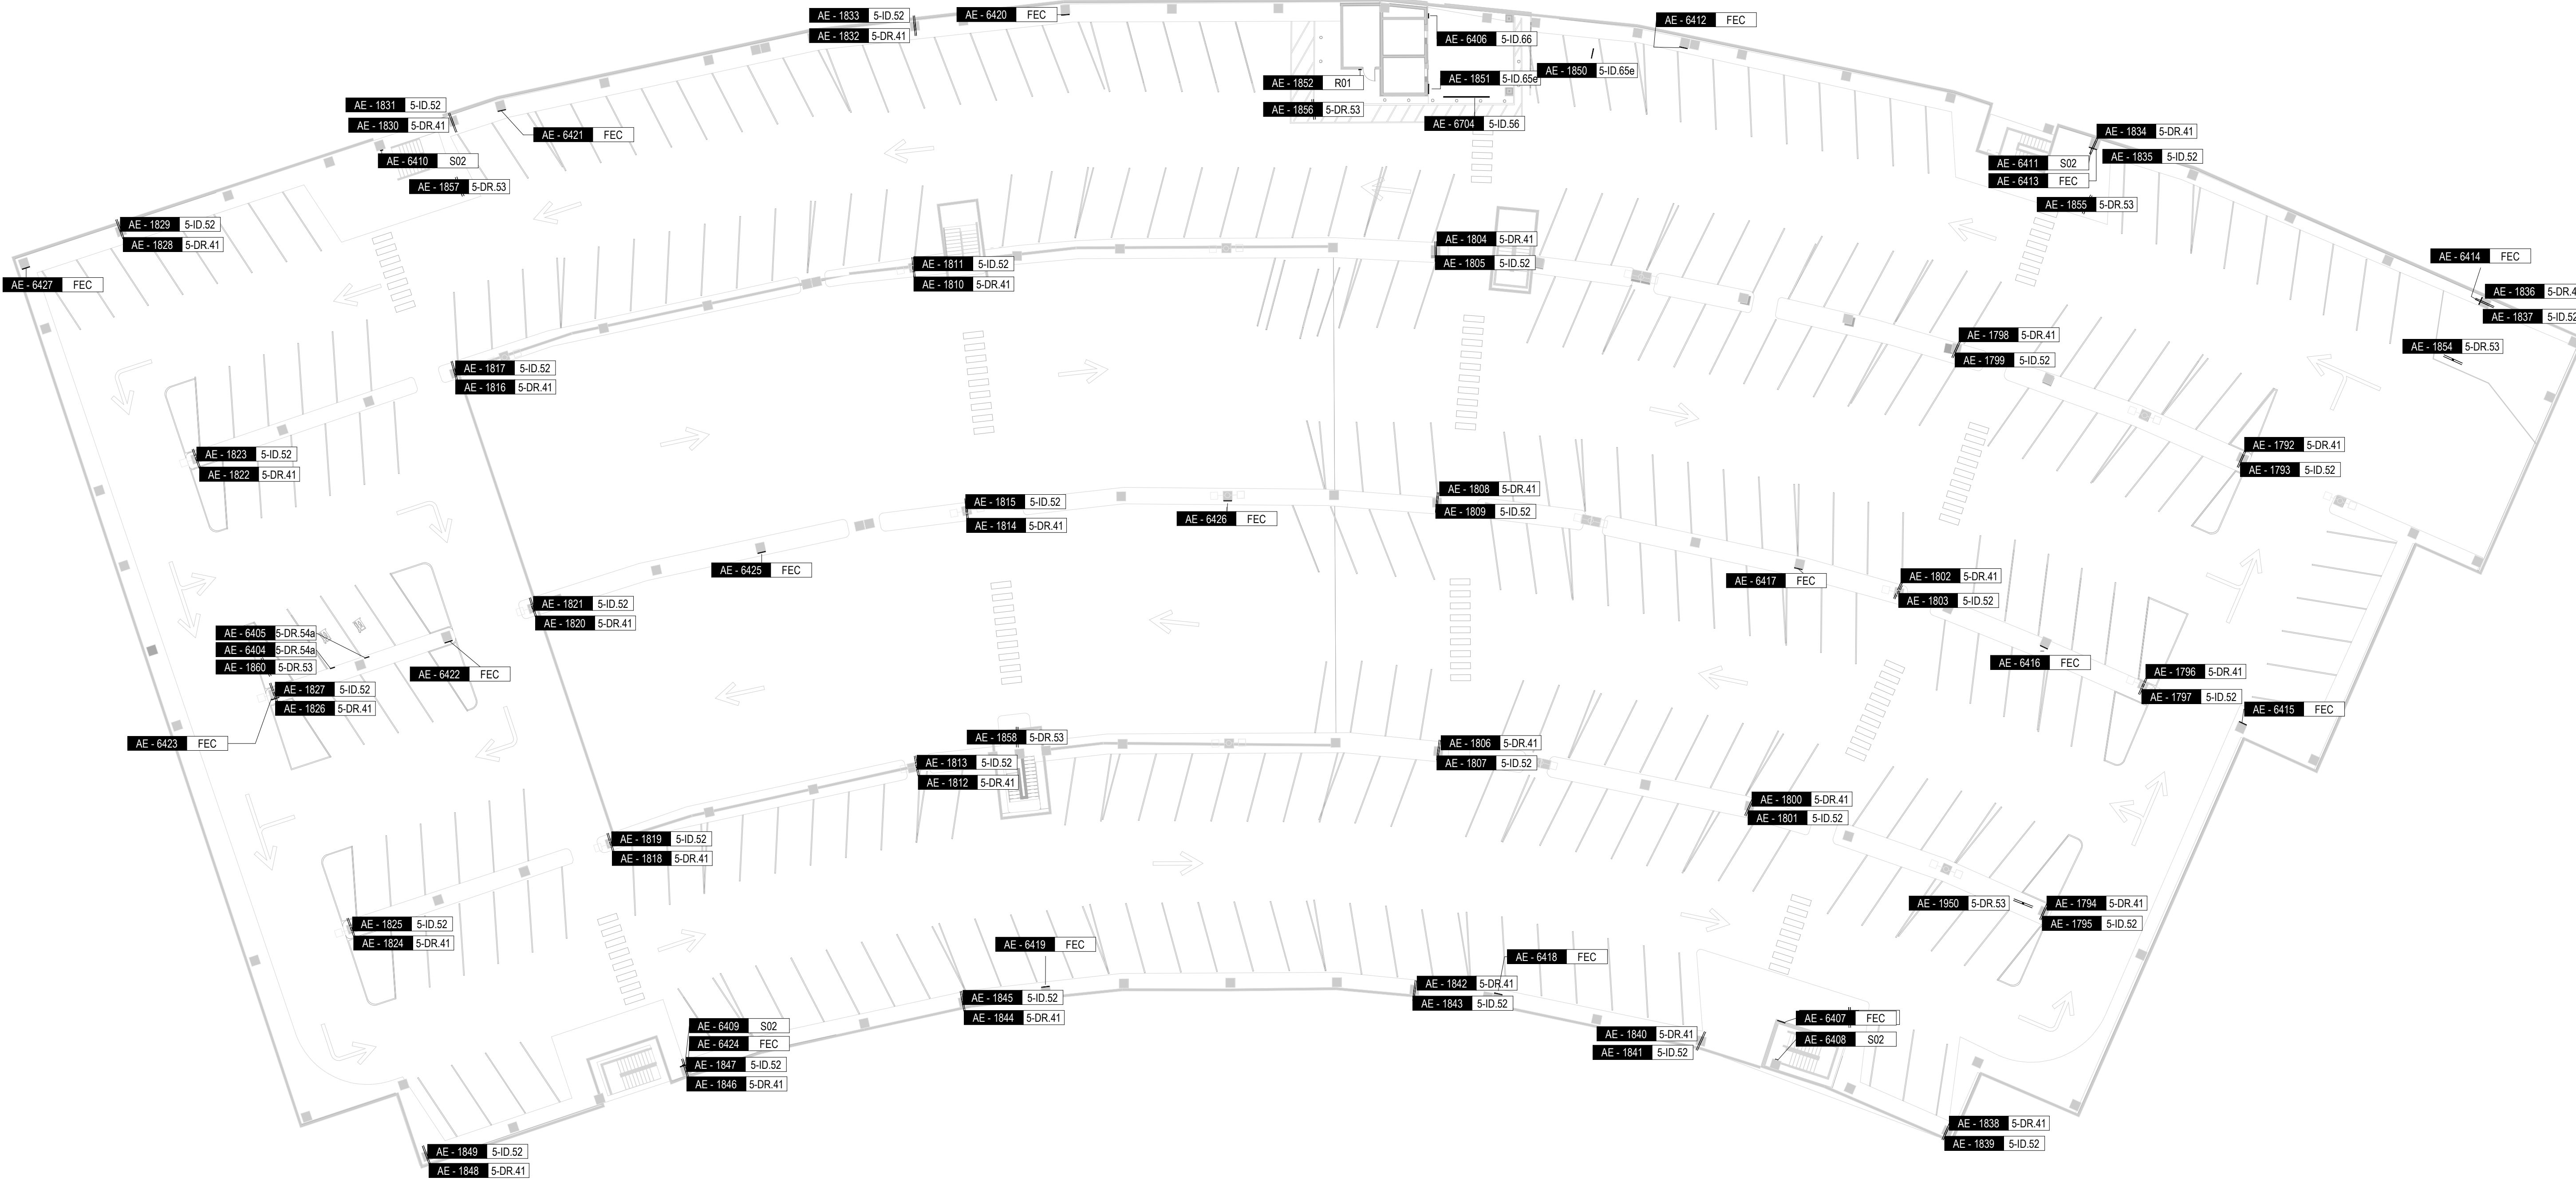

1 GARAGE A - LEVEL E
3/64" = 1'-0"


GENERAL NOTE

- REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
- REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.


SHEET NOTE

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TPOOT R/S-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE


LEGEND

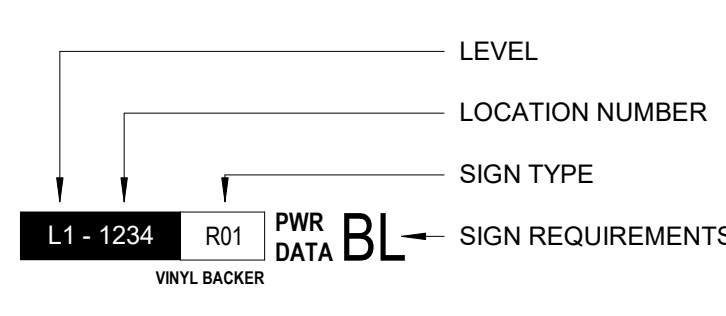

KEY PLAN

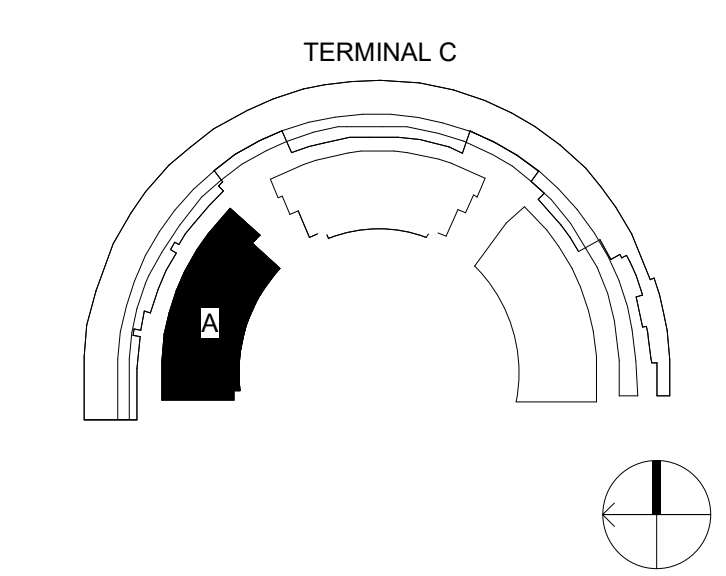

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

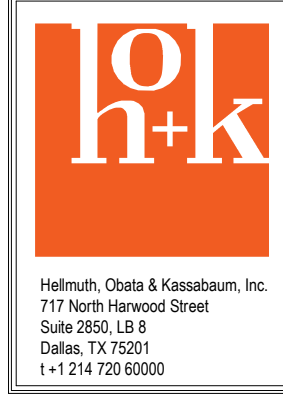

Hobbs, Clark & Koenigsmann, Inc.
717 North Memorial Street
Dallas, TX 75201
1+1214 722 6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-02-23	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS
ARCH WAYFINDING GARAGE A PLAN - LEVEL E
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
AG105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


GENERAL NOTES

1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.


SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TPOOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Informational
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

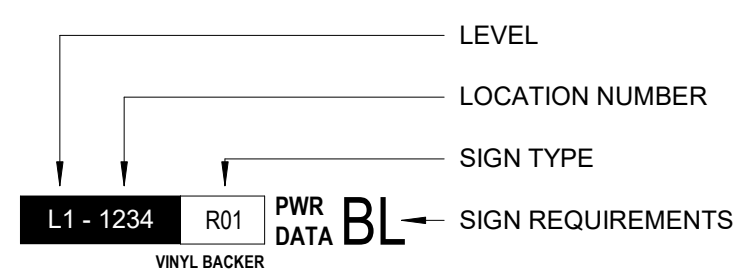


KEY PLAN

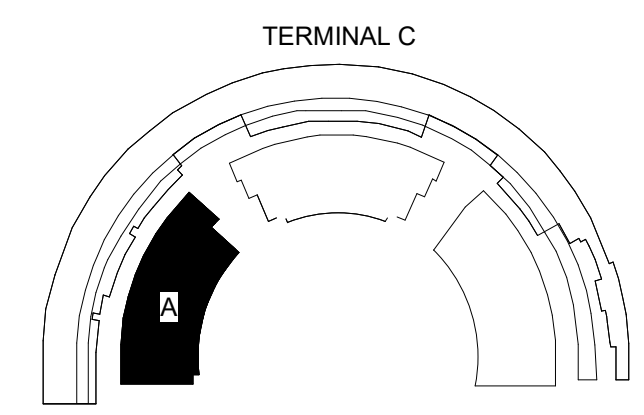

① COLUMN SIGNS - GARAGE A - LEVEL A
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

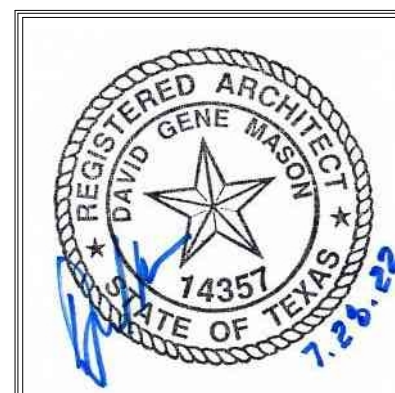

Hobbs, Clark & Koenigsmann, Inc.
717 North Memorial Street
Suite 2050, LB #
Dallas, TX 75201
1-214-722-6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	100% ISSUED FOR PERMIT (APP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS


ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL A

PERMIT NUMBER: 822-0022

SHEET NUMBER

AG201-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

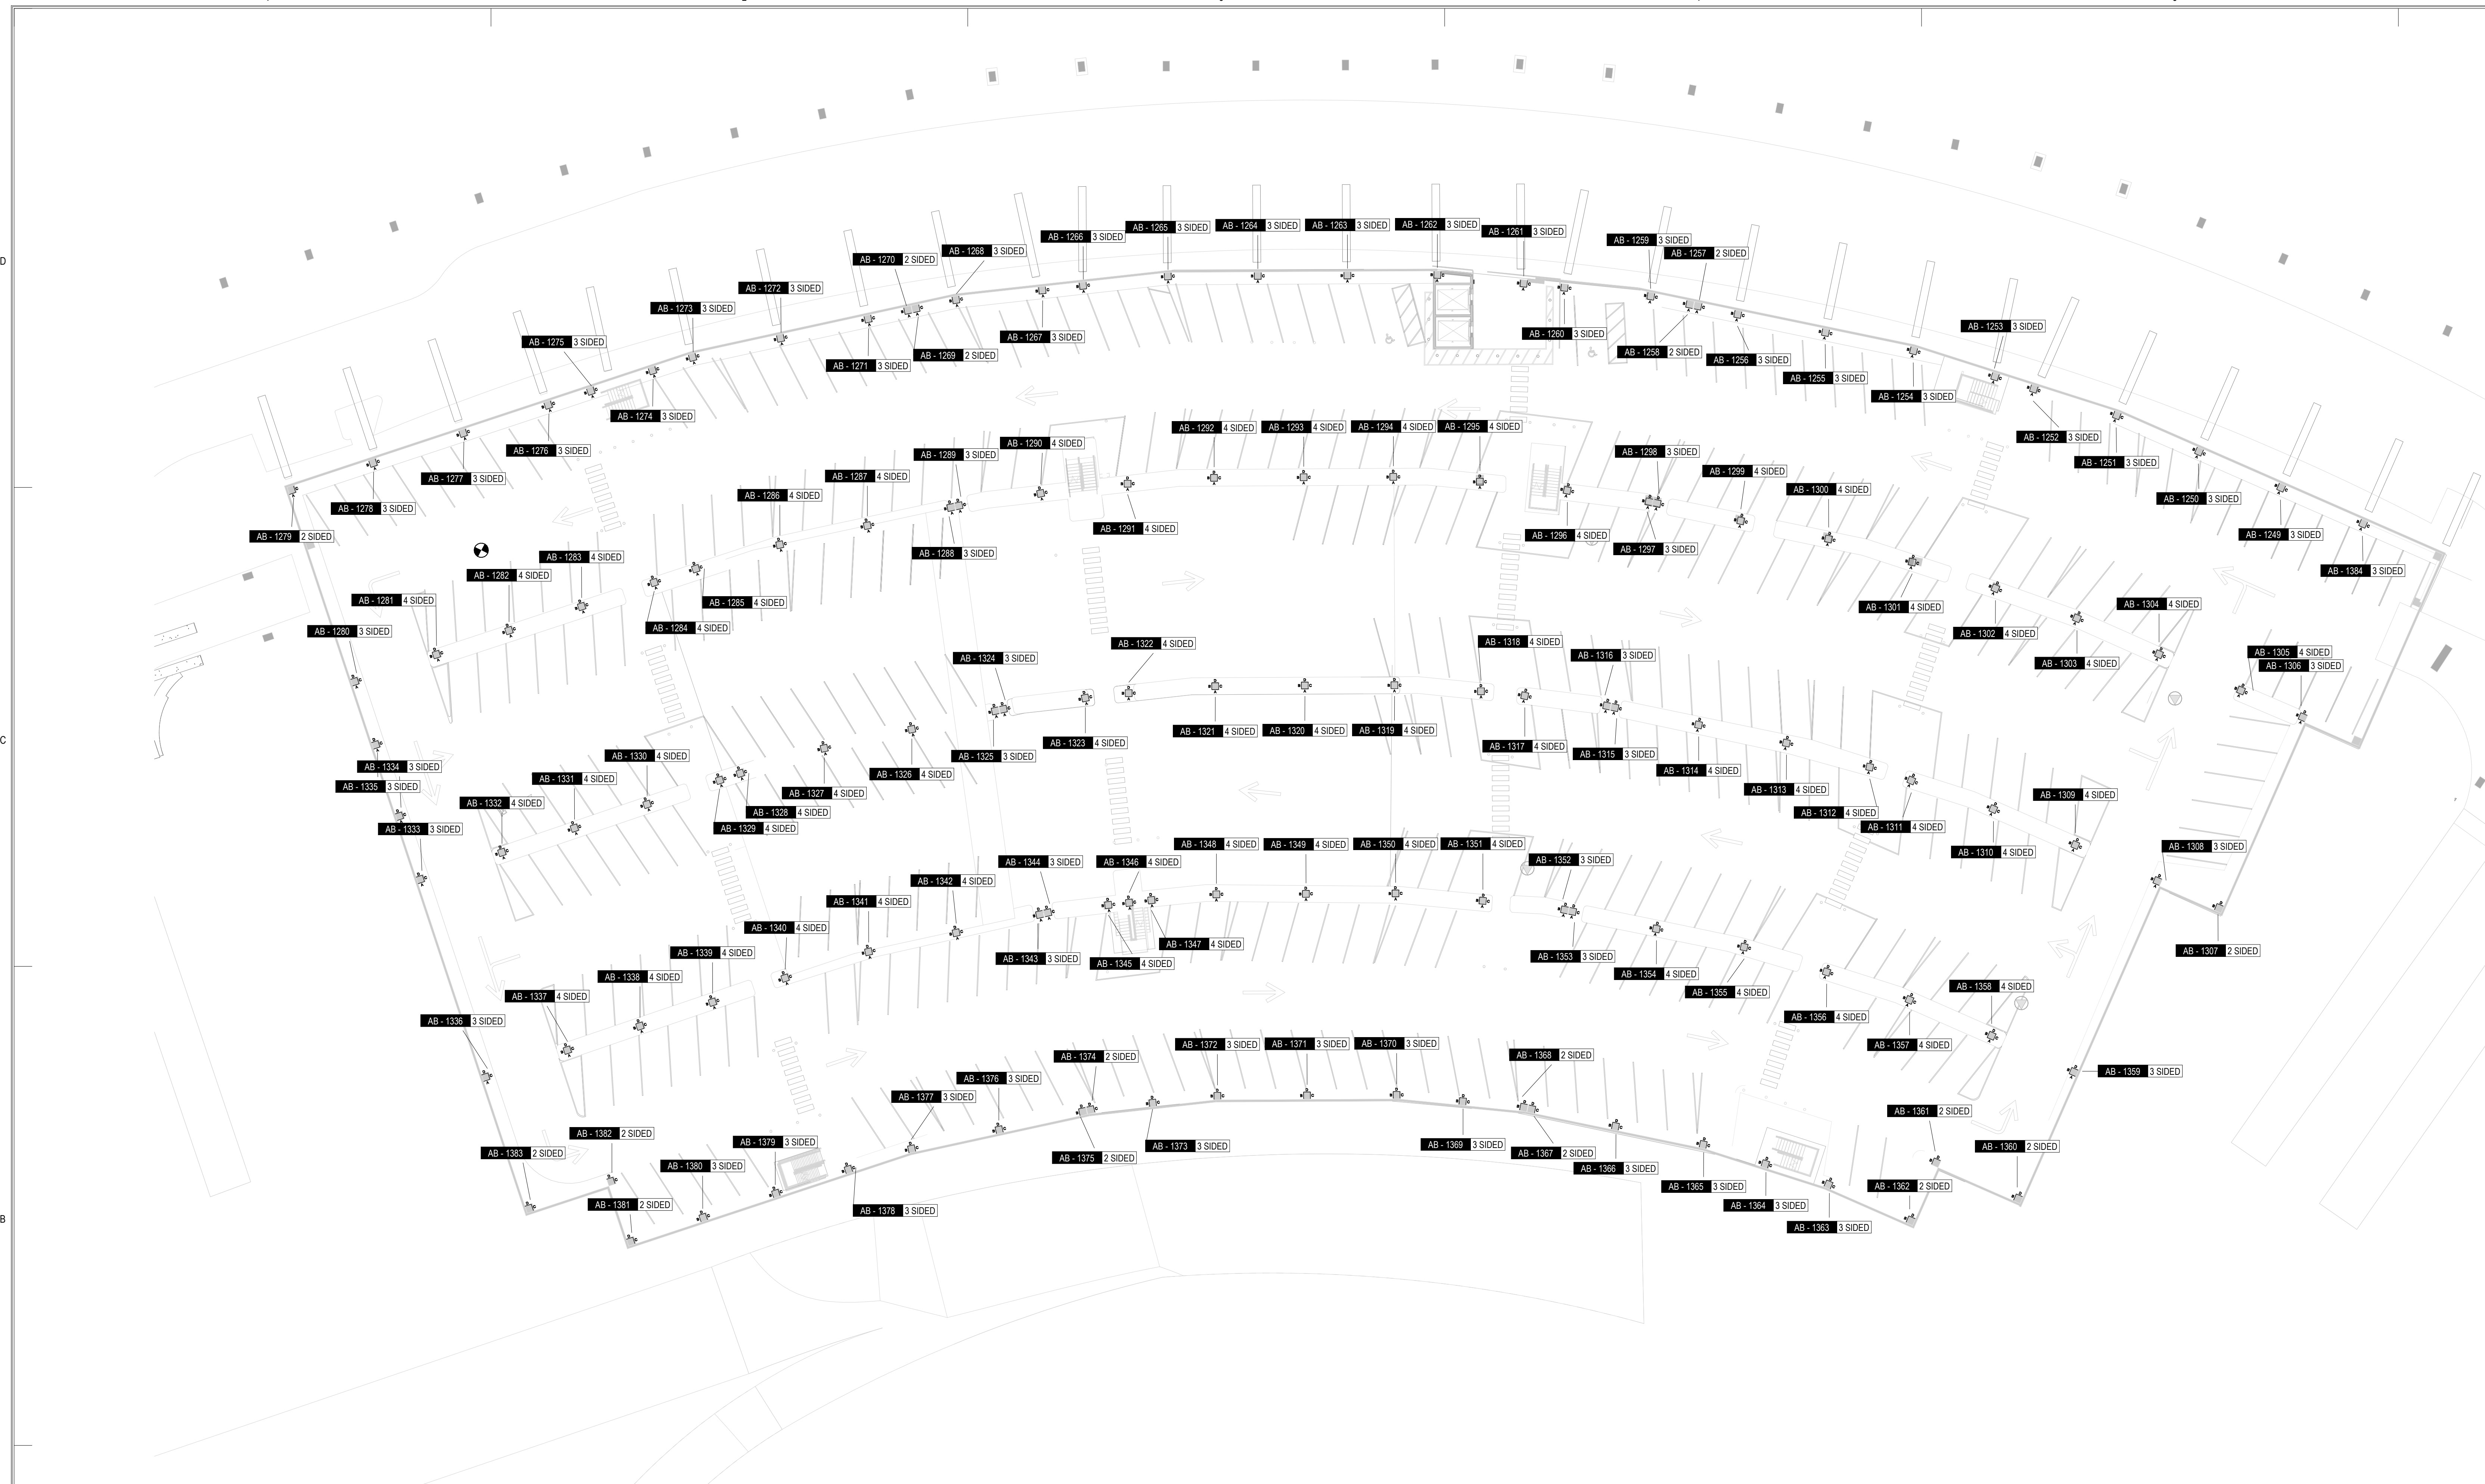

① COLUMN SIGNS - GARAGE A - LEVEL B
3/64" = 1'-0"


GENERAL NOTES

1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.


SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.02	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Information
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE


LEGEND

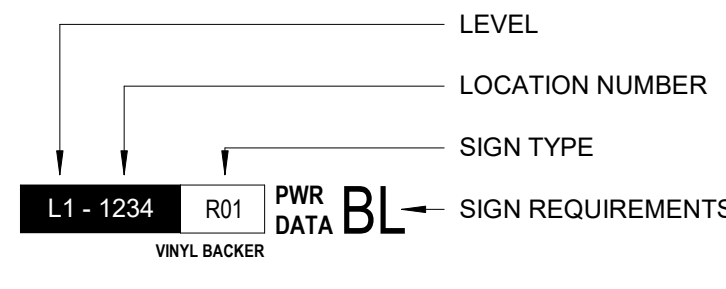

KEY PLAN

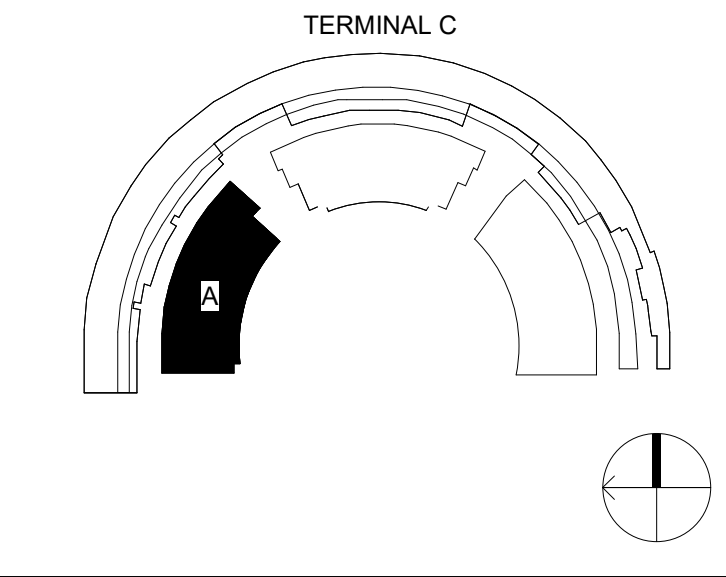

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

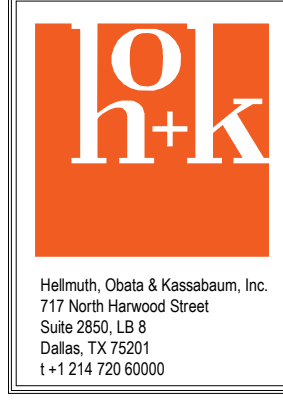

Hobbs, Clark & Kohnstamm, Inc.
717 North Memorial Street
Dallas, TX 75201
1-214-722-6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
4	2022-07-28	100% ISSUED FOR PERMIT (APP)

**DFW TERMINAL C GARAGE AND ROADWAYS
ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL B**

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG202-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


GENERAL NOTES

1. REFER TO AG5 SERIES FOR DESIGN INTENT, COLOR, AND INSTALLATION GUIDELINES.
2. REFER TO AG6 SERIES FOR MESSAGE SCHEDULES.


SIGN TYPE LIST

SIGN TYPE	SIGN DESCRIPTION
S-DR.03	VEHICULAR - Up-Down Trailblazer
S-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
S-DR.08	VEHICULAR - Exit Trailblazer
S-DR.19	VEHICULAR - Garage Ramp Entry Directional
S-DR.31	PEDESTRIAN - Terminal Trailblazer
S-DR.41	PEDESTRIAN - Terminal Trailblazer
S-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
S-DR.54a	POLE MOUNT CHARGING STATION
S-ID.01	VEHICULAR - Ramp Entry ID Graphics
S-ID.20	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
S-ID.21	OVERHEAD ENTRY SIGN
S-ID.25	VEHICULAR - GARAGE TOTEM SIGN
S-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
S-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
S-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
S-ID.54	PEDESTRIAN - VALET PARKING ID
S-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
S-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
S-ID.66	WALL MOUNT ASSISTANCE ID
S-ID.67	FLIP ID
S-IN.01	VEHICULAR - Roadside Level ID Space Count Informational
S-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
S-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

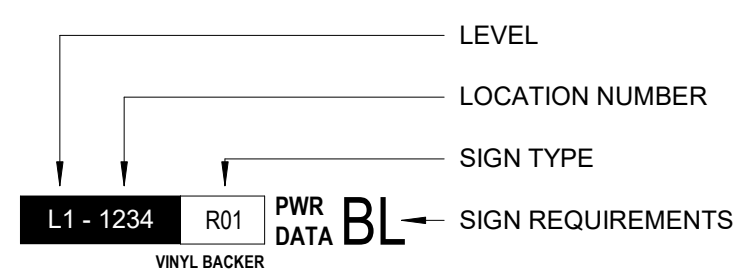

KEY PLAN

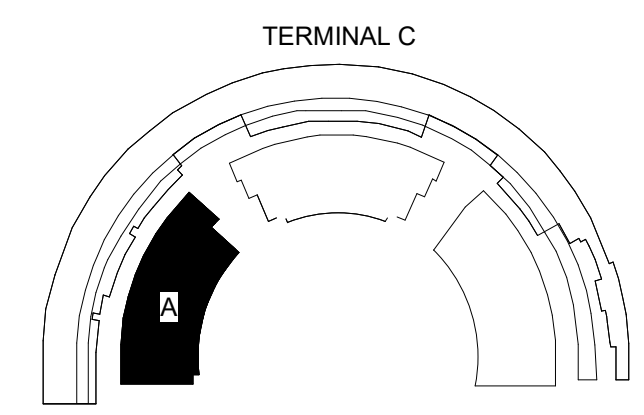

① COLUMN SIGNS - GARAGE A - LEVEL C
3/64" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



Hobbs, Clark & Koenigsmann, Inc.
717 North Memorial Street
Dallas, TX 75201
1-214-728-6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
4	2022-07-28	100% ISSUED FOR PERMIT (APP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS

ARCH WAYFINDING GARAGE A COLUMN PLAN - LEVEL C

PERMIT NUMBER: 822-0022


SHEET NUMBER

AG203-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

REFLECTIVE	5 DR.0	DIRECTIONAL	CEILING SUSPENDED	VEHICULAR - UP/DOWN TRAFFIC	1 direction, 1 or 2 sides
------------	--------	-------------	-------------------	-----------------------------	---------------------------


GENERAL NOTES
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.

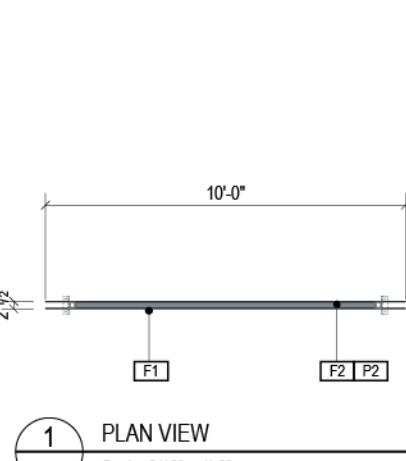


1 PLAN VIEW
Scale: 3/16" = 1'-0"

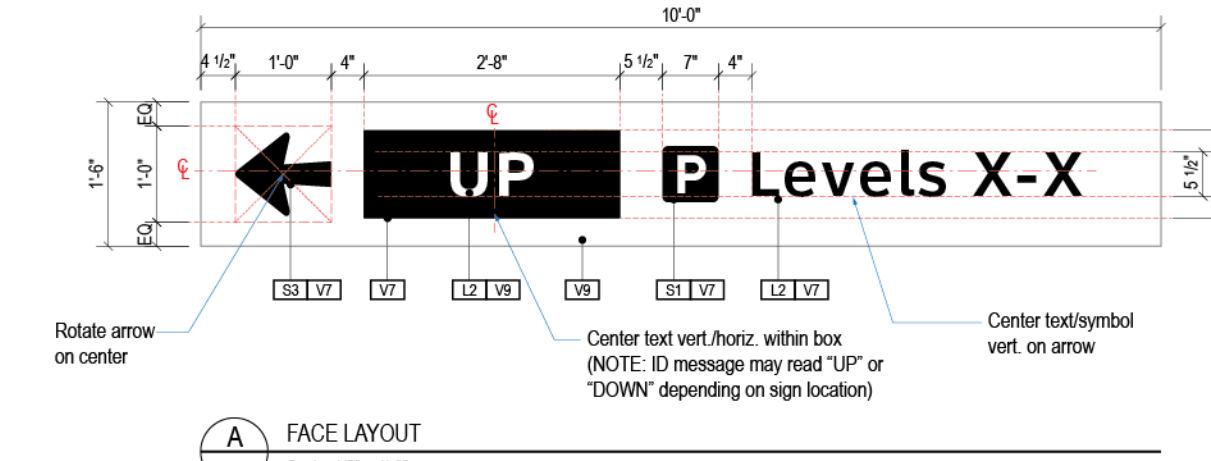


A FACE LAYOUT
Scale: 1/2" = 1'-0"

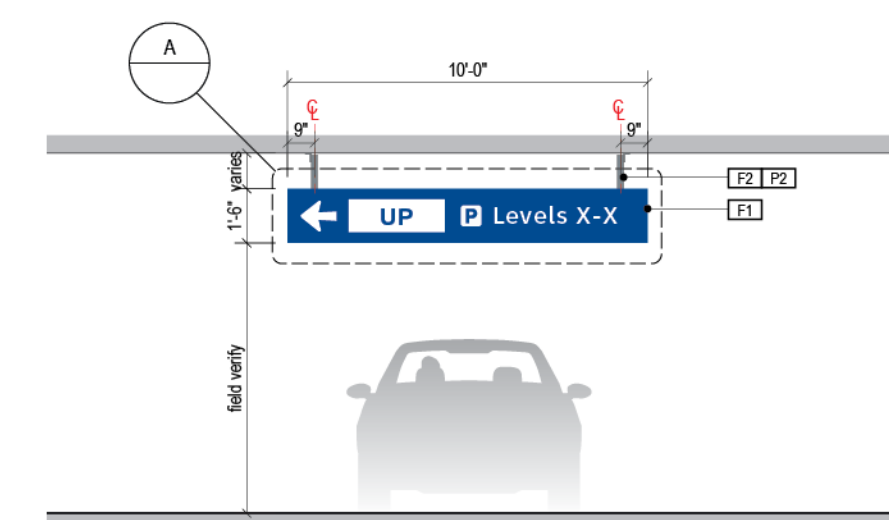

2 ELEVATION
Scale: 3/16" = 1'-0"

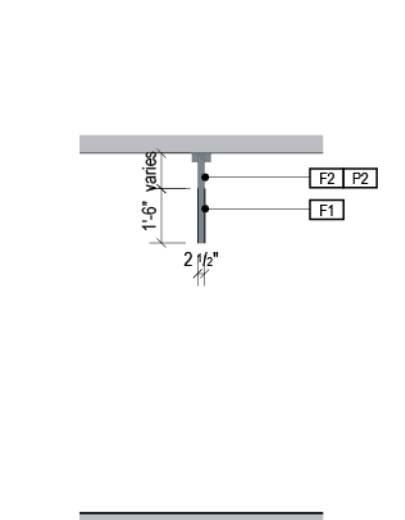

3 END VIEW
Scale: 3/16" = 1'-0"

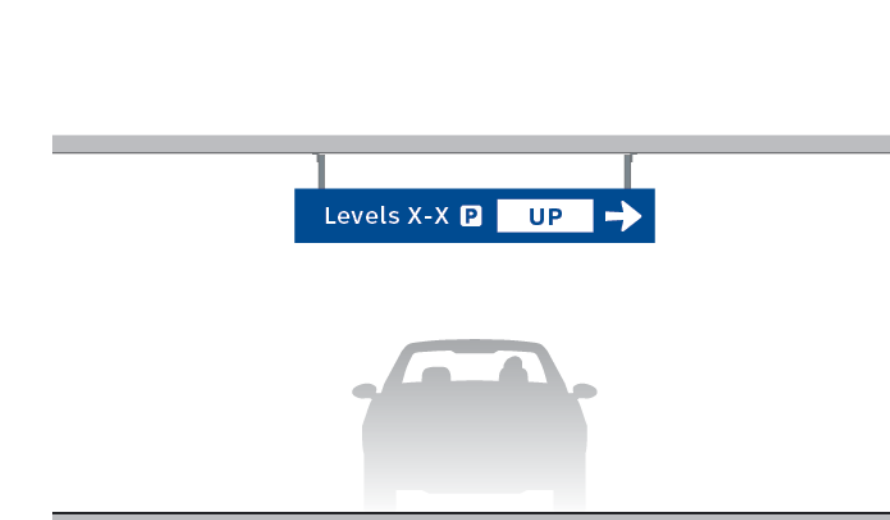


4 ELEVATION (OPPOSITE SIDE)
Scale: 3/16" = 1'-0"

- FABRICATION NOTES**
1. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 2. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 3. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 4. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.


- GRAPHICS / COLORS / DECORATION NOTES**
1. Typeface: font - Clearview Text Medium
 2. Universal Symbols: ADA/VI/DOCS style symbol artwork
 3. Veh. Arrows: use only official MUTCD/DOCS arrow art
 4. Vinyl: FLM / DIGITAL PRINT
 5. White: 3M 4395 DGG White (Fluorescent)
 6. Blue: 3M 4395 DGG Blue (Fluorescent)
 7. Paint: Silver Mattress Paint #48P3118 Brushed Aluminum, satin finish

REFLECTIVE	5 DR.07	DIRECTIONAL	CEILING SUSPENDED	VEHICULAR - Directional w/ 2 message per direction, 2 directions, 1 or 2 sides
------------	---------	-------------	-------------------	--


GENERAL NOTES
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.

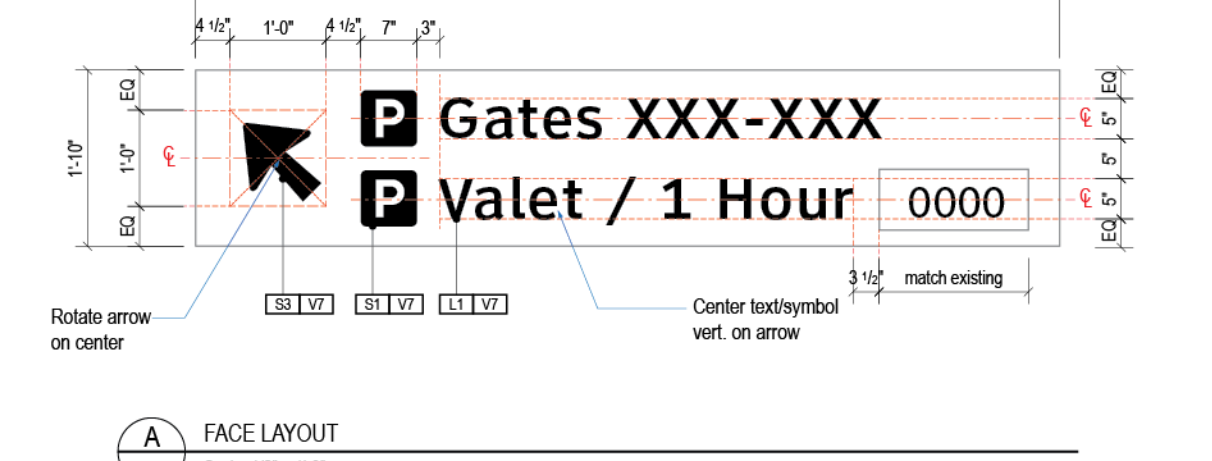


1 PLAN VIEW
Scale: 3/16" = 1'-0"

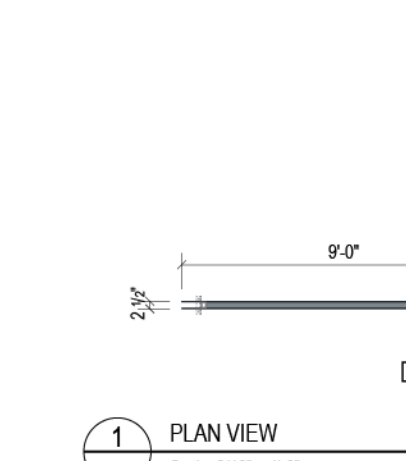


A FACE LAYOUT
Scale: 1/2" = 1'-0"

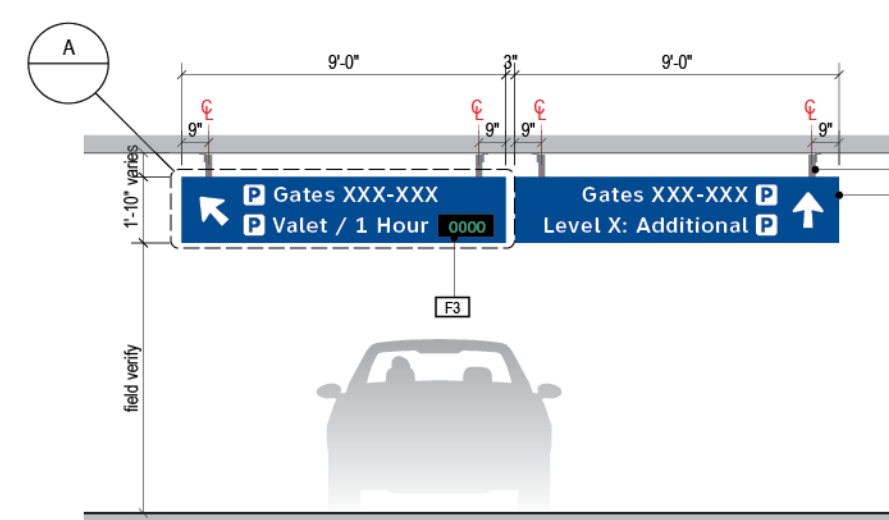

2 ELEVATION
Scale: 3/16" = 1'-0"

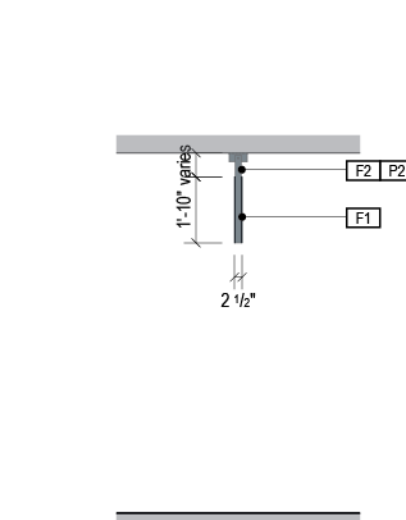

3 END VIEW
Scale: 3/16" = 1'-0"

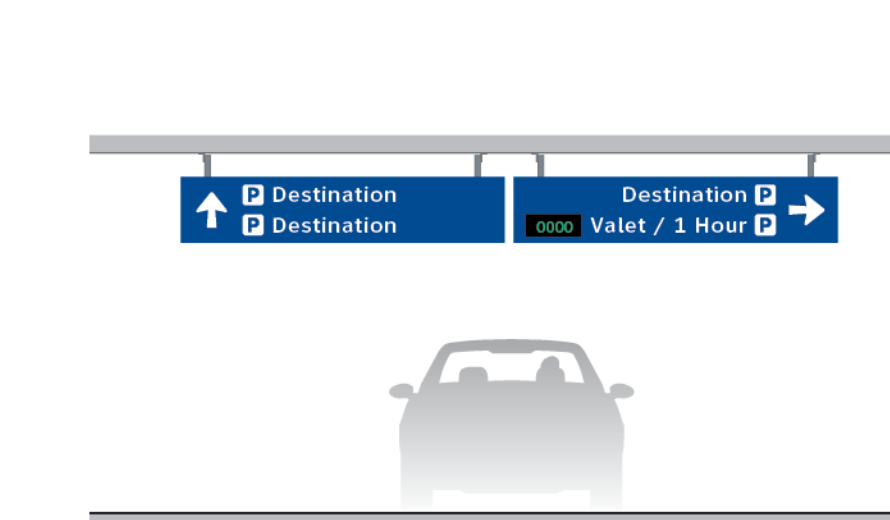


4 ELEVATION (OPPOSITE SIDE)
Scale: 3/16" = 1'-0"

- FABRICATION NOTES**
1. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 2. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 3. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 4. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.


- GRAPHICS / COLORS / DECORATION NOTES**
1. Typeface: font - Clearview Text Medium
 2. Universal Symbols: ADA/VI/DOCS style symbol artwork
 3. Veh. Arrows: use only official MUTCD/DOCS arrow art
 4. Vinyl: FLM / DIGITAL PRINT
 5. White: 3M 4395 DGG White (Fluorescent)
 6. Blue: 3M 4395 DGG Blue (Fluorescent)
 7. Paint: Silver Mattress Paint #48P3118 Brushed Aluminum, satin finish

REFLECTIVE / DYNAMIC LED	5 DR.07A	DIRECTIONAL	CEILING SUSPENDED	VEHICULAR - Directional w/ 2 messages per direction, 2 directions, 1 or 2 sides
--------------------------	----------	-------------	-------------------	---


GENERAL NOTES
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.

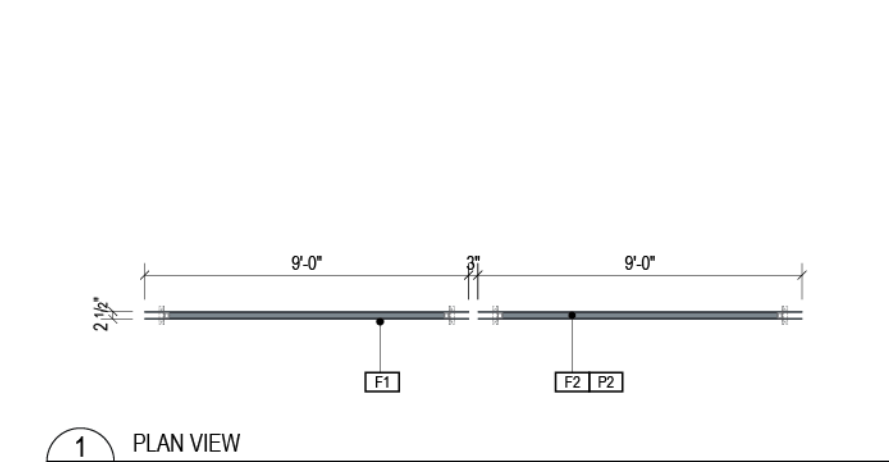


1 PLAN VIEW
Scale: 3/16" = 1'-0"

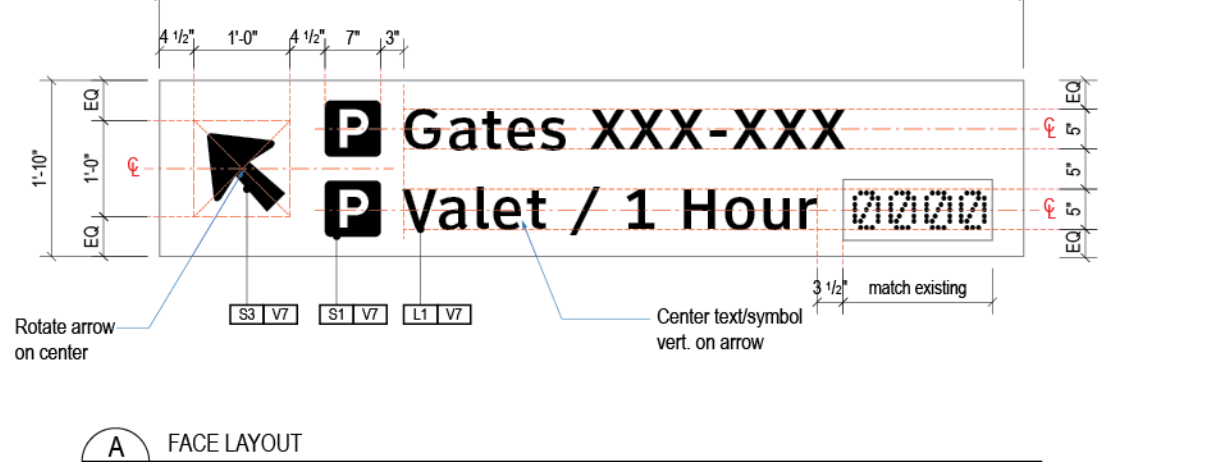


A FACE LAYOUT
Scale: 1/2" = 1'-0"

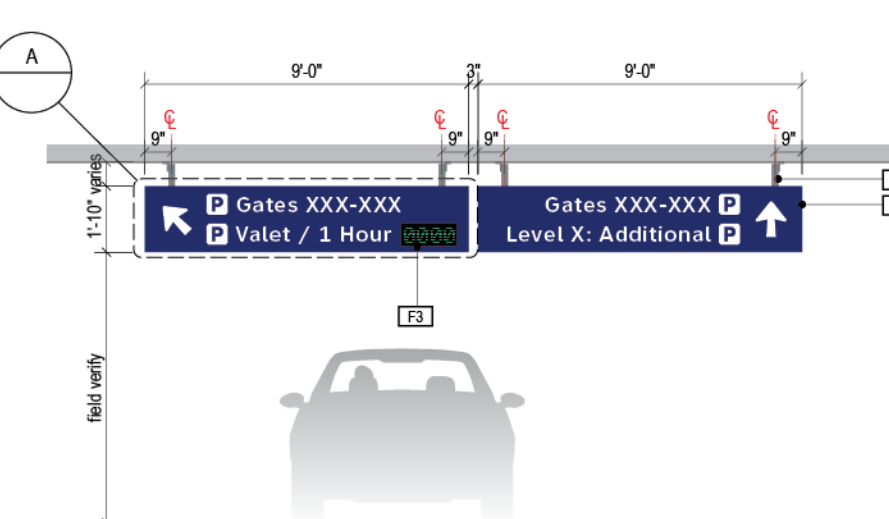

2 ELEVATION
Scale: 3/16" = 1'-0"

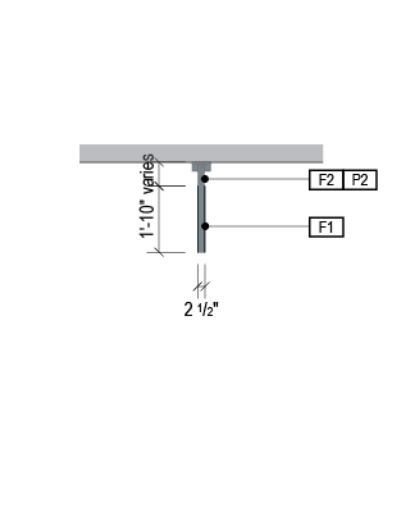

3 END VIEW
Scale: 3/16" = 1'-0"

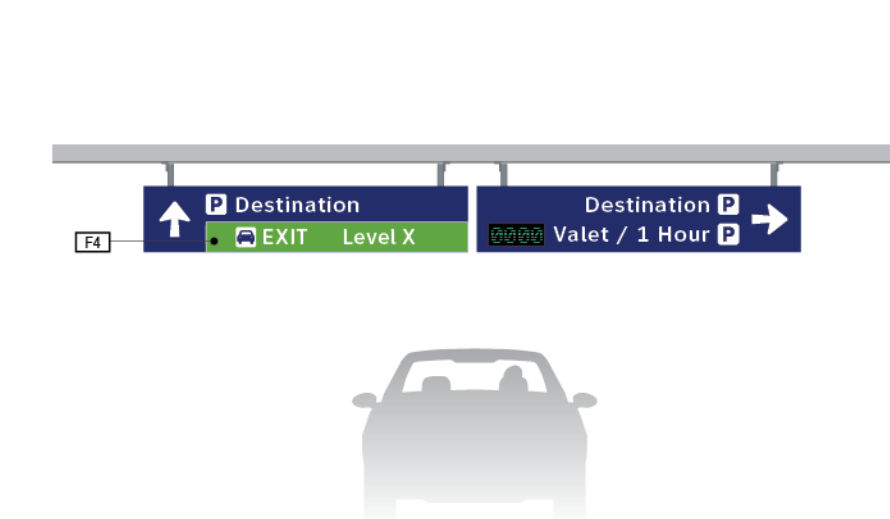


4 ELEVATION (OPPOSITE SIDE)
Scale: 3/16" = 1'-0"

- FABRICATION NOTES**
1. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 2. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 3. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 4. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.


- GRAPHICS / COLORS / DECORATION NOTES**
1. Typeface: font - Clearview Text Medium
 2. Universal Symbols: ADA/VI/DOCS style symbol artwork
 3. Veh. Arrows: use only official MUTCD/DOCS arrow art
 4. Vinyl: FLM / DIGITAL PRINT
 5. Light Green: match PMS 382C
 6. White: 3M 4395 DGG White (Fluorescent)
 7. Blue: 3M 4395 DGG Blue (Fluorescent)
 8. Paint: Silver Mattress Paint #48P3118 Brushed Aluminum, satin finish
 9. Dynamic Space Court Art: by others
 10. Exit sign required on both sides for heavy traffic locations

REFLECTIVE	5 DR.08	DIRECTIONAL	CEILING SUSPENDED	VEHICULAR - Exit Trafficway, 1 direction, 1 or 2 sides
------------	---------	-------------	-------------------	--


GENERAL NOTES
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.
 All sign designs shall be constructed of structural steel support members, aluminum, stainless steel, and aluminum hardware and fasteners and shall be approved by the Designer for use in the field.

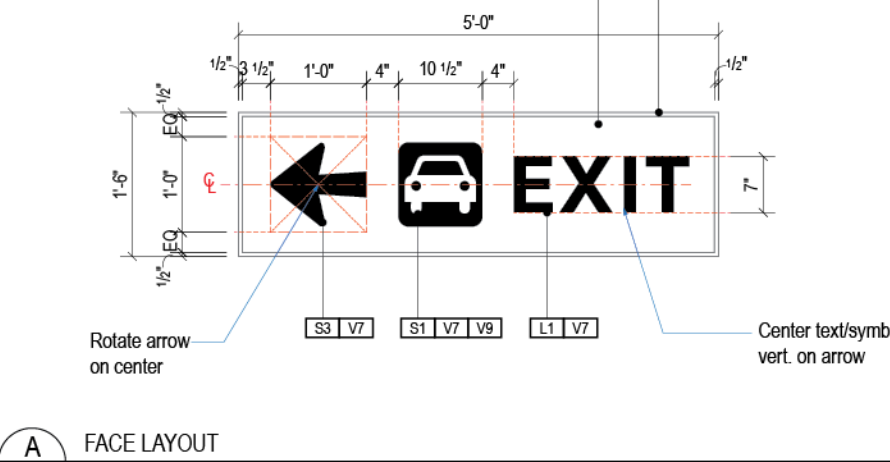


1 PLAN VIEW
Scale: 3/16" = 1'-0"

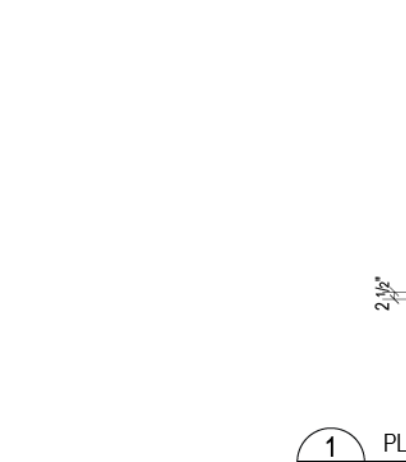


A FACE LAYOUT
Scale: 1/2" = 1'-0"

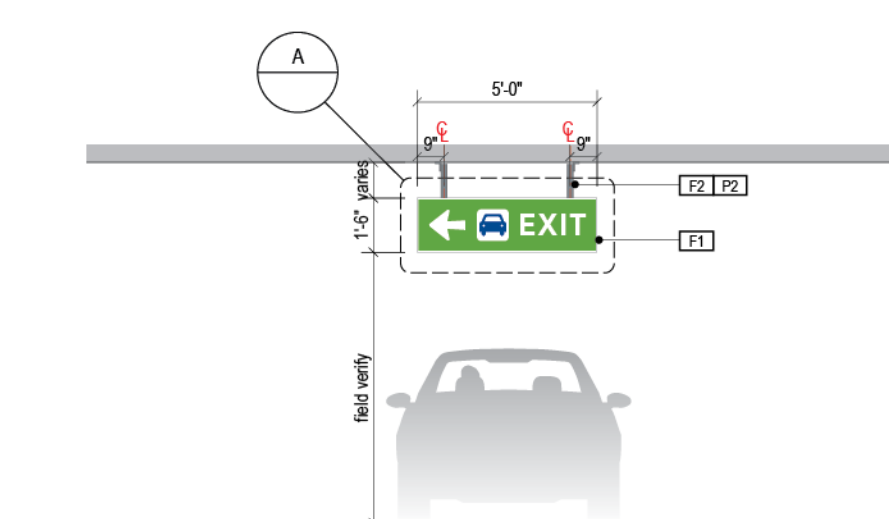

2 ELEVATION
Scale: 3/16" = 1'-0"

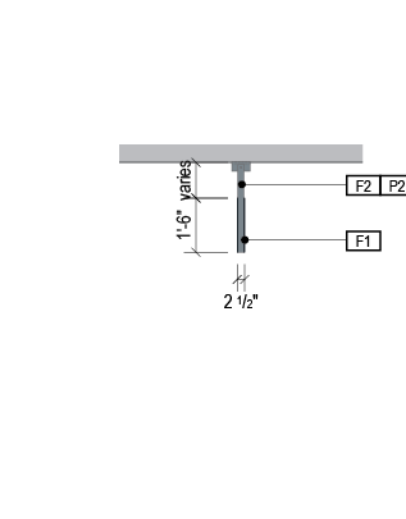


3 END VIEW
Scale: 3/16" = 1'-0"

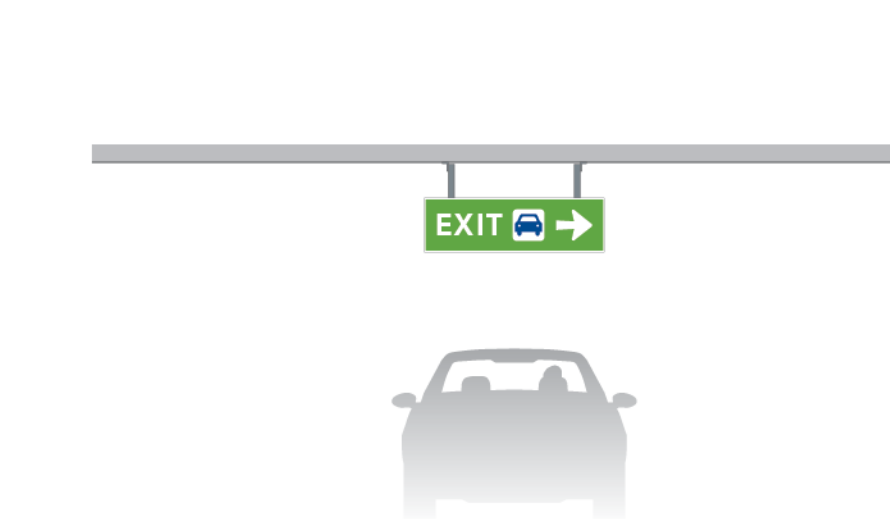

4 ELEVATION (OPPOSITE SIDE)
Scale: 3/16" = 1'-0"

- FABRICATION NOTES**
1. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 2. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 3. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.
 4. SIGN FACE: Fabricated aluminum extrusion frame with stainless steel edge lip sign material construction of extruded aluminum and cast aluminum components with stainless steel hardware. Extruded sign face and sign material. Extruded aluminum support frame with stainless steel hardware and stainless steel sign mounting hardware.

- GRAPHICS / COLORS / DECORATION NOTES**
1. Typeface: font - Clearview Text Medium
 2. Universal Symbols: ADA/VI/DOCS style symbol artwork
 3. Veh. Arrows: use only official MUTCD/DOCS arrow art
 4. Vinyl: FLM / DIGITAL PRINT
 5. Light Green: match PMS 382C
 6. White: 3M 4395 DGG White (Fluorescent)
 7. Blue: 3M 4395 DGG Blue (Fluorescent)
 8. Paint: Silver Mattress Paint #48P3118 Brushed Aluminum, satin finish
 9. Dynamic Space Court Art: by others
 10. Exit sign required on both sides for heavy traffic locations

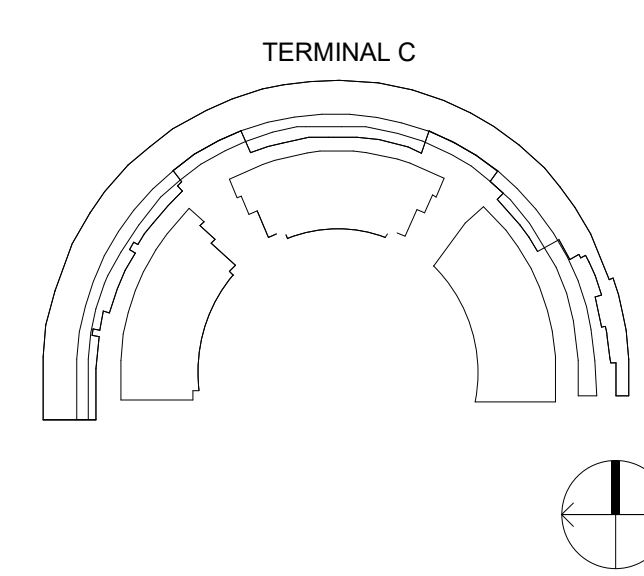

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261



DRAWN BY: AS
 APPROVED BY:
 ISSUE DATE: 2022-07-28










NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
1	2021-10-23	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS
SIGNAGE DETAIL
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
AG502-900

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

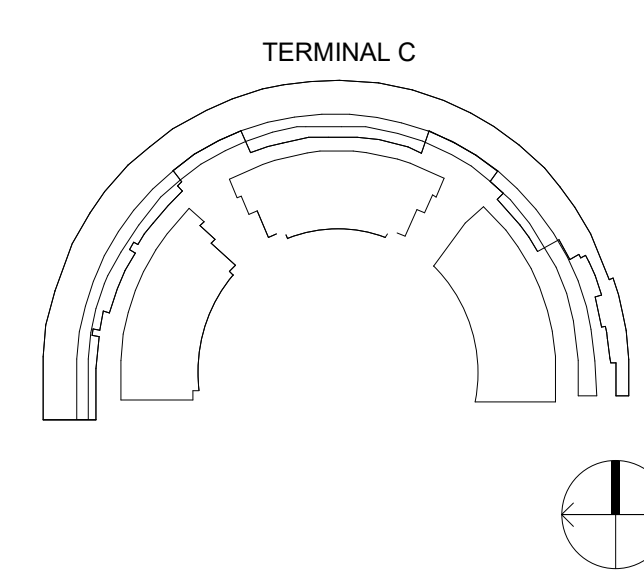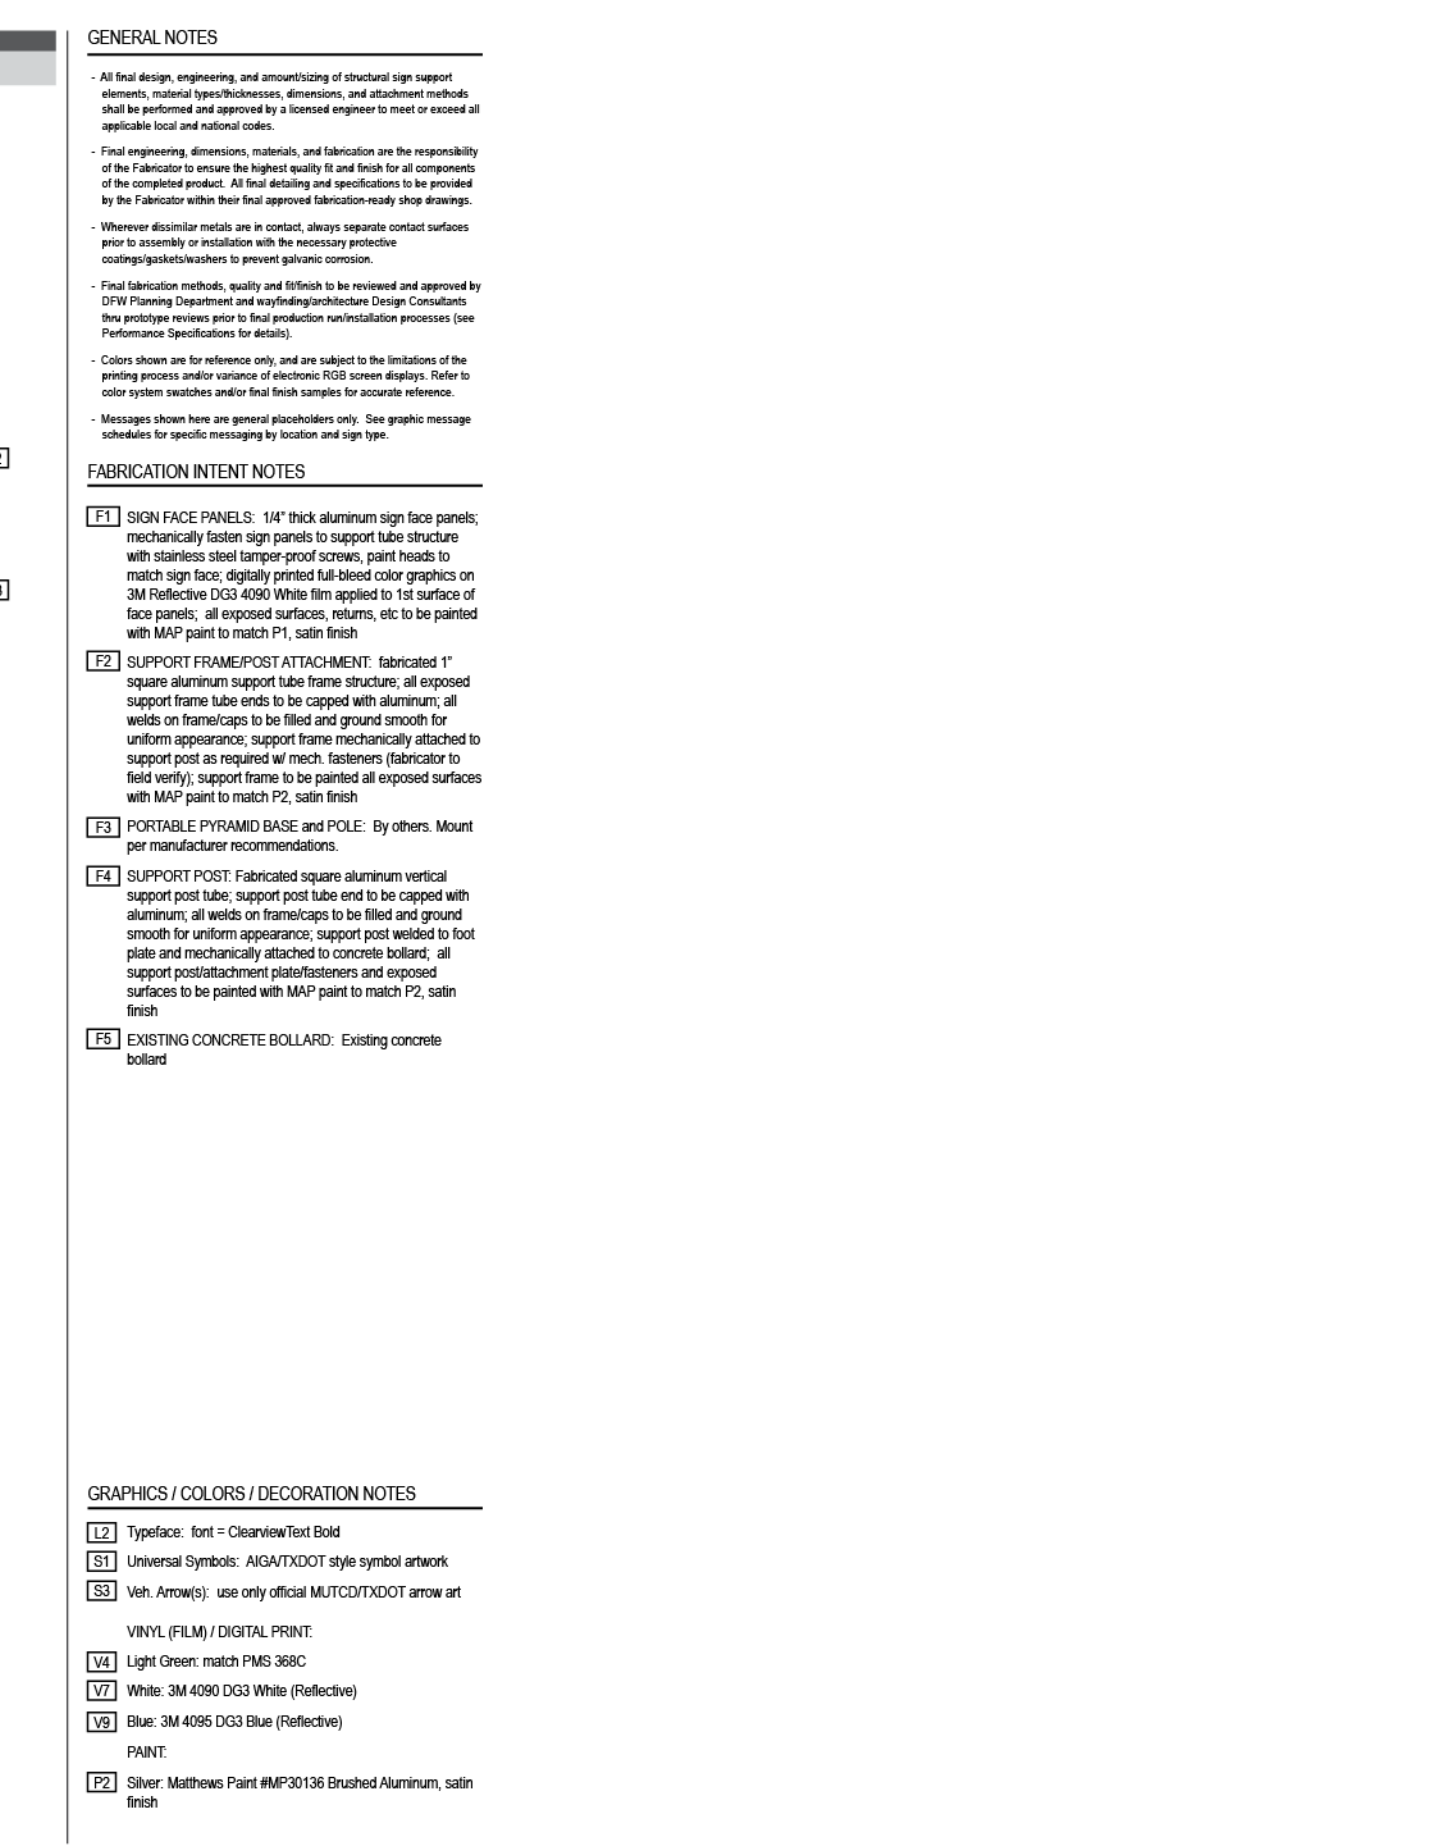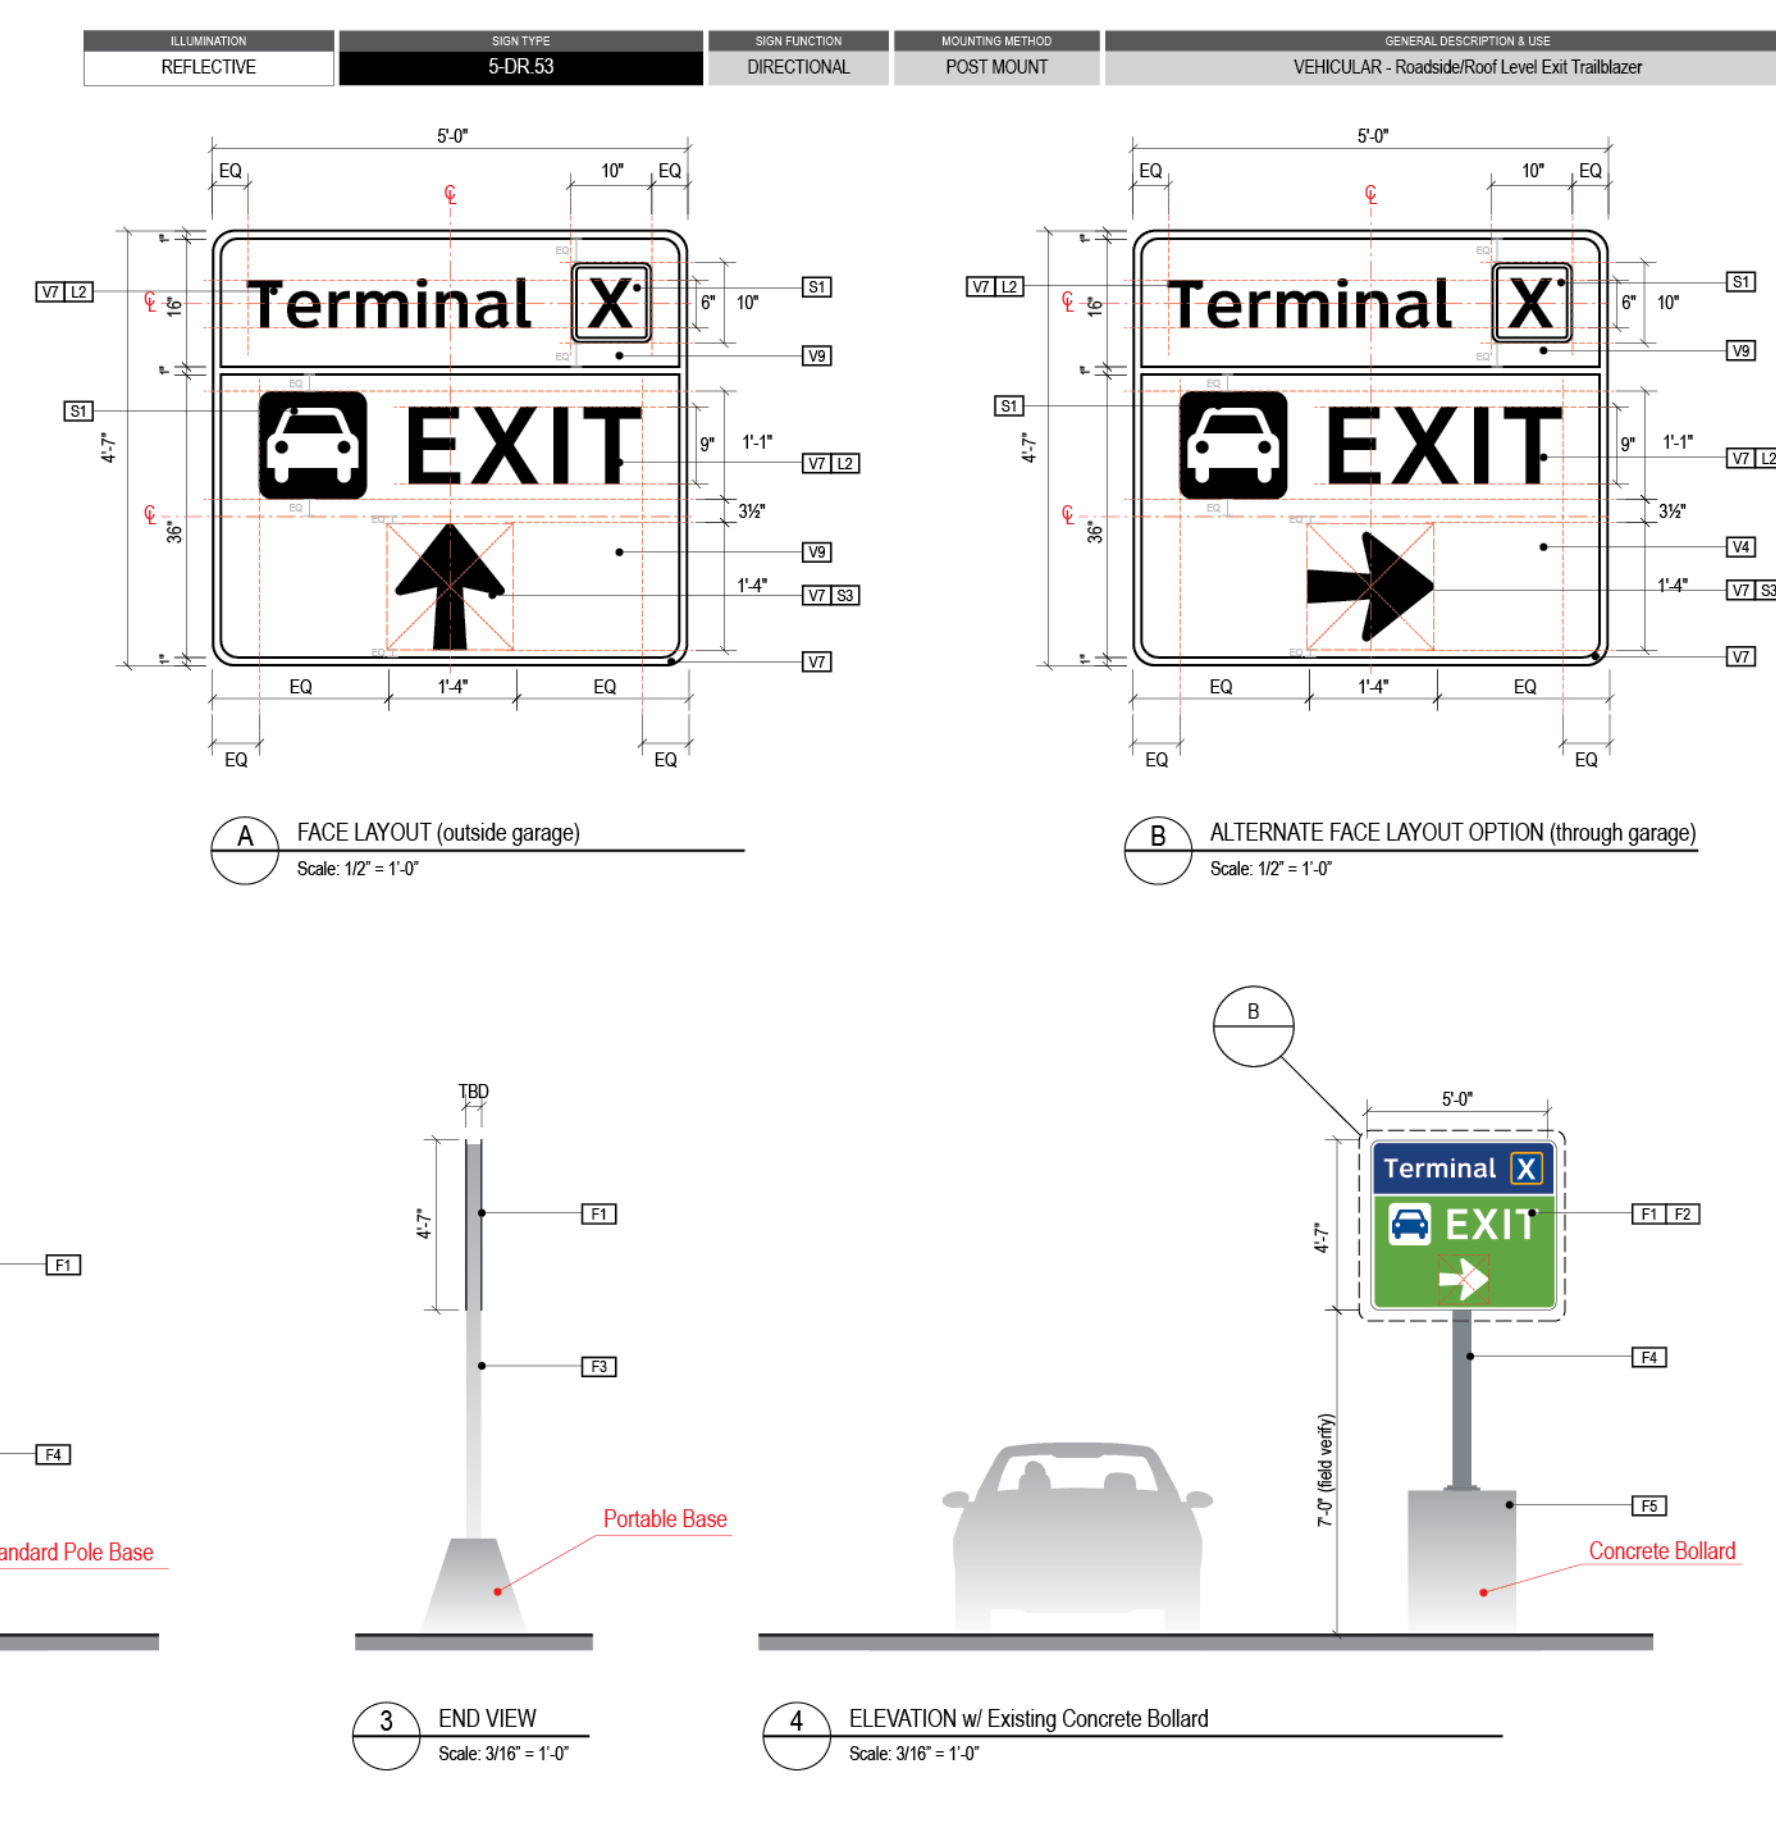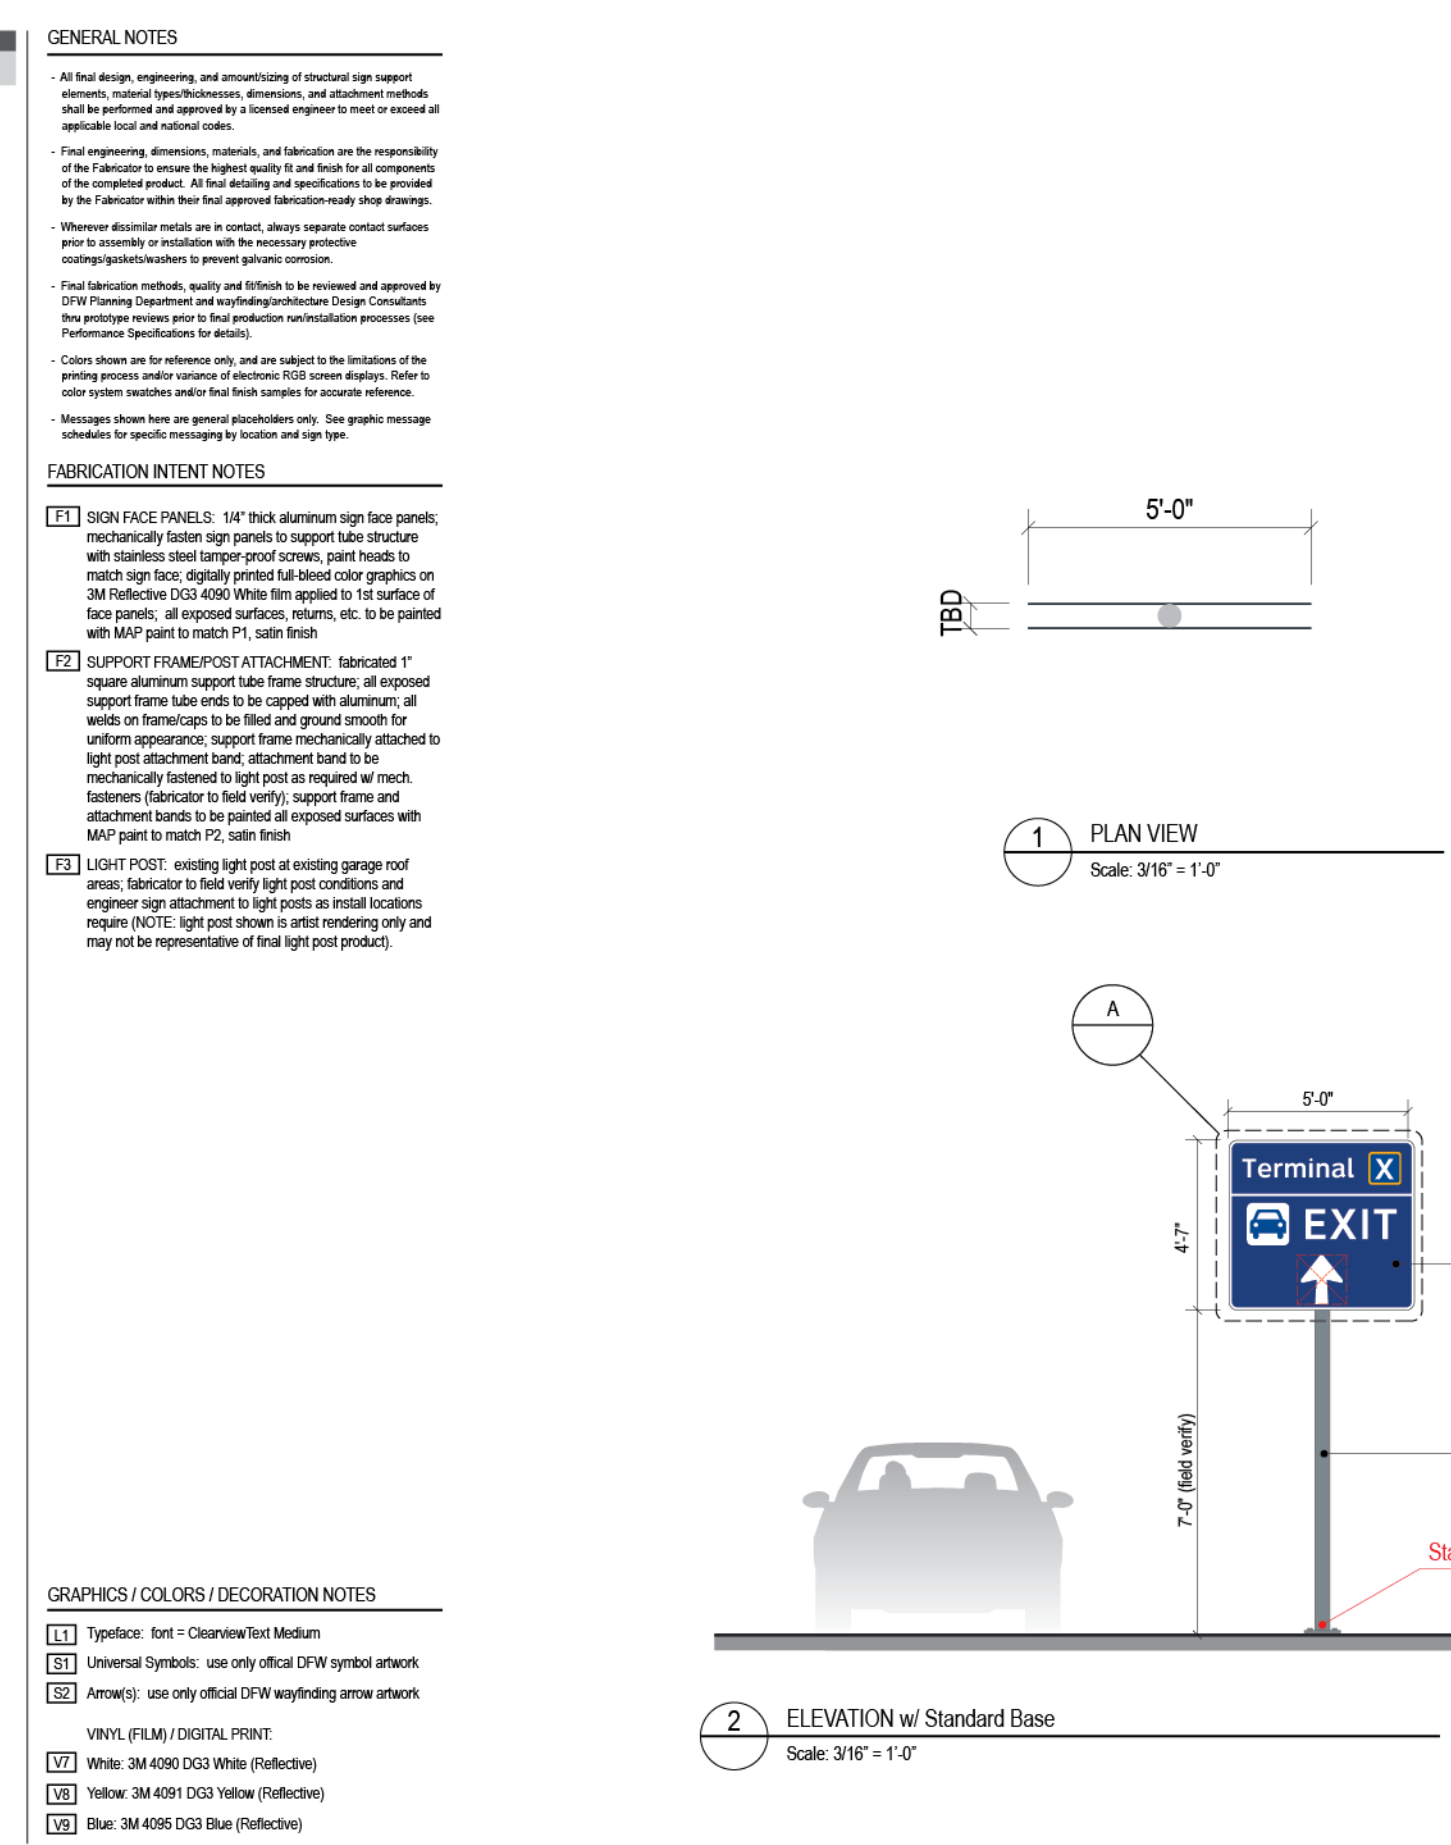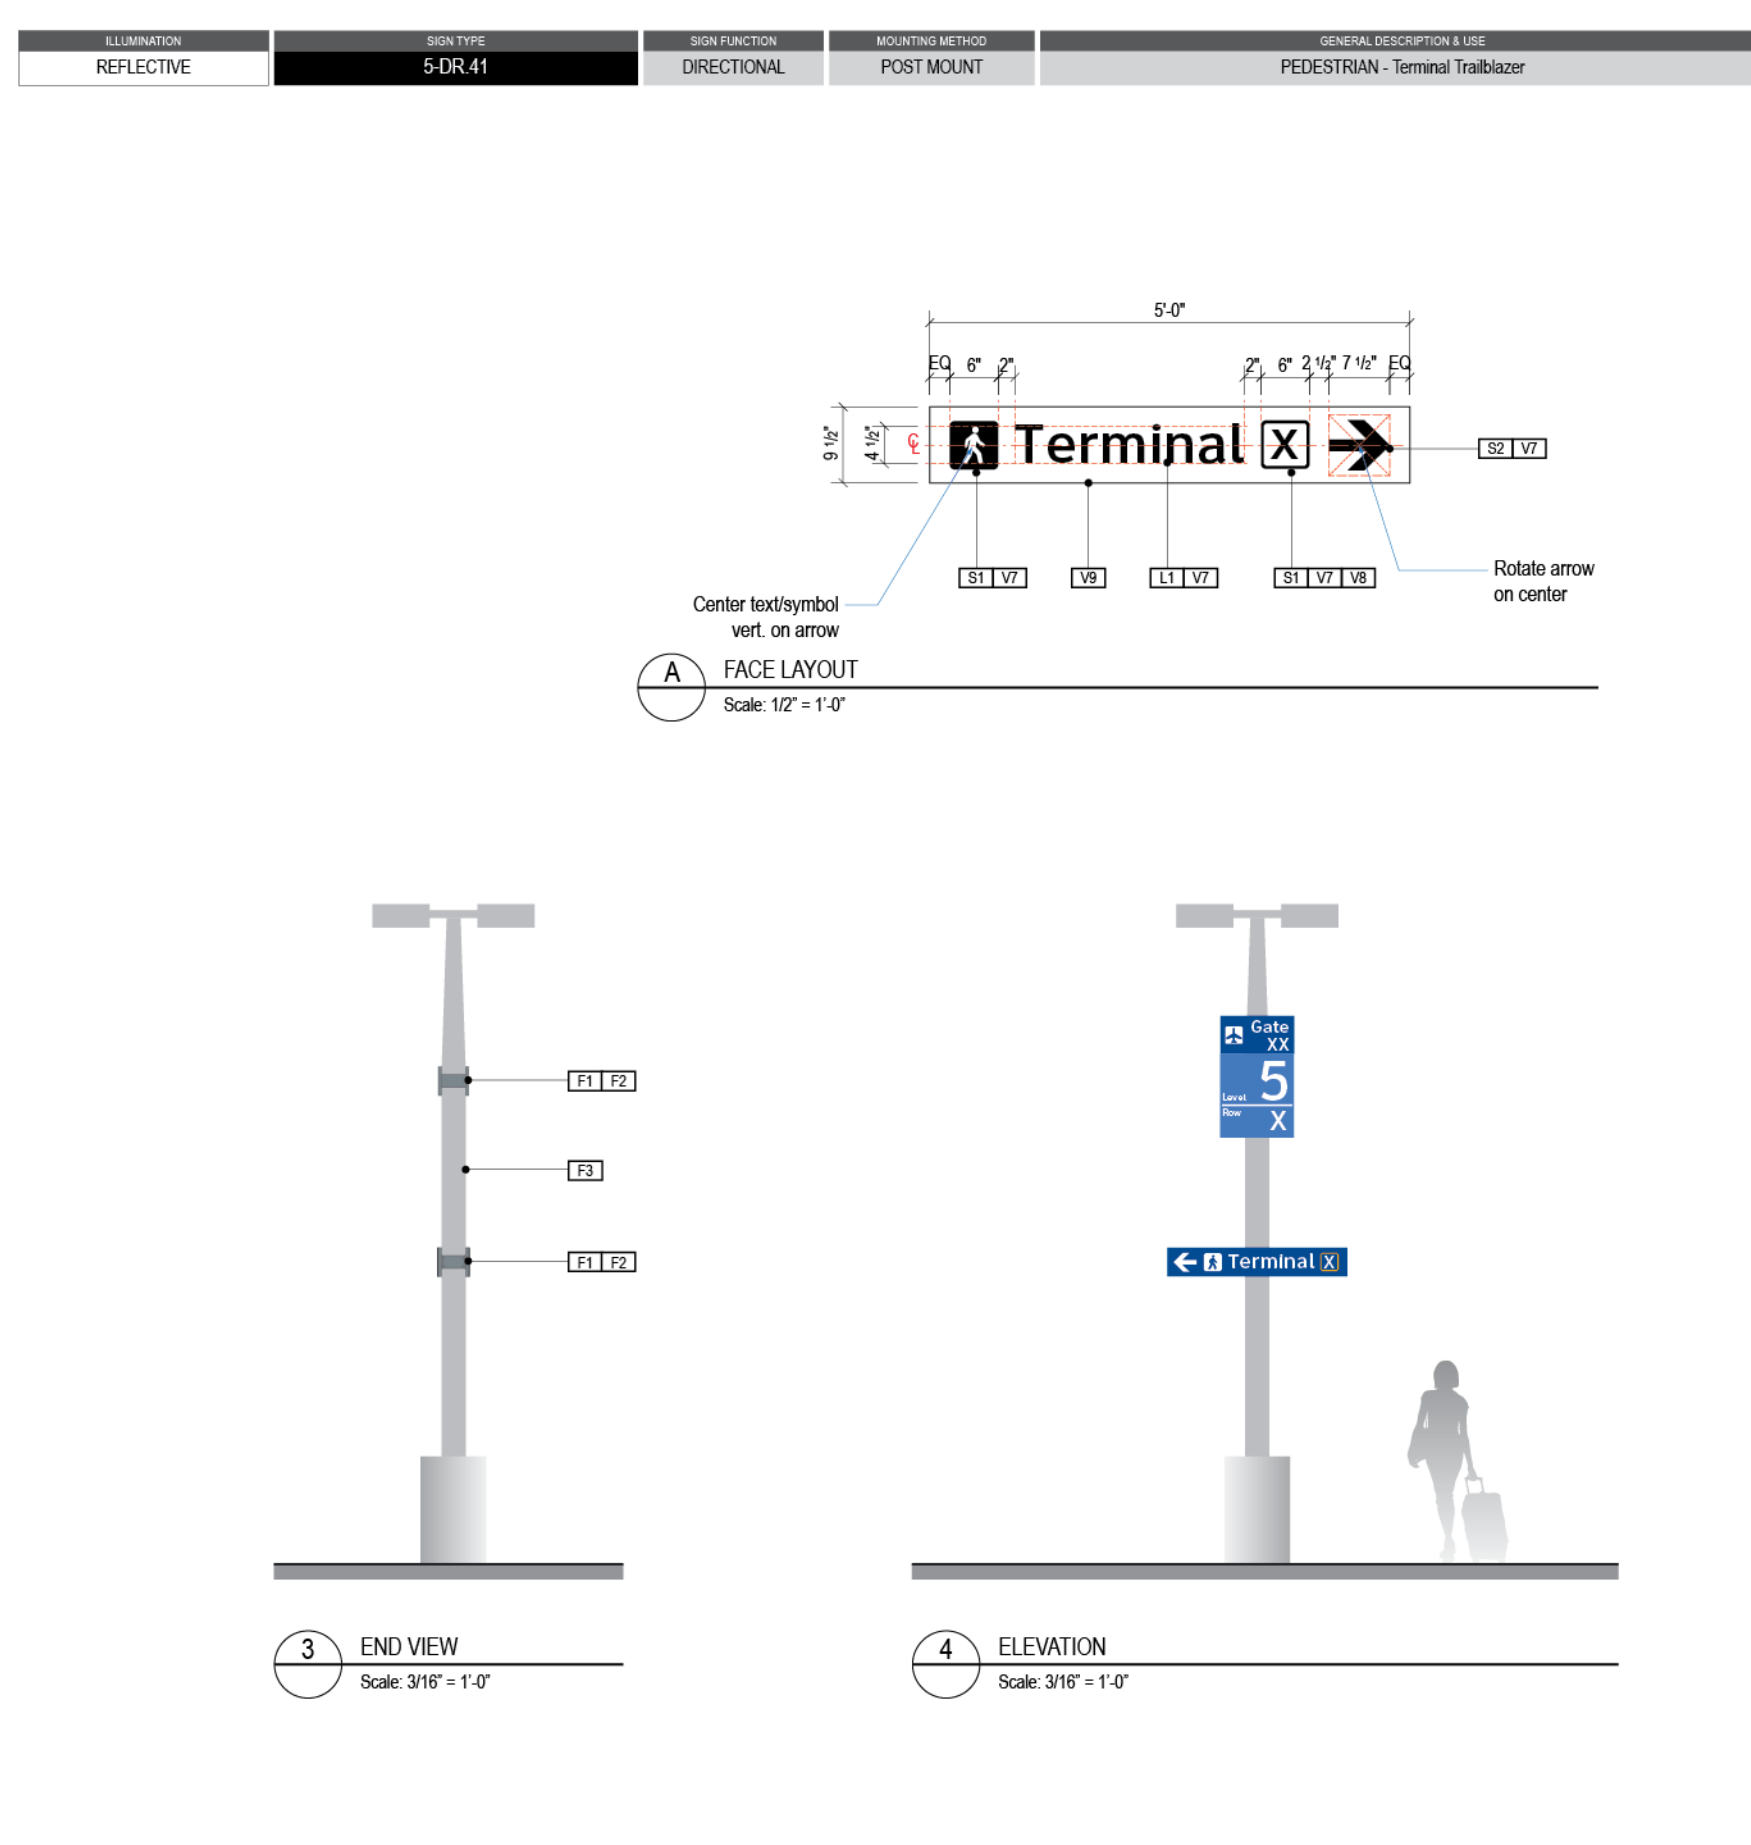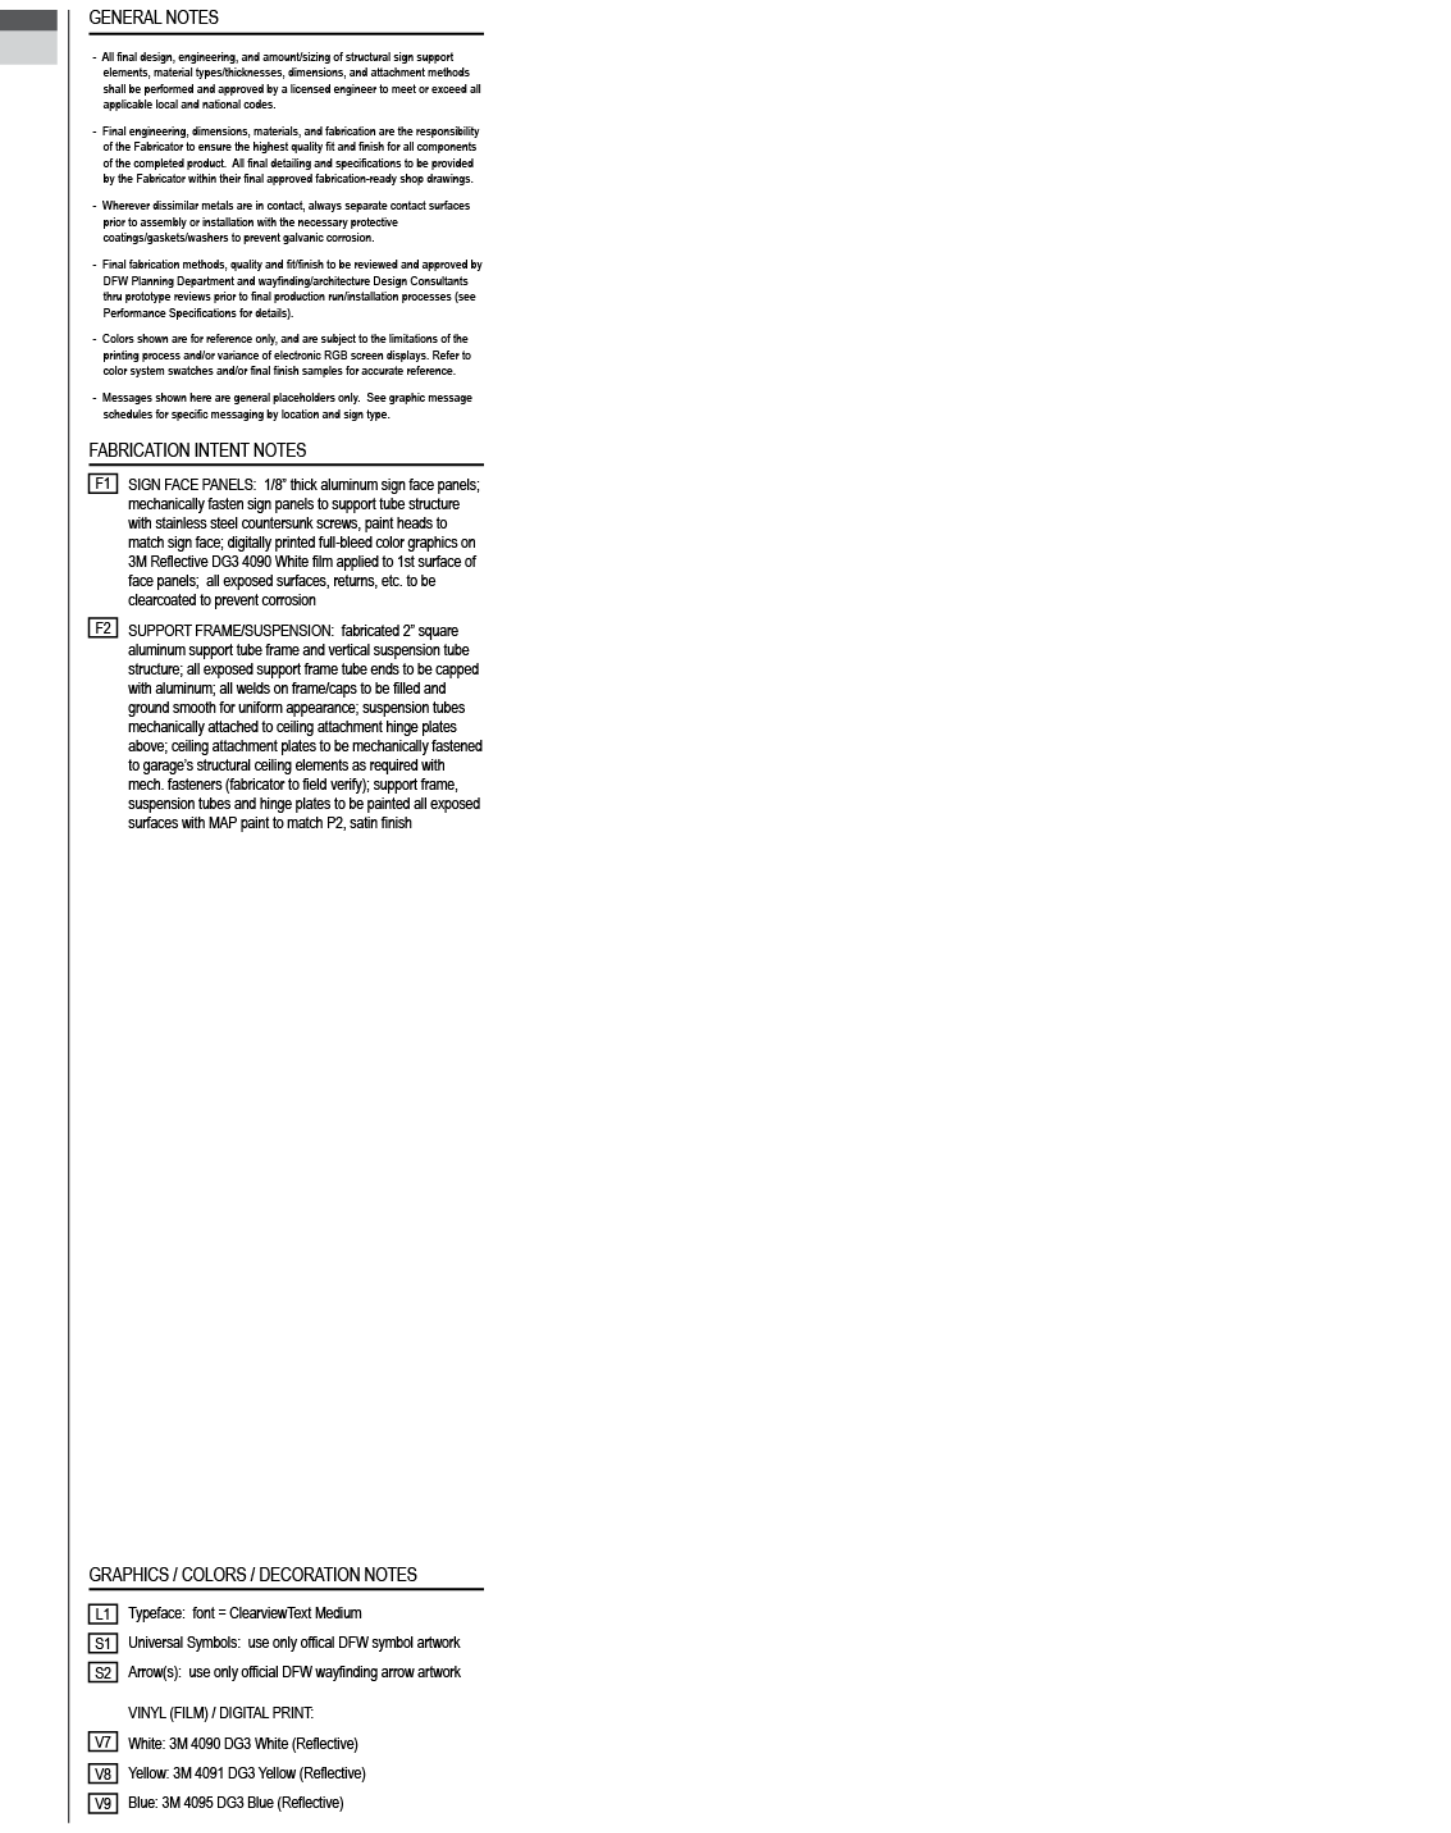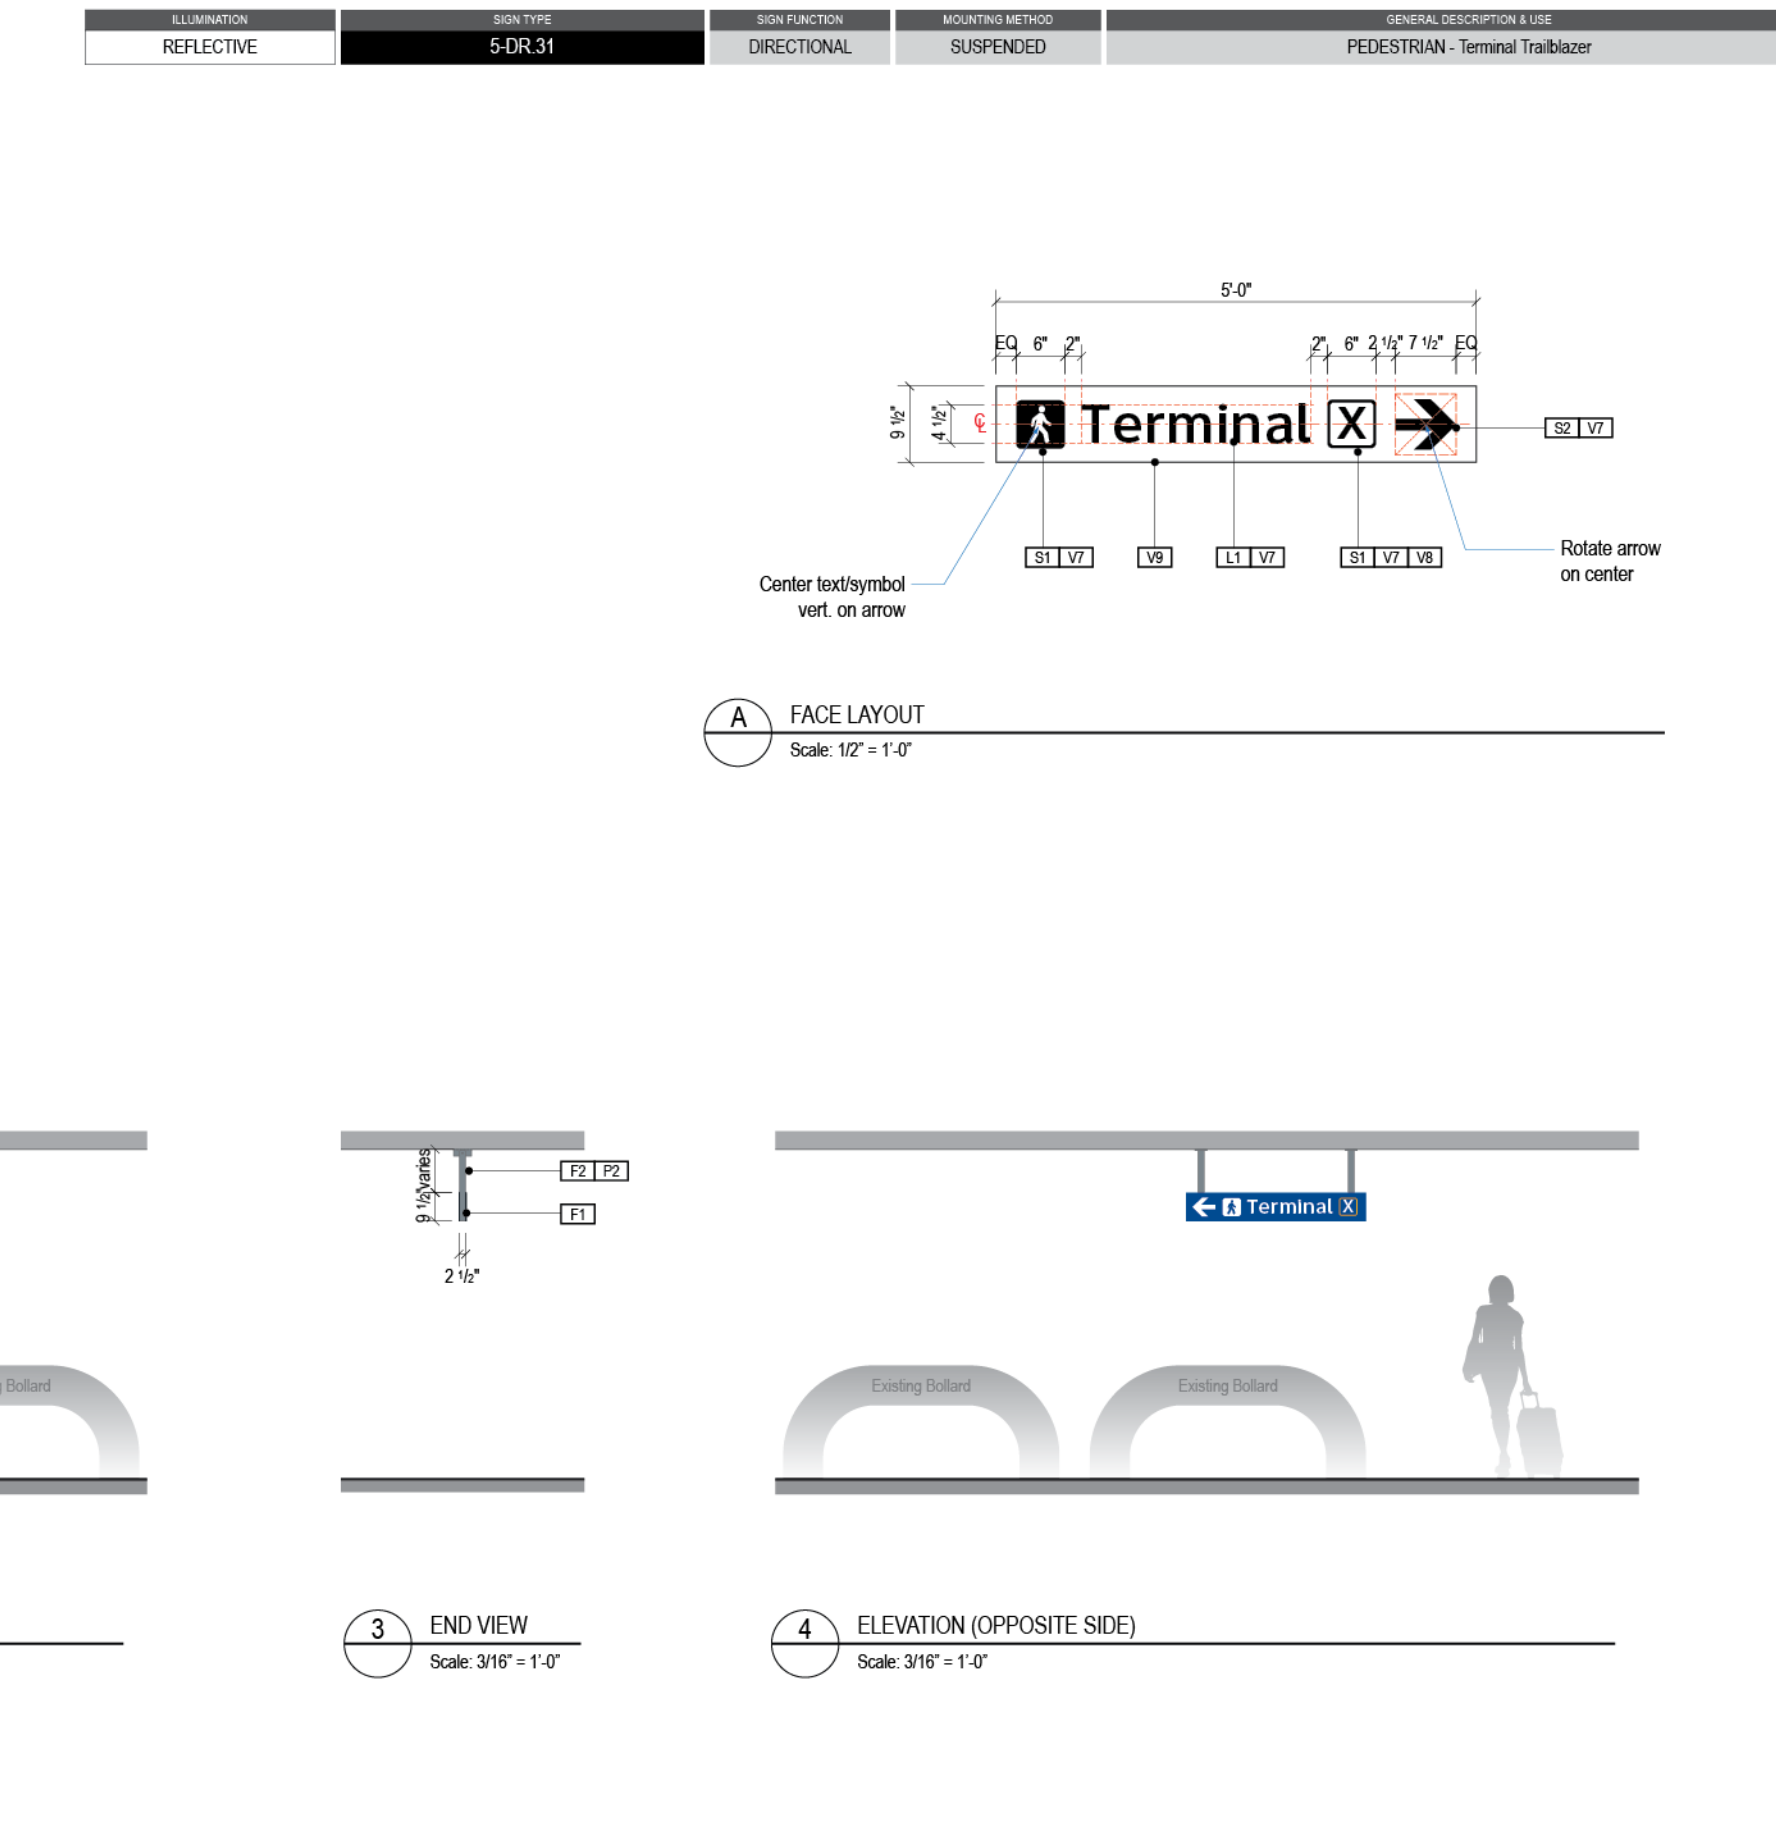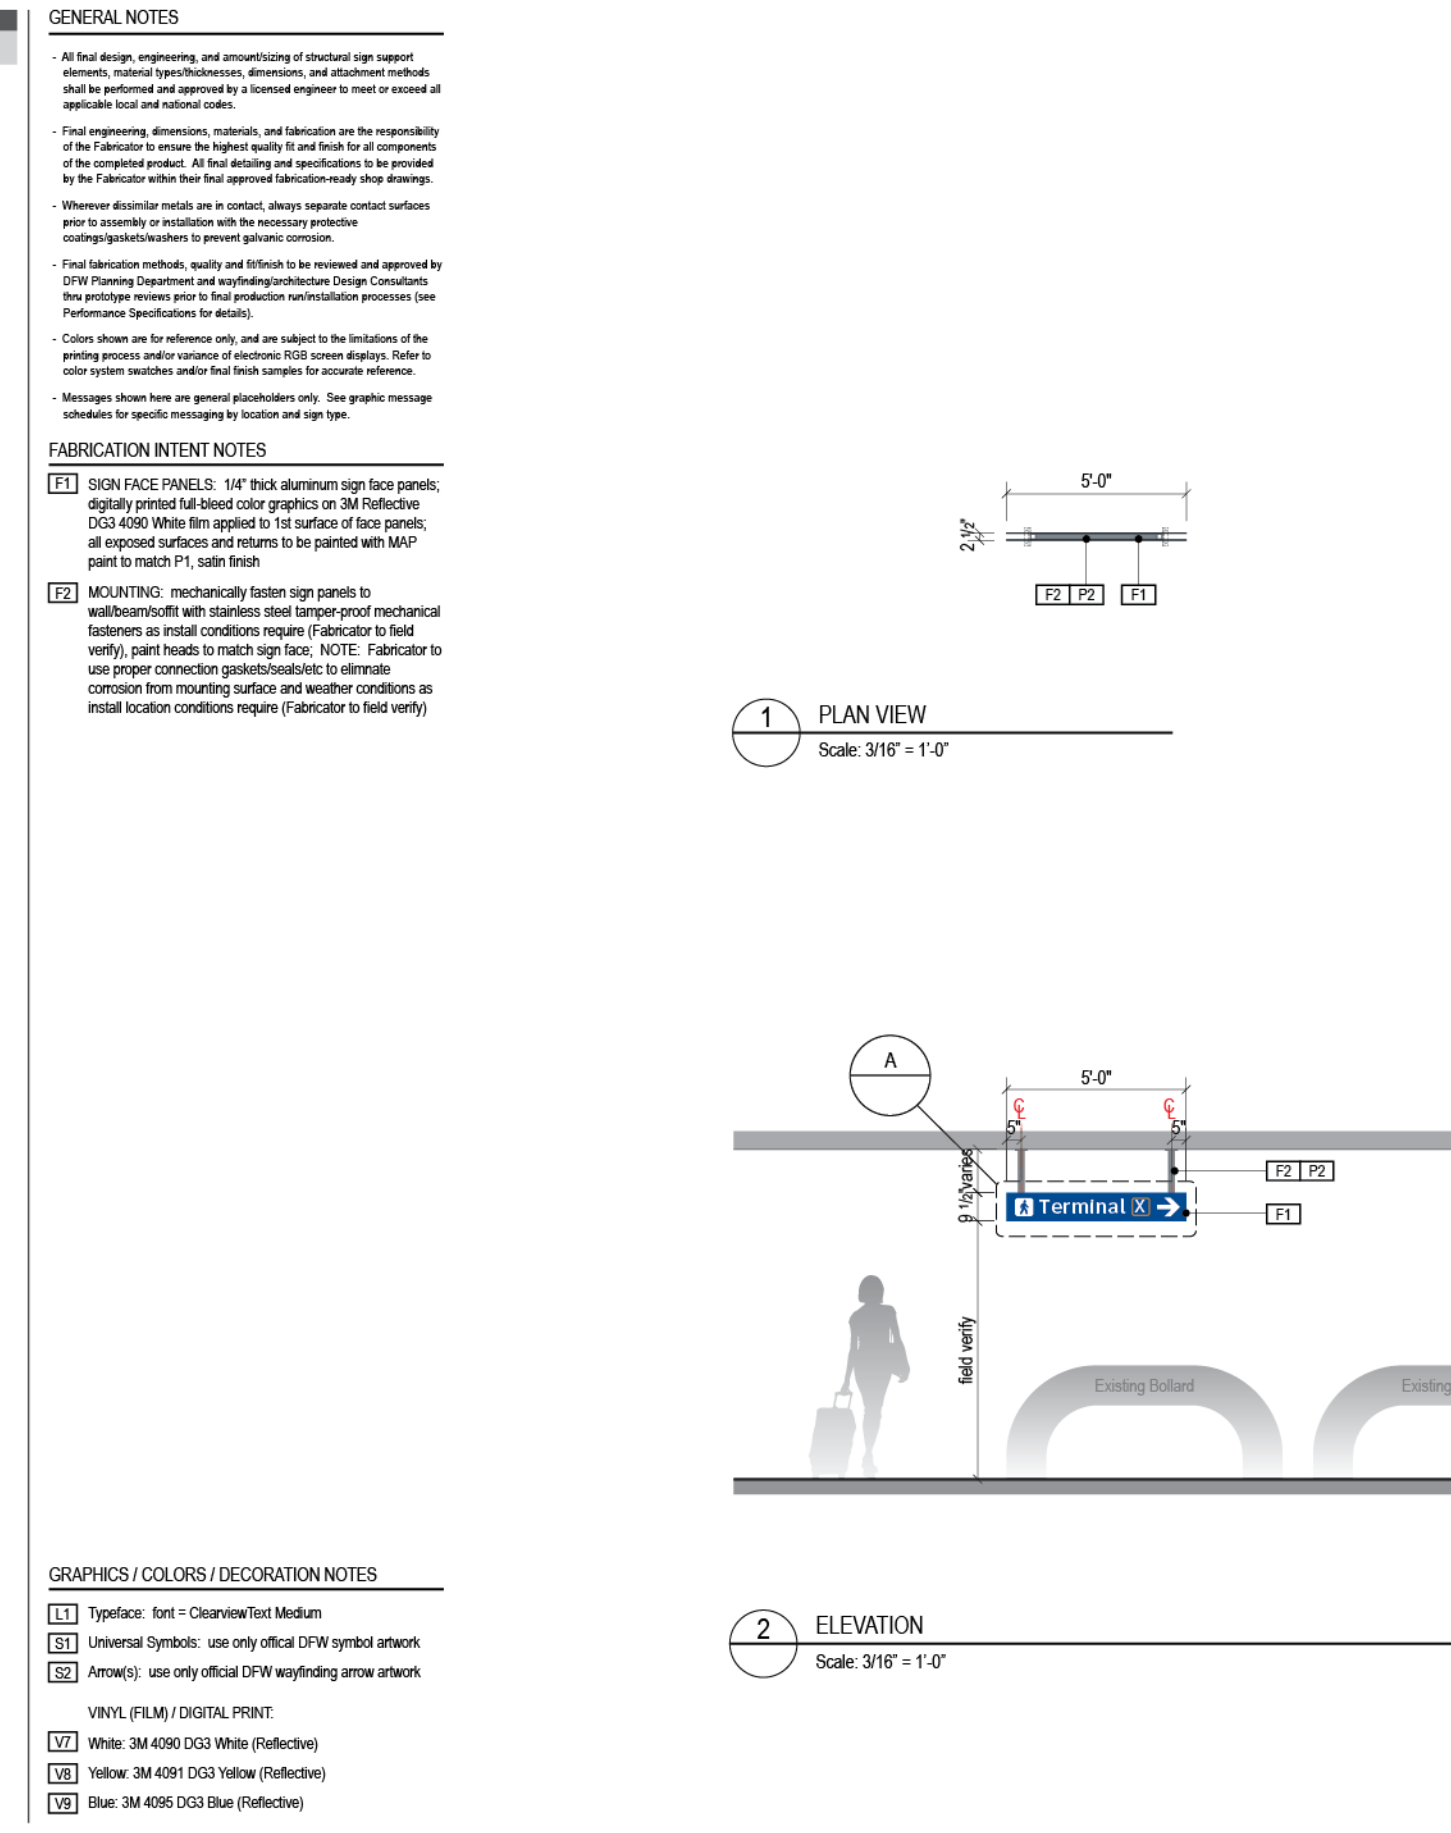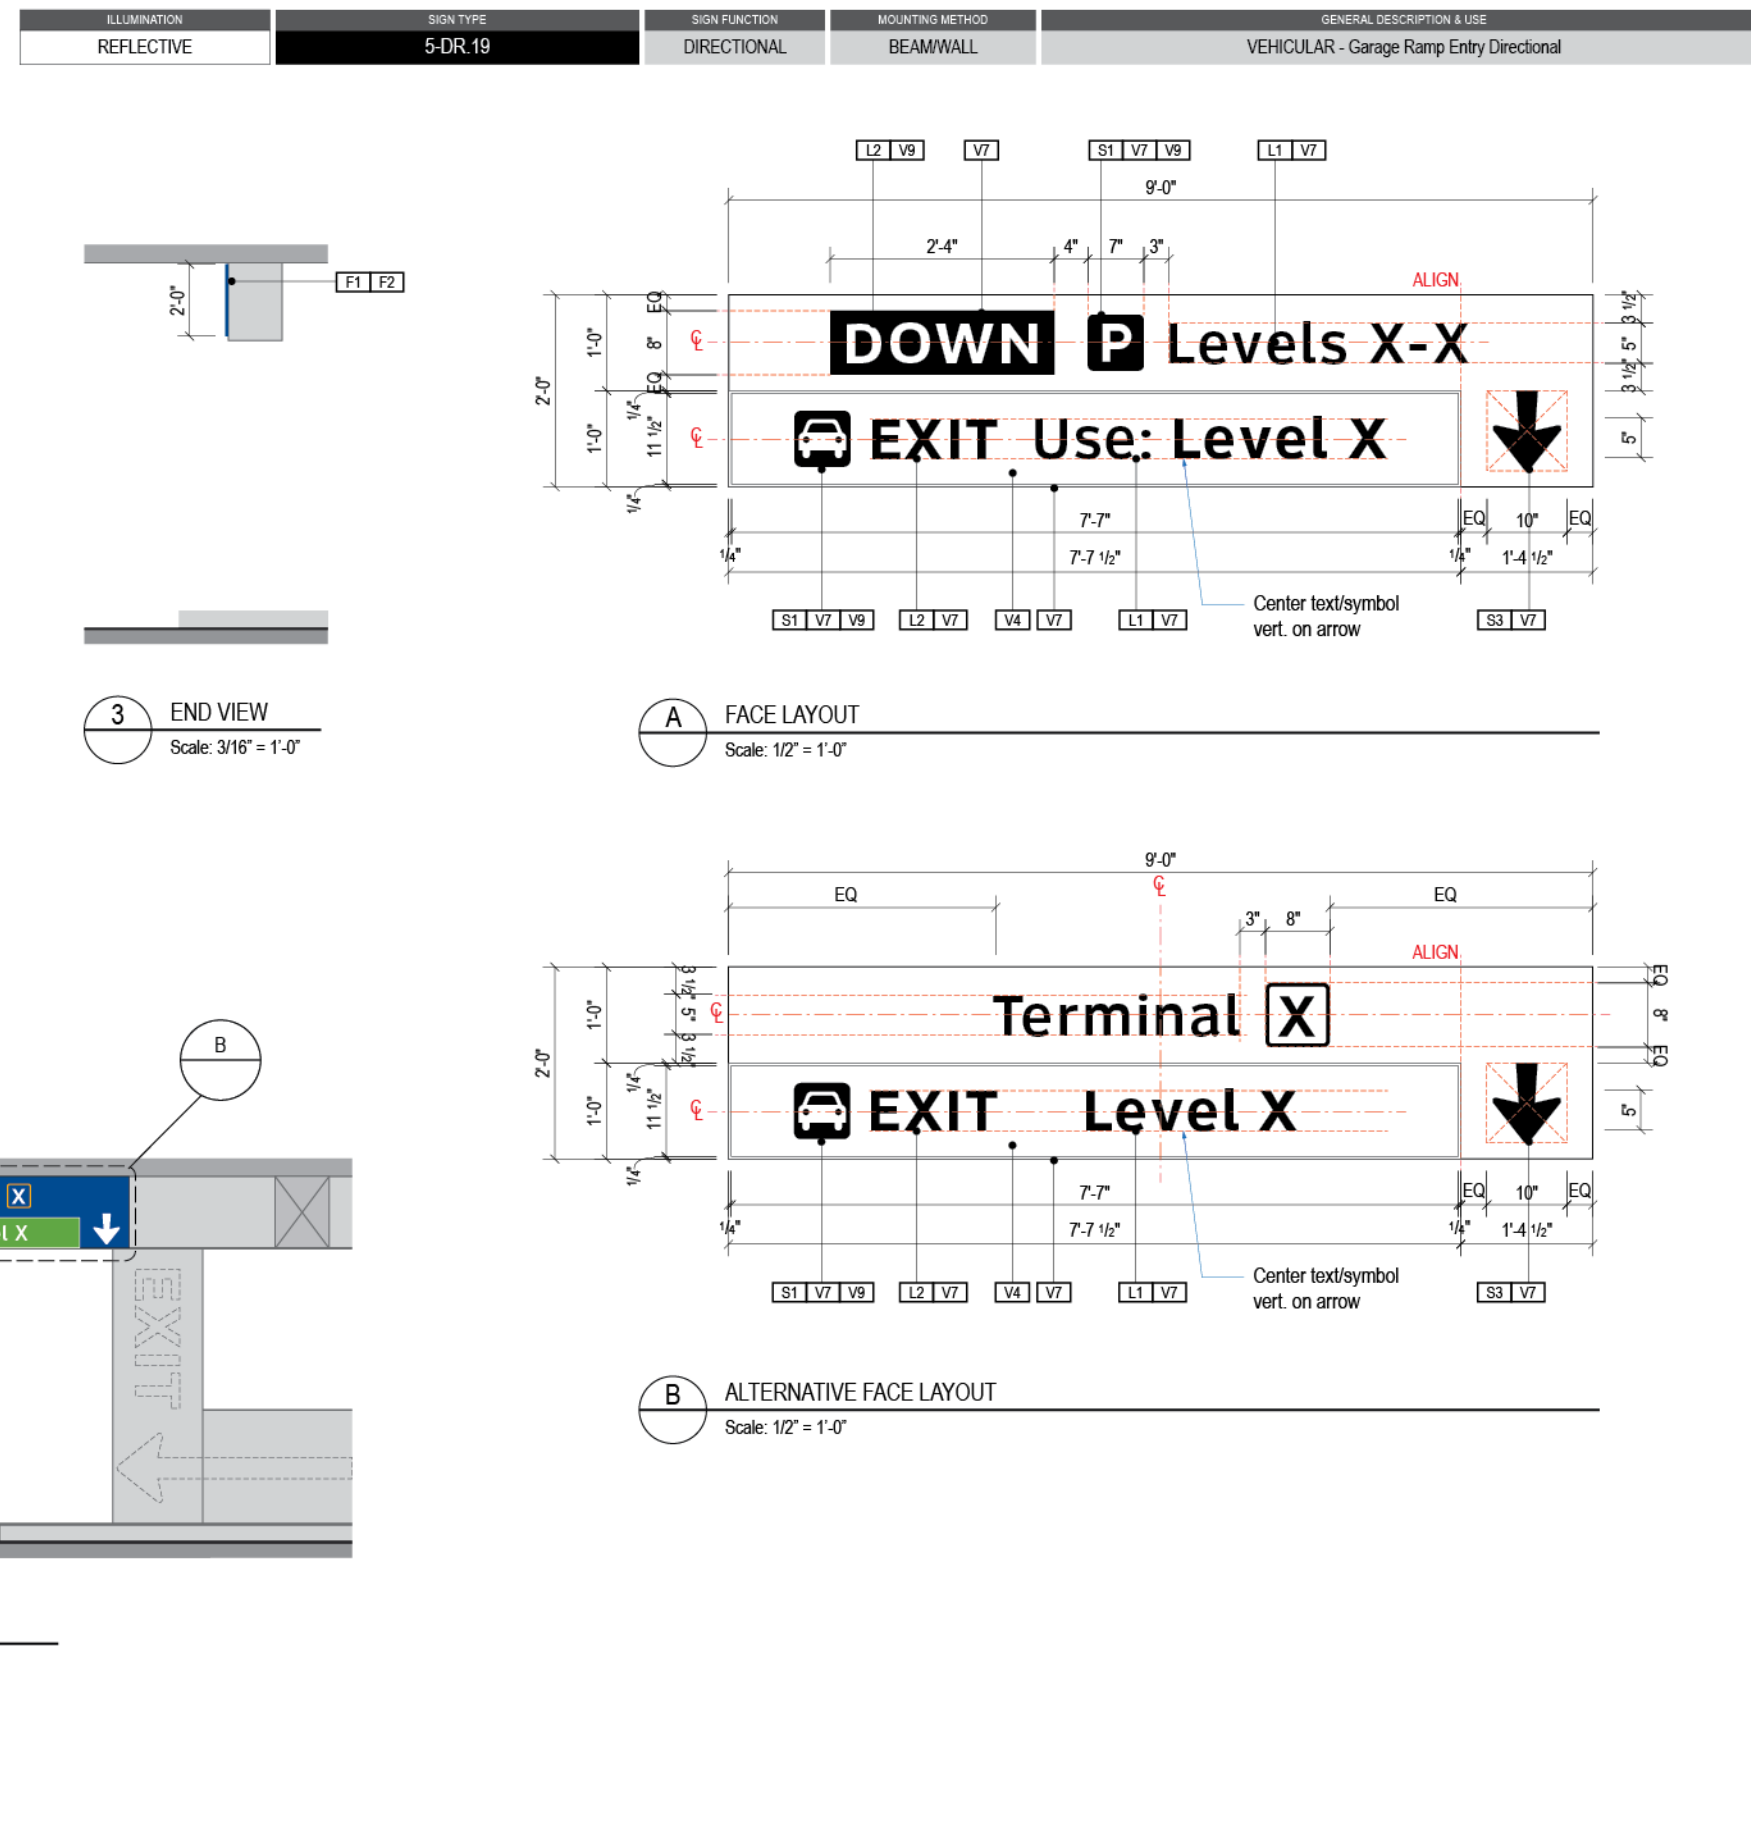

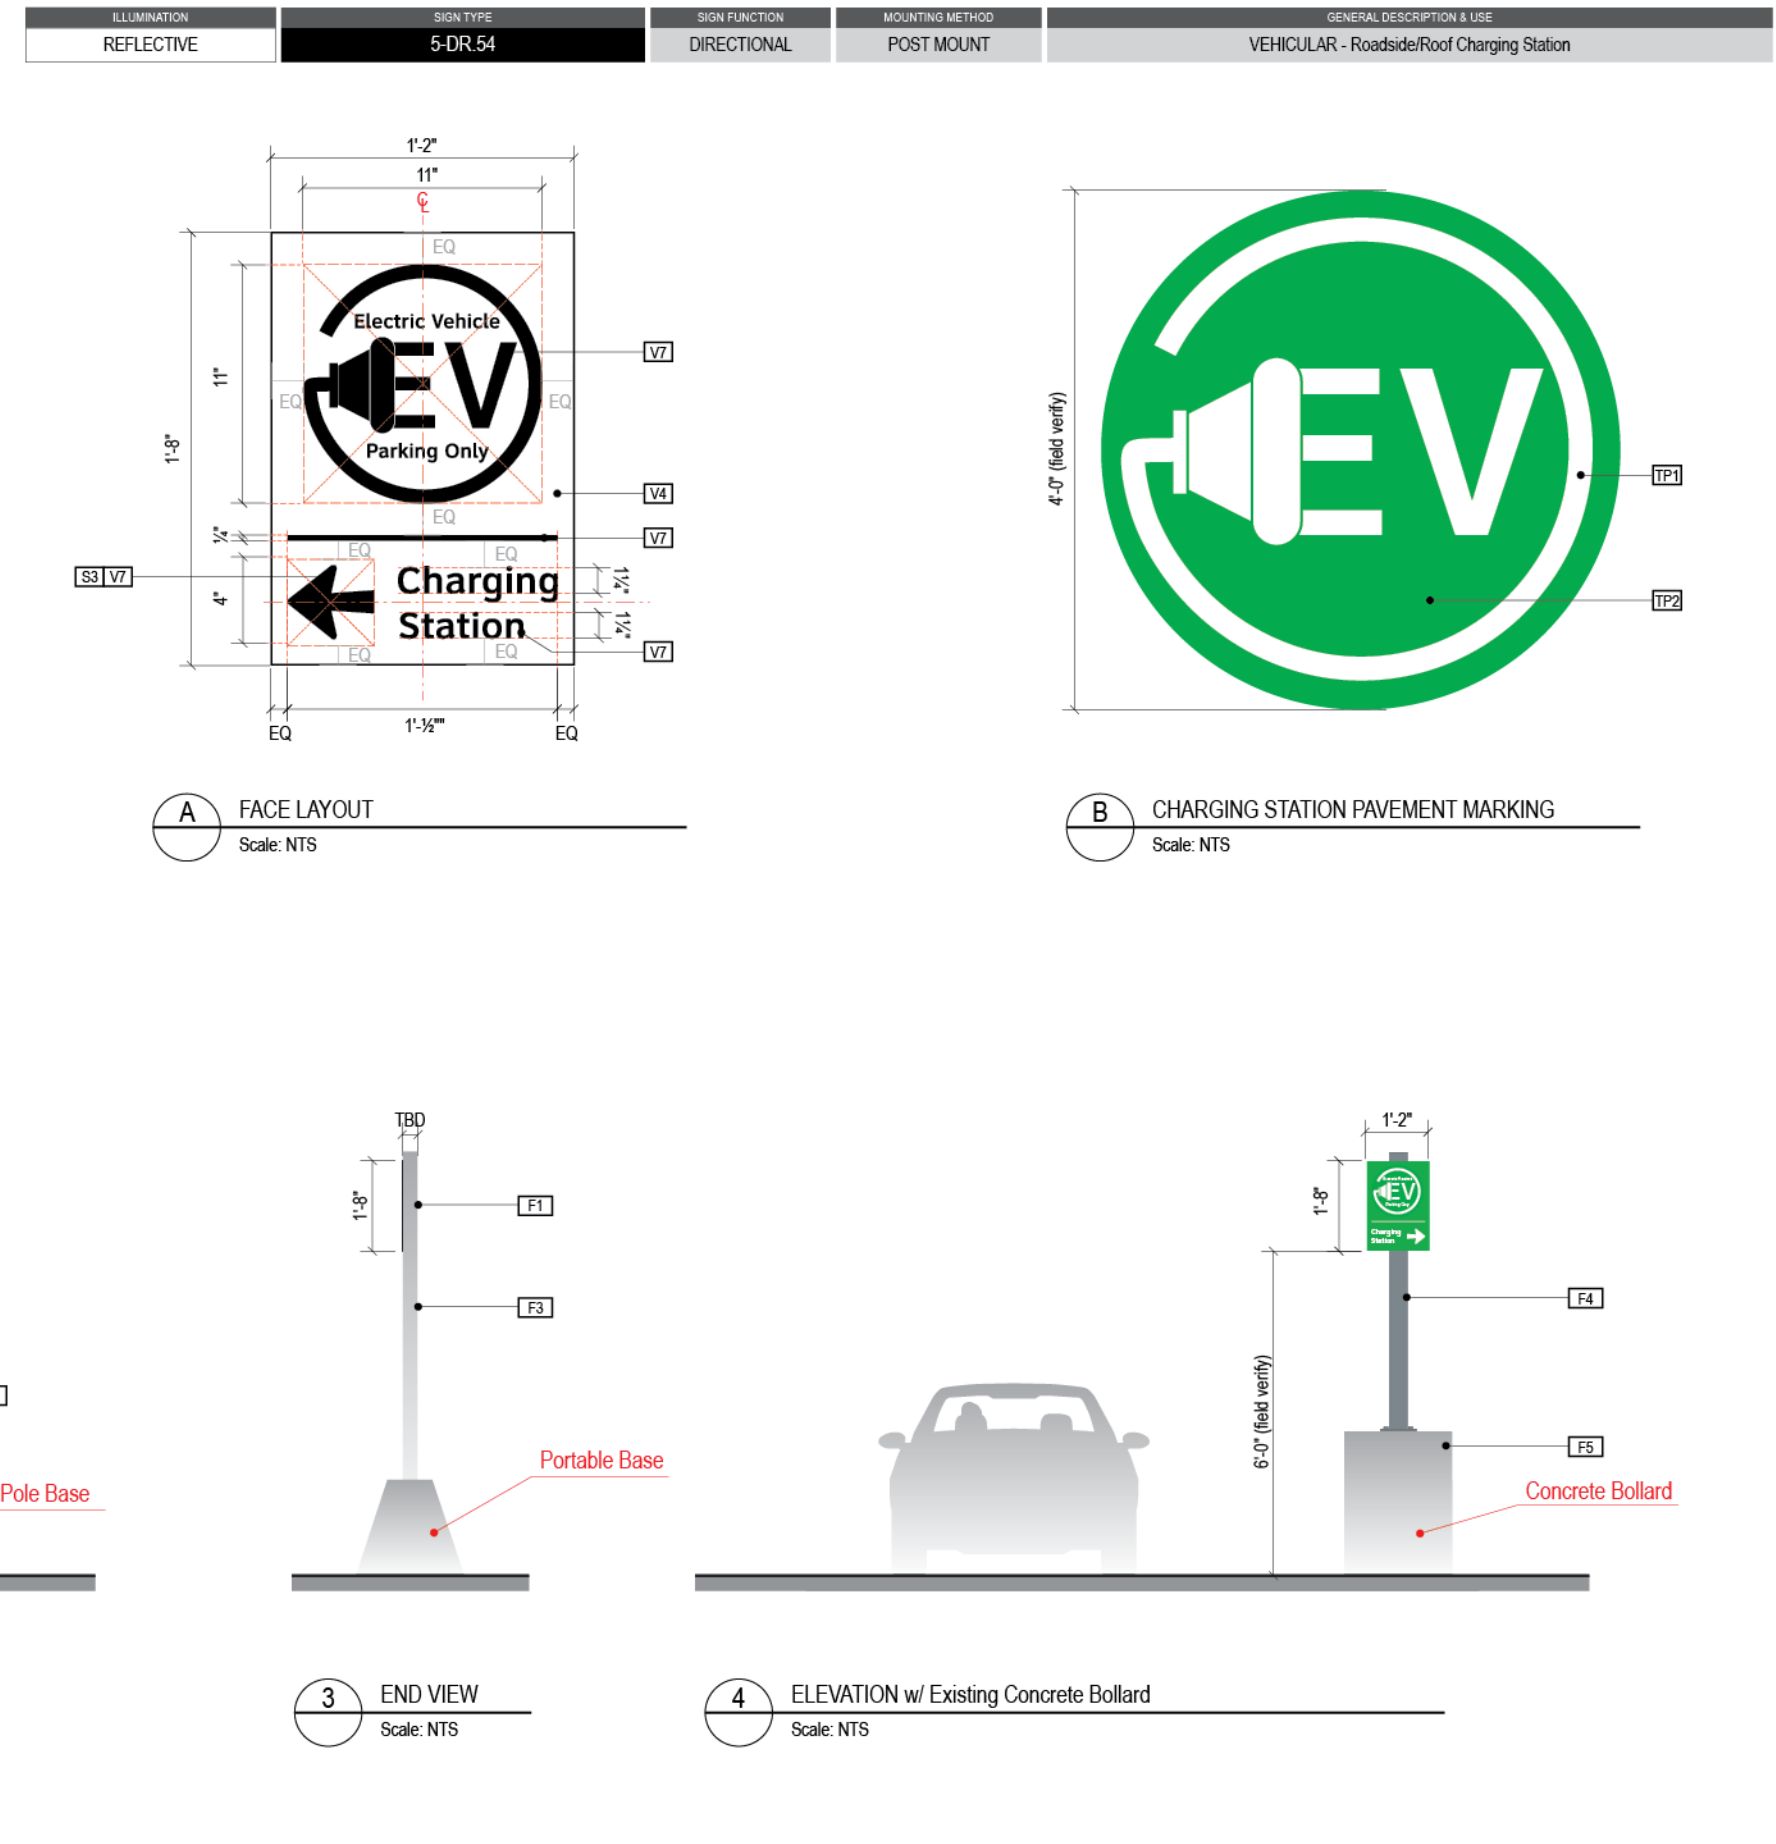

GENERAL NOTES

All final design, engineering, and manufacturing of structural sign support assembly, including fabrications, accessories, and hardware materials shall be performed and approved by a licensed engineer to meet or exceed all applicable code and regulatory codes.

Final engineering, accessories, materials, and hardware on the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

Final fabrication methods, quality and finish to be reviewed and approved by the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Consult with the fabricator on all details related to the installation of the sign and accessories. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

FABRICATION INTENT NOTES

[1] SIGN FACE PANELS: 1/4" thick aluminum sign face panels, fabricated using panels to support aluminum frame with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

[2] SUPPORT FRAME: Fabricated aluminum frame, fabricated using aluminum support frame structure, all exposed support frame shall be painted with aluminum paint. Support frame shall be painted with aluminum paint. Support frame shall be painted with aluminum paint.

[3] PORTABLE FRAME BASE AND POLE: By others. Mount sign on portable frame base and pole.

[4] SUPPORT POST: Fabricated aluminum vertical support post, support post shall be painted with aluminum paint. Support post shall be painted with aluminum paint. Support post shall be painted with aluminum paint.

[5] EXISTING CONCRETE BOLLARD: Existing concrete bollard.

GRAPHICS / COLORS / DECORATION NOTES

[1] Signface: White - Clearview Traffic Sign



[2] Universal Symbols: ASCTA/ISO sign symbol artwork

[3] Sign Artwork: use only official MUTCD/ISO artwork

FINISH

[1] White: FMS White C, Type DMS-6200 Traffic Paint

[2] Green: to match FMS 1462 C Traffic Paint

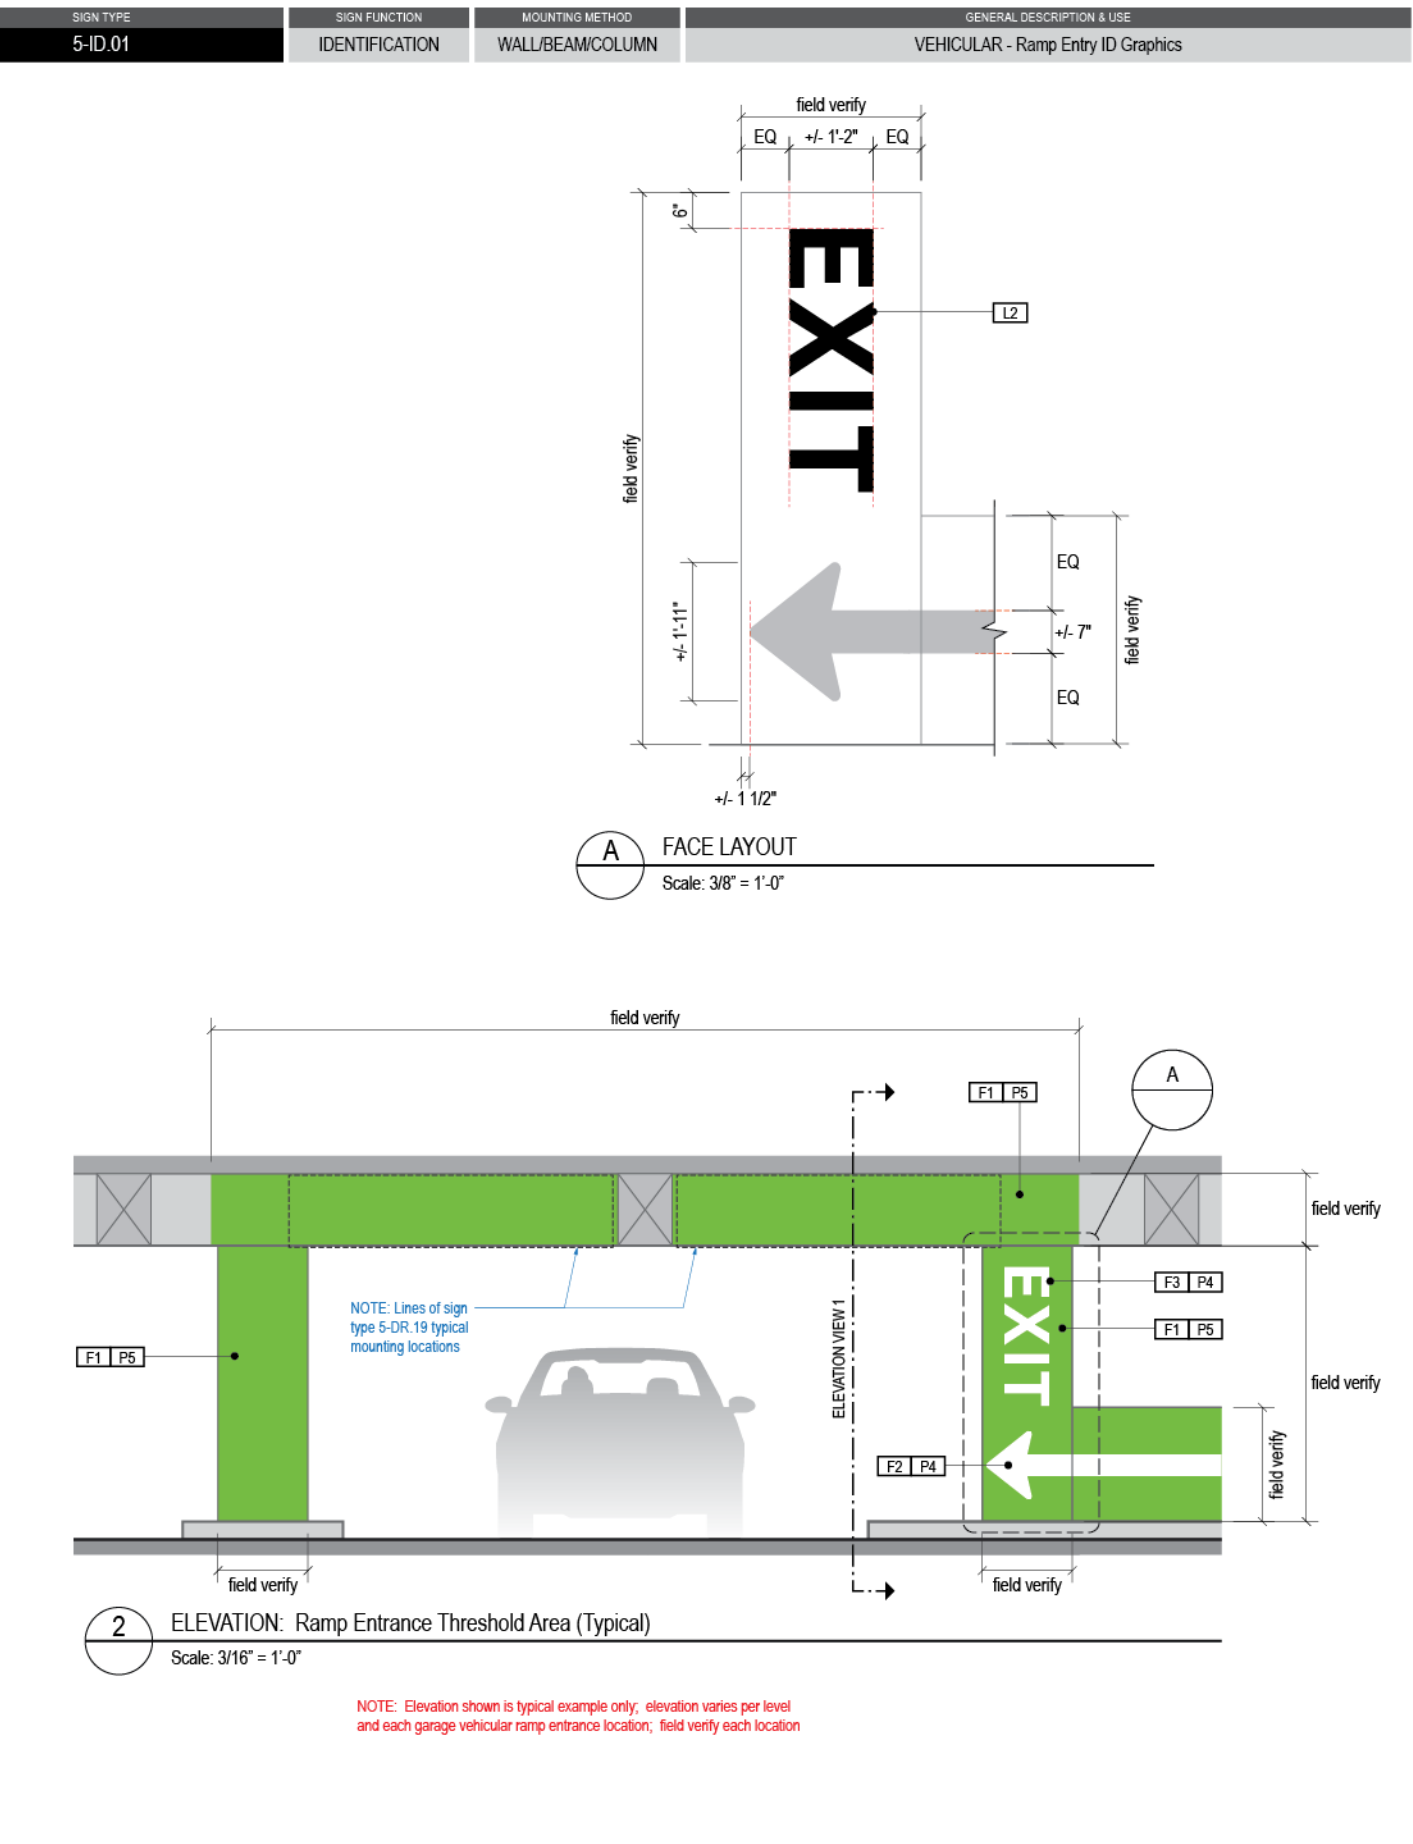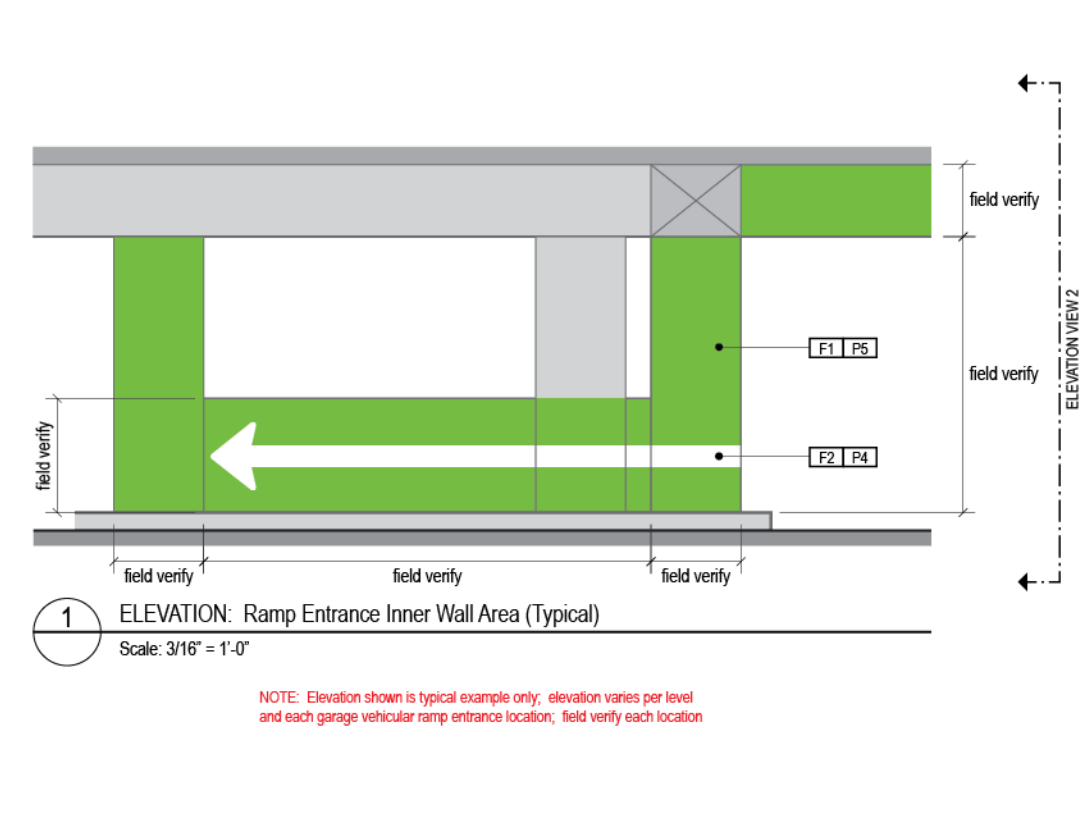

GENERAL NOTES

All final design, engineering, and manufacturing of structural sign support assembly, including fabrications, accessories, and hardware materials shall be performed and approved by a licensed engineer to meet or exceed all applicable code and regulatory codes.

Final engineering, accessories, materials, and hardware on the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

Final fabrication methods, quality and finish to be reviewed and approved by the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Consult with the fabricator on all details related to the installation of the sign and accessories. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

FABRICATION INTENT NOTES

[1] BACKGROUND AREA: paint existing background area with MPF paint, color finish. Background existing background surface area conditions and prep with primer prior to painting per paint manufacturer's specifications.

[2] SIGN GRAPHICS: paint sign with MPF paint, color finish. Sign existing background surface area conditions and prep with primer prior to painting per paint manufacturer's specifications.


[3] LARGE EXIT LETTERS: paint letters with MPF paint, color finish. Sign existing background surface area conditions and prep with primer prior to painting per paint manufacturer's specifications.

GRAPHICS / COLORS / DECORATION NOTES

[1] Signface: Clearview Traffic Sign

[2] White: MPF paint # MPF021, satin finish

[3] Exit Light Green: MPF paint to match FMS 360C, satin finish

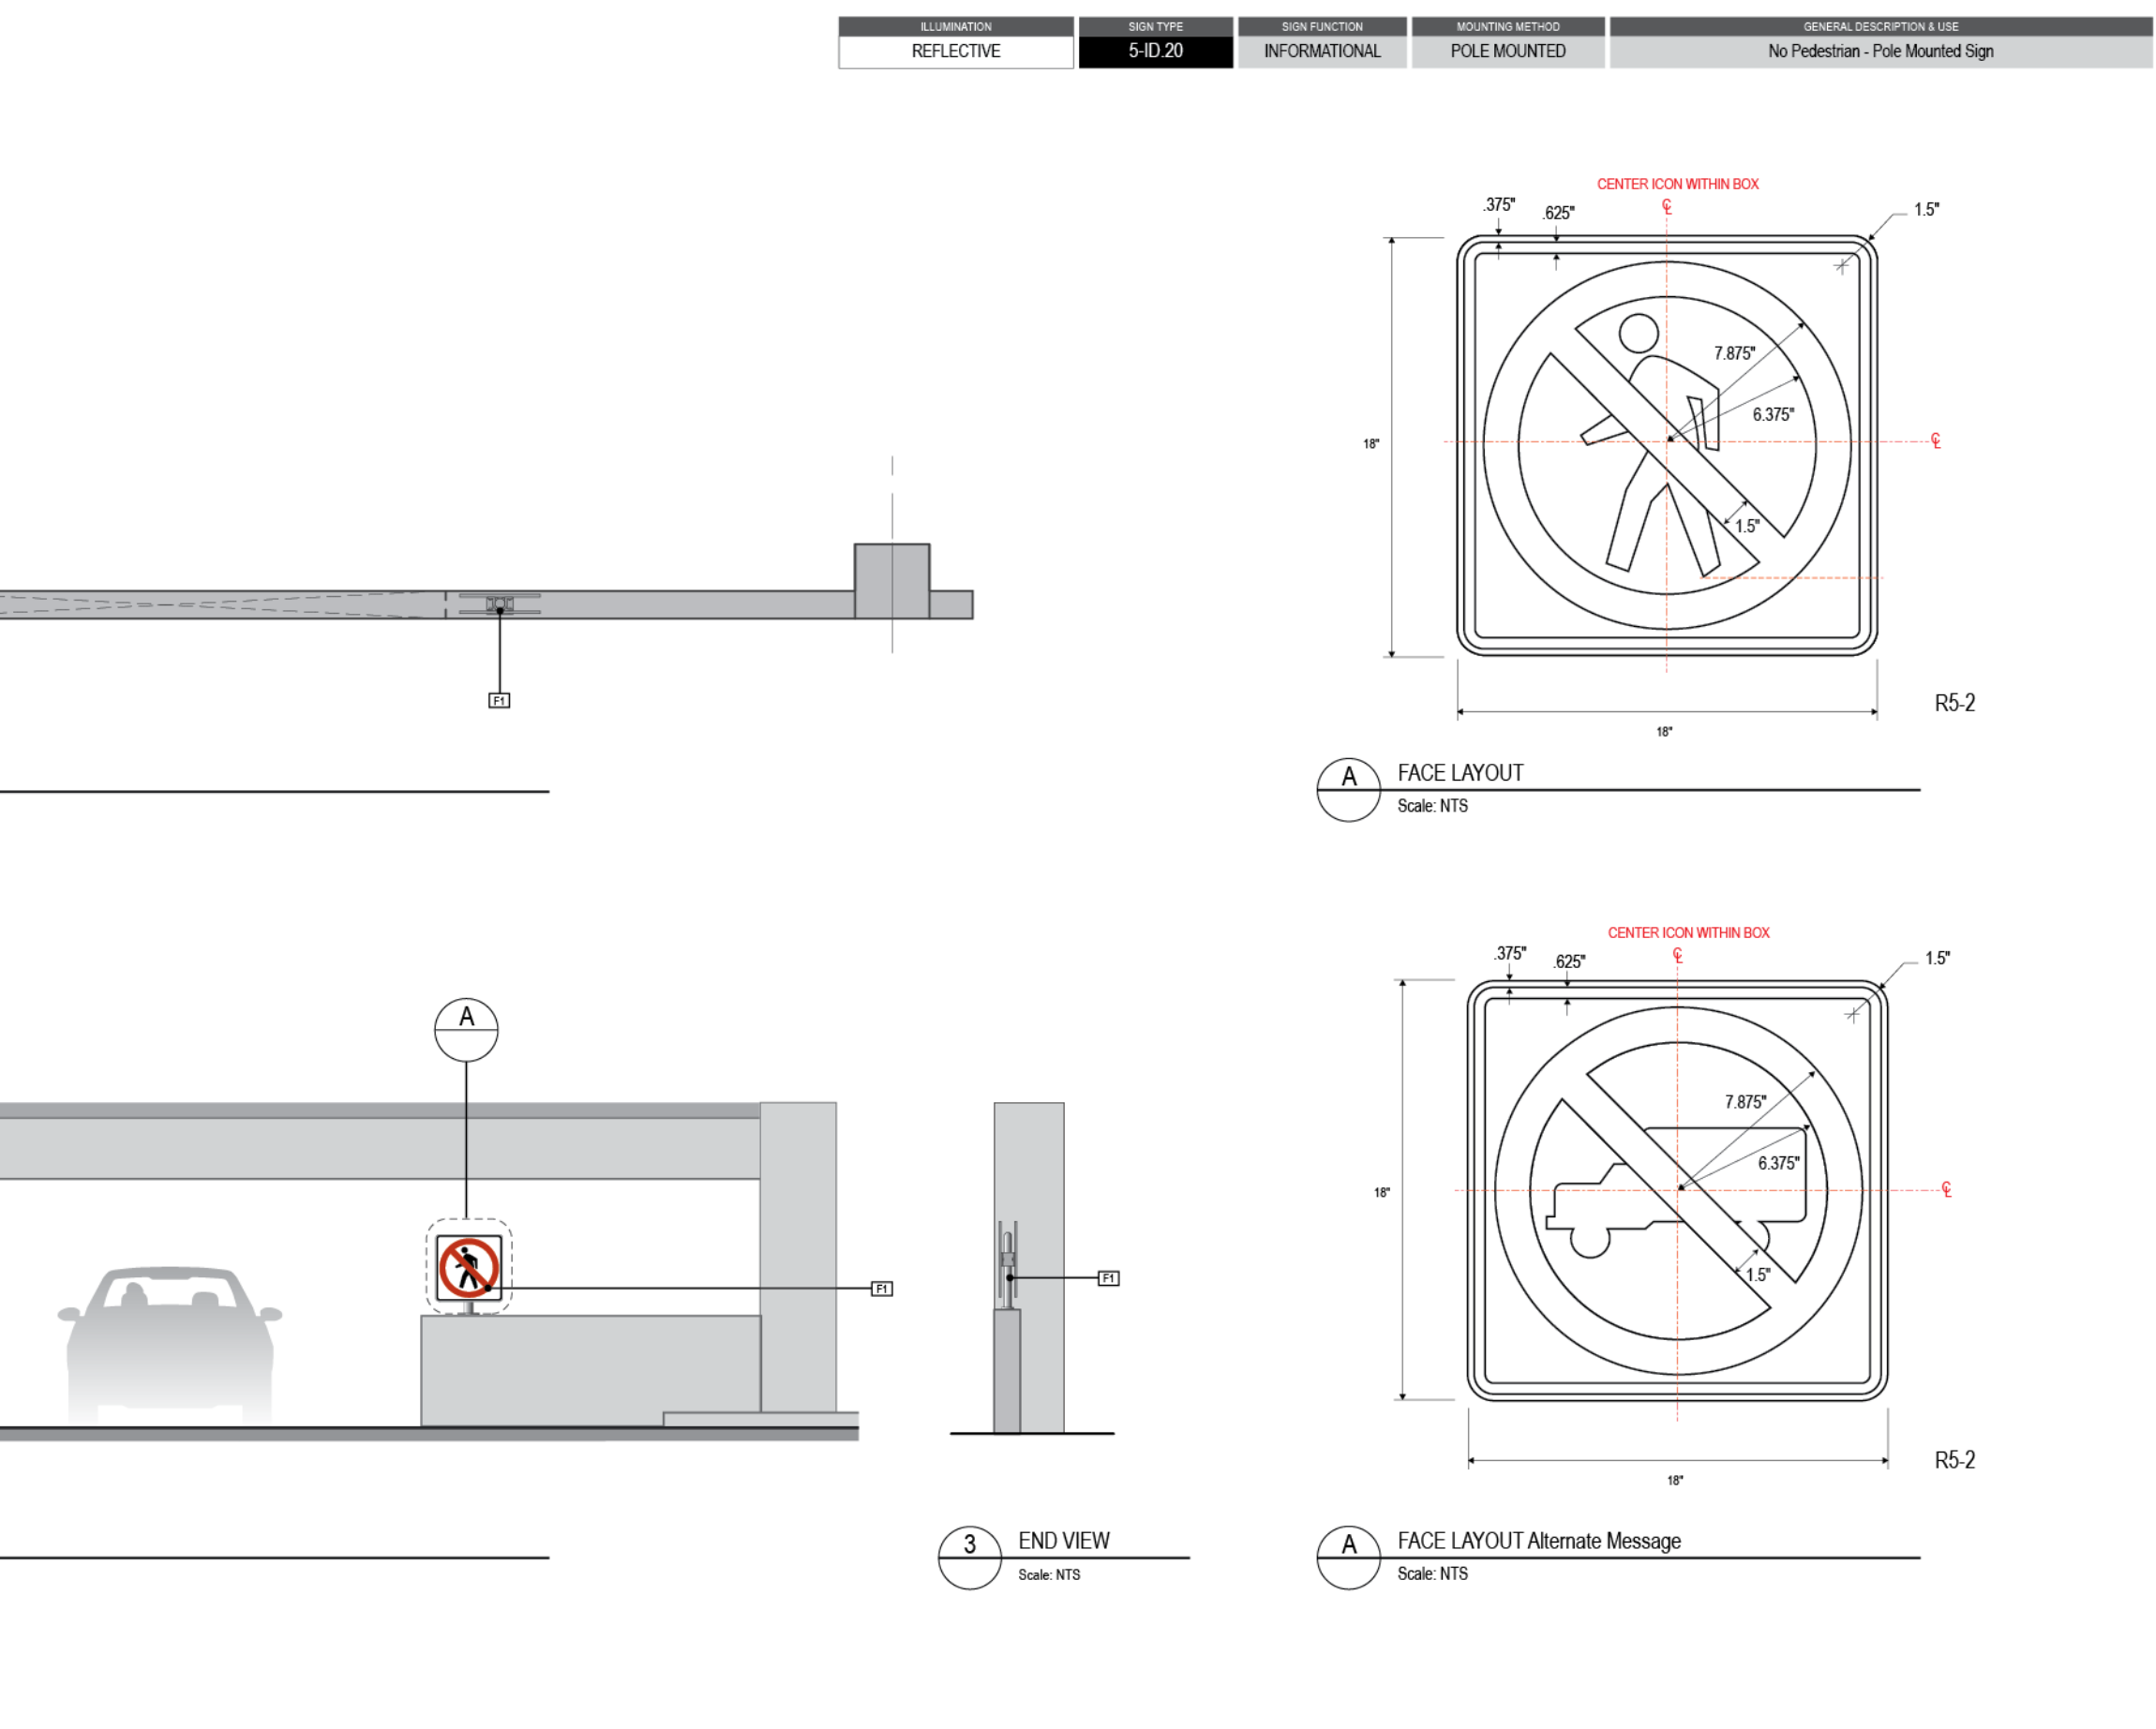

GENERAL NOTES

All final design, engineering, and manufacturing of structural sign support assembly, including fabrications, accessories, and hardware materials shall be performed and approved by a licensed engineer to meet or exceed all applicable code and regulatory codes.

Final engineering, accessories, materials, and hardware on the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

Final fabrication methods, quality and finish to be reviewed and approved by the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Consult with the fabricator on all details related to the installation of the sign and accessories. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

FABRICATION INTENT NOTES

[1] SIGN CABINET FRAME: include fabricated metal fabricated sign face assembly mounted on fabricated aluminum and cast aluminum components with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

[2] SIGN FACE: fabricated sign face assembly mounted on fabricated aluminum and cast aluminum components with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

[3] SIGN MOUNTING: mount to wall structure elements with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

GRAPHICS / COLORS / DECORATION NOTES

[1] Signface: White - Clearview Traffic Sign

[2] Universal Symbols: ASCTA/ISO sign symbol artwork

[3] Sign Artwork: use only official MUTCD/ISO artwork

FINISH

[1] White: FMS White C, Type DMS-6200 Traffic Paint



[2] Silver: MPF paint # MPF021, satin finish

[3] Signface: MPF paint to match FMS 1462 C, satin finish

[4] Signface: MPF paint # MPF021, satin finish

[5] Signface: MPF paint to match FMS 360C, satin finish

[6] Light Green: MPF paint to match FMS 360C, satin finish

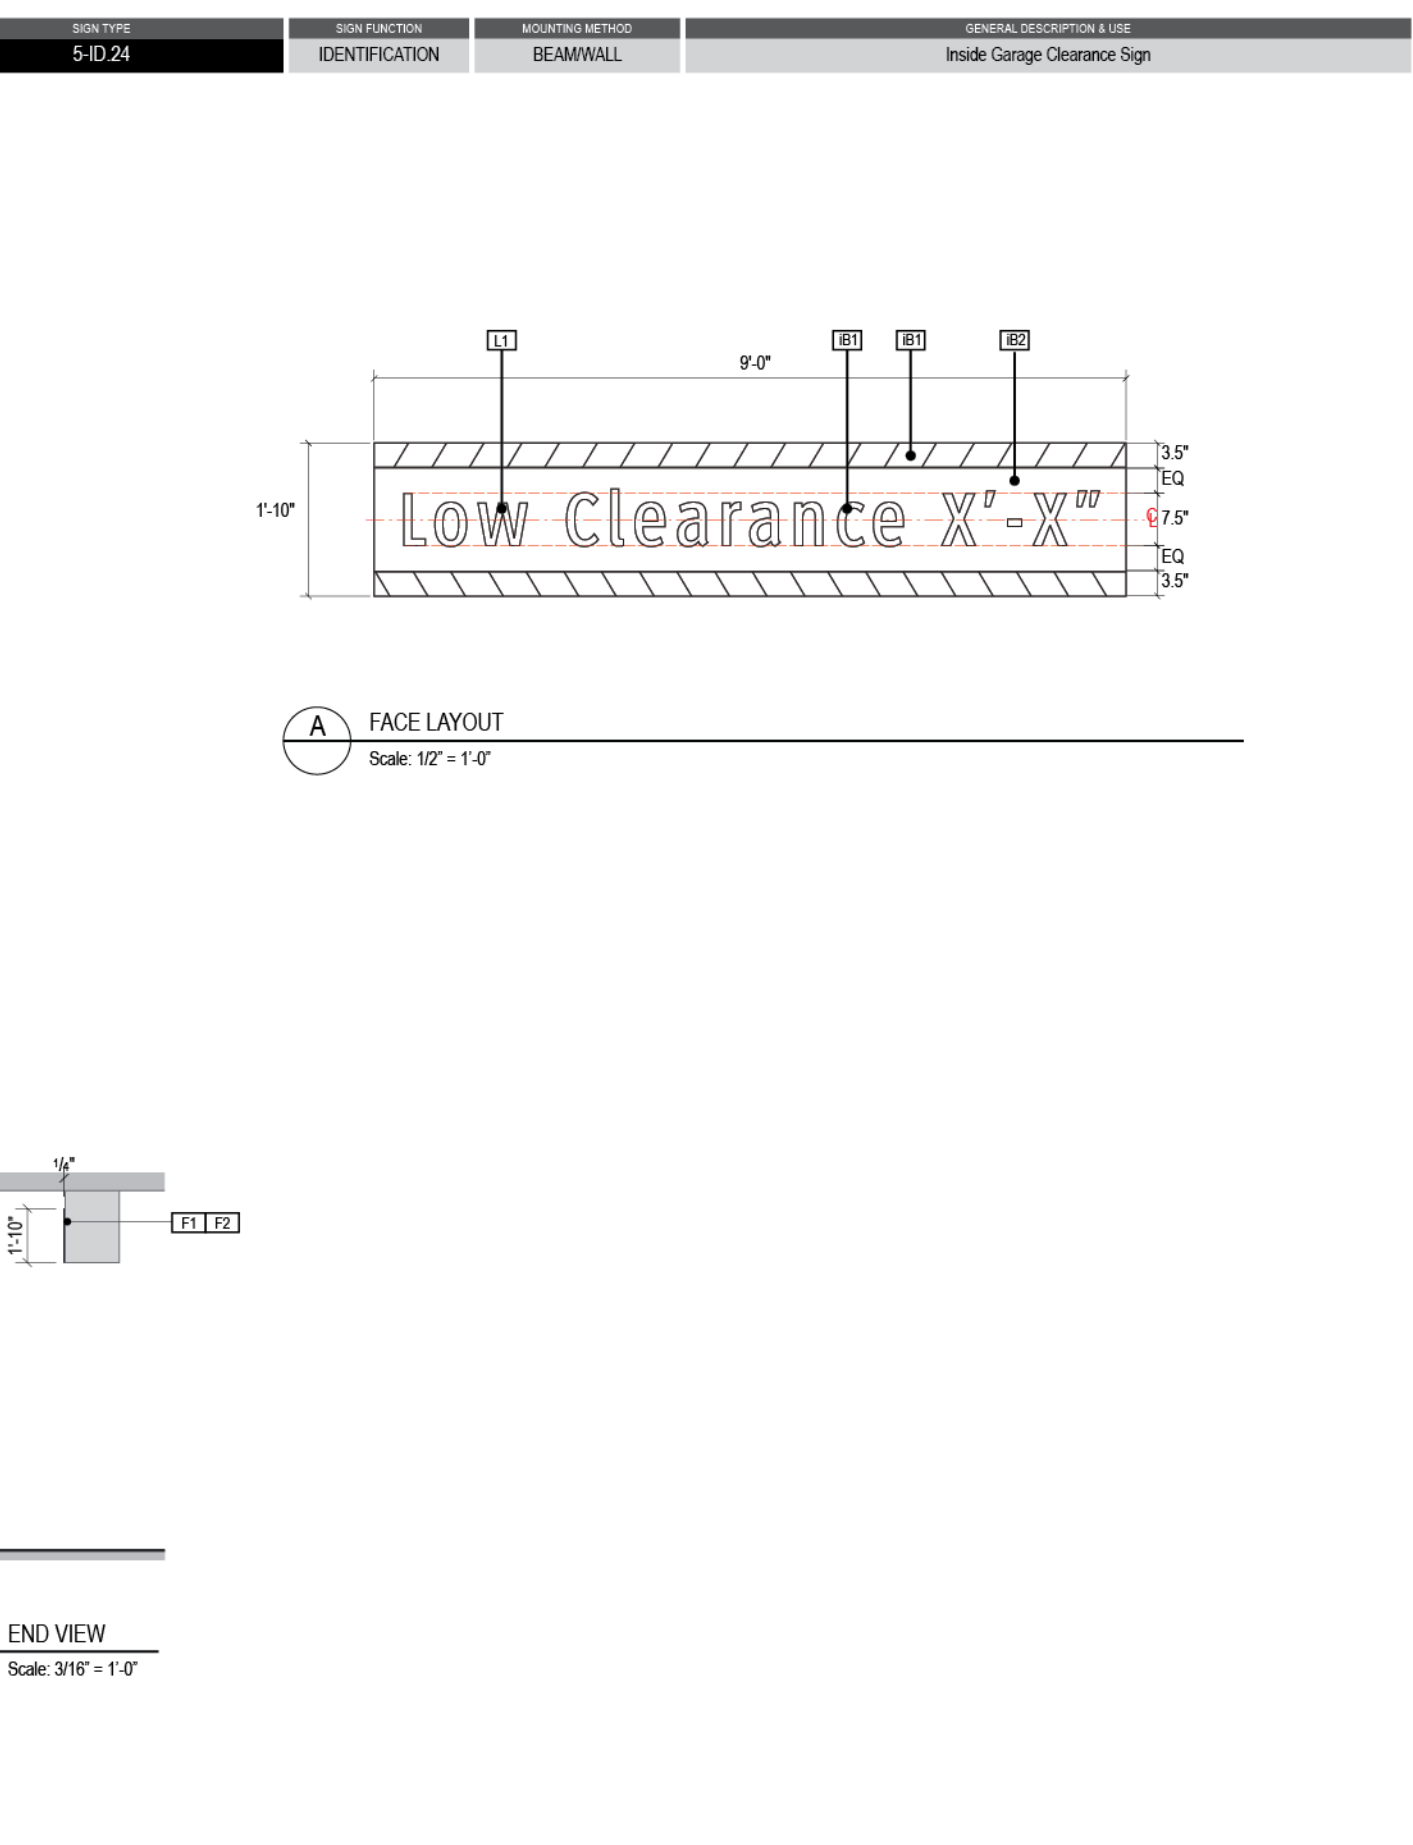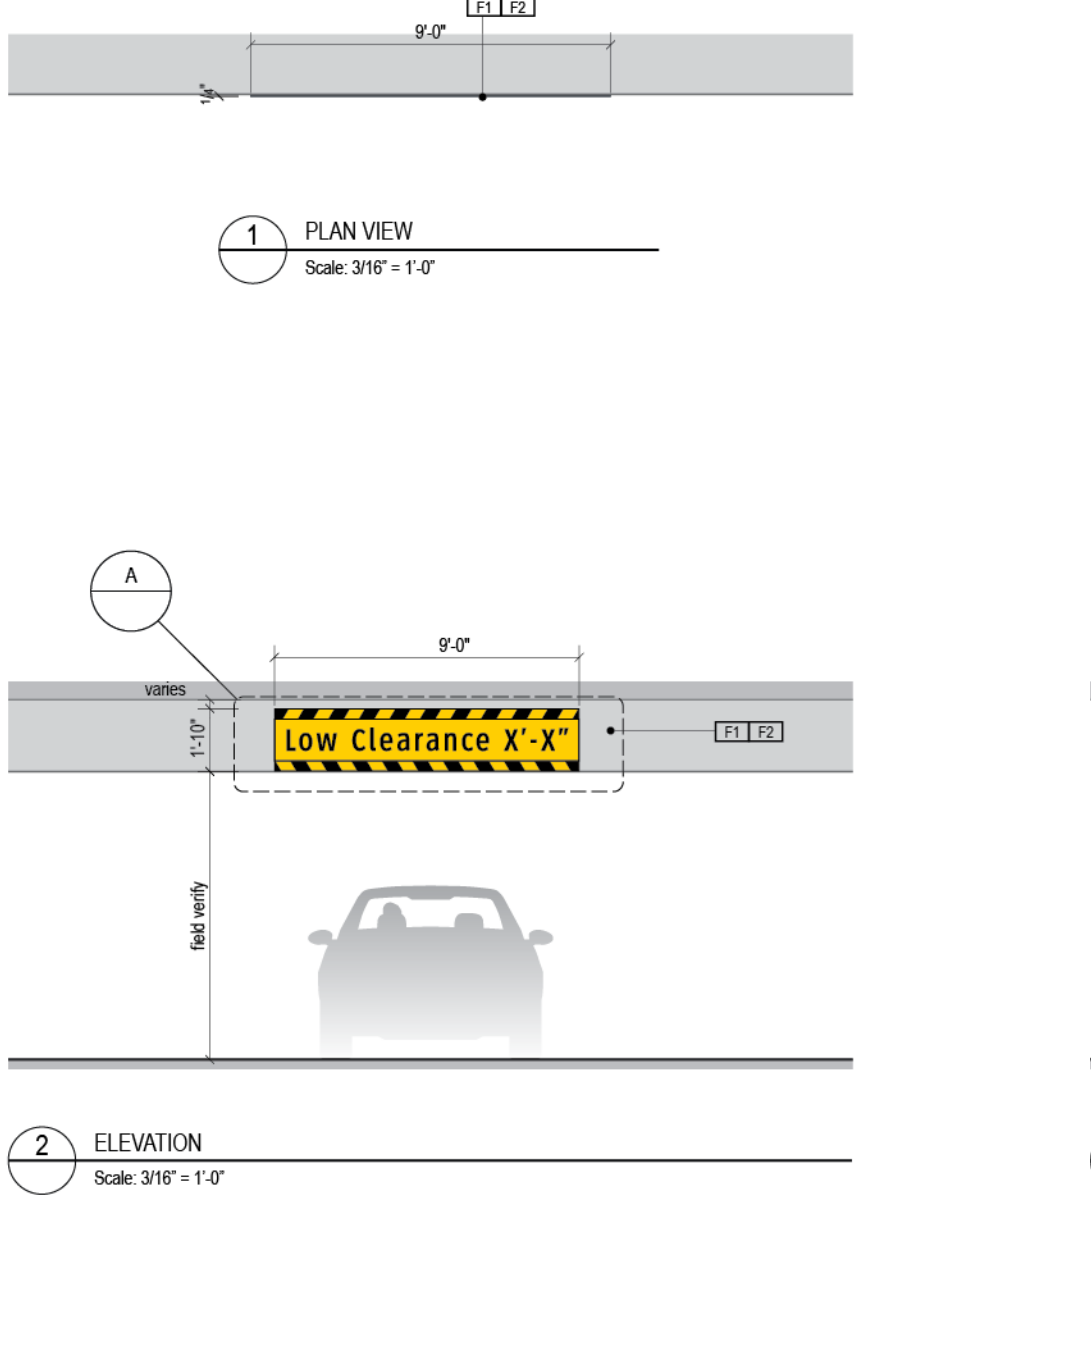

GENERAL NOTES

All final design, engineering, and manufacturing of structural sign support assembly, including fabrications, accessories, and hardware materials shall be performed and approved by a licensed engineer to meet or exceed all applicable code and regulatory codes.

Final engineering, accessories, materials, and hardware on the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

Final fabrication methods, quality and finish to be reviewed and approved by the fabricator. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Consult with the fabricator on all details related to the installation of the sign and accessories. The fabricator shall be responsible for the accuracy of the dimensions shown on the sign and for the accuracy of the components of the sign.

Message shown here are general guidelines only. See graphic message schedule for specific message by location and sign type.

FABRICATION INTENT NOTES

[1] SIGN CABINET FRAME: include fabricated metal fabricated sign face assembly mounted on fabricated aluminum and cast aluminum components with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

[2] SIGN FACE: fabricated sign face assembly mounted on fabricated aluminum and cast aluminum components with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

[3] SIGN MOUNTING: mount to wall structure elements with stainless steel long-profile corner, paint finish to match sign face. Sign panels shall be fabricated to match sign face. Sign panels shall be fabricated to match sign face.

GRAPHICS / COLORS / DECORATION NOTES

[1] Signface: White - Clearview Traffic Sign

[2] Universal Symbols: ASCTA/ISO sign symbol artwork

[3] Sign Artwork: use only official MUTCD/ISO artwork

FINISH

[1] White: FMS White C, Type DMS-6200 Traffic Paint


[2] Silver: MPF paint # MPF021, satin finish

[3] Signface: MPF paint to match FMS 1462 C, satin finish

[4] Signface: MPF paint # MPF021, satin finish


[5] Signface: MPF paint to match FMS 360C, satin finish

[6] Powder coated Traffic Yellow

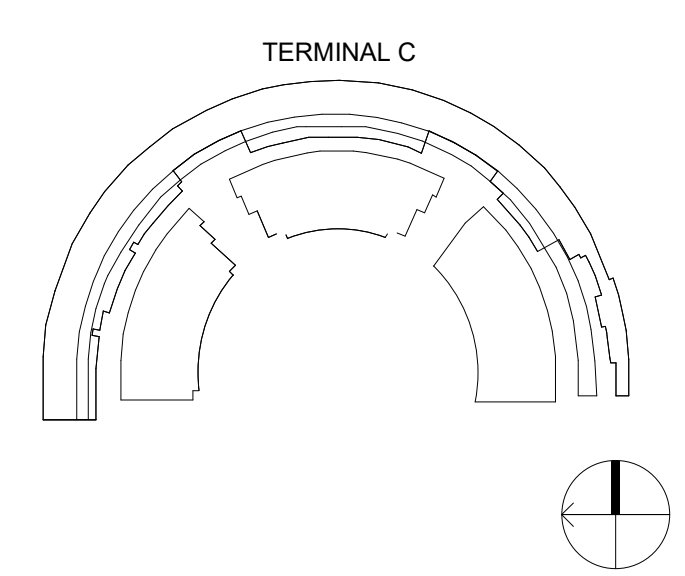

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

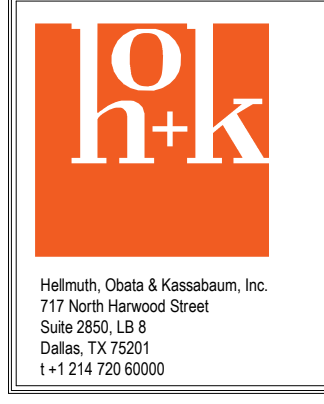

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-10-23	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS

SIGNAGE DETAIL

SHEET NUMBER **AG504-900**

PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

IN PROGRESS

IN PROGRESS

ELEMENT	SIGN TYPE	SIGN FUNCTION	MOUNTING METHOD	GENERAL DESCRIPTION USE
NON-ILLUMINATED	S-ID-66	IDENTIFICATION	WALL MOUNT	PEDESTRIAN - Wall Mount Assistance ID

GENERAL NOTES

- All final design, engineering, and manufacturing of finished sign support structure, including specifications, drawings, and materials, shall be prepared and approved by a licensed engineer prior to start of construction and installation.
- Final engineering, fabrication, and installation shall be the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the information provided. All final design and manufacturing shall be approved by the fabricator after the final approval of the design and manufacturing process.
- Wherever dynamic units are used, they shall be mounted on a support structure that is designed to accommodate the dynamic forces and is approved by a licensed engineer.
- Final fabrication, erection, quality and finish shall be reviewed and approved by DFW Project Director and approved by the Texas Department of Transportation (TxDOT) Project Director.
- Colors shown are for reference only, and are subject to the limitations of the printing process and color calibration. All colors shall be confirmed by the fabricator using color calibration charts. The fabricator shall be responsible for the accuracy of the color calibration process.
- Messages shown are for general information only. The graphic message shall be approved by the fabricator and approved.

FABRICATION INTENT NOTES

- 1. SIGN PANEL: composite phenolic core with sign with integral graphics. See sign and manufacturer's message panel.
- 2. MOUNTING: mount to wall structural elements with connection system as installation conditions require.

GRAPHICS / COLORS / DECORATION NOTES

- 1.1 Typeface: Helvetica - Condensed Bold Medium
- 1.2 Universal Symbols: use only official DFW symbol artwork.

VINYL / FILM / DIGITAL PRINT

- 1.1 Sign Panel: Composite phenolic core with sign with integral graphics. See sign and manufacturer's message panel.
- 1.2 Level 1: Red - to match PMS 185C
- 1.3 Level 2: Purple - to match PMS 282C
- 1.4 Level 3: Yellow - to match PMS 10C
- 1.5 Level 4: Green - to match PMS 15C
- 1.6 Level 5: Blue - to match PMS 272C

ELEMENT	SIGN TYPE	SIGN FUNCTION	MOUNTING METHOD	GENERAL DESCRIPTION USE
NON-ILLUMINATED	S-ID-67	IDENTIFICATION	WALL MOUNT	PEDESTRIAN - Fig ID

GENERAL NOTES

- All final design, engineering, and manufacturing of finished sign support structure, including specifications, drawings, and materials, shall be prepared and approved by a licensed engineer prior to start of construction and installation.
- Final engineering, fabrication, and installation shall be the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the information provided. All final design and manufacturing shall be approved by the fabricator after the final approval of the design and manufacturing process.
- Wherever dynamic units are used, they shall be mounted on a support structure that is designed to accommodate the dynamic forces and is approved by a licensed engineer.
- Final fabrication, erection, quality and finish shall be reviewed and approved by DFW Project Director and approved by the Texas Department of Transportation (TxDOT) Project Director.
- Colors shown are for reference only, and are subject to the limitations of the printing process and color calibration. All colors shall be confirmed by the fabricator using color calibration charts. The fabricator shall be responsible for the accuracy of the color calibration process.
- Messages shown are for general information only. The graphic message shall be approved by the fabricator and approved.

FABRICATION INTENT NOTES

- 1. SIGN PANEL: composite phenolic core with sign with integral graphics. See sign and manufacturer's message panel.
- 2. MOUNTING: mount to wall structural elements with connection system as installation conditions require.

GRAPHICS / COLORS / DECORATION NOTES

- 1.1 Typeface: Helvetica - Condensed Bold Medium
- 1.2 Universal Symbols: use only official DFW symbol artwork.

VINYL / FILM / DIGITAL PRINT

- 1.1 Sign Panel: Composite phenolic core with sign with integral graphics. See sign and manufacturer's message panel.
- 1.2 Level 1: Red - to match PMS 185C
- 1.3 Level 2: Purple - to match PMS 282C
- 1.4 Level 3: Yellow - to match PMS 10C
- 1.5 Level 4: Green - to match PMS 15C
- 1.6 Level 5: Blue - to match PMS 272C

ELEMENT	SIGN TYPE	SIGN FUNCTION	MOUNTING METHOD	GENERAL DESCRIPTION USE
REFLECTIVE / DYNAMIC	S-IN-01	INFORMATIONAL	GROUND MOUNT	VEHICULAR - Roadside Level (Space Count Informational)

GENERAL NOTES

- All final design, engineering, and manufacturing of finished sign support structure, including specifications, drawings, and materials, shall be prepared and approved by a licensed engineer prior to start of construction and installation.
- Final engineering, fabrication, and installation shall be the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the information provided. All final design and manufacturing shall be approved by the fabricator after the final approval of the design and manufacturing process.
- Wherever dynamic units are used, they shall be mounted on a support structure that is designed to accommodate the dynamic forces and is approved by a licensed engineer.
- Final fabrication, erection, quality and finish shall be reviewed and approved by DFW Project Director and approved by the Texas Department of Transportation (TxDOT) Project Director.
- Colors shown are for reference only, and are subject to the limitations of the printing process and color calibration. All colors shall be confirmed by the fabricator using color calibration charts. The fabricator shall be responsible for the accuracy of the color calibration process.
- Messages shown are for general information only. The graphic message shall be approved by the fabricator and approved.

FABRICATION INTENT NOTES

- 1. SIGN FRAME: modular fabricated frame with aluminum extrusion and cast aluminum components with concealed internal hardware. Includes sign face and sign support structure.
- 2. SIGN FACE: fabric and sign face assembly include composite of external aluminum frame and concealed internal hardware. Includes sign face and sign support structure.
- 3. SIGN: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 4. MOUNTING: mount to wall structural elements with connection system as installation conditions require. Includes sign face and sign support structure.

GRAPHICS / COLORS / DECORATION NOTES

- 1.1 Typeface: Helvetica - Condensed Bold Medium
- 1.2 Typeface: Helvetica - Condensed Bold
- 1.3 Typeface: Helvetica - Condensed Bold
- 1.4 Universal Symbols: use only official DFW symbol artwork.
- 1.5 Universal Symbols: use only official DFW symbol artwork.

VINYL / FILM / DIGITAL PRINT

- 1.1 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.2 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.3 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.4 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.5 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.

ELEMENT	SIGN TYPE	SIGN FUNCTION	MOUNTING METHOD	GENERAL DESCRIPTION USE
REFLECTIVE / DYNAMIC	S-IN-02	INFORMATIONAL	GROUND MOUNT	VEHICULAR - Roadside Level (Space Count Informational)

GENERAL NOTES

- All final design, engineering, and manufacturing of finished sign support structure, including specifications, drawings, and materials, shall be prepared and approved by a licensed engineer prior to start of construction and installation.
- Final engineering, fabrication, and installation shall be the responsibility of the fabricator. The fabricator shall be responsible for the accuracy of the information provided. All final design and manufacturing shall be approved by the fabricator after the final approval of the design and manufacturing process.
- Wherever dynamic units are used, they shall be mounted on a support structure that is designed to accommodate the dynamic forces and is approved by a licensed engineer.
- Final fabrication, erection, quality and finish shall be reviewed and approved by DFW Project Director and approved by the Texas Department of Transportation (TxDOT) Project Director.
- Colors shown are for reference only, and are subject to the limitations of the printing process and color calibration. All colors shall be confirmed by the fabricator using color calibration charts. The fabricator shall be responsible for the accuracy of the color calibration process.
- Messages shown are for general information only. The graphic message shall be approved by the fabricator and approved.

FABRICATION INTENT NOTES

- 1. SIGN FRAME: modular fabricated frame with aluminum extrusion and cast aluminum components with concealed internal hardware. Includes sign face and sign support structure.
- 2. SIGN FACE: fabric and sign face assembly include composite of external aluminum frame and concealed internal hardware. Includes sign face and sign support structure.
- 3. SIGN: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 4. MOUNTING: mount to wall structural elements with connection system as installation conditions require. Includes sign face and sign support structure.

GRAPHICS / COLORS / DECORATION NOTES


- 1.1 Typeface: Helvetica - Condensed Bold Medium
- 1.2 Typeface: Helvetica - Condensed Bold
- 1.3 Typeface: Helvetica - Condensed Bold
- 1.4 Universal Symbols: use only official DFW symbol artwork.
- 1.5 Universal Symbols: use only official DFW symbol artwork.

VINYL / FILM / DIGITAL PRINT


- 1.1 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.2 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.3 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.4 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.
- 1.5 Sign: 6061 aluminum extrusion frame with sign face and sign support structure. Includes sign face and sign support structure.

Sign with to contain thickness of existing dynamic units (+/- 8" shown, field verify existing dynamic units)


1 PLAN VIEW
Scale: 3/16" = 1'-0"

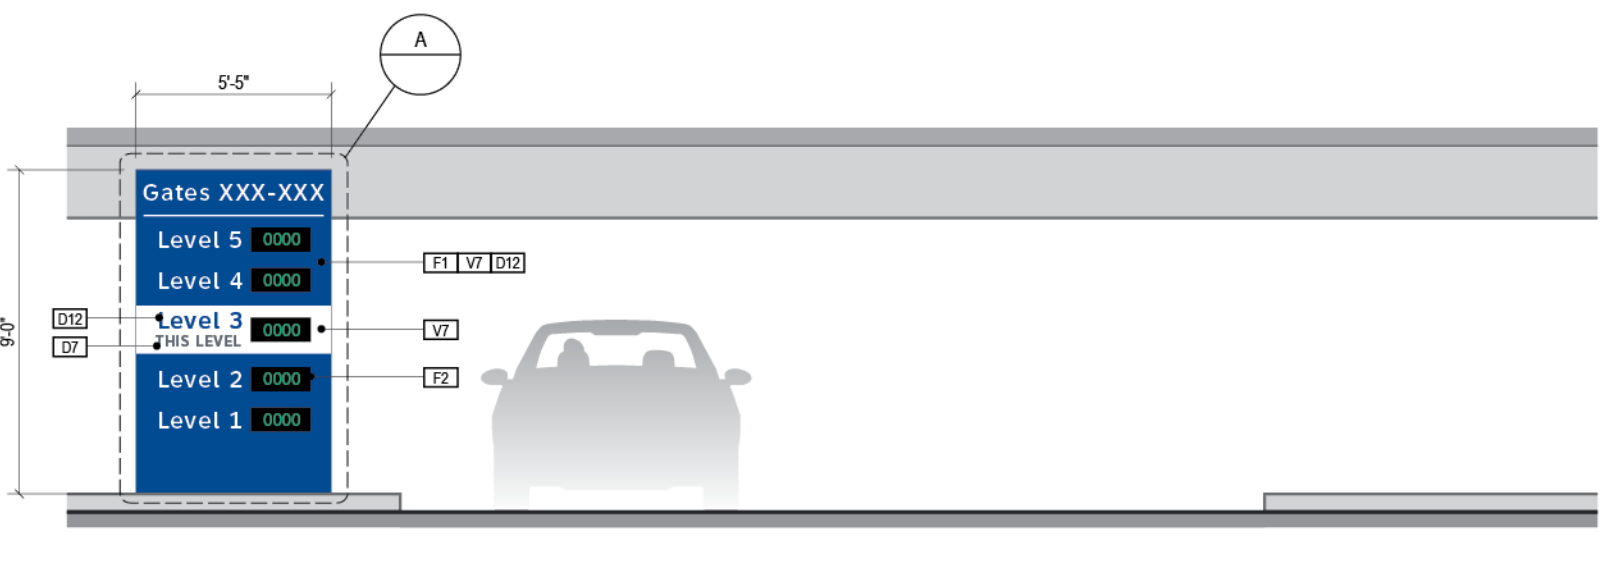

1 ELEVATION - Garage Level 3 Entrance Area (Typical)
Scale: 3/16" = 1'-0"

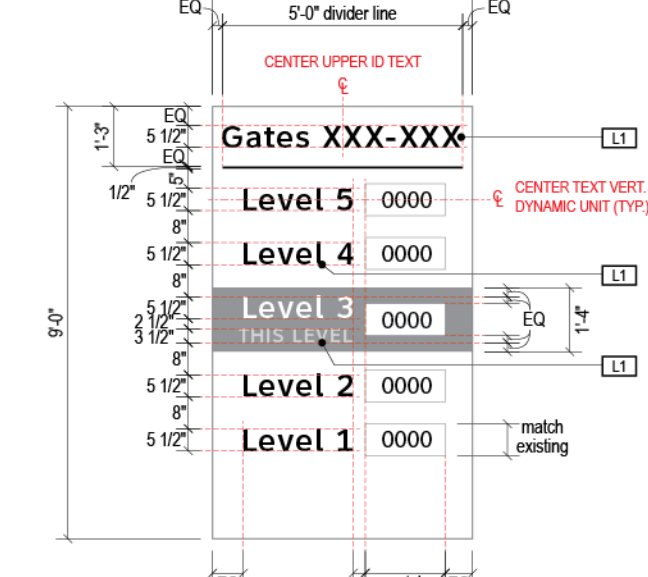

A FACE LAYOUT
Scale: 1/4" = 1'-0"

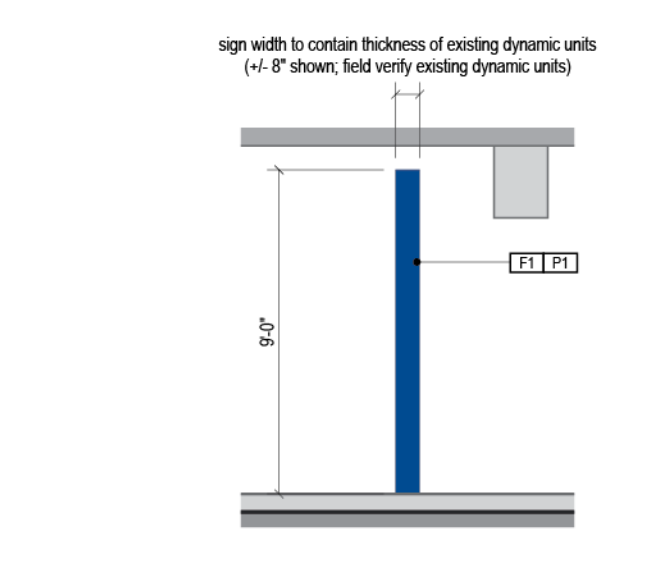


2 SIDE VIEW
Scale: 3/16" = 1'-0"

Sign with to contain thickness of existing dynamic units (+/- 8" shown, field verify existing dynamic units)


1 PLAN VIEW
Scale: 3/16" = 1'-0"




1 ELEVATION - Garage Entrance Area (Typical)
Scale: 3/16" = 1'-0"

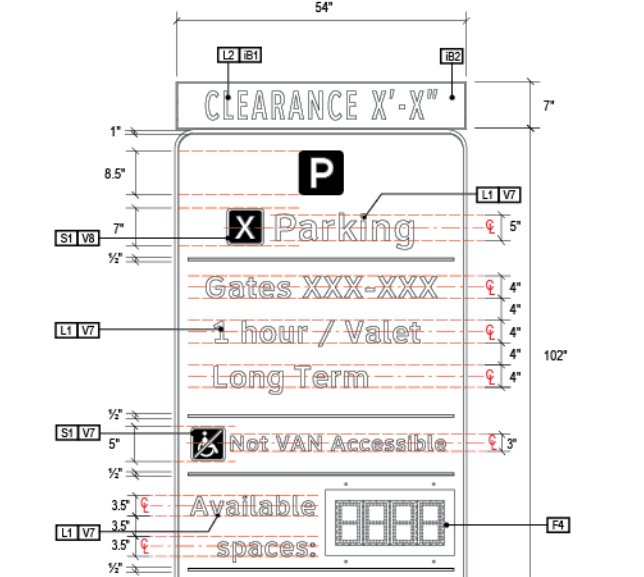

A FACE LAYOUT
Scale: 1/4" = 1'-0"

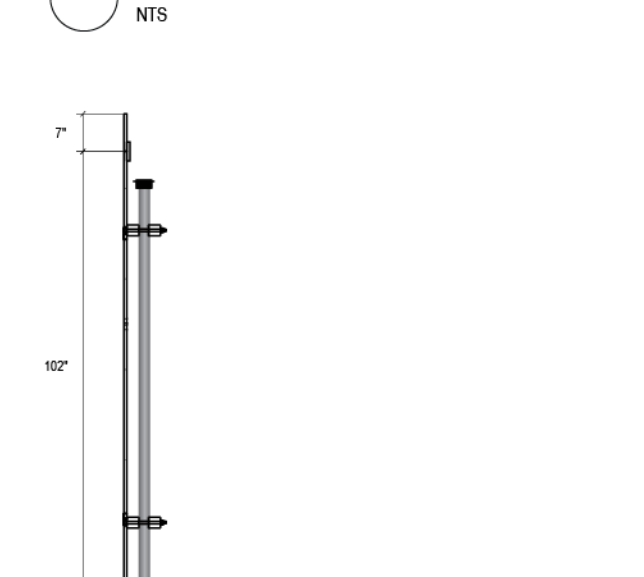

2 SIDE VIEW
Scale: 3/16" = 1'-0"

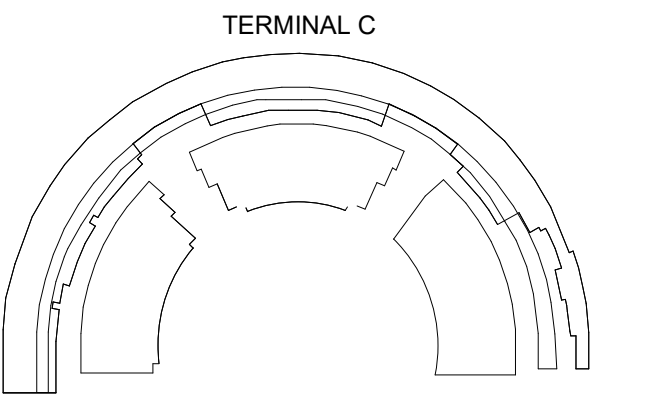

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k

Hydruik, Clark & Koenigsmann, Inc.
717 North Memorial Street
Suite 2050, LB #
Dallas, TX 75201
1-214-722-6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-01-08	75% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)



PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS
SIGNAGE DETAIL

PERMIT NUMBER: 822-0022

SHEET NUMBER
AG507-900

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

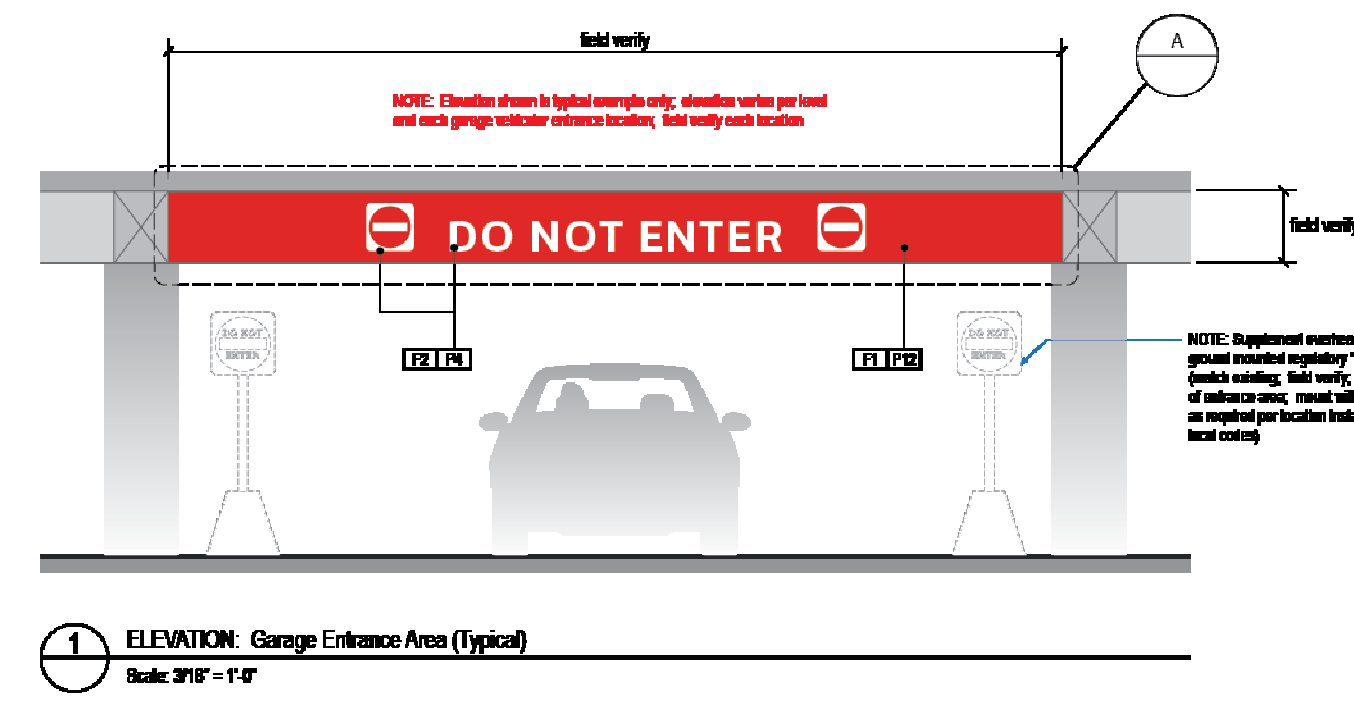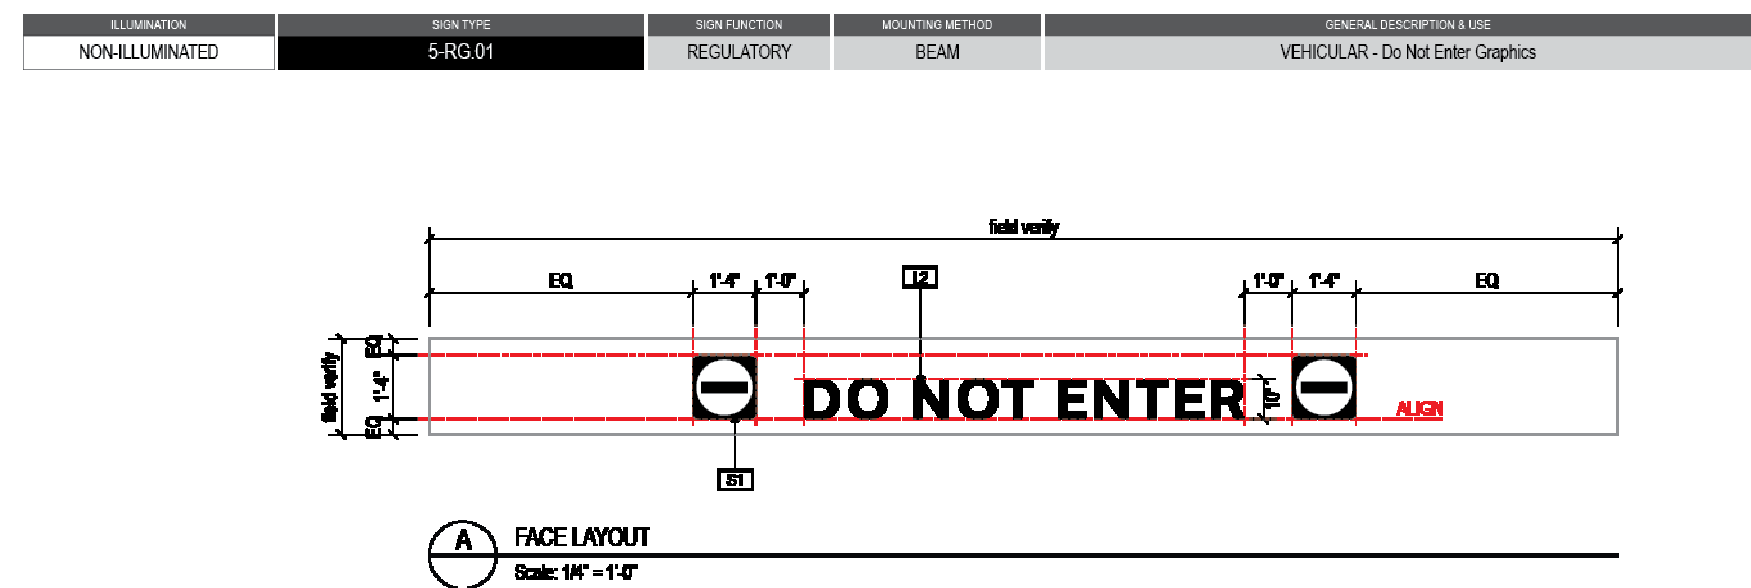

GENERAL NOTES


- All final design, engineering, and construction documents are subject to review and approval by the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

FABRICATION INSTRUCTIONS

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

CONTRACTOR/INSTALLER/ERECTOR NOTES

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

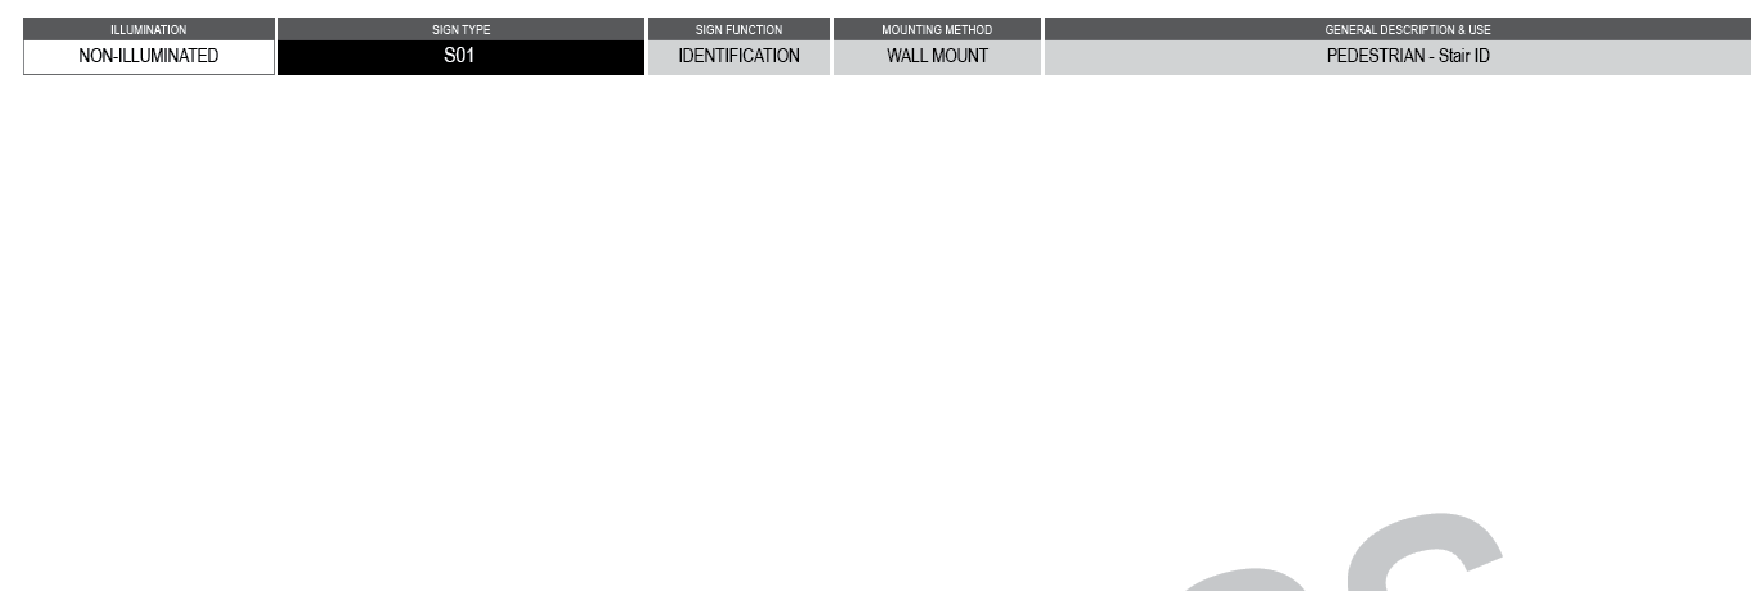

GENERAL NOTES

- All final design, engineering, and construction documents are subject to review and approval by the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

FABRICATION INSTRUCTIONS

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

CONTRACTOR/INSTALLER/ERECTOR NOTES

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).



GENERAL NOTES

- All final design, engineering, and construction documents are subject to review and approval by the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

FABRICATION INSTRUCTIONS

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

CONTRACTOR/INSTALLER/ERECTOR NOTES

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).



GENERAL NOTES

- All final design, engineering, and construction documents are subject to review and approval by the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- The sign shall be installed in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

FABRICATION INSTRUCTIONS


- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

CONTRACTOR/INSTALLER/ERECTOR NOTES

- 1. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).
- 2. SIGN PANEL: Composite panels are available in a variety of colors and finishes. The sign shall be fabricated in accordance with the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT) and the Texas Department of Transportation (TxDOT).

IN PROGRESS

IN PROGRESS

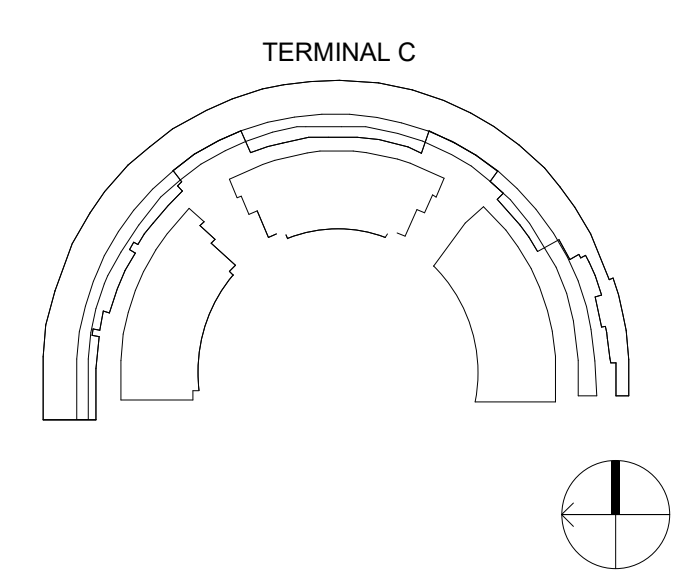

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k

Holtz, Clark & Kaufman, Inc.
717 North Main Street
Dallas, TX 75201
1-214-722-6000

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
3	2021-01-09	75% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS
SIGNAGE DETAIL

PROJECT NUMBER: TFD-007


PERMIT NUMBER: B22-0022

SHEET NUMBER
AG508-900


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




Figure 1.1.9a DFW Wayfinding Sign Family: Airport Perimeter Fence Signage

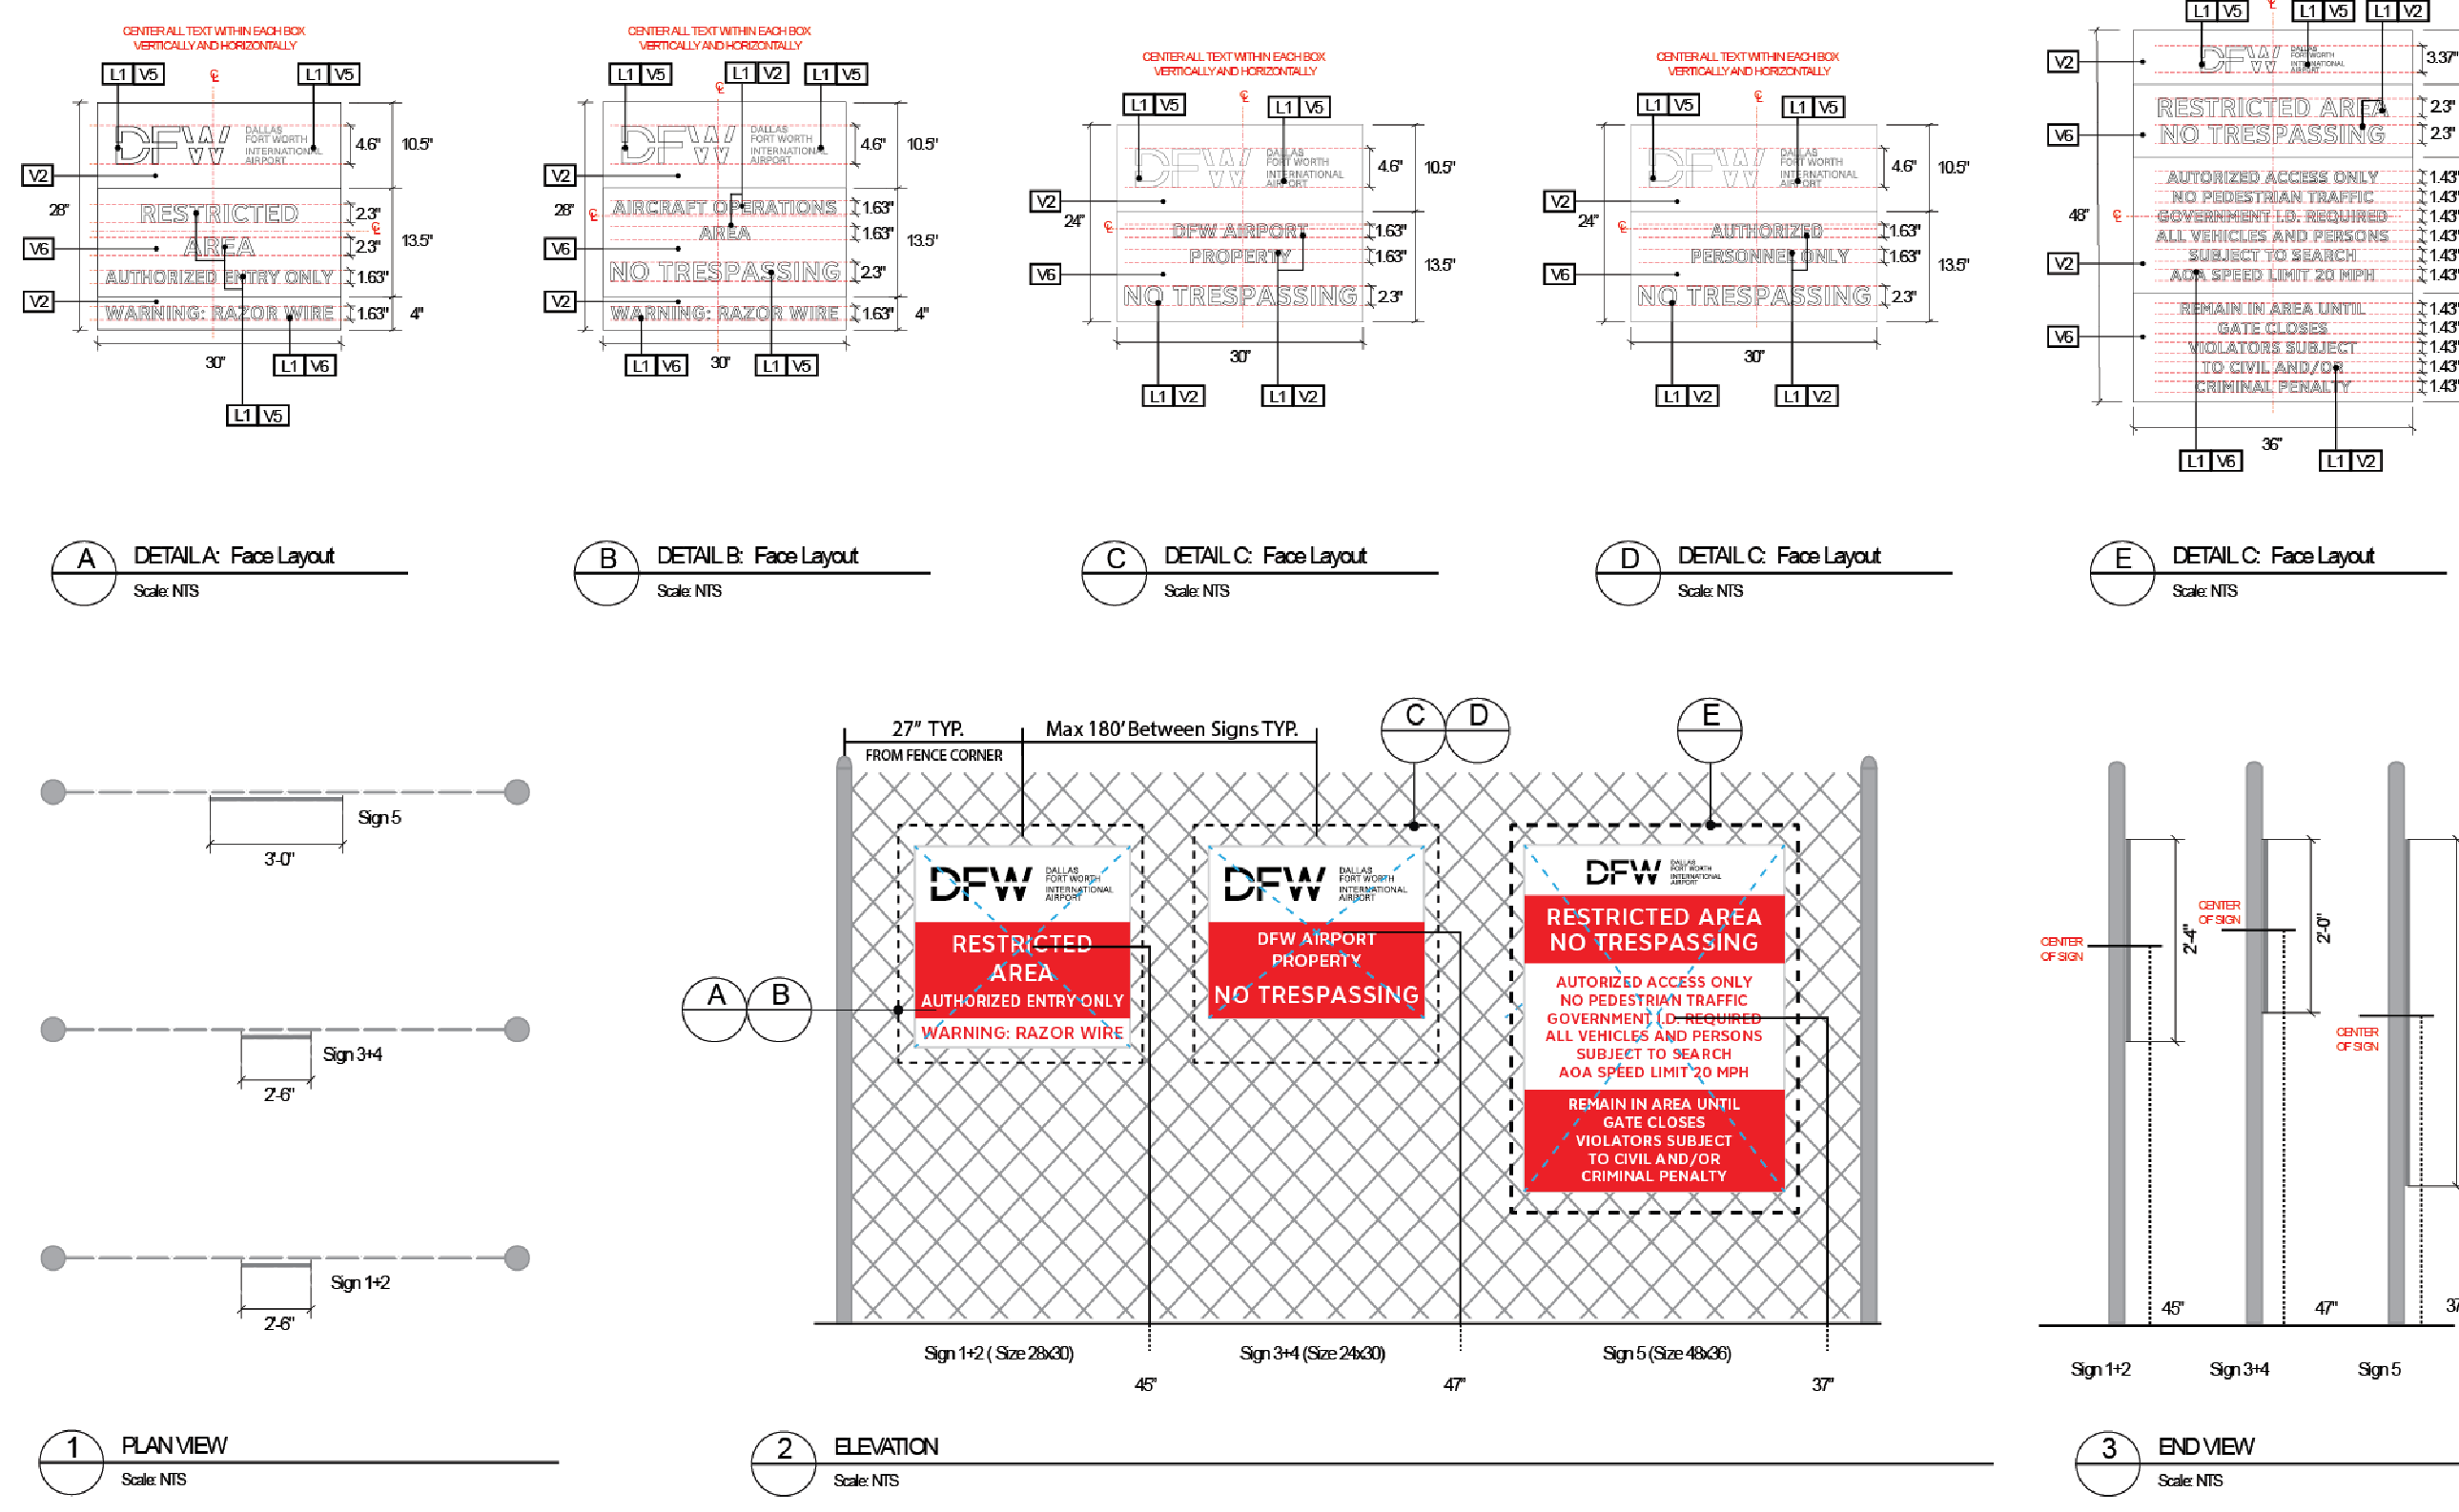

- GENERAL NOTES**
- 1. All signs, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 2. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 3. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 4. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 5. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
- FABRICATION NOTES**
- 1. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 2. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 3. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 4. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 5. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
- DRYNESS/COLORS/DECORATION NOTES**
- 1. System: 100 - Clearcoat/Black
 - 2. System: 100 - Clearcoat/Black
 - 3. System: 100 - Clearcoat/Black
 - 4. System: 100 - Clearcoat/Black
 - 5. System: 100 - Clearcoat/Black

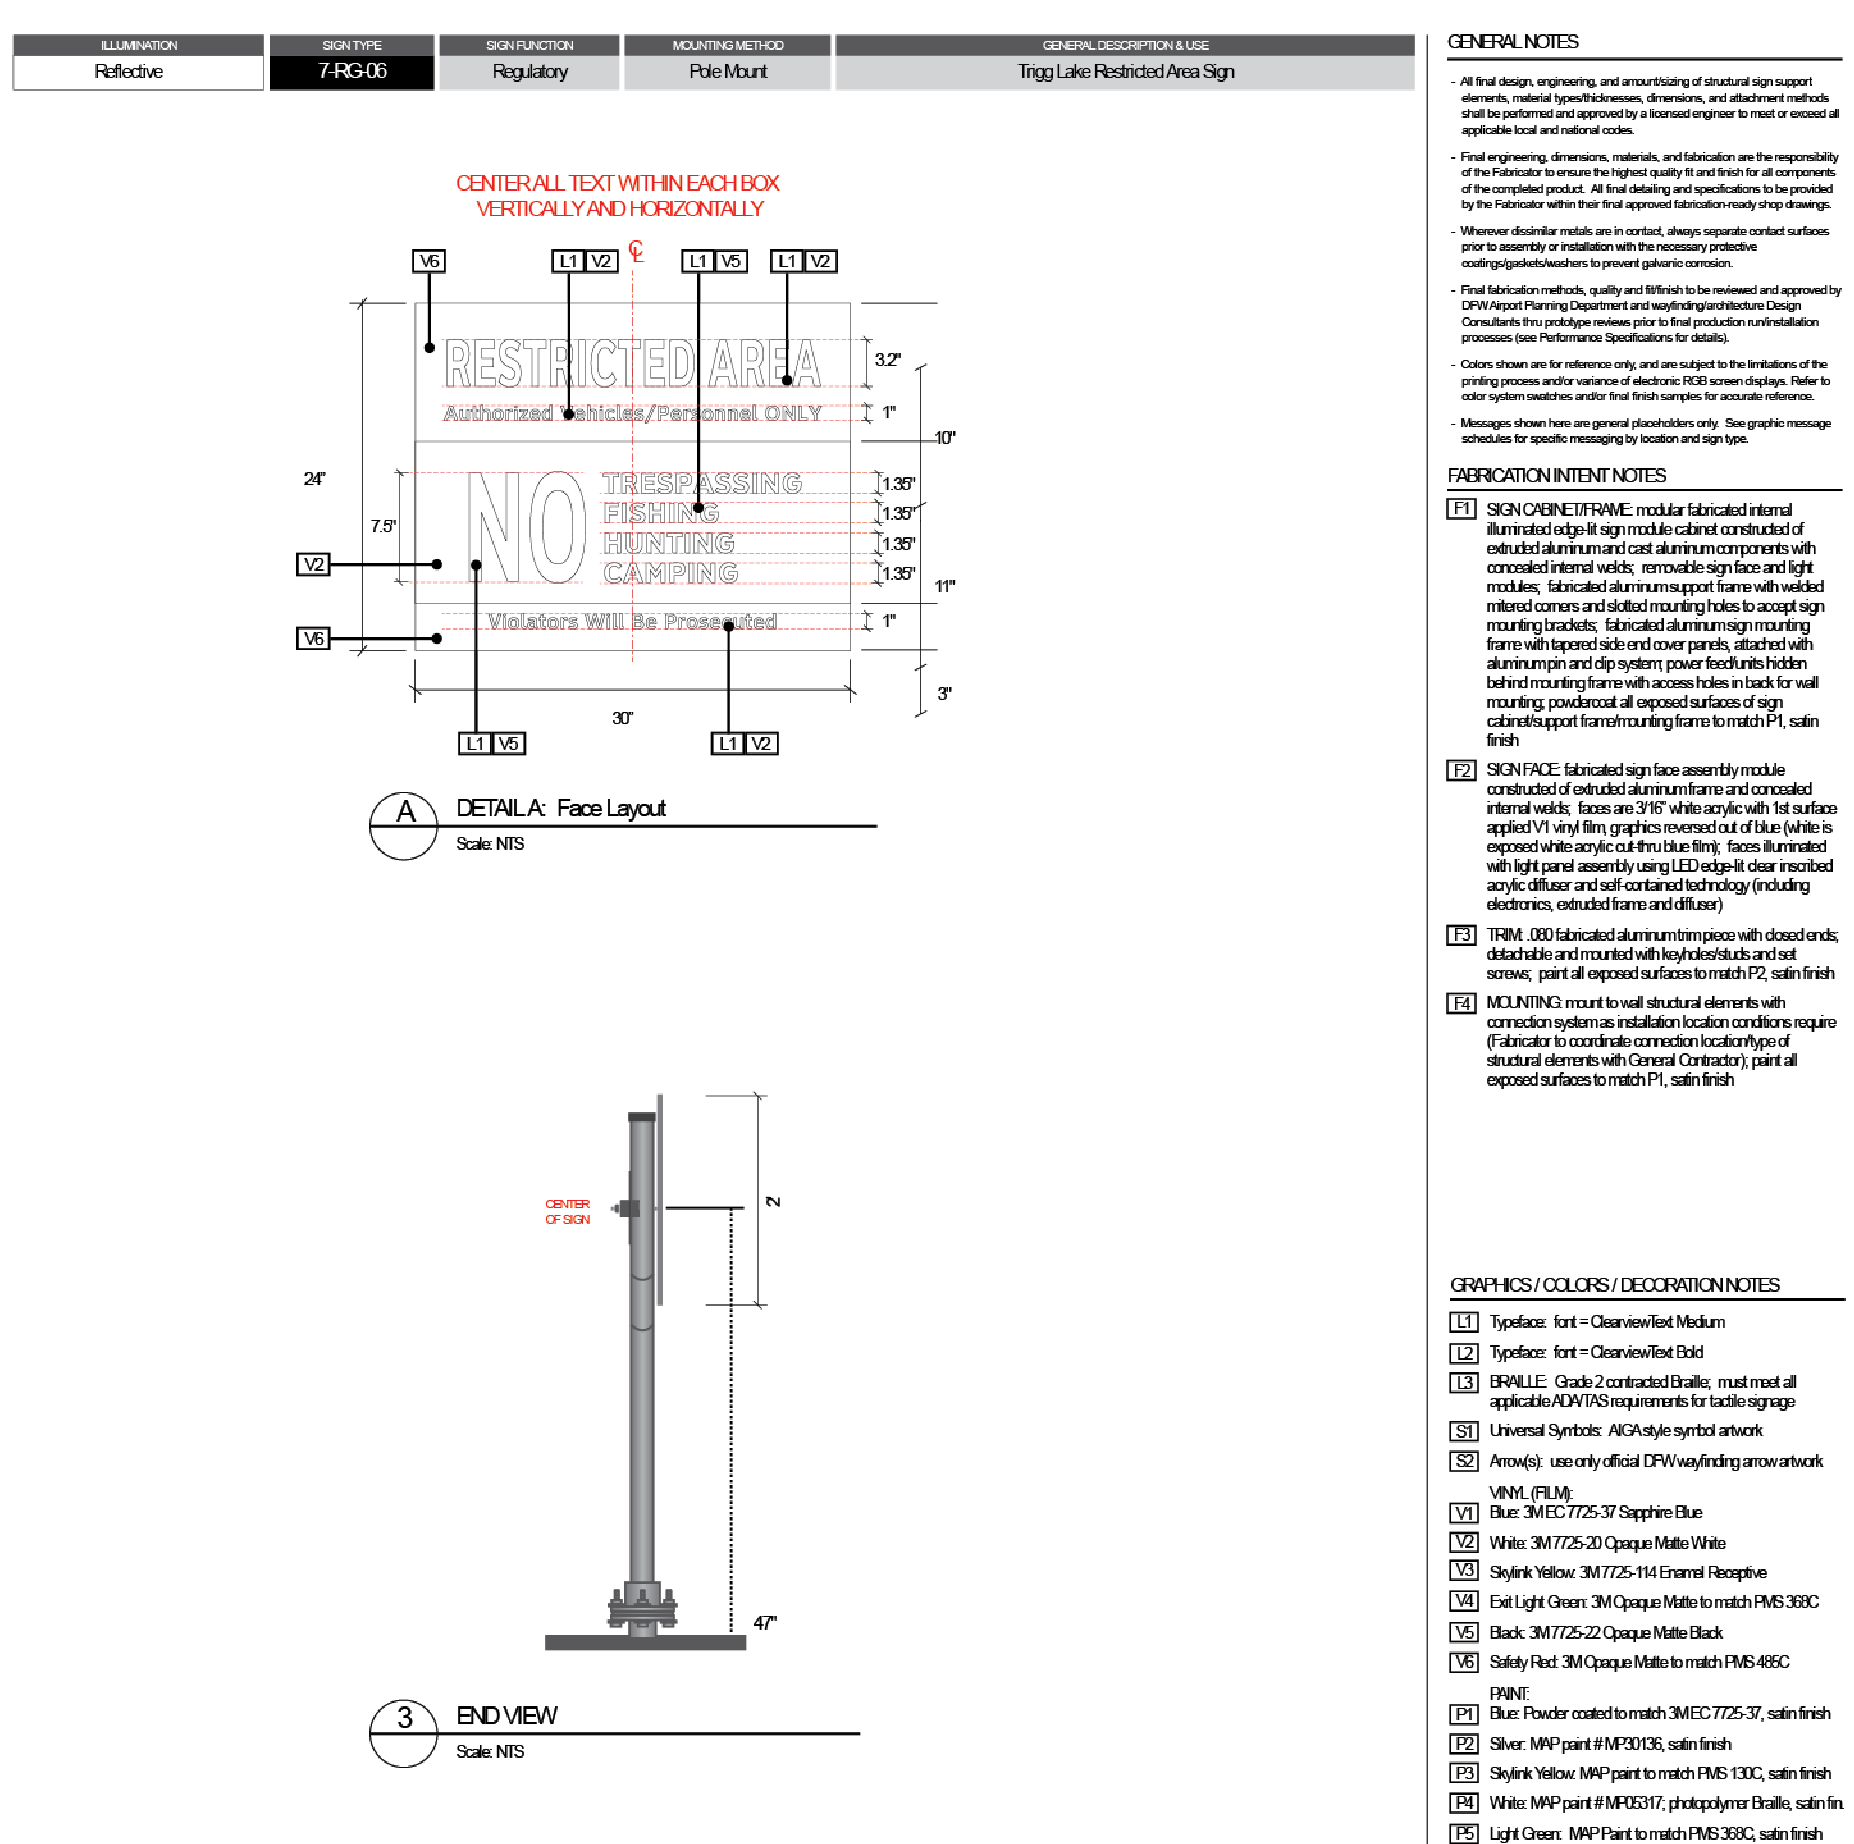

- GENERAL NOTES**
- 1. All signs, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 2. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 3. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 4. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 5. The design, engineering, and all materials of construction shall be in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
- FABRICATION NOTES**
- 1. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 2. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 3. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 4. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
 - 5. SIGN FABRICATION: Make fabrication of signs in accordance with the specifications and standards of the International Brotherhood of Fire Alarm and Signaling Association (IBFASA).
- DRYNESS/COLORS/DECORATION NOTES**
- 1. System: 100 - Clearcoat/Black
 - 2. System: 100 - Clearcoat/Black
 - 3. System: 100 - Clearcoat/Black
 - 4. System: 100 - Clearcoat/Black
 - 5. System: 100 - Clearcoat/Black

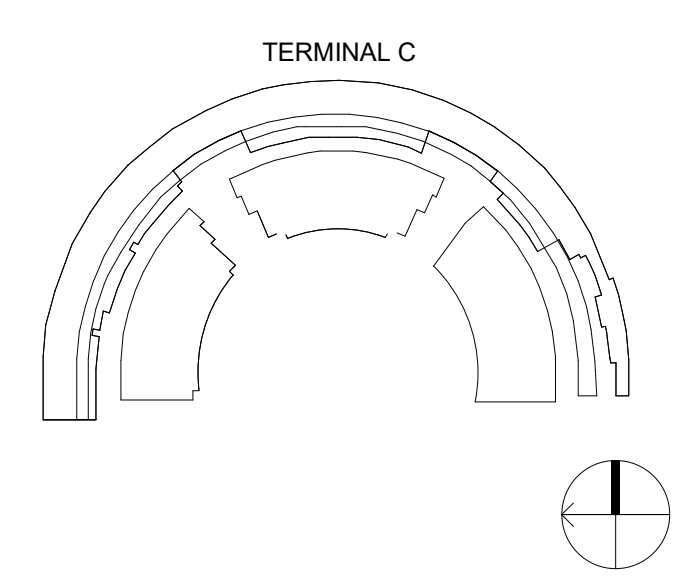

GARAGE A ARCHITECTURAL GRAPHICS SCHEDULE - LEVEL A

Table with columns: SIGN GROUP, LOCATION NO., SIGN DESCRIPTION, ROOM NO., ROOM NAME, MESSAGE A, MESSAGE B, POWER, DATA, BLOCKING, VINYL BACKER, COMMENTS, COUNT. Includes rows for VEHICULAR, PEDESTRIAN, POLE MOUNT CHARGING STATION, and FLIP ID signs.

GARAGE A ARCHITECTURAL GRAPHICS SCHEDULE - LEVEL A

Table with columns: SIGN GROUP, LOCATION NO., SIGN DESCRIPTION, ROOM NO., ROOM NAME, MESSAGE A, MESSAGE B, POWER, DATA, BLOCKING, VINYL BACKER, COMMENTS, COUNT. Includes rows for VEHICULAR, FIRE EXTINGUISHER ID, ROOM ID, and STAIR SIGN signs.


GENERAL NOTE

1. MESSAGING TO BE REVIEWED AND APPROVED BY THE CLIENT.


SHEET NOTE

Table with columns: SIGN TYPE, SIGN DESCRIPTION. Lists various sign types and their descriptions, such as VEHICULAR - Up-Down Trailblazer, PEDESTRIAN - Terminal Trailblazer, etc.


LEGEND

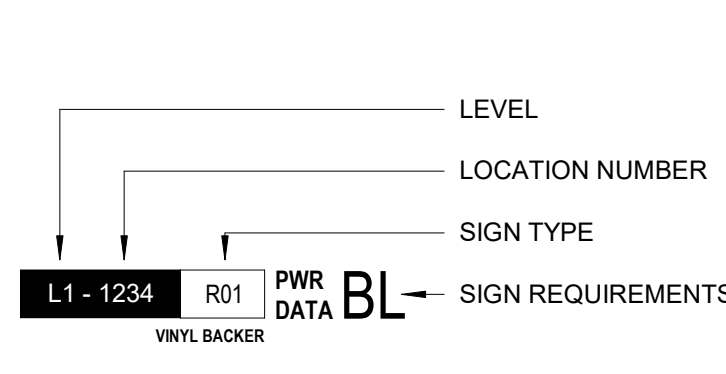

KEY PLAN

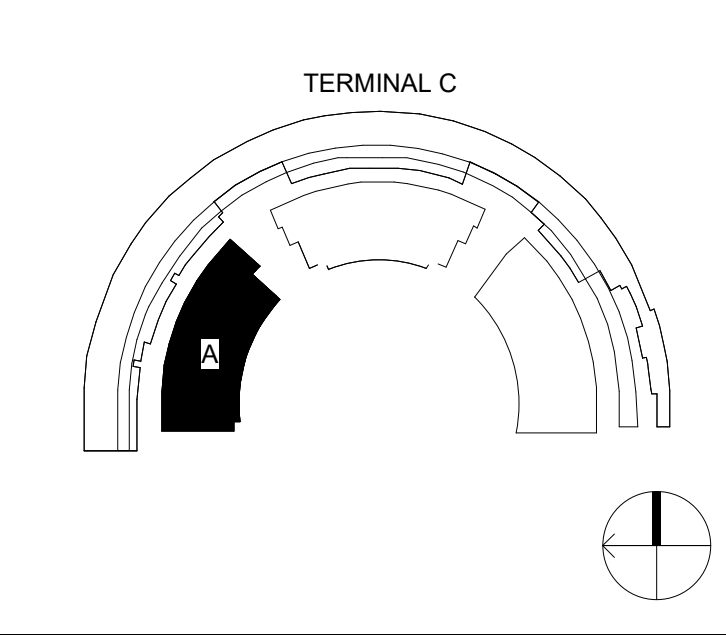

DFW logo and address: DALLAS FORT WORTH INTERNATIONAL AIRPORT, 2330 N INTERNATIONAL PARKWAY, DFW AIRPORT, TX 75261

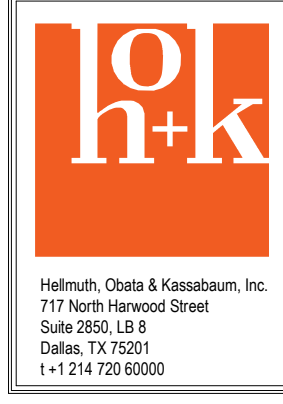

DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28
NOT FOR BID OR CONSTRUCTION

Table with columns: NO., DATE, DESCRIPTION. Lists revision history for the schedule.

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A SIGNAGE SCHEDULE - LEVEL A
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
AG601-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GARAGE A ARCHITECTURAL GRAPHICS SCHEDULE - LEVEL C													
SIGN GROUP	LOCATION NO.	SIGN DESCRIPTION	ROOM NO.	ROOM NAME	MESSAGE A	MESSAGE B	POWER	DATA	BLOCKING	VINYL BACKER	COMMENTS	COUNT	
5DR.03													
5DR.03	1597	VEHICULAR - Up-Down Trailblazer					No	No	No	No		1	
5DR.03.1												1	
5DR.07													
5DR.07	1405	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1406	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1407	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1408	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1409	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	No	Yes	No		1	
5DR.07	1410	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1411	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1412	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1413	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1414	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	No	Yes	No		1	
5DR.07	1415	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1416	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1417	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1418	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1419	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1420	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1421	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1422	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1423	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1424	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1425	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1426	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1427	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1428	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1429	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1430	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1448	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1449	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07	1450	VEHICULAR - Directionals with 2 Messages Per Direction					Yes	Yes	No	No		1	
5DR.07.29												29	
5DR.08													
5DR.08	1598	VEHICULAR - Exit Trailblazer					No	No	No	No		1	
5DR.08.1												1	
5DR.31													
5DR.31	1431	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1432	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1433	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1434	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1435	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1436	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1437	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1438	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1439	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1440	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1441	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1442	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1443	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1444	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1445	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1446	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1447	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	1451	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	6317	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	6316	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1	
5DR.31	6323	PEDESTRIAN - Terminal Trailblazer					No	No	Yes	No		1	
5DR.31	6324	PEDESTRIAN - Terminal Trailblazer					No	No	Yes	No		1	
5DR.31.22												22	
5ID.21													
5ID.21	1595	OVERHEAD ENTRY SIGN					No	No	No	No		1	
5ID.21.1												1	
5ID.55													
5ID.55	14610	PEDESTRIAN - Large Wall Mounted Garage Entrance ID					No	No	No	No		1	
5ID.55	14611	PEDESTRIAN - Large Wall Mounted Garage Entrance ID					No	No	No	No		1	
5ID.55	14612	PEDESTRIAN - Large Wall Mounted Garage Entrance ID					No	No	No	No		1	
5ID.55.3												3	
5ID.65c													
5ID.65c	1591	PEDESTRIAN - Wall Mount Elevator Level ID/Directory					No	No	No	No		1	
5ID.65c	1592	PEDESTRIAN - Wall Mount Elevator Level ID/Directory					No	No	No	No		1	
5ID.65c.2												2	
5IN.01													
5IN.01	1590	VEHICULAR - Roadside Level ID Space Count Informational					Yes	Yes	No	No		1	
5IN.01	1596	VEHICULAR - Roadside Level ID Space Count Informational					No	No	No	No		1	
5IN.01.2												2	
5RG.01													
5RG.01	1594	VEHICULAR - Do Not Enter Graphics					No	No	No	No		1	
5RG.01	6319	VEHICULAR - Do Not Enter Graphics					No	No	No	No		1	
5RG.01.2												2	
FEC													
FEC	1599	FIRE EXTINGUISHER ID					No	No	No	No		1	
FEC	6331	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6332	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6333	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6335	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6336	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6337	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6338	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6339	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6340	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6341	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6342	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6343	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6344	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6345	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6346	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC	6347	FIRE EXTINGUISHER ID			(FEC GRAPHICS)	(FEC GRAPHICS)	No	No	No	No		1	
FEC.17												17	
R01													
R01	1588	ROOM ID					No	No	No	No		1	
R01	1589	ROOM ID					No	No	No	No		1	
R01	6322	ROOM ID					No	No	No	No		1	
R01	6329	ROOM ID					No	No	No	No		1	
R01	6330	ROOM ID					No	No	No	No		1	
R01.5												5	
S02													
S02	6325	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1	
S02	6326	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1	
S02	6327	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1	
S02	6328	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1	
S02.4												4	
GRAND TOTAL: 89												89	

GARAGE A ARCHITECTURAL GRAPHICS SCHEDULE - LEVEL C													
SIGN GROUP	LOCATION NO.	SIGN DESCRIPTION	ROOM NO.	ROOM NAME	MESSAGE A	MESSAGE B	POWER	DATA	BLOCKING	VINYL BACKER	COMMENTS	COUNT	
5DR.03													
5DR.03	1597	VEHICULAR - Up-Down Trailblazer					No	No	No	No		1	
5DR.03.1												1	
5DR.07													
5DR.07	1405	VEHICULAR - Directionals with 2 Messages Per Direction					Yes						

GARAGE A ARCHITECTURAL GRAPHICS SCHEDULE - LEVEL E

SIGN GROUP	LOCATION NO.	SIGN DESCRIPTION	ROOM NO.	ROOM NAME	MESSAGE A	MESSAGE B	POWER	DATA	BLOCKING	VINYL BACKER	COMMENTS	COUNT
5-DR.41												
5-DR.41	1792	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1794	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1796	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1798	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1800	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1802	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1804	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1806	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1808	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1810	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1812	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1814	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1816	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1818	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1820	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1822	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1824	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1826	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1828	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1830	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1832	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1834	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1836	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1838	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1840	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1842	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1844	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1846	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41	1848	PEDESTRIAN - Terminal Trailblazer					No	No	No	No		1
5-DR.41: 29												29
5-DR.53												
5-DR.53	1854	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1855	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1856	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1857	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1858	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1859	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1860	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53	1860	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*					No	No	No	No		1
5-DR.53: 8												8
5-DR.54a												
5-DR.54a	6404	POLE MOUNT CHARGING STATION		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
5-DR.54a	6405	POLE MOUNT CHARGING STATION		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
5-DR.54a: 2												2
5-ID.52												
5-ID.52	1793	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1795	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1797	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1799	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1801	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1803	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1805	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1807	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1809	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1811	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1813	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1815	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1817	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1819	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1821	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1823	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1825	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1827	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1829	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1831	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1833	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1835	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1837	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1839	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1841	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1843	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1845	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1847	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52	1849	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides					No	No	No	No		1
5-ID.52: 29												29
5-ID.56												
5-ID.56	6704	PEDESTRIAN - Wall Mounted Elevator Garage Level ID					No	No	No	No		1
5-ID.56: 1												1
5-ID.65a												
5-ID.65a	1850	PEDESTRIAN - Wall Mount Elevator Level ID/Directory					No	No	No	No		1
5-ID.65a	1851	PEDESTRIAN - Wall Mount Elevator Level ID/Directory					No	No	No	No		1
5-ID.65a: 2												2
5-ID.66												
5-ID.66	6406	WALL MOUNT ASSISTANCE ID					No	No	No	No		1
5-ID.66: 1												1
FEC												
FEC	6407	FIRE EXTINGUISHER ID					No	No	No	No		1
FEC	6412	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6413	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6414	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6415	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6416	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6417	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6418	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6419	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6420	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6421	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6422	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6423	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6424	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6425	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6426	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC	6427	FIRE EXTINGUISHER ID		(FEC GRAPHICS)	(FEC GRAPHICS)		No	No	No	No		1
FEC: 17												17
R01												
R01	1852	ROOM ID					No	No	No	No		1
R01: 1												1
S02												
S02	6408	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1
S02	6409	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1
S02	6410	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1
S02	6411	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE					No	No	No	No		1
S02: 4												4
GRAND TOTAL: 94												94

GENERAL NOTE


1. MESSAGING TO BE REVIEWED AND APPROVED BY THE CLIENT.

SHEET NOTE


SIGN TYPE SIGN DESCRIPTION

5-DR.03	VEHICULAR - Up-Down Trailblazer
5-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
5-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
5-DR.08	VEHICULAR - Exit Trailblazer
5-DR.19	VEHICULAR - Garage Ramp Entry Directional
5-DR.31	PEDESTRIAN - Terminal Trailblazer
5-DR.41	PEDESTRIAN - Terminal Trailblazer
5-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides*
5-DR.54a	POLE MOUNT CHARGING STATION
5-ID.01	VEHICULAR - Ramp Entry ID Graphics
5-ID.20	POLE MOUNTED - TxDOT RPS-3 - SINGLE SIDED
5-ID.21	OVERHEAD ENTRY SIGN
5-ID.25	VEHICULAR - GARAGE TOTEM SIGN
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
5-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
5-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
5-ID.54	PEDESTRIAN - VALET PARKING ID
5-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
5-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65a	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.66	WALL MOUNT ASSISTANCE ID
5-ID.67	FLIP ID
5-IN.01	VEHICULAR - Roadside Level ID Space Count Informational
5-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
5-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE

LEGEND

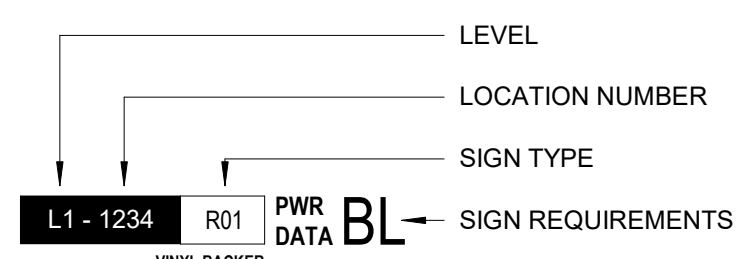

KEY PLAN

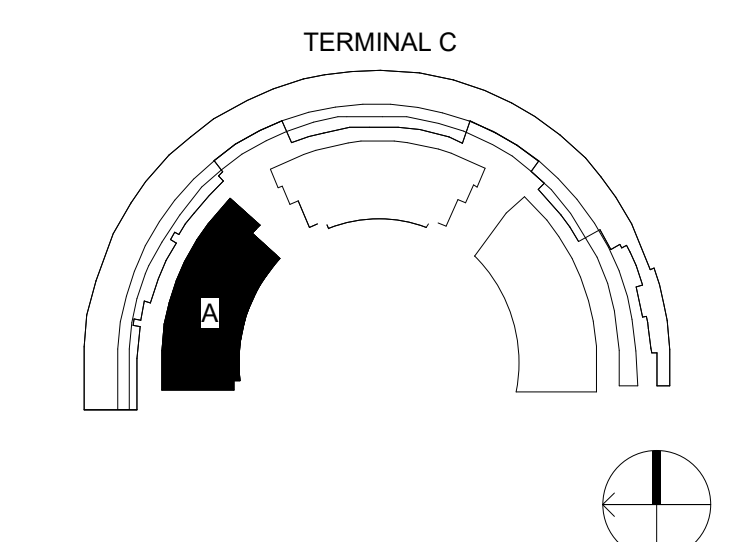

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: AS
APPROVED BY:
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-10-29	30% DESIGN
2	2021-01-09	70% DESIGN
3	2022-09-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A SIGNAGE SCHEDULE - LEVEL E

PERMIT NUMBER: B22-0022

SHEET NUMBER

AG605-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

D
C
B
A

GARAGE A ARCHITECTURAL GRAPHICS COLUMN SCHEDULE - LEVEL A

SIGN GROUP	SIGN DESCRIPTION	MESSAGE A	COMMENTS	COUNT
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			232
5-ID.51a	232			
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			177
5-ID.51b	177			
5-ID.53	PEDESTRIAN - 1 HOUR PARKING ID			35
5-ID.53	35			
GRAND TOTAL				444

GARAGE A ARCHITECTURAL GRAPHICS COLUMN SCHEDULE - LEVEL B

SIGN GROUP	SIGN DESCRIPTION	MESSAGE A	COMMENTS	COUNT
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			236
5-ID.51a	236			
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			215
5-ID.51b	215			
GRAND TOTAL				451

GARAGE A ARCHITECTURAL GRAPHICS COLUMN SCHEDULE - LEVEL C

SIGN GROUP	SIGN DESCRIPTION	MESSAGE A	COMMENTS	COUNT
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			236
5-ID.51a	236			
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			179
5-ID.51b	179			
5-ID.53	PEDESTRIAN - 1 HOUR PARKING ID			26
5-ID.53	26			
5-ID.54	PEDESTRIAN - VALET PARKING ID			11
5-ID.54	11			
GRAND TOTAL				452

GARAGE A ARCHITECTURAL GRAPHICS COLUMN SCHEDULE - LEVEL D

SIGN GROUP	SIGN DESCRIPTION	MESSAGE A	COMMENTS	COUNT
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			232
5-ID.51a	232			
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID			211
5-ID.51b	211			
GRAND TOTAL				443


GENERAL NOTE

1. MESSAGING TO BE REVIEWED AND APPROVED BY THE CLIENT.


SHEET NOTE

SIGN TYPE	SIGN DESCRIPTION
5-DR.03	VEHICULAR - Up-Down Trailblazer
5-DR.07	VEHICULAR - Directionals with 2 Messages Per Direction
5-DR.07b	VEHICULAR - Directionals with 2 Messages Per Direction
5-DR.08	VEHICULAR - Exit Trailblazer
5-DR.19	VEHICULAR - Garage Ramp Entry Directional
5-DR.31	PEDESTRIAN - Terminal Trailblazer
5-DR.41	PEDESTRIAN - Terminal Trailblazer
5-DR.53	VEHICULAR - Roadside/Roof Level Exit Trailblazer, 1 or 2 sides
5-DR.54a	POLE MOUNT CHARGING STATION
5-ID.01	VEHICULAR - Ramp Entry ID Graphics
5-ID.20	POLE MOUNTED - TxDOT RS-3 - SINGLE SIDED
5-ID.21	OVERHEAD ENTRY SIGN
5-ID.25	VEHICULAR - GARAGE TOTEM SIGN
5-ID.51a	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
5-ID.51b	PEDESTRIAN - WALL COLUMN MOUNT GARAGE SECTION ID
5-ID.52	PEDESTRIAN - Light Pole Mount Garage Section ID, 2 sides
5-ID.53	PEDESTRIAN - 1 HOUR PARKING ID
5-ID.54	PEDESTRIAN - VALET PARKING ID
5-ID.55	PEDESTRIAN - Large Wall Mounted Garage Entrance ID
5-ID.56	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65b	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65c	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65d	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65e	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.65f	PEDESTRIAN - Wall Mount Elevator Level ID/Directory
5-ID.66	WALL MOUNT ASSISTANCE ID
5-ID.67	FLIP ID
5-IN.01	VEHICULAR - Roadside Level ID Space Count Informational
5-IN.02	VEHICULAR - ROADSIDE GARAGE ENTRANCE DIRECTIONAL
5-RG.01	VEHICULAR - Do Not Enter Graphics
FEC	FIRE EXTINGUISHER ID
R01	ROOM ID
S01	STAIR SIGN - EXTERIOR STAIRWELL ID - WITH BRAILLE
S02	STAIR SIGN - INTERIOR STAIRWELL FIRE CODE


LEGEND

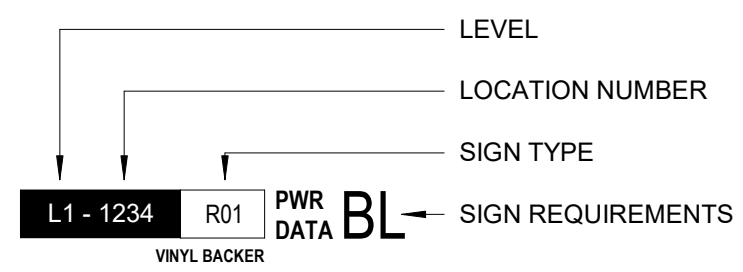

KEY PLAN

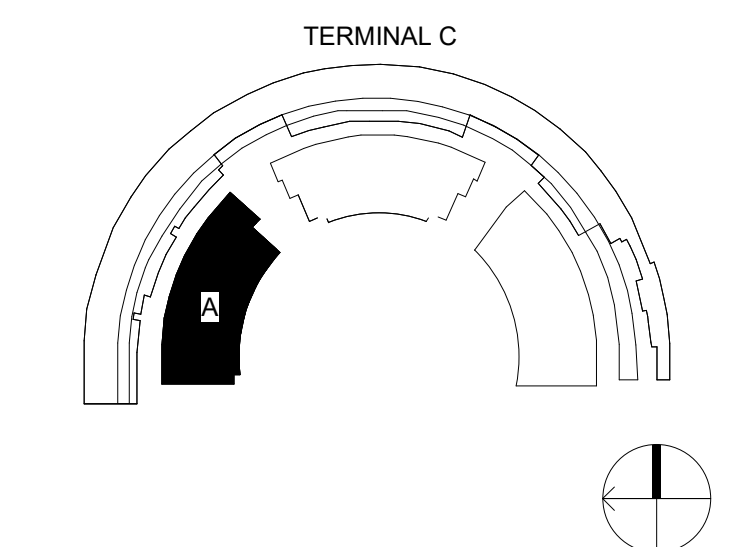

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

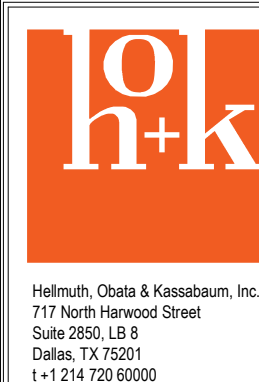

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NO.	DATE	DESCRIPTION
3	2022-08-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

NOT FOR BID OR CONSTRUCTION

**DFW TERMINAL C GARAGE AND ROADWAYS
GARAGE A COLUMN SIGN SCHEDULE**


PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER

AG610-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

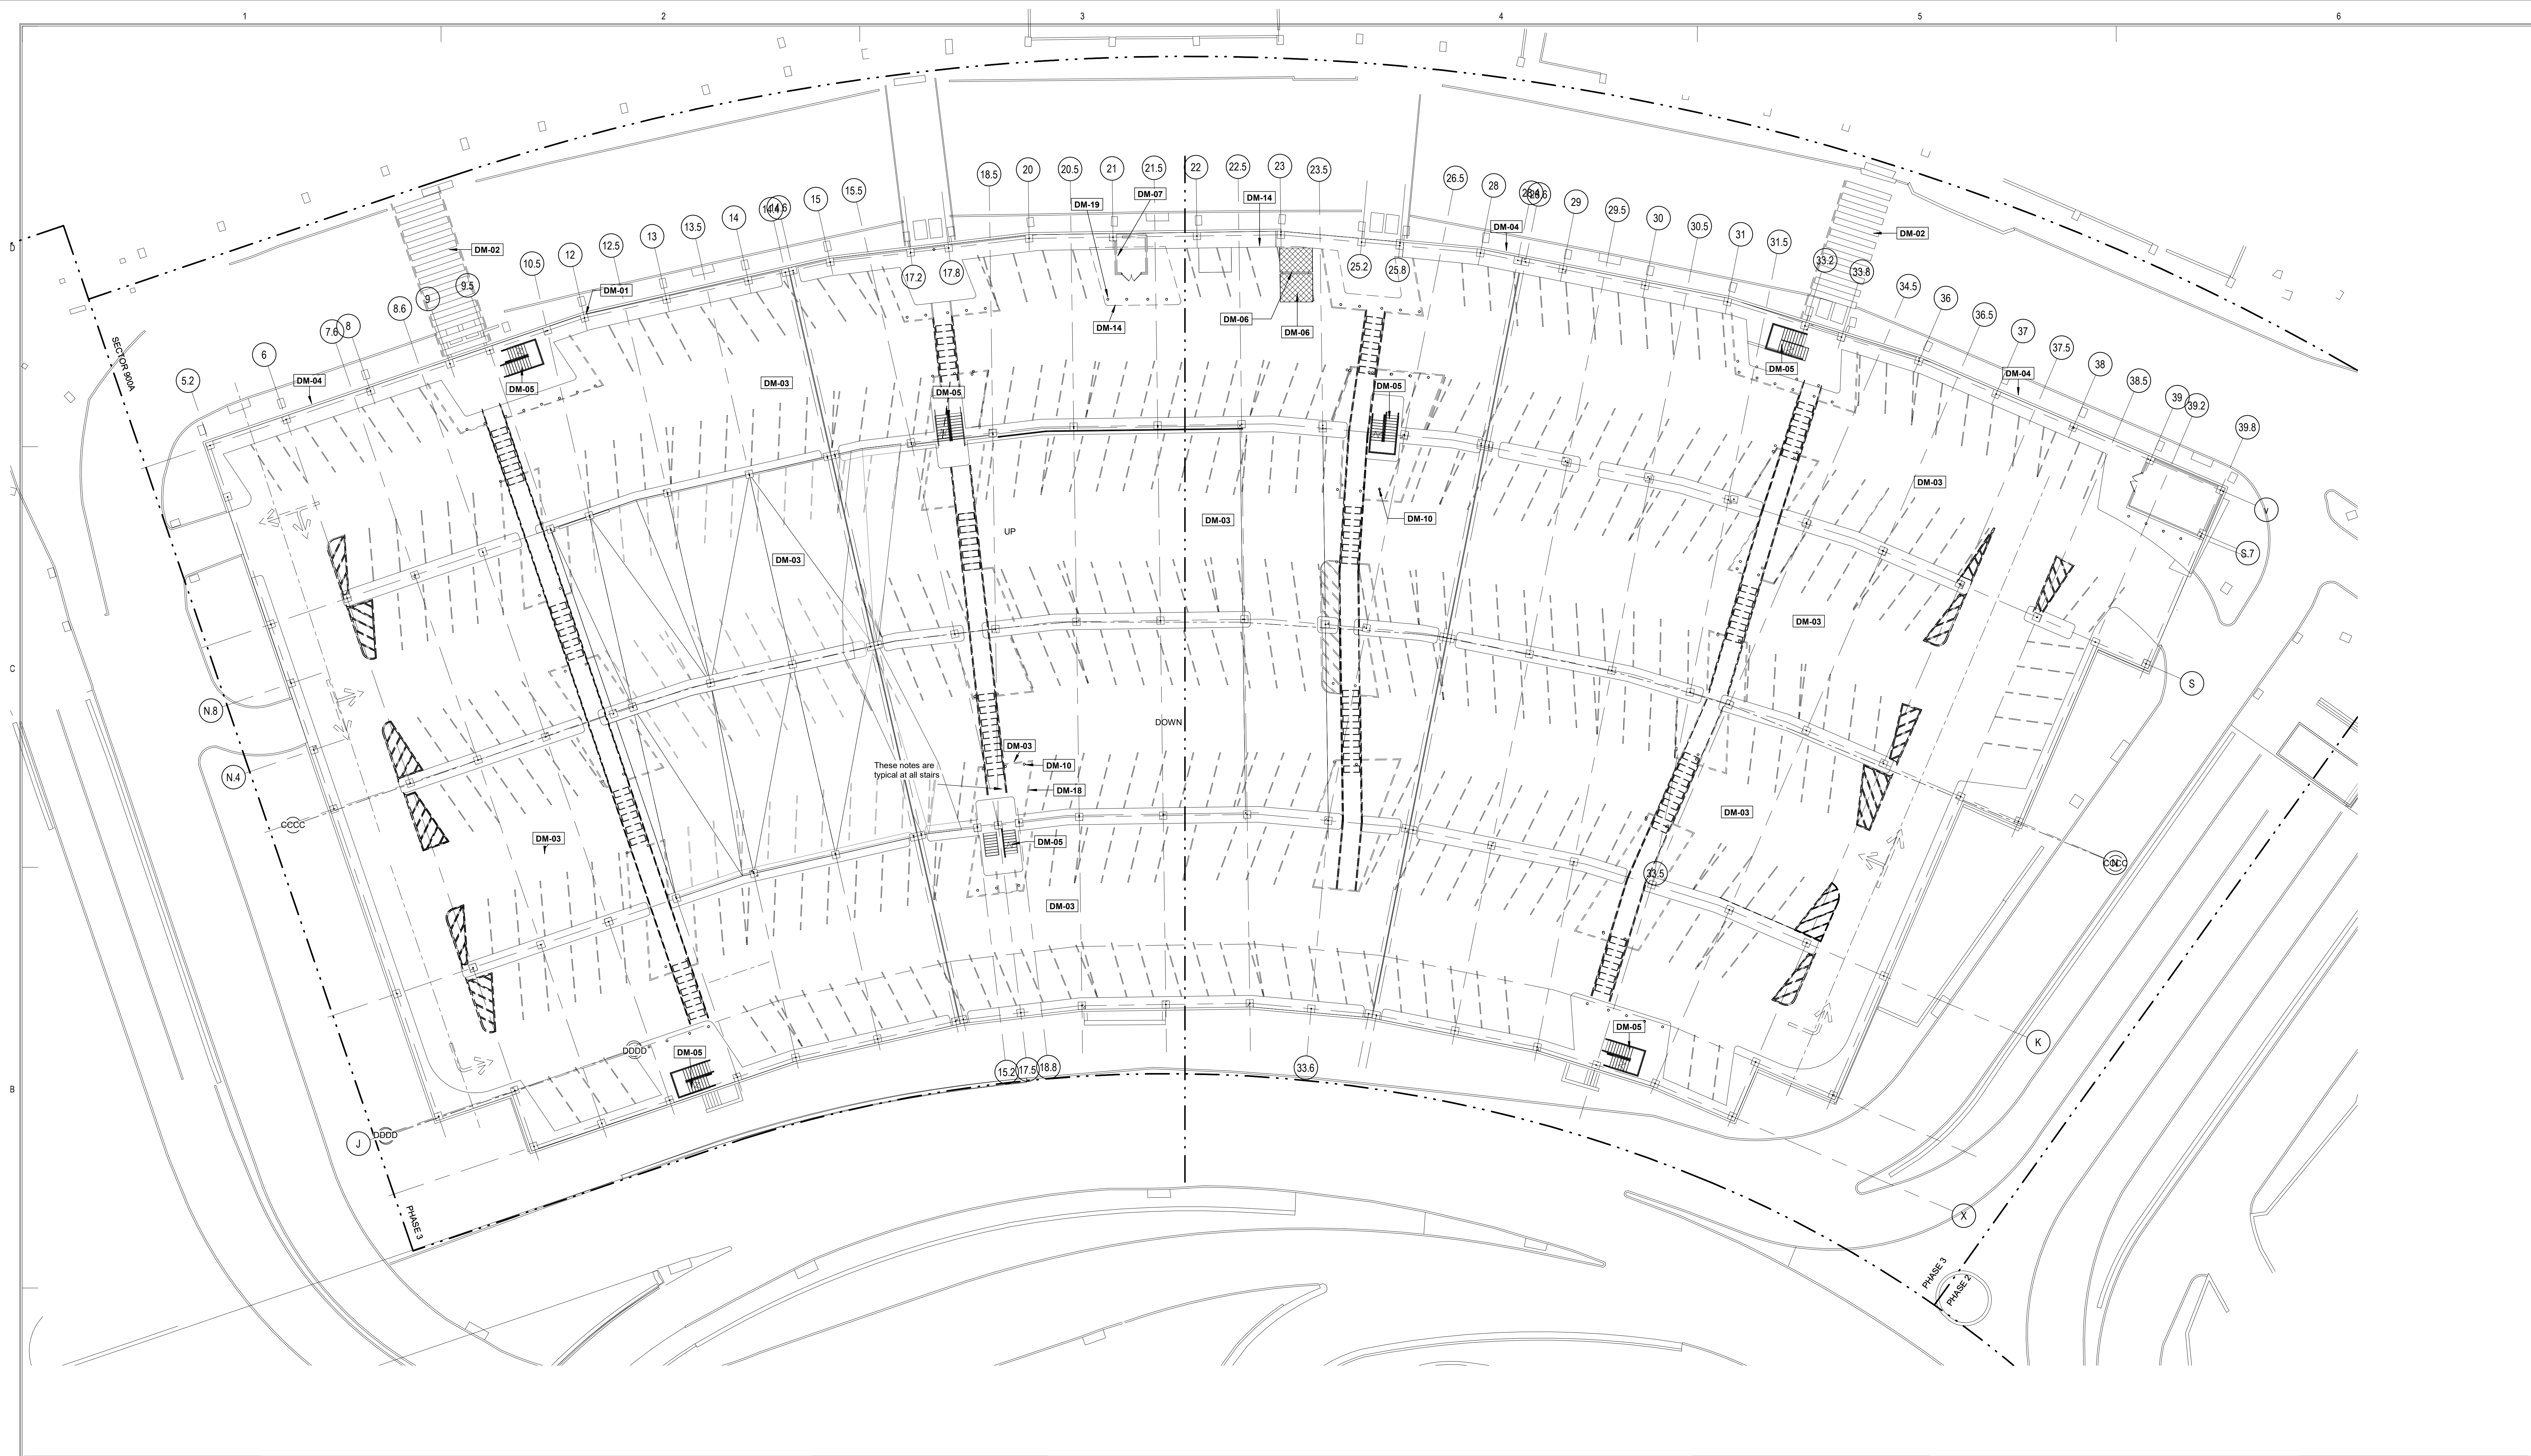


GENERAL NOTE

1. REMOVE ALL EXISTING SIGNAGE THROUGHOUT THE GARAGE ON ALL LEVELS. PATCH AND REPAIR WALLS AS NECESSARY TO MATCH ADJACENT AND ACCEPT NEW FINISHES. REFERENCE SIGNAGE SHEETS.
2. REMOVE EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS. REFER TO ELECTRICAL.
3. SANDBLAST ALL METAL AT STAIRS INCLUDING RAILINGS AND REPAIR.
4. CLEAN OUT ALL EXPANSION JOINTS. REMOVE GASKETING AND PREP FOR NEW EXPANSION MATERIAL. REFERENCE SPECIFICATIONS SECTION 07 90 00 07 95 00.
5. COORDINATE WITH CIVIL ON ROADWAY REMOVAL.
6. SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT STRIPING THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
7. PRESSURE WASH SPANDREL WALLS, COLUMNS AND CEILINGS IN THE GARAGES.
8. ALL STRUCTURAL REINFORCING AND POST-TENSION TENDONS MUST BE IDENTIFIED PRIOR TO CUTTING OF SLAB. CUT OPENING IN SLAB TO ALLOW FOR THE INSTALL OF THE NEW ELEVATOR BANK. CONTRACTOR TO ENSURE NO DAMAGE TO ANY EXISTING REINFORCING OR PT IS DONE. IF DAMAGED, THE CLIENT SHALL BE NOTIFIED IMMEDIATELY. REFERENCE STRUCTURAL DRAWINGS FOR INFORMATION REGARDING THE CUTTING OF THE SLAB.
9. REMOVE EXISTING GARAGE LIGHTING FIXTURE AND EXIT SIGNS. REFER TO ELECTRICAL.
10. REMOVE EXISTING FIRE HOSE CABINETS. REFER TO FIRE PROTECTION.
11. REFER TO CIVIL DRAWINGS FOR INFORMATION ON ROADWAY DEMO WORK.
12. ROOF DRAINS TO BE COMPLETELY CLEANED AND EVALUATED IF REPLACEMENT IS NECESSARY AND INSTALL NEW ROOF INLETS OR DOWNSPOUTS AS NECESSARY.
13. BARRIERS TO BE INSTALLED THROUGHOUT DEMOLITION AND CONSTRUCTION TO PREVENT DUST-COVERING OF ADJACENT ROADWAYS.


SHEET NOTE : DEMOLITION NOTES

Key Value	Keynote Text
DM-01	ROADWAY COLUMNS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION. TYP.
DM-02	SANDBLAST TO REMOVE EXISTING CROSSWALK STRIPING.
DM-03	SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT AND STRIPING TAPE THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
DM-04	PRESSURE WASH SPANDREL WALLS AND CEILINGS IN THE THROUGHOUT.
DM-05	SANDBLAST EXISTING STAIRS AND STAIR STRUCTURE TO REMOVE EXISTING PAINT AND RUST. REMOVE CONCRETE TREAD AND/OR NOSING AS NOTED PER LOCATION. REFER TO ENLARGED STAIR PLANS.
DM-06	EXISTING SLAB TO BE REMOVED TO EXTENT SHOWN FOR NEW ELEVATOR. REFERENCE STRUCTURAL DRAWINGS FOR MORE INFORMATION.
DM-07	REMOVE CMU ENCLOSURE AND ALL ASSOCIATED HARDWARE AND EQUIPMENT.
DM-10	EXISTING BOLLARDS TO REMAIN THIS AREA. SANDBLAST TO REMOVE PAINT. PREP TO RECEIVE NEW FINISH.
DM-14	REPAIR ANY DAMAGE TO PEDESTRIAN BRIDGE FROM WATER INFILTRATION.
DM-18	
DM-19	REMOVE CURB AND RAISED SURFACE TO EXTENT SHOWN FOR NEW ELEVATOR AND VESTIBULE.


LEGEND

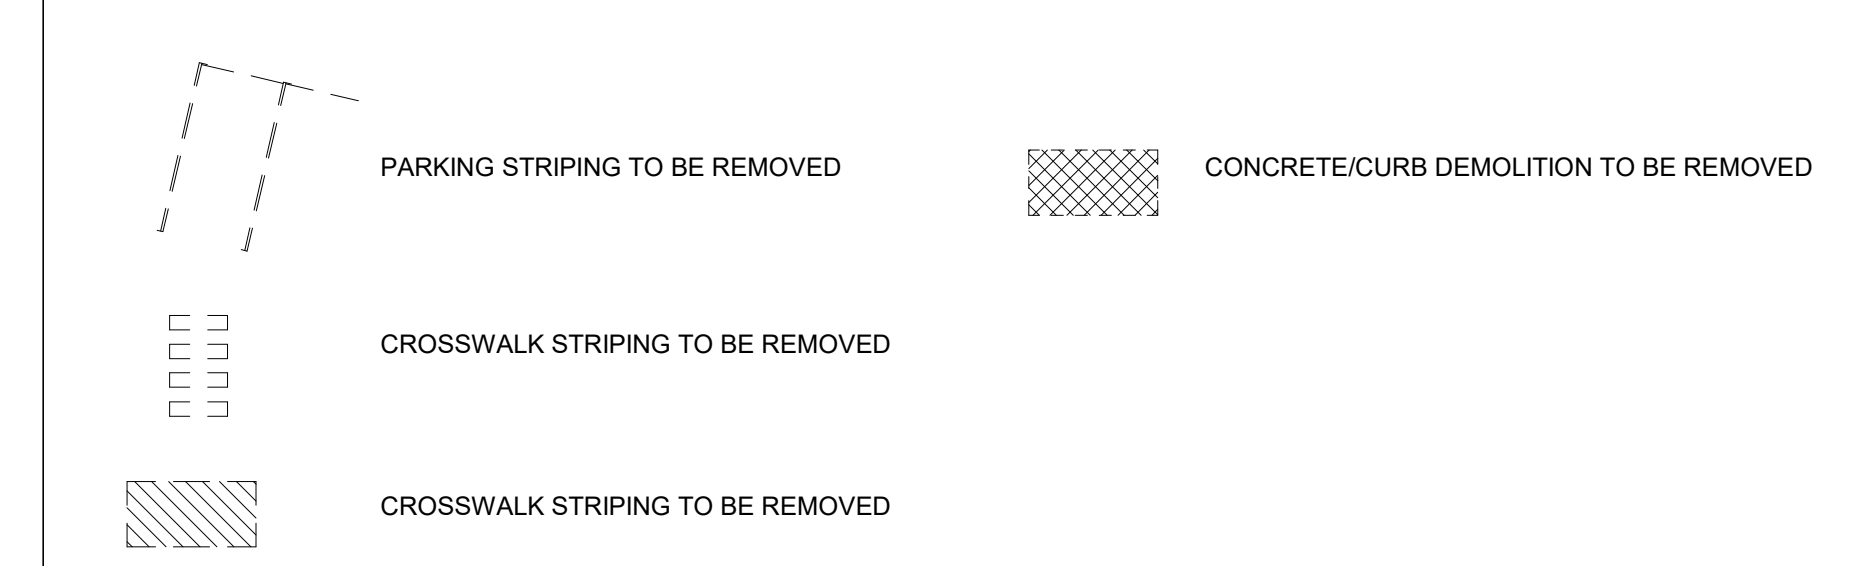

KEY PLAN

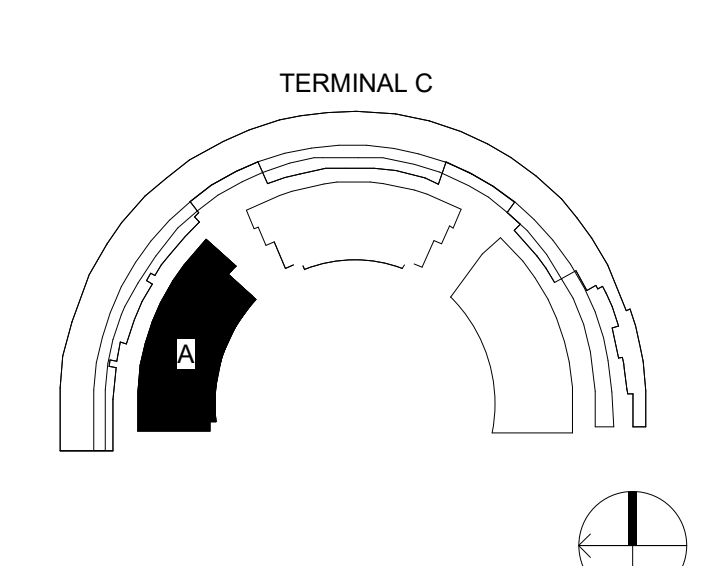

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

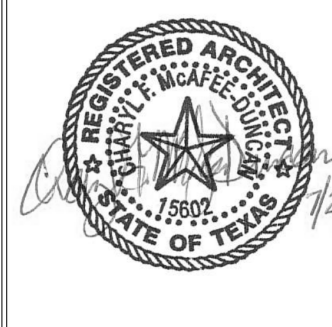

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2021-08-05	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
GARAGE A DEMO PLAN - LEVEL A

SHEET NUMBER
AD101-900A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

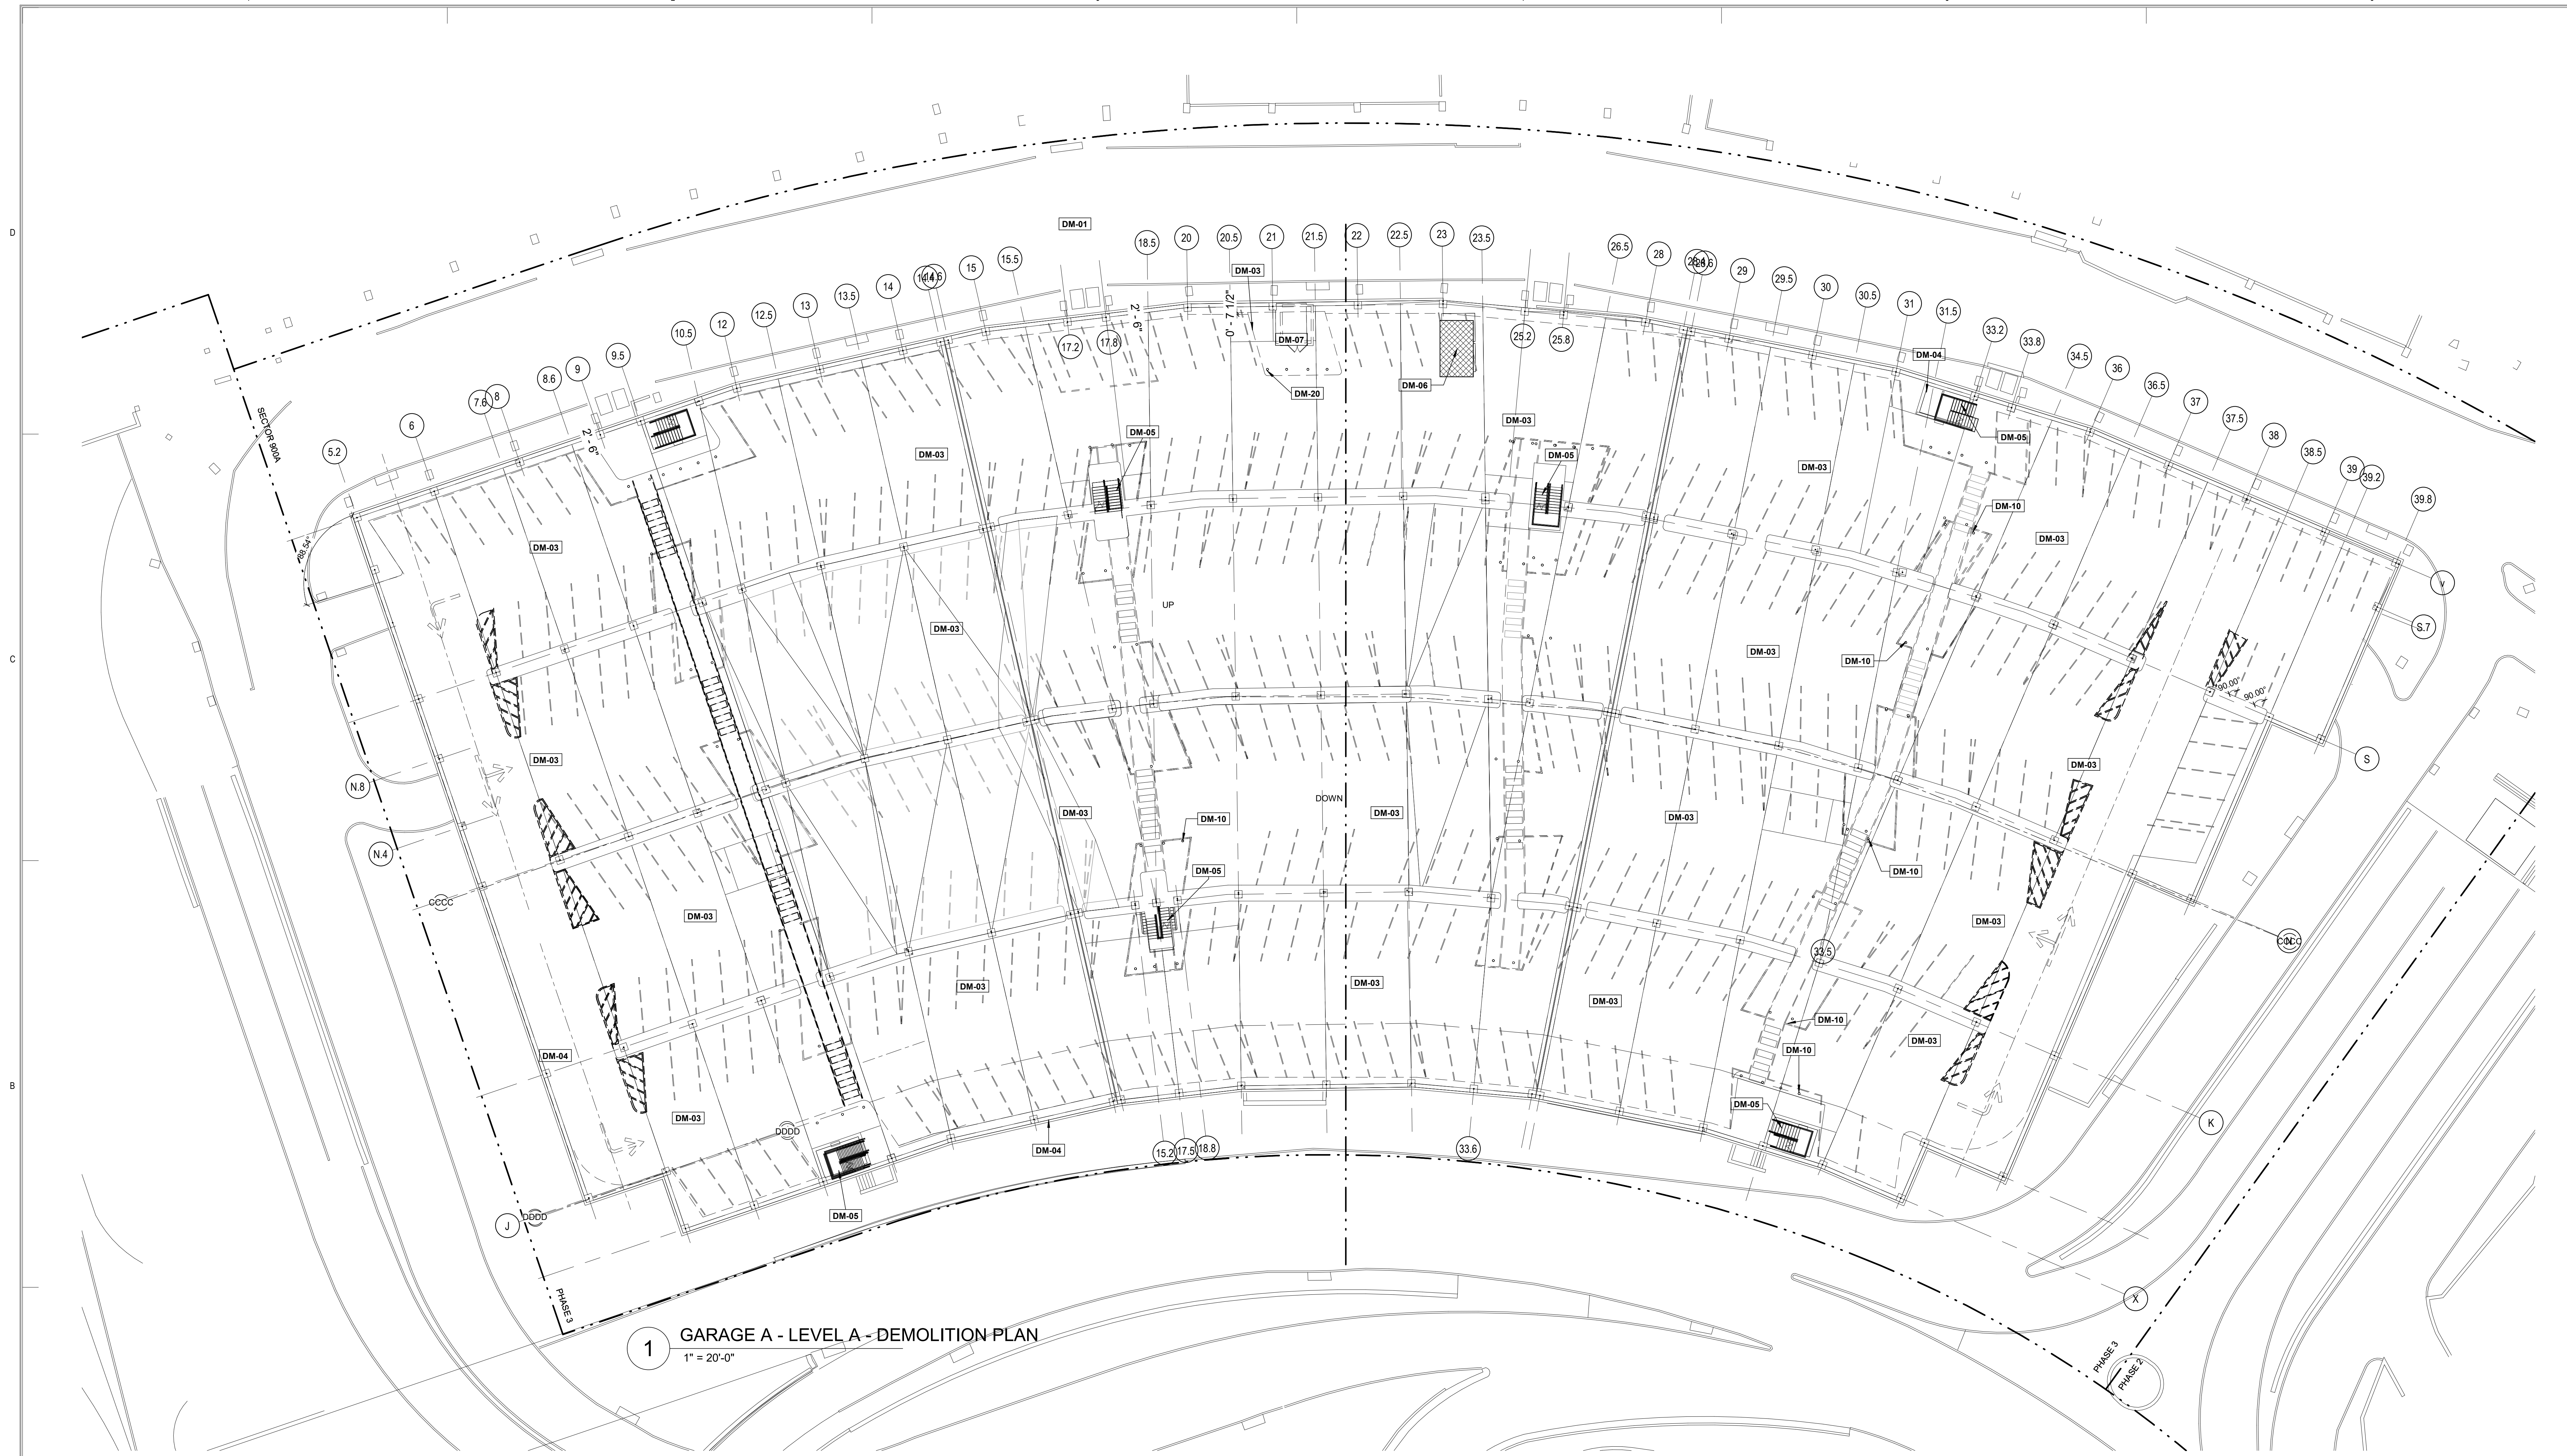

1 GARAGE A - LEVEL A - DEMOLITION PLAN
1" = 20'-0"


GENERAL NOTE

1. REMOVE ALL EXISTING SIGNAGE THROUGHOUT THE GARAGE ON ALL LEVELS. PATCH AND REPAIR WALLS AS NECESSARY TO MATCH ADJACENT AND ACCEPT NEW FINISHES. REFERENCE SIGNAGE SHEETS.
2. REMOVE EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS. REFER TO ELECTRICAL.
3. SANDBLAST ALL METAL AT STAIRS INCLUDING RAILINGS AND REPAIR.
4. CLEAN OUT ALL EXPANSION JOINTS. REMOVE GASKETING AND PREP FOR NEW EXPANSION MATERIAL. REFERENCE SPECIFICATIONS SECTION 07 90 00/ 07 95 00.
5. COORDINATE WITH CIVIL ON ROADWAY REMOVAL.
6. SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT STRIPING THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
7. PRESSURE WASH SPANDREL WALLS, COLUMNS AND CEILINGS IN THE GARAGES.
8. ALL STRUCTURAL REINFORCING AND POST-TENSION TENDONS MUST BE IDENTIFIED PRIOR TO CUTTING OF SLAB. CUT OPENING IN SLAB TO ALLOW FOR THE INSTALL OF THE NEW ELEVATOR BANK. CONTRACTOR TO ENSURE NO DAMAGE TO ANY EXISTING REINFORCING OR PT IS DONE. IF DAMAGED, THE CLIENT SHALL BE NOTIFIED IMMEDIATELY. REFERENCE STRUCTURAL DRAWINGS FOR INFORMATION REGARDING THE CUTTING OF THE SLAB.
9. REMOVE EXISTING GARAGE LIGHTING FIXTURE AND EXIT SIGNS. REFER TO ELECTRICAL.
10. REMOVE EXISTING FIRE HOSE CABINETS. REFER TO FIRE PROTECTION.
11. REFER TO CIVIL DRAWINGS FOR INFORMATION ON ROADWAY DEMO WORK.
12. ROOF DRAINS TO BE COMPLETELY CLEANED AND EVALUATED IF REPLACEMENT IS NECESSARY AND INSTALL NEW ROOF INLETS OR DOWNSPOUTS AS NECESSARY.
13. BARRIERS TO BE INSTALLED THROUGHOUT DEMOLITION AND CONSTRUCTION TO PREVENT DUST-COVERING OF ADJACENT ROADWAYS.


SHEET NOTE : DEMOLITION NOTES

Key Value	Keynote Text
DM-01	ROADWAY COLUMNS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION. TYP.
DM-03	SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT AND STRIPING TAPE THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
DM-04	PRESSURE WASH SPANDREL WALLS AND CEILINGS IN THE THROUGHOUT.
DM-05	SANDBLAST EXISTING STAIRS AND STAIR STRUCTURE TO REMOVE EXISTING PAINT AND RUST. REMOVE CONCRETE TREAD AND/OR NOSING AS NOTED PER LOCATION REFER TO ENLARGED STAIR PLANS.
DM-06	EXISTING SLAB TO BE REMOVED TO EXTENT SHOWN FOR NEW ELEVATOR. REFERENCE STRUCTURAL DRAWINGS FOR MORE INFORMATION.
DM-07	REMOVE CMU ENCLOSURE AND ALL ASSOCIATED HARDWARE AND EQUIPMENT.
DM-10	EXISTING BOLLARDS TO REMAIN THIS AREA. SANDBLAST TO REMOVE PAINT. PREP TO RECEIVE NEW FINISH.
DM-12	REMOVE EXISTING FIRE HOSE CABINETS THROUGHOUT. REFER TO FIRE PROTECTION PLANS FOR MORE INFORMATION.
DM-20	REMOVE BOLLARDS DOWN TO LEVEL SURFACE.

LEGEND

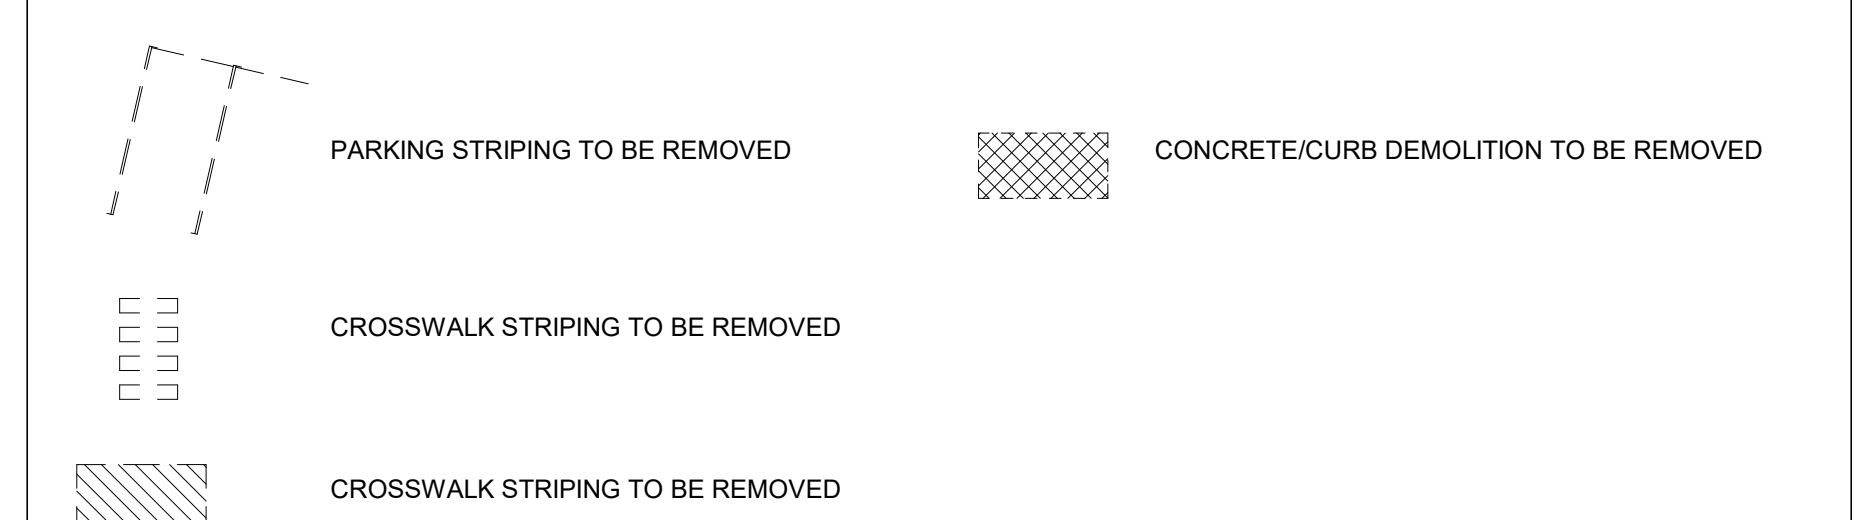

KEY PLAN

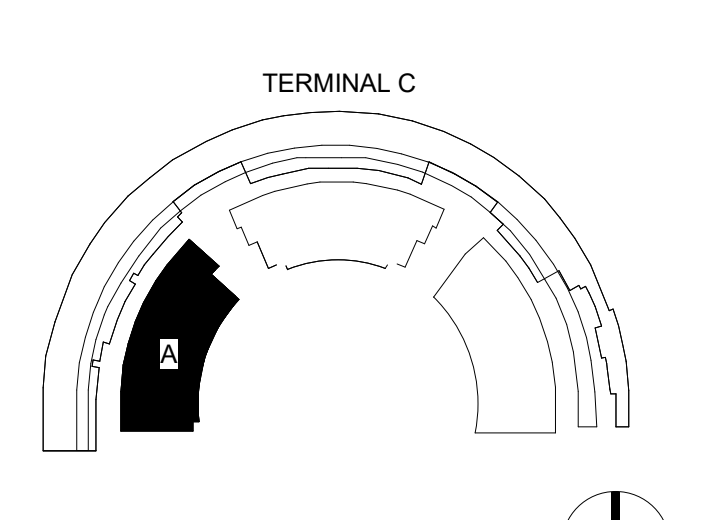

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



McAfee³
ARCHITECTURE+DESIGN

McAfee Architecture, Inc.
171 North Rowland Street
Suite 200, LB #1
Dallas, TX 75201
1-469-600-6644

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NO.	DATE	DESCRIPTION
2021-10-05	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

NOT FOR BID OR CONSTRUCTION


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
GARAGE A DEMO PLAN - LEVEL B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AD102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

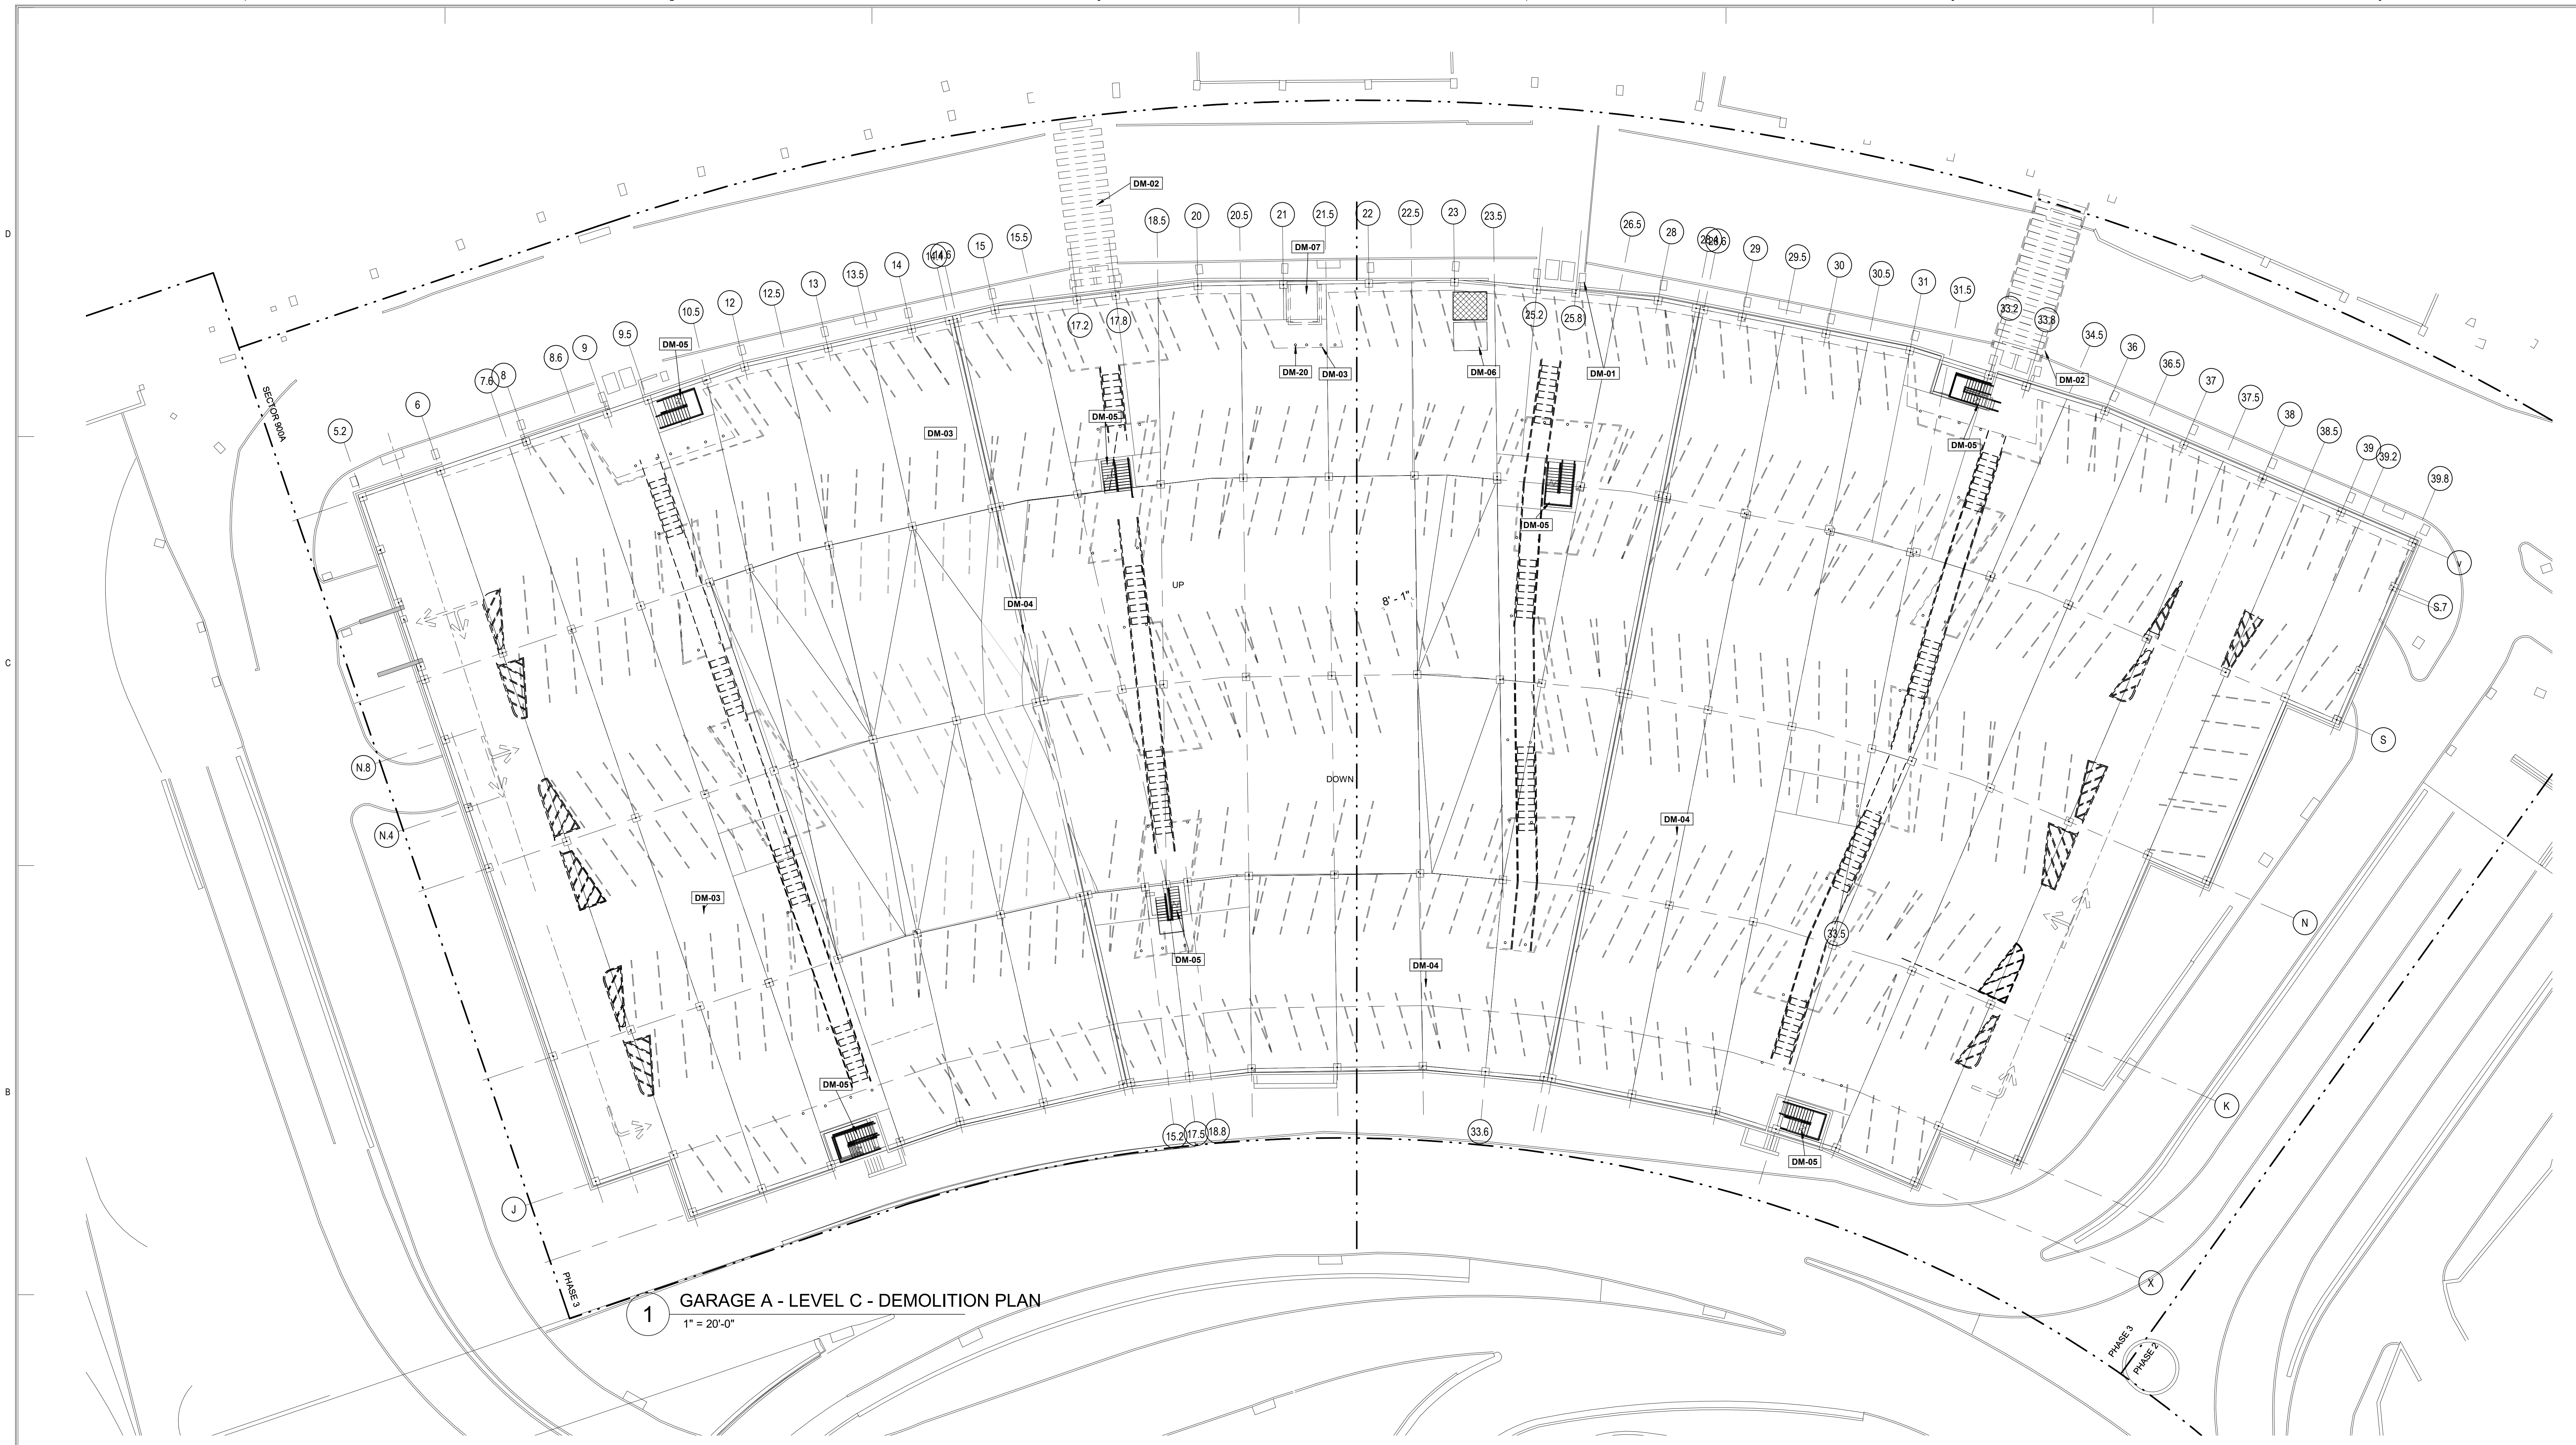



1 GARAGE A - LEVEL C - DEMOLITION PLAN
1" = 20'-0"

GENERAL NOTE


- REMOVE ALL EXISTING SIGNAGE THROUGHOUT THE GARAGE ON ALL LEVELS. PATCH AND REPAIR WALLS AS NECESSARY TO MATCH ADJACENT AND ACCEPT NEW FINISHES. REFERENCE SIGNAGE SHEETS.
- REMOVE EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS. REFER TO ELECTRICAL.
- SANDBLAST ALL METAL AT STAIRS INCLUDING RAILINGS AND REPAINT.
- CLEAN OUT ALL EXPANSION JOINTS. REMOVE GASKETING AND PREP FOR NEW EXPANSION MATERIAL. REFERENCE SPECIFICATIONS SECTION 07 90 00/ 07 95 00.
- COORDINATE WITH CIVIL ON ROADWAY REMOVAL.
- SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT STRIPING THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
- PRESSURE WASH SPANDREL WALLS, COLUMNS AND CEILINGS IN THE GARAGES.
- ALL STRUCTURAL REINFORCING AND POST-TENSION TENDONS MUST BE IDENTIFIED PRIOR TO CUTTING OF SLAB. CUT OPENING IN SLAB TO ALLOW FOR THE INSTALL OF THE NEW ELEVATOR BANK. CONTRACTOR TO ENSURE NO DAMAGE TO ANY EXISTING REINFORCING OR PT IS DONE. IF DAMAGED, THE CLIENT SHALL BE NOTIFIED IMMEDIATELY. REFERENCE STRUCTURAL DRAWINGS FOR INFORMATION REGARDING THE CUTTING OF THE SLAB.
- REMOVE EXISTING GARAGE LIGHTING FIXTURE AND EXIT SIGNS. REFER TO ELECTRICAL.
- REMOVE EXISTING FIRE HOSE CABINETS. REFER TO FIRE PROTECTION.
- REFER TO CIVIL DRAWINGS FOR INFORMATION ON ROADWAY DEMO WORK.
- ROOF DRAINS TO BE COMPLETELY CLEANED AND EVALUATED IF REPLACEMENT IS NECESSARY AND INSTALL NEW ROOF INLETS OR DOWNSPOUTS AS NECESSARY.
- BARRIERS TO BE INSTALLED THROUGHOUT DEMOLITION AND CONSTRUCTION TO PREVENT DUST-COVERING OF ADJACENT ROADWAYS.

SHEET NOTE

Key Value	Keynote Text
DM-01	ROADWAY COLUMNS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION. TYP.
DM-02	SANDBLAST TO REMOVE EXISTING CROSSWALK STRIPING.
DM-03	SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT AND STRIPING TAPE THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
DM-04	PRESSURE WASH SPANDREL WALLS AND CEILINGS IN THE THROUGHOUT.
DM-05	SANDBLAST EXISTING STAIRS AND STAIR STRUCTURE TO REMOVE EXISTING PAINT AND RUST. REMOVE CONCRETE TREAD AND/OR NOSING AS NOTED PER LOCATION REFER TO ENLARGED STAIR PLANS.
DM-06	EXISTING SLAB TO BE REMOVED TO EXTENT SHOWN FOR NEW ELEVATOR. REFERENCE STRUCTURAL DRAWINGS FOR MORE INFORMATION.
DM-07	REMOVE CMU ENCLOSURE AND ALL ASSOCIATED HARDWARE AND EQUIPMENT.
DM-20	REMOVE BOLLARDS DOWN TO LEVEL SURFACE

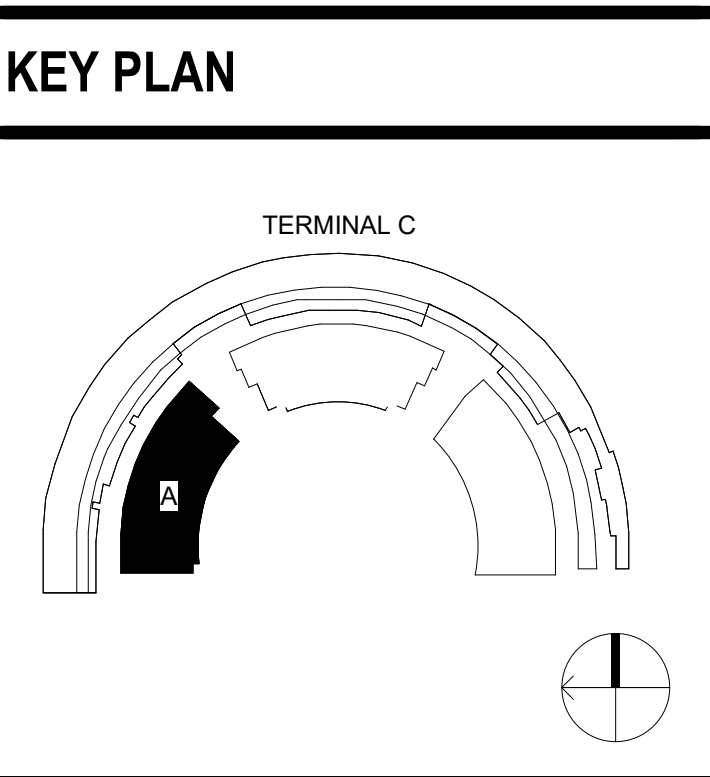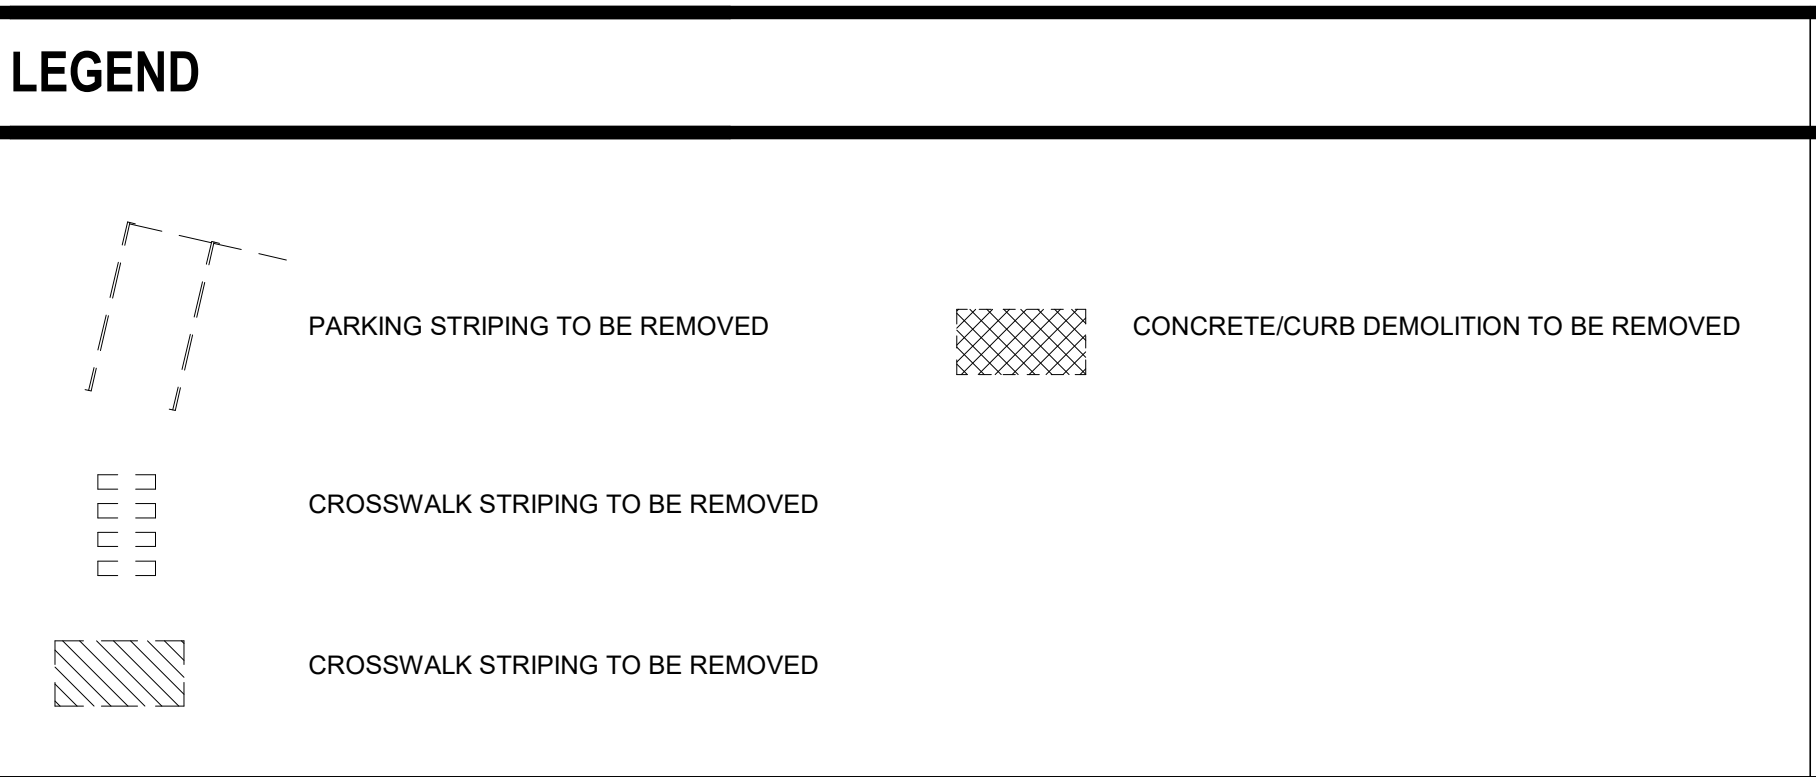

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

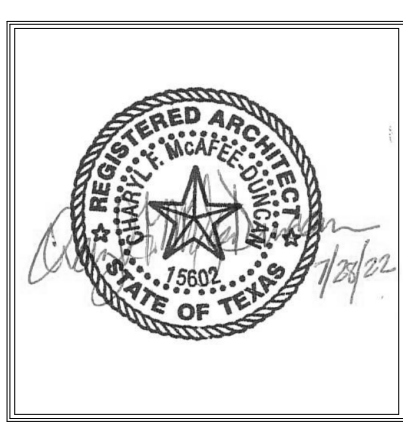

McAfee³
ARCHITECTURE+DESIGN

McAfee Architects, Inc.
1500 North Central Expressway
Suite 2100, L.B.F.
Dallas, TX 75201
1-469-920-6644

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2023-10-05	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
GARAGE A DEMO PLAN - LEVEL C

PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
AD103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

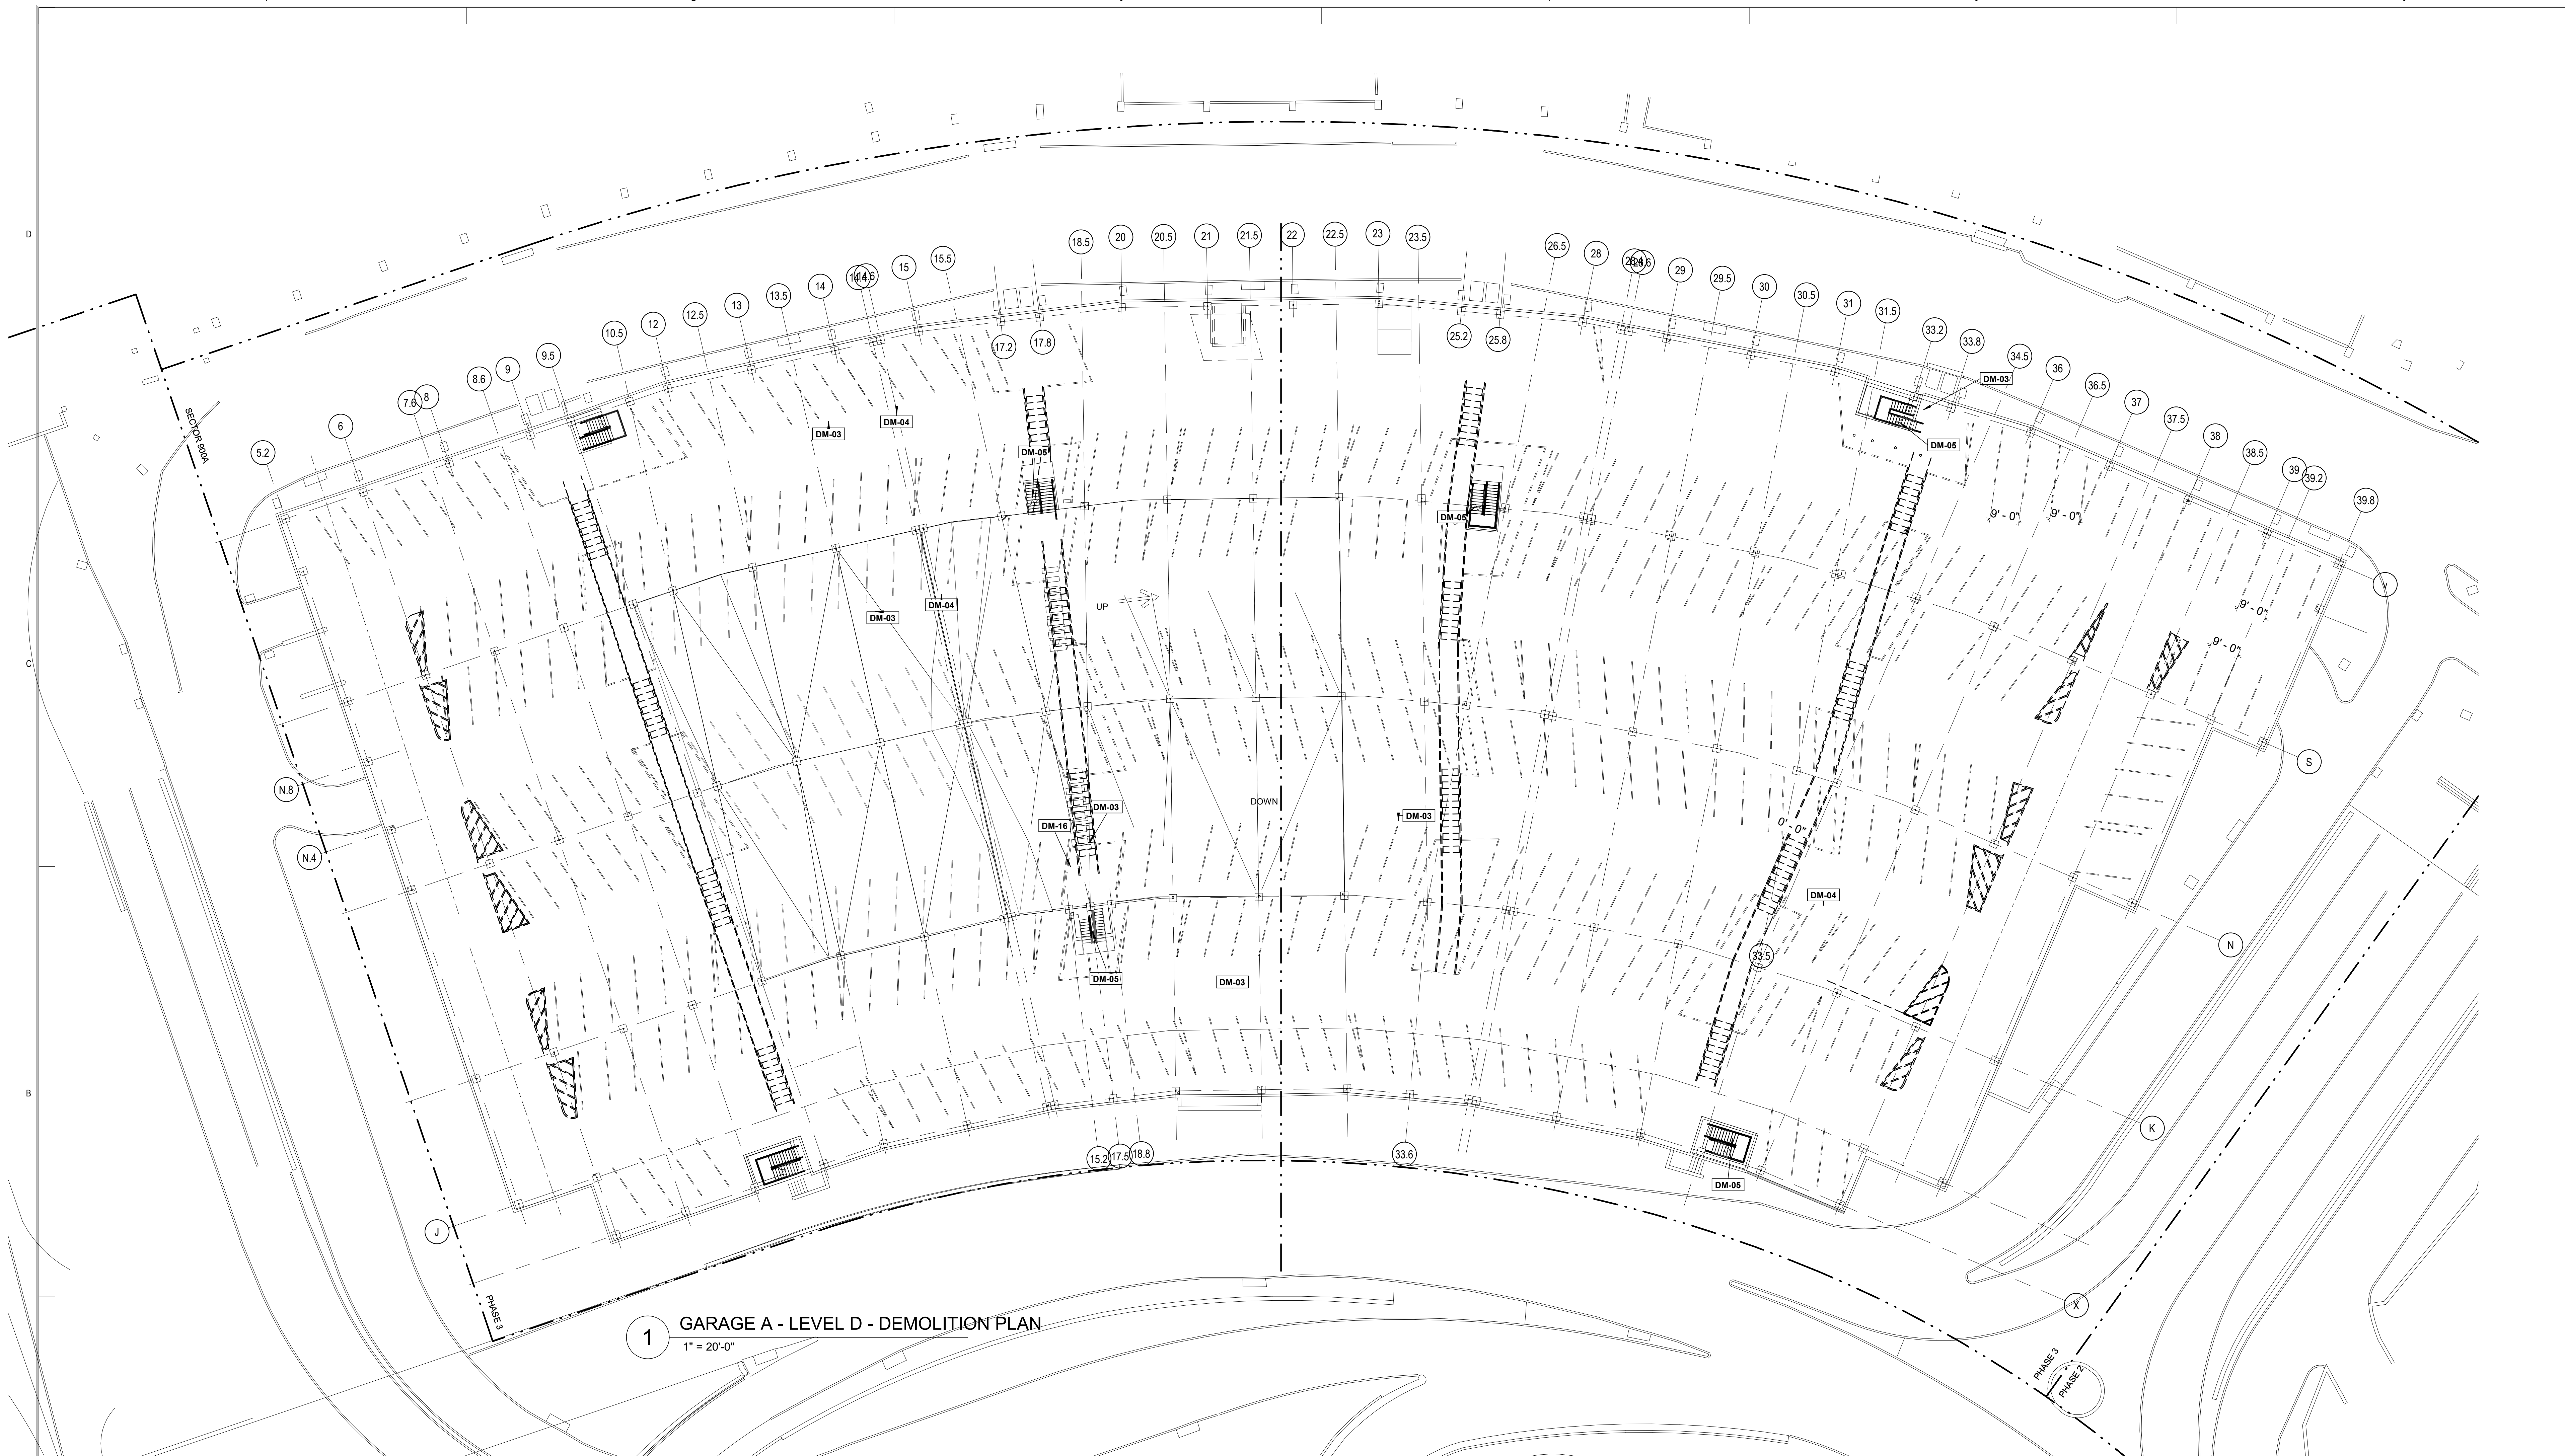

1 GARAGE A - LEVEL D - DEMOLITION PLAN
1" = 20'-0"

GENERAL NOTE

1. REMOVE ALL EXISTING SIGNAGE THROUGHOUT THE GARAGE ON ALL LEVELS. PATCH AND REPAIR WALLS AS NECESSARY TO MATCH ADJACENT AND ACCEPT NEW FINISHES. REFERENCE SIGNAGE SHEETS.
2. REMOVE EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS. REFER TO ELECTRICAL.
3. SANDBLAST ALL METAL AT STAIRS INCLUDING RAILINGS AND REPAIR.
4. CLEAN OUT ALL EXPANSION JOINTS. REMOVE GASKETING AND PREP FOR NEW EXPANSION MATERIAL. REFERENCE SPECIFICATIONS SECTION 07 90 00/ 07 95 00.
5. COORDINATE WITH CIVIL ON ROADWAY REMOVAL.
6. SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT STRIPING THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
7. PRESSURE WASH SPANDREL WALLS, COLUMNS AND CEILINGS IN THE GARAGES.
8. ALL STRUCTURAL REINFORCING AND POST-TENSION TENDONS MUST BE IDENTIFIED PRIOR TO CUTTING OF SLAB. CUT OPENING IN SLAB TO ALLOW FOR THE INSTALL OF THE NEW ELEVATOR BANK. CONTRACTOR TO ENSURE NO DAMAGE TO ANY EXISTING REINFORCING OR PT IS DONE. IF DAMAGED, THE CLIENT SHALL BE NOTIFIED IMMEDIATELY. REFERENCE STRUCTURAL DRAWINGS FOR INFORMATION REGARDING THE CUTTING OF THE SLAB.
9. REMOVE EXISTING GARAGE LIGHTING FIXTURE AND EXIT SIGNS. REFER TO ELECTRICAL.
10. REMOVE EXISTING FIRE HOSE CABINETS. REFER TO FIRE PROTECTION.
11. REFER TO CIVIL DRAWINGS FOR INFORMATION ON ROADWAY DEMO WORK.
12. ROOF DRAINS TO BE COMPLETELY CLEANED AND EVALUATED IF REPLACEMENT IS NECESSARY AND INSTALL NEW ROOF INLETS OR DOWNSPOUTS AS NECESSARY.
13. BARRIERS TO BE INSTALLED THROUGHOUT DEMOLITION AND CONSTRUCTION TO PREVENT DUST-COVERING OF ADJACENT ROADWAYS.


SHEET NOTE

Key Value	Keynote Text
DM-03	SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT AND STRIPING TAPE THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
DM-04	PRESSURE WASH SPANDREL WALLS, AND CEILINGS IN THE THROUGHOUT.
DM-05	SANDBLAST EXISTING STAIRS AND STAIR STRUCTURE TO REMOVE EXISTING PAINT AND RUST. REMOVE CONCRETE TREAD AND/OR NOSING AS NOTED PER LOCATION. REFER TO ENLARGED STAIR PLANS.
DM-16	DEMO ALL FINISHES AND CEILINGS WITHIN PEDESTRIAN BRIDGE AND PREP FOR NEW FINISHES. REFERENCE TO FINISH SCHEDULE ON SHEET AE402-900B.


LEGEND



KEY PLAN

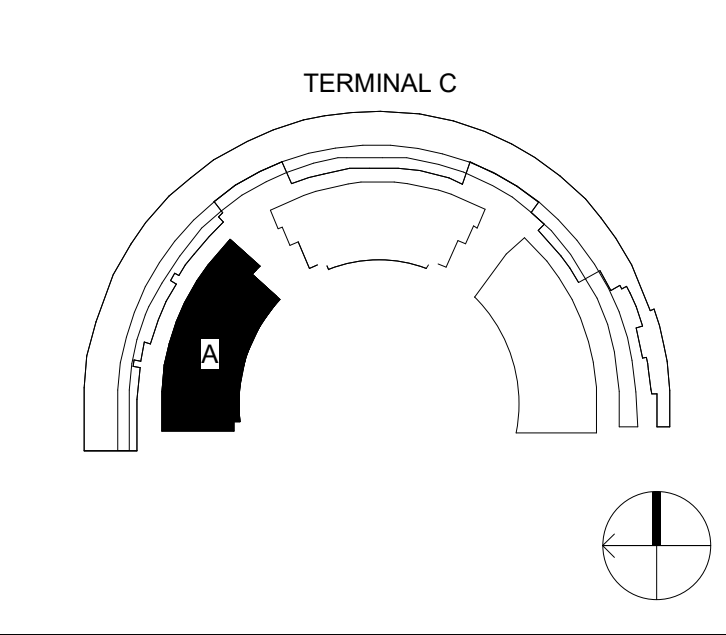

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

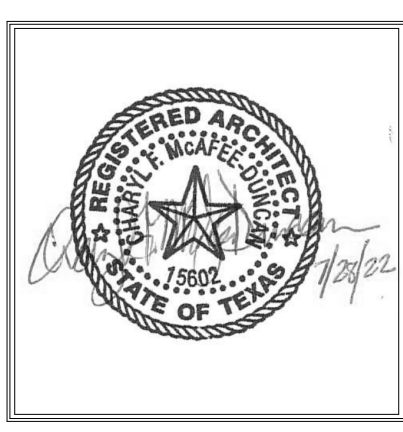

h+k McAfée³ ARCHITECTURE+DESIGN
McAfee Architects, Inc.
6000 Forest Lane
Suite 200, LBJ
Dallas, TX 75243
1-214-722-6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2023-10-05	30% DESIGN	
2022-01-09	70% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
GARAGE A DEMO PLAN - LEVEL D

PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
AD104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

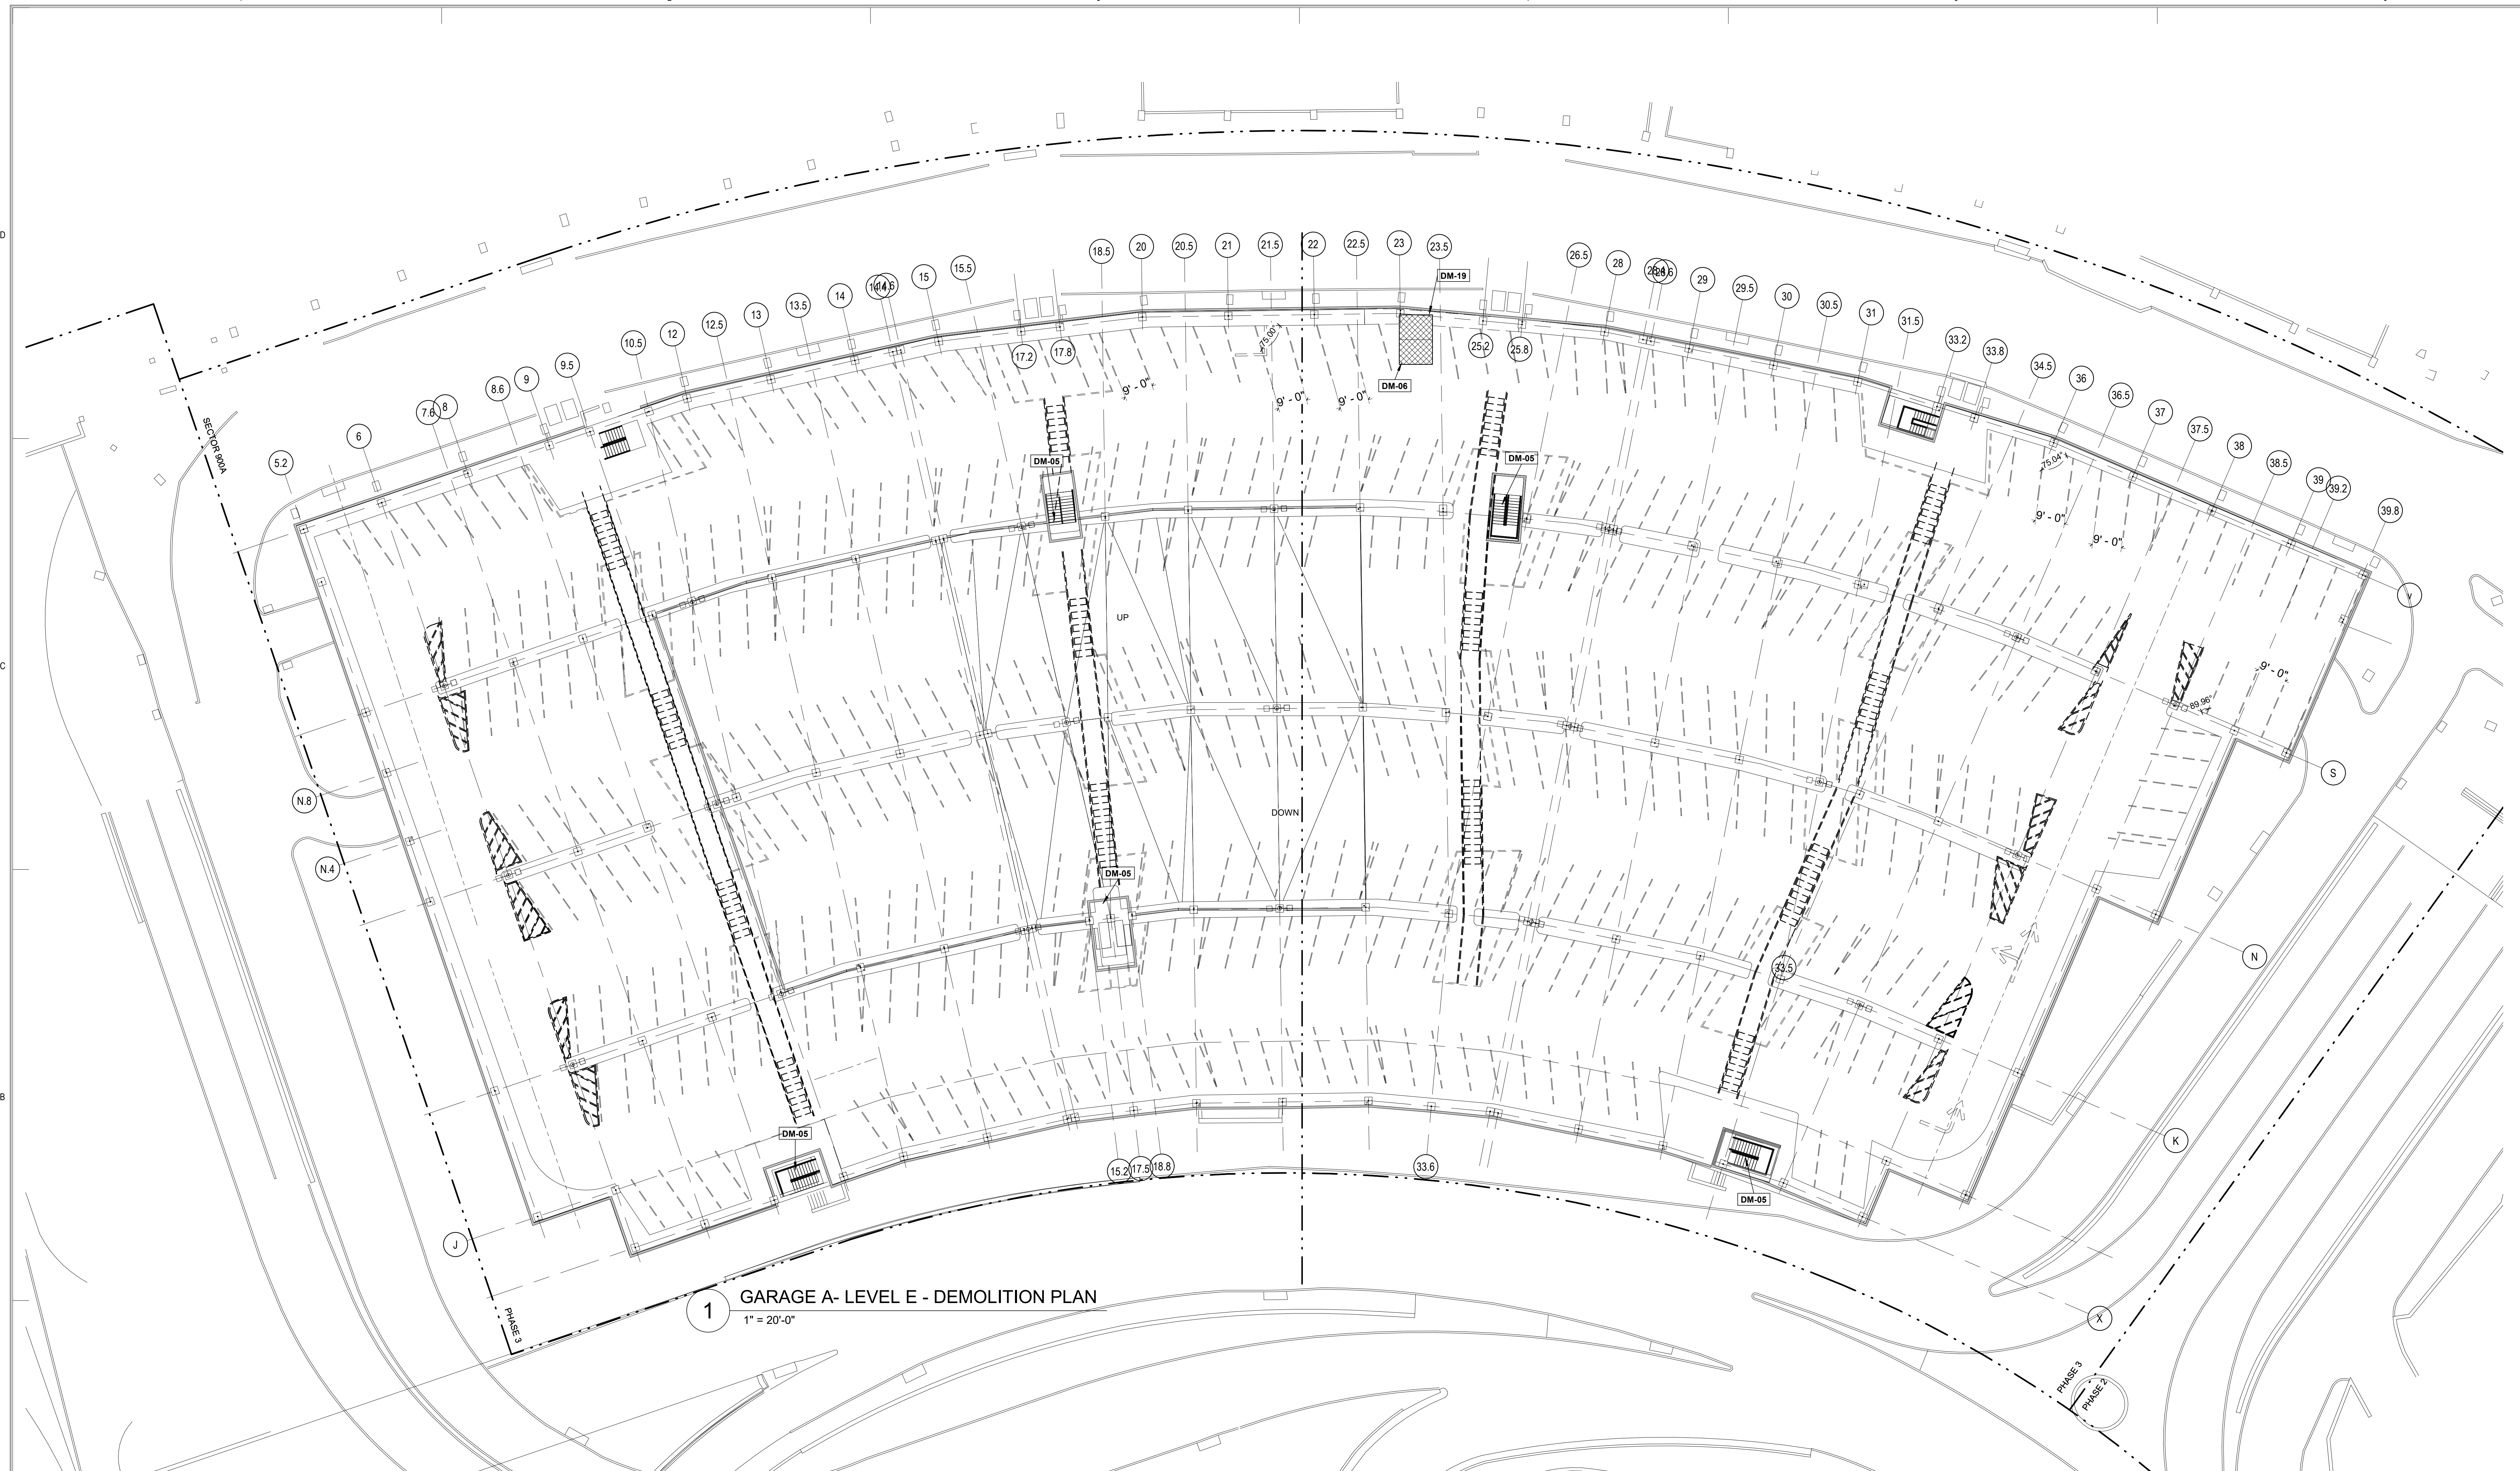



GENERAL NOTE

1. REMOVE ALL EXISTING SIGNAGE THROUGHOUT THE GARAGE ON ALL LEVELS. PATCH AND REPAIR WALLS AS NECESSARY TO MATCH ADJACENT AND ACCEPT NEW FINISHES. REFERENCE SIGNAGE SHEETS.
2. REMOVE EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS. REFER TO ELECTRICAL.
3. SANDBLAST ALL METAL AT STAIRS INCLUDING RAILINGS AND REPAIR.
4. CLEAN OUT ALL EXPANSION JOINTS. REMOVE GASKETING AND PREP FOR NEW EXPANSION MATERIAL. REFERENCE SPECIFICATIONS SECTION 07 90 00/ 07 95 00.
5. COORDINATE WITH CIVIL ON ROADWAY REMOVAL.
6. SANDBLAST THE EXISTING FLOORS AND REMOVE ALL EXISTING PAINT STRIPING THROUGHOUT THE GARAGE ON ALL LEVELS. REFERENCE PARKING PLANS FOR RE-STRIPING.
7. PRESSURE WASH SPANDREL WALLS, COLUMNS AND CEILINGS IN THE GARAGES.
8. ALL STRUCTURAL REINFORCING AND POST-TENSION TENDONS MUST BE IDENTIFIED PRIOR TO CUTTING OF SLAB. CUT OPENING IN SLAB TO ALLOW FOR THE INSTALL OF THE NEW ELEVATOR BANK. CONTRACTOR TO ENSURE NO DAMAGE TO ANY EXISTING REINFORCING OR PT IS DONE. IF DAMAGED, THE CLIENT SHALL BE NOTIFIED IMMEDIATELY. REFERENCE STRUCTURAL DRAWINGS FOR INFORMATION REGARDING THE CUTTING OF THE SLAB.
9. REMOVE EXISTING GARAGE LIGHTING FIXTURE AND EXIT SIGNS. REFER TO ELECTRICAL.
10. REMOVE EXISTING FIRE HOSE CABINETS. REFER TO FIRE PROTECTION.
11. REFER TO CIVIL DRAWINGS FOR INFORMATION ON ROADWAY DEMO WORK.
12. ROOF DRAINS TO BE COMPLETELY CLEANED AND EVALUATED IF REPLACEMENT IS NECESSARY AND INSTALL NEW ROOF INLETS OR DOWNSPOUTS AS NECESSARY.
13. BARRIERS TO BE INSTALLED THROUGHOUT DEMOLITION AND CONSTRUCTION TO PREVENT DUST-COVERING OF ADJACENT ROADWAYS.

SHEET NOTE


Key Value	Keynote Text
DM-05	SANDBLAST EXISTING STAIRS AND STAIR STRUCTURE TO REMOVE EXISTING PAINT AND RUST. REMOVE CONCRETE TREAD AND/OR NOSING AS NOTED PER LOCATION REFER TO ENLARGED STAIR PLANS.
DM-06	EXISTING SLAB TO BE REMOVED TO EXTENT SHOWN FOR NEW ELEVATOR. REFERENCE STRUCTURAL DRAWINGS FOR MORE INFORMATION.
DM-19	REMOVE CURB AND RAISED SURFACE TO EXTENT SHOWN FOR NEW ELEVATOR AND VESTIBULE.

LEGEND

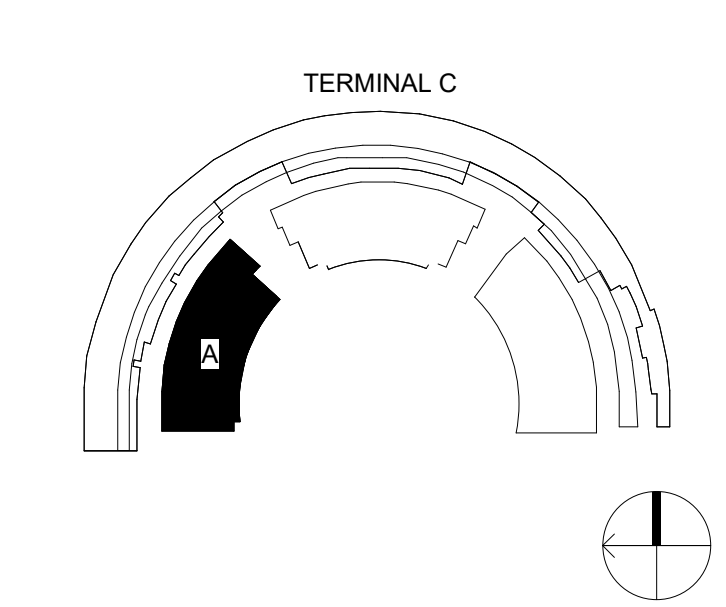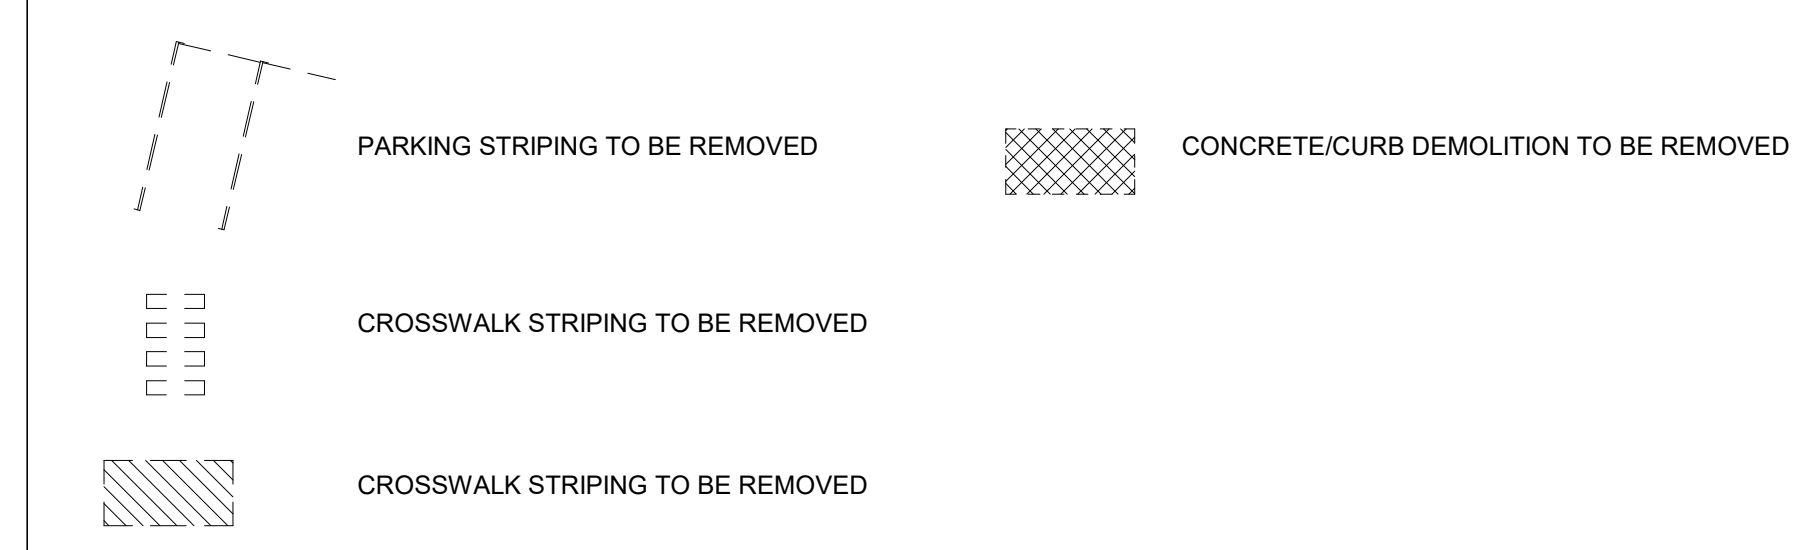

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

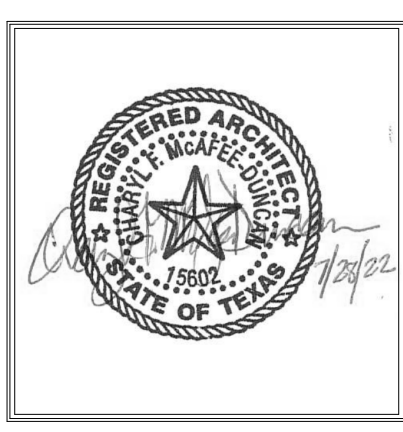

McAfee³
ARCHITECTURE+DESIGN

McAfee Architects, Inc.
777 North River Street
Suite 2000, LB #
Dallas, TX 75201
+1 214 722 6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2023-10-09	30% DESIGN	
2022-01-09	70% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
GARAGE A DEMO PLAN - LEVEL E

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
AD105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

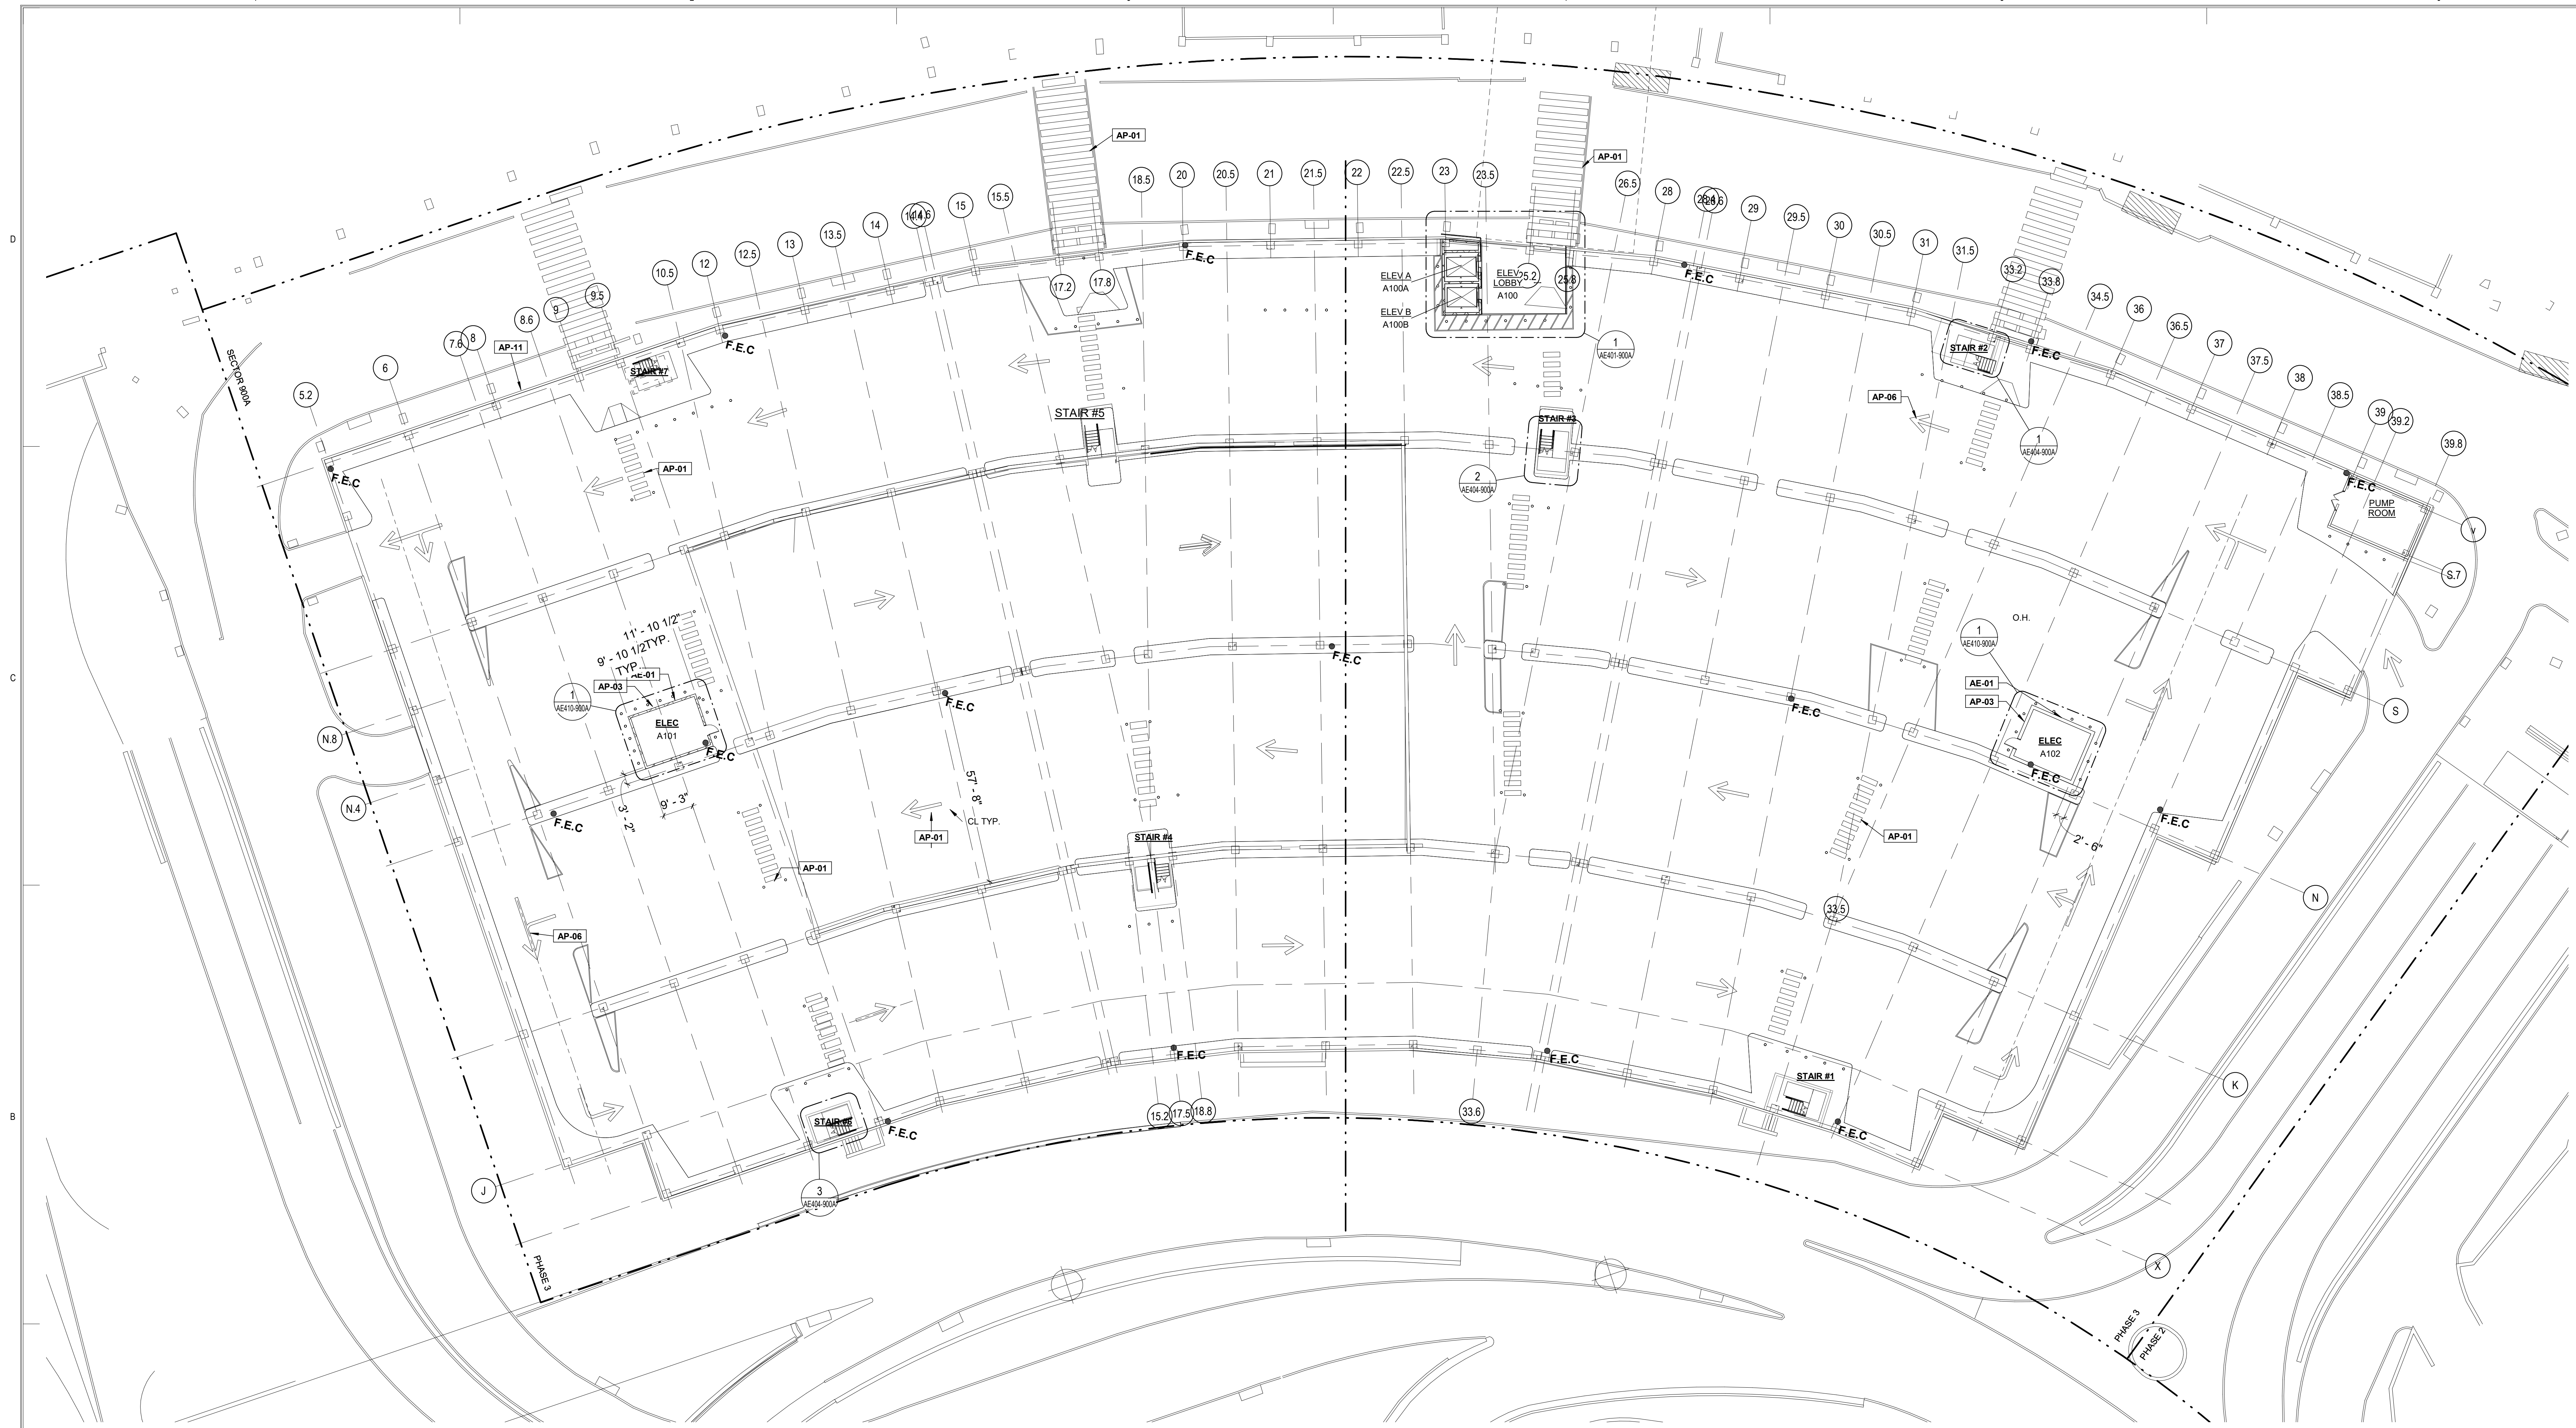

A1 FLOOR PLAN - LEVEL A - OVERALL
1" = 20'-0"

GENERAL NOTE


1. EXISTING EXPANSION JOINTS TO BE INFILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION.
2. REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION.
3. REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS, FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE.
4. REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES.
5. ALL PARKING SPACES ARE 8'-6"X18'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR, VALET, OAV ARE 9'-0"X18'-0" TYPICAL.
6. MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE.

SHEET NOTE

Key Value	Keynote Text
AE-01	NEW 8" CMU ENCLOSURE CONSTRUCTED TO UNDERSIDE OF STRUCTURE ABOVE. REFERENCE DETAILS, STRUCTURAL NOTES.
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-03	4" WIDE WHITE PAVEMENT MARKING AT 3'-0" O.C. AT 45 DEGREE ANGLE, TYP., AROUND THE ELEVATOR LOBBY AREA AND ACCESSIBLE AISLES THROUGHOUT GARAGE ON ALL LEVELS.
AP-06	CAR ACCESSIBLE PARKING SPACE WITH ADA/TAS COMPLIANT SIGNAGE.
AP-11	INSTALL CONCRETE PANEL TO MATCH EXISTING ADJACENT PANEL.

LEGEND

KEY PLAN

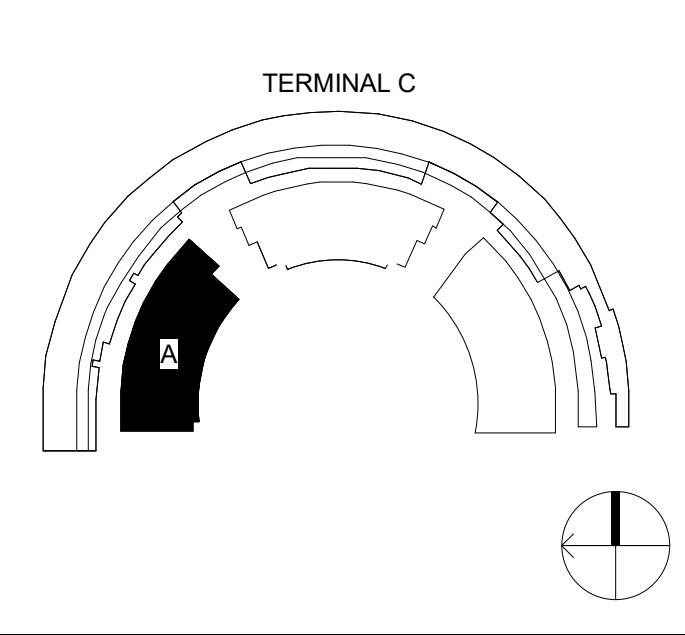

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k McAfée³ ARCHITECTURE+DESIGN
McAfée Architecture, Inc.
777 North River Street
Suite 200, LB #1
Dallas, TX 75201
1-214-722-6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
FLOOR PLAN - LEVEL A - OVERALL
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022

SHEET NUMBER
AE101-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

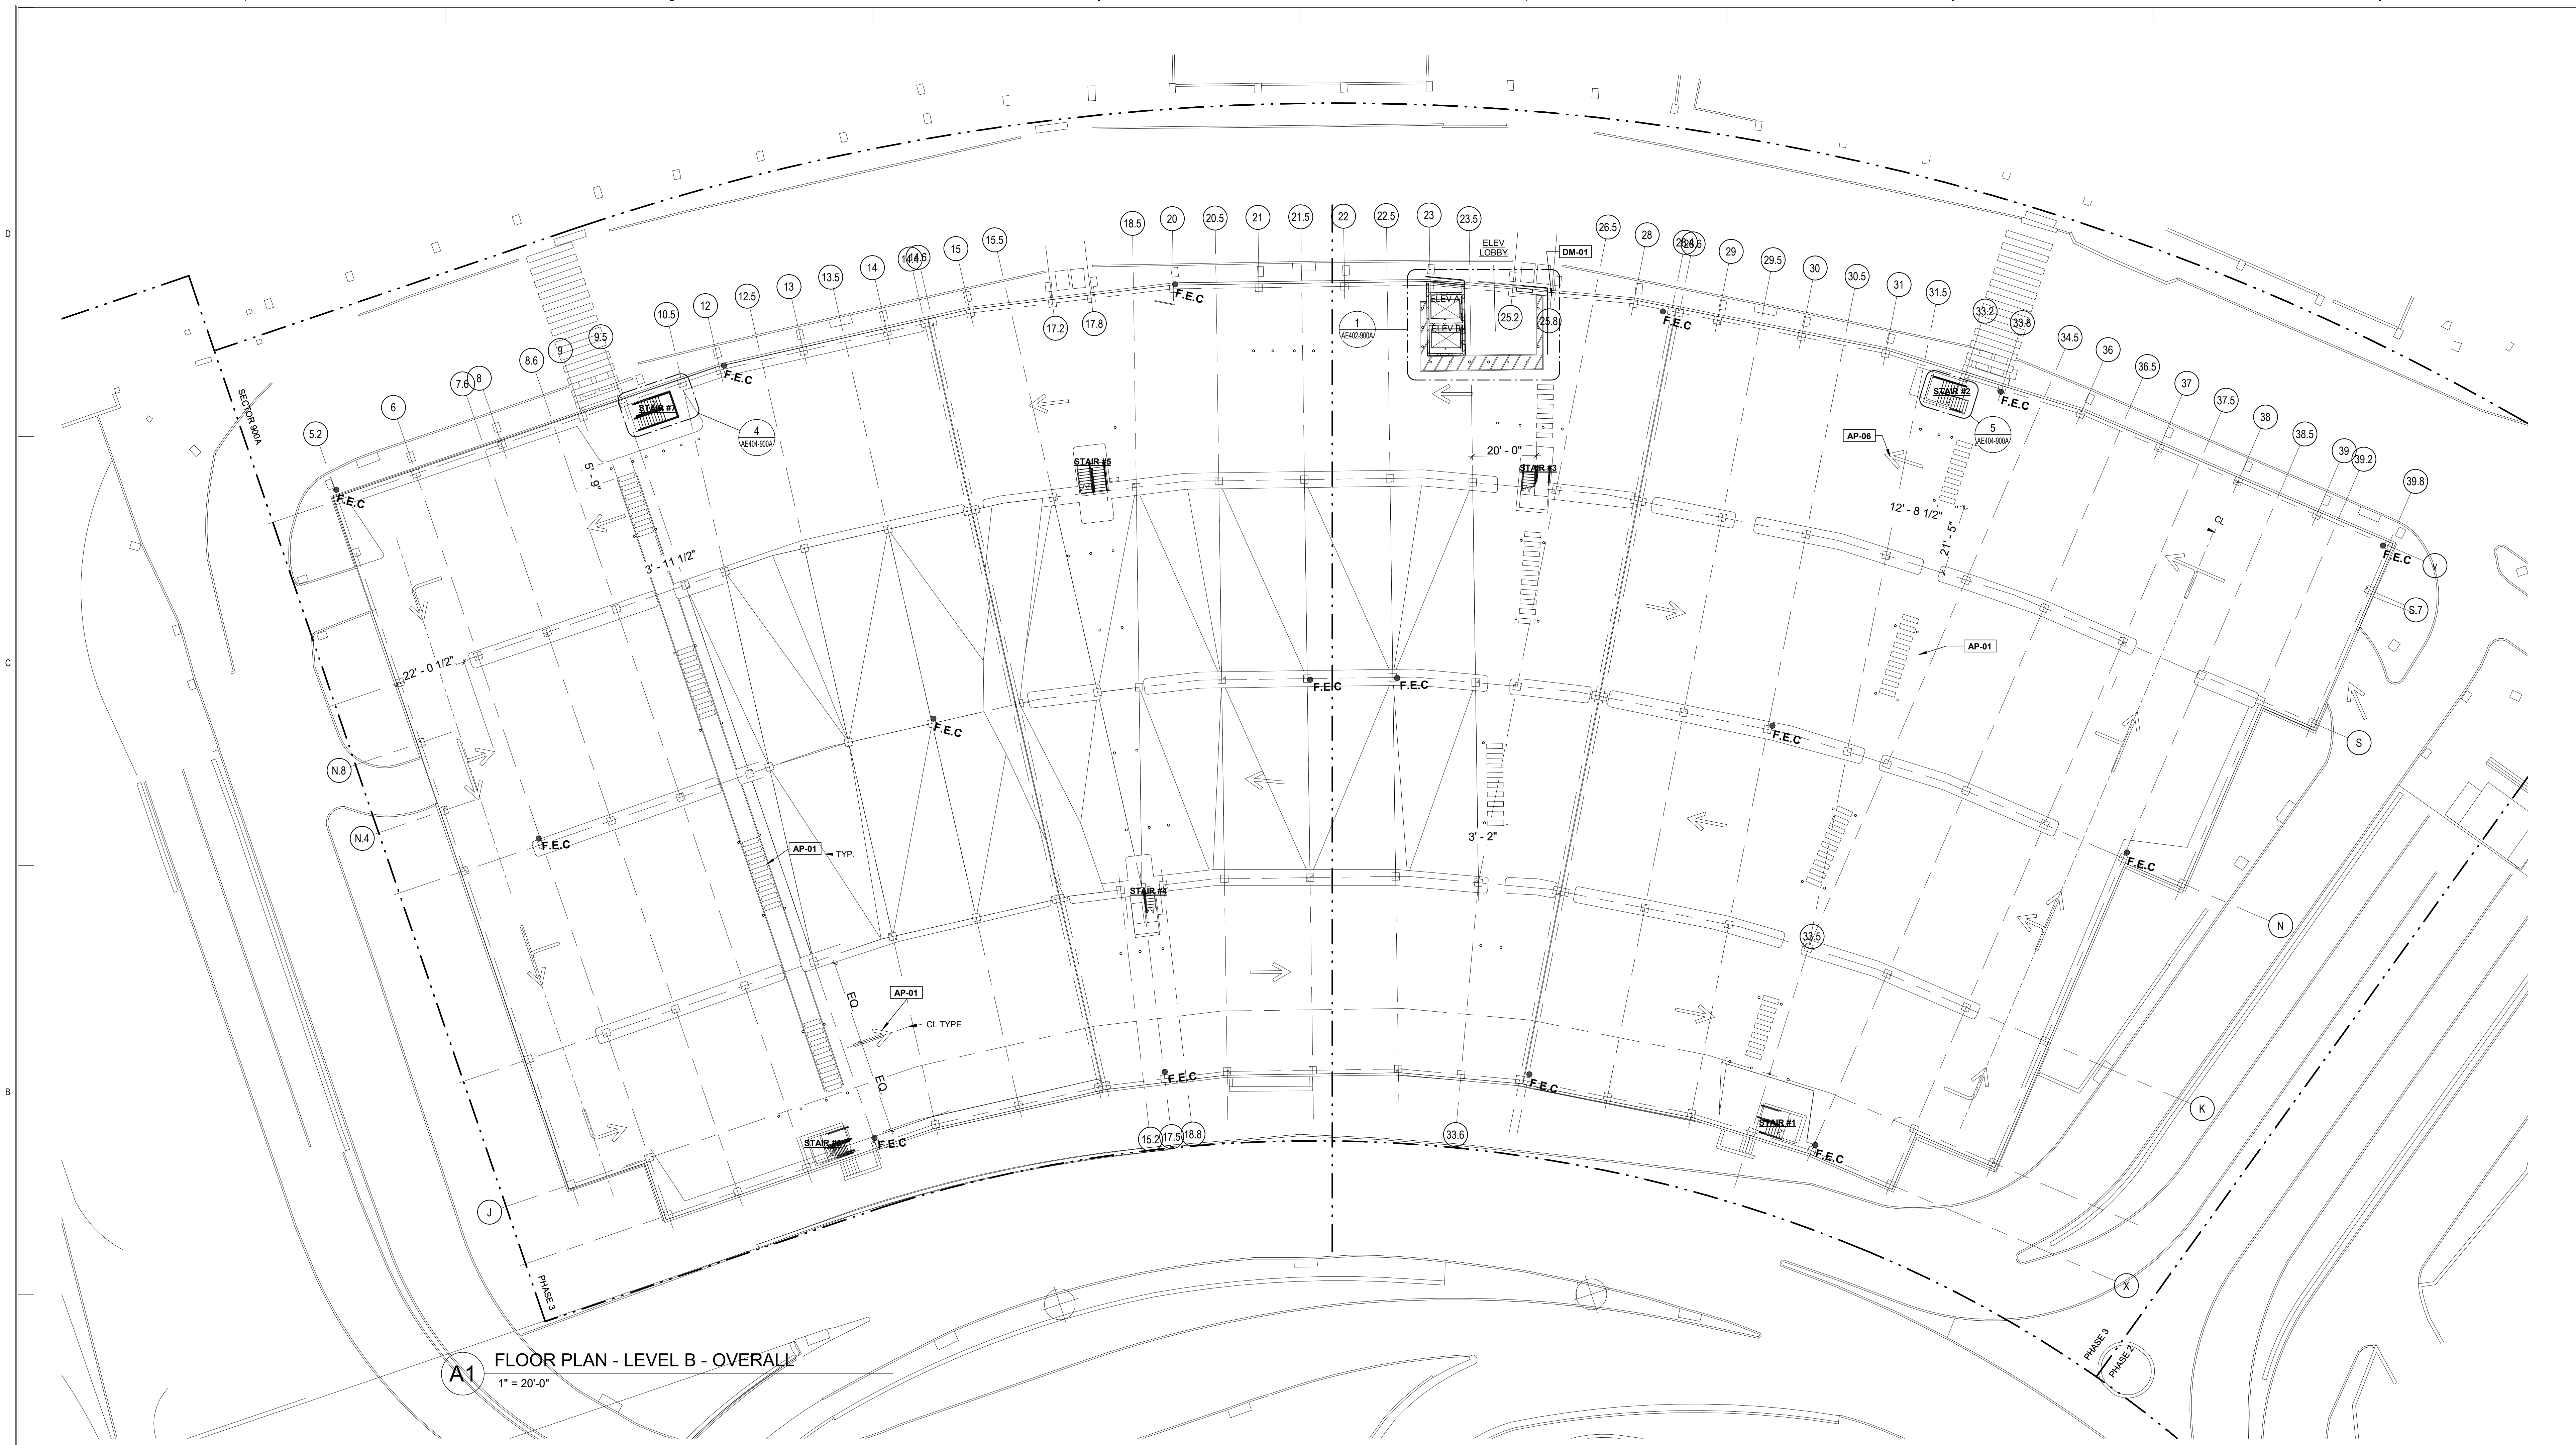

A1 FLOOR PLAN - LEVEL B - OVERALL
1" = 20'-0"

GENERAL NOTE

ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
CAR ACCESSIBLE PARKING SPACE WITH ADA/TAS COMPLIANT SIGNAGE.
ROADWAY COLUMNS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION, TYP.


KEY NOTES

Key Value	Keynote Text
AP02	
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-06	CAR ACCESSIBLE PARKING SPACE WITH ADA/TAS COMPLIANT SIGNAGE.
DM-01	ROADWAY COLUMNS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION, TYP.

LEGEND


Blank legend area for symbols and their corresponding keynotes.

KEY PLAN

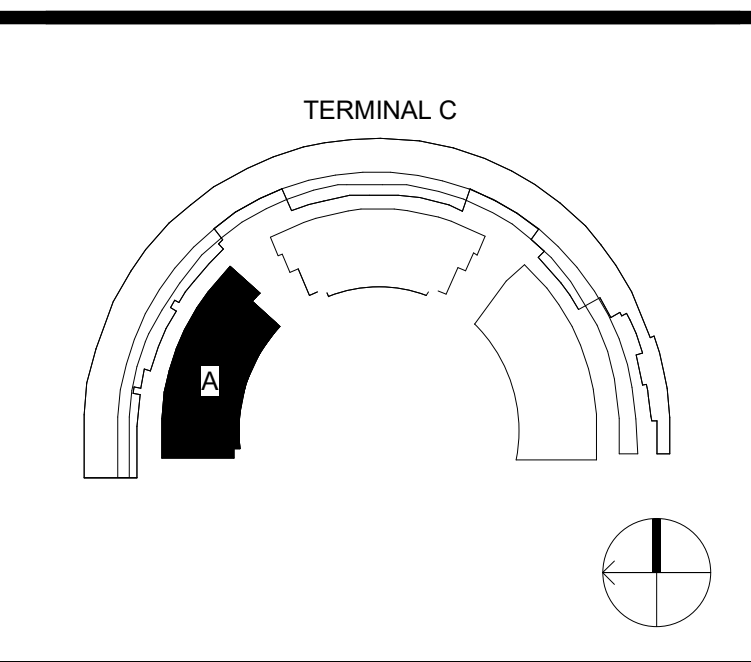


DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

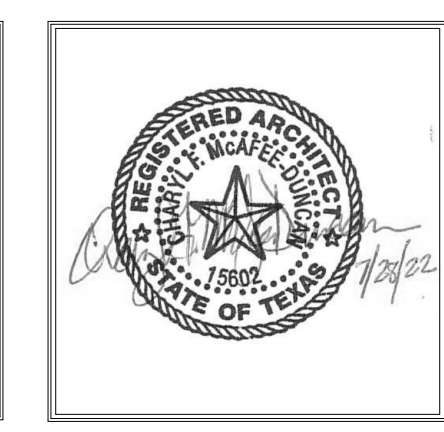



McAfee3
ARCHITECTURE+DESIGN

Hydrex, Clark & Rosenbaum, Inc.
717 North Memorial Drive
Suite 210
Dallas, TX 75201
1-214-722-6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
FLOOR PLAN - LEVEL B - OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AE102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

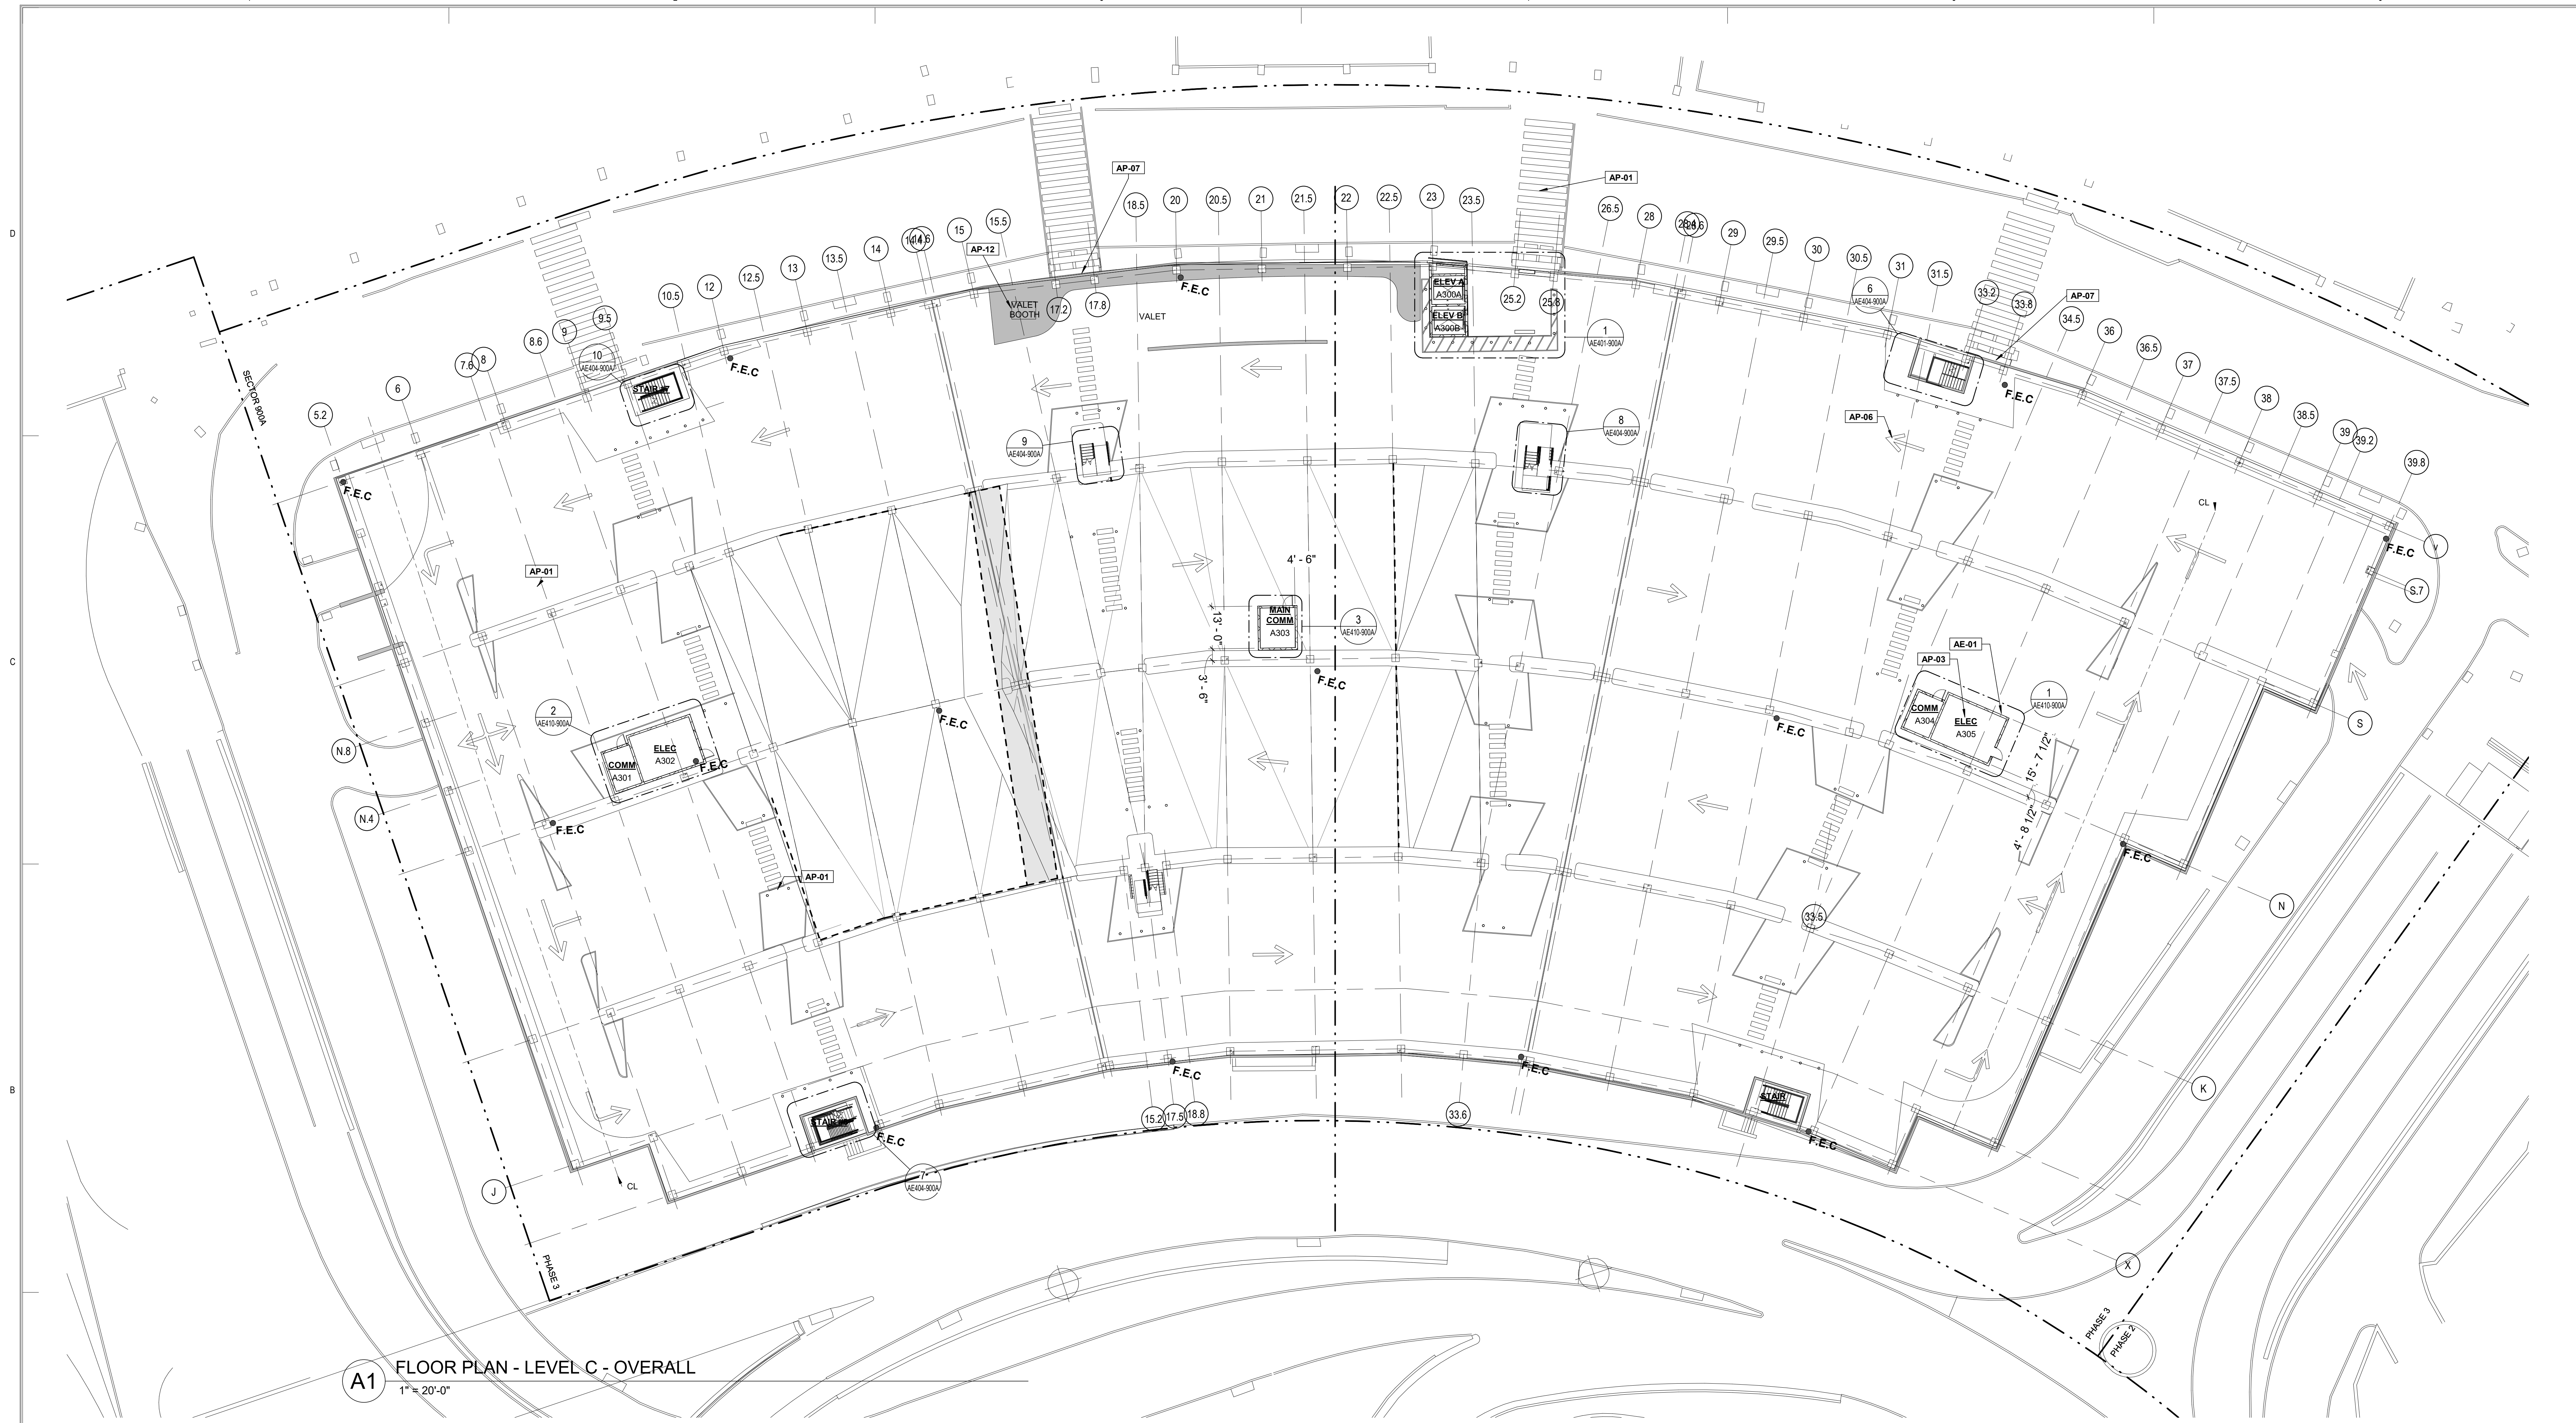

A1 FLOOR PLAN - LEVEL C - OVERALL
1" = 20'-0"


GENERAL NOTE

SHEET NOTE

Key Value	Keynote Text
AE-01	NEW 8" CMU ENCLOSURE CONSTRUCTED TO UNDERSIDE OF STRUCTURE ABOVE, REFERENCE DETAILS, STRUCTURAL NOTES.
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-03	4" WIDE WHITE PAVEMENT MARKING AT 3'-0" O.C. AT 45 DEGREE ANGLE, TYP., AROUND THE ELEVATOR LOBBY AREA AND ACCESSIBLE AISLES THROUGHOUT GARAGE ON ALL LEVELS.
AP-06	CAR ACCESSIBLE PARKING SPACE WITH ADATAS COMPLIANT SIGNAGE.
AP-07	VAN ACCESSIBLE PARKING SPACE WITH ADATAS COMPLIANT SIGNAGE.
AP-12	VALET BOOTH ENCLOSURE AS SPECIFIED.

LEGEND

KEY PLAN

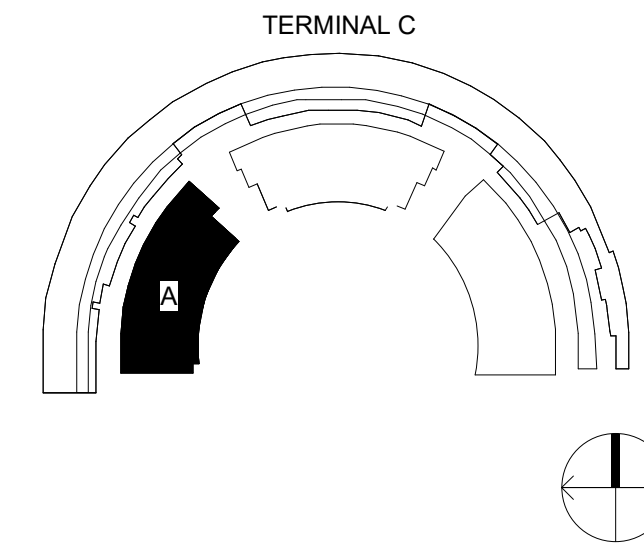

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-05	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
FLOOR PLAN - LEVEL C - OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
AE103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

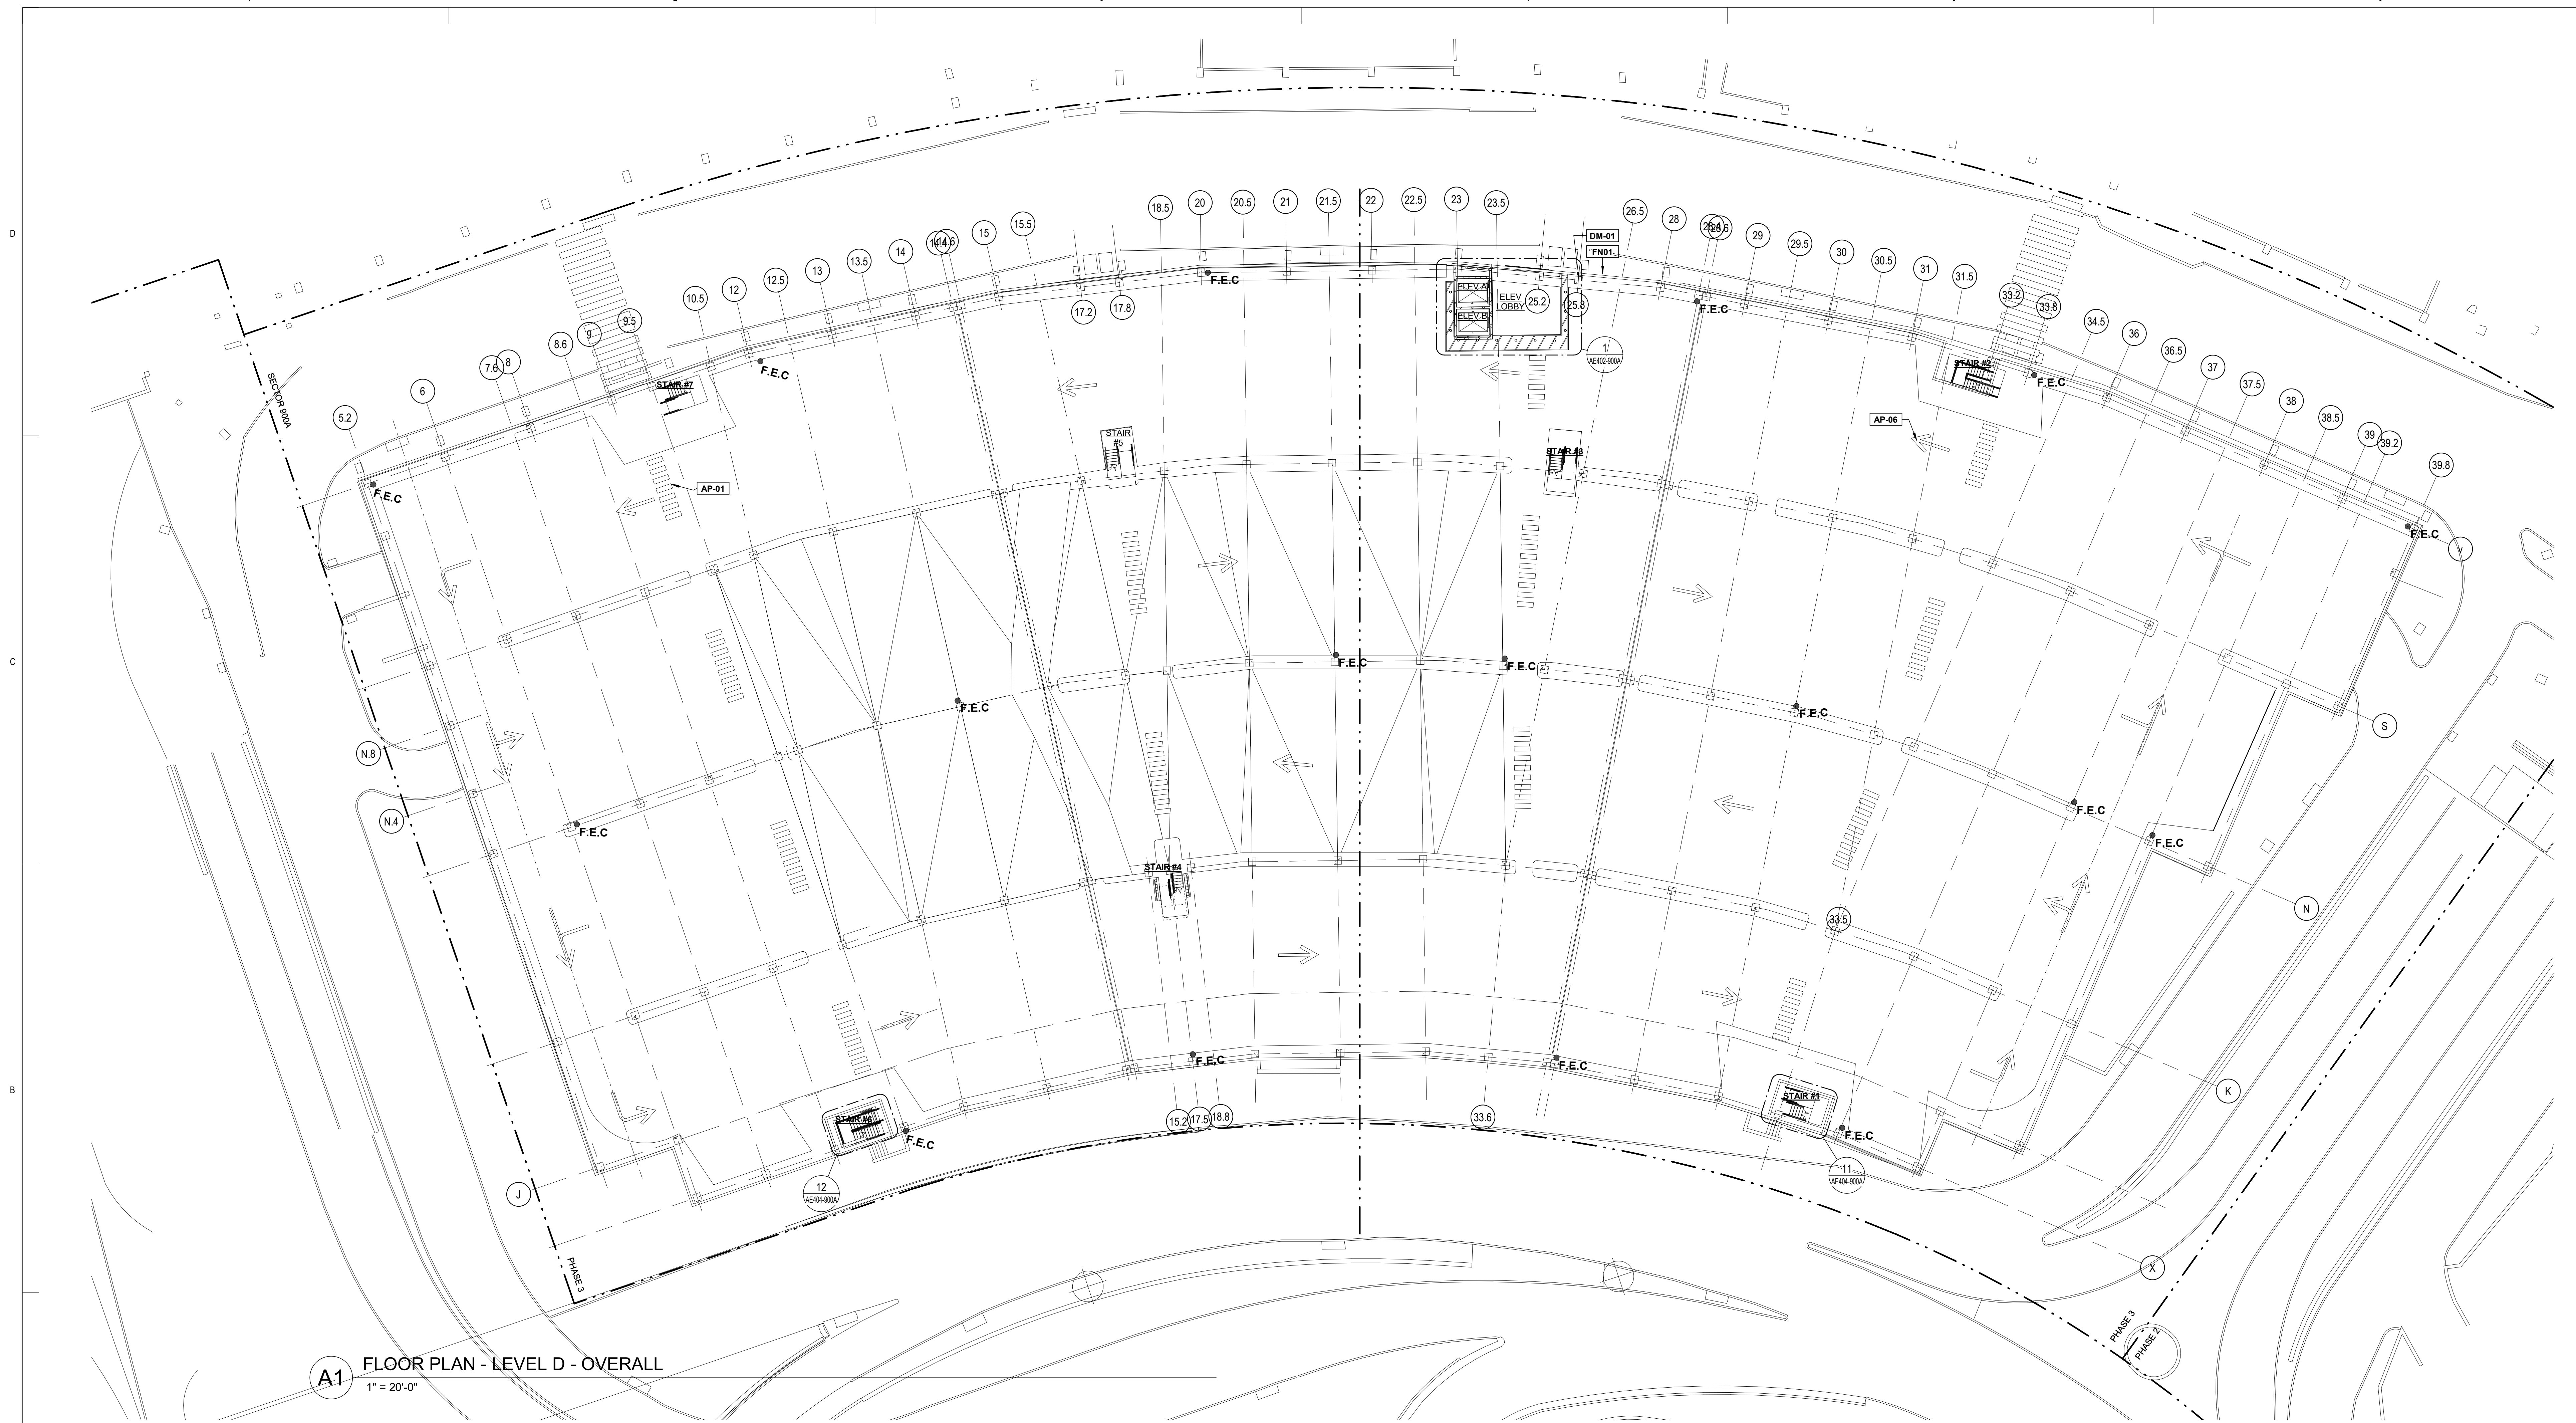

A1 FLOOR PLAN - LEVEL D - OVERALL
1" = 20'-0"


GENERAL NOTE SHEET NOTE LEGEND KEY PLAN

GENERAL NOTE

SHEET NOTE


Key Value	Keynote Text
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-06	CAR ACCESSIBLE PARKING SPACE WITH ADA/TAS COMPLIANT SIGNAGE.
DM-01	ROADWAY COLLUMS TO BE PROTECTED AT ALL TIMES DURING CONSTRUCTION, TYP.
FN01	STAINLESS STEEL WIRE MESH (M-1), REFER FINISH SCHEDULE.

LEGEND

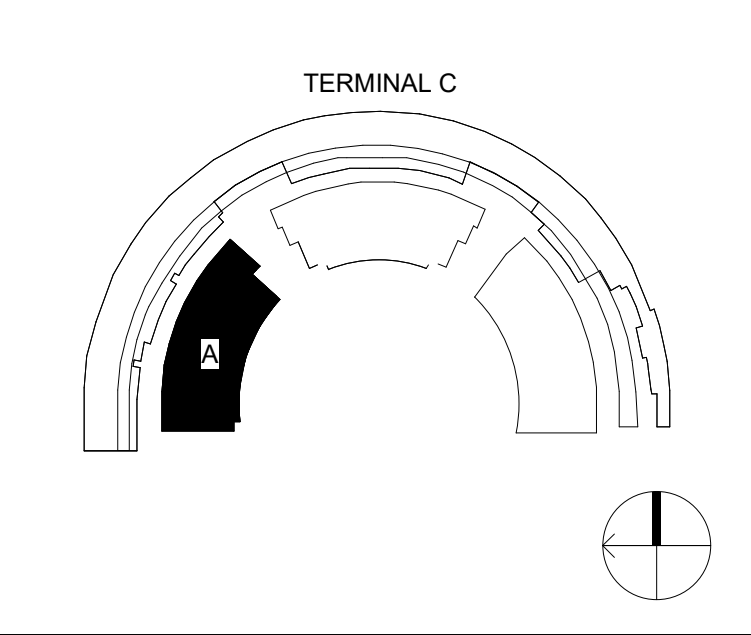

DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

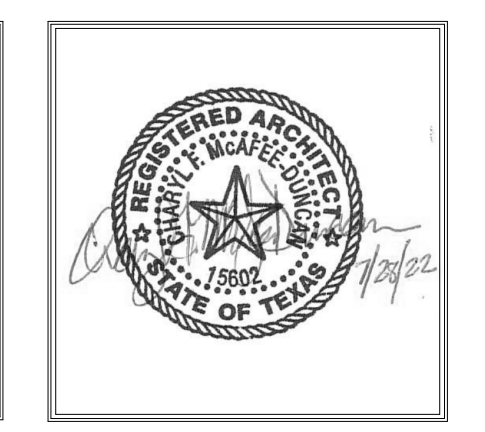

McAfee3
ARCHITECTURE+DESIGN

McAfee3, Clark & Koenigsmann, Inc.
771 North Riverwood Drive
Suite 210
Dallas, TX 75241
+1 214 722 6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-09	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A


FLOOR PLAN - LEVEL D - OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AE104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

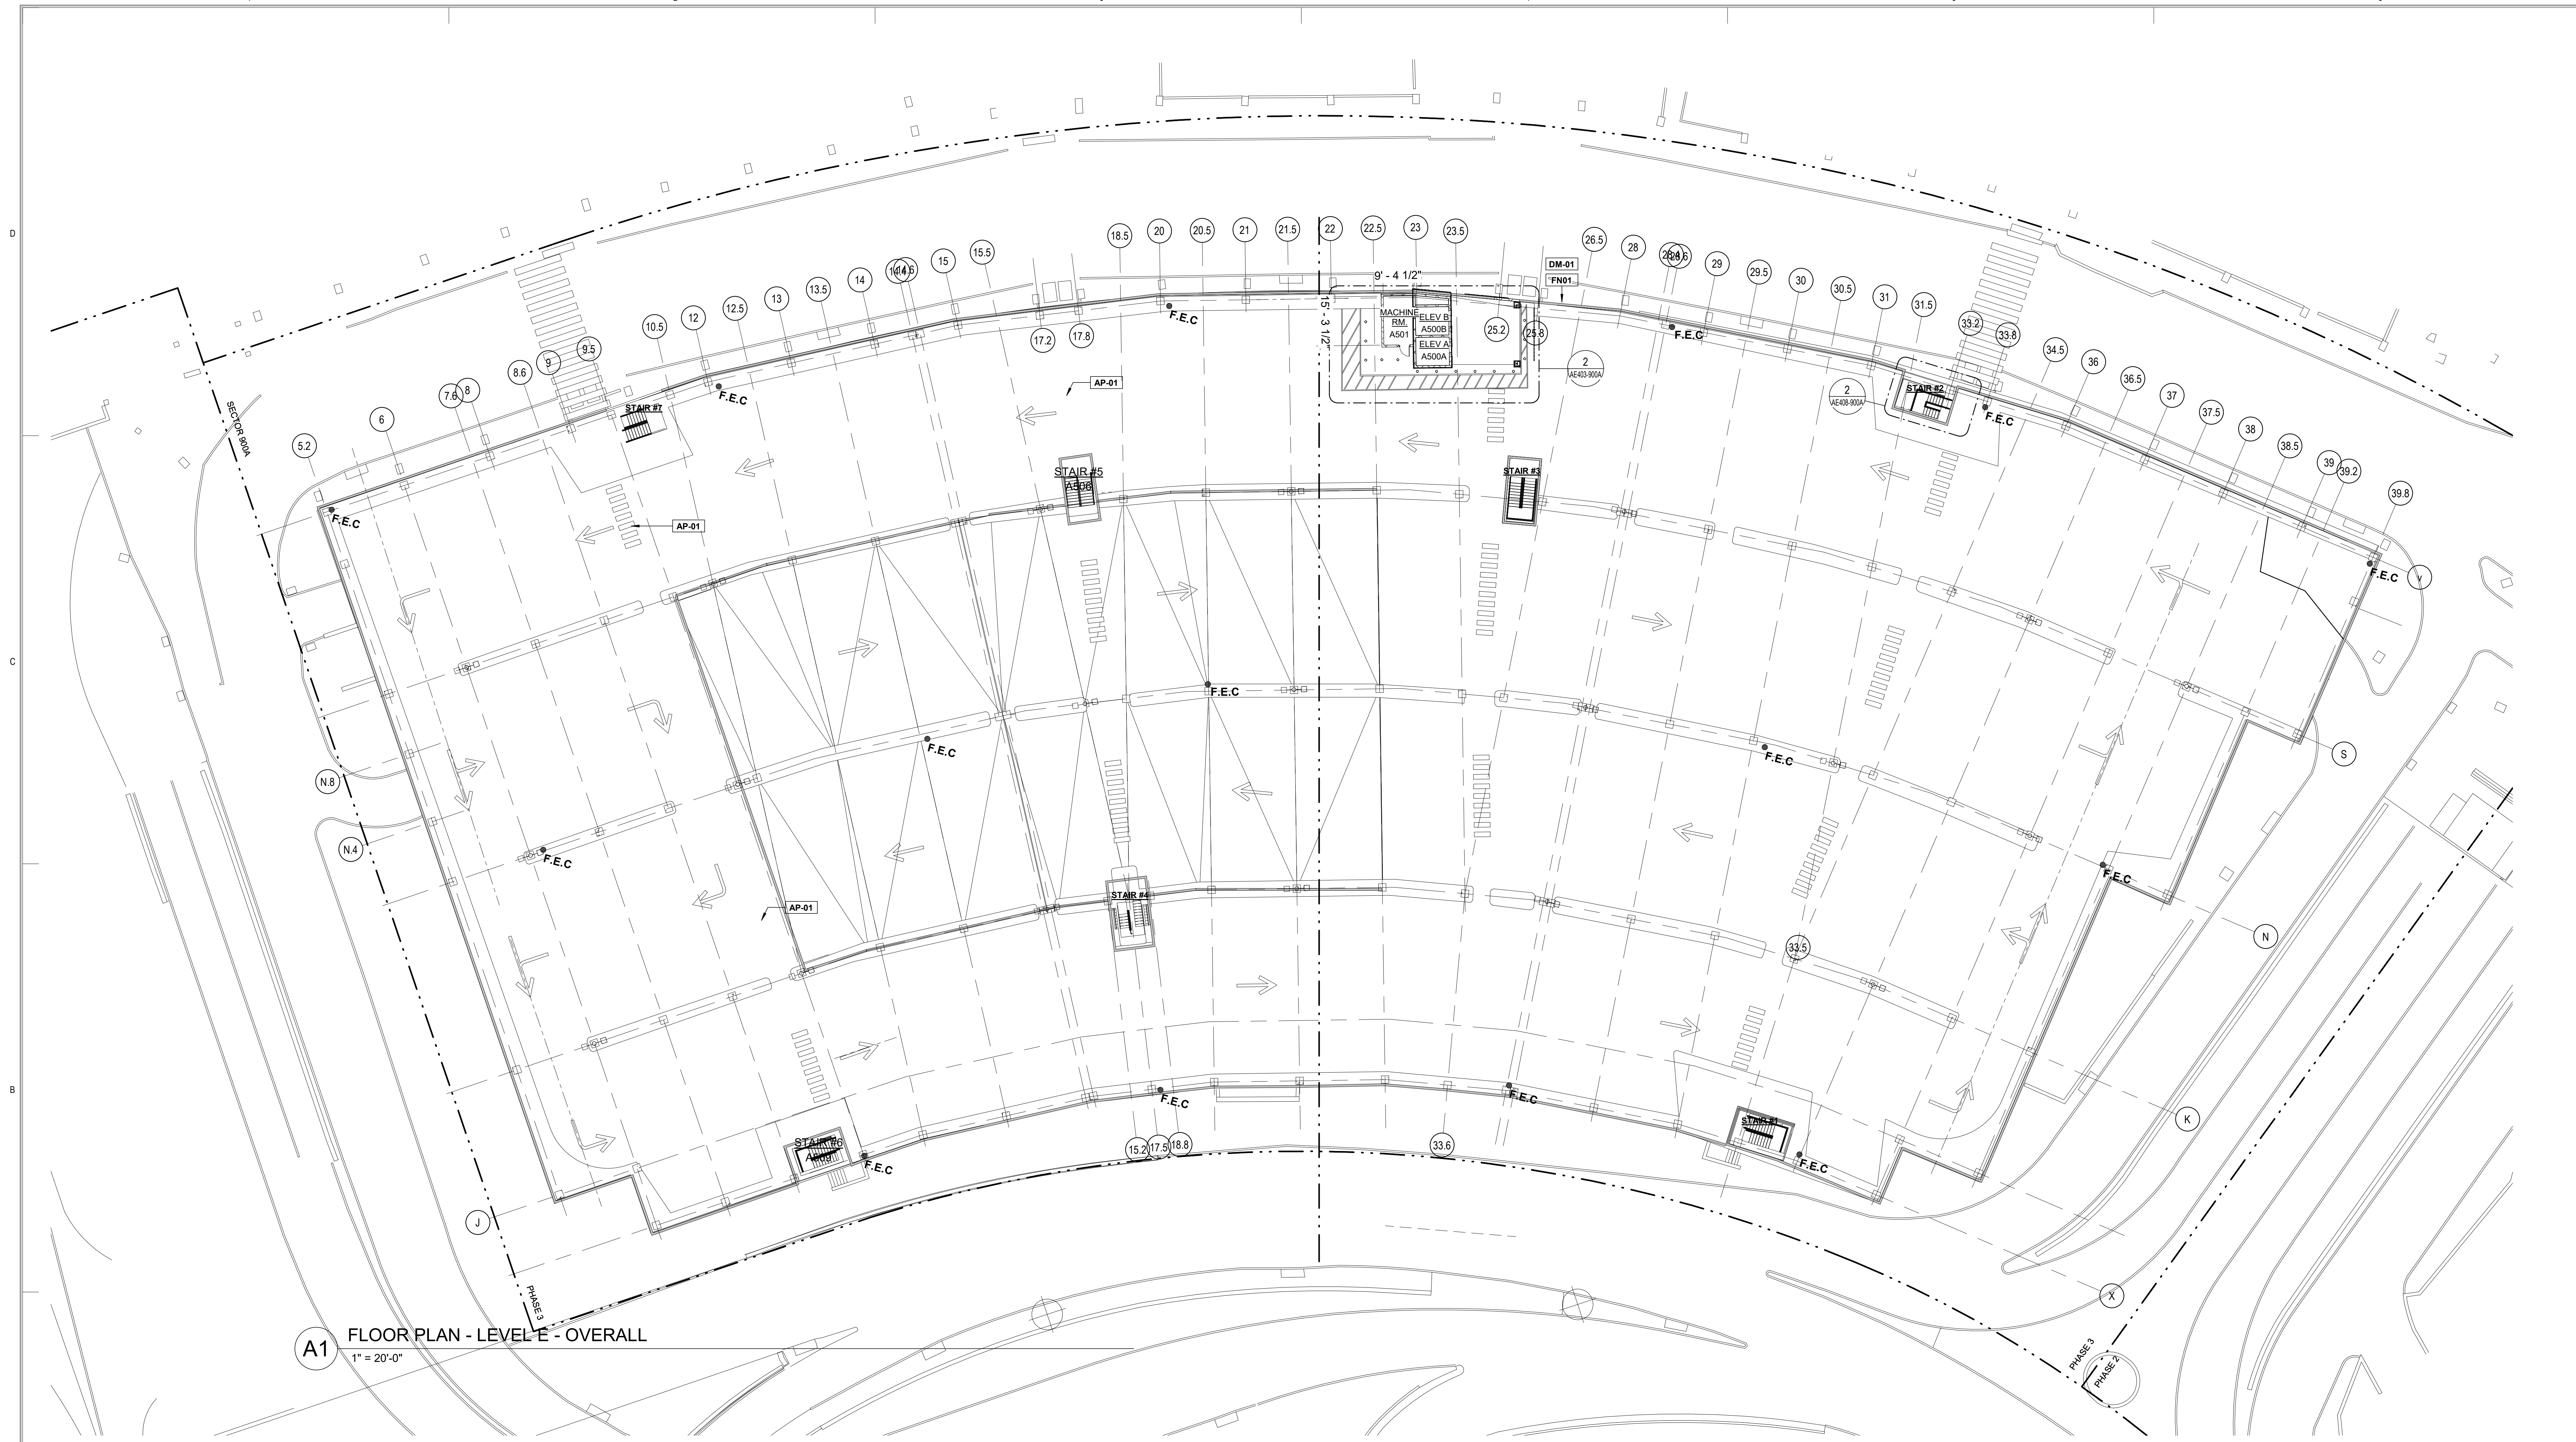

A1 FLOOR PLAN - LEVEL E - OVERALL
1" = 20'-0"


GENERAL NOTE SHEET NOTE LEGEND KEY PLAN

GENERAL NOTE

SHEET NOTE

Key Value	Keynote Text
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
FN01	STAINLESS STEEL WIRE MESH (M-1), REFER FINISH SCHEDULE.

LEGEND

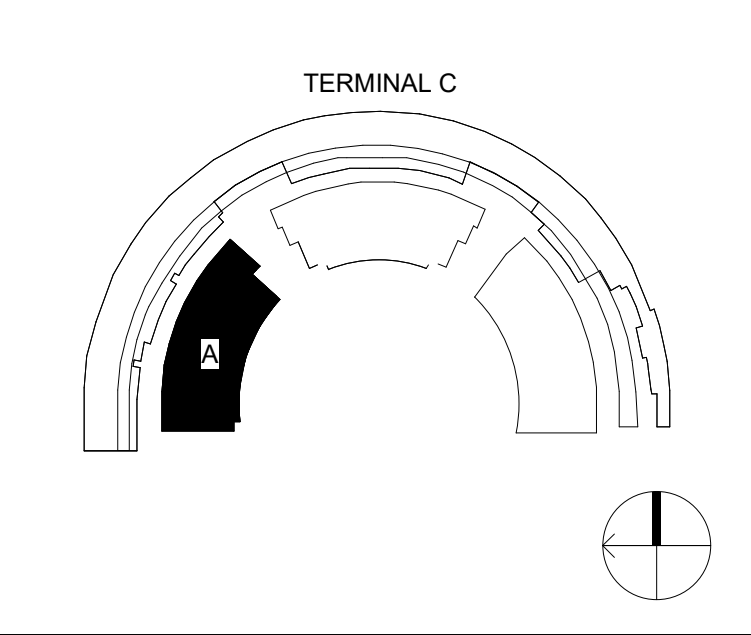

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

McAfee³
ARCHITECTURE+DESIGN
McAfee Architects, Inc.
6000 Fossil Lane
Suite 200, LB #
Dallas, TX 75243
+1 214 722 6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
FLOOR PLAN - LEVEL E - OVERALL
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022

SHEET NUMBER
AE105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

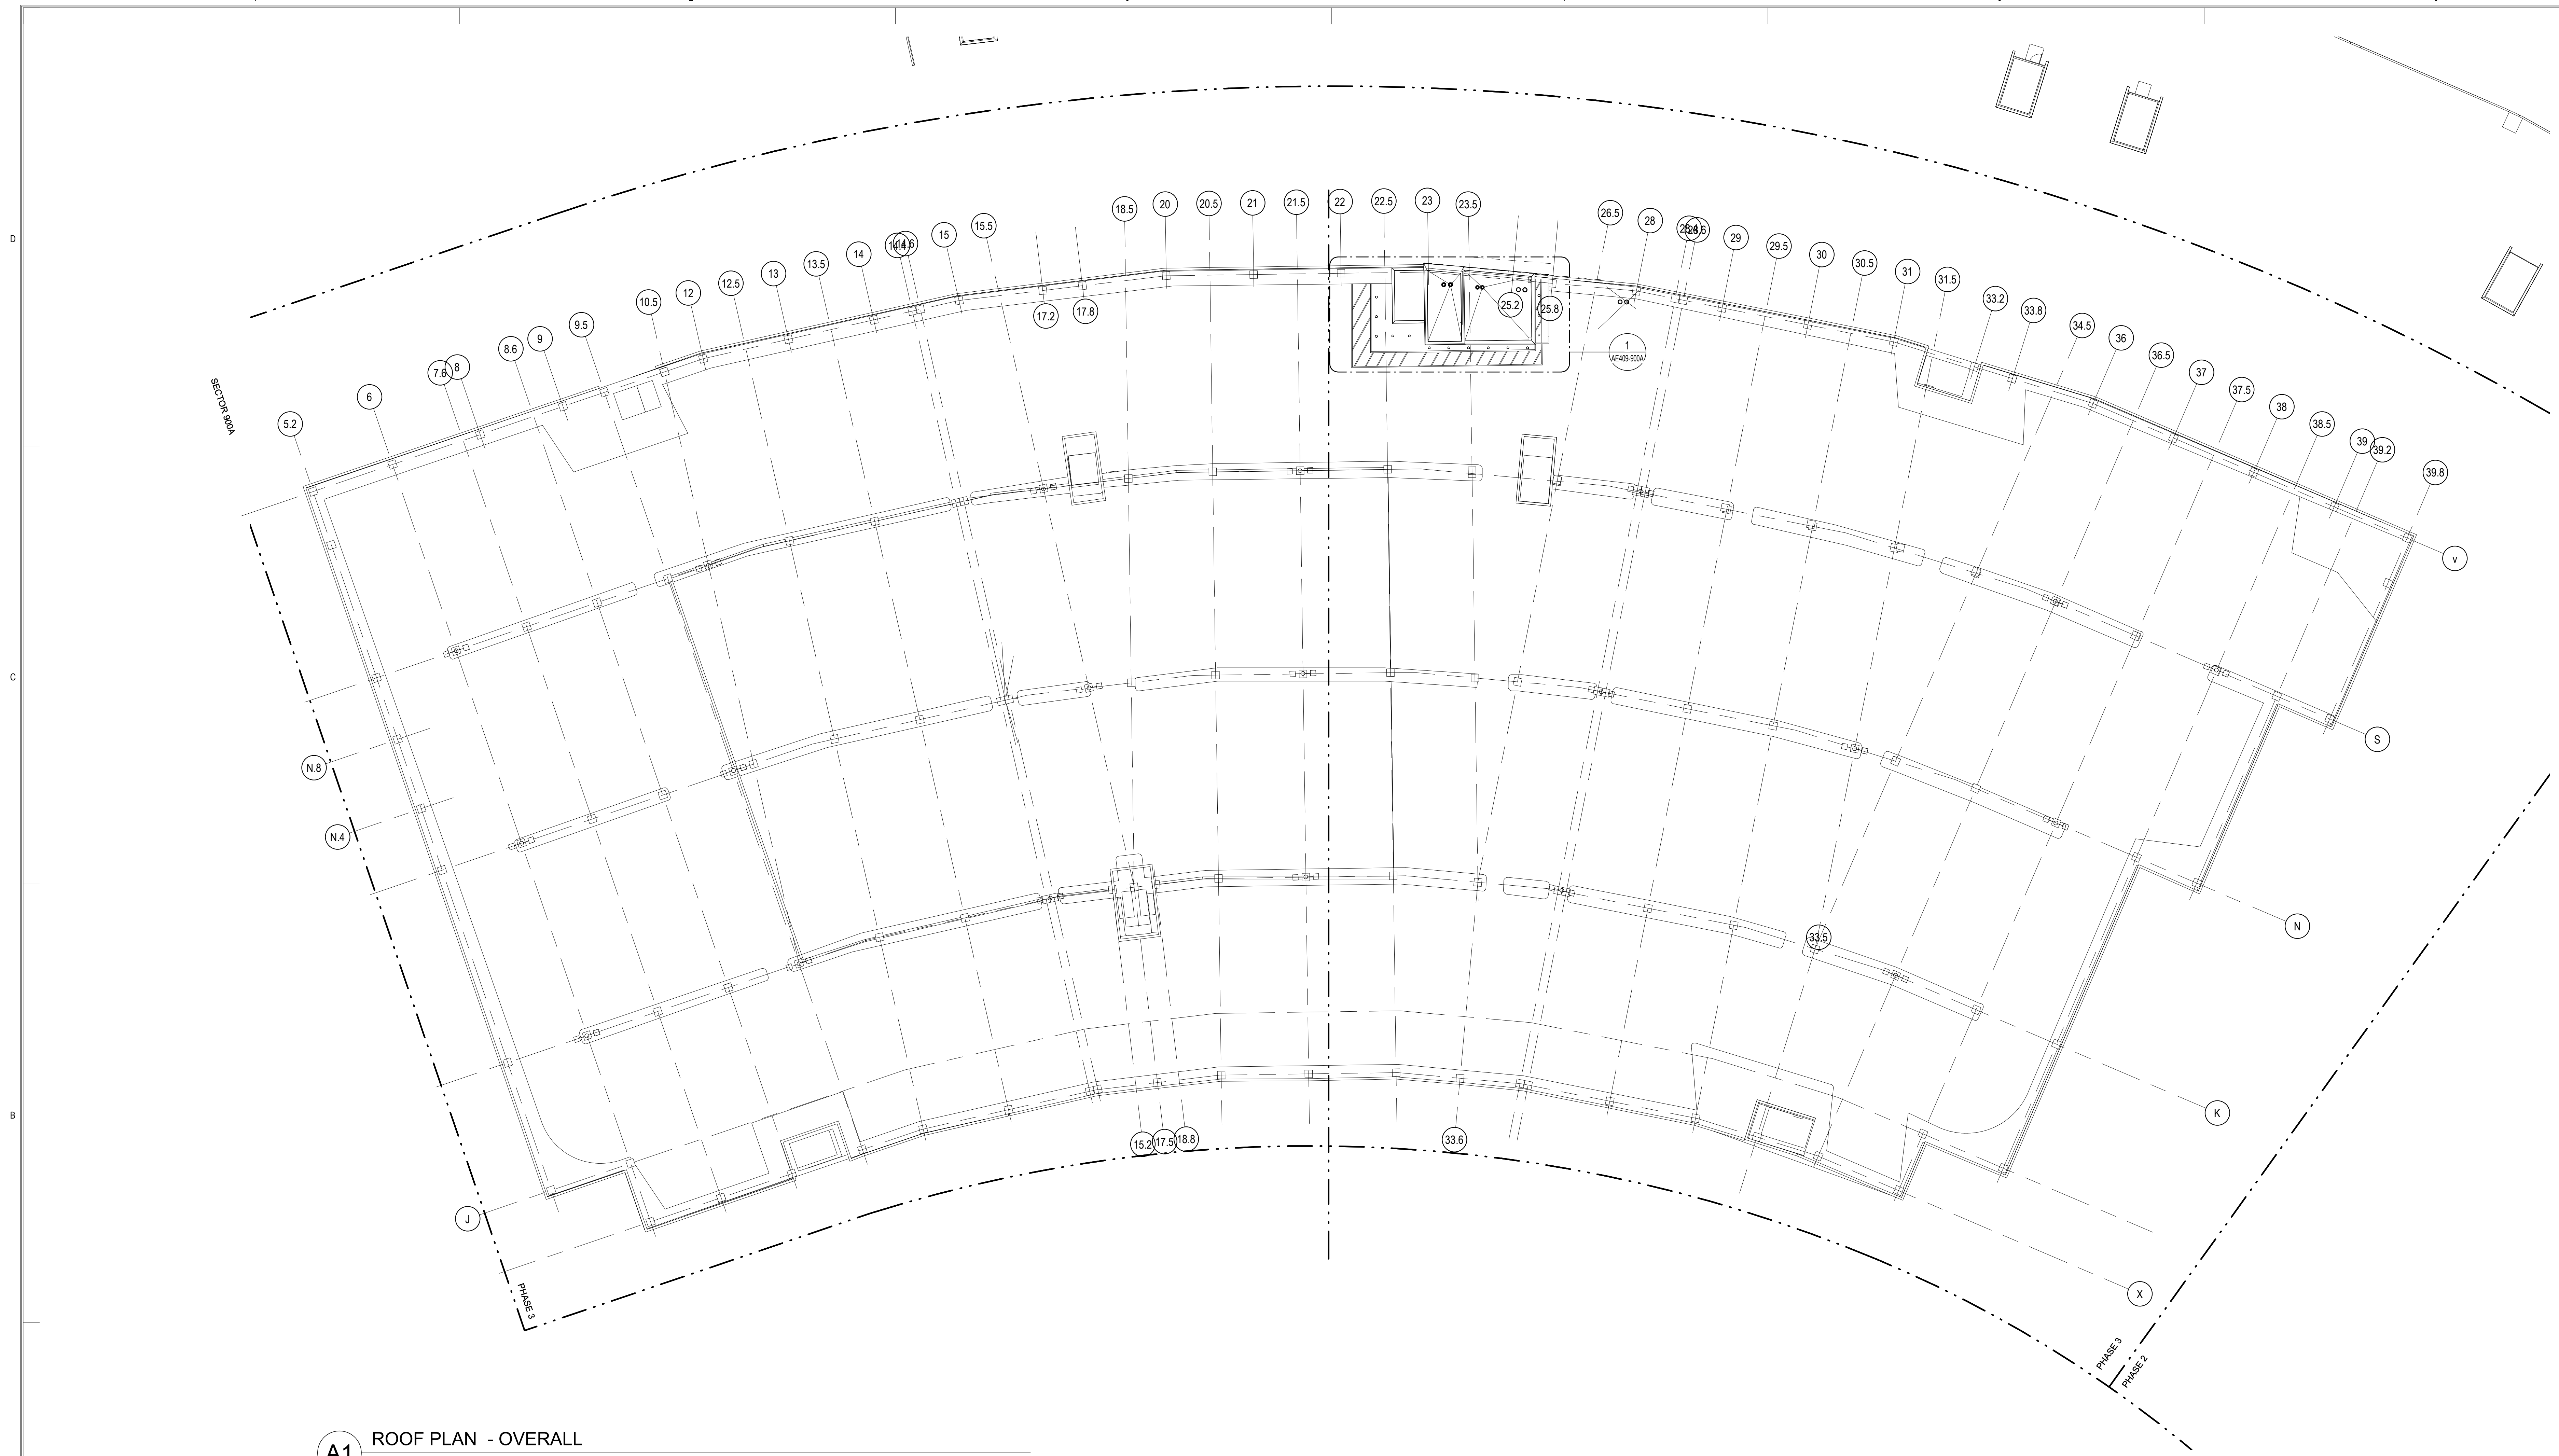

A1 ROOF PLAN - OVERALL
1" = 20'-0"

GENERAL NOTE	SHEET NOTE	LEGEND	KEY PLAN				
	<table border="1"> <thead> <tr> <th>Key Value</th> <th>Keynote Text</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> </tr> </tbody> </table>	Key Value	Keynote Text				
Key Value	Keynote Text						

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k **McAfee³**
ARCHITECTURE+DESIGN

McAfee, Clark & Rosenbaum, Inc.
717 North Westwood Street
Suite 2000, LB #
Dallas, TX 75201
+1 214 722 6000

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A

ROOF PLAN - OVERALL


PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
AE106-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

PARKING LEGEND						
PARKING SPACE...	LEVEL A...	LEVEL B...	LEVEL C...	LEVEL D...	LEVEL E...	TOTAL
ACCESSIBLE PARKING	15 (CAR)	2 (CAR)	13 (CAR=8, VAN=5)	3 (CAR)	0	33
EV ACCESSIBLE PARKING	1(CAR)	0	1(VAN)	0	0	2
EV PARKING	12	2	12	2	2	30
LIMOUSINE	2	0	2	0	0	4
VALET	0	0	22	0	0	22
OAV (OFF AIRPORT VALET)	7	0	0	0	0	7
1 HR PARKING	28	0	23	0	0	51
1 HR PARKING - HINGE SPACES	41	0	25	0	0	66

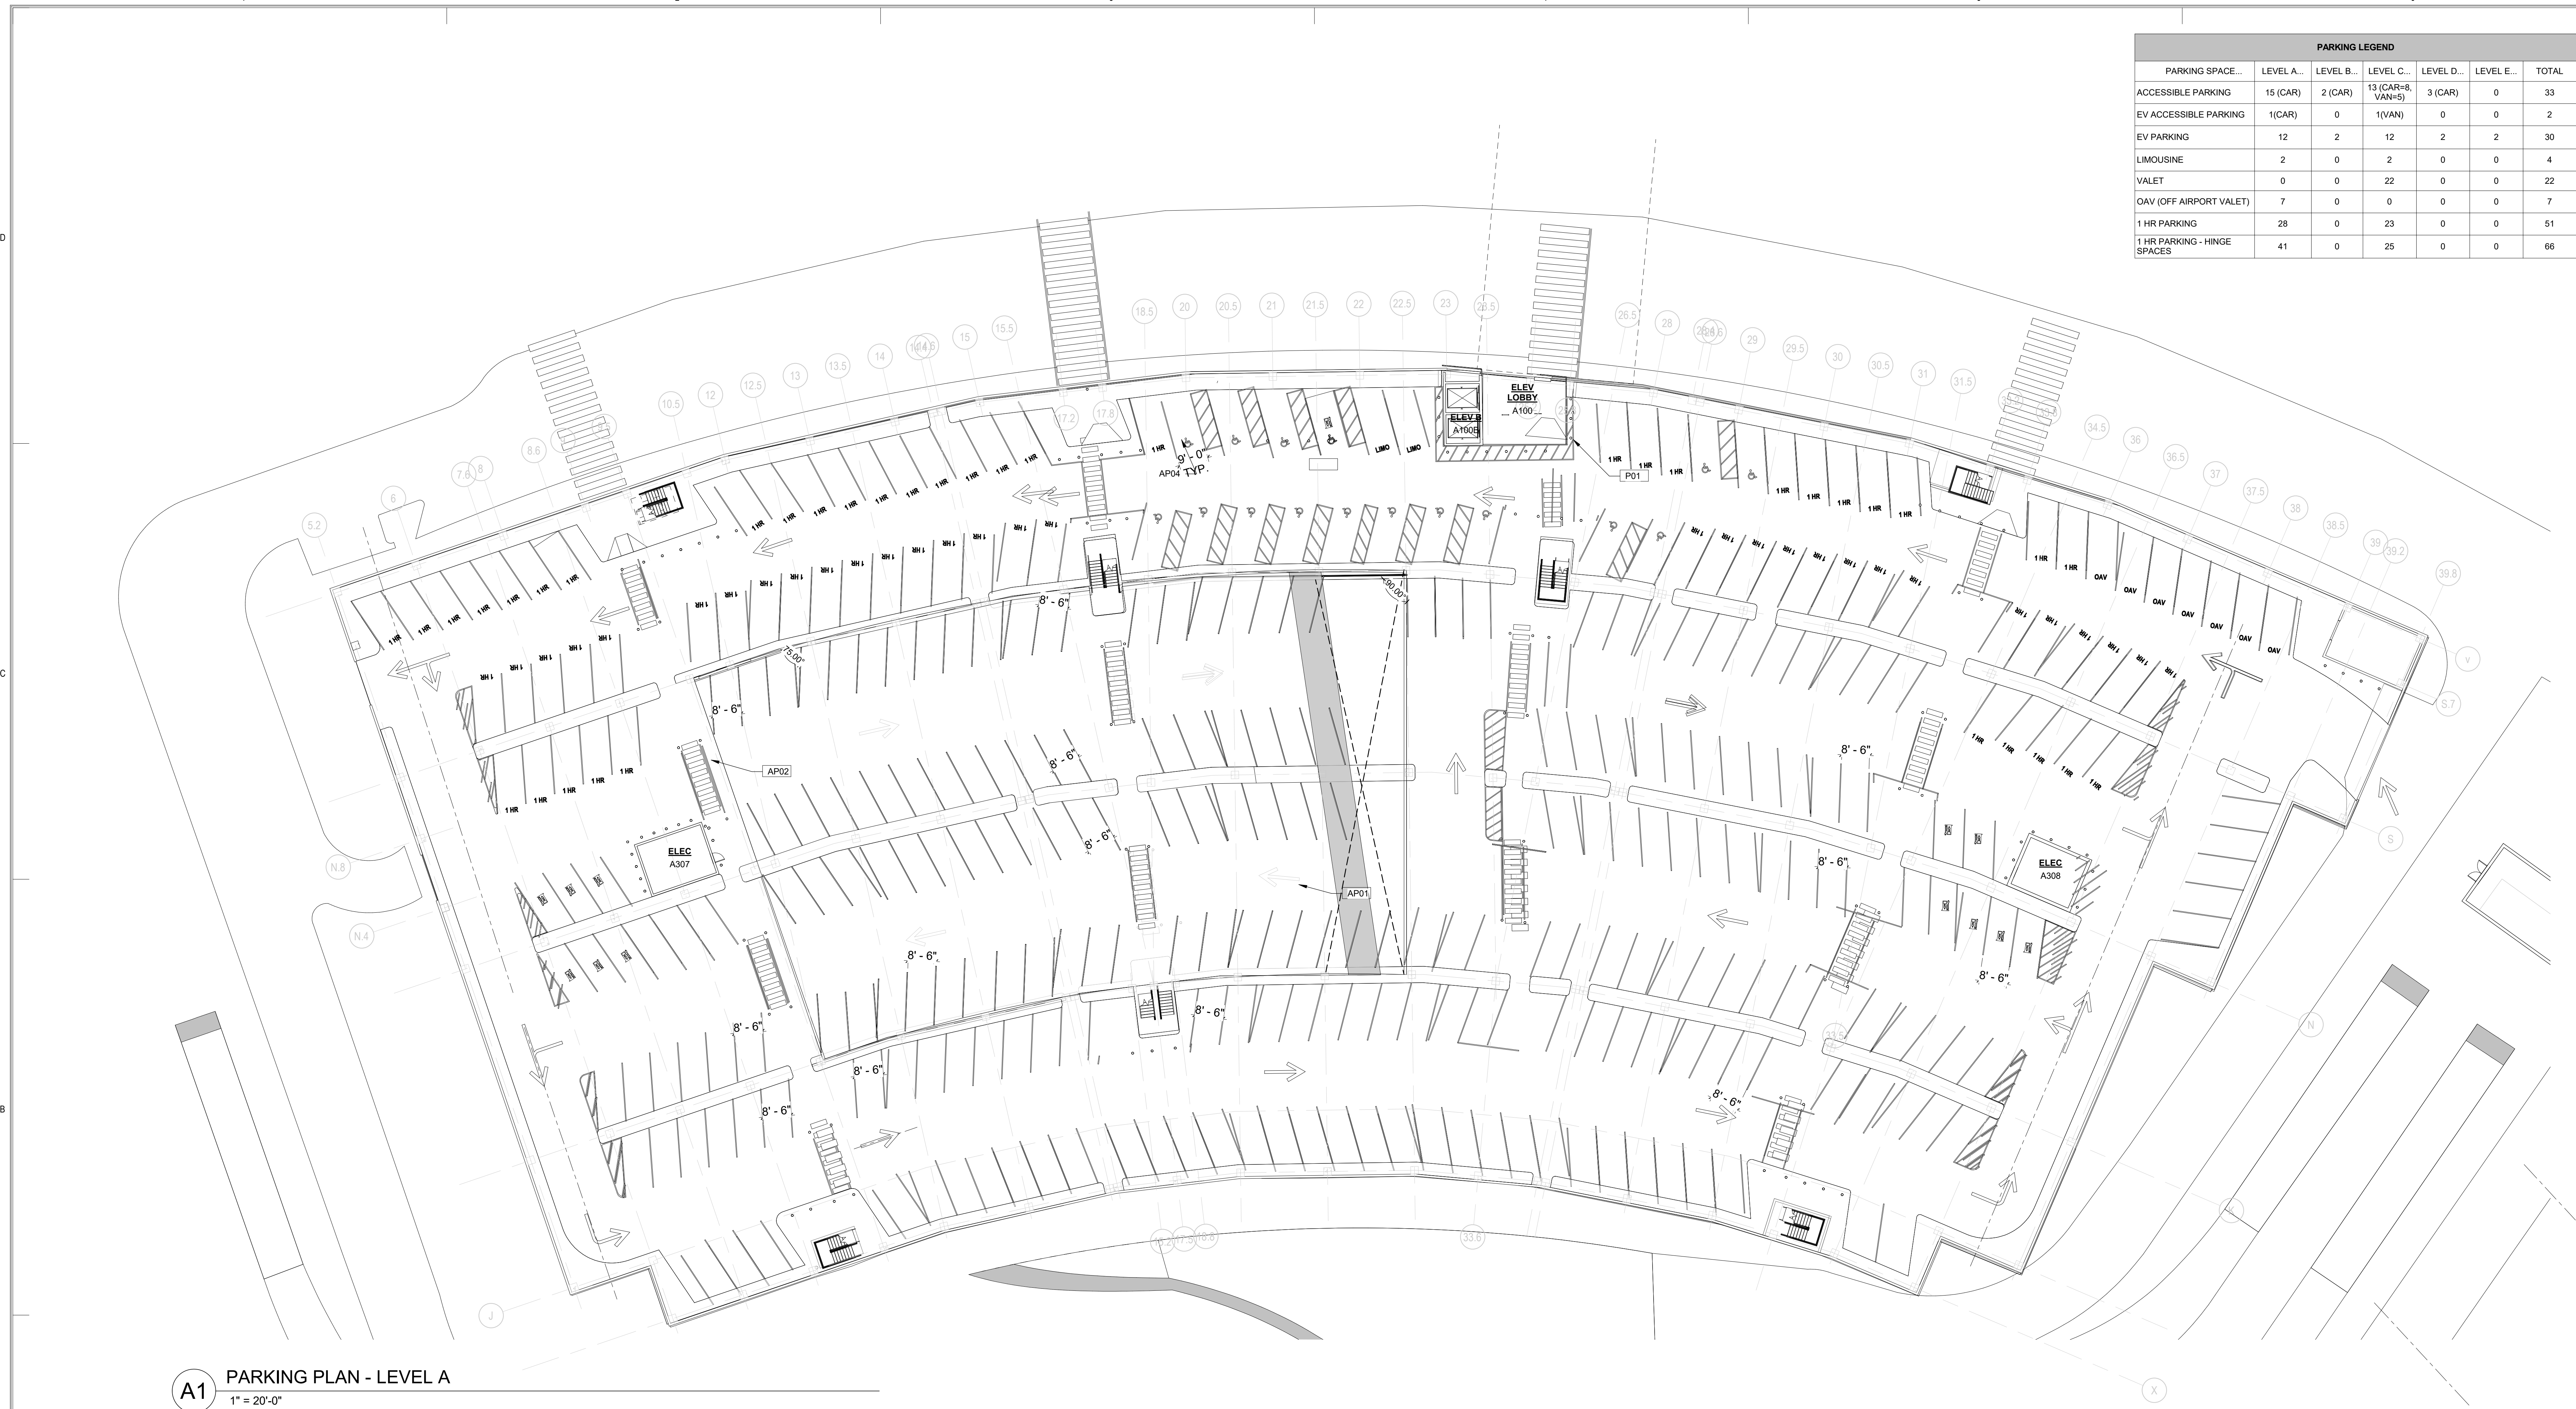

A1 PARKING PLAN - LEVEL A
1" = 20'-0"

<p>GENERAL NOTE</p> <ol style="list-style-type: none"> EXISTING EXPANSION JOINTS TO BE INFILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION. REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION. REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE. REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES. ALL PARKING SPACES ARE 8'-6"X16'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR, VALET, OAV ARE 8'-0"X16'-0" TYPICAL. MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE. 	<p>KEY NOTES</p> <p>AP01 ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE AP02 STRIPED PEDESTRIAN WALKWAY AP04 REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION P01 6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPEBOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.</p>	<p>PARKING LEGEND</p> <p>ACCESSIBLE PARKING REQUIREMENTS FOR TOTAL COUNT OF 1860 REQUIRED ACCESSIBLE SPOTS: 25 (33 TOTAL PROVIDED) REQUIRED ACCESSIBLE VAN 3 (5 PROVIDED)</p>	<p>KEY PLAN</p>
---	---	---	------------------------

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k McAfée³ ARCHITECTURE+DESIGN

McAfee Architects, Inc.
777 North Central Expressway
Suite 2000, LB #
Dallas, TX 75201
1-214-722-6000

DRAWN BY: Author
 APPROVED BY: Approver
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
PARKING PLAN - LEVEL A


PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
AE141-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

PARKING SPACE...	PARKING LEGEND					TOTAL
	LEVEL A...	LEVEL B...	LEVEL C...	LEVEL D...	LEVEL E...	
ACCESSIBLE PARKING	15 (CAR)	2 (CAR)	13 (CAR=8, VAN=5)	3 (CAR)	0	33
EV ACCESSIBLE PARKING	1(CAR)	0	1(VAN)	0	0	2
EV PARKING	12	2	12	2	2	30
LIMOUSINE	2	0	2	0	0	4
VALET	0	0	22	0	0	22
OAV (OFF AIRPORT VALET)	7	0	0	0	0	7
1 HR PARKING	28	0	23	0	0	51
1 HR PARKING - HINGE SPACES	41	0	25	0	0	66

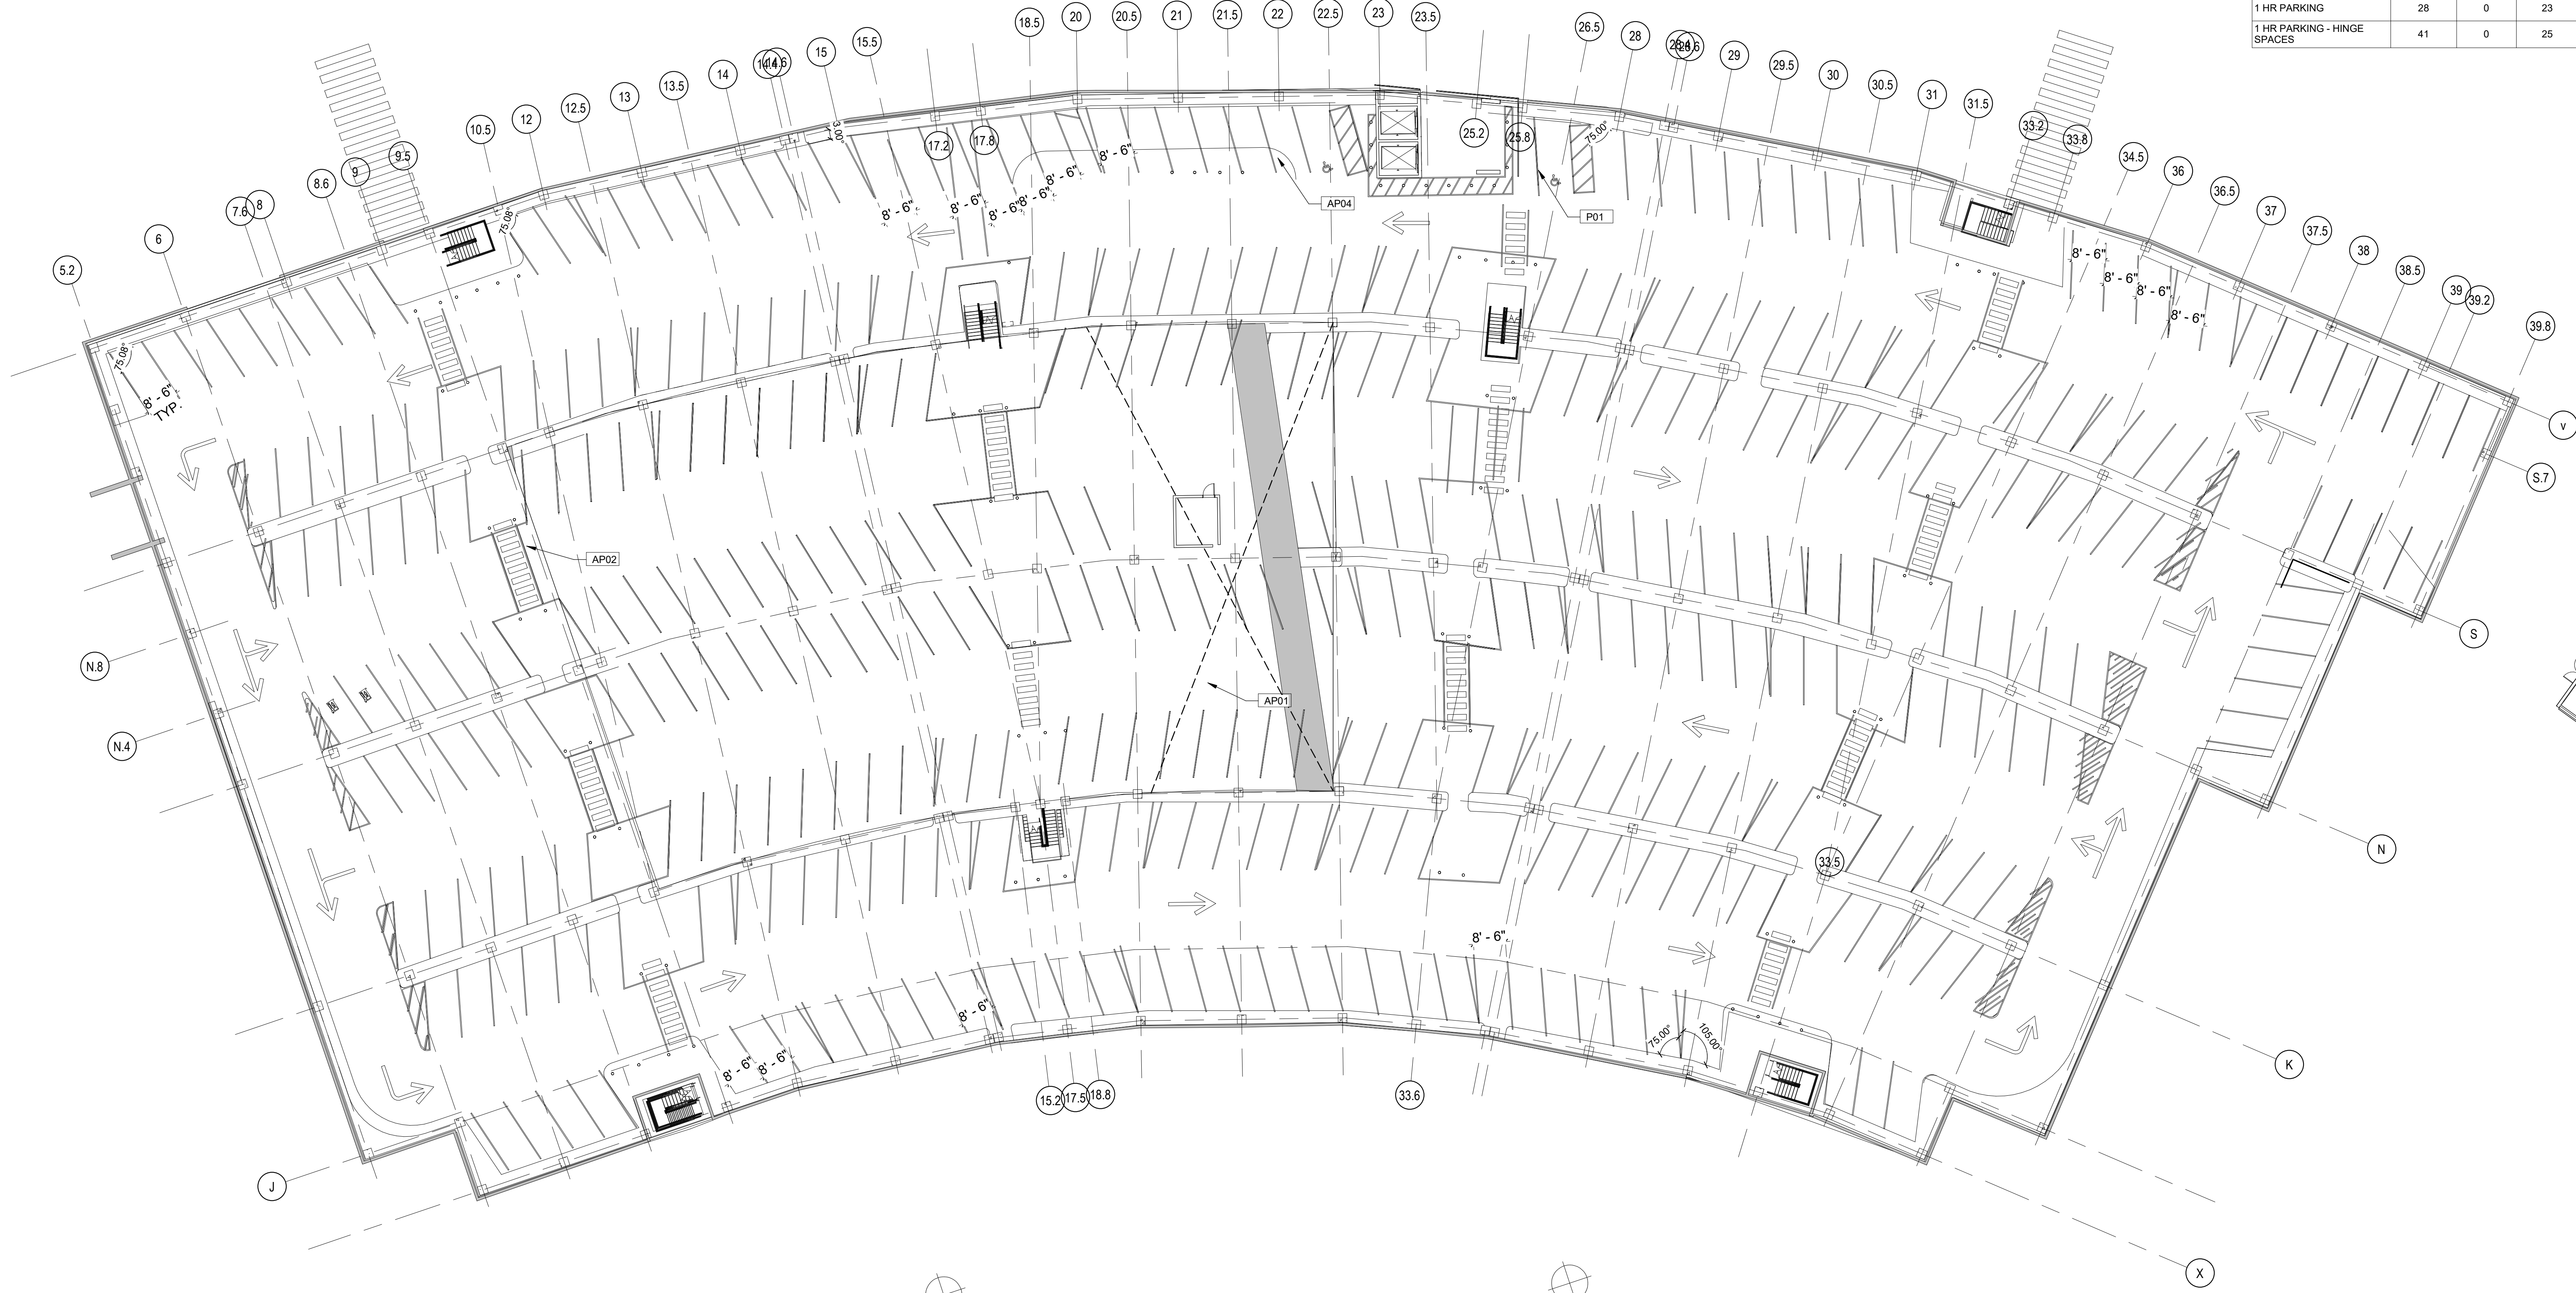

A1 PARKING PLAN - LEVEL B
1" = 20'-0"

GENERAL NOTE

- EXISTING EXPANSION JOINTS TO BE FILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION.
- REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION.
- REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS, FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE.
- REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES.
- ALL PARKING SPACES ARE 9'-0"x18'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR, VALET, OAV ARE 9'-0"x18'-0" TYPICAL.
- MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE.


SHEET NOTE

- AP01 ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE
 AP02 STRIPED PEDESTRIAN WALKWAY
 AP04 REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION
 P01 6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPEBOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.

PARKING NOTES

ACCESSIBLE PARKING REQUIREMENTS FOR TOTAL COUNT OF 1560
 REQUIRED ACCESSIBLE SPOTS 25 (33 TOTAL PROVIDED)
 REQUIRED ACCESSIBLE VAN 3 (5 PROVIDED)

KEY PLAN

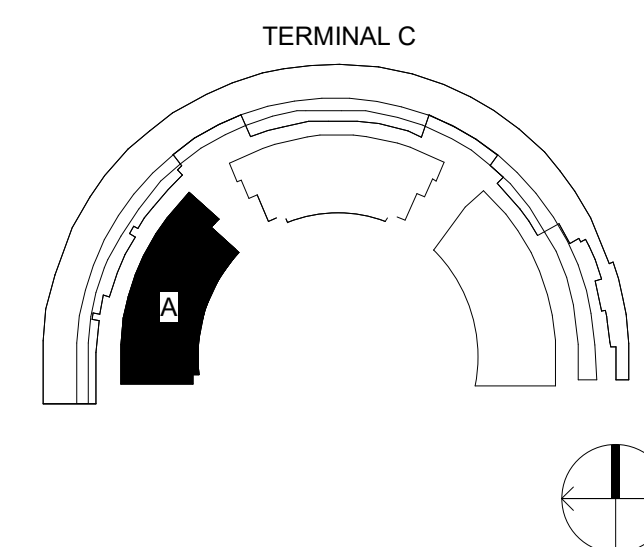

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
 APPROVED BY: Approver
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
PARKING PLAN - LEVEL B

SHEET NUMBER
AE142-900A

PERMIT NUMBER: B22-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

PARKING LEGEND						
PARKING SPACE...	LEVEL A...	LEVEL B...	LEVEL C...	LEVEL D...	LEVEL E...	TOTAL
ACCESSIBLE PARKING	15 (CAR)	2 (CAR)	13 (CAR+5 VAN+5)	3 (CAR)	0	33
EV ACCESSIBLE PARKING	1(CAR)	0	1(VAN)	0	0	2
EV PARKING	12	2	12	2	2	30
LIMOUSINE	2	0	2	0	0	4
VALET	0	0	22	0	0	22
OAV (OFF AIRPORT VALET)	7	0	0	0	0	7
1 HR PARKING	28	0	23	0	0	51
1 HR PARKING - HINGE SPACES	41	0	25	0	0	66



A1 PARKING PLAN - LEVEL C
1" = 20'-0"

GENERAL NOTE SHEET NOTE PARKING NOTES KEY PLAN

GENERAL NOTE


- EXISTING EXPANSION JOINTS TO BE INFILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION.
- REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION.
- REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS, FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE.
- REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES.
- ALL PARKING SPACES ARE 8'-6"X18'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR, VALET, OAV ARE 9'-0"X18'-0" TYPICAL.
- MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE.

SHEET NOTE

AP01 ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE
 AP02 STRIPED PEDESTRIAN WALKWAY. REFER SHEET AE502-900B.
 AP04 REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION
 P01 6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPEBOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR:SAFETY YELLOW, WITH REFLECTIVE RED TAPE.

PARKING NOTES

ACCESSIBLE PARKING REQUIREMENTS FOR TOTAL COUNT OF 1880
 REQUIRED ACCESSIBLE SPOTS 25 (33 TOTAL PROVIDED)
 REQUIRED ACCESSIBLE VAN 3 (5 PROVIDED)

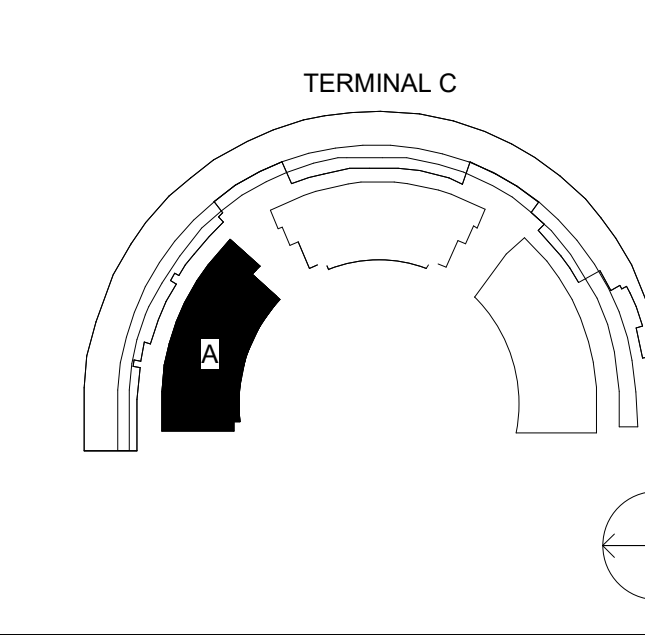

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

McAfee³
ARCHITECTURE+DESIGN

McAfee3 Architecture, Inc.
777 North Central Expressway
Suite 2103
Dallas, TX 75241
+1 214 722 6000

DRAWN BY: Author
 APPROVED BY: Approver
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
PARKING PLAN - LEVEL C


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
AE143-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

PARKING SPACE...	PARKING LEGEND					TOTAL
	LEVEL A...	LEVEL B...	LEVEL C...	LEVEL D...	LEVEL E...	
ACCESSIBLE PARKING	15 (CAR)	2 (CAR)	13 (CAR=8, VAN=5)	3 (CAR)	0	33
EV ACCESSIBLE PARKING	1(CAR)	0	1(VAN)	0	0	2
EV PARKING	12	2	12	2	2	30
LIMOUSINE	2	0	2	0	0	4
VALET	0	0	22	0	0	22
OAV (OFF AIRPORT VALET)	7	0	0	0	0	7
1 HR PARKING	28	0	23	0	0	51
1 HR PARKING - HINGE SPACES	41	0	25	0	0	66

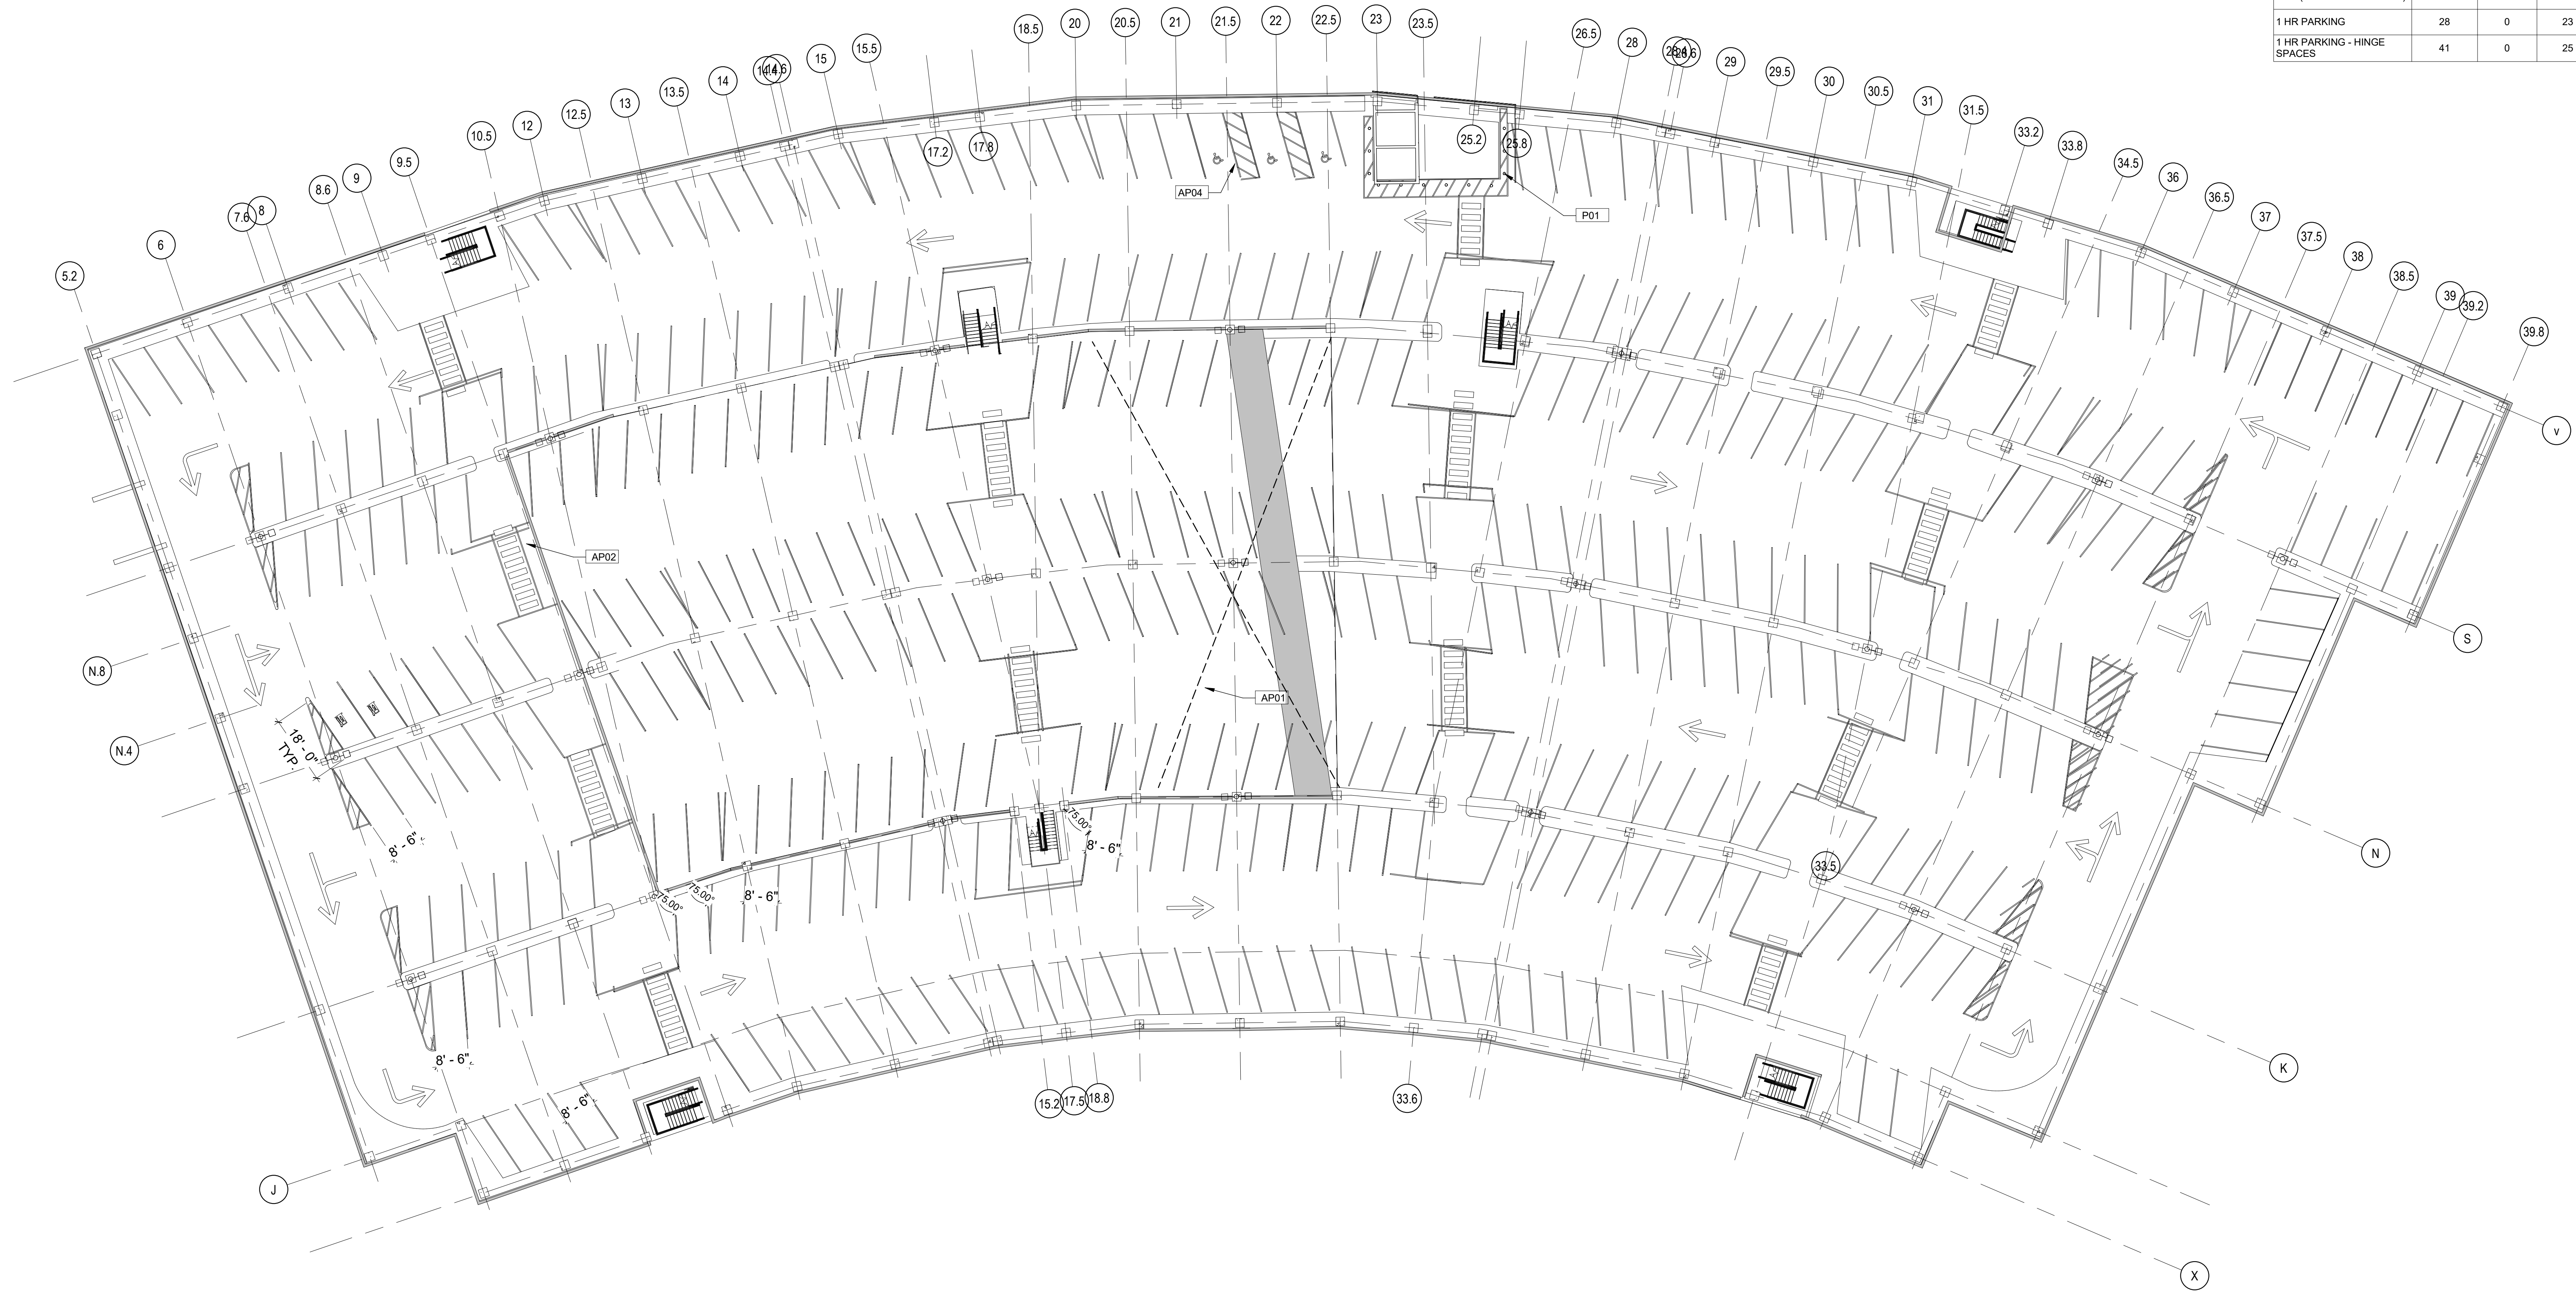

A1 PARKING PLAN - LEVEL D
1" = 20'-0"

GENERAL NOTE

- EXISTING EXPANSION JOINTS TO BE INFILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION.
- REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION.
- REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS, FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE.
- REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES.
- ALL PARKING SPACES ARE 8'-0"X18'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR, VALET, OAV ARE 9'-0"X18'-0" TYPICAL.
- MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE.


SHEET NOTE

- AP01 ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE
 STRIPED PEDESTRIAN WALKWAY. REFER SHEET AE502-900B.
 AP02 REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION
 AP04 REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION
 P01 6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPEBOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.

PARKING NOTES

- ACCESSIBLE PARKING REQUIREMENTS FOR TOTAL COUNT OF 1560**
 REQUIRED ACCESSIBLE SPOTS 25 (33 TOTAL PROVIDED)
 REQUIRED ACCESSIBLE VAN 3 (5 PROVIDED)

KEY PLAN

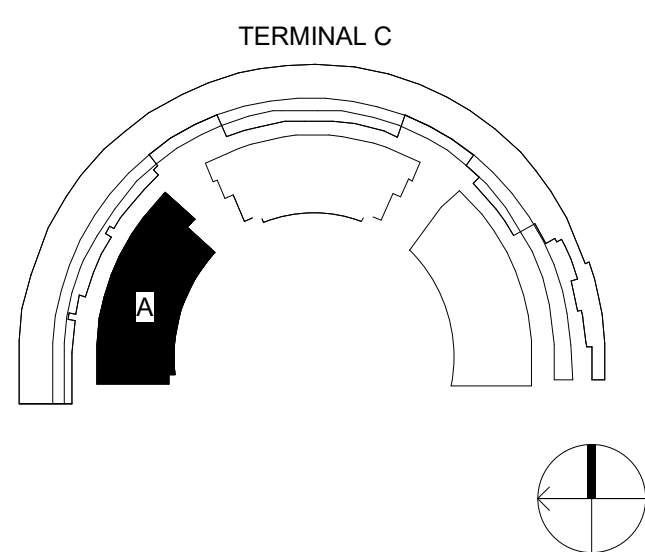

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT



DRAWN BY: Author
 APPROVED BY: Approver
 ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
PARKING PLAN - LEVEL D

PERMIT NUMBER: B22-0022

SHEET NUMBER
AE144-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


PARKING SPACE...	PARKING LEGEND					TOTAL
	LEVEL A...	LEVEL B...	LEVEL C...	LEVEL D...	LEVEL E...	
ACCESSIBLE PARKING	15 (CAR)	2 (CAR)	13 (CAR+8 VAN-5)	3 (CAR)	0	33
EV ACCESSIBLE PARKING	1 (CAR)	0	1 (VAN)	0	0	2
EV PARKING	12	2	12	2	2	30
LIMOUSINE	2	0	2	0	0	4
VALET	0	0	22	0	0	22
OAV (OFF AIRPORT VALET)	7	0	0	0	0	7
1 HR PARKING	28	0	23	0	0	51
1 HR PARKING - HINGE SPACES	41	0	25	0	0	66

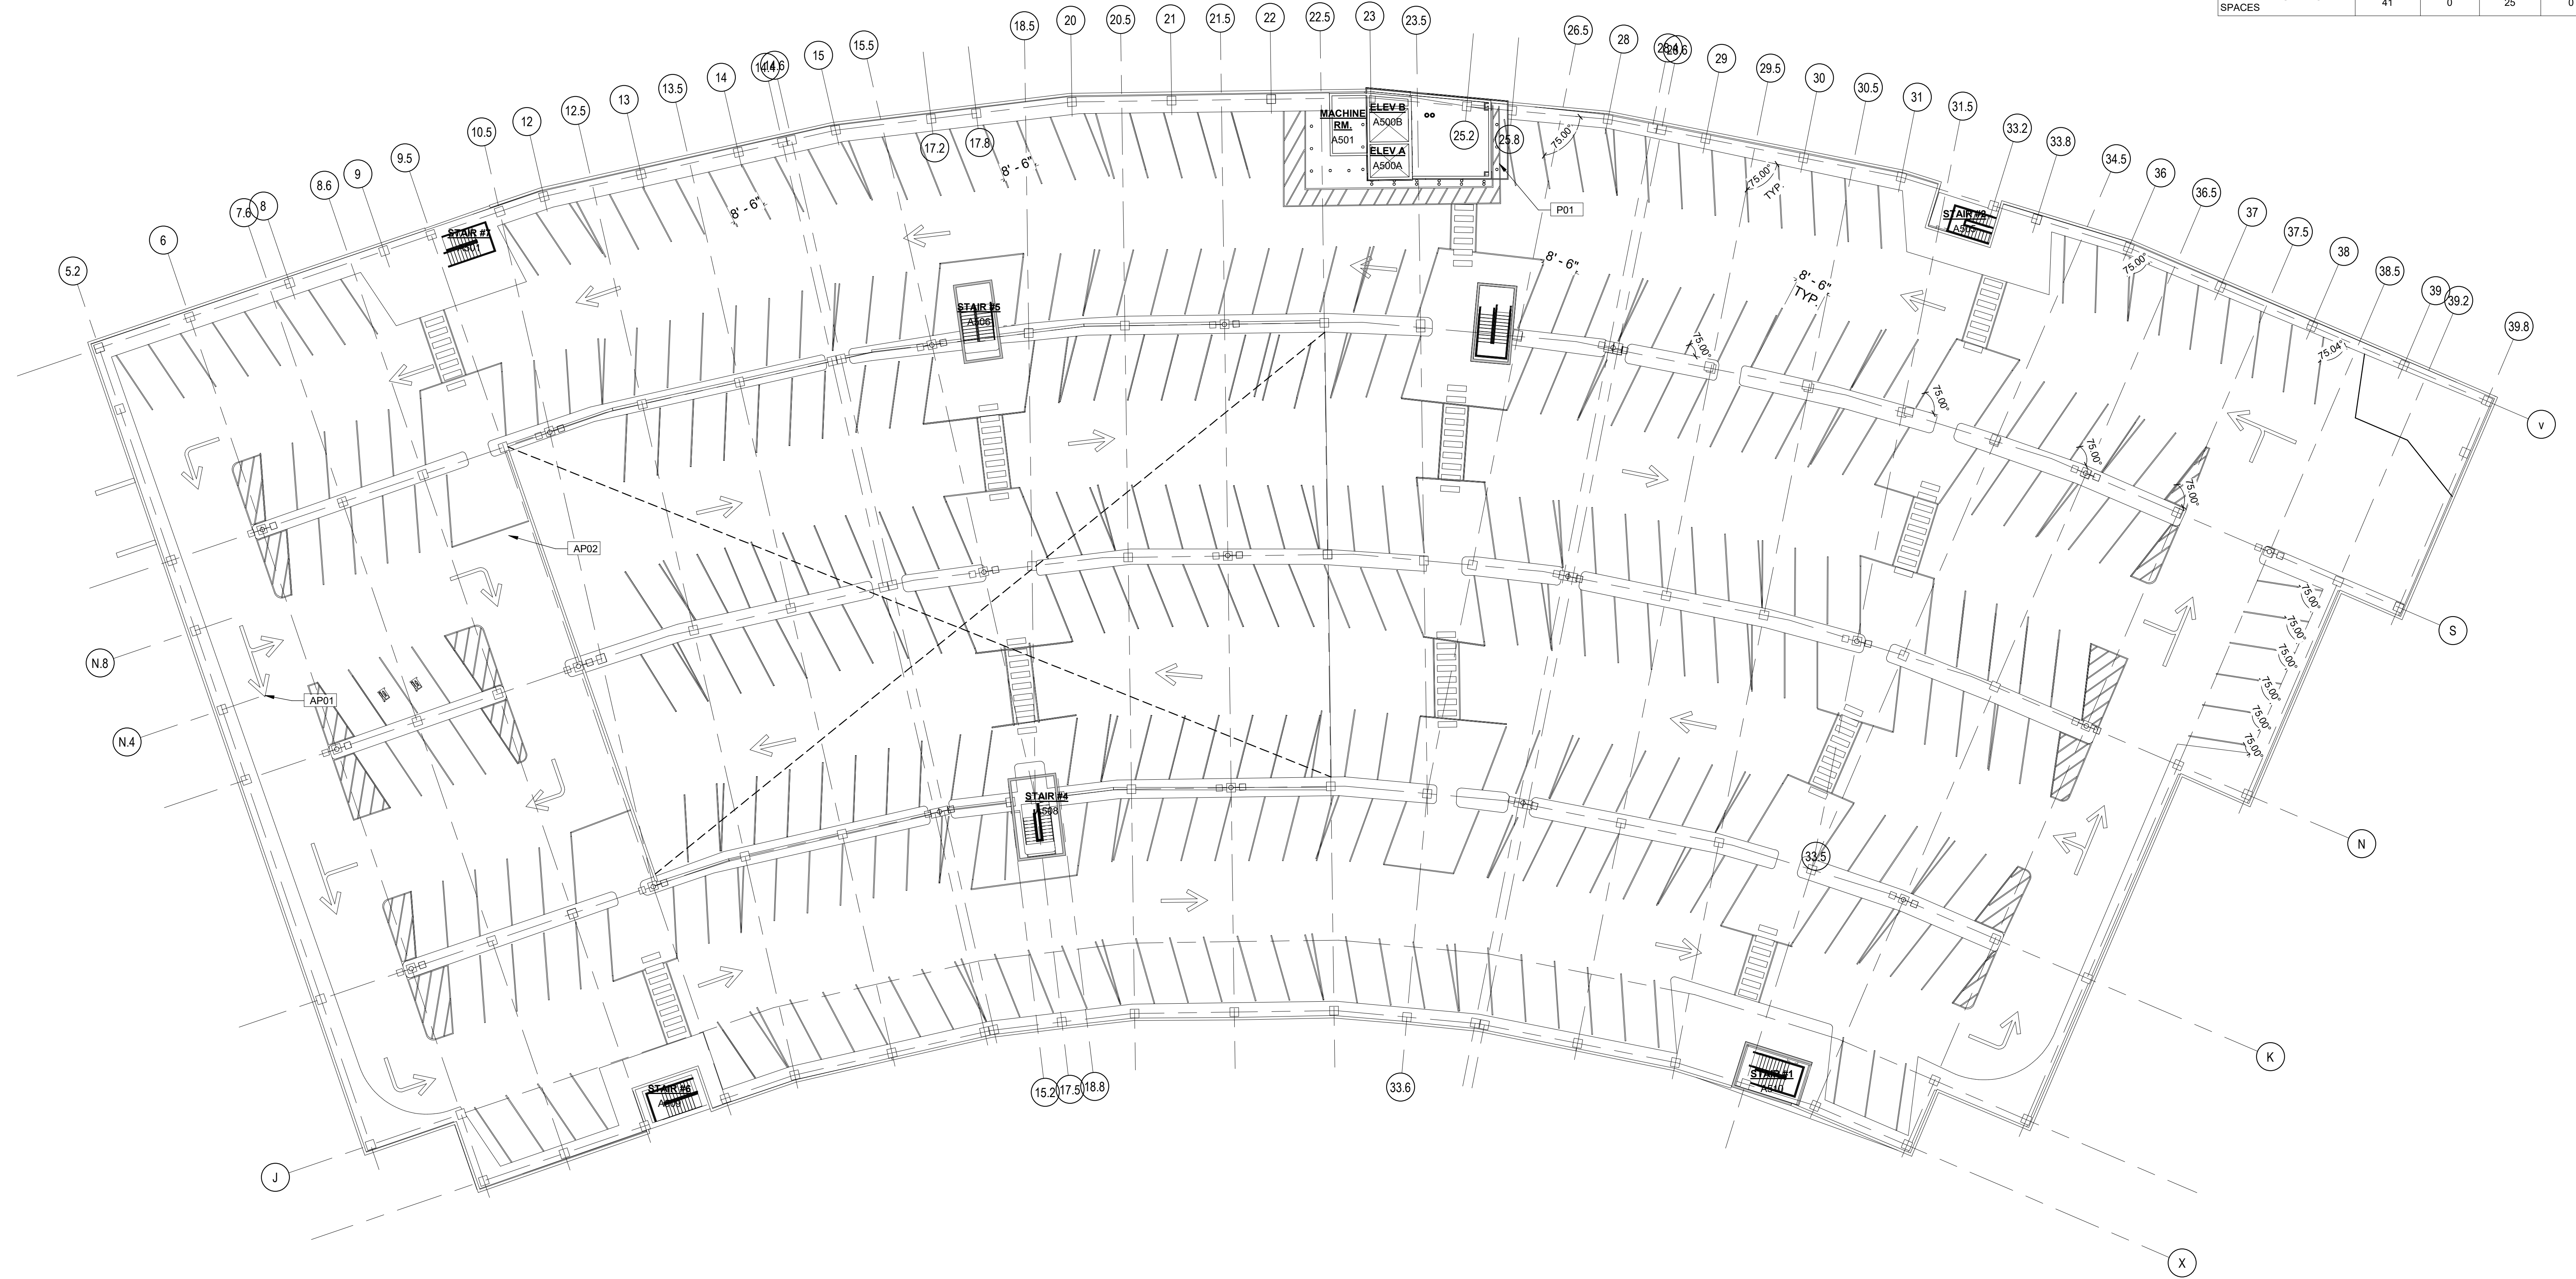

A1 PARKING PLAN - LEVEL E
1" = 20'-0"

SHEET NOTES	KEY NOTES	LEGEND	KEY PLAN
<ol style="list-style-type: none"> EXISTING EXPANSION JOINTS TO BE INFILLED WITH NEW EXPANSION JOINT SYSTEM TO BE COMPATIBLE WITH EXISTING GARAGE CONSTRUCTION. REFER TO SHEET AE140-900C AND AE502-900B FOR ALL ACCESSIBLE SIGNAGE AND STRIPING INFORMATION. REFER TO AG SERIES - WAYFINDING SIGNAGE SHEETS, FOR LOCATIONS AND DETAILS OF WAYFINDING SIGNAGE. REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES. ALL PARKING SPACES ARE 8'-6"x18'-0" TYPICAL, OTHER THAN THE FIRST LANE IN LEVELS A & C, WHERE THE DESIGNATED PARKING - 1HR. VALET, OAV ARE 9'-0"x18'-0" TYPICAL. MAINTAIN 12 VAN ACCESSIBLE SPACES IN GARAGES A & B UNTIL PROJECT IS COMPLETE. 	<p>AP01 AP02 AP04 P01</p> <p>ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE STRIPED PEDESTRIAN WALKWAY REFER TO SHEET AE140-900C FOR ALL ACCESSIBLE SIGNAGE INFORMATION 6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPEBOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.</p>	<p>ACCESSIBLE PARKING REQUIREMENTS FOR TOTAL COUNT OF 1560</p> <p>REQUIRED ACCESSIBLE SPOTS 25 (33 TOTAL PROVIDED) REQUIRED ACCESSIBLE VAN 3 (5 PROVIDED)</p>	

<p>DALLAS FORT WORTH INTERNATIONAL AIRPORT</p>	<p>2330 N INTERNATIONAL PARKWAY DFW AIRPORT, TX 75261</p>		<p>Heldrich, Clark & Koenigsmann, Inc. 771 North River Street Suite 200, LB # Dallas, TX 75201 1-214-722-6000</p>	<p>McAfee³ ARCHITECTURE+DESIGN</p> <p>McAfee3 Architecture, Inc. 8000 Forest Lane Suite 213 Dallas, TX 75243 1-469-920-9444</p>	<p>DRAWN BY: Author APPROVED BY: Approver ISSUE DATE: 2022-07-28</p>	<table border="1"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>2022-08-01</td> <td>100% DESIGN</td> </tr> <tr> <td>2</td> <td>2022-07-28</td> <td>100% ISSUED FOR PERMIT (IFP)</td> </tr> </tbody> </table>	NO.	DATE	DESCRIPTION	1	2022-08-01	100% DESIGN	2	2022-07-28	100% ISSUED FOR PERMIT (IFP)	<p>DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A PARKING PLAN - LEVEL E</p>	<p>SHEET NUMBER AE145-900A</p>
					NO.	DATE	DESCRIPTION										
1	2022-08-01	100% DESIGN															
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)															
<p>PROJECT NUMBER: TFD-007</p>					<p>PERMIT NUMBER: B22-0022</p>	<p>SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.</p>											

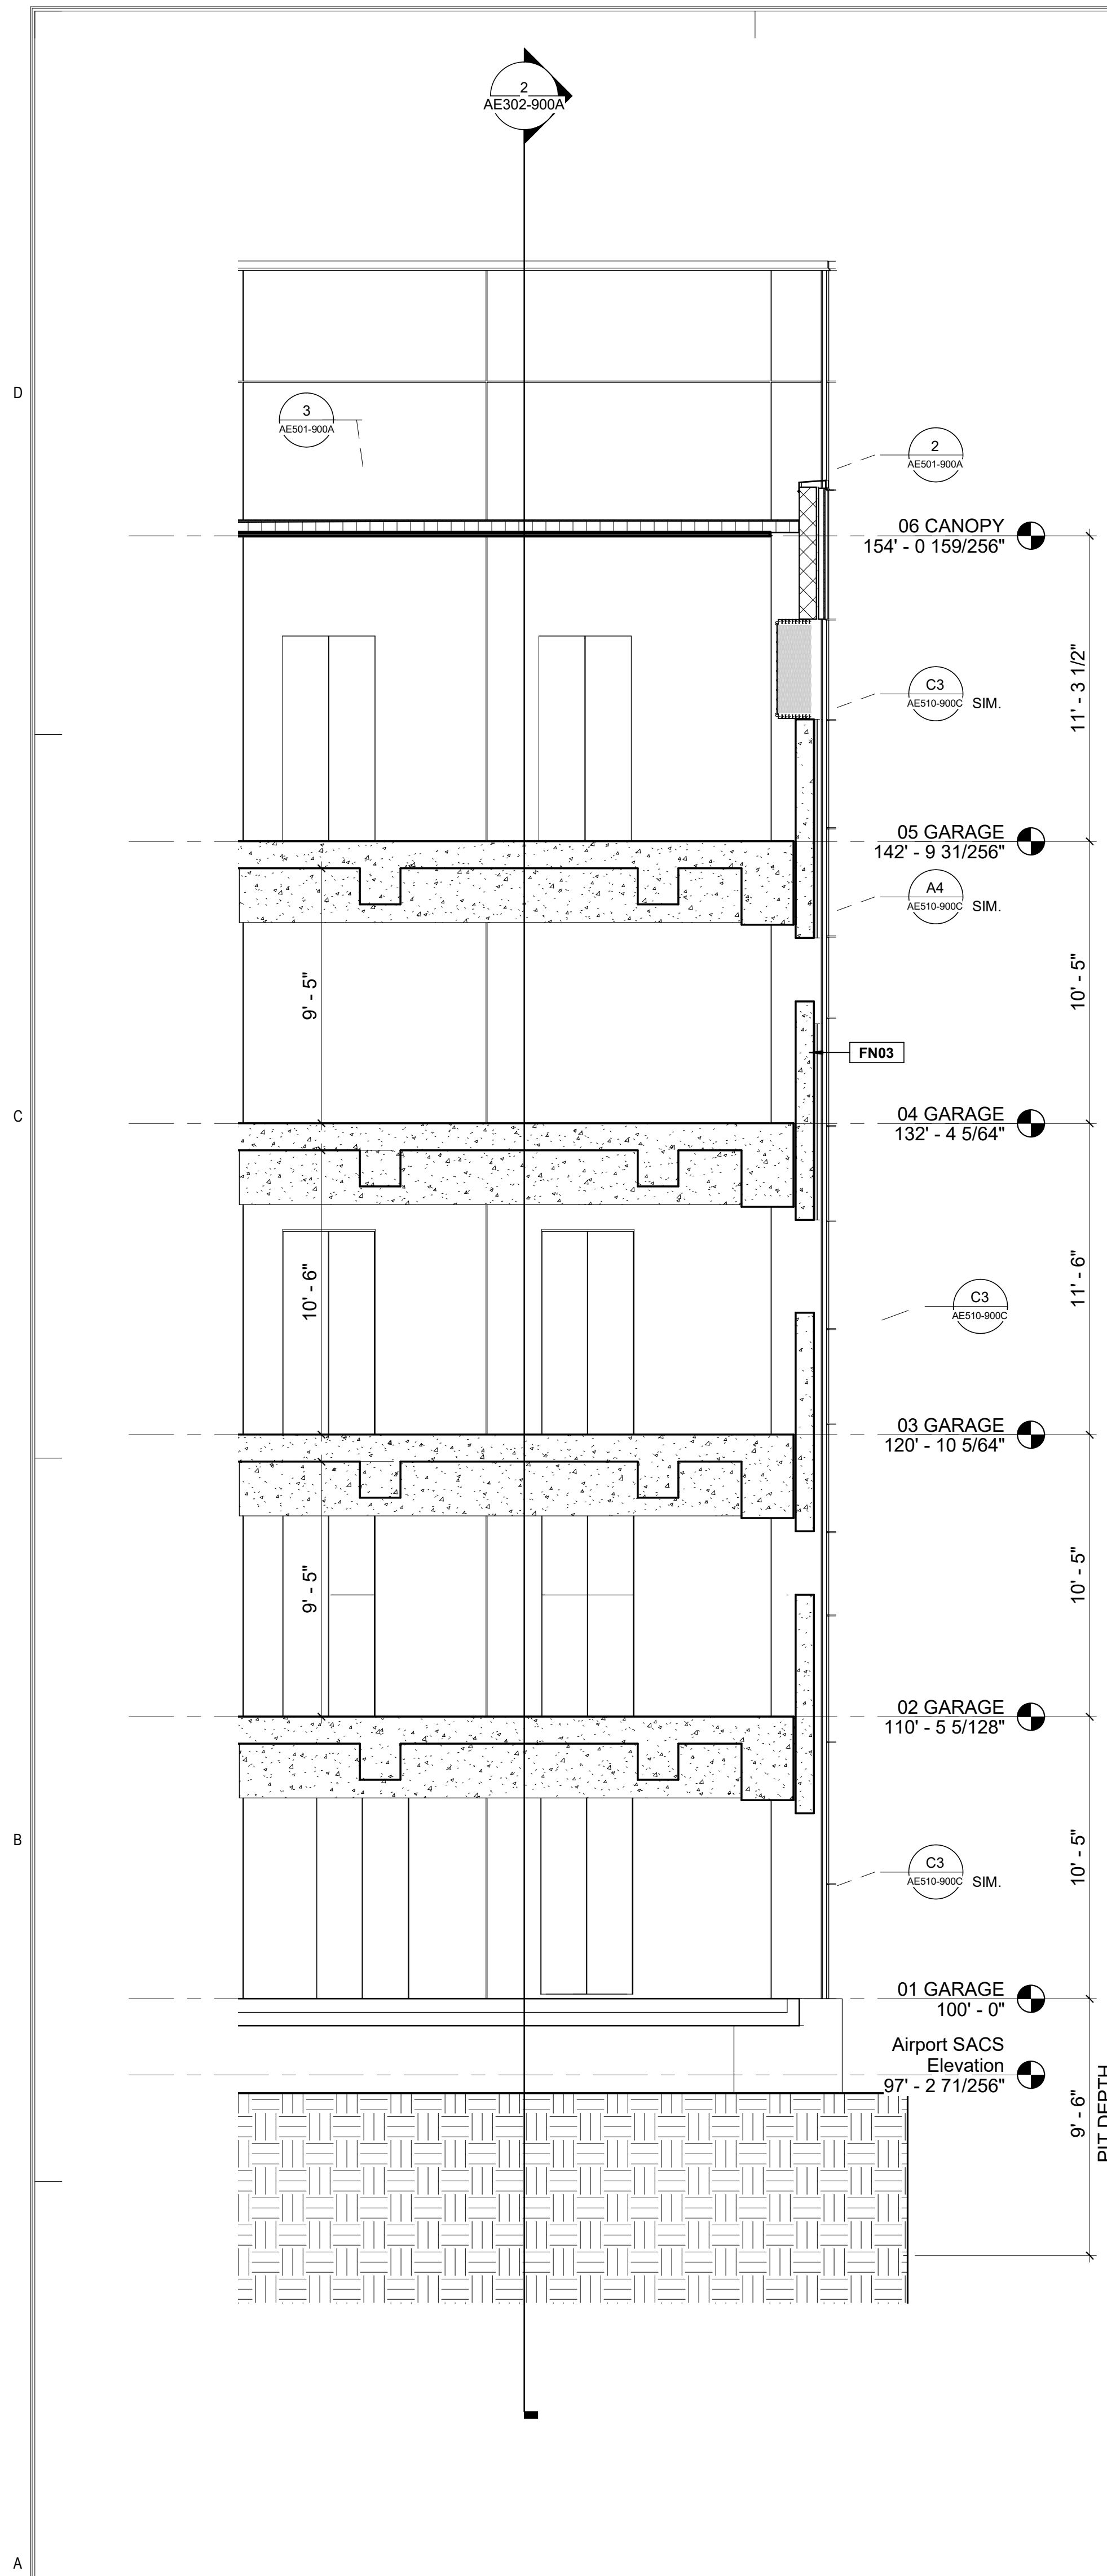


GENERAL NOTE

SHEET NOTE

Key Value	Keynote Text
FN03	BURNISHED CONCRETE MASONRY UNIT WALL (CMU-1). REFER FINISH SCHEDULE.

LEGEND

KEY PLAN

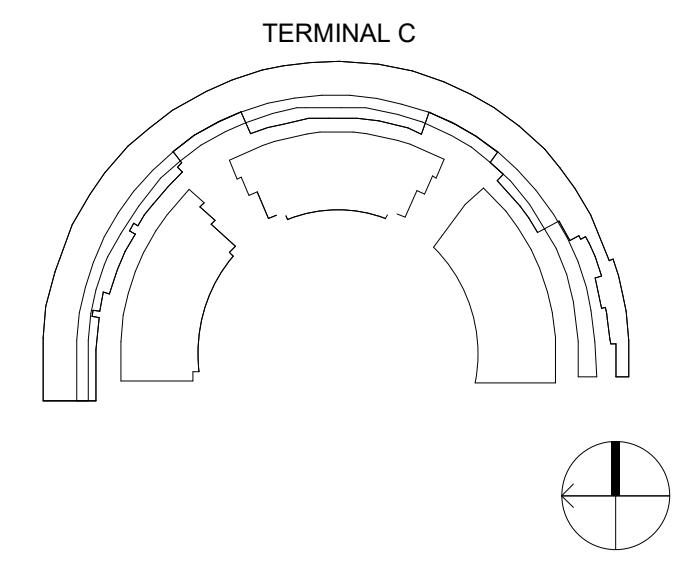

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k

McAfee³
ARCHITECTURE+DESIGN

Helmuth, Obata & Kassabaum, Inc.
177 North Harvard Street
Suite 2000, L.R.F.
Dallas, TX 75201
1-714-720-6000

McAfee3 Architecture, Inc.
6530 Grand Lane
Suite 213
Dallas, TX 75243
1-489-920-8444

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE:	DESCRIPTION:
	2022-07-28	100% ISSUED FOR PERMIT (IFP)


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
PARTIAL EXTERIOR ELEVATION

PROJECT NUMBER: TFD-007


PERMIT NUMBER: B22-0022

SHEET NUMBER
AE203-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

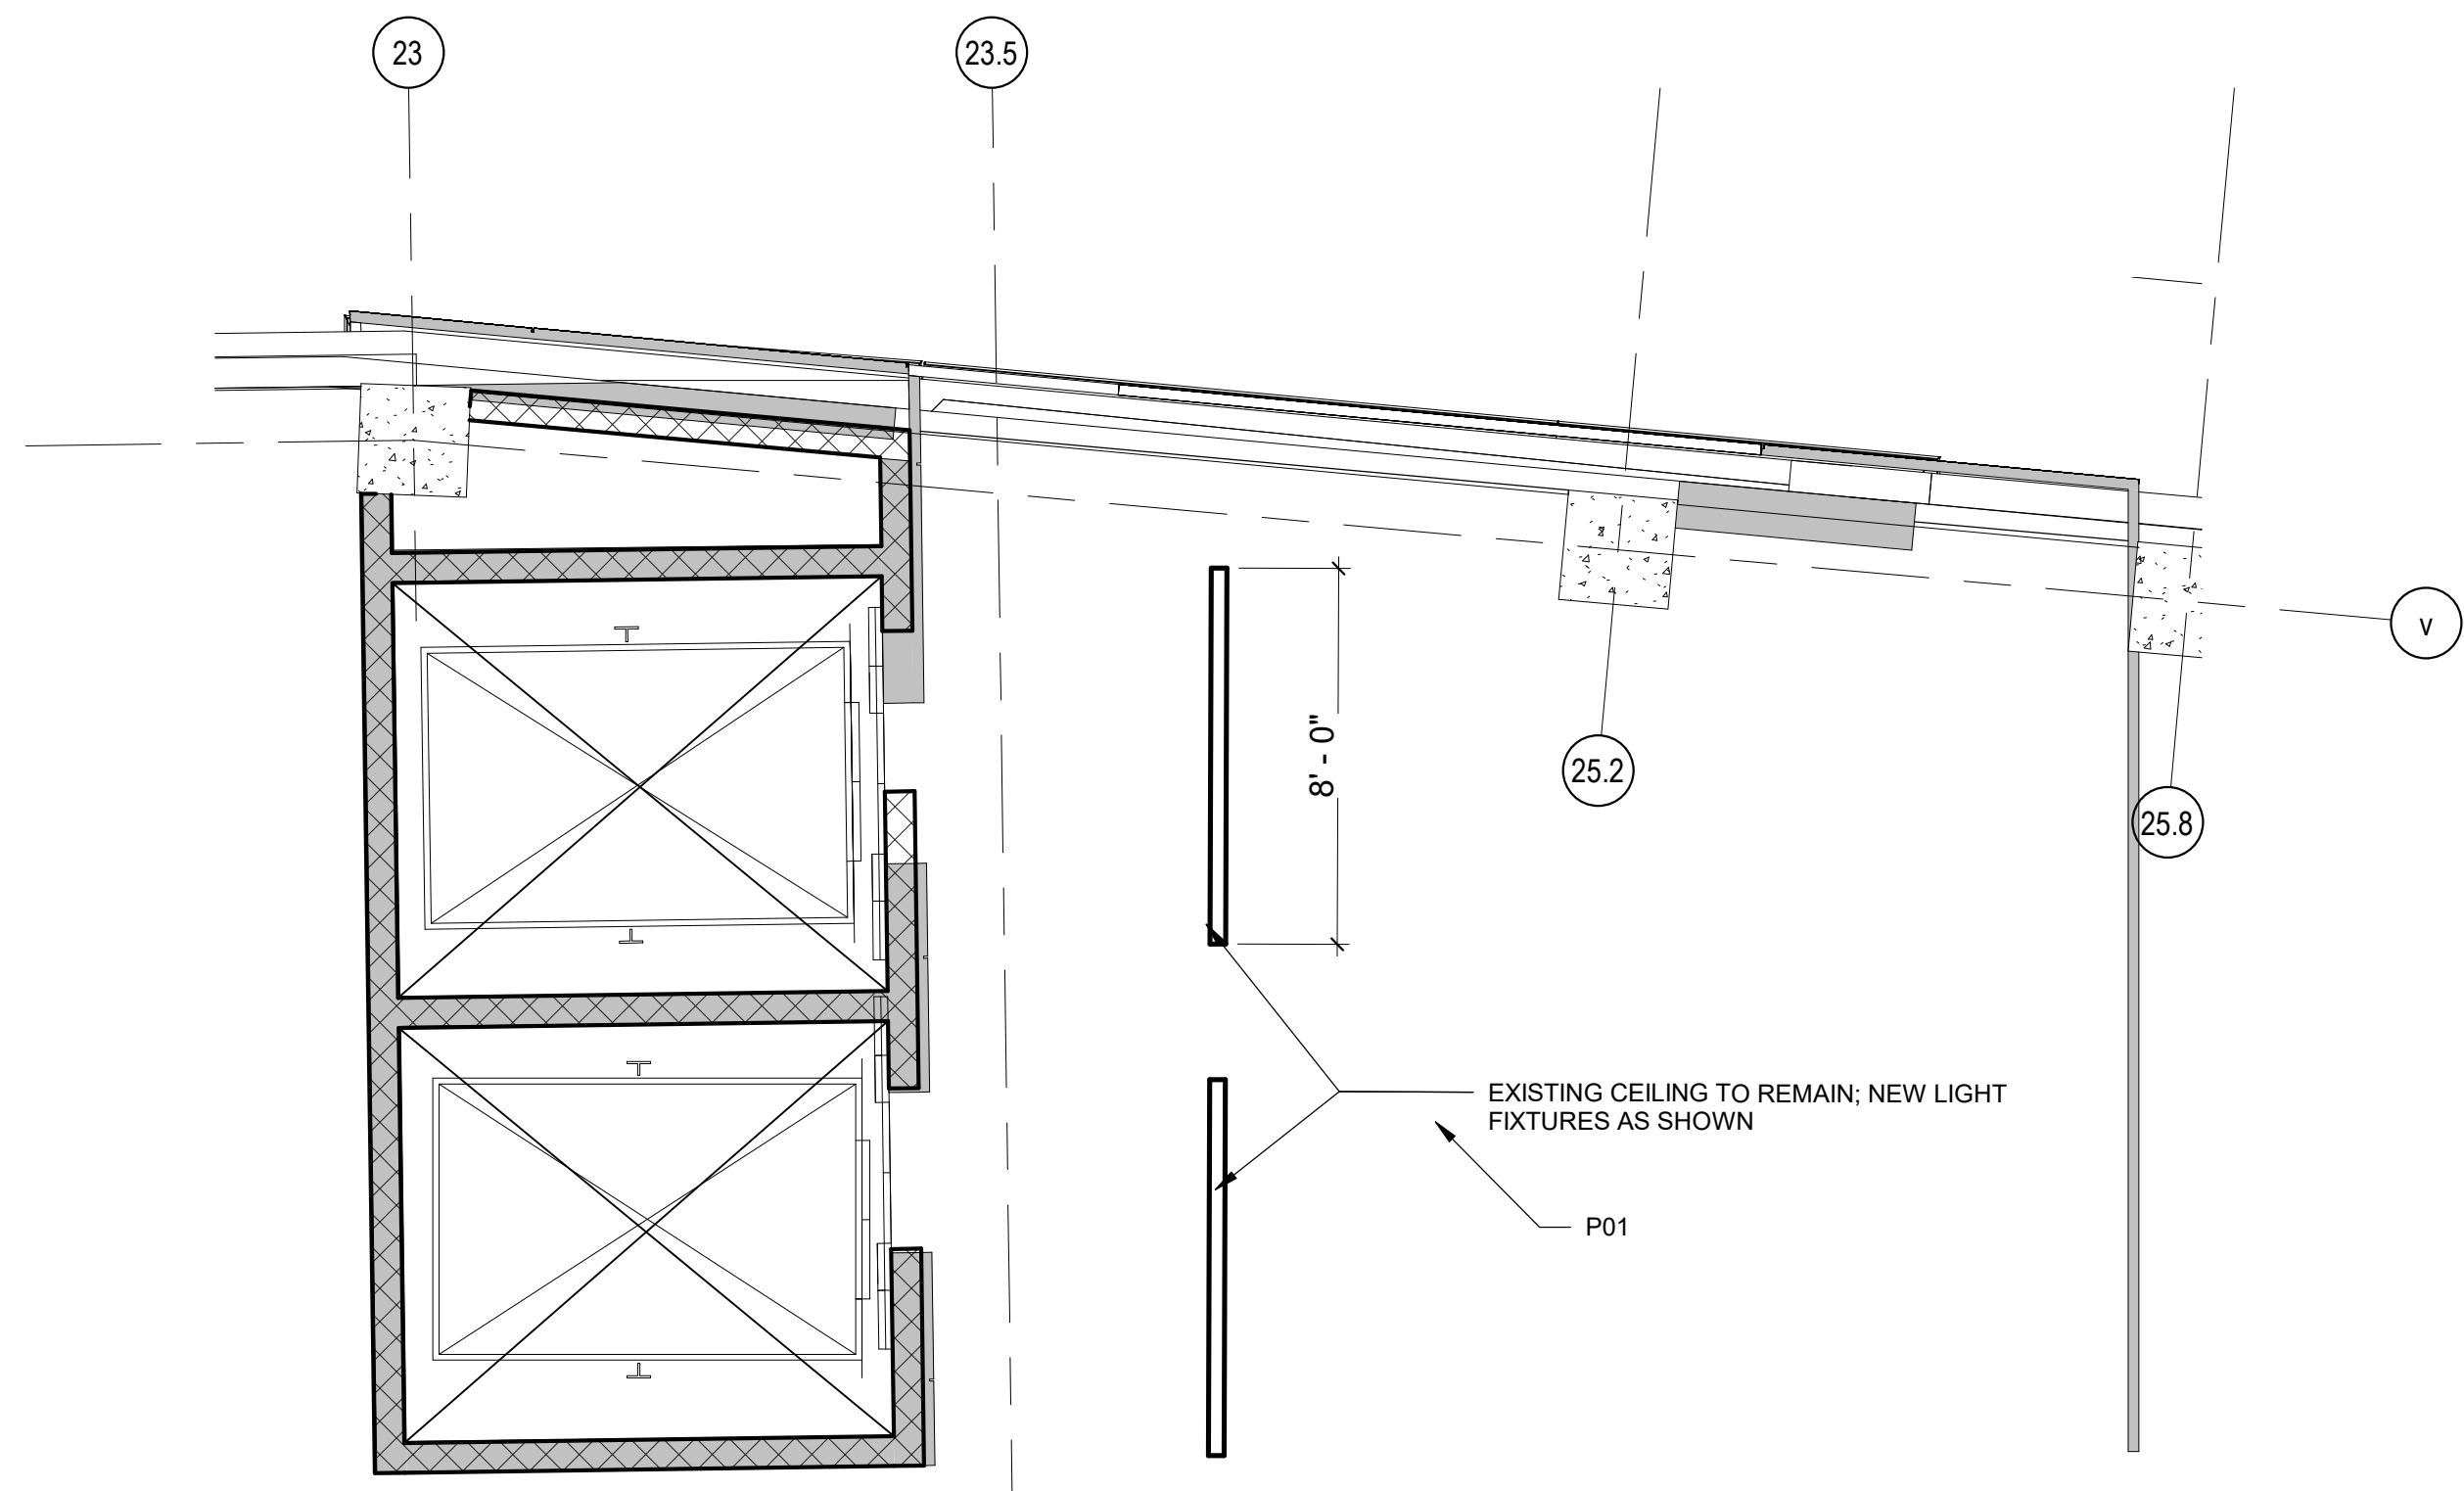

2 ENLARGED ELEVATOR LOBBY RCP - LEVELS A & C
1/4" = 1'-0"

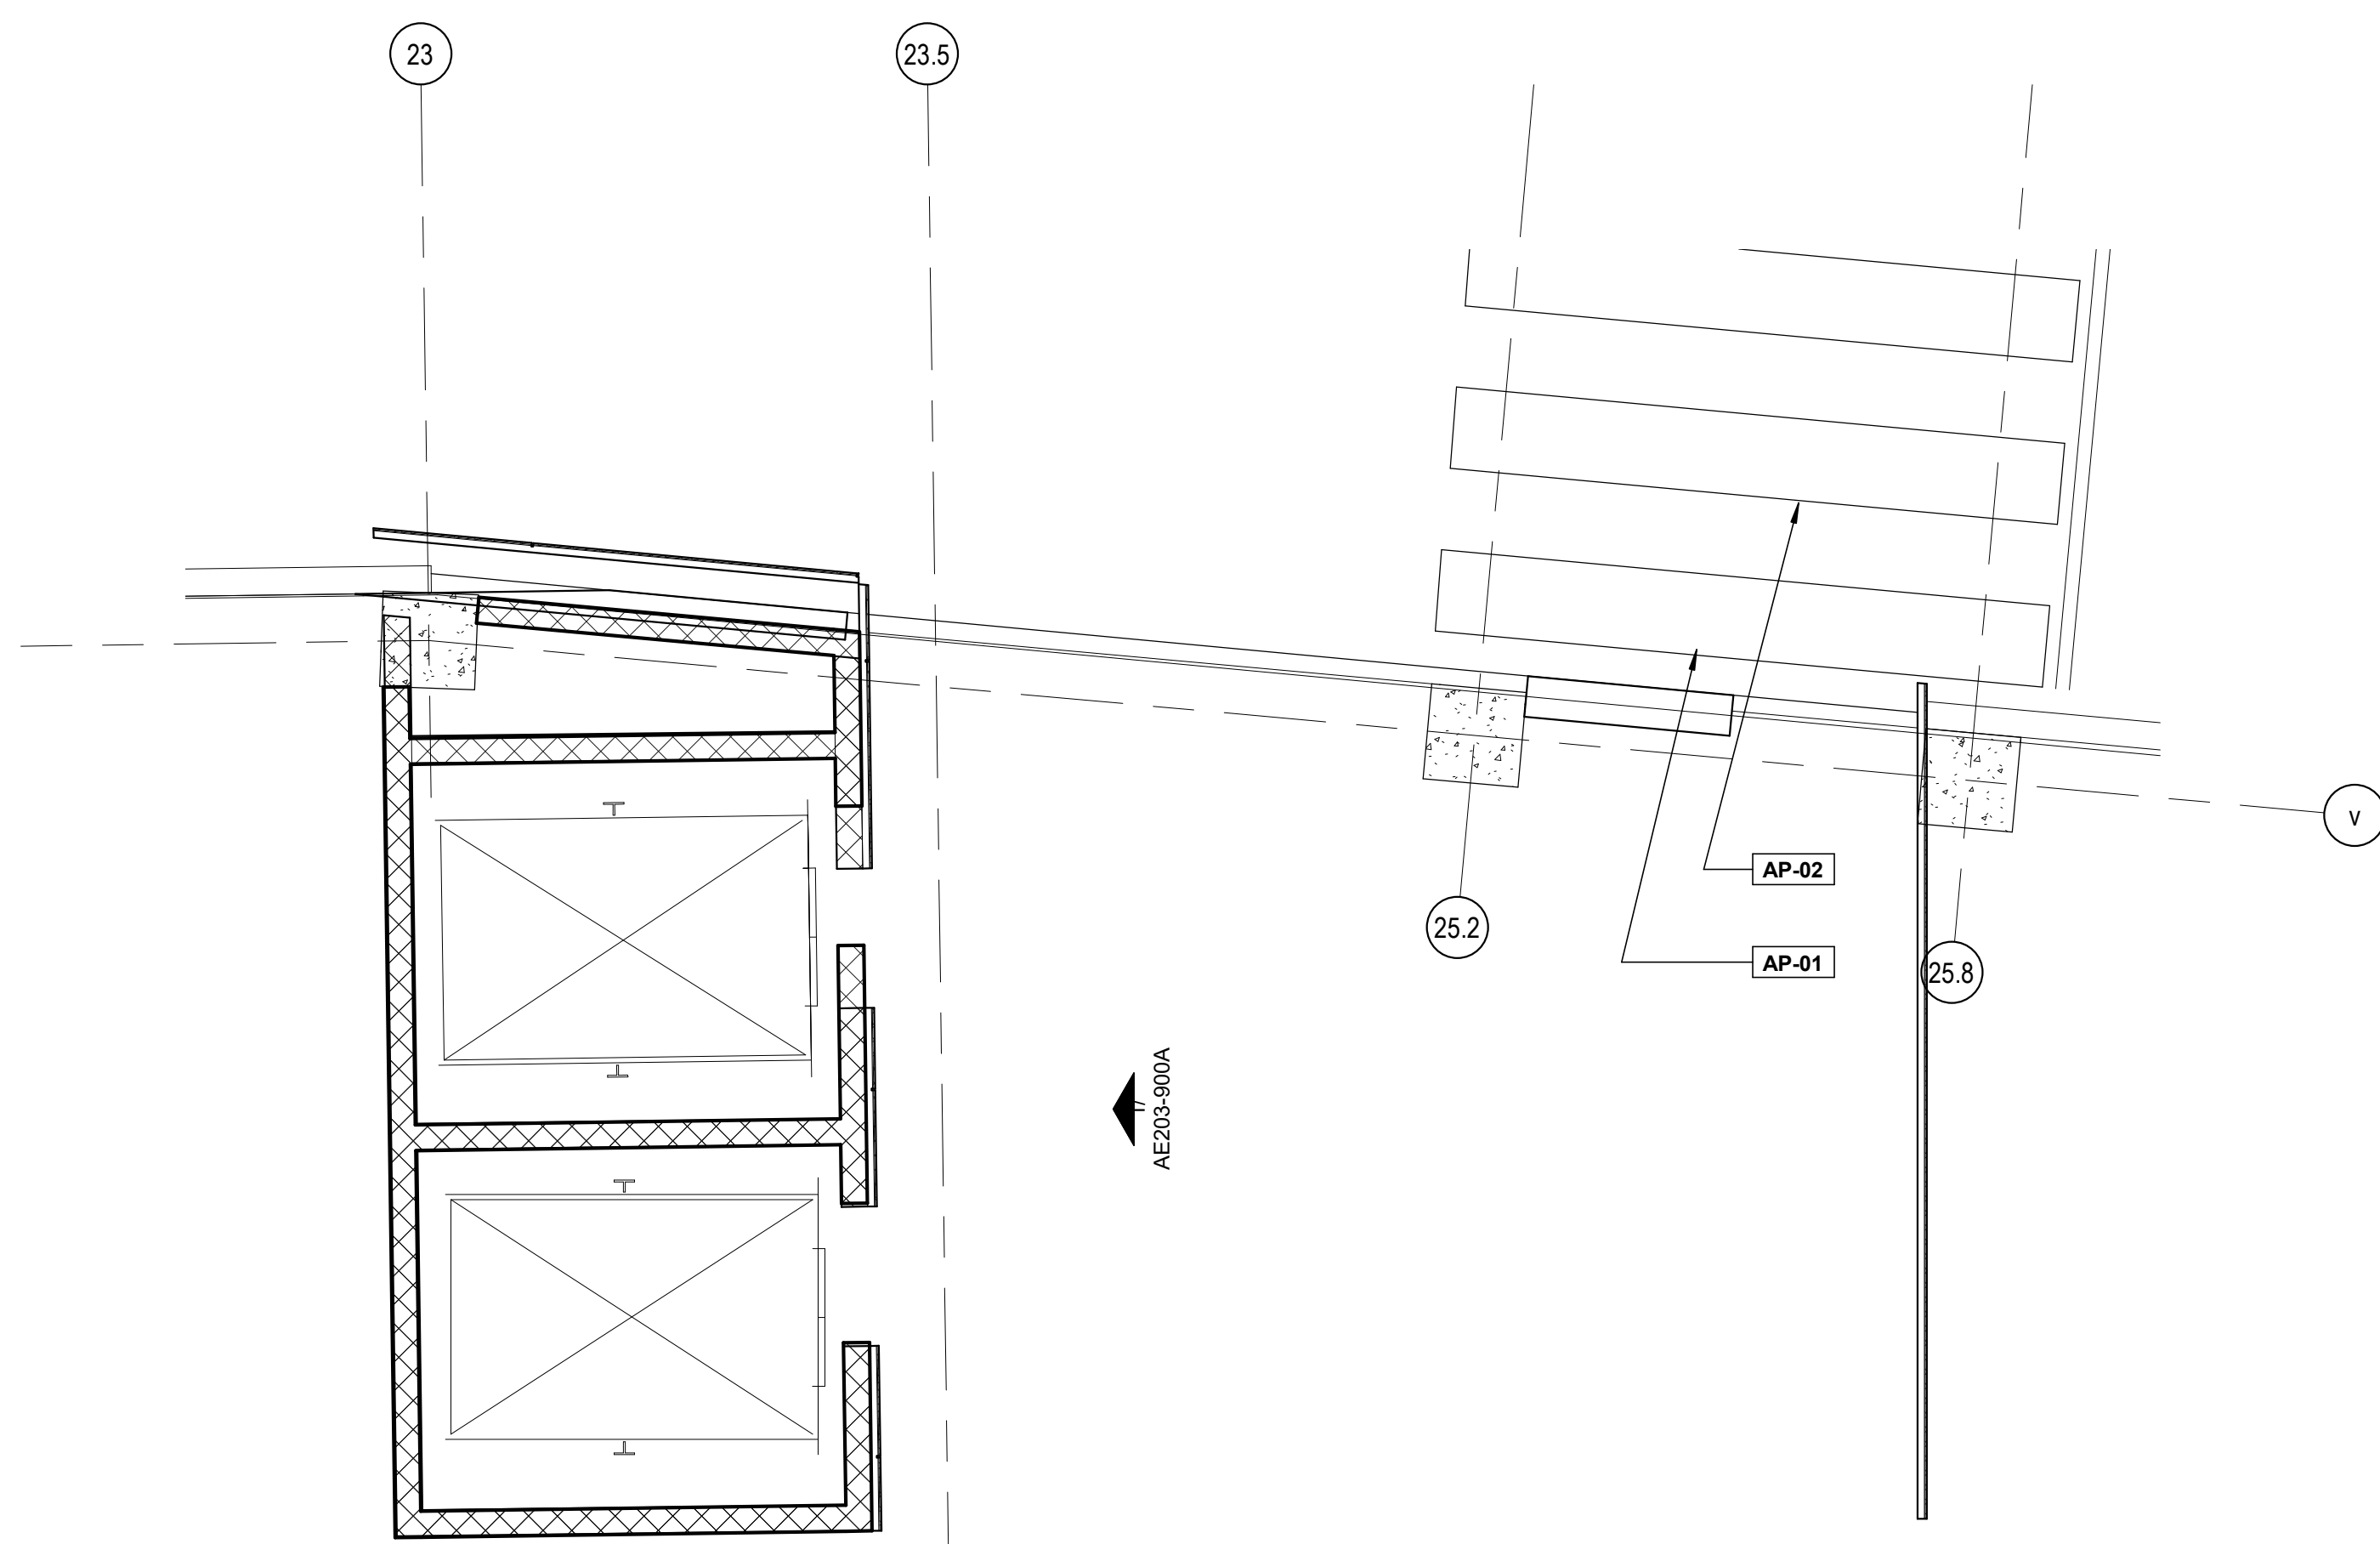


1 ENLARGED ELEVATOR LOBBY FLOOR PLAN - LEVELS A & C
1/4" = 1'-0"

GENERAL NOTE KEY NOTES LEGEND KEY PLAN


GENERAL NOTE

Key Value	Keynote Text
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-02	STRIPED PEDESTRIAN WALKWAY

LEGEND

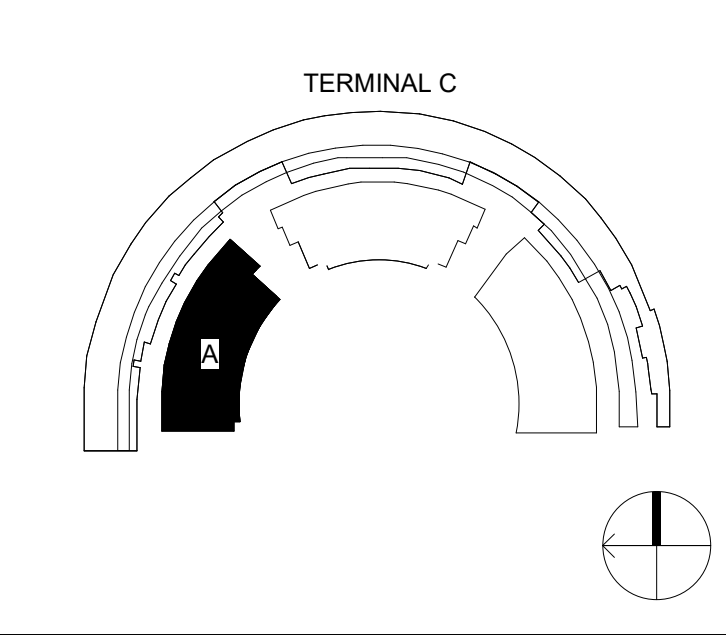

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

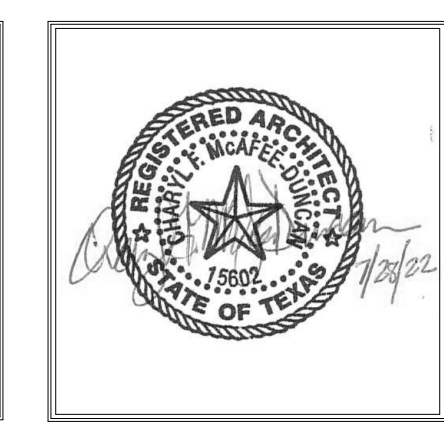

h+k **McAfee³**
ARCHITECTURE+DESIGN
McAfee Architects, Inc.
6505 Forest Lane
Suite 213
Dallas, TX 75243
+1 469 500 9444

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
ENLARGED ELEVATOR LOBBY PLANS - LEVELS A & C
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022

SHEET NUMBER
AE401-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

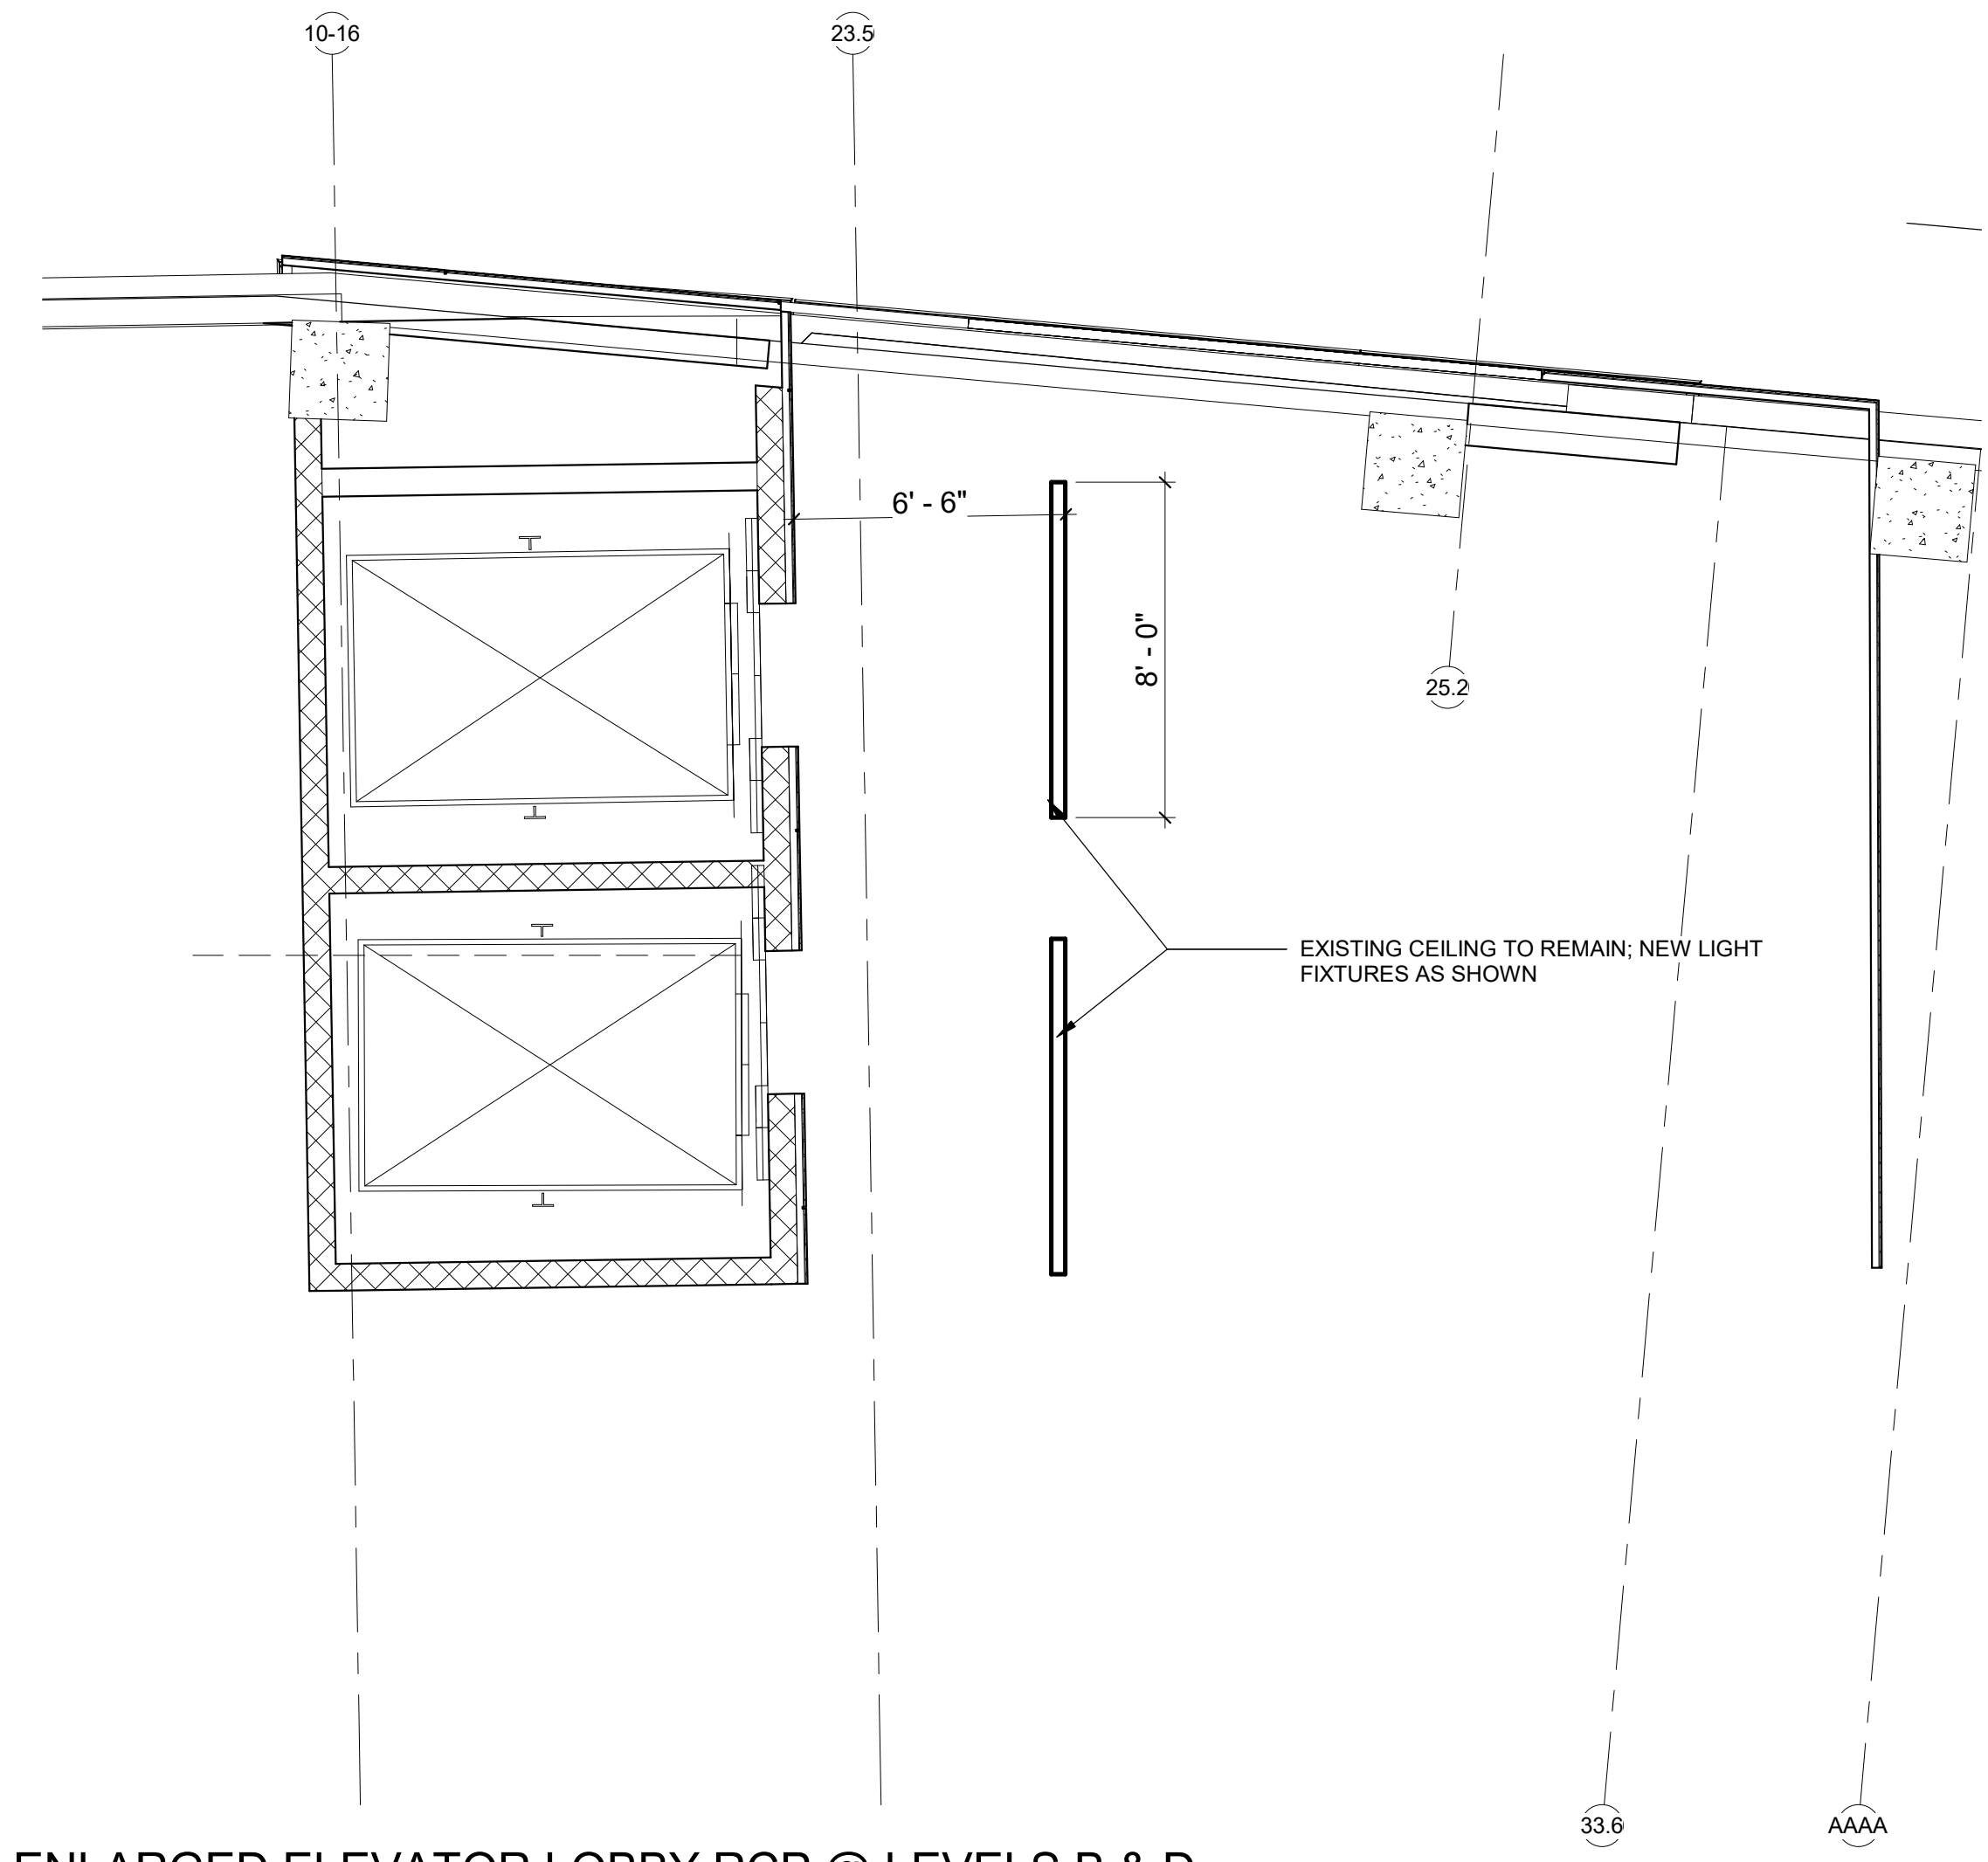

2 ENLARGED ELEVATOR LOBBY RCP @ LEVELS B & D
1/4" = 1'-0"

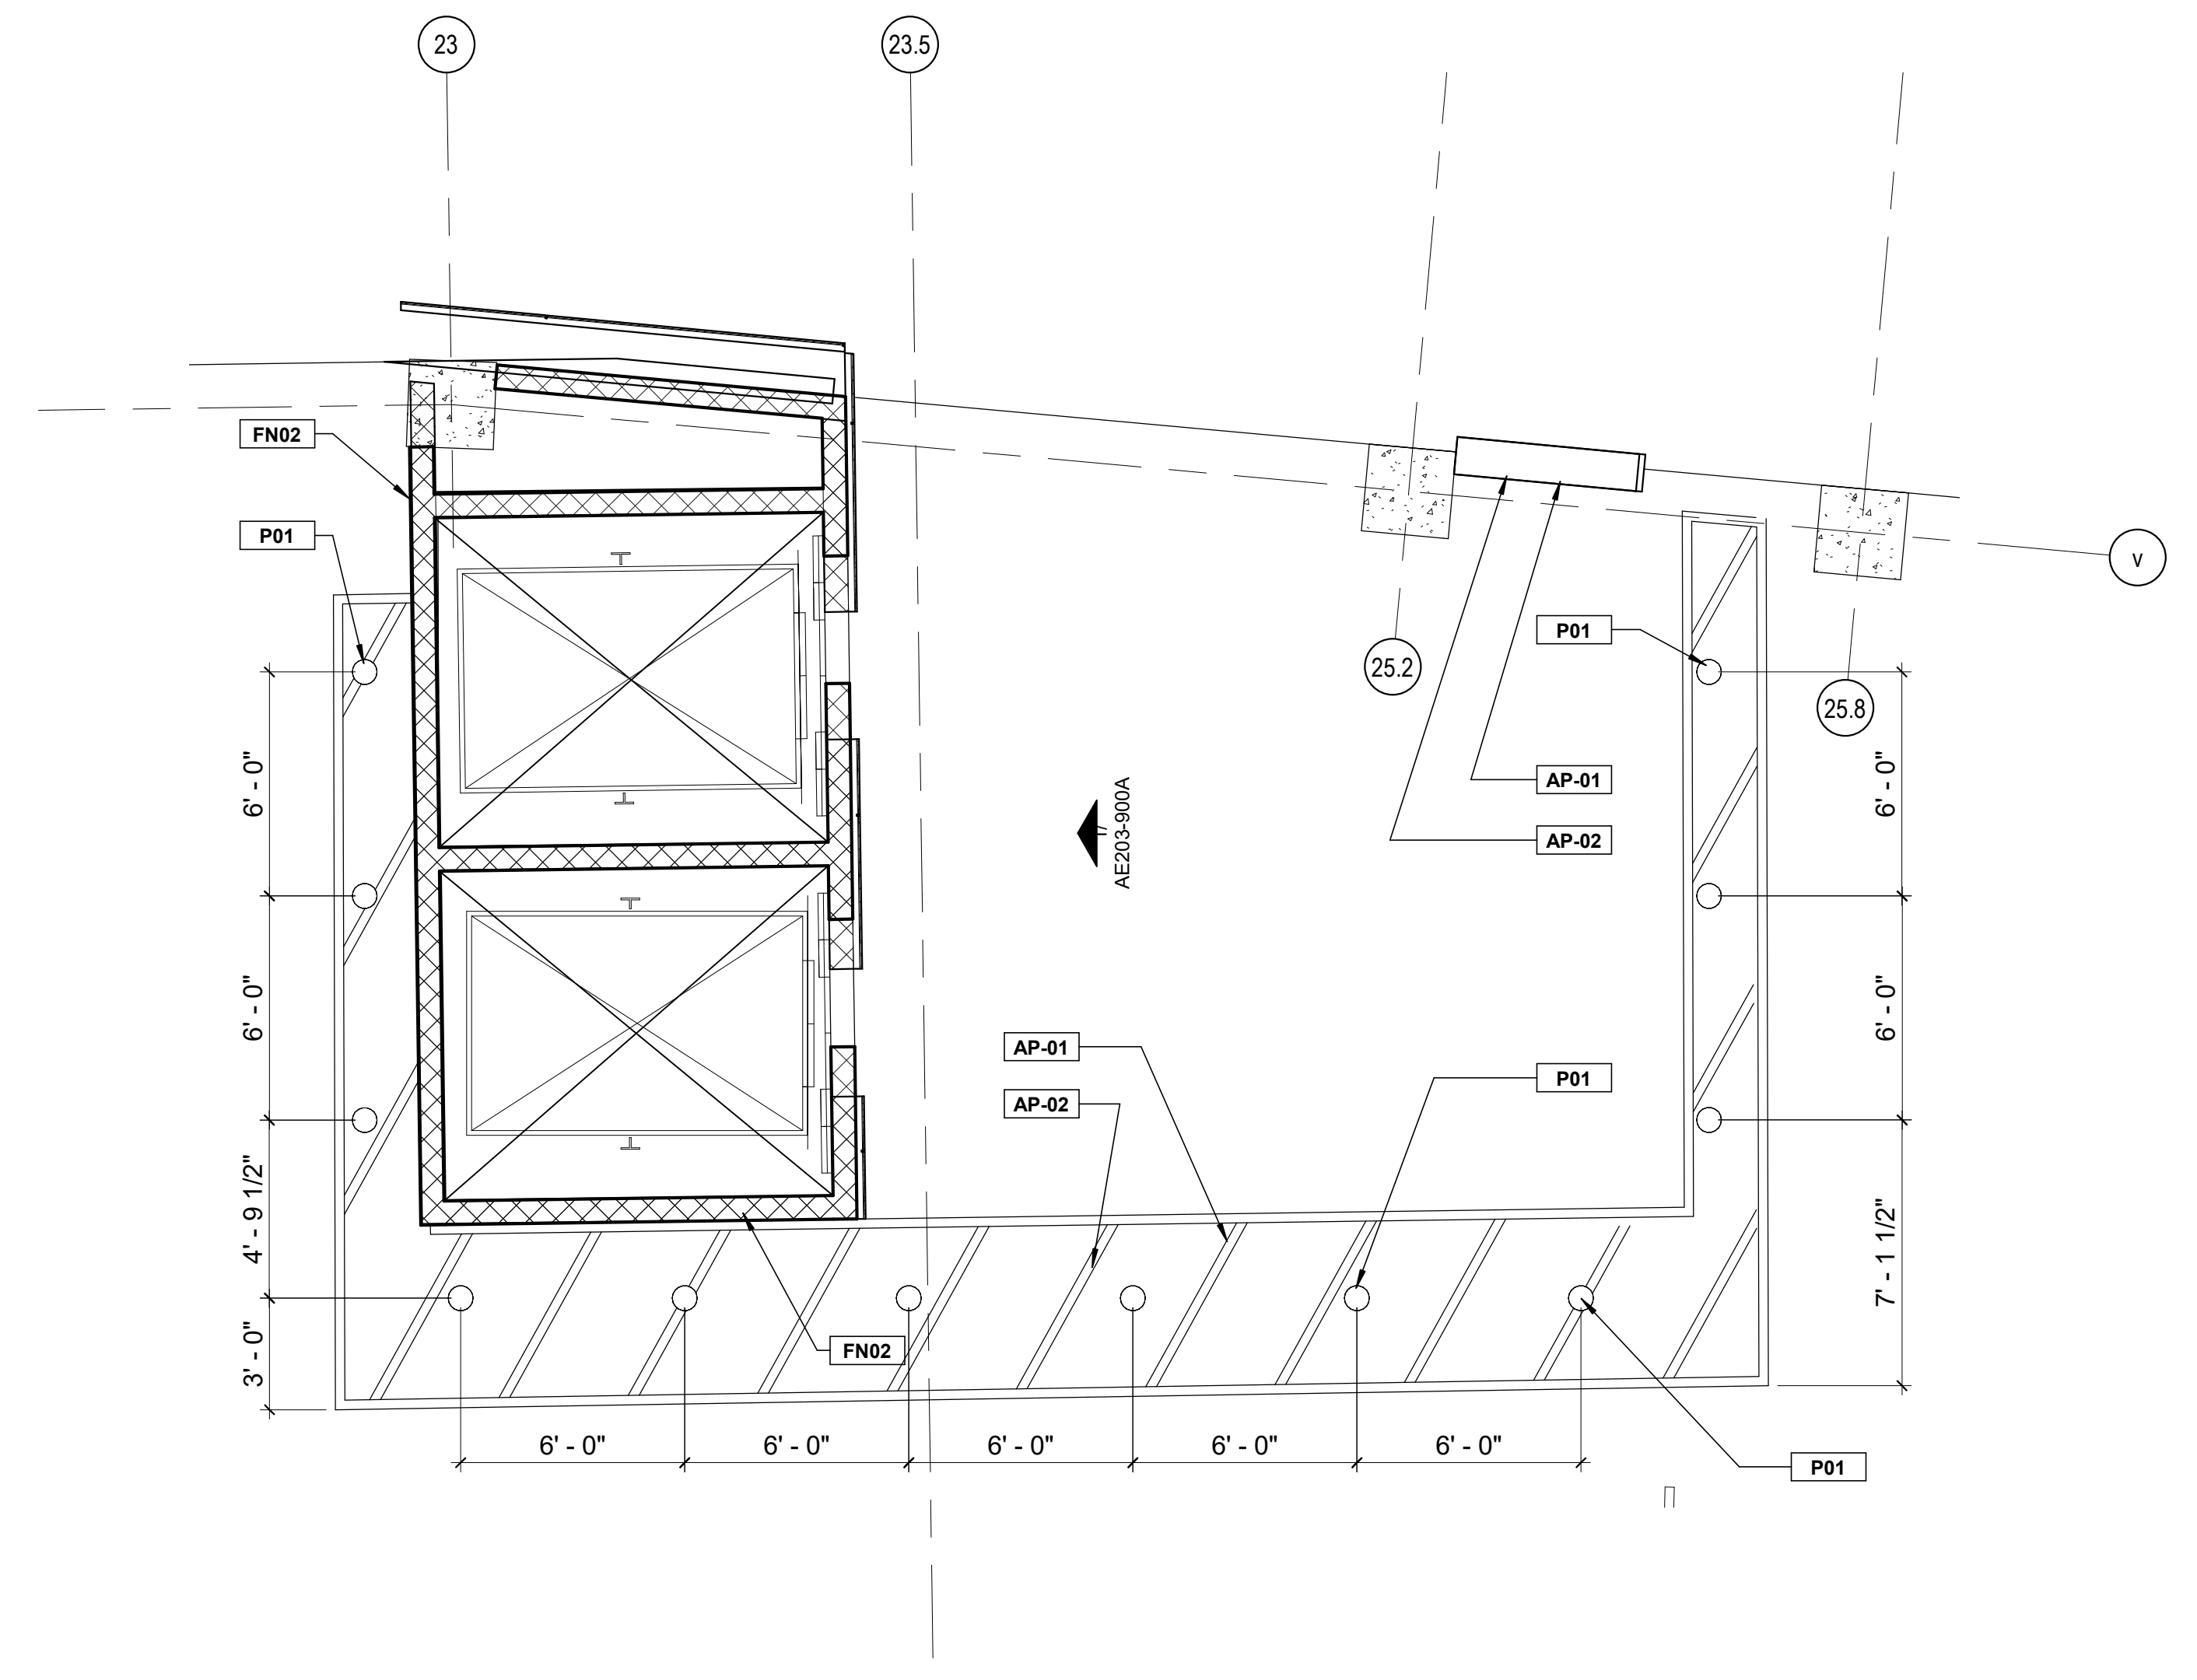

1 ENLARGED ELEVATOR LOBBY FLOOR PLAN - LEVELS B & D
1/4" = 1'-0"


GENERAL NOTE

SHEET NOTE

PARKING NOTES

KEY PLAN

Key Value	Keynote Text
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-02	STRIPED PEDESTRIAN WALKWAY
FN02	METAL COMPOSITE MATERIAL WALL PANEL SYSTEM (ACM-1)
P01	6" DIA. X 36" HIGH CONCRETE-FILLED STEEL PIPE BOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.

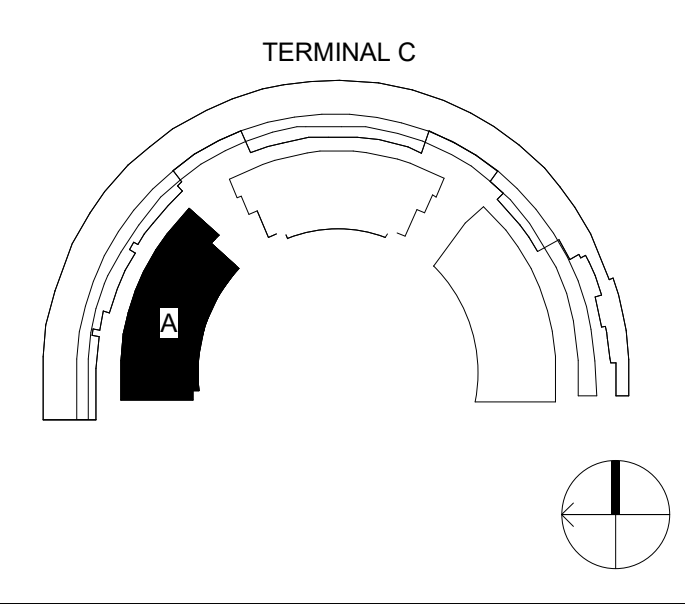

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
ENLARGED ELEVATOR LOBBY PLANS - LEVELS B & D

PROJECT NUMBER: TFD-007


PERMIT NUMBER: B22-0022

SHEET NUMBER
AE402-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

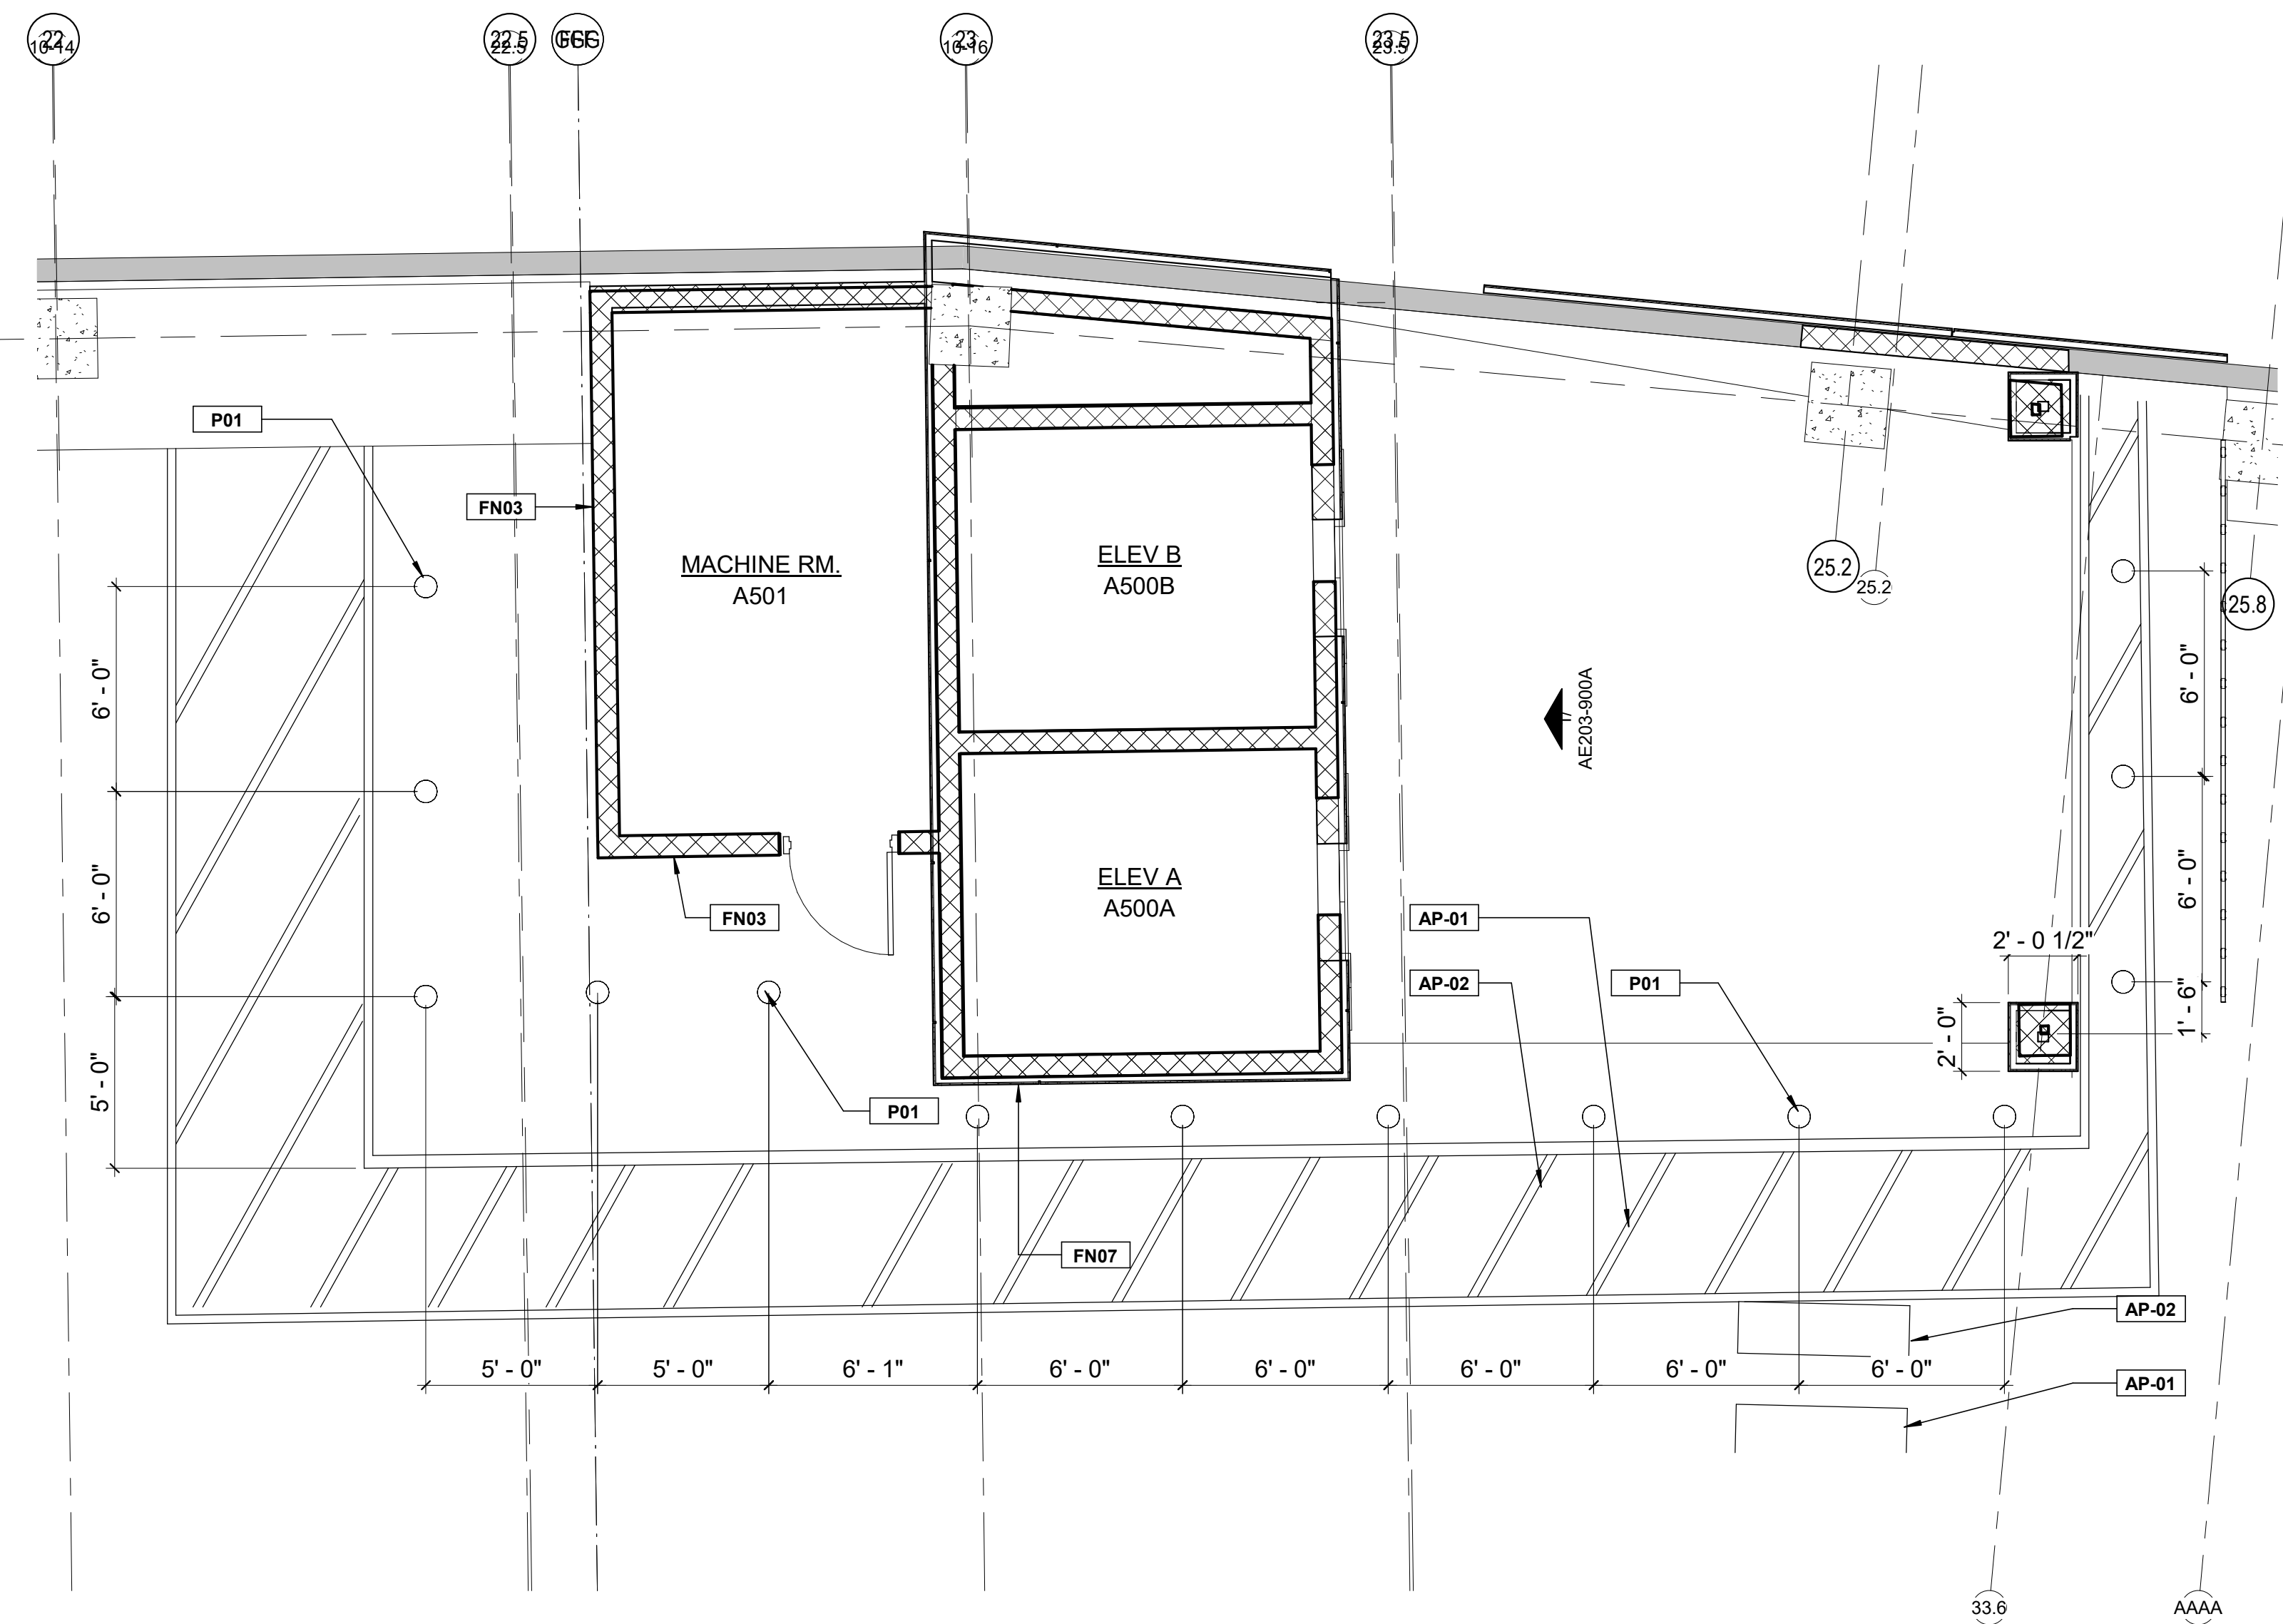

2 ENLARGED ELEVATOR LOBBY PLAN - LEVEL E
1/4" = 1'-0"

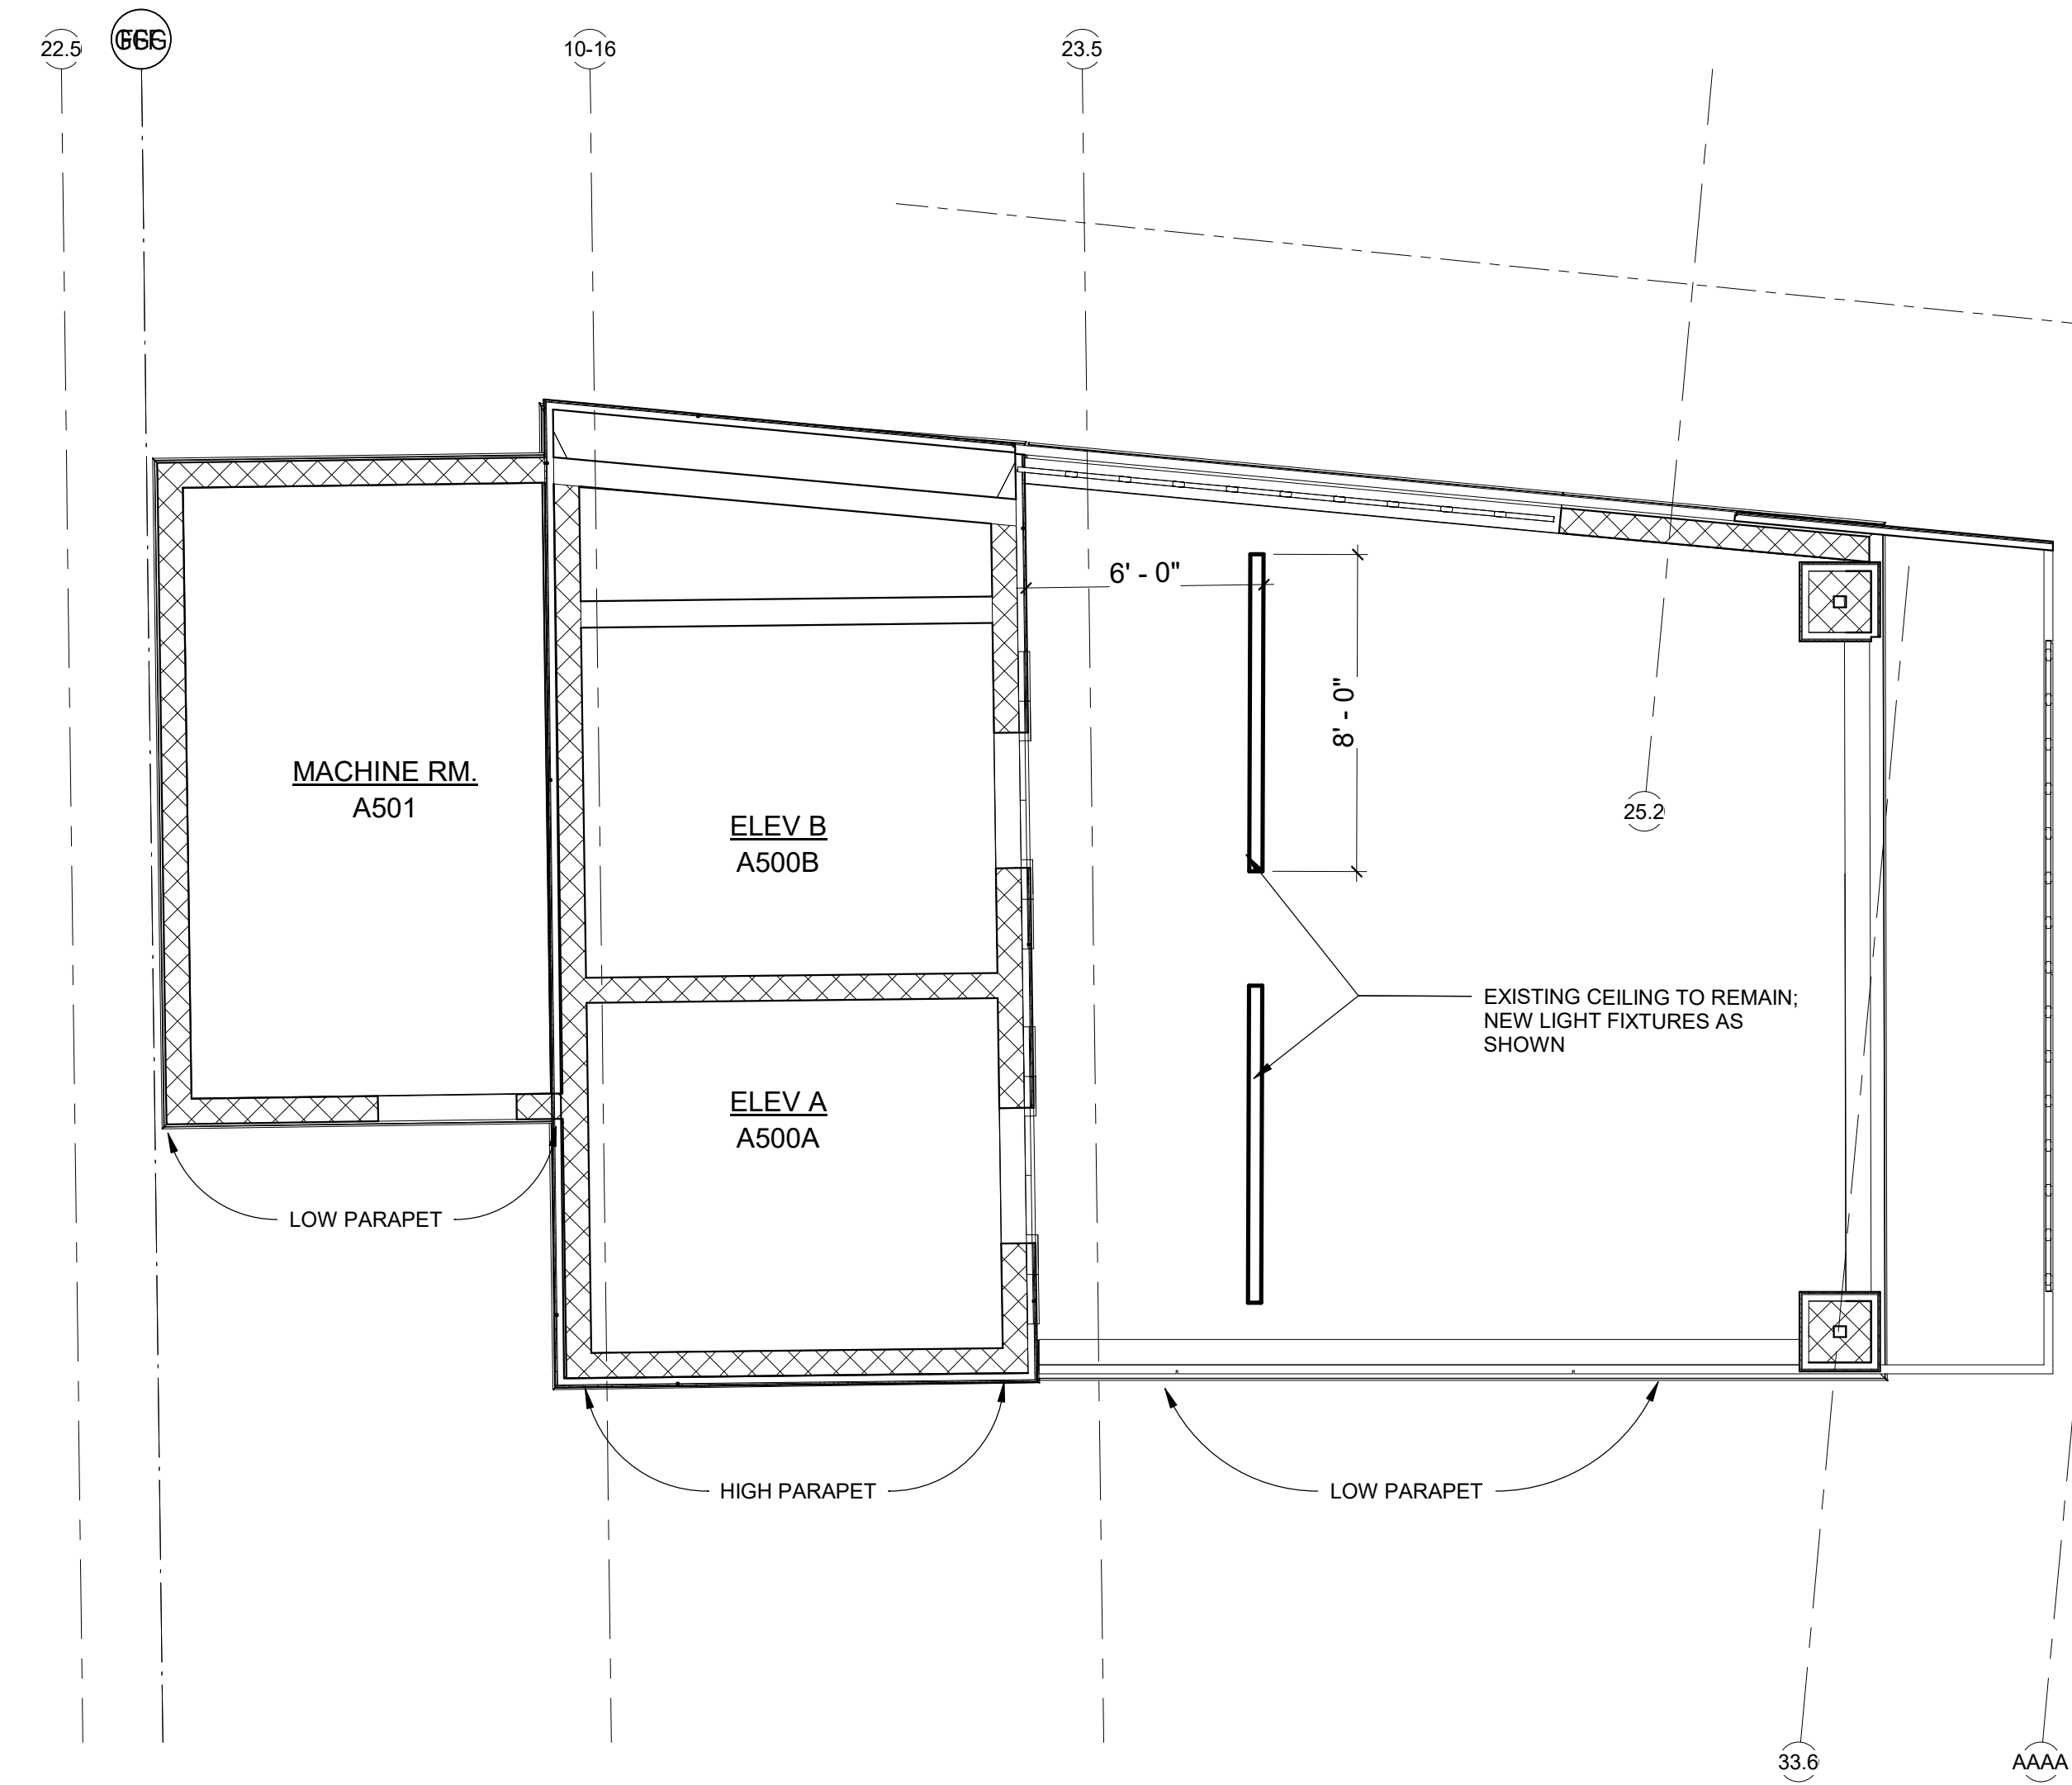

1 ENLARGED ELEVATOR LOBBY RCP - LEVEL E
1/4" = 1'-0"


GENERAL NOTE

KEY NOTES

PARKING NOTES

KEY PLAN

Key Value	Keynote Text
AP-01	ALL STRIPING AND TRAFFIC MARKINGS TO BE PAINTED TRAFFIC WHITE UNLESS NOTED OTHERWISE.
AP-02	STRIPED PEDESTRIAN WALKWAY
FN03	BURNISHED CONCRETE MASONRY UNIT WALL (CMU-1). REFER FINISH SCHEDULE.
FN07	METAL COMPOSITE MATERIAL WALL PANEL SYSTEM (ACM-1)
P01	6" DIA. X36" HIGH CONCRETE-FILLED STEEL PIPE BOLLARDS WITH HDPE BOLLARD SLEEVE. COLOR: SAFETY YELLOW, WITH REFLECTIVE RED TAPE.

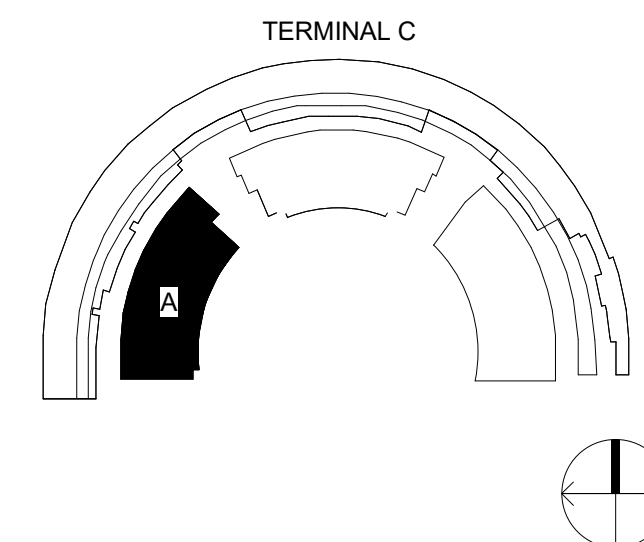

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR
CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	70% DESIGN
2	2022-03-01	100% DESIGN
3	2022-02-28	100% ISSUED FOR PERMIT (IFP)


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
ENLARGED ELEVATOR LOBBY PLANS - LEVEL E

PROJECT NUMBER: TFD-007


PERMIT NUMBER: B22-0022

SHEET NUMBER
AE403-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

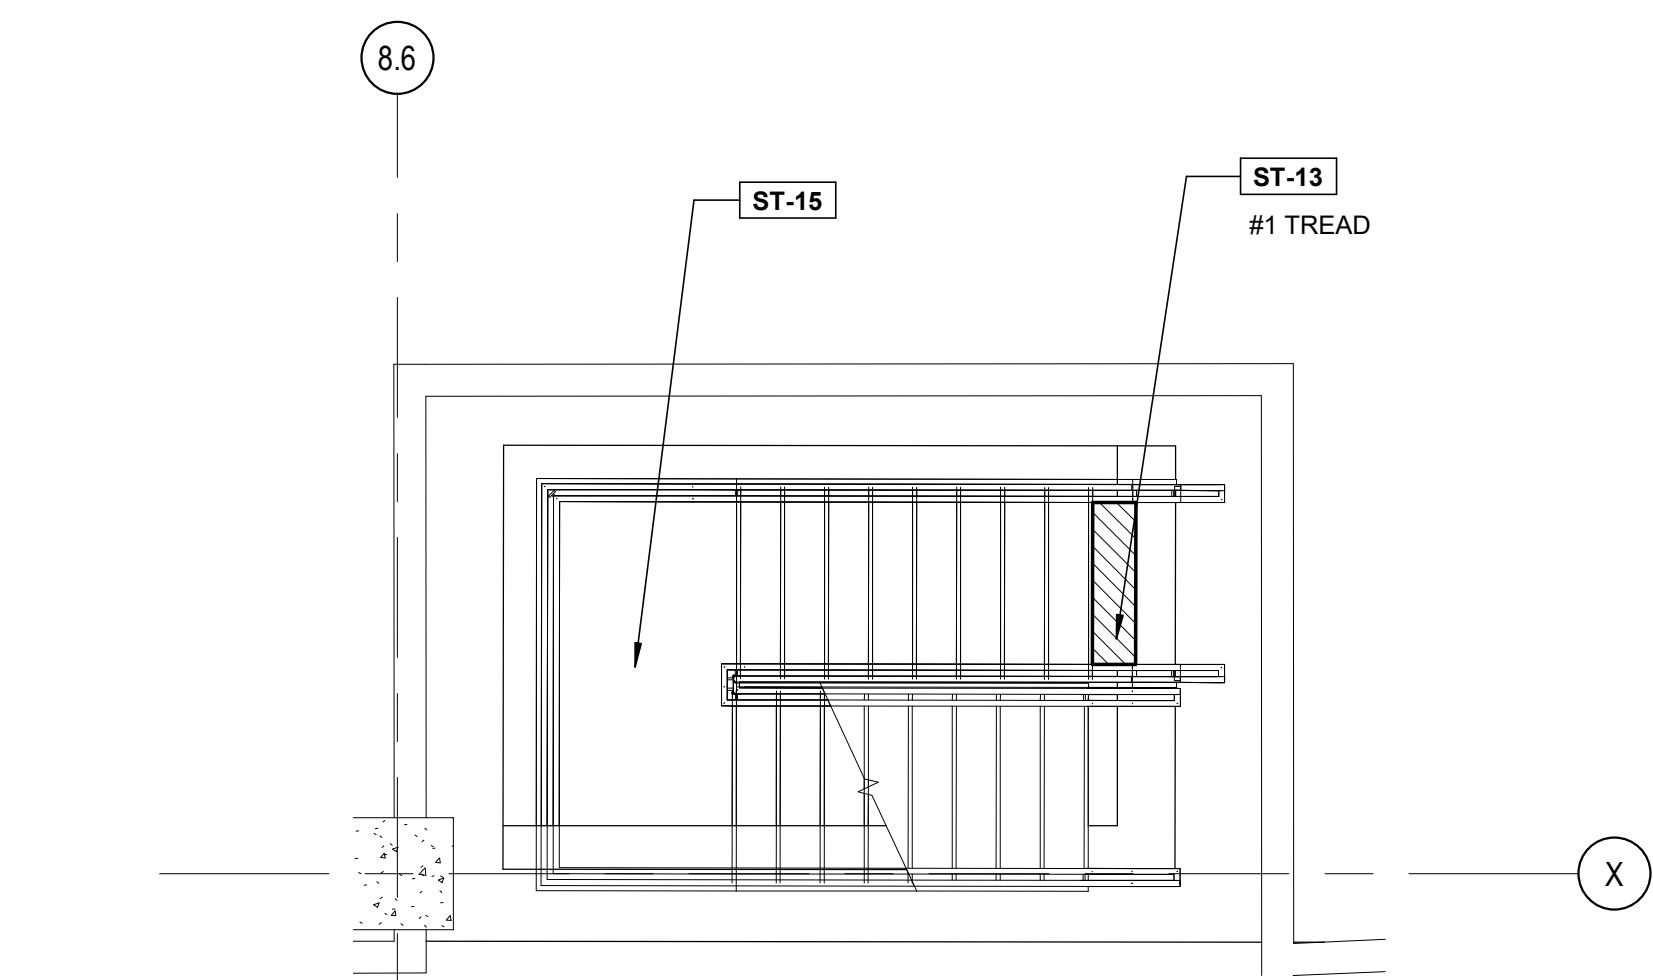


12 ENLARGED STAIR PLAN--STAIR #6 LEVEL D
1/4" = 1'-0"

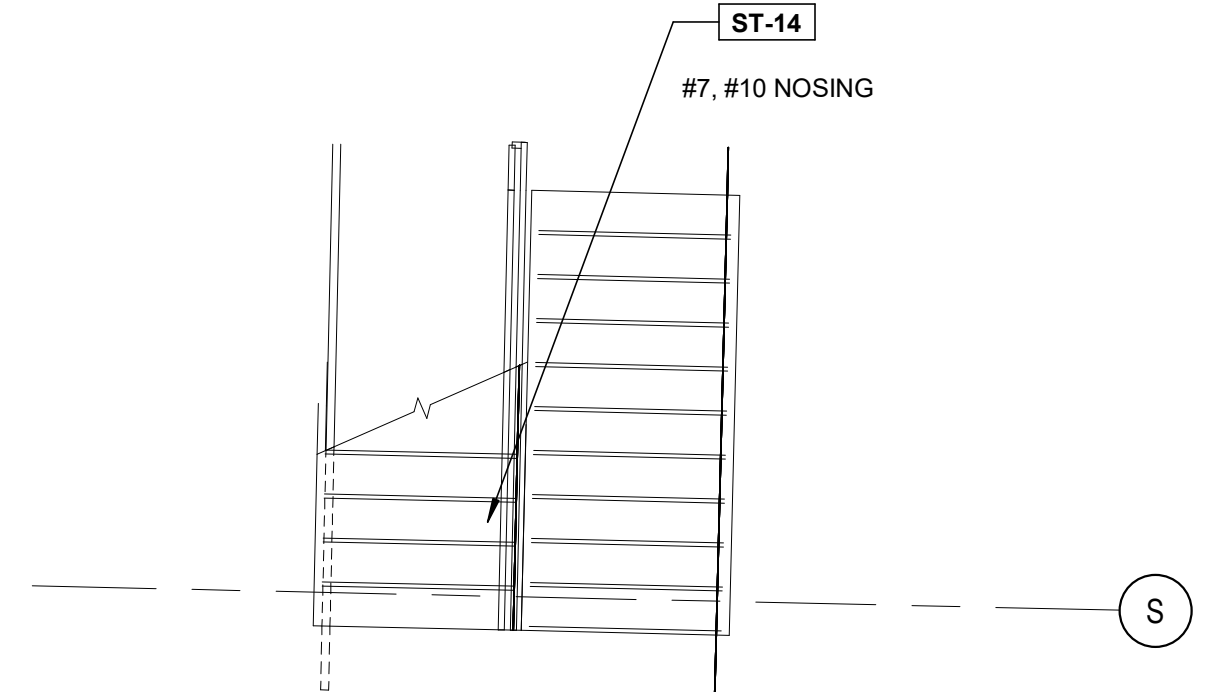


9 ENLARGED STAIR PLAN--STAIR #5 LEVEL C
1/4" = 1'-0"

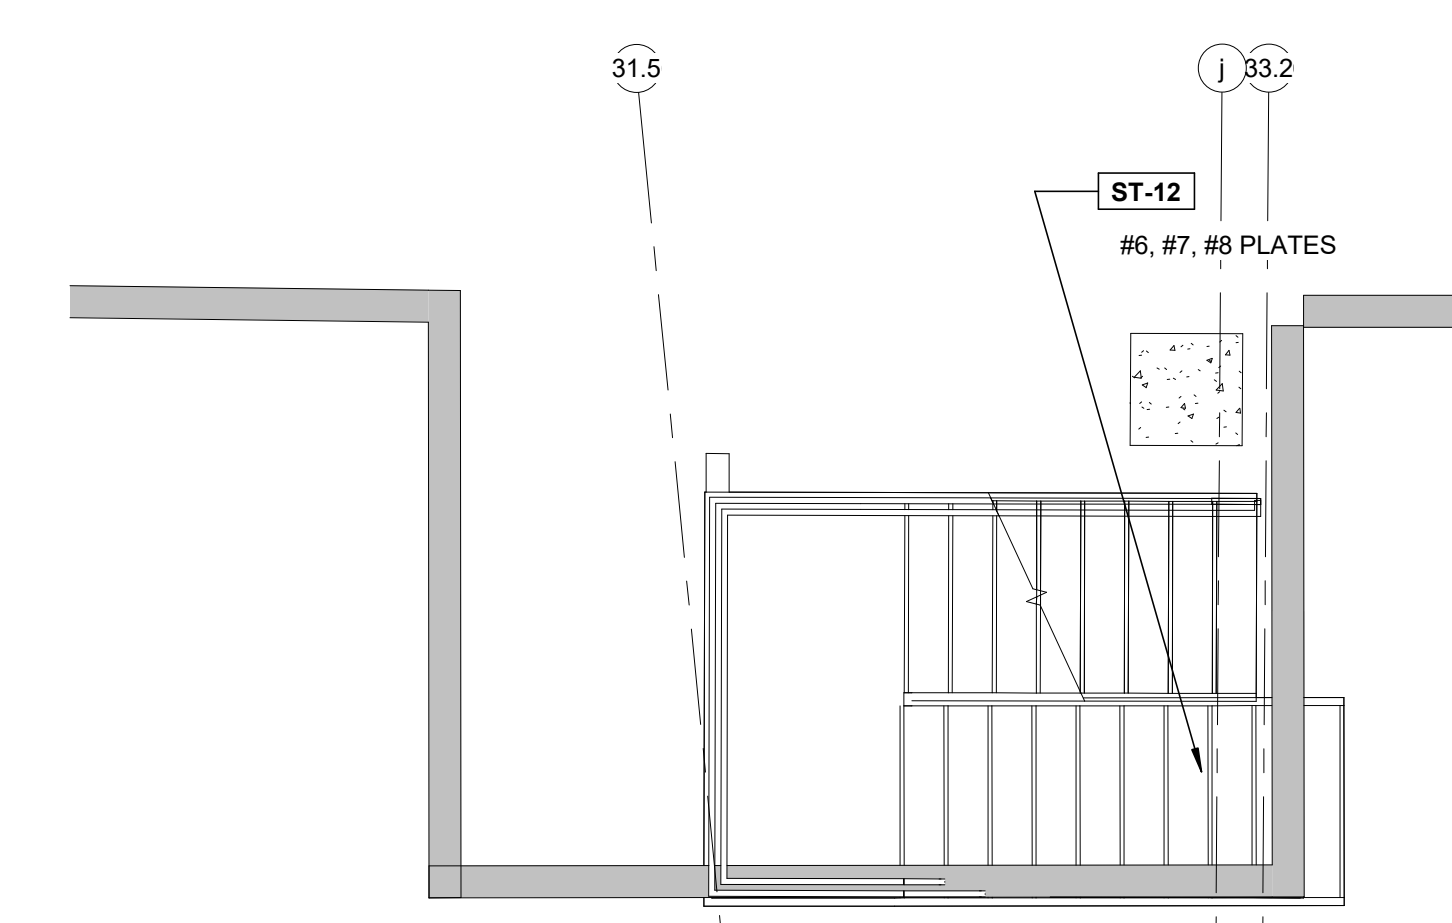


6 ENLARGED STAIR PLAN--STAIR #2 LEVEL C
1/4" = 1'-0"

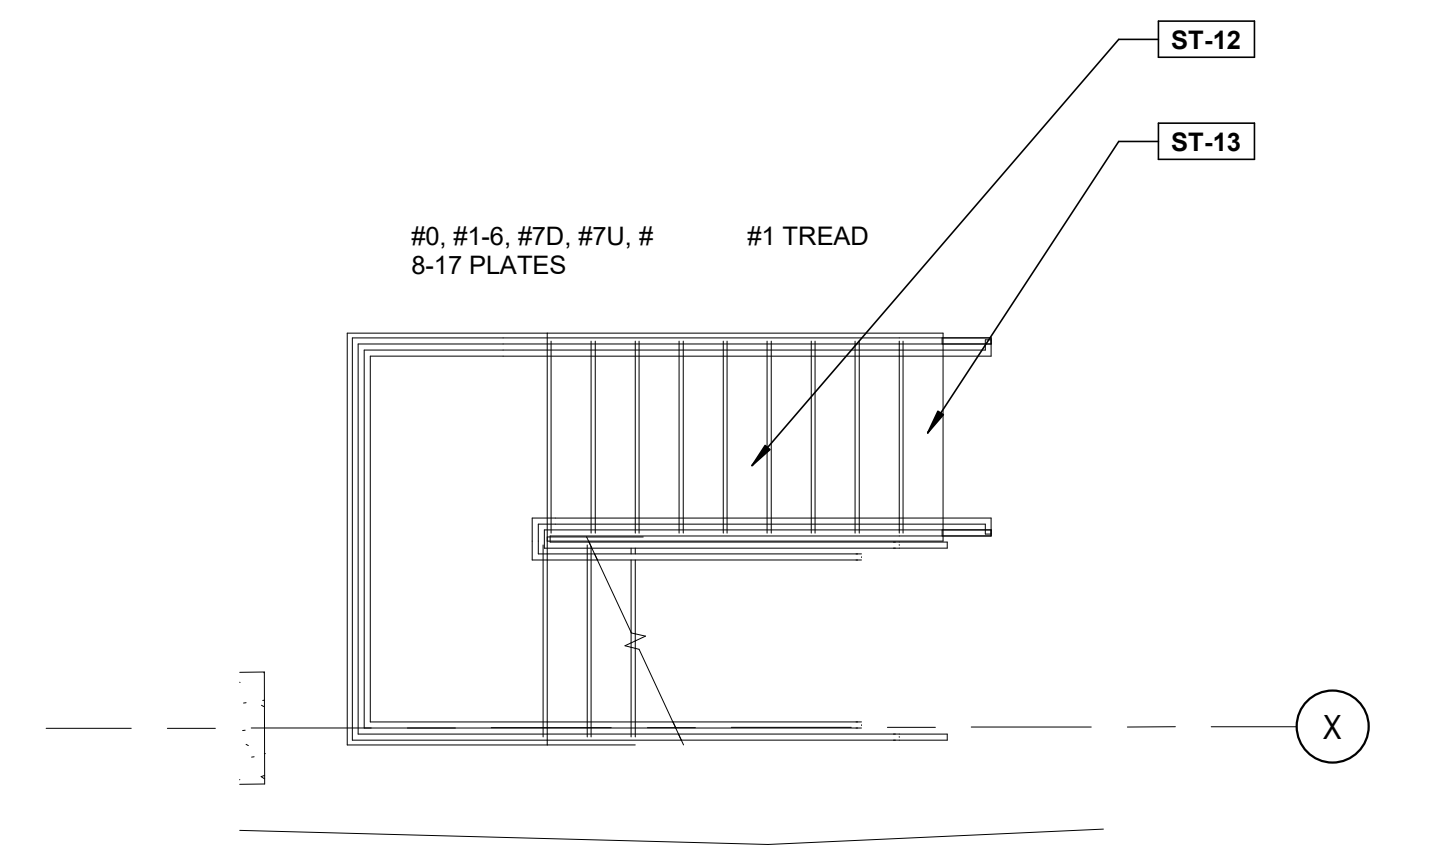


3 ENLARGED STAIR PLAN--STAIR #6 LEVEL A
1/4" = 1'-0"

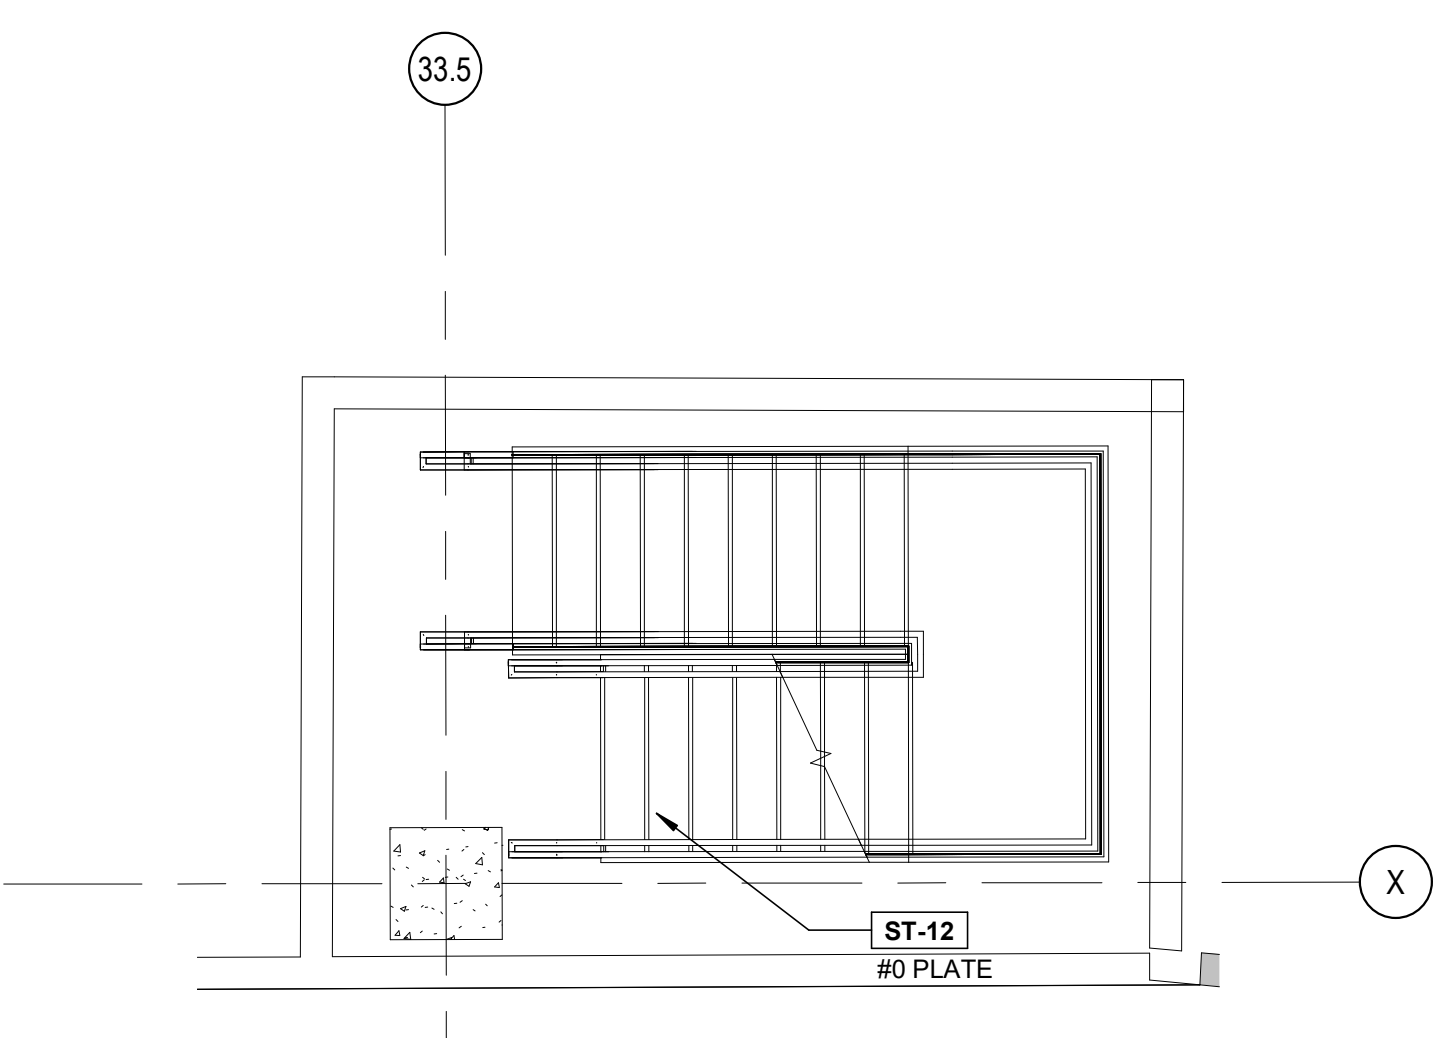


11 ENLARGED STAIR PLAN--STAIR #1 LEVEL D
1/4" = 1'-0"

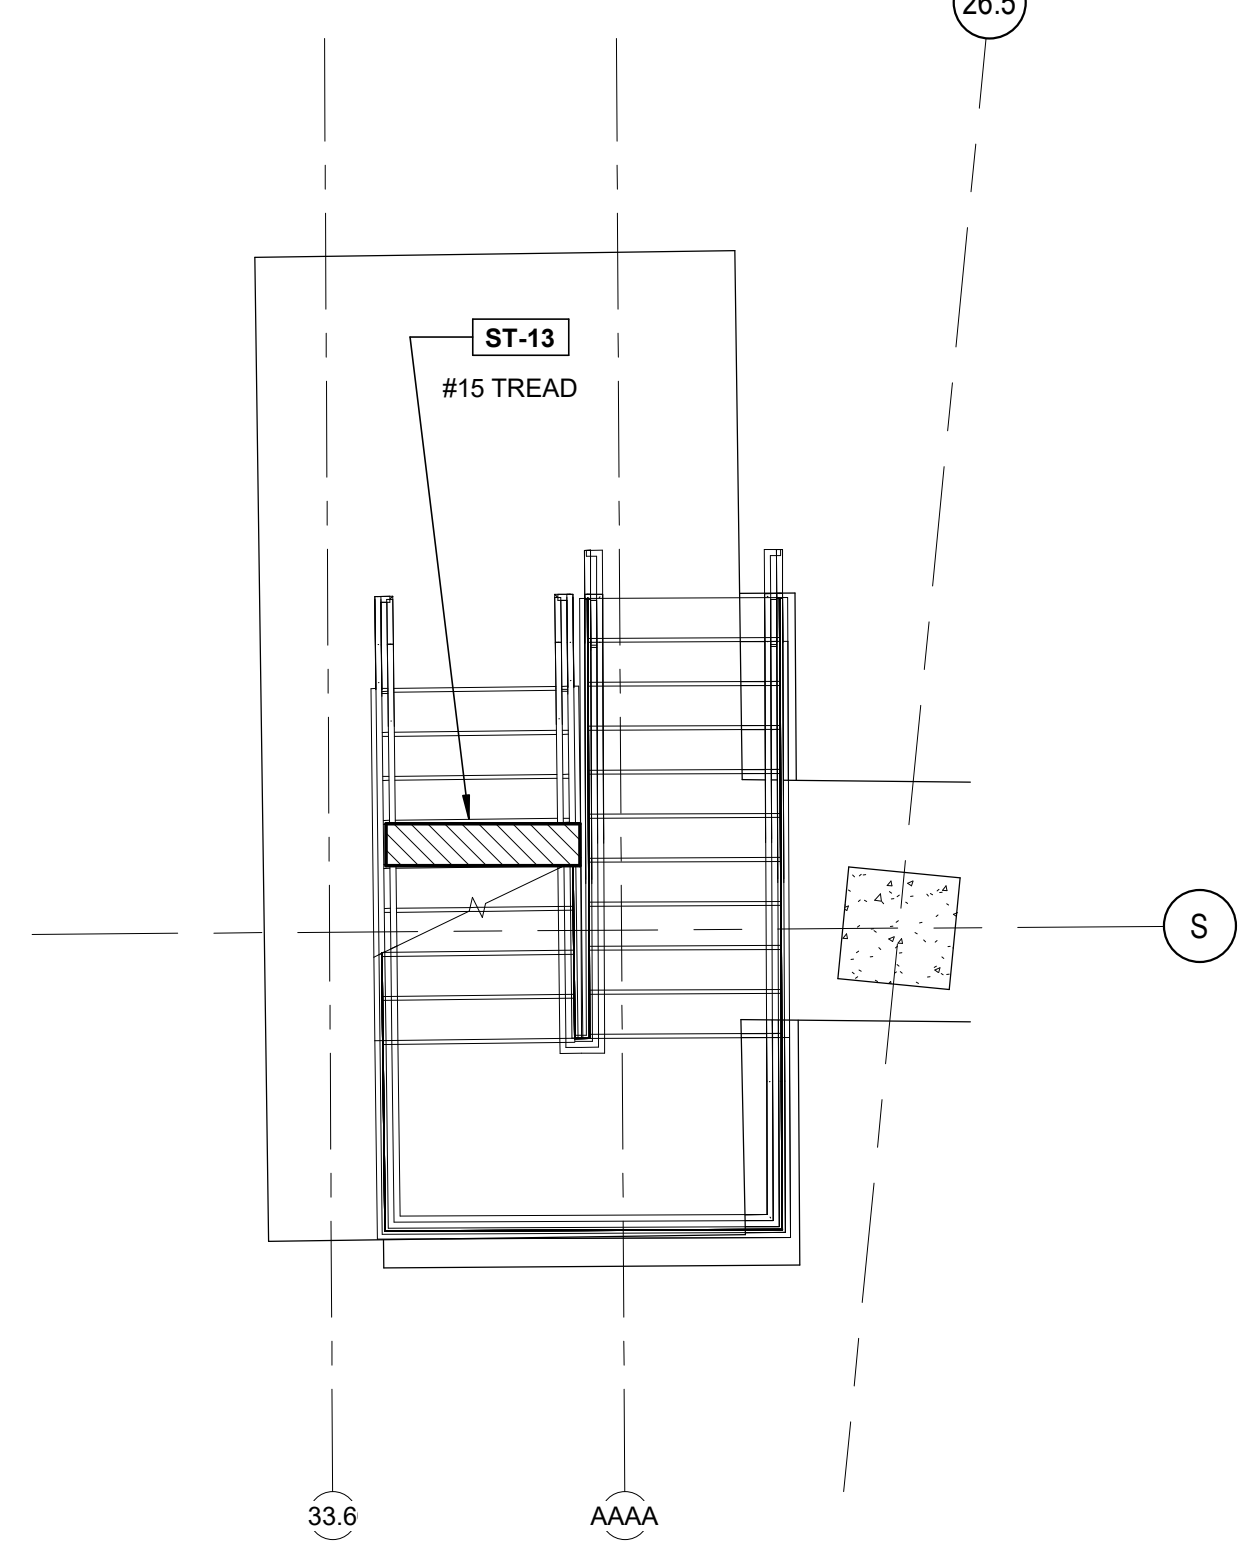


8 ENLARGED STAIR PLAN--STAIR #3 LEVEL C
1/4" = 1'-0"

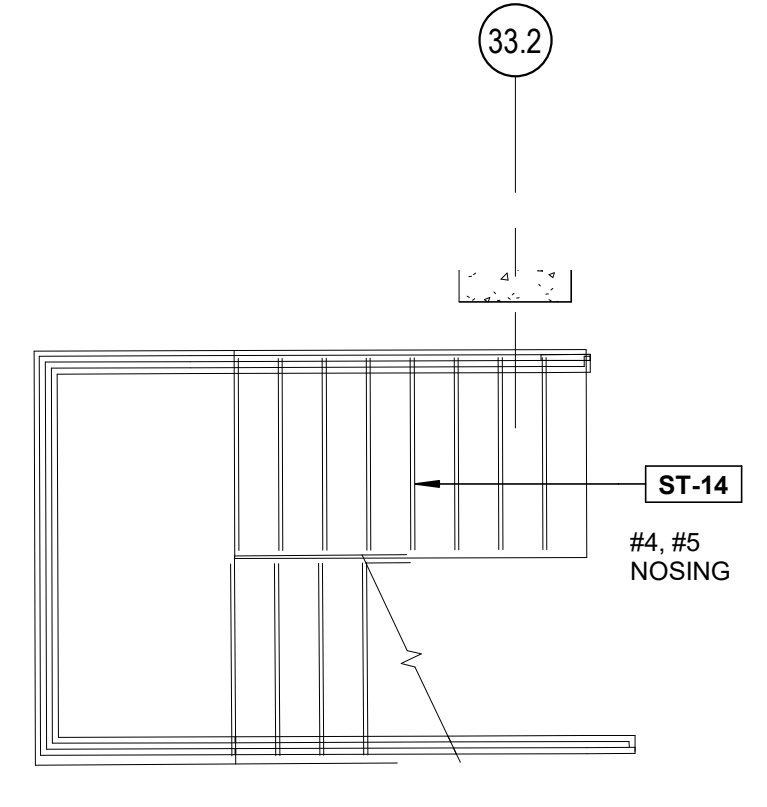


5 ENLARGED STAIR PLAN--STAIR #2 LEVEL B
1/4" = 1'-0"

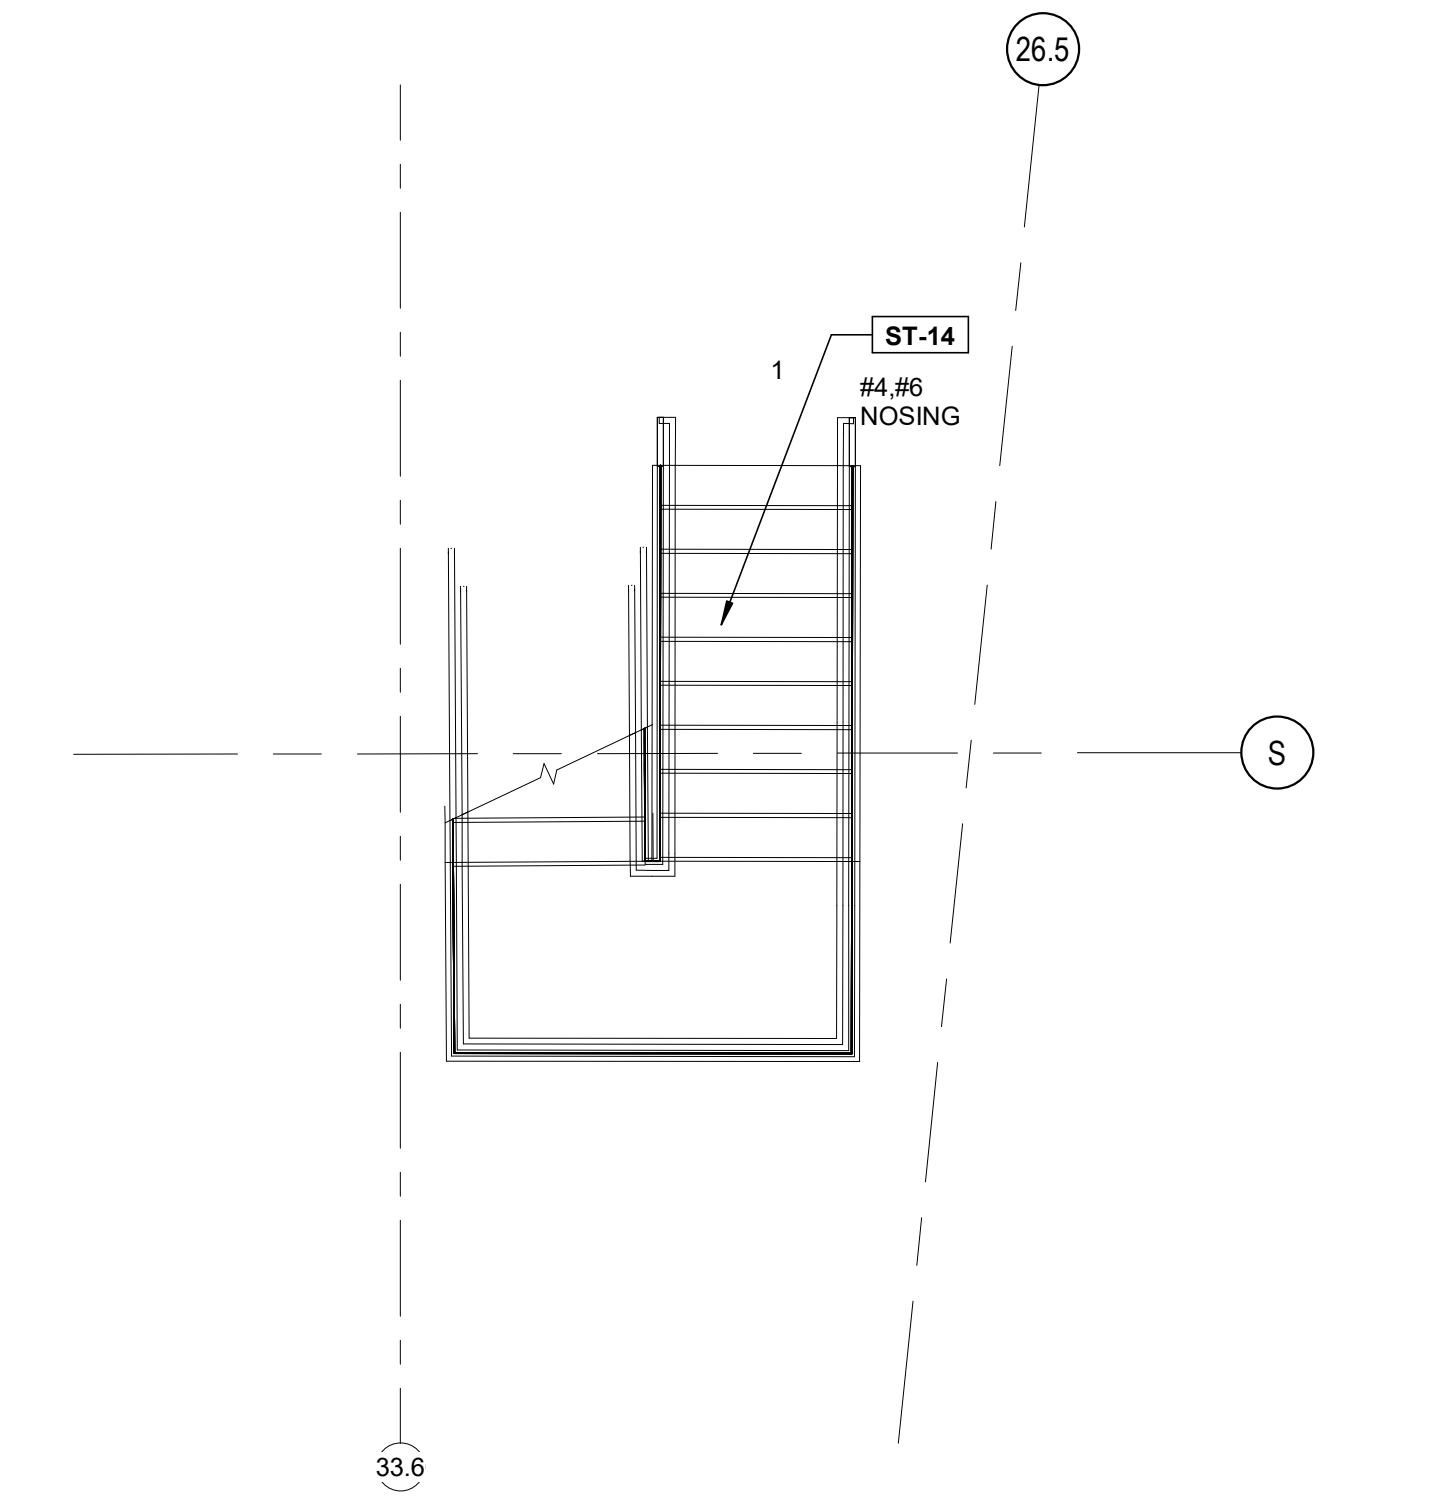


2 ENLARGED STAIR PLAN--STAIR #3 LEVEL A
1/4" = 1'-0"

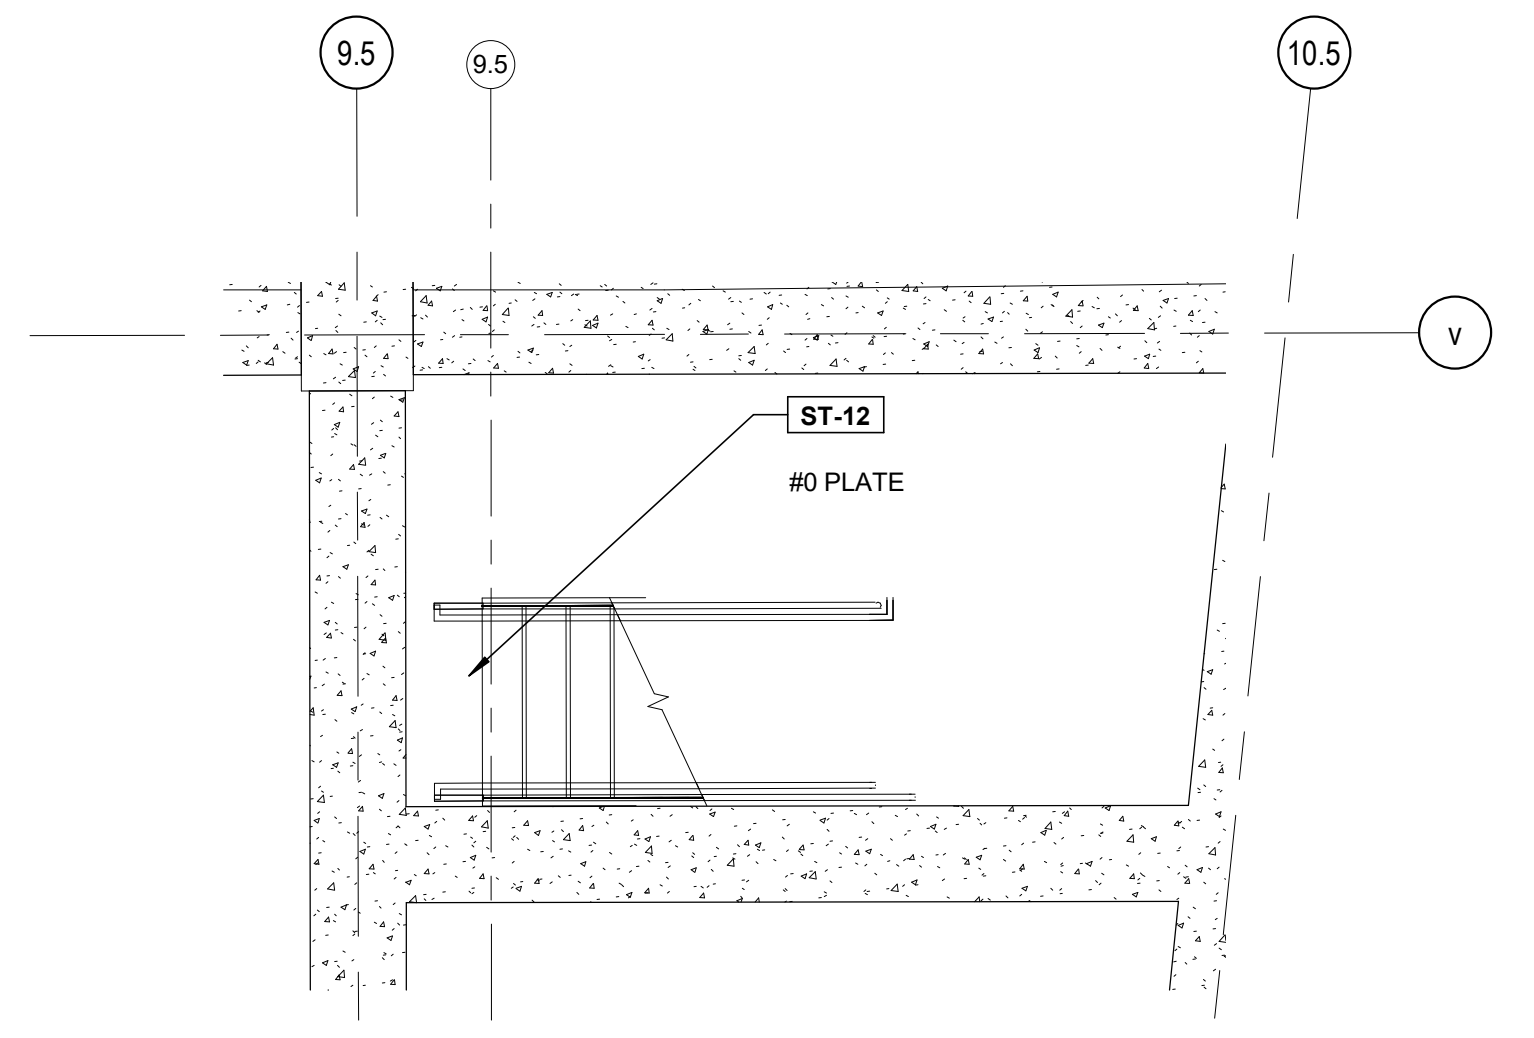


10 ENLARGED STAIR PLAN--STAIR #7 LEVEL C
1/4" = 1'-0"

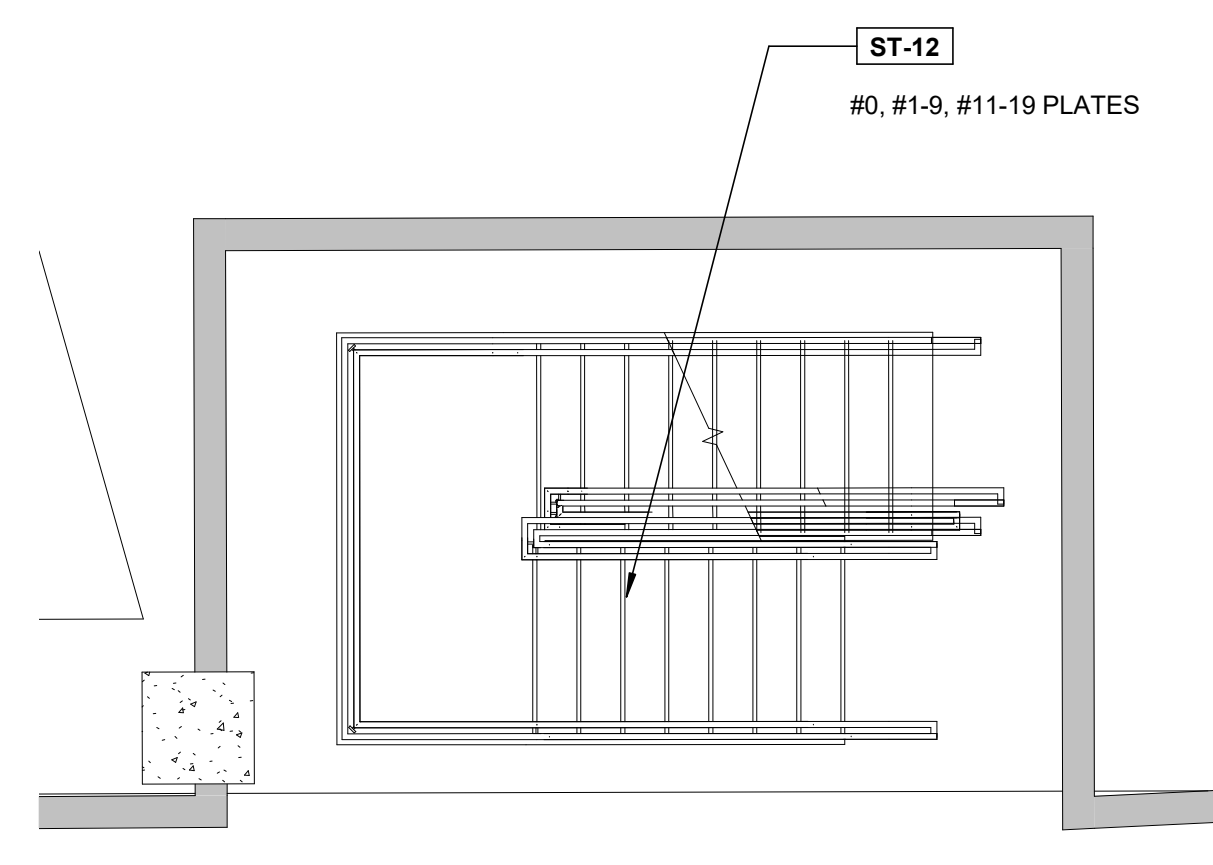

7 ENLARGED STAIR PLAN--STAIR #6 LEVEL C
1/4" = 1'-0"

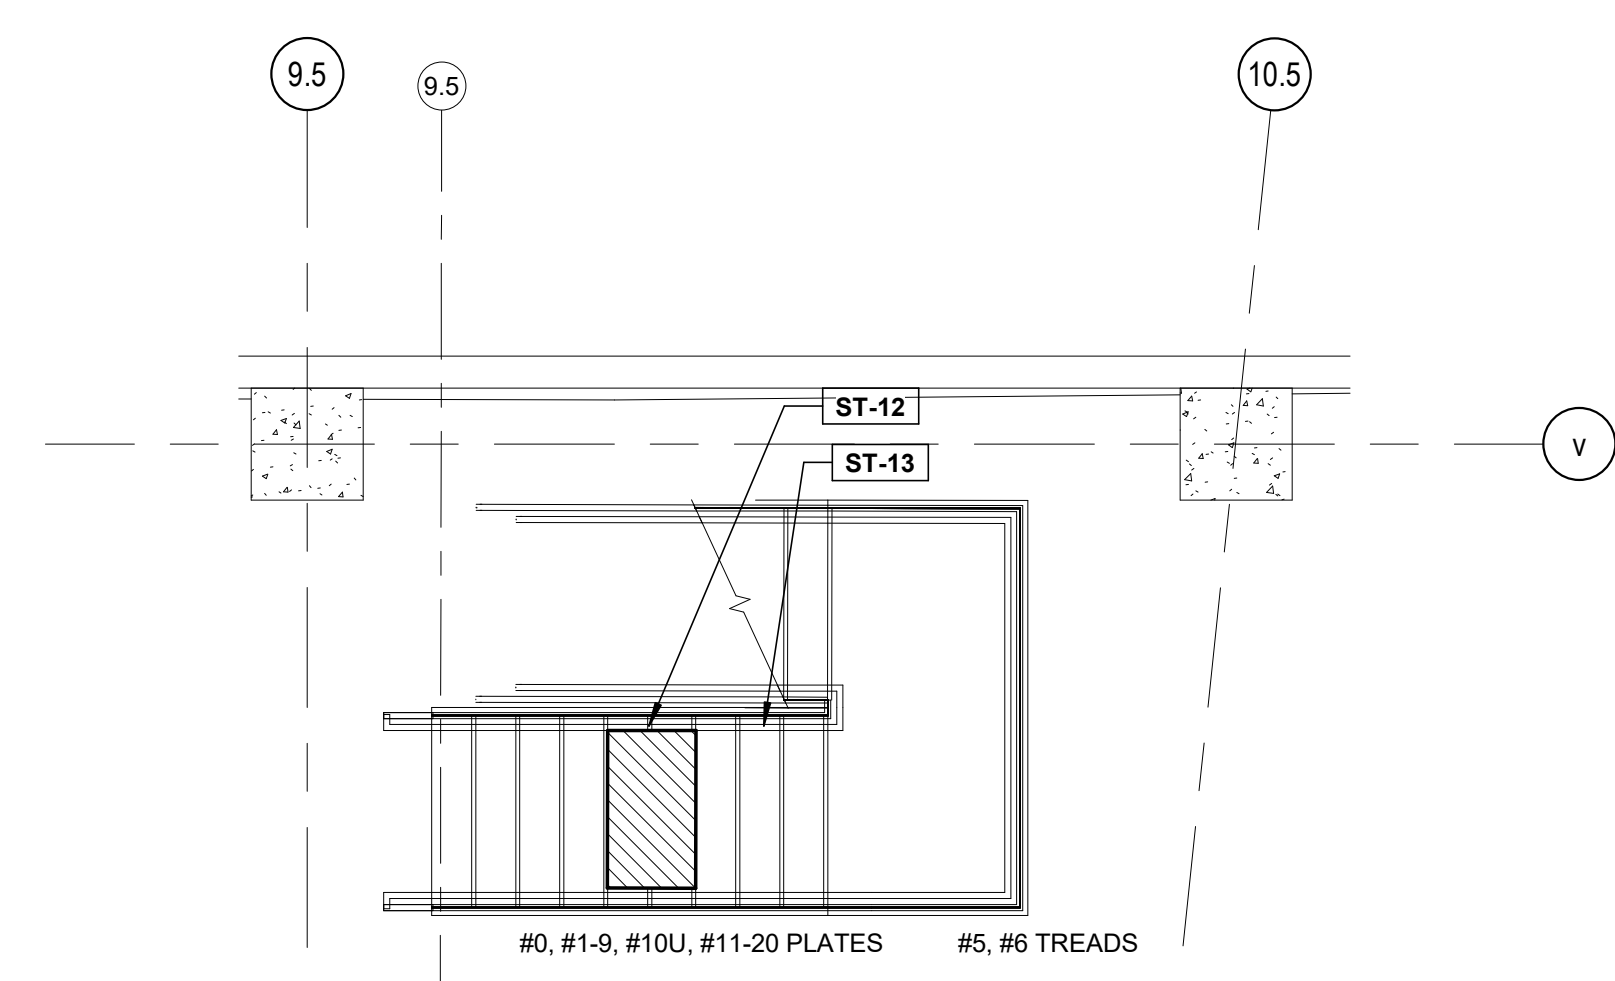

4 ENLARGED STAIR PLAN--STAIR #7 LEVEL B
1/4" = 1'-0"

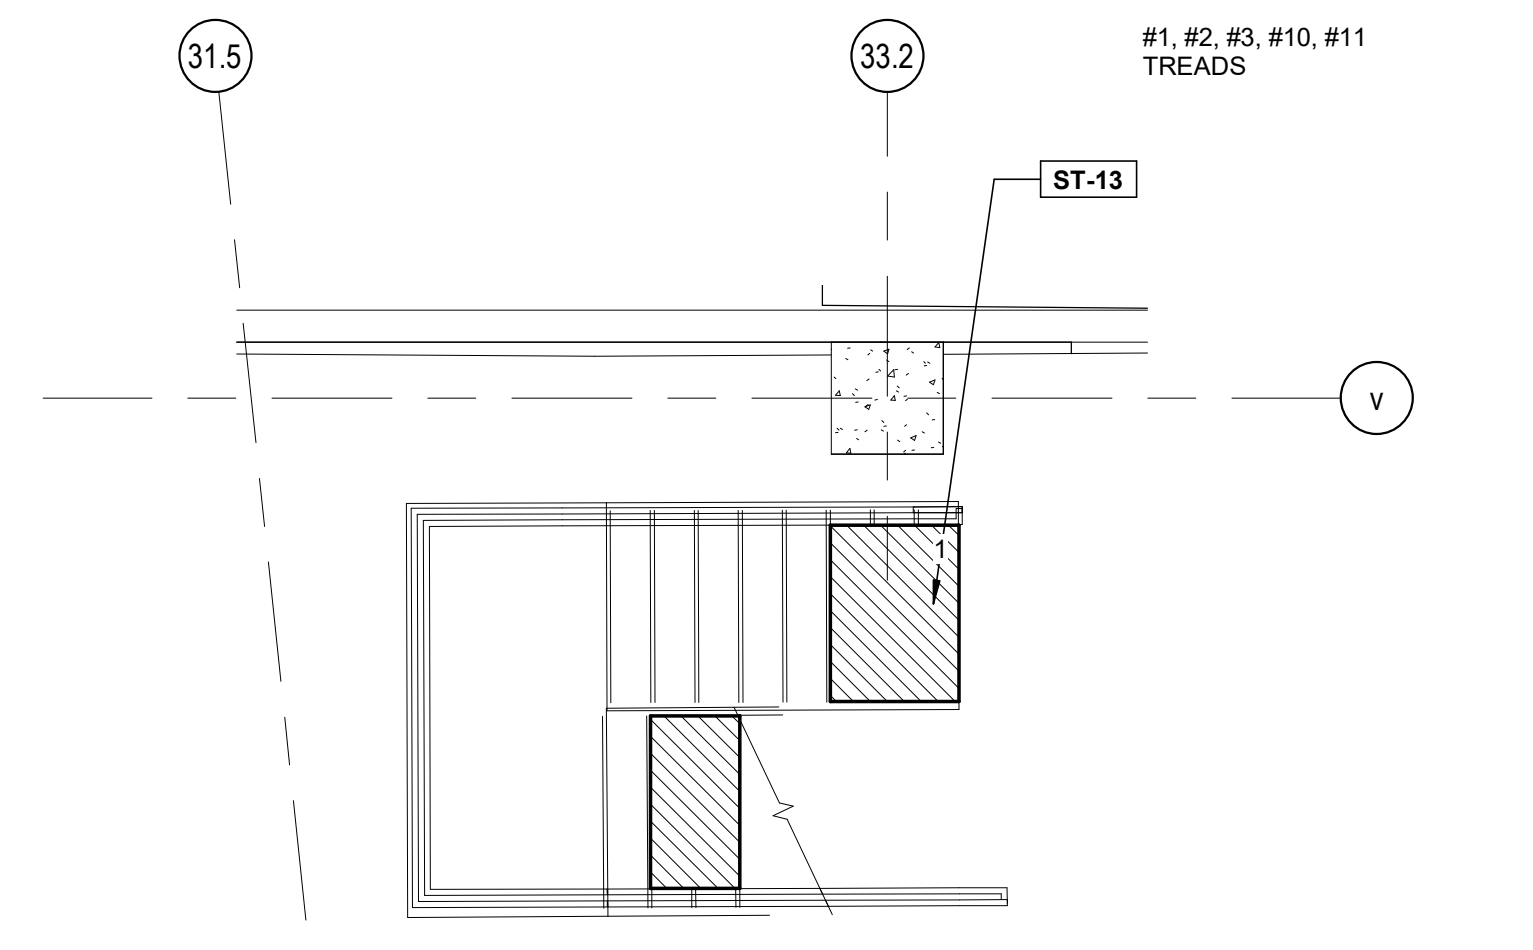

1 ENLARGED STAIR PLAN--STAIR #2 LEVEL A
1/4" = 1'-0"


GENERAL NOTE

- REPAIR CONCRETE SPALLING IN THE GARAGE FLOORS. REFER TO STRUCTURAL NOTES.
- REFER TO KEY PLAN DENOTING THE PLATE AND TREAD NUMBERING AND STAIR DETAILS ON SHEET AE501-900B
- DEMO AND REMOVE CONCRETE LANDING AND TREADS, AS NOTED PRIOR TO MITIGATE AND REPAIR THE STEEL/PLATE PART OF THE STAIR. CONTRACTOR TO FIELD VERIFY THE INTEGRITY OF STEEL PANS BEFORE STARTING TO EVALUATE THE REPAIR ON THE STEEL.

KEY NOTES

Key Value	Keynote Text
ST-12	PLATE REPAIR: REMOVE AND REPLACE PLATES NOTED, ALONG WITH NEW CONCRETE TOPPING AND NOSING WITH THE ANTI-SLIP FINISH.
ST-13	TREAD REPAIR: REMOVE AND REPLACE CONCRETE TOPPING AND NOSING WITH THE ANTI-SLIP FINISH AT NOSING TO MATCH EXISTING.
ST-14	NOSING REPAIR: REMOVE AND REPLACE NOSING WITH THE ANTI-SLIP FINISH TO MATCH EXISTING.
ST-15	LANDING REPAIR: REPAIR AND RE-POUR CONCRETE ON STAIR LANDING AS NOTE AND FEATHER IT OUT. CHIPS AND CRACKS AT LANDING ALSO

LEGEND

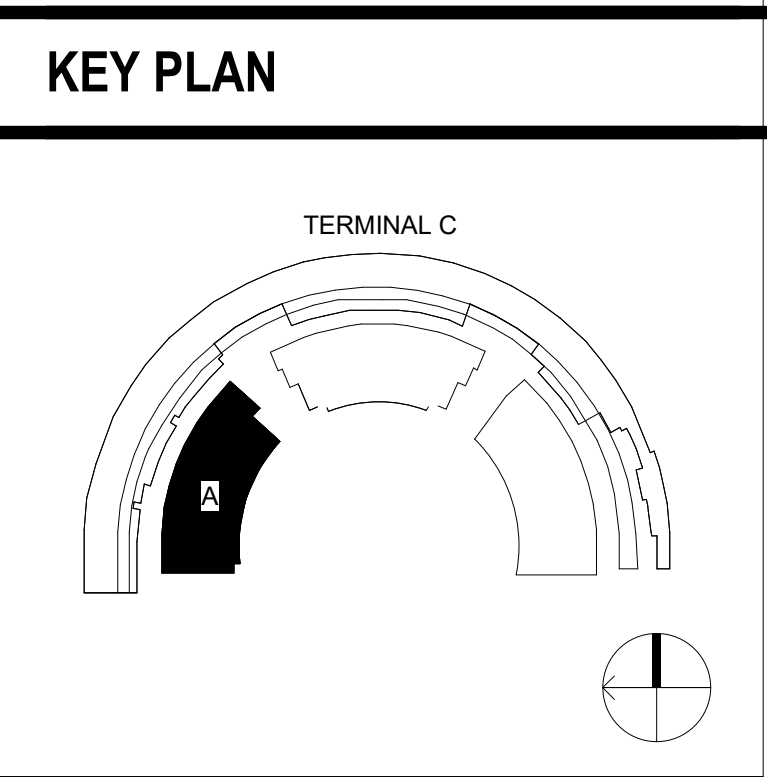

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
ENLARGED STAIR PLANS

PERMIT NUMBER: B22-0022

SHEET NUMBER
AE404-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

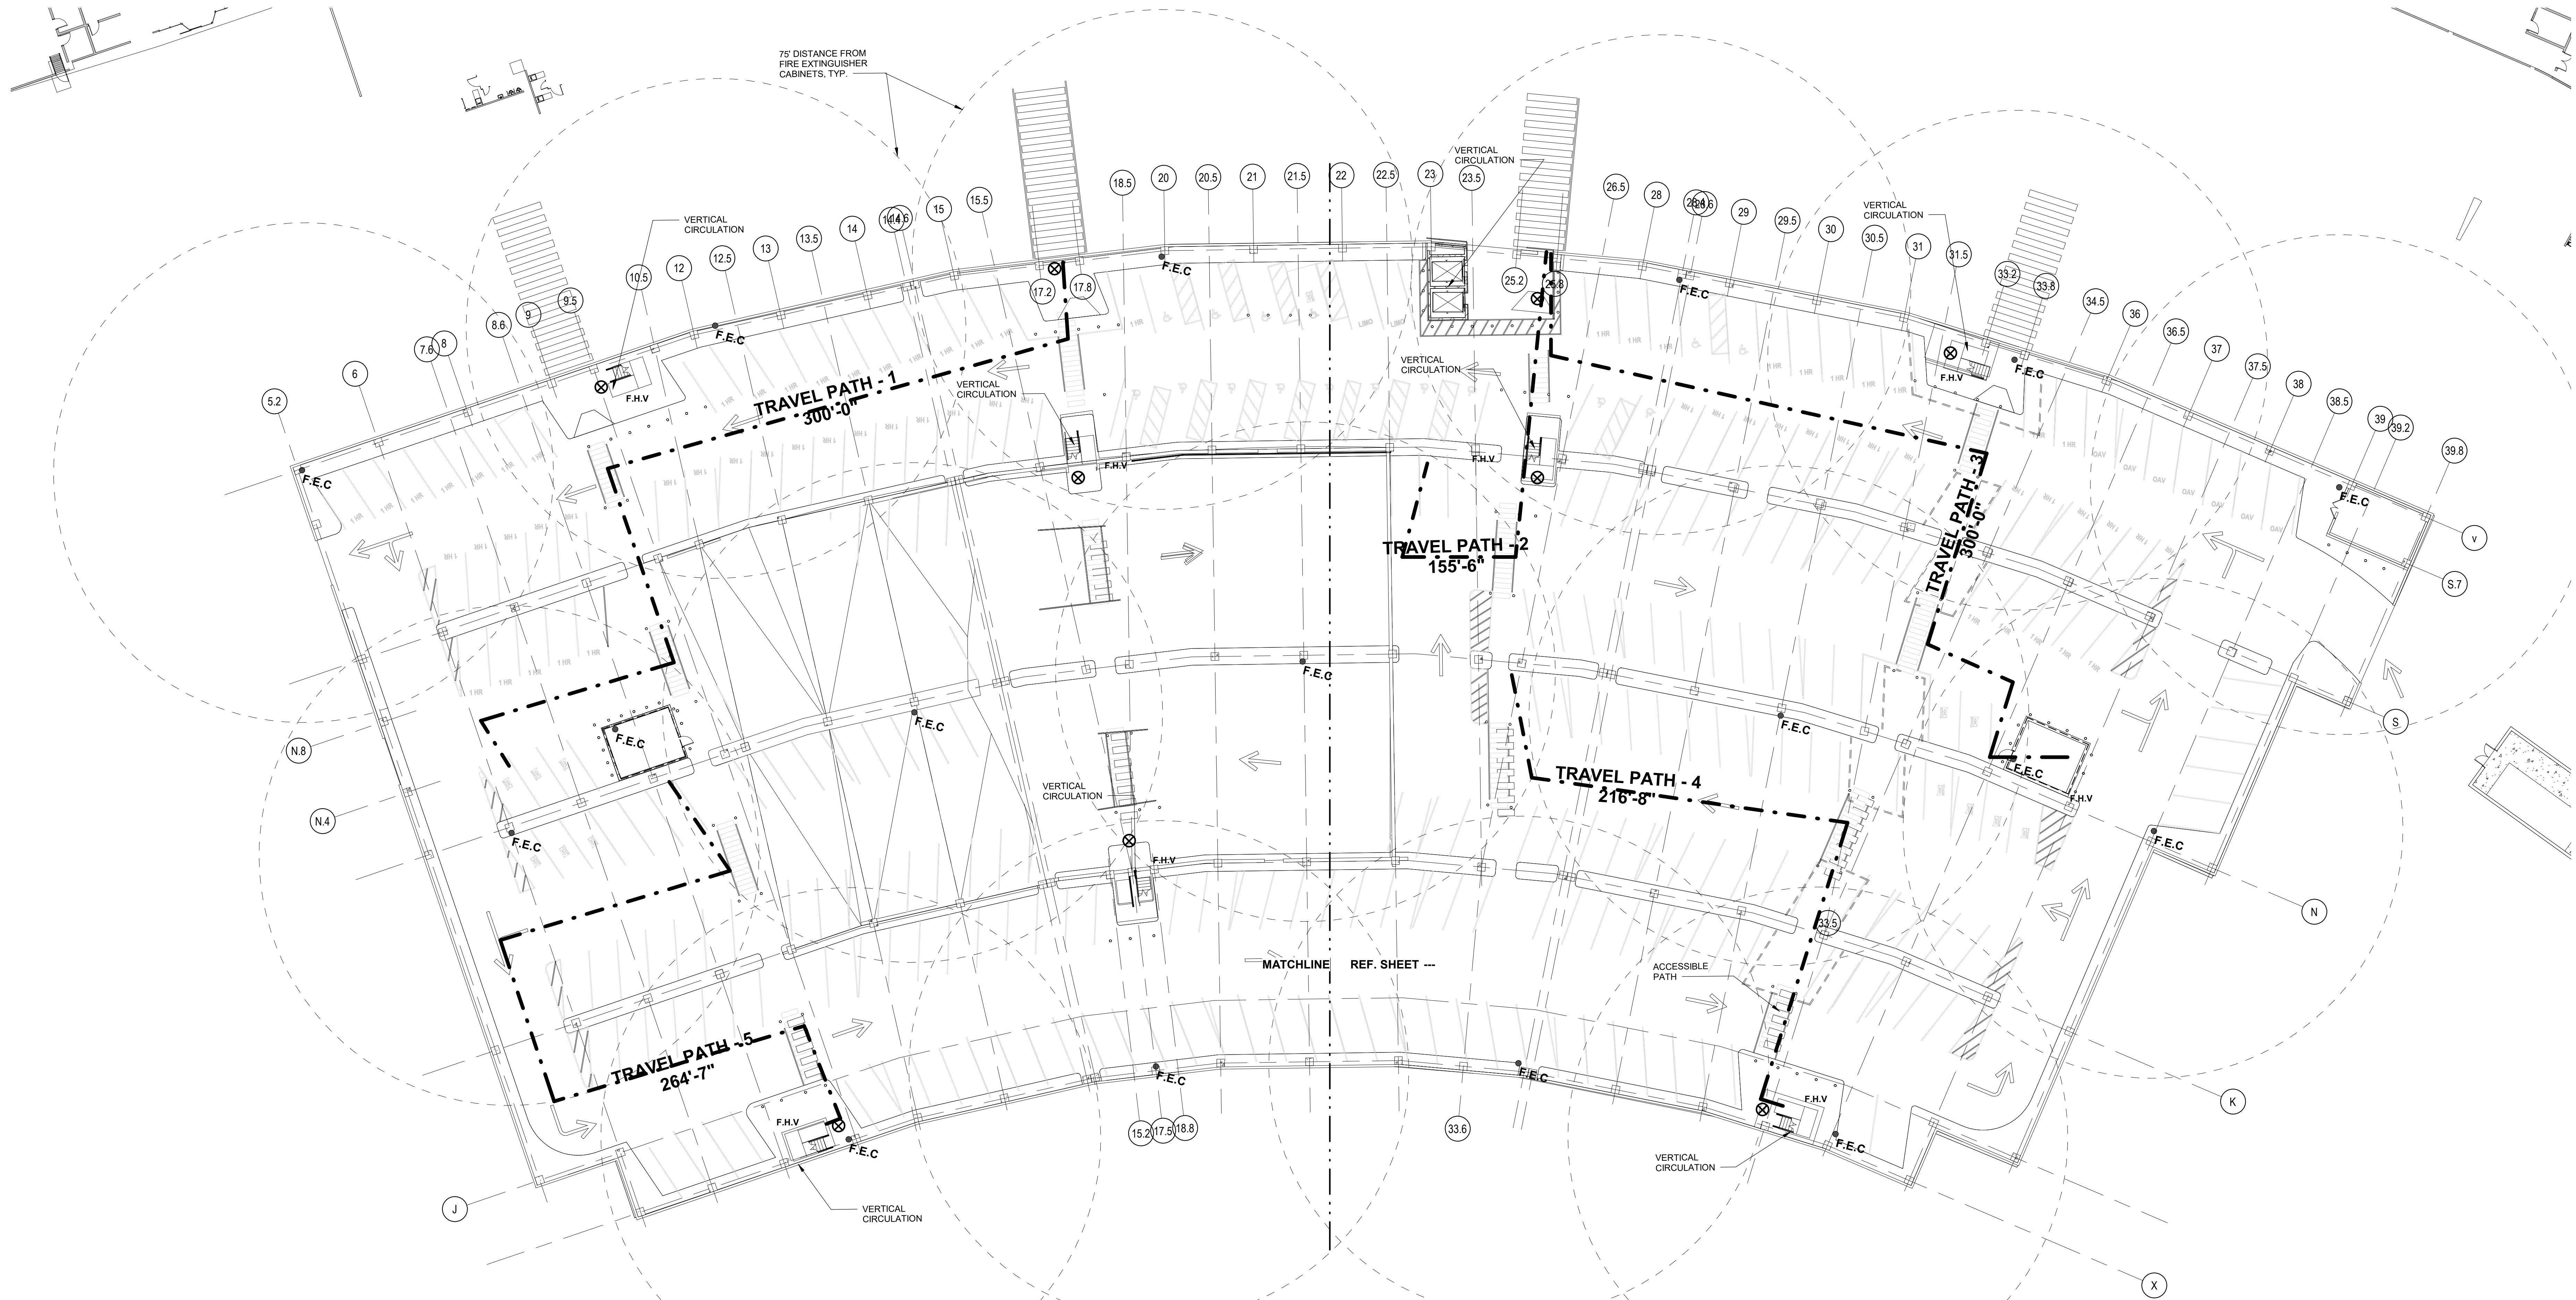


A1 LIFE SAFETY PLAN - LEVEL A
1" = 20'-0"

TRAVEL PATH ID	TRAVEL PATH DISTANCE
1	300'-0"
2	155'-6"
3	300'-0"
4	216'-8"
5	264'-7"

AREA SCHEDULE FOR OCCUPANCY LOADS - GARAGE A			
OCCUPANCY	AREA	OLF	OL
AIRSIDE			
S-2	135,132SF	200	675
AVAILABLE EXIT CAPACITY = 980			

LIFE SAFETY PLAN LEGEND	
EXIT SIGNS	⊗
TRAVEL PATH	---
1 HR FIRE RATED WALL	---
FIRE EXTINGUISHER	F.E.C
FIRE HOSE CONNECTION	F.H.V

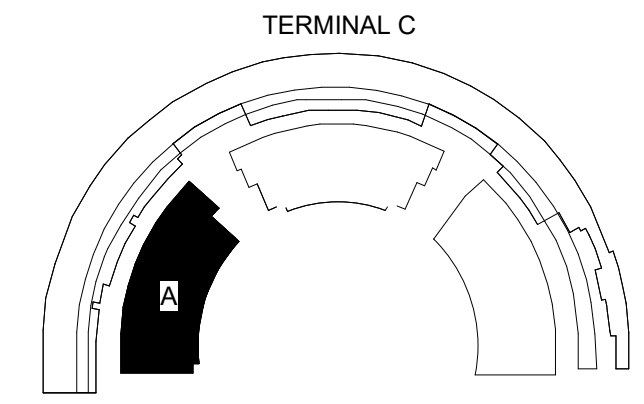

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-08-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
LIFE SAFETY PLAN - LEVEL A

SHEET NUMBER
G1101-900A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

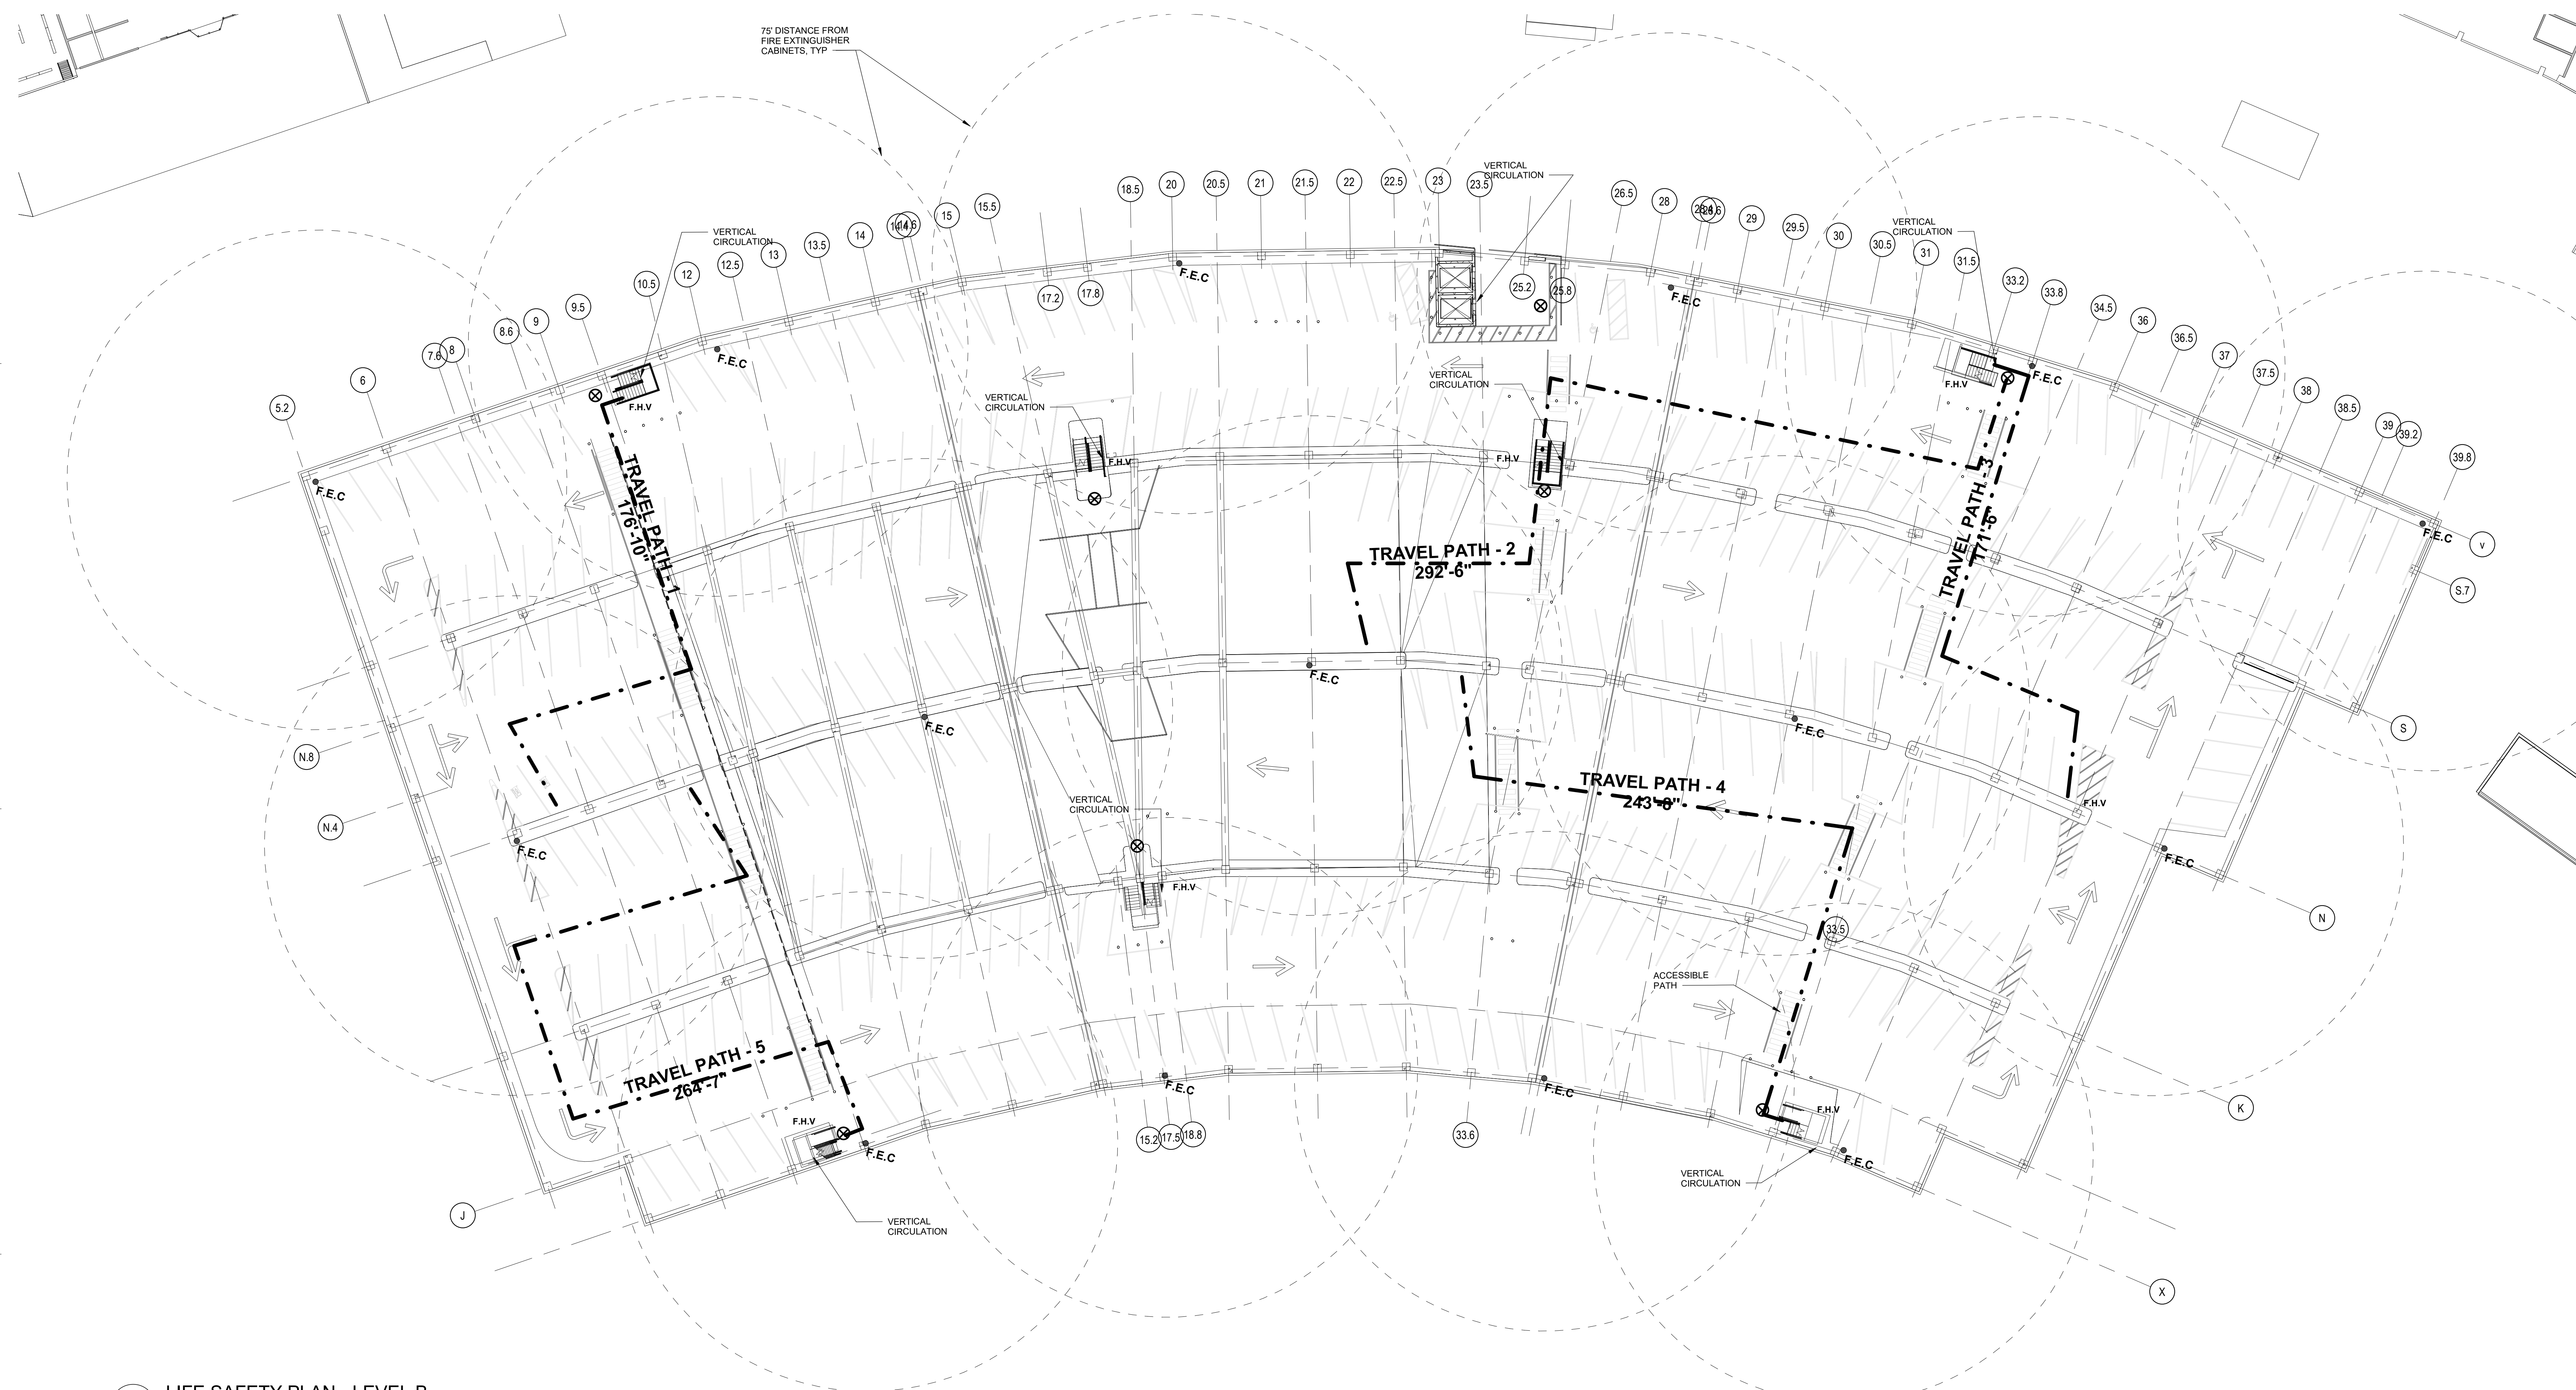


A1 LIFE SAFETY PLAN - LEVEL B
1" = 20'-0"

TRAVEL DISTANCES	
TRAVEL PATH ID	TRAVEL PATH DISTANCE
1	176'-10"
2	292'-6"
3	171'-6"
4	243'-8"
5	264'-7"

AREA SCHEDULE FOR OCCUPANCY LOADS - GARAGE A				
OCCUPANCY	AREA	OLF	OL	
AIRSIDE				
S-2	135,132SF	200	675	
AVAILABLE EXIT CAPACITY = 980				

LIFE SAFETY PLAN LEGEND	
EXIT SIGNS	
TRAVEL PATH	
1 HR FIRE RATED WALL	
FIRE EXTINGUISHER	F.E.C
FIRE HOSE CONNECTION	F.H.V

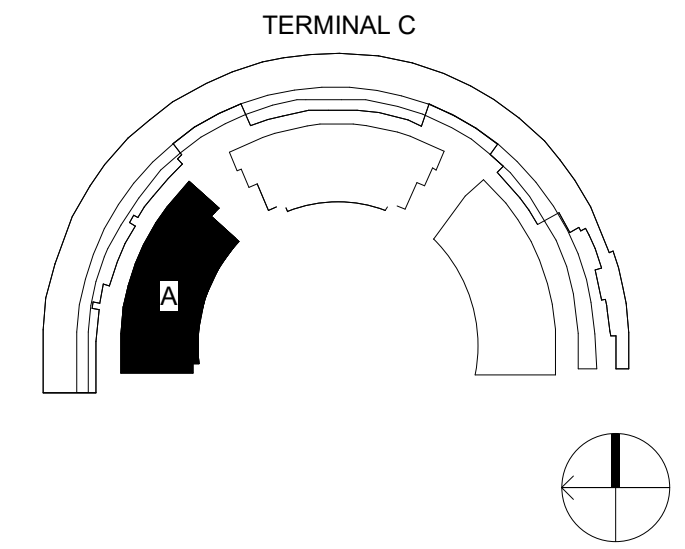

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
LIFE SAFETY PLAN - LEVEL B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
G1102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




A1 LIFE SAFETY PLAN - LEVEL C
1" = 20'-0"


TRAVEL PATH ID	TRAVEL PATH DISTANCE
1	293'-0"
2	181'-6"
3	300'-0"
4	243'-8"
5	264'-7"

AREA SCHEDULE FOR OCCUPANCY LOADS - GARAGE A			
OCCUPANCY	AREA	OLF	OL
AIRSIDE			
S-2	135,132SF	200	675
AVAILABLE EXIT CAPACITY = 980			

LIFE SAFETY PLAN LEGEND	
EXIT SIGNS	⊗
TRAVEL PATH	---
1 HR FIRE RATED WALL	---
FIRE EXTINGUISHER	F.E.C
FIRE HOSE CONNECTION	F.H.V

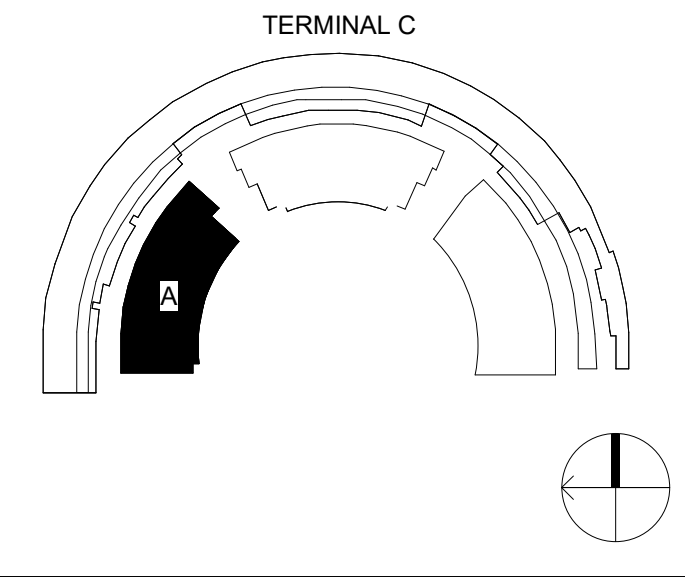

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

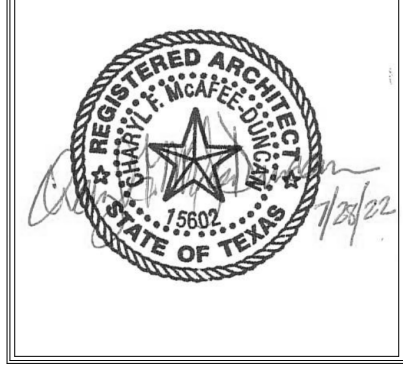

DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-02-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)


PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
LIFE SAFETY PLAN - LEVEL C

PERMIT NUMBER: B22-0022

SHEET NUMBER
G1103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

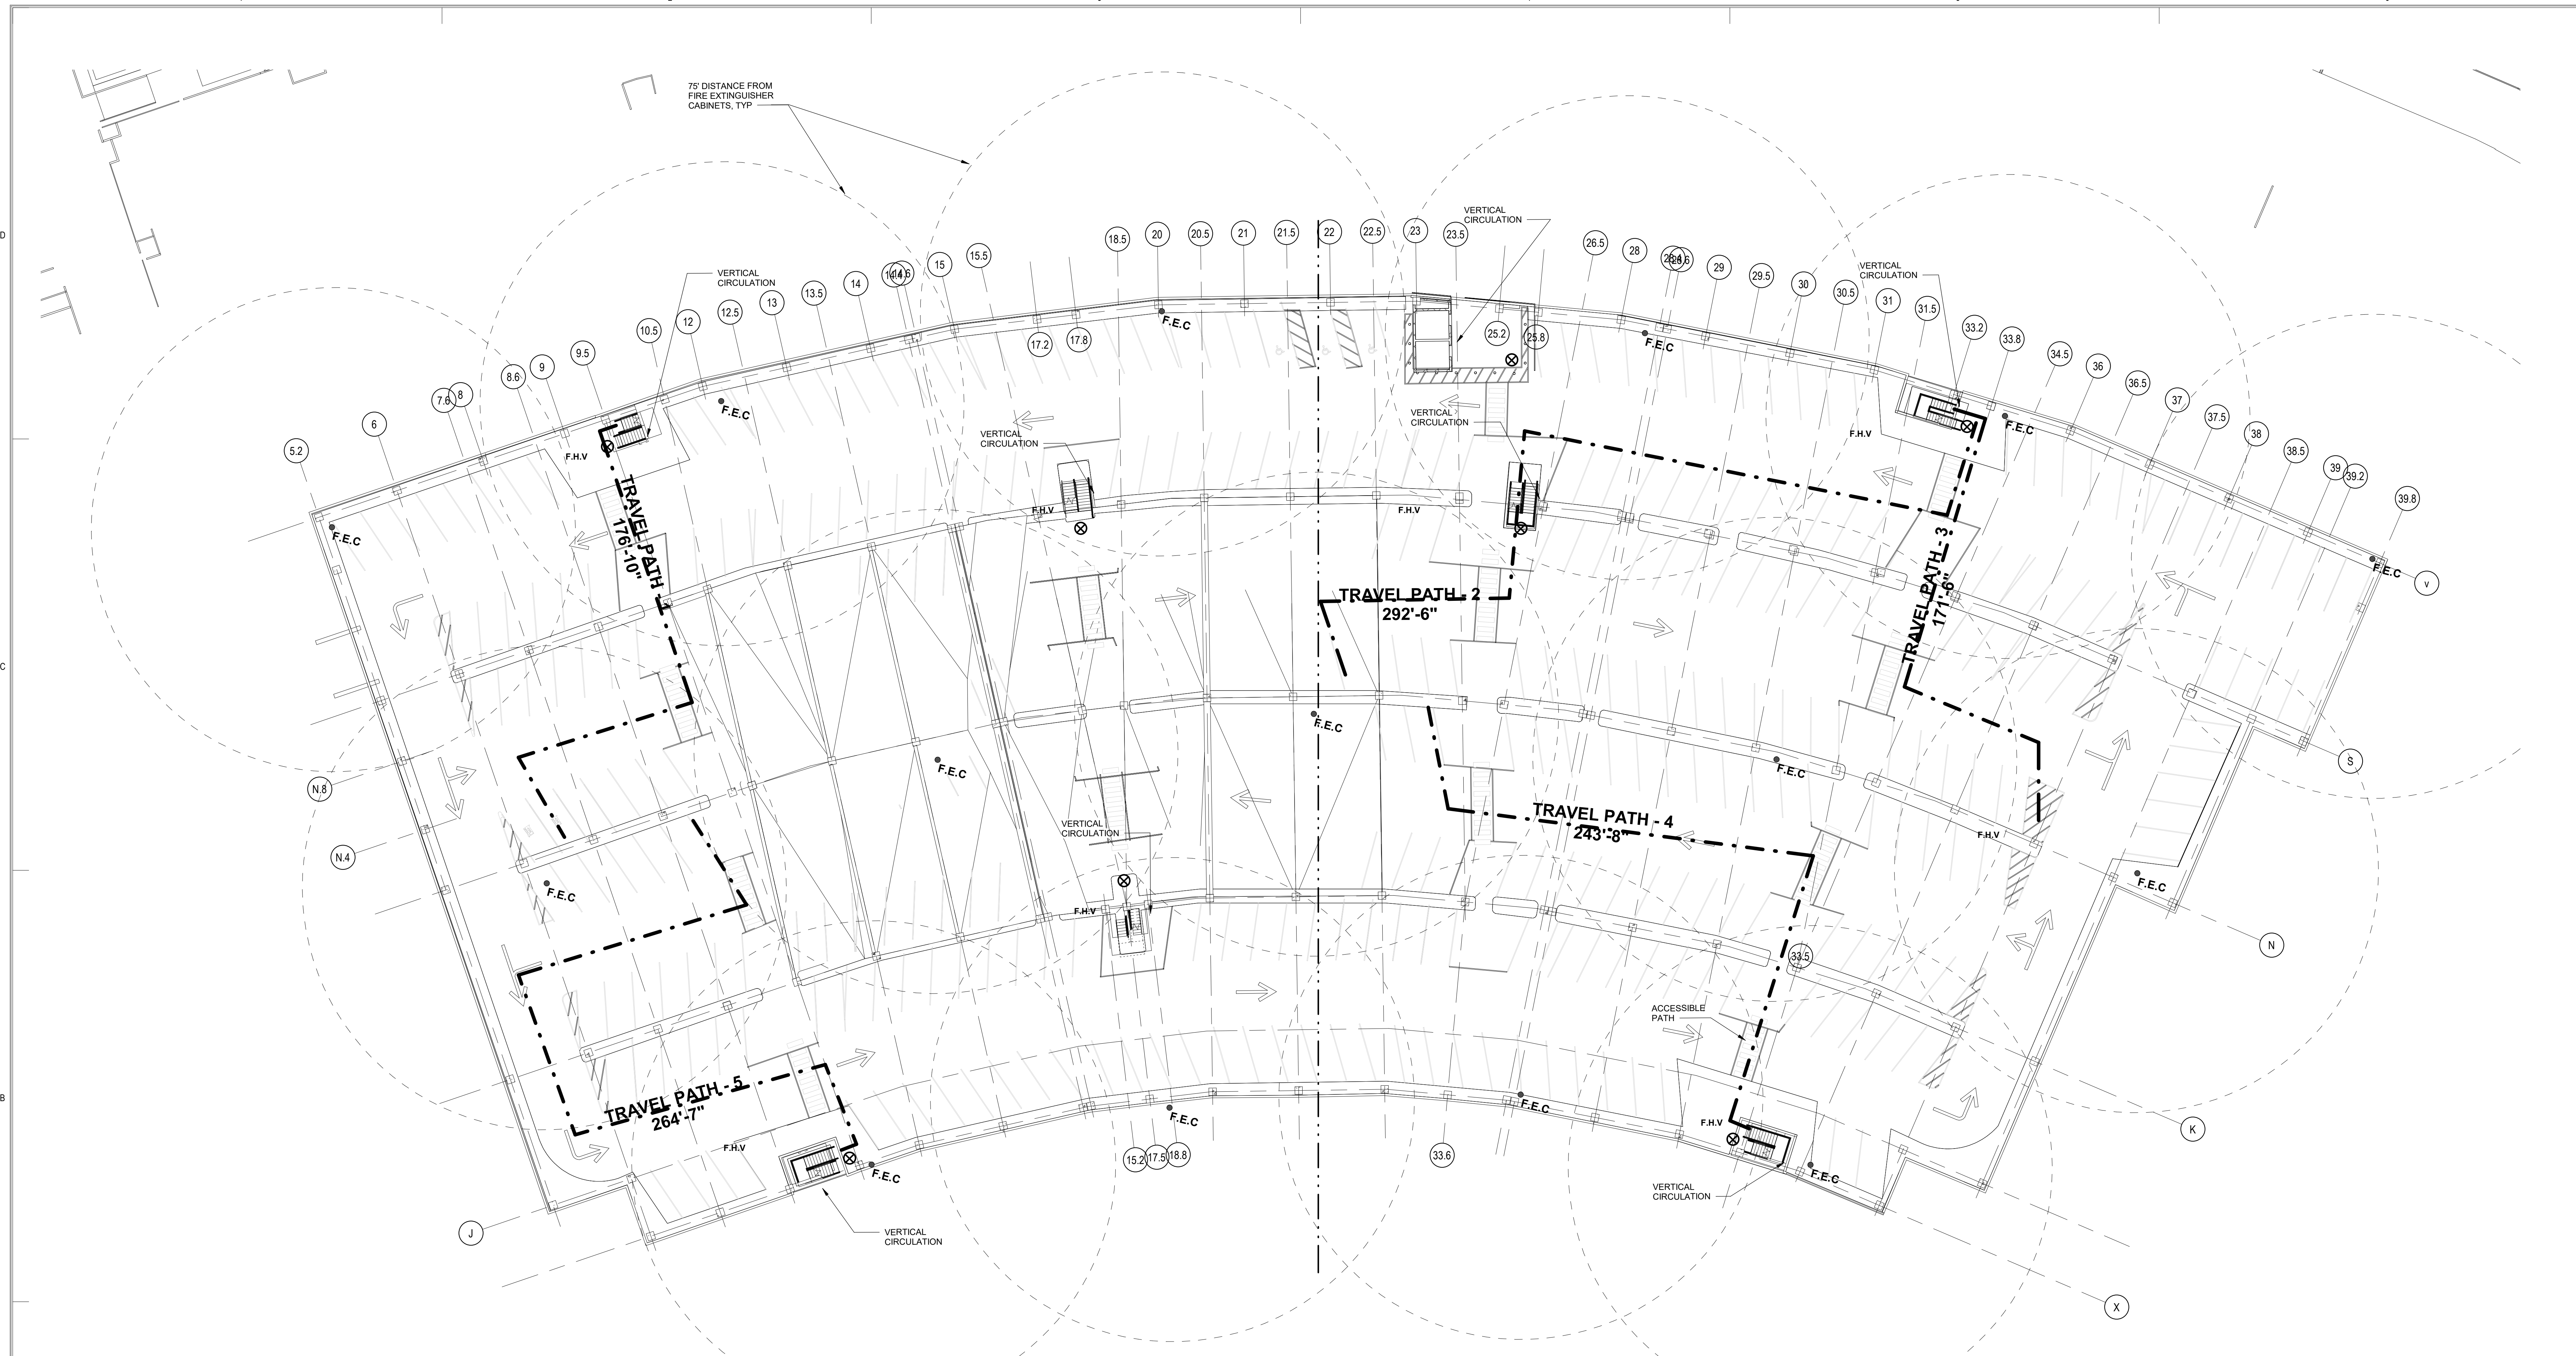


A1 LIFE SAFETY PLAN - LEVEL D
1" = 20'-0"

TRAVEL DISTANCES	
TRAVEL PATH ID	TRAVEL PATH DISTANCE
1	176'-10"
2	292'-6"
3	171'-6"
4	243'-8"
5	264'-7"

AREA SCHEDULE FOR OCCUPANCY LOADS - GARAGE A			
OCCUPANCY	AREA	OLF	OL
AIRSIDE			
S-2	135,132SF	200	675
AVAILABLE EXIT CAPACITY = 980			

LIFE SAFETY PLAN LEGEND	
EXIT SIGNS	⊗
TRAVEL PATH	---
1 HR FIRE RATED WALL	---
FIRE EXTINGUISHER	F.E.C
FIRE HOSE CONNECTION	F.H.V

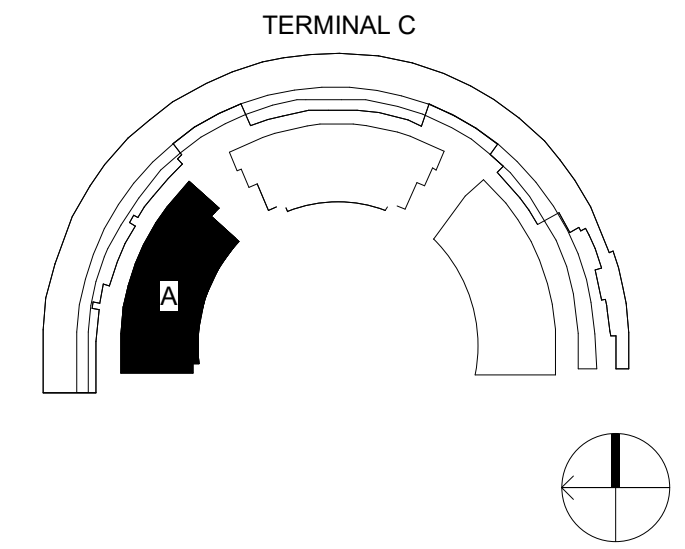

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)


PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
LIFE SAFETY PLAN - LEVEL D

PERMIT NUMBER: B22-0022

SHEET NUMBER
G1104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

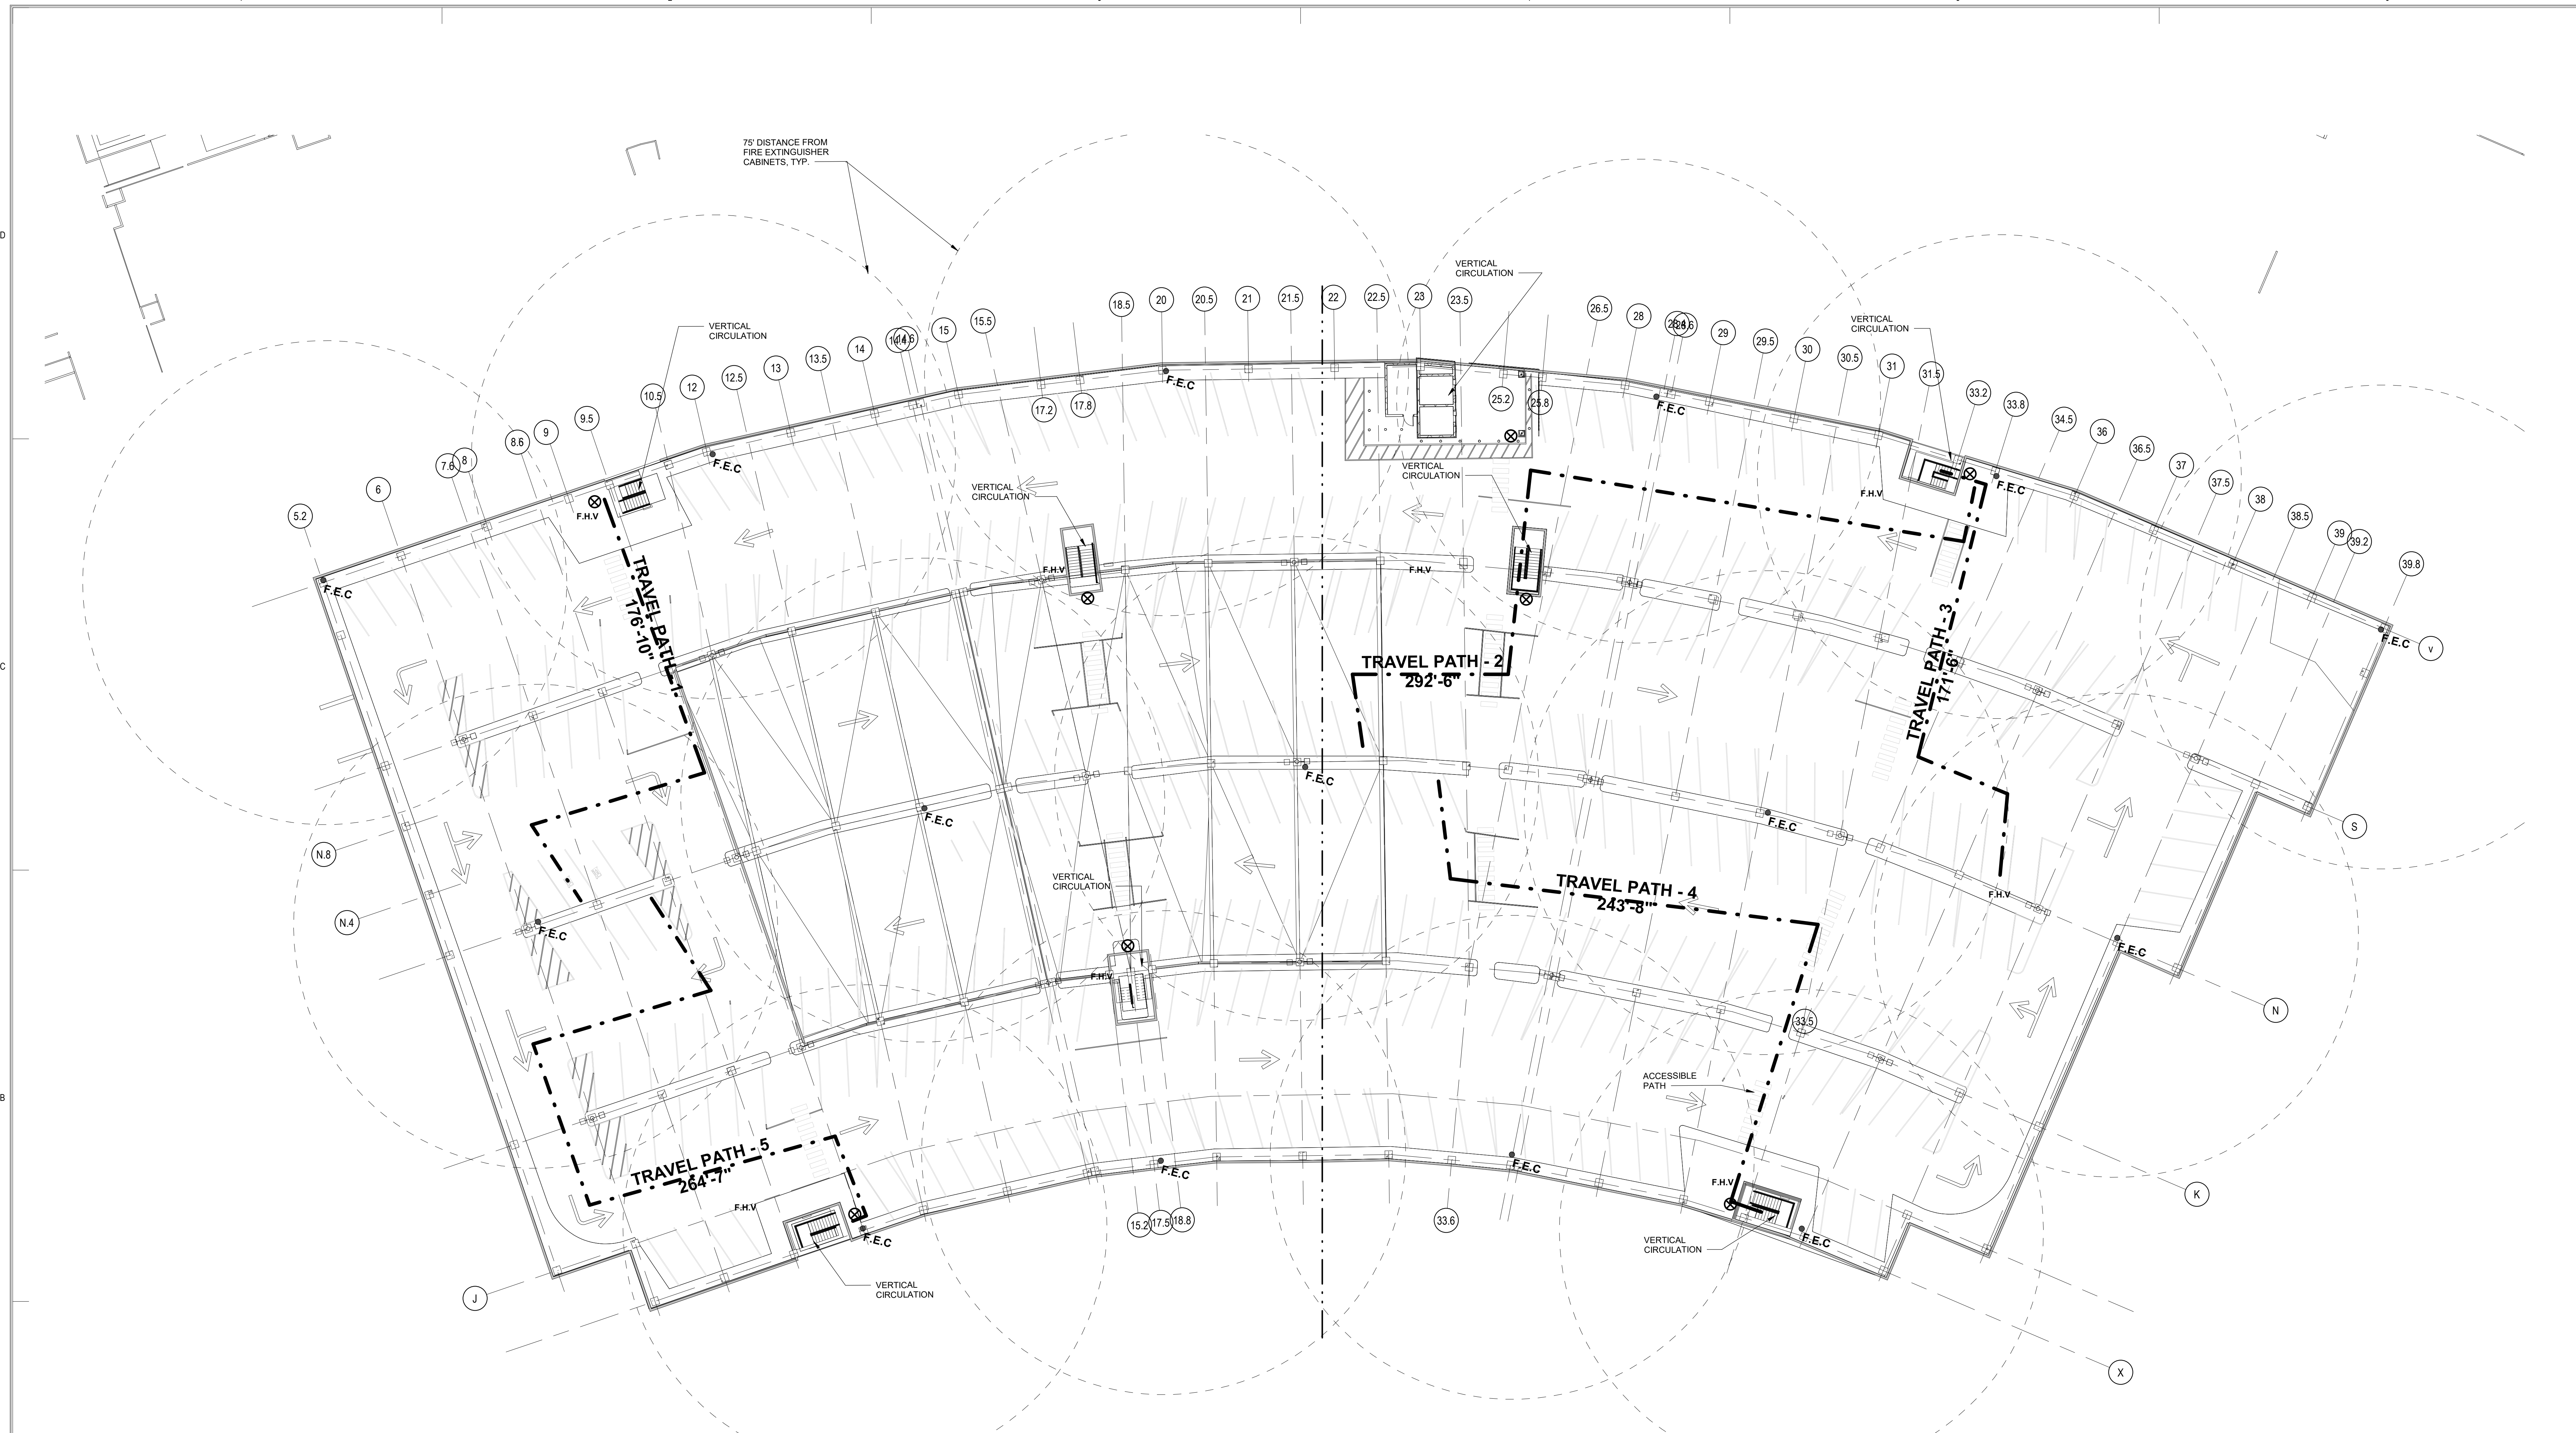


A1 LIFE SAFETY PLAN - LEVEL E
1" = 20'-0"

TRAVEL DISTANCES	
TRAVEL PATH ID	TRAVEL PATH DISTANCE
1	176'-10"
2	292'-6"
3	171'-6"
4	243'-8"
5	264'-7"

AREA SCHEDULE FOR OCCUPANCY LOADS - GARAGE A				
OCCUPANCY	AREA	OLF	OL	
AIRSIDE				
S-2	109,823SF	200	549	

AVAILABLE EXIT CAPACITY = 980

LIFE SAFETY PLAN LEGEND	
EXIT SIGNS	⊗
TRAVEL PATH	---
1 HR FIRE RATED WALL	---
FIRE EXTINGUISHER	F.E.C
FIRE HOSE CONNECTION	F.H.V

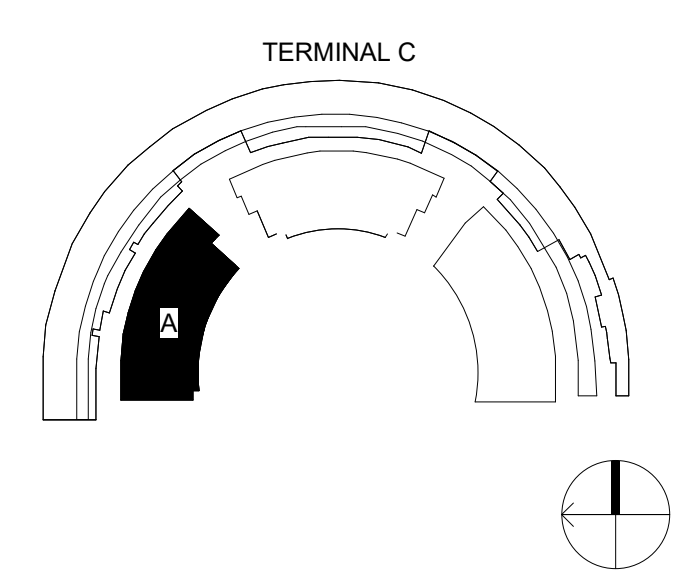

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: Author
APPROVED BY: Approver
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-08-01	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007

DFW TERMINAL C GARAGE AND ROADWAYS - GARAGE A
LIFE SAFETY PLAN - LEVEL E

PERMIT NUMBER: B22-0022

SHEET NUMBER
G1105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

ABBREVIATIONS

-A	COMPRESSED AIR, AUDIO, AMPERE	-H	HEIGHT
A	ALARM BELL	HCLG	HUNG CEILING
ACO	AIR COMPRESSOR	HDS	HEADS
ACV	ALARM CHECK VALVE	HORIZ	HORIZONTAL
AD	ACCESS DOOR, AREA DRAIN	HP	HORSE POWER
AFF	ABOVE FINISHED FLOOR	HVAC	HEATING, VENTILATION, & AIR CONDITIONING
AFG	ABOVE FINISHED GRADE	HZ	HERTZ
AHJ	AUTHORITY HAVING JURISDICTION	-I	IRON BODY, BRONZE MOUNTED
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	IN	INCH
AP	ALARM PANEL	-J	JANITORS CLOSET
AS	AUTOMATIC SPRINKLER	JC	JANITORS CLOSET
ASD	AUTOMATIC SPRINKLER DRAIN	JP	JOCKEY PUMP
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS	JPC	JOCKEY PUMP CONTROLLER
ASTM	AMERICAN SOCIETY FOR TESTING & MATERIALS	-L	LOCAL ALARM PANEL
AUTO	AUTOMATIC	LAP	LOCAL ALARM PANEL
AUX	AUXILIARY	-M	MAXIMUM
AV	ALARM VALVE, AUDIO VISUAL	MAX	MAXIMUM
AWWA	AMERICAN WATER WORKS ASSOCIATION	MECH	MECHANICAL
		MER	MECHANICAL EQUIPMENT ROOM
-B	BY DIRECTIONAL SHUTOFF VALVE	MIN	MINIMUM, MINUTE
BDVS	BELOW FINISHED FLOOR	MTD	MOUNTED
BFF	BELOW FINISHED GRADE	MTGHT	MOUNTING HEIGHT
BFG	BELOW FINISHED GRADE	-N	NORMALLY CLOSED
BFP	BACKFLOW PREVENTOR	NC	NORMALLY CLOSED
BLDG	BUILDING	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
BLWDN	BLOWDOWN	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
BM	BEAM	NIC	NOT IN CONTRACT
BR	BRANCH	NO	NORMALLY OPEN, NUMBER
BSMT	BASEMENT	NS	NO SPRINKLERS IN ROOM
-C	CONNECT TO EXISTING	NTS	NOT TO SCALE
CFM	CUBIC FEET PER MINUTE	-O	ON CENTER
CFSP	COMBINED FIRE STANDPIPE/SPRINKLER	OC	ON CENTER
		OD	OUTSIDE DIAMETER
CLG	CEILING	OS&Y	OPEN STEM AND YOKE
COL	COLUMN	OSHA	OCCUPATIONAL SAFETY AND HEALTH ACT
CONN	CONNECT, CONNECTION		
CP	CHROME PLATED, CONTROL PANEL	-P	PRE-ACTION VALVE
CR	CASING RELIEF VALVE, CONTROL RELAY	PAV	PRE-ACTION VALVE
CTV	CONTROL VALVE	PG	PRESSURE GAUGE
CV	CHECK VALVE	PH	PHASE
CVO	CAPPED AND VALVED OUTLET	PLBG	PLUMBING
-D	EXISTING TO BE DEMOLISHED	PNEU	PNEUMATIC
(D)	EXISTING TO BE DEMOLISHED	PO	PLUGGED OUTLET
DCDA	DOUBLE CHECK DETECTOR ASSEMBLY	PRV	PRESSURE REDUCING VALVE
DEMO	DEMOLITION	PS	PRESSURE SWITCH
DIA	DIAMETER	PSI	POUNDS PER SQUARE INCH
DIPS	DOUBLE INTERLOCK PREACTION SYSTEM	PSP	PREACTION SPRINKLER PIPING
DLV	DELUGE VALVE	-R	REMOVE EXISTING
DN	DOWN	(R)	REMOVE EXISTING
DPAV	DRY PIPE ALARM VALVE	RCV	RISER CONTROL VALVE
DR	DRAIN	REC	RECESSED
DSP	DRY SPRINKLER PIPING	REQD	REQUIRED
DWG	DRAWING	REV	REVISED, REVISION
-E	EXISTING TO REMAIN	RM	ROOM
(E)	EXISTING TO REMAIN	RPM	REVOLUTIONS PER MINUTE
(ER)	EXISTING TO BE RELOCATED	RPZ	REDUCED PRESSURE ZONE
EL	ELEVATION	RV	RELIEVE VALVE
ELEC	ELECTRIC, ELECTRICAL	-S	SLEEVE
EQUIP	EQUIPMENT	SL	SLEEVE
-F	FUTURE	SP	SPRINKLER, SPRINKLER PIPING
(F)	FUTURE	SP HD	SPRINKLER HEAD
F	FIRE SERVICE, FAHRENHEIT, FEMALE	SQ FT	SQUARE FEET
FACP	FIRE ALARM CONTROL PANEL	STD	STANDARD
FCA	FLOOR CONTROL VALVE ASSEMBLY, FAULT CURRENT AVAILABLE	STP	STANDPIPE
FD	FLOOR DRAIN	-T	TOTAL DYNAMIC HEAD
FDC	FIRE DEPARTMENT CONNECTION	TH	TEST HEADER
FE	FIRE EXTINGUISHER	TS	TAMPER SWITCH
FEC	FIRE EXTINGUISHER CABINET	TYP	TYPICAL
FH	FIRE HYDRANT	-U	UNDERWRITERS LABORATORY UNLESS NOTED OTHERWISE
FHC	FIRE HOSE CABINET	UL	UNDERWRITERS LABORATORY UNLESS NOTED OTHERWISE
FHR	FIRE HOSE RACK	UNO	UNDERWRITERS LABORATORY UNLESS NOTED OTHERWISE
FHV	FIRE HOSE VALVE	USSG	UNITED STATES STANDARD GAUGE
FHVC	FIRE HOSE VALVE CABINET	-V	VOLTS, VENT, VIDEO
FL / FLR	FLOOR	V	VOLTS, VENT, VIDEO
FM	FACTORY MUTUAL GLOBAL	VERT	VERTICAL
FO	FOAM PIPING	VO	VALVED OUTLET
FP	FIRE PROTECTION	-W	WITH
FPC	FIRE PUMP CONTROLLER	W	WITH
FPMC	FIRE PUMP	W/O	WITHOUT
FSP	FIRE STAND PIPE	WFS	WATER FLOW SWITCH
FT	FOOT, FEET	WM	WATER METER
FT HD	FOOT HEAD	WMG	WATER MOTOR GONG
*F	FAHRENHEIT	WOG	WATER, OIL, OR GAS
-G	GALLON	WOP	WORKING PRESSURE, WEATHERPROOF
GAL	GALLON	WSP	WORKING STEAM PRESSURE
GALV	GALVANIZED	WT	WEIGHT
GAP	GRAPHIC DISPLAY ANNUNCIATOR PANEL	WTR	WATER
GC	GENERAL CONTRACTOR	WMP	WORKING WATER PRESSURE
GLV	GLOBE VALVE	-Z	ZONE CONTROL VALVE
GPM	GALLONS PER MINUTE	ZCV	ZONE CONTROL VALVE
GV	GATE VALVE		

SYMBOLS LEGEND

ANNOTATION	
	VIEW TITLE SCALE: NTS PLAN TITLE NO. -1
	TITLE FP-201 / SCALE: NTS TITLE MARK DETAIL OR PLAN NO. - 1 FOUND IN FP-201
	DETAIL REFERENCE DETAIL NO. - 1 FOUND IN FP-501
	SECTION MARK SECTION NO. - 1 FOUND IN FP-501
	DETAIL BOUNDARY B DETAIL NO. - 2
	SHEET KEYNOTE
	REVISION CLOUD (DELTA 1)
	EQUIPMENT TAG DESIGNATION AC DESIGNATION NUMBER 1-1
	SPRINKLER PIPE RISER DESIGNATION
	FIRE STAND PIPE RISER DESIGNATION
	POINT OF CONNECTION NOT TO SCALE
	POINT OF DISCONNECTION
FIRE PROTECTION LINES	
	NEW PIPING (SEE ABBREVIATION FOR PIPE I.D.)
	EXISTING TO REMAIN
	EXISTING TO BE DEMOLISHED
FITTINGS	
	RISER
	CAPPED OUTLET
	CONCENTRIC REDUCER
	ECCENTRIC REDUCER
	FLOW ORIFICE
	PIPING CONN - BOTTOM
	PIPING CONN - UP
	PIPING CONN - DOWN
	UNION
	STRAINER
	TEE
SPRINKLER HEADS	
	WATER SPRAY NOZZLE
	PENDANT SPRINKLER
	PENDANT ON DROP NIPPLE
	PENDANT ON DROP NIPPLE W/ GUARD
	SIDEWALL SPRINKLER
	SIDEWALL W/ GUARD
	SIDEWALL SPRINKLER EXTENDED
	SIDEWALL SPRINKLER EXTENDED W/ GUARD
	UPRIGHT SPRINKLER
	UPRIGHT SPRINKLER WITH GUARD
	UPRIGHT SPRINKLER ON RISER NIPPLE
	WINDOW SPRINKLER
FIRE DEPARTMENT CONNECTIONS	
	FREESTANDING SIAMESE CONN
	SIAMESE CONNECTION
	SINGLE CONNECTION
	FIRE PUMP
	FREESTANDING TEST HEADER
	WALL MOUNTED TEST HEADER
	PUBLIC TWO OUTLET HYDRANT
	PUBLIC TWO OUTLET W/ PUMPER CONN HYDRANT
	WALL TWO OUTLET HYDRANT

VALVES	
	AIR VENT - AUTOMATIC
	AUTO AIR RELIEF VALVE
	BALL VALVE
	CHECK VALVE
	CHECK VALVE - ALARM
	INDICATING BUTTERFLY VALVE
	INDICATING BUTTERFLY VALVE WITH TAMPER SWITCH
	GATE VALVE - ANGLED
MISCELLANEOUS	
	BACK FLOW PREVENTER
	ENCLOSED SIGHT CONE
	FIRE EXTINGUISHER CABINET
	FIRST DETECTION BELL AND LIGHT
	FIRST DETECTION HORN AND LIGHT
	FIRE HOSE CABINET
	FIRE HOSE VALVE W/ REDUCER CAP AND CHAIN
	FIRE HOSE VALVE W/ REDUCER ON RACK
	FIXED AIR GAP
	FLOW METER
	FLOW SWITCH
	GRAPHICAL ANNUNCIATOR
	MANUAL PULL STATION
	METAL FIRE EXTINGUISHER
	MOTOR CONTROLLER
	OPEN SIGHT CONE
	PRESSURE GAUGE
	PRESSURE SWITCH
	PURGE PANEL
	SIGHT GLASS
	SMOKE DETECTOR
	SPRINKLER FLOOR CNTL ASSEMBLY
	SPRINKLER FLOOR CNTL ASSEMBLY WITH PRV
	TEST MASTER MODULE
	THERMOMETER GAUGE
	DO NOT ENTER WARN SIGNLIGHT
	WATER FLOW SWITCH
	WATER MOTOR GONG
	FULLY SPRINKLERED SPACE
	NON-SPRINKLERED SPACE
	WET STANDPIPE HOSE STATION
	DRY STANDPIPE HOSE STATION

GENERAL NOTES


- CONTRACTOR SHALL VERIFY EXISTING PIPING RUNS AND CONDITIONS WITH THE NEW WORK PRIOR TO START.
- CONTRACTOR SHALL OBTAIN ALL PERMITS AND FILE ALL WORK INCLUDING HYDRAULIC CALCULATION WITH THE AUTHORITY HAVING JURISDICTION AND OWNERS INSURANCE CARRIER.
- COORDINATE ALL WORK WITH OTHER TRADES PRIOR TO START OF WORK.
- SCHEDULE DRAINDOWN OF EXISTING SPRINKLER SYSTEM WITH OWNER PRIOR TO START OF WORK.
- ALL AUXILIARY DRAINS TO BE IN LOCKABLE CABINETS LOCATED ON ALL FLOORS OF GARAGE.
- TESTING OF SPRINKLER AND STANDPIPE SYSTEM IN ACCORDANCE WITH NFPA AND LOCAL CITY BUILDING CODE. COMPLETE SPRINKLER SYSTEM AND CLASS 1 STAND PIPE SYSTEM SHALL BE INSTALLED OR UPGRADED TO CURRENT DFW STANDARDS.
- PROTECT ALL STANDPIPES, RISERS, AND HOSE CONNECTIONS AT ROADWAYS AND PARKING SPACES WITH BOLLARDS OR OTHER PROTECTION MEANS AT ALL LEVELS OF GARAGE.
- REPLACE DRAIN COVER FOR ALL REQUIRED DRAINS ON ROOF LEVEL.

SHEET INDEX

NO.	TITLE	SCALE
F-001-900A	FIRE PROTECTION COVER SHEET	NONE
F-002-900A	FIRE PROTECTION SCHEDULES	NONE
F-201-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL A - PHASE 3	1" = 20'-0"
F-202-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL B - PHASE 3	1" = 20'-0"
F-203-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL C - PHASE 3	1" = 20'-0"
F-204-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL D - PHASE 3	1" = 20'-0"
F-205-900A	GARAGE A FIRE PROTECTION PLAN - LEVEL E - PHASE 3	1" = 20'-0"
F-401-900A	FIRE PROTECTION ENLARGED PLAN	AS NOTED
F-501-900A	FIRE PROTECTION DETAILS	NONE



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

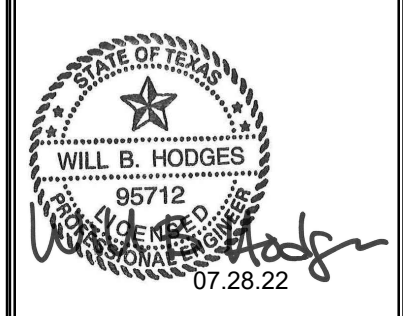

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-07-28	75% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007

Garage A
FIRE PROTECTION COVER SHEET

PERMIT NUMBER: 822-0022

SHEET NUMBER
F-001-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

PIPING MATERIALS AND APPLICATIONS SCHEDULE


SERVICE	LINE SIZE	PIPE	FITTINGS	JOINTS	NOTES	
		PRESSURE CLASS 150 COATED & LINED DUCTILE IRON SCHEDULE 40 CARBON STEEL ASTM A 53B 1/20 SCHEDULE 10 BLACK STEEL ASTM A 106 OR ASTM A 178	DUCTILE IRON GASKETED MECHANICAL JOINT SCHEDULE 40 CARBON STEEL VICTAULIC	CLASS 125 GALVANIZED CAST IRON THREADED WELDED BOLTED CARBON STEEL FLANGED CLASS 125 CAST IRON THREADED MALLEABLE CAST IRON THREADED DUCTILE IRON MECHANICAL JOINT FLANGED DUCTILE IRON MECHANICAL JOINT ASTM A 47 BUTT WELDED FLANGED WITH MECHANICAL JOINT THREADED WITH FLON BASED JOINT COMPOUND MALLEABLE CAST IRON MECHANICAL JOINT DUCTILE IRON MECHANICAL JOINT ASTM A 536		1. PAINT ALL EXPOSED ABOVEGROUND PIPING RED. 2. USE WELDED STEEL FLANGES AT VALVES 3. BRANCH LINE TAKE-OFFS SHALL BE WELDED/THREADED OUTLETS EQUAL TO THREAD-O-LET. 4. SPOOL-PIECES SHALL BE FABRICATED COMPLETE WITH WELDED FLANGES AND WELDED BRANCH LINE TAKE-OFFS PRIOR TO GALVANIZING.
ABOVEGROUND FIRE SERVICE MAINS AND WET FEED MAINS	4" AND LARGER	•	•	•	1,2	
WET/DRY/PREACTION SPRINKLER LINES	2-1/2" AND LARGER	•	•	•	1,2,3,4	
	2" AND SMALLER	•	•	•	1,2,3,4	
MISCELLANEOUS DRAIN LINES	2" AND SMALLER	•	•	•	1	

NOTES:
ALL PIPE AND FITTINGS SHALL BE OF DOMESTIC MANUFACTURER AND SHALL MEET THE REQUIREMENTS OF SPECIFICATIONS.



DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

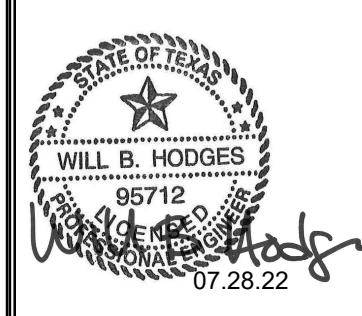

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7069

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-07-28	100% DESIGN
2	2022-09-01	100% DESIGN
3	2022-09-28	100% ISSUED FOR PERMIT (IFP)


Garage A

FIRE PROTECTION SCHEDULES

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
F-002-900A

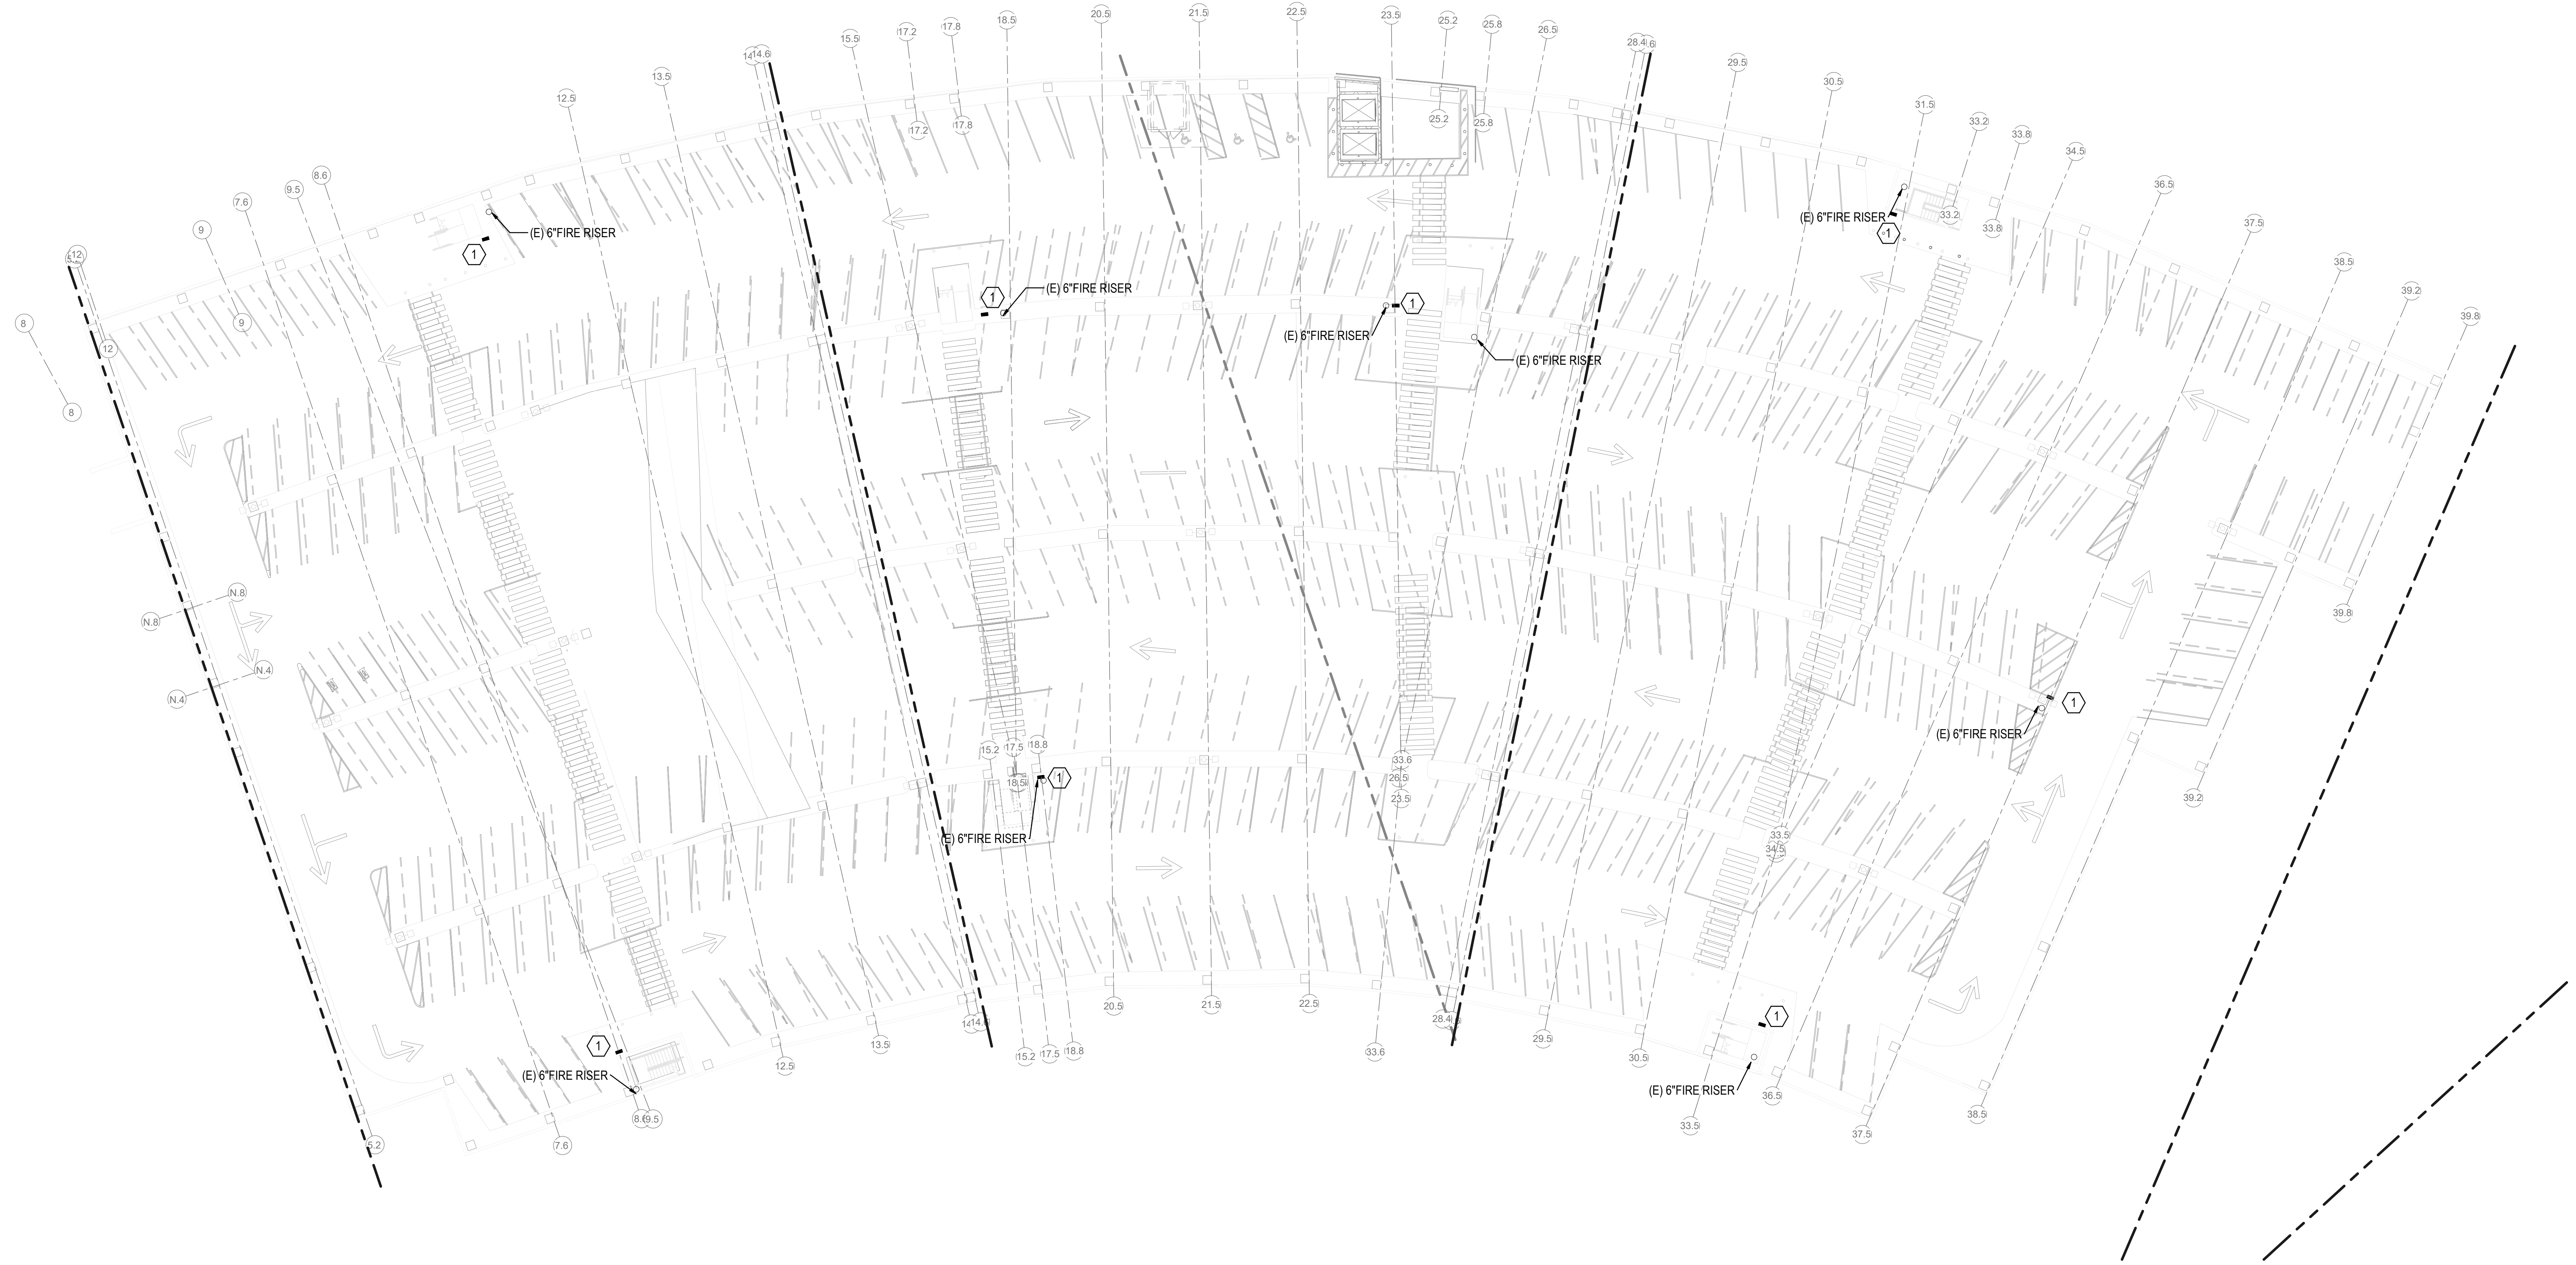


SHEET NOTES

1. REFER TO SHEET FP-001 FOR FIRE PROTECTION GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. EXISTING FIRE HOSE CABINET TO BE REMOVED AND 2-1/2\"/>

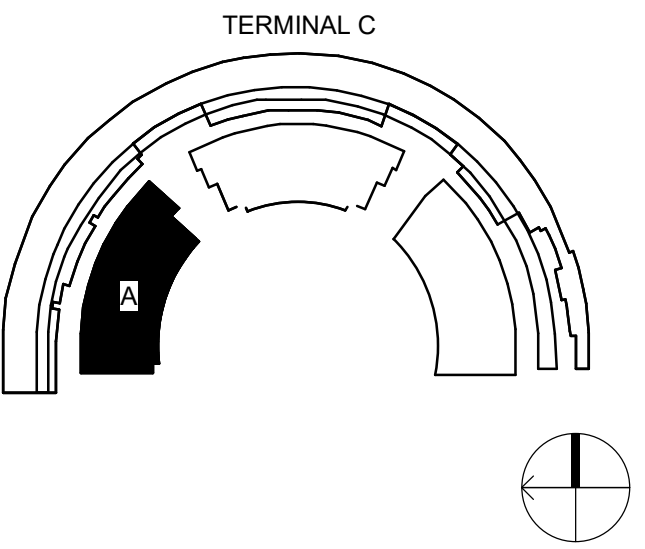

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

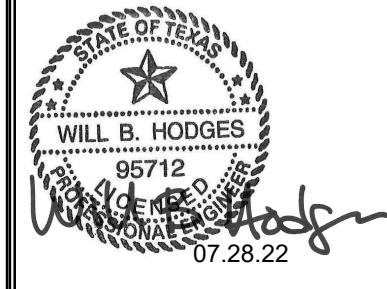

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

Helmuth, Obata & Kassabaum, Inc.
717 North Riverfront Street
Suite 2800, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION


Garage A
GARAGE A FIRE PROTECTION PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
F-204-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

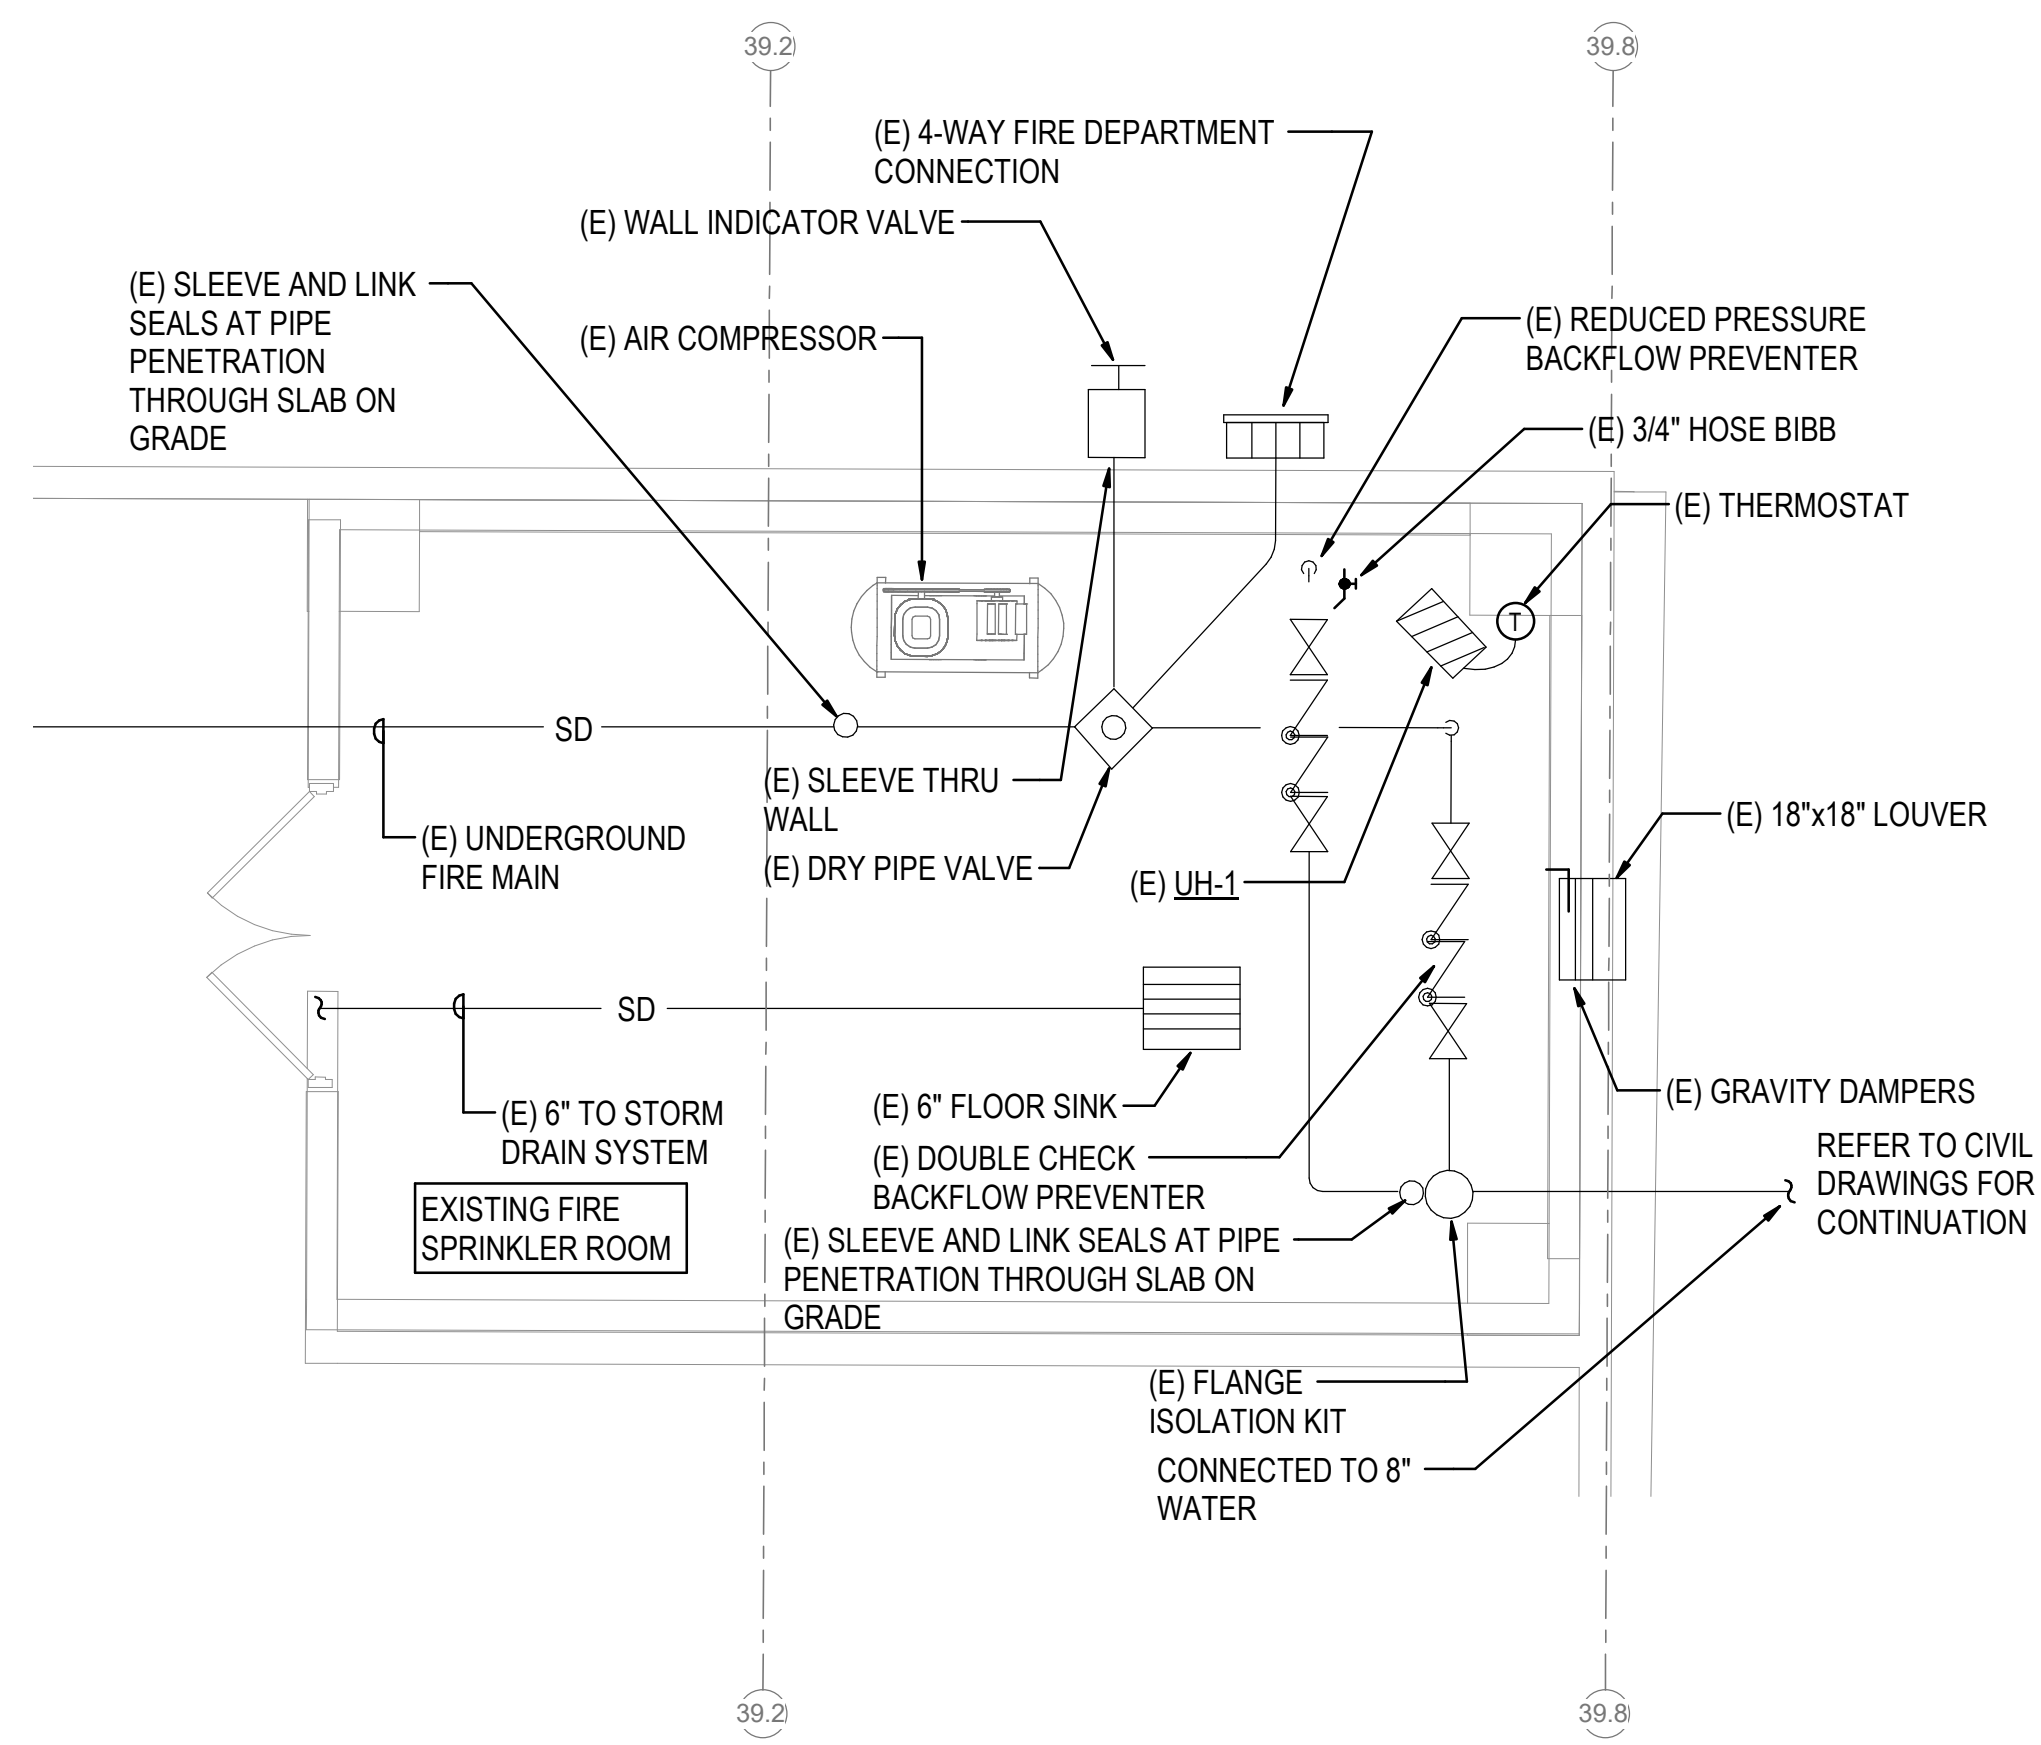

1 FIRE PROTECTION - PUMP ROOM
ENLARGED PLAN
SCALE: 1/4" = 1'-0"

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

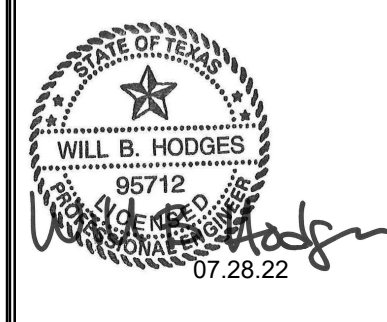

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7069

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

Helmuth, Obata & Kassabaum, Inc.
717 North Marwood Street
Suite 2050, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: Author
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
	2022-02-01	100% DESIGN
	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A

FIRE PROTECTION ENLARGED PLAN


PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022


SHEET NUMBER
F-401-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


D
C
B
A

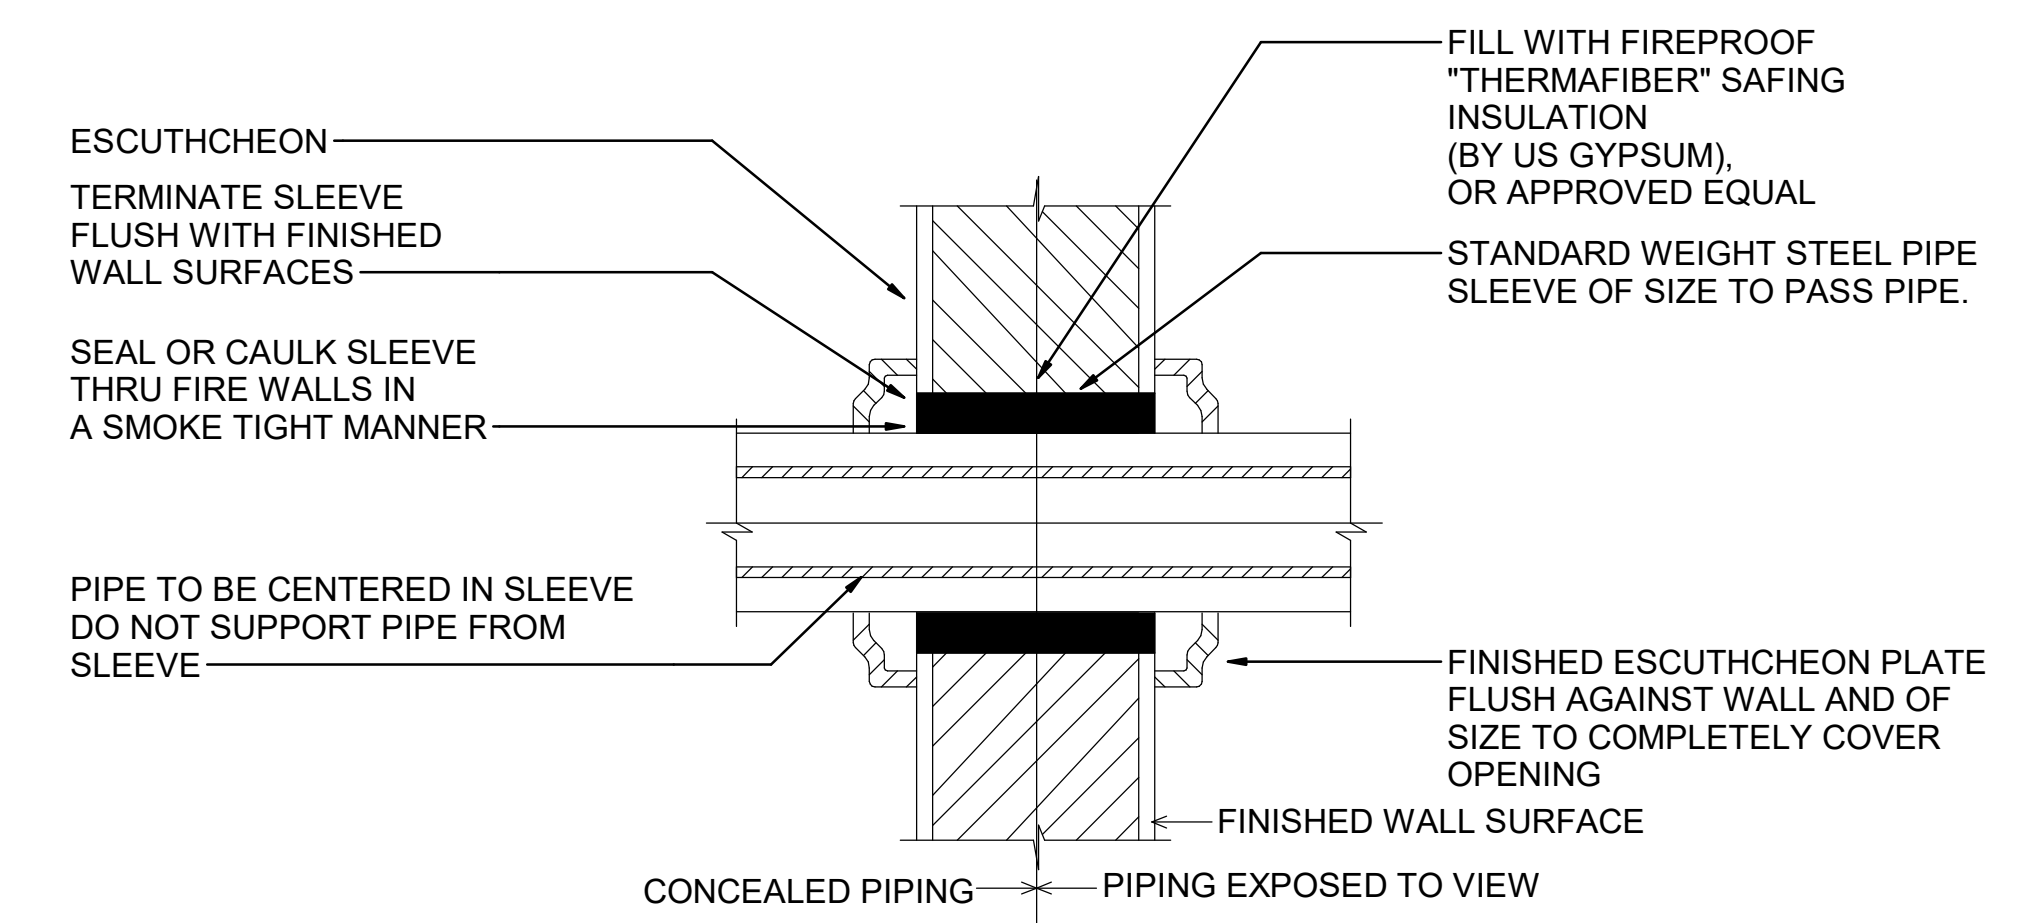

2 PIPE SLEEVE THROUGH WALL DETAIL
SCALE: N.T.S.

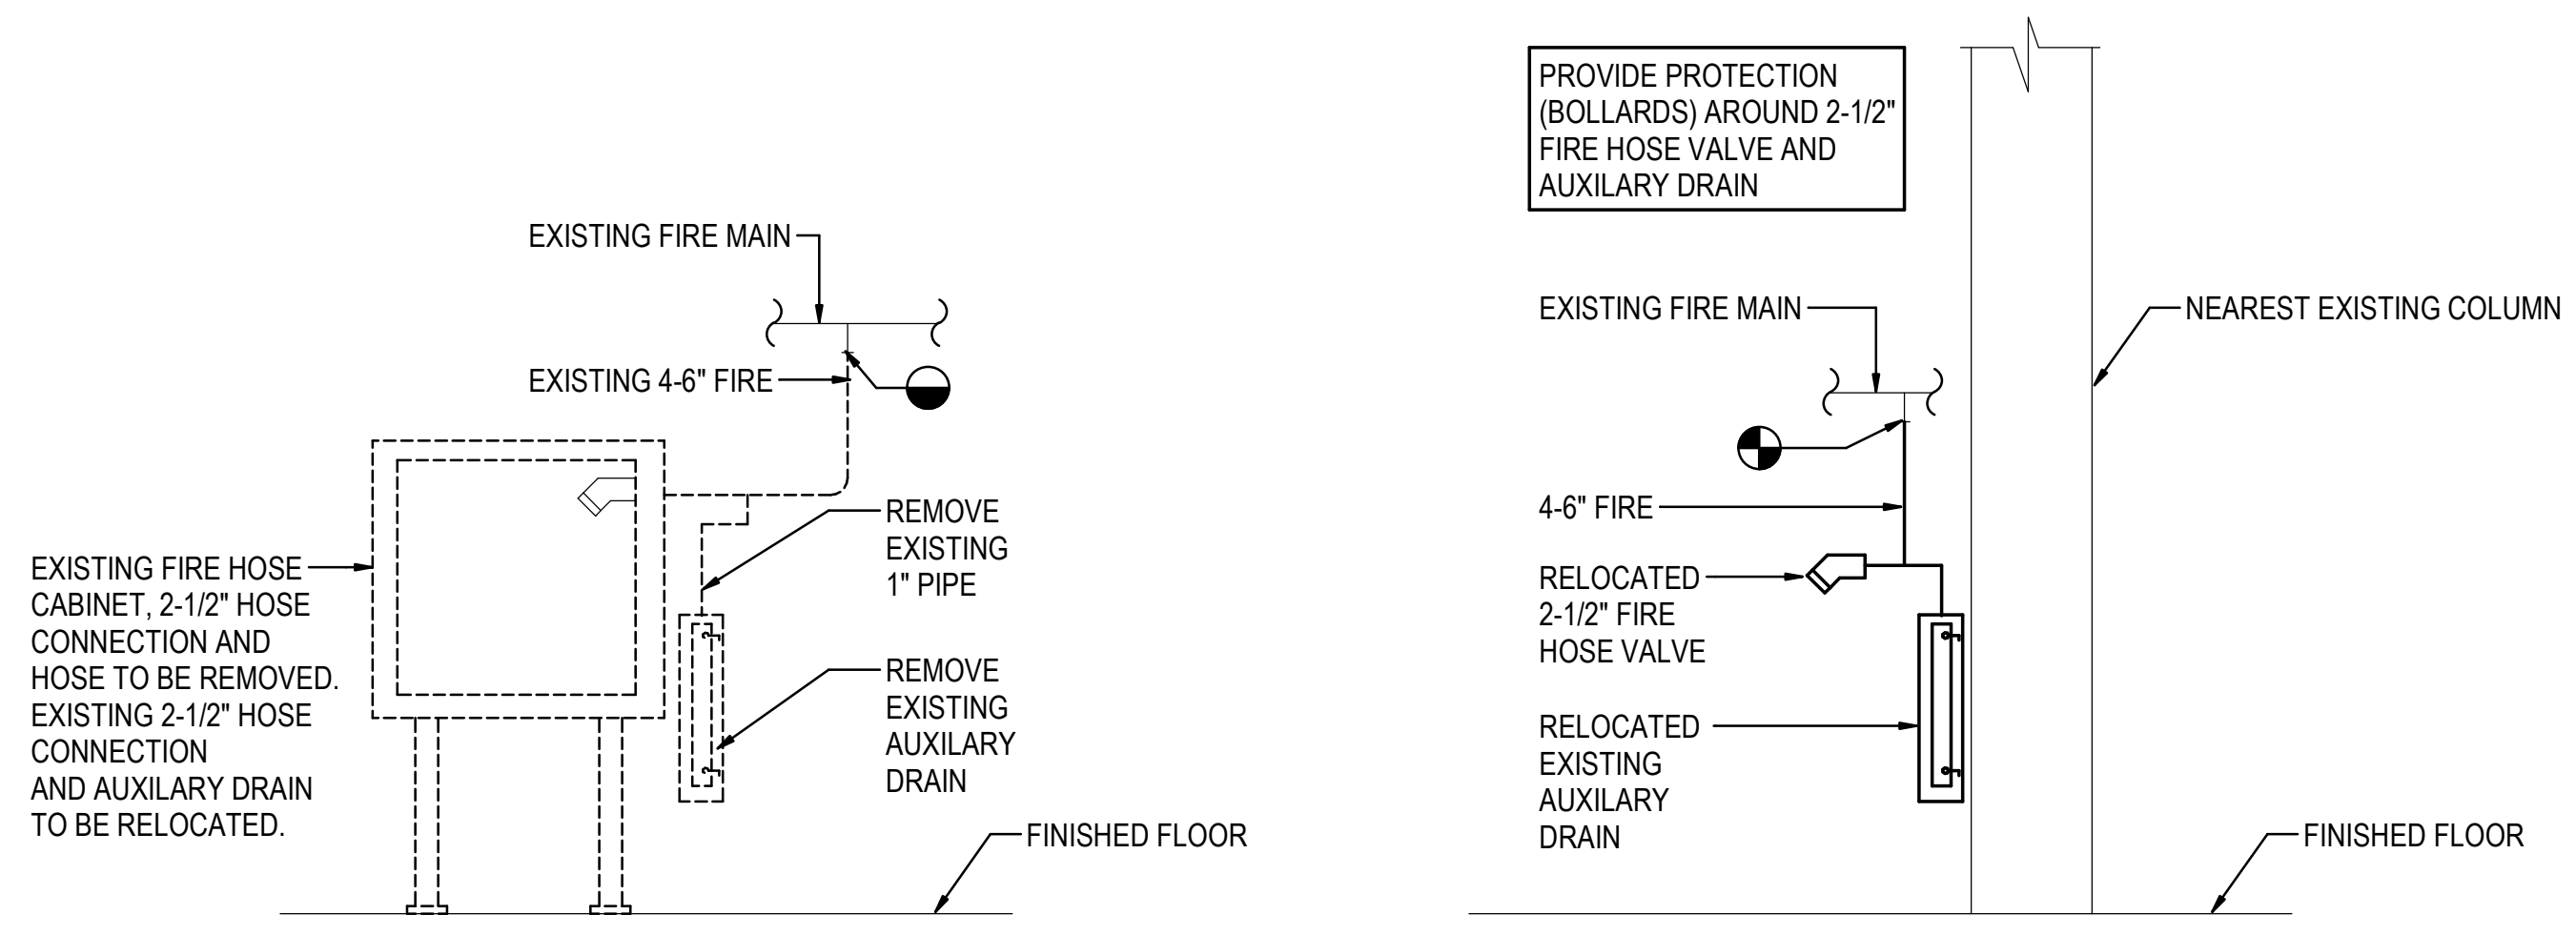


3 FIRE HOSE VALVE DETAIL
SCALE: N.T.S.

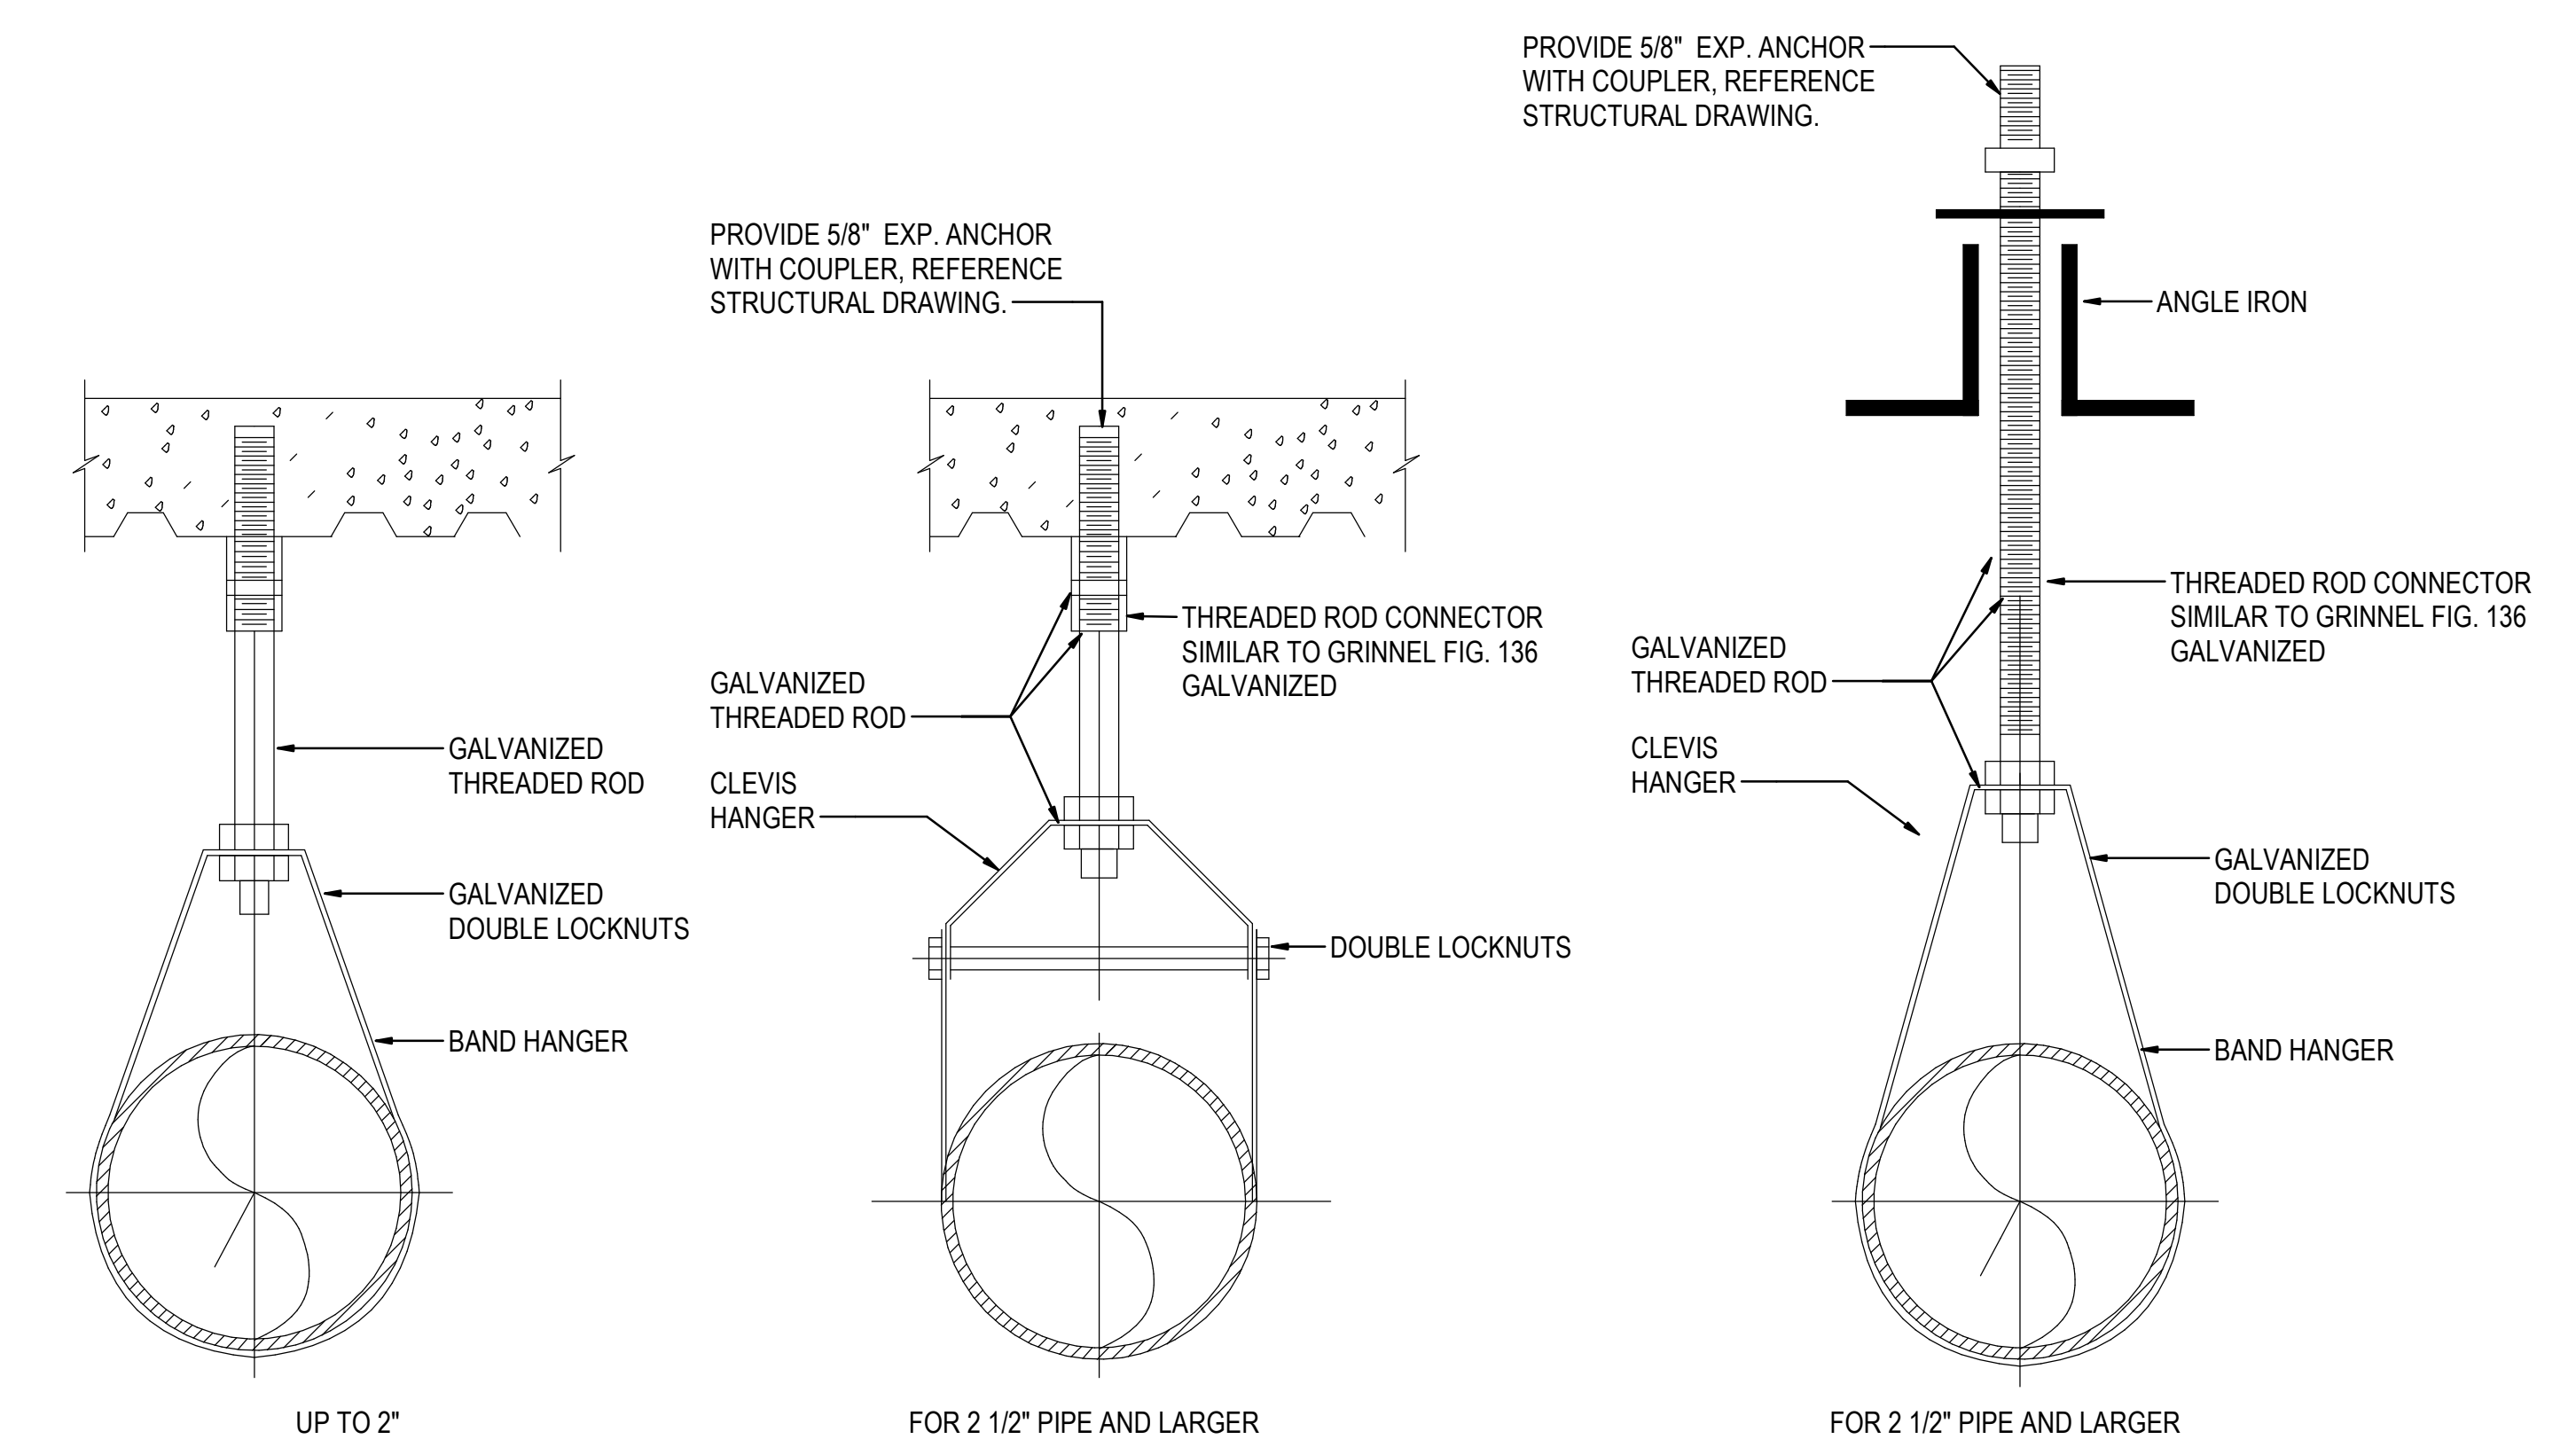

1 PIPE SUPPORT DETAIL
SCALE: N.T.S.



DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

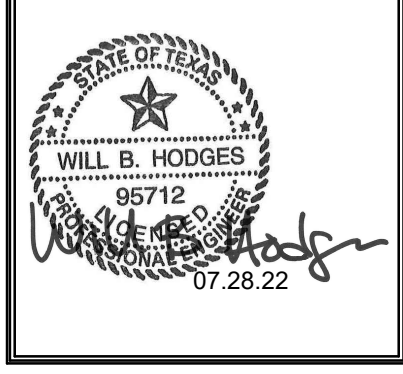

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue, Suite 415, Dallas, TX 75206
Tel: 972-470-0704, www.syska.com
Heinrich, Clark & Rosenbaum, Inc. 717 North Harwood Street, Suite 2050, LB # Dallas, TX 75201, 4124 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

Garage A
FIRE PROTECTION DETAILS
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
F-501-900A

ABBREVIATIONS

-A-	ABANDON	-M-	MAXIMUM
ABAN	ABANDON	MAX	MECHANICAL
ACS DR	ACCESS DOOR	MECH	MEDIUM
AFF	ABOVE FINISHED FLOOR	MED	MEDIUM EQUIPMENT ROOM
AG	AIR GAP	MFR	MANUFACTURER
AHJ	AUTHORITY HAVING JURISDICTION	MGCV	MASTER GAS CONTROL VALVE
AP	ACCESS PANEL	MIN	MINIMUM, MINUTE
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS	MS	MOP SINK
ASSE	AMERICAN SOCIETY OF SANITARY ENGINEERS	MTGHT	MOUNTING HEIGHT
ASTM	AMERICAN SOCIETY FOR TESTING & MATERIALS	-N-	NORMALLY CLOSED
AW	ACID WASTE	NC	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
AWWA	AMERICAN WATER WORKS ASSOCIATION	NEMA	NORMALLY OPEN, NUMBER
-B-		NO	NOT IN CONTRACT
BFF	BELOW FINISHED FLOOR	NP	NON-POTABLE WATER
BFP	BACKFLOW PREVENTOR	NTS	NOT TO SCALE
BLDG	BUILDING	-O-	
BLW	BELOW / UNDERGROUND	OC	ON CENTER
BLWDN	BLOWDOWN	OD	OUTSIDE DIAMETER
BMS	BUILDING MANAGEMENT SYSTEM	ORD	OVERFLOW ROOF DRAIN
-C-		OS&Y	OPEN STEM AND YOKE
CAP	CAPACITY, CAPACITOR	OSHA	OCCUPATIONAL SAFETY AND HEALTH ACT
CFM	CUBIC FEET PER MINUTE	-P-	
CL	CENTER LINE, CLOSE, CLOSET	PIV	POST INDICATOR VALVE
CLG	CEILING	PLBG	PLUMBING
CNDS	CONDENSATE	PLD	PLENUM DRAIN
CO	CLEANOUT	POS	POSITIVE
CONN	CONNECT, CONNECTION	PSI	POUNDS PER SQUARE INCH
COORD	COORDINATE	-R-	
CU FT	CUBIC FEET	R	RISE
CU IN	CUBIC INCH	RD	ROOF DRAIN
CV	CHECK VALVE	REC	RECESSED
CW	COLD WATER	REFR	REFRIGERATION
-D-		REM	REMOVABLE
(D)	EXISTING TO BE DEMOLISHED	REQD	REQUIRED
DEG	DEGREE	REV	REVISED, REVISION
DEMO	DEMOLITION	RM	ROOM
DF	DRINKING FOUNTAIN	RO	REVERSE OSMOSIS
DIA	DIAMETER	RPM	REVOLUTIONS PER MINUTE
DN	DOWN	RR	ROOF RECEPTOR
DOM	DOMESTIC	-S-	
DR	DRAIN	S	SOIL
DWG	DRAWING	SA	SHOCK ABSORBER, SUPPLY AIR
DWH	DOMESTIC WATER HEATER	SAN	SANITARY
-E-		SCP	SCUPPER
(E)EX	EXISTING TO REMAIN	SD	STORM DRAIN
(ER)	EXISTING TO BE RELOCATED	SE	SEWAGE EJECTOR
EJ	EJECTOR	SED	SEWAGE EJECTOR DISCHARGE
EL	ELEVATION, ELEVATOR LOBBY	SK	SINK
EQ	EQUAL	SMP	SUMP PUMP
EQUIP	EQUIPMENT	SMPD	SUMP PUMP DISCHARGE
EWC	ELECTRIC WATER COOLER	SPEC	SPECIFICATION
EWH	ELECTRIC WATER HEATER	SQ FT	SQUARE FEET
EWS	EYEWASH STATION	SS	STAINLESS STEEL
-F-		STD	STANDARD
F	FAHRENHEIT, FIRE SERVICE, FEMALE	STRUC	STRUCTURAL
FCO	FLOOR CLEANOUT	-T-	
FD	FLOOR DRAIN	T&P	TEMPERATURE AND PRESSURE VALVE
FF EL	FINISH FLOOR ELEVATION	VALVE	VALVE
FL/FLR	FLOOR	TD	TRENCH DRAIN
FT	FOOT, FEET	TDH	TOTAL DYNAMIC HEAD
-G-		TEMP	TEMPERATURE
G	GAS, GROUND, GREEN	TP	TRAP PRIMER
GAL	GALLON	TS	TAMPER SWITCH
GALV	GALVANIZED	TYP	TYPICAL
GC	GENERAL CONTRACTOR	-J-	
GPF	GALLONS PER FLUSH	UGND	UNDERGROUND
GPH	GALLONS PER HOUR	UL	UNDERWRITERS LABORATORY
GPM	GALLONS PER MINUTE	UR	URINAL
GR FL	GROUND FLOOR	-V-	
GWH	GAS WATER HEATER	V	VENT, VOLT, VIDEO
-H-		VB	VACUUM BREAKER
HD	HUB DRAIN	VEL	VELOCITY
HDC	HANDICAPPED	VIF	VERIFY IN FIELD
HLAV	HANDICAPPED LAVATORY	VOL	VOLUME
HORIZ	HORIZONTAL	VOV	VALVE ON VERTICAL
HTR	HEATER	VTR	VENT THROUGH ROOF
HJR	HANDICAPPED URINAL	-W-	
HVAC	HEATING, VENTILATION, & AIR CONDITIONING	W	WIDTH, WASTE, WIRE, WALL PHONE, WATT
HW	HOT WATER	W	WITH
HWC	HANDICAPPED WATER CLOSET	W/O	WITHOUT
HWCP	HOT WATER CIRCULATION PUMP	WC	WATER CLOSET
HWP	HOT WATER PUMP	WCO	WALL CLEANOUT
-I-		WFS	WATER FLOW SWITCH
ID	INSIDE DIMENSION	WHA-A	WATER HAMMER ARRESTOR (LETTER INDICATES P.D.I. SIZE)
IE	INVERT ELEVATION	WM	WATER METER
IN	INCH	WMS	WIRE MESH SCREEN
-J-		WSP	WORKING STEAM PRESSURE
JC	JANITORS CLOSET	WT	WEIGHT
-K-		WTR	WATER
KW	KILOWATT	WWP	WORKING WATER PRESSURE
-L-		-Z-	
LAB	LABORATORY	ZCV	ZONE CONTROL VALVE
LAP	LOCAL ALARM PANEL		
LAV	LAVATORY		
LBS	POUND(S)		
LPD	LITERS PER DAY		

SYMBOLS LEGEND

ANNOTATION	
	VIEW TITLE SCALE: NTS PLAN TITLE NO. -1
	TITLE SCALE: NTS TITLE MARK DETAIL OR PLAN NO. -1 FOUND IN P-201
	DETAIL REFERENCE DETAIL NO. -1 FOUND IN P-501
	SECTION MARK SECTION NO. -1 FOUND IN P-501
	DETAIL BOUNDARY B DETAIL NO. -2
	SHEET KEYNOTE
	REVISION CLOUD (DELTA 1)
	EQUIPMENT TAG DESIGNATION AC DESIGNATION NUMBER 1-1
	DOMESTIC WATER RISER DESIGNATION
	SANITARY WATER RISER DESIGNATION
	STORM WATER RISER DESIGNATION
	NATURAL GAS RISER DESIGNATION
	POINT OF CONNECTION
	POINT OF DISCONNECTION
PLUMBING LINES	
	NEW PIPING (SEE ABBREVIATION FOR PIPE I.D.)
	EXISTING TO REMAIN
	EXISTING TO BE DEMOLISHED
	UNDERGROUND / BELOW
	COLD WATER
	HOT WATER
	HOT WATER RETURN
	VENT
CONTROL DEVICES	
	PIPE HEAT TRACER
VALVES	
	AIR VENT - AUTOMATIC
	BACK WATER VALVE
	BALANCING VALVE
	BALL VALVE
	BALL VALVE - MOTORIZED
	BUTTERFLY VALVE
	CHECK VALVE
	DIAPHRAGM VALVE
	DRAIN VALVE
	FLOAT VALVE
	FUSIBLE LINK
	GATE VALVE
	GATE VALVE - OS&Y
	GLOBE VALVE
	MASTER GAS CONTROL VALVE
	PLUG VALVE
	PLUG SAFETY
	PRESSURE REDUCING VALVE
	PRESSURE RELIEF VALVE
	SEISMIC GAS CONTROL VALVE
	SOLENOID VALVE
	VALVED IN VERTICAL (DROP)
	VALVED IN VERTICAL (RISE)
	VALVED AND CAPPED OUTLET

MISCELLANEOUS	
	BACK FLOW PREVENTER
	HOSE BIBB
	METER
	TRAP PRIMER
	WALL HYDRANT
	WATER HAMMER ARRESTOR - SUFFIX INDICATES PDI SIZE
	VACUUM BREAKER
FITTINGS	
	CLEANOUT
	CLEANOUT TO GRADE
	ELBOW DOWN
	ELBOW DOWN TO TEE
	ELBOW UP
	END CAP
	P-TRAP
	TEE DOWN
	TEE UP
	TEE SIDE OUTLET DOWN
	TEE SIDE OUTLET UP
	UNION
	VENT THROUGH ROOF
DRAINS	
	AREA DRAIN
	FLOOR DRAIN
	FLOOR SINK
	FLOOR SINK W/ HALF GRATE
	HUB DRAIN
	ROOF DRAIN
	ROOF DRAIN OVERFLOW
	ROOF RECEPTOR
	TRENCH DRAIN

GENERAL NOTES


- DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS. EXACT LOCATION SHALL BE COORDINATED WITH ALL TRADES, THE STRUCTURAL DRAWINGS, ARCHITECTURAL DRAWINGS, AND/OR GENERAL CONTRACTOR AND CONSTRUCTION MANAGER.
- LOCATION AND SIZES OF EXISTING PIPING ARE APPROXIMATE. VERIFY THE LOCATIONS AND SIZES OF EXISTING PIPING IN THE FIELD. IF ANY DISCREPANCIES OCCUR WITH THE CONTRACT DRAWINGS, NOTIFY THE ARCHITECT AND/OR THE ENGINEER PRIOR TO COMMENCEMENT OF NEW WORK.
- ALL EXPOSED PIPING PENETRATIONS THROUGH WALLS OR CEILINGS SHALL BE PROVIDED WITH APPROPRIATE FIRE RETARDANT SEALANT AND ESCUTCHEONS.
- SEAL OPENINGS AROUND PLUMBING WORK AND PIPING THROUGH PARTITIONS, WALLS AND FLOORS (NOT IN SHAFTS) WITH NON-COMBUSTIBLE MATERIAL AND ESCUTCHEONS.
- SUBMISSION OF A PROPOSAL SHALL BE EVIDENCE THAT A CAREFUL EXAMINATION OF THE SITE, DRAWINGS & SPECIFICATIONS HAVE BEEN MADE AND THE CONTRACTOR IS FAMILIAR WITH THOSE ITEMS AND AREAS THAT WILL PRESENT DIFFICULTY TO THE PERFORMANCE OF THIS CONTRACT. LATER CLAIMS SHALL NOT BE MADE FOR LABOR, EQUIPMENT, ETC. NECESSARY TO COMPLETE ALL WORK AS A RESULT OF DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN.
 - CONTRACTOR TO VERIFY THE EXISTING CONDITIONS BEFORE CONSTRUCTION; CONFIRMING SIZES AND LOCATIONS OF ALL EXISTING PIPING PRIOR TO START OF WORK.
 - ALL DIMENSIONS AND EXISTING CONDITIONS SHALL BE CHECKED AND VERIFIED BY THE CONTRACTOR AT THE SITE BEFORE PROCEEDING WITH ANY WORK.
 - PRIOR TO STARTING DEMOLITION, DETERMINE LOCATIONS AND EXISTING CONDITIONS.
- THIS CONTRACTOR SHALL PAY FEES, GIVE NOTICE, FILE NECESSARY DRAWINGS AND OBTAIN PERMITS AND CERTIFICATES OF APPROVAL REQUIRED IN CONNECTION WITH WORK UNDER THIS CONTRACT AND COMPLY WITH LOCAL LAWS AND ORDINANCES.
- PROVIDE ALL REQUIRED LABOR, MATERIALS, EQUIPMENT, AND SERVICES NECESSARY FOR A COMPLETE AND SAFE INSTALLATION OF MECHANICAL IN FULL CONFORMITY WITH REQUIREMENTS OF ALL AUTHORITIES HAVING JURISDICTION, ALL AS INDICATED ON DRAWINGS AND/OR HEREIN SPECIFIED FOR THE SYSTEMS INCLUDED. WORK SHALL BE INSTALLED IN A NEAT, WORKMANLIKE MANNER. INCLUDE ALL COSTS FOR PERMITS, LICENSES, CERTIFICATES, FILING AND INSPECTIONS REQUIRED BY AUTHORITIES HAVING JURISDICTION.
- UNDER NO CIRCUMSTANCES WILL THIS CONTRACTOR, OR HIS WORKMEN, BE PERMITTED TO USE ANY PART OF THE BUILDING AS A SHOP EXCEPT PARTS AS DESIGNATED FOR SUCH USE.
- ALL EXISTING WATER PIPING WITHIN FIVE (5) FT. OF NEW CONNECTIONS SHALL BE PROVIDED WITH NEW INSULATION.
- REFER TO ARCHITECTURAL DRAWINGS FOR FINAL ADDITIONAL INFORMATION.
- ALL WORK MUST BE COORDINATED AROUND THE OPERATION OF THE FACILITY.
- REPLACE ALL REQUIRED MISSING OR DAMAGED DRAIN COVERS ON TOP FLOOR.
- STORE MATERIALS IN DESIGNATED SPACES.
- UNNECESSARY NOISE SHALL BE AVOIDED AT ALL TIMES AND NECESSARY NOISE SHALL BE REDUCED TO A MINIMUM.
- ALL APPLICABLE CODES, LAWS AND REGULATIONS GOVERNING OR RELATING TO ANY PORTION OF THIS WORK ARE HEREBY INCORPORATED INTO AND MADE A PART OF THESE CONSTRUCTION DOCUMENTS AND THEIR PROVISIONS SHALL BE CARRIED OUT BY THE CONTRACTOR WHO SHALL INFORM THE OWNER PRIOR TO SUBMITTING A PROPOSAL OF ANY WORK OR MATERIALS WHICH VIOLATE ANY OF THE ABOVE LAWS AND REGULATIONS. ANY WORK DONE BY THE CONTRACTOR CAUSING SUCH VIOLATION SHALL BE CORRECTED BY THE CONTRACTOR.
- REMOVAL OF CERTAIN EXISTING WORK WILL BE NECESSARY FOR THE PERFORMANCE OF THE GENERAL WORK. ALL EXISTING CONDITIONS CANNOT BE COMPLETELY DETAILED ON THE DRAWINGS. THE CONTRACTOR SHALL SURVEY THE SITE AND INCLUDE ALL CHANGES IN MAKING UP WORK PROPOSAL.
- DISCONNECT, REMOVE AND/OR RELOCATE EXISTING MATERIAL, EQUIPMENT, AND OTHER WORK AS NOTED OR REQUIRED FOR PROPER INSTALLATION OF SYSTEM.
- THE CONTRACTOR SHALL RESTORE ALL AREAS DISTURBED DURING CONSTRUCTION TO THEIR ORIGINAL STATE.
- THE CONTRACTOR SHALL KEEP ALL EQUIPMENT AND MATERIALS, AND ALL PARTS OF THE BUILDING, EXTERIOR SPACES AND ADJACENT STREETS, SIDEWALKS AND PAVEMENTS, FREE FROM MATERIAL AND DEBRIS RESULTING FROM THE EXECUTION OF THIS WORK. EXCESS MATERIALS WILL NOT BE PERMITTED TO ACCUMULATE EITHER ON THE INTERIOR OR THE EXTERIOR.

SHEET INDEX

NO.	TITLE	SCALE
P-001-900A	PLUMBING COVER SHEET	NONE
P-002-900A	SCHEDULES	NONE
P-101-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL A - PHASE 3	1" = 20'-0"
P-102-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL B - PHASE 3	1" = 20'-0"
P-103-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL C - PHASE 3	1" = 20'-0"
P-104-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL D - PHASE 3	1" = 20'-0"
P-105-900A	GARAGE A PLUMBING DEMOLITION PLAN - LEVEL E - PHASE 3	1" = 20'-0"
P-201-900A	GARAGE A PLUMBING PLAN - LEVEL A - PHASE 3	1" = 20'-0"
P-202-900A	GARAGE A PLUMBING PLAN - LEVEL B - PHASE 3	1" = 20'-0"
P-203-900A	GARAGE A PLUMBING PLAN - LEVEL C - PHASE 3	1" = 20'-0"
P-204-900A	GARAGE A PLUMBING PLAN - LEVEL D - PHASE 3	1" = 20'-0"
P-205-900A	GARAGE A PLUMBING PLAN - LEVEL E - PHASE 3	1" = 20'-0"
P-501-900A	DETAILS	NONE



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

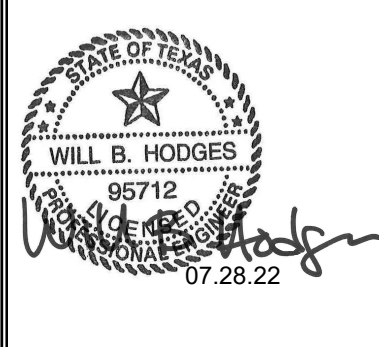

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
Incorporated in Texas
717 North Meadows Drive
Suite 200, LB #
Dallas, TX 75201
1+214 728 6000

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR
CONSTRUCTION


NO.	DATE	DESCRIPTION
	2022-01-09	75% DESIGN
	2022-03-01	100% DESIGN
	2022-07-28	100% ISSUED FOR PERMIT (IFP)

PROJECT NUMBER: TFD-007

Garage A
PLUMBING COVER SHEET

PERMIT NUMBER: 822-0022


SHEET NUMBER
P-001-900A

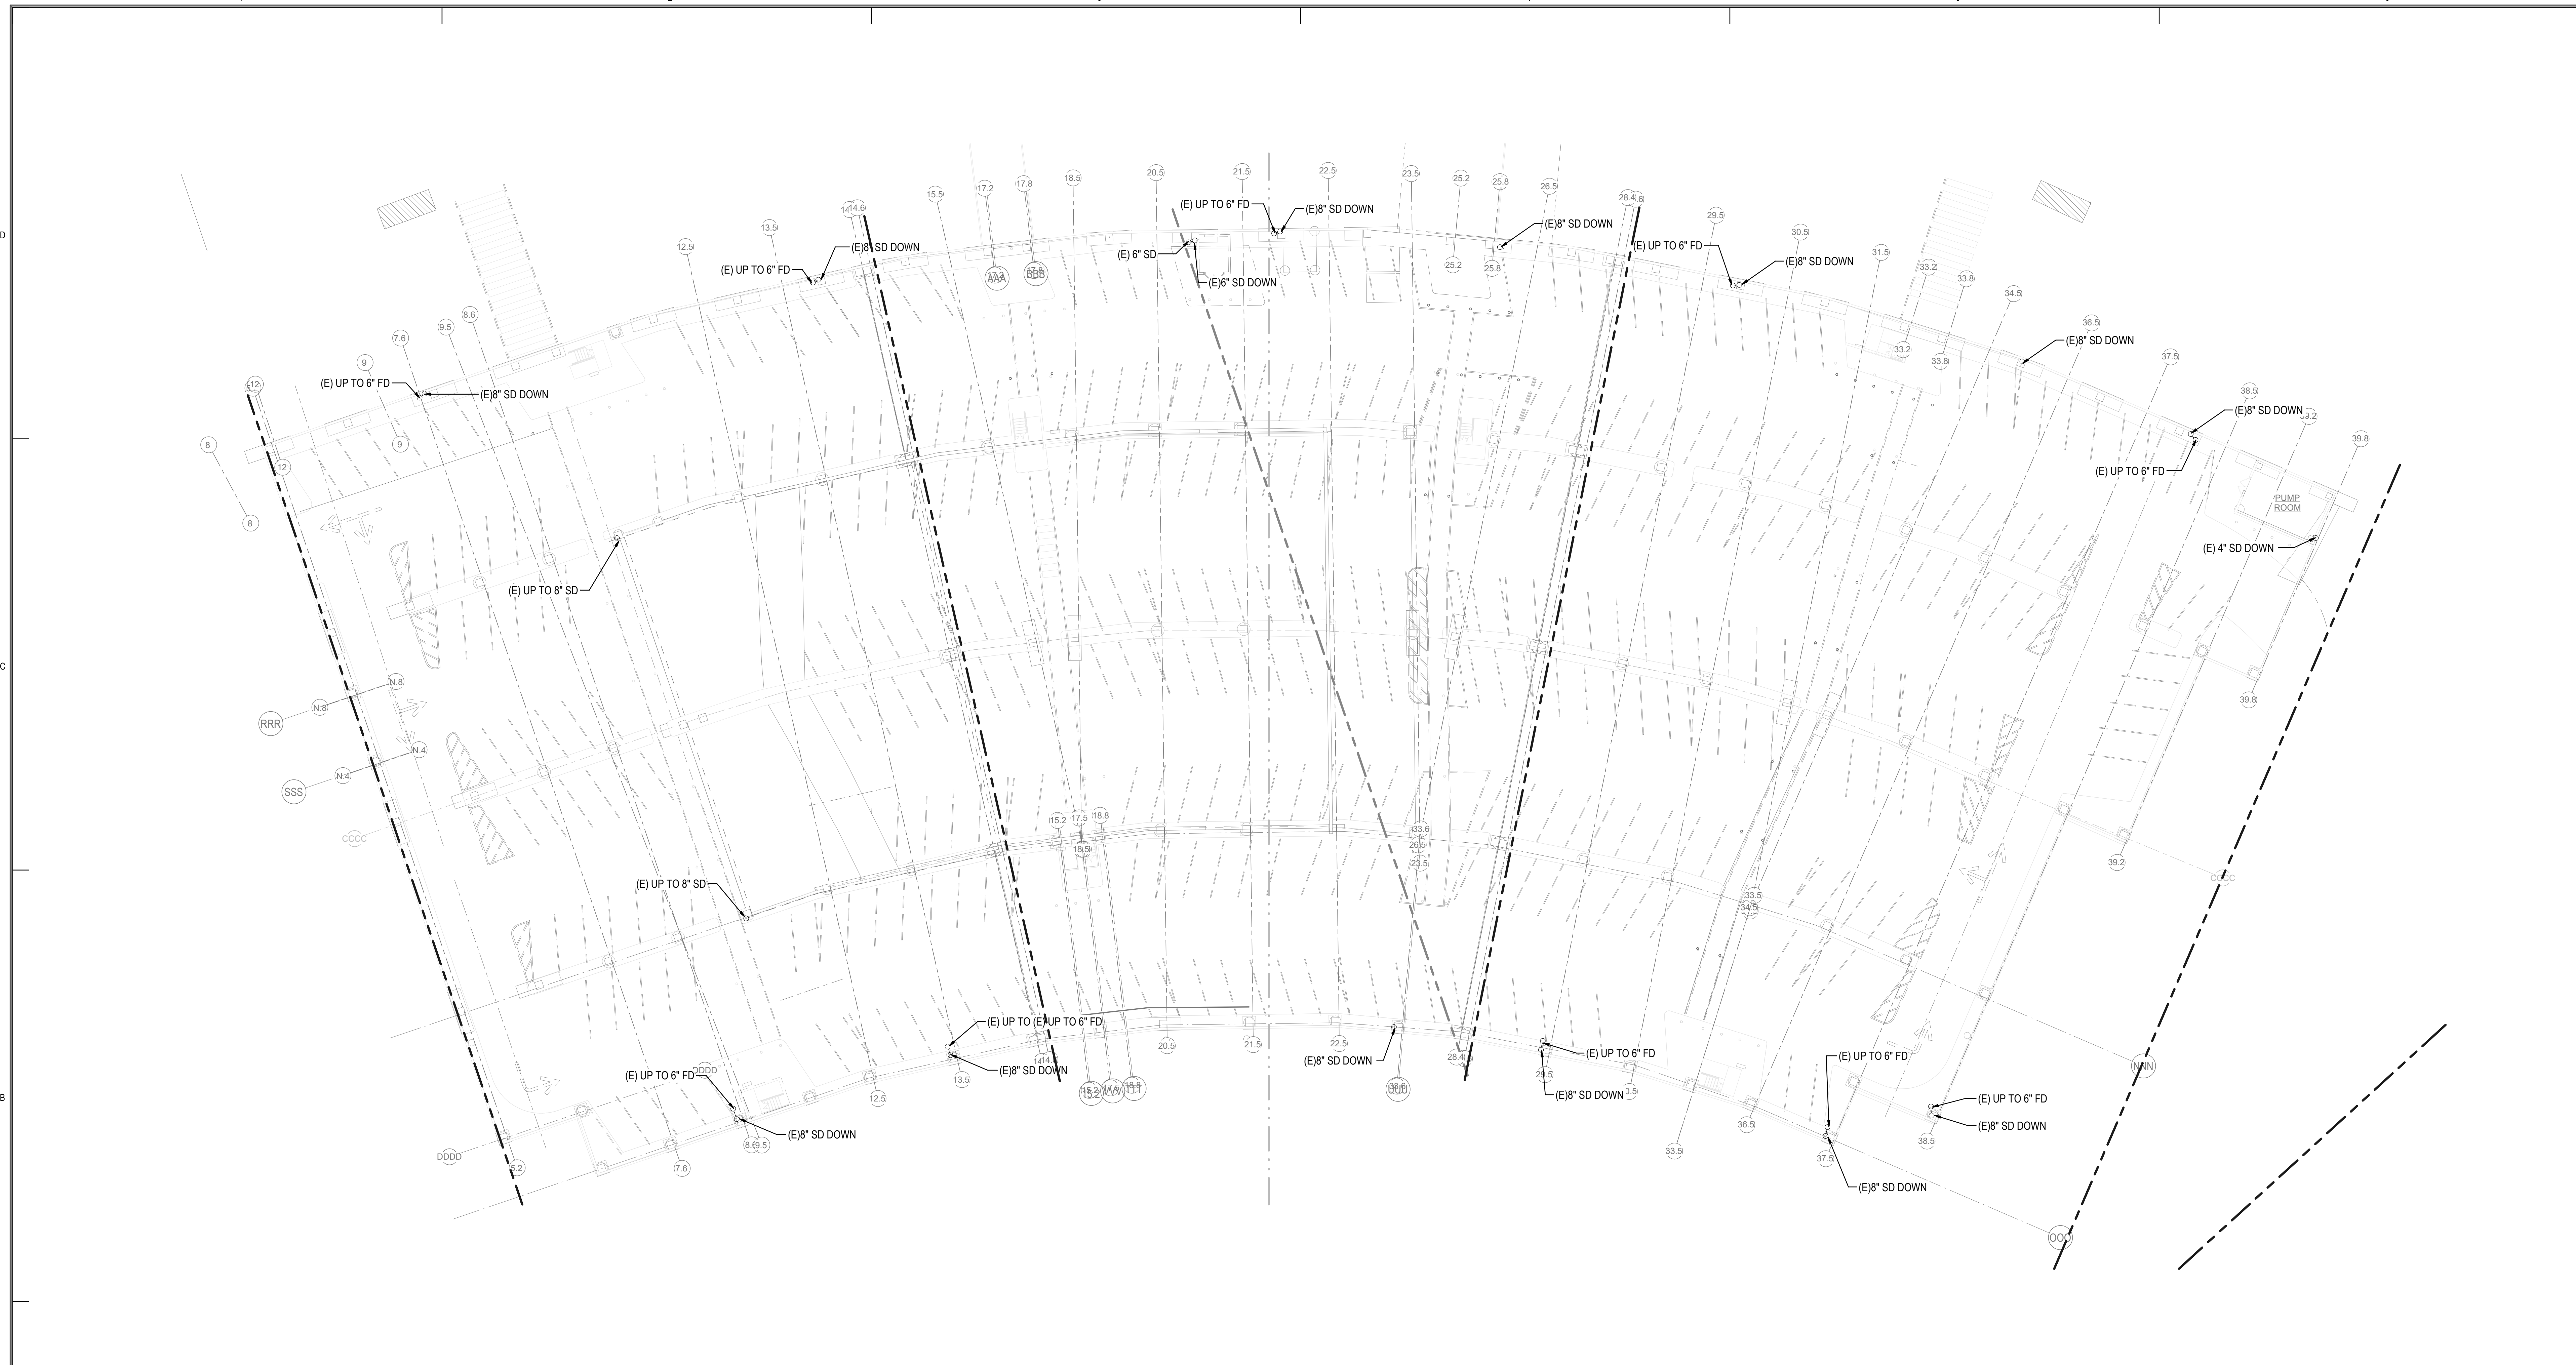

SHEET NOTES


1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

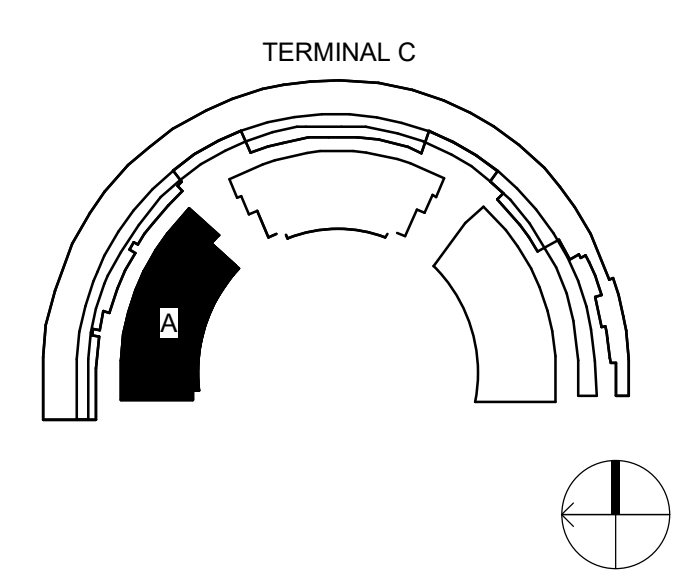

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

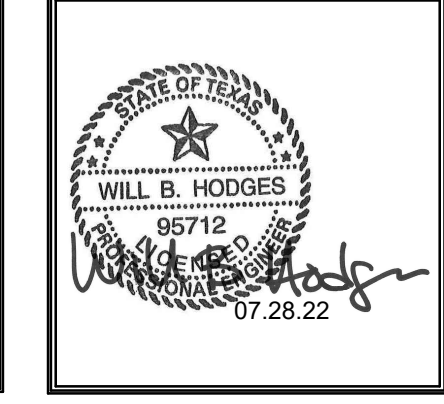

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

Hodges, Chad & Koenigsmann, Inc.
717 North Meadows Street
Suite 200, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A


GARAGE A PLUMBING DEMOLITION PLAN - LEVEL A - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
P-101-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

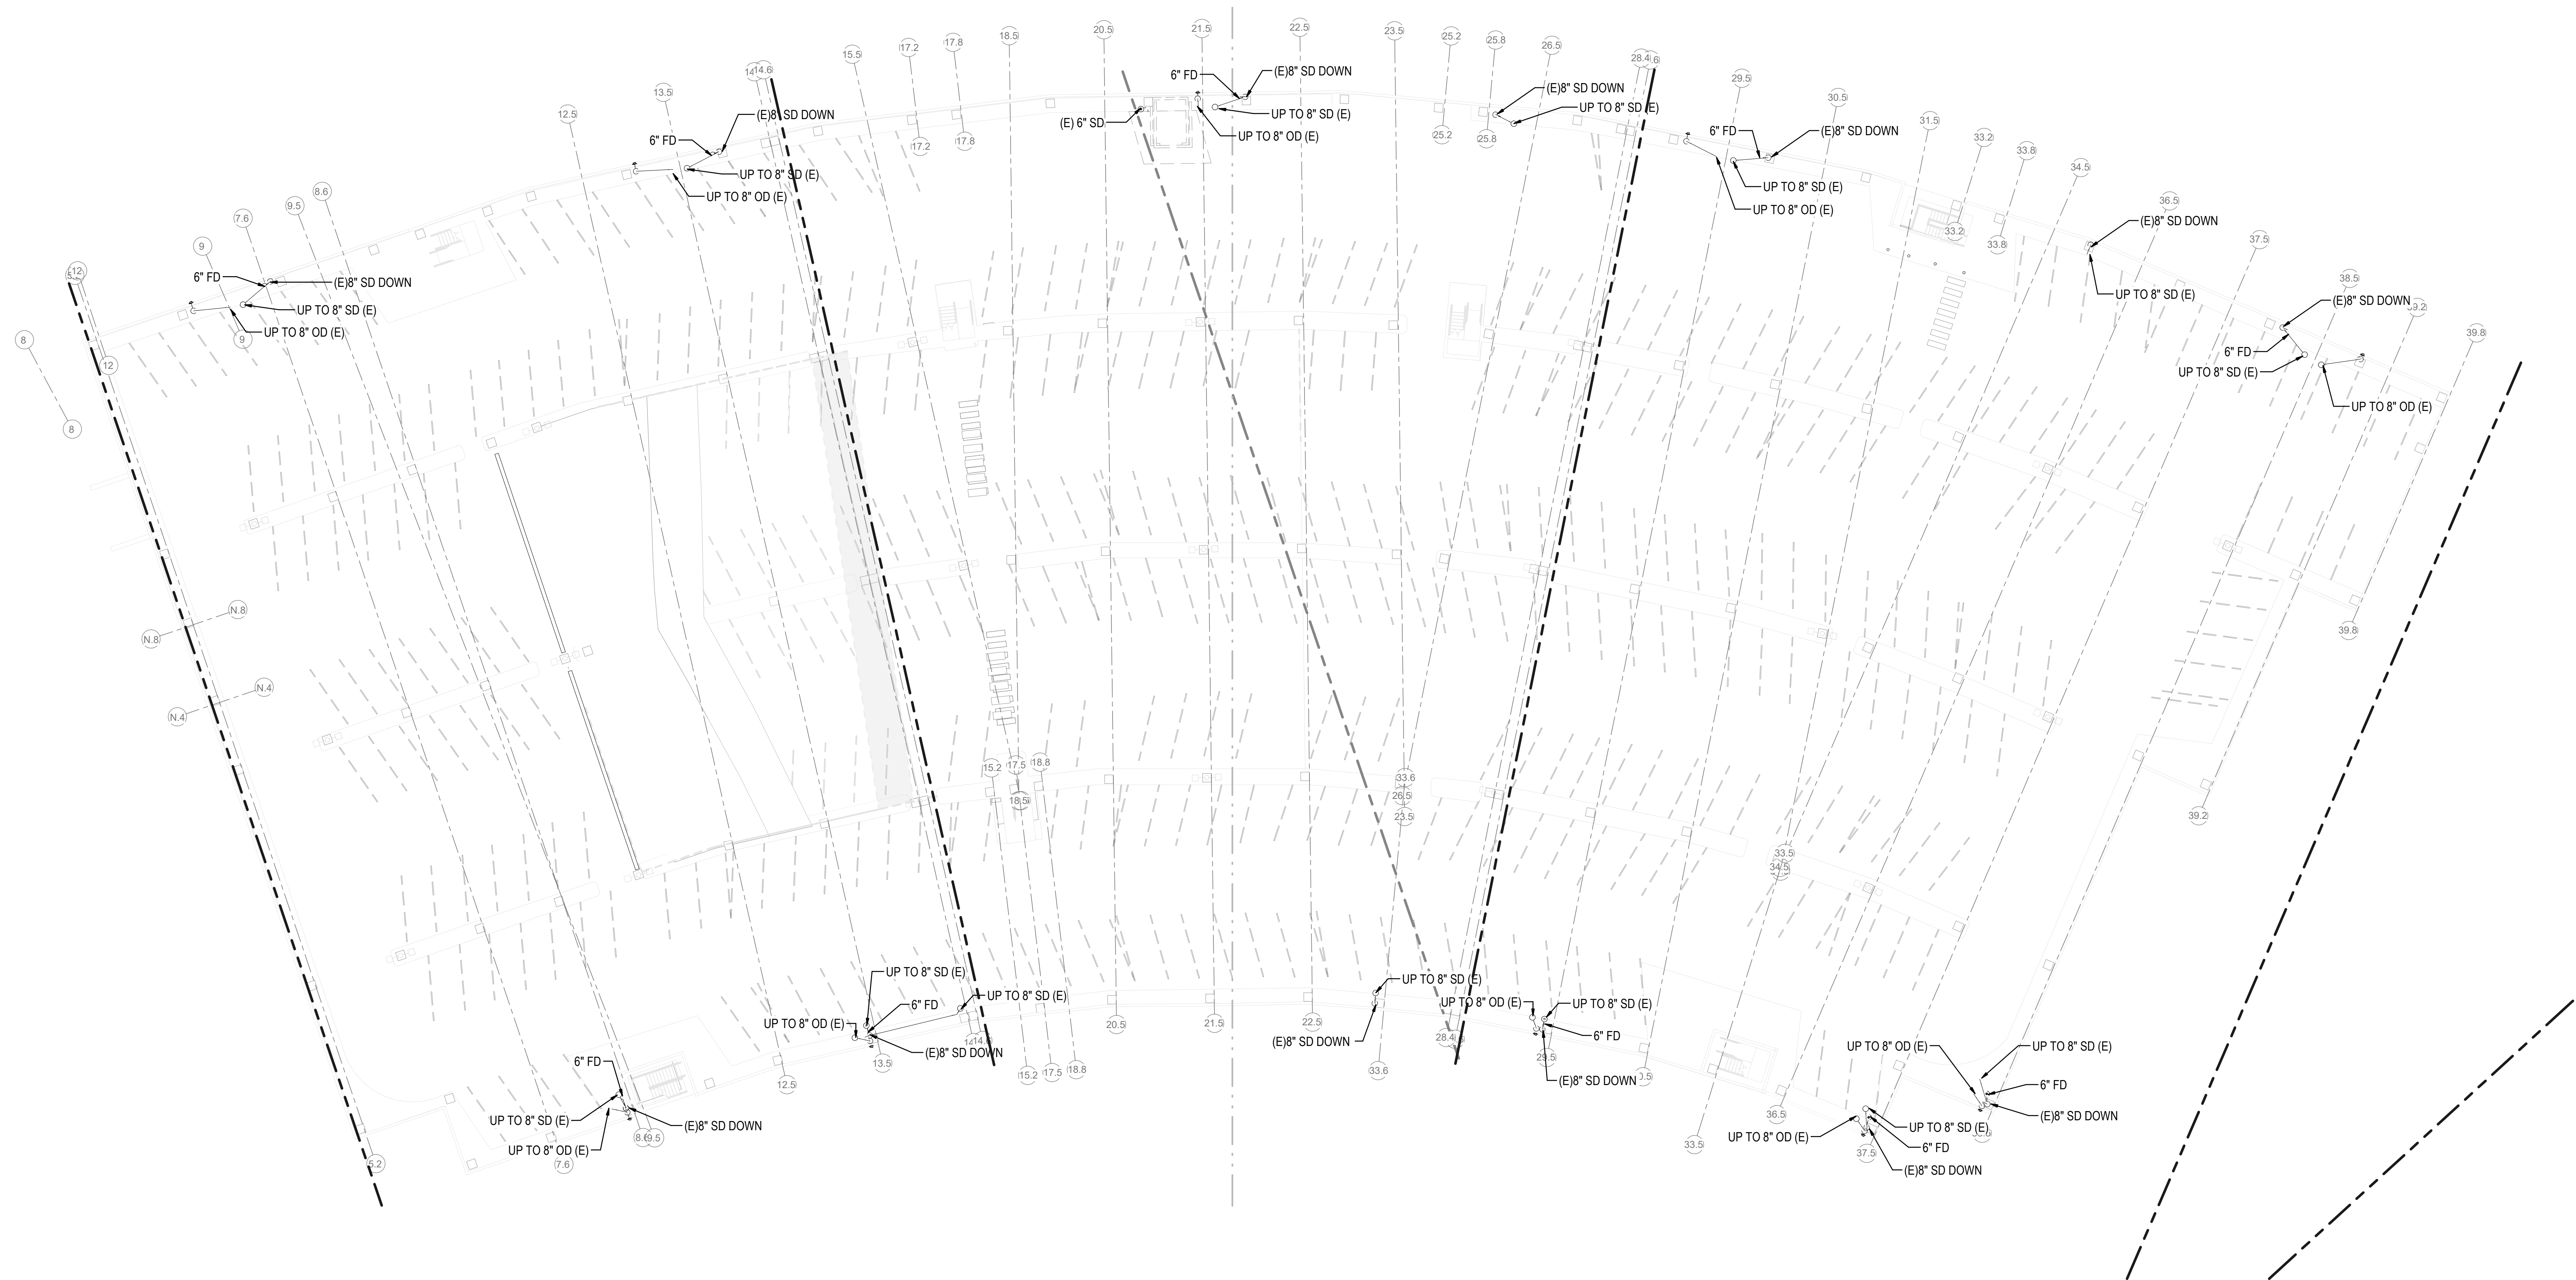

SHEET NOTES


1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

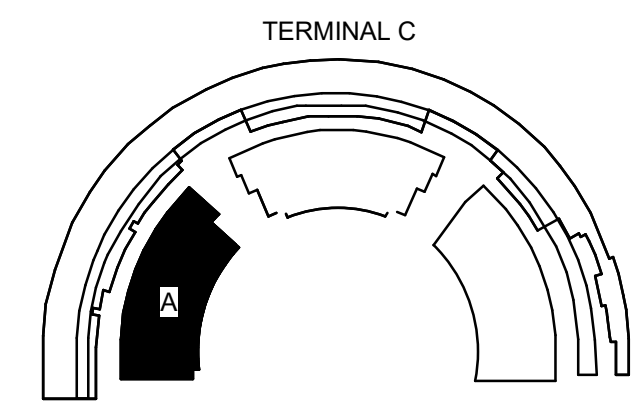

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

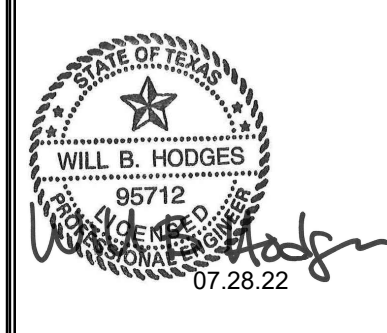

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

Hobbs, Clark & Koenigsmann, Inc.
717 North Harwood Street
Suite 200, LB #
Dallas, TX 75201
1-214-728-6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


Garage A
GARAGE A PLUMBING DEMOLITION PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
P-104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

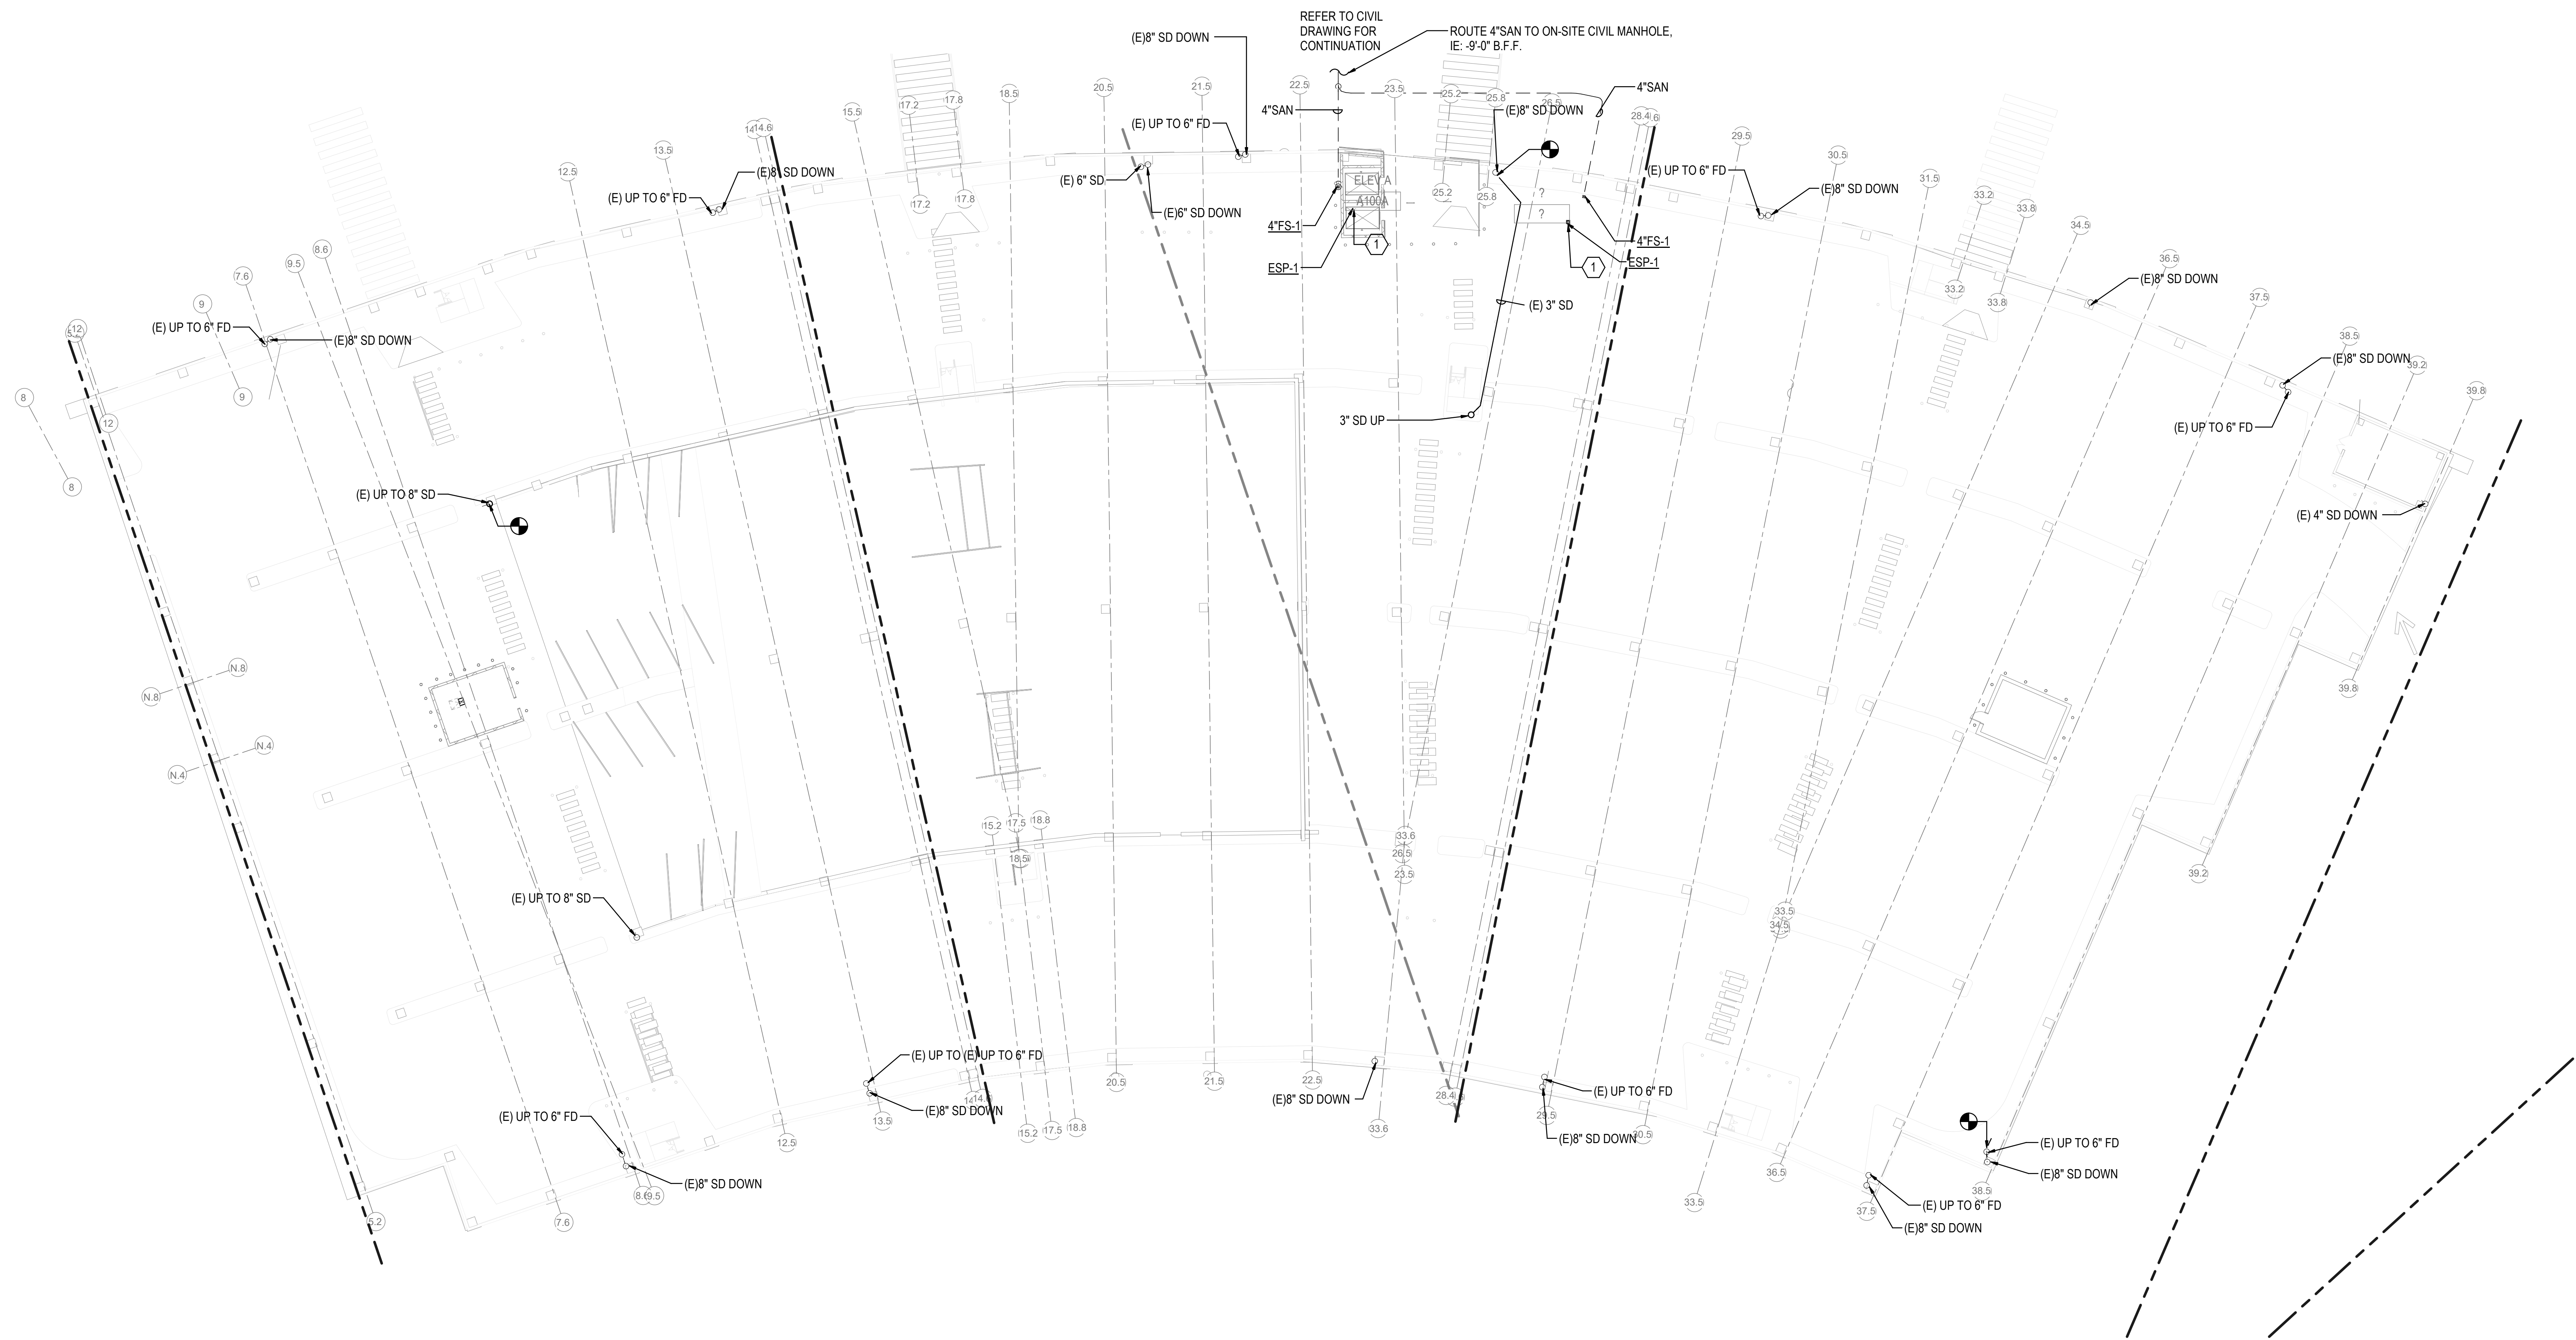


SHEET NOTES

1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. ESP-1, ELEVATOR SUMP PUMP. SEE SCHEDULE AND SPECS FOR ADDITIONAL INFORMATION. PROVIDE AND ROUTE 3\"/>

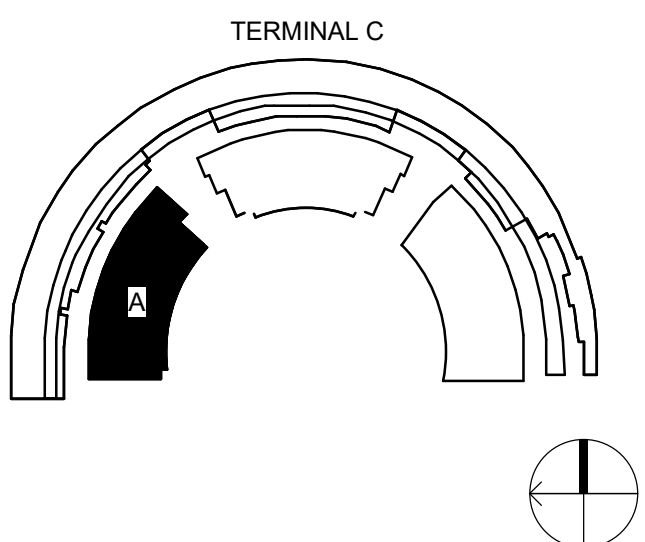

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

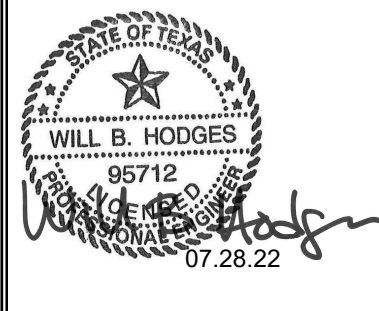

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A


GARAGE A PLUMBING PLAN - LEVEL A - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
P-201-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

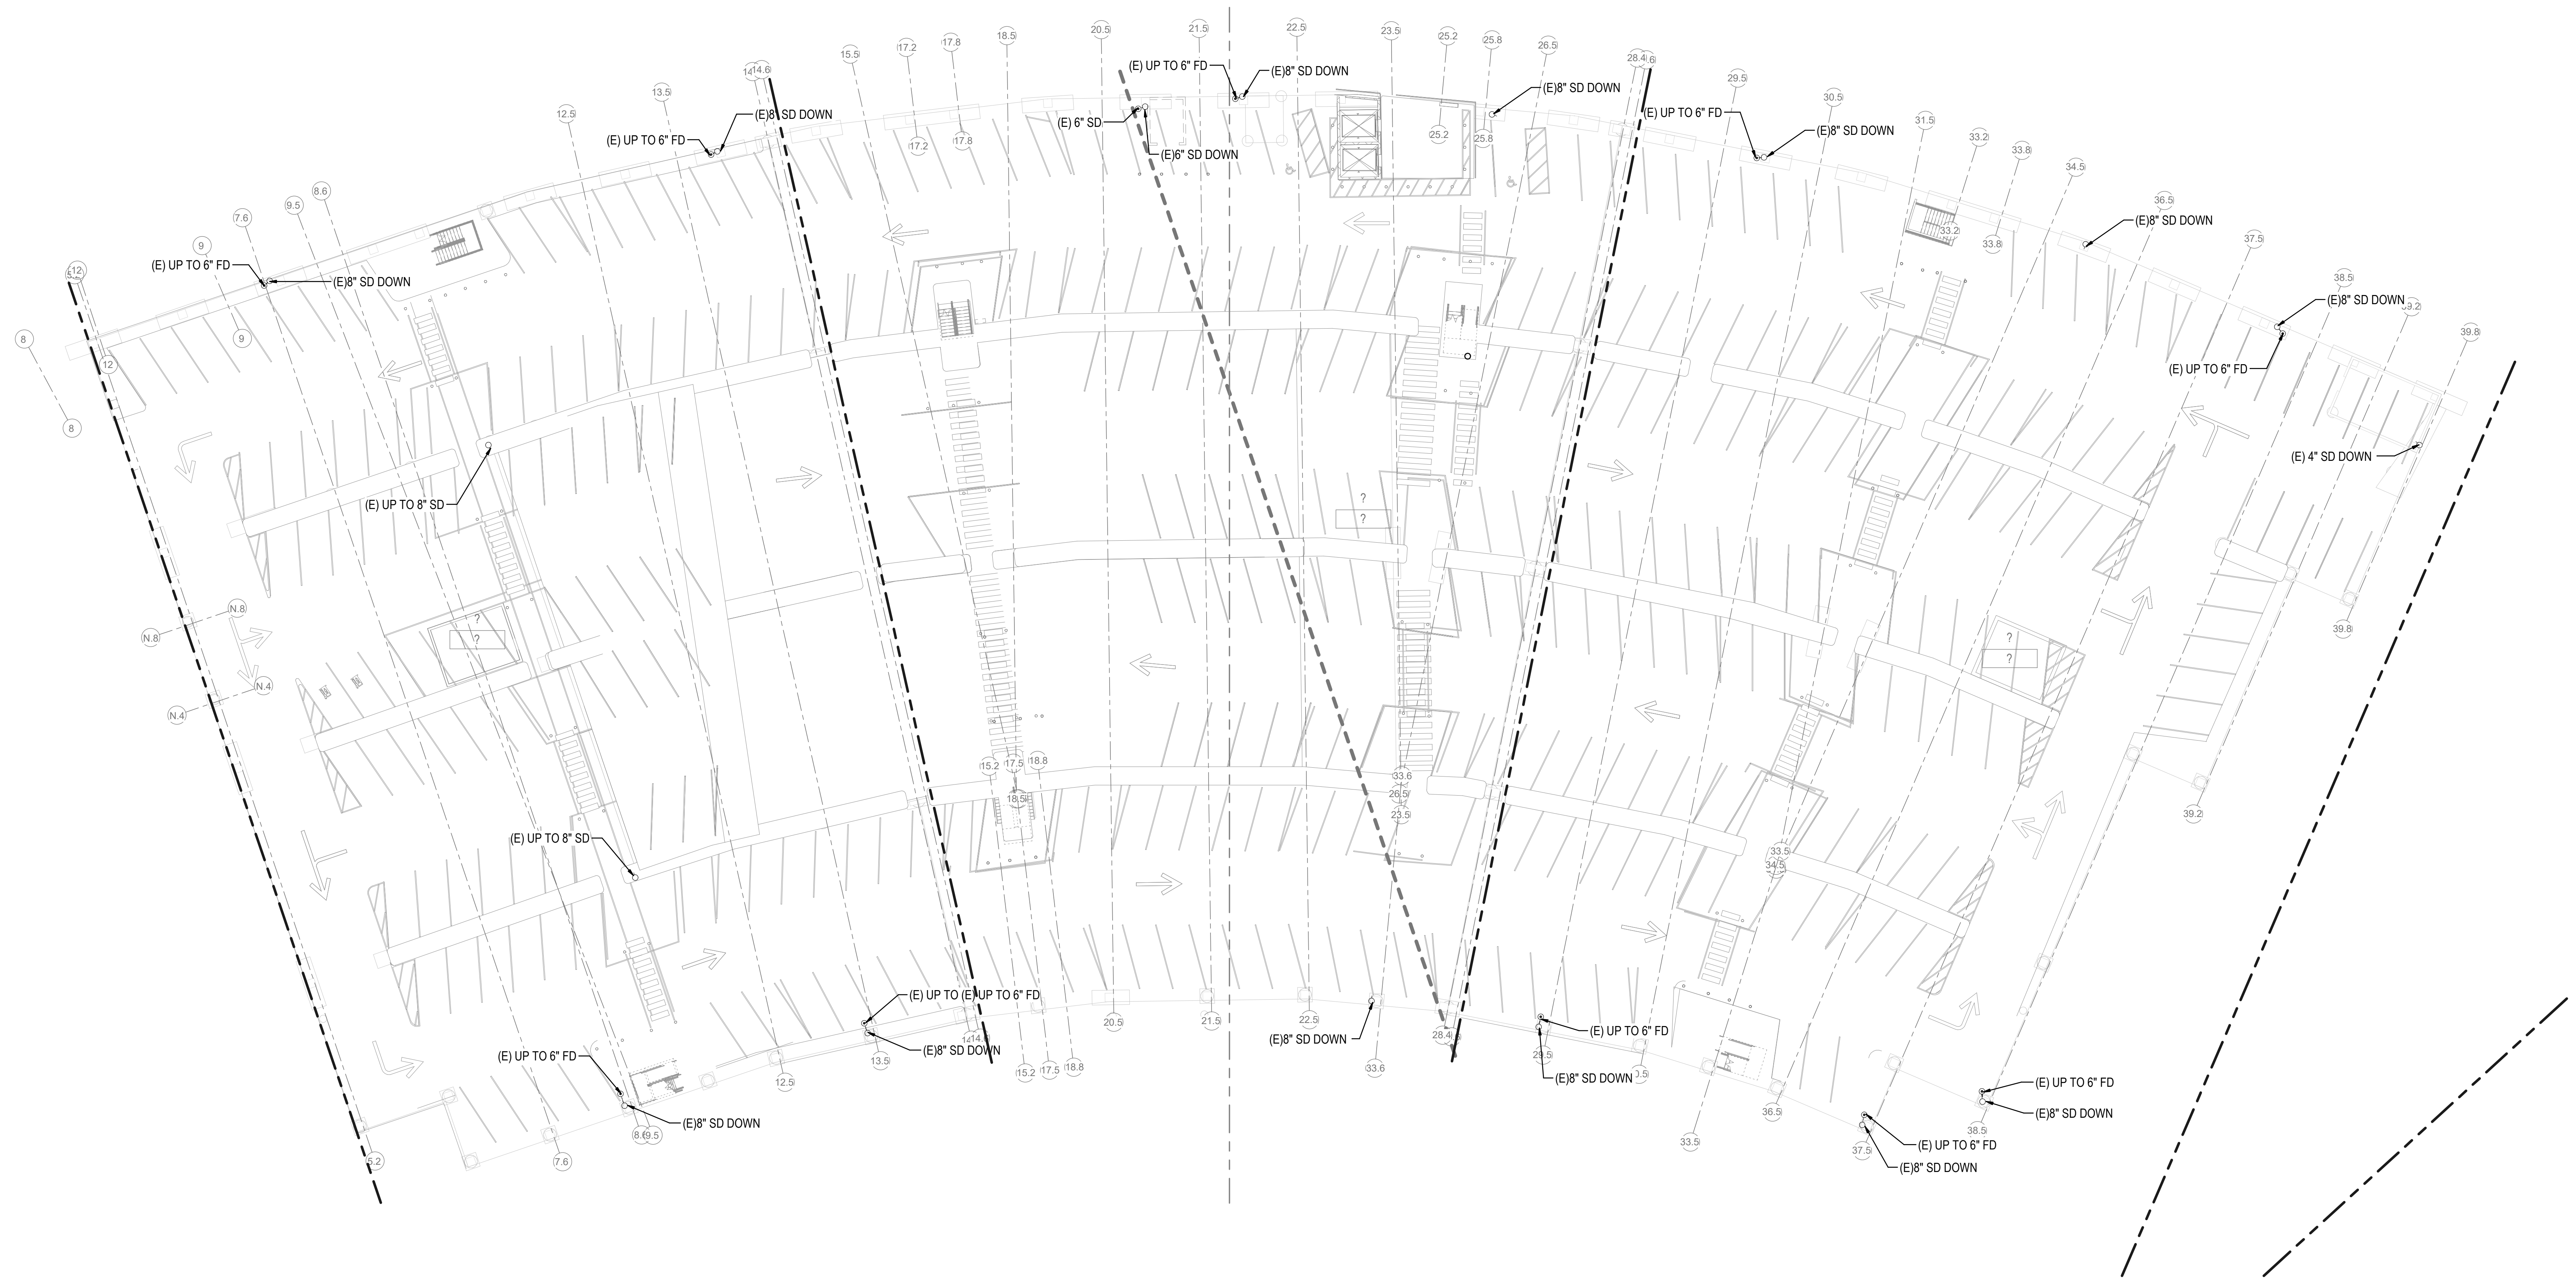

SHEET NOTES


1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

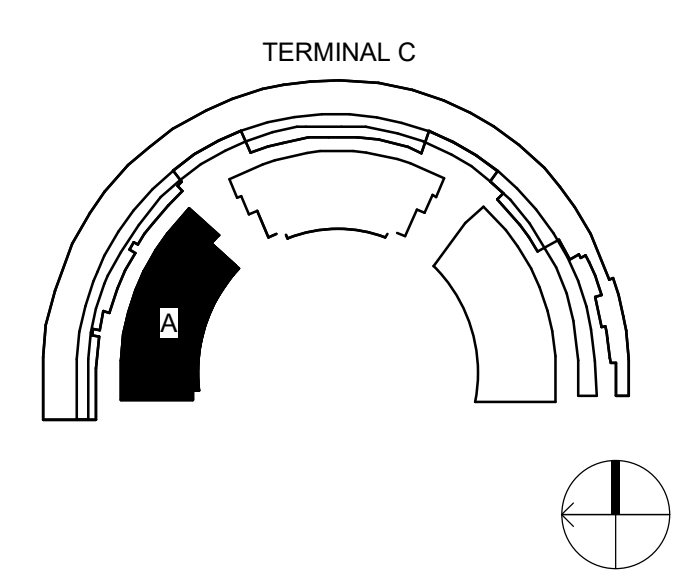

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

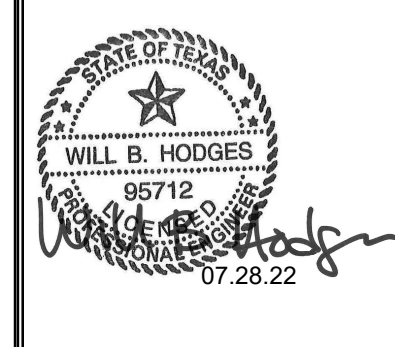

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A


GARAGE A PLUMBING PLAN - LEVEL B - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
P-202-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

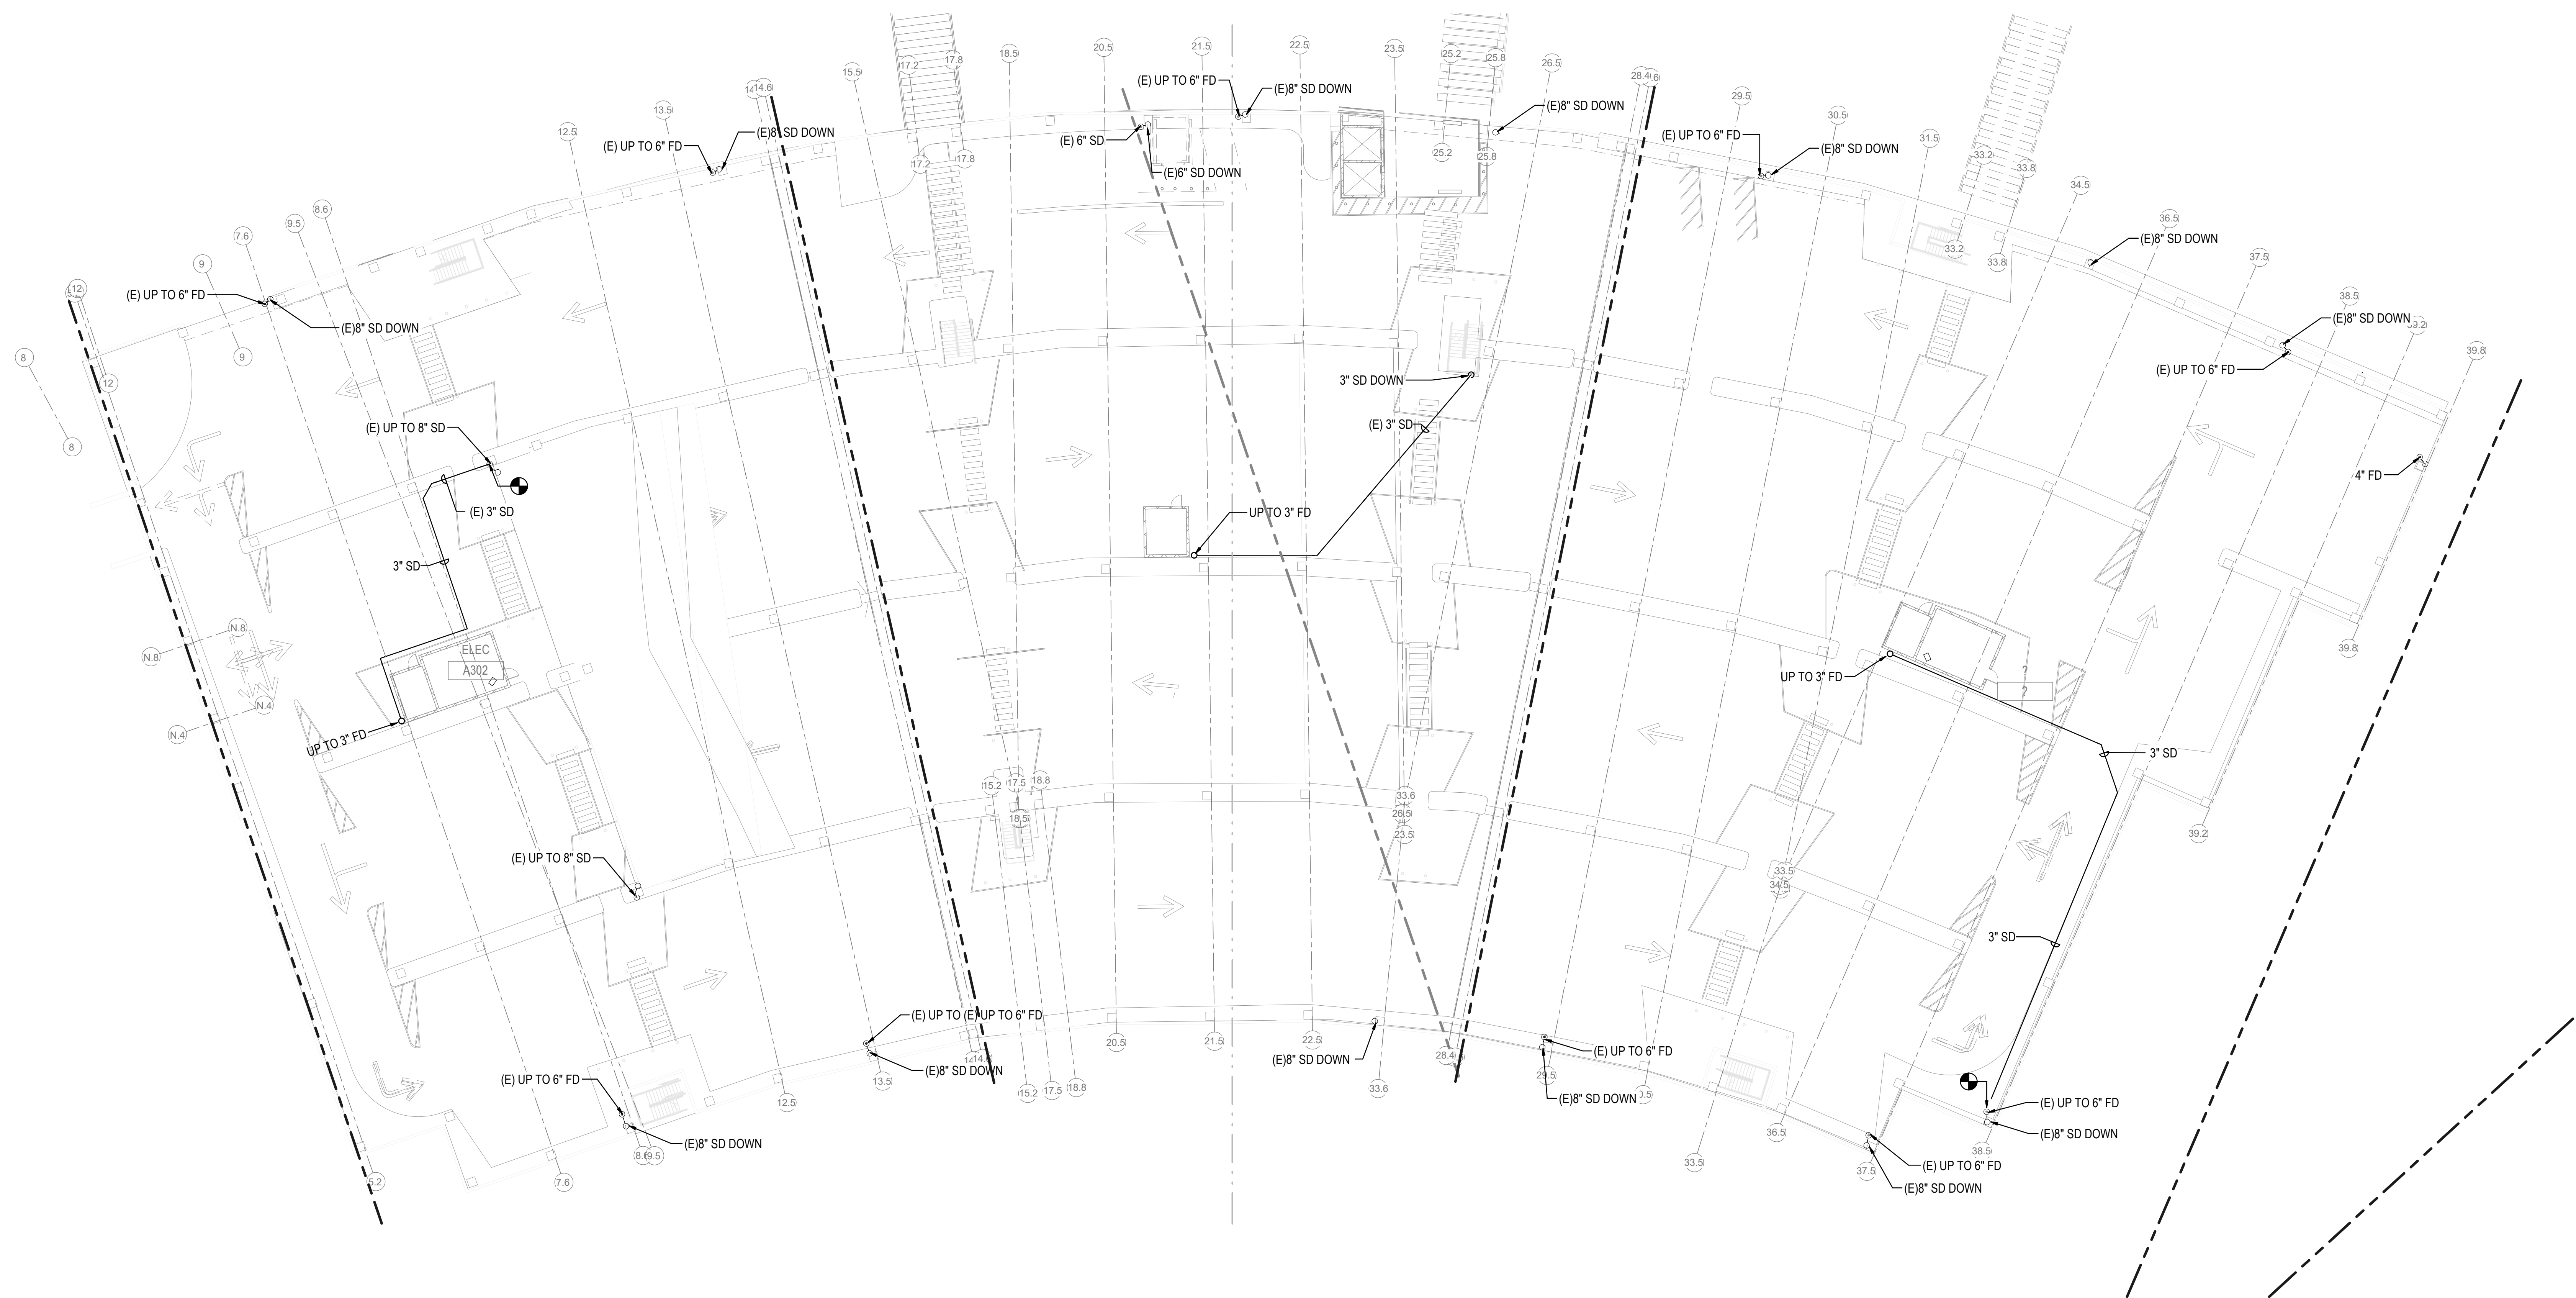

SHEET NOTES


1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

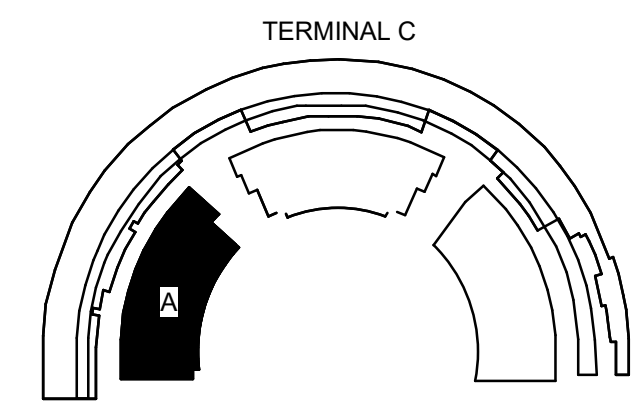

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

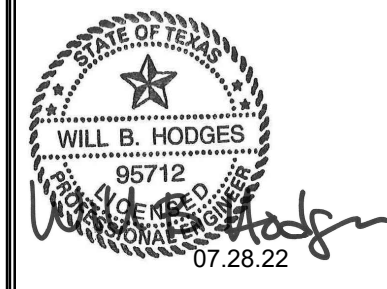

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

Hobbs, Clark & Koenigsmann, Inc.
717 North Meadows Street
Suite 200, LB #1
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A


GARAGE A PLUMBING PLAN - LEVEL C - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
P-203-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

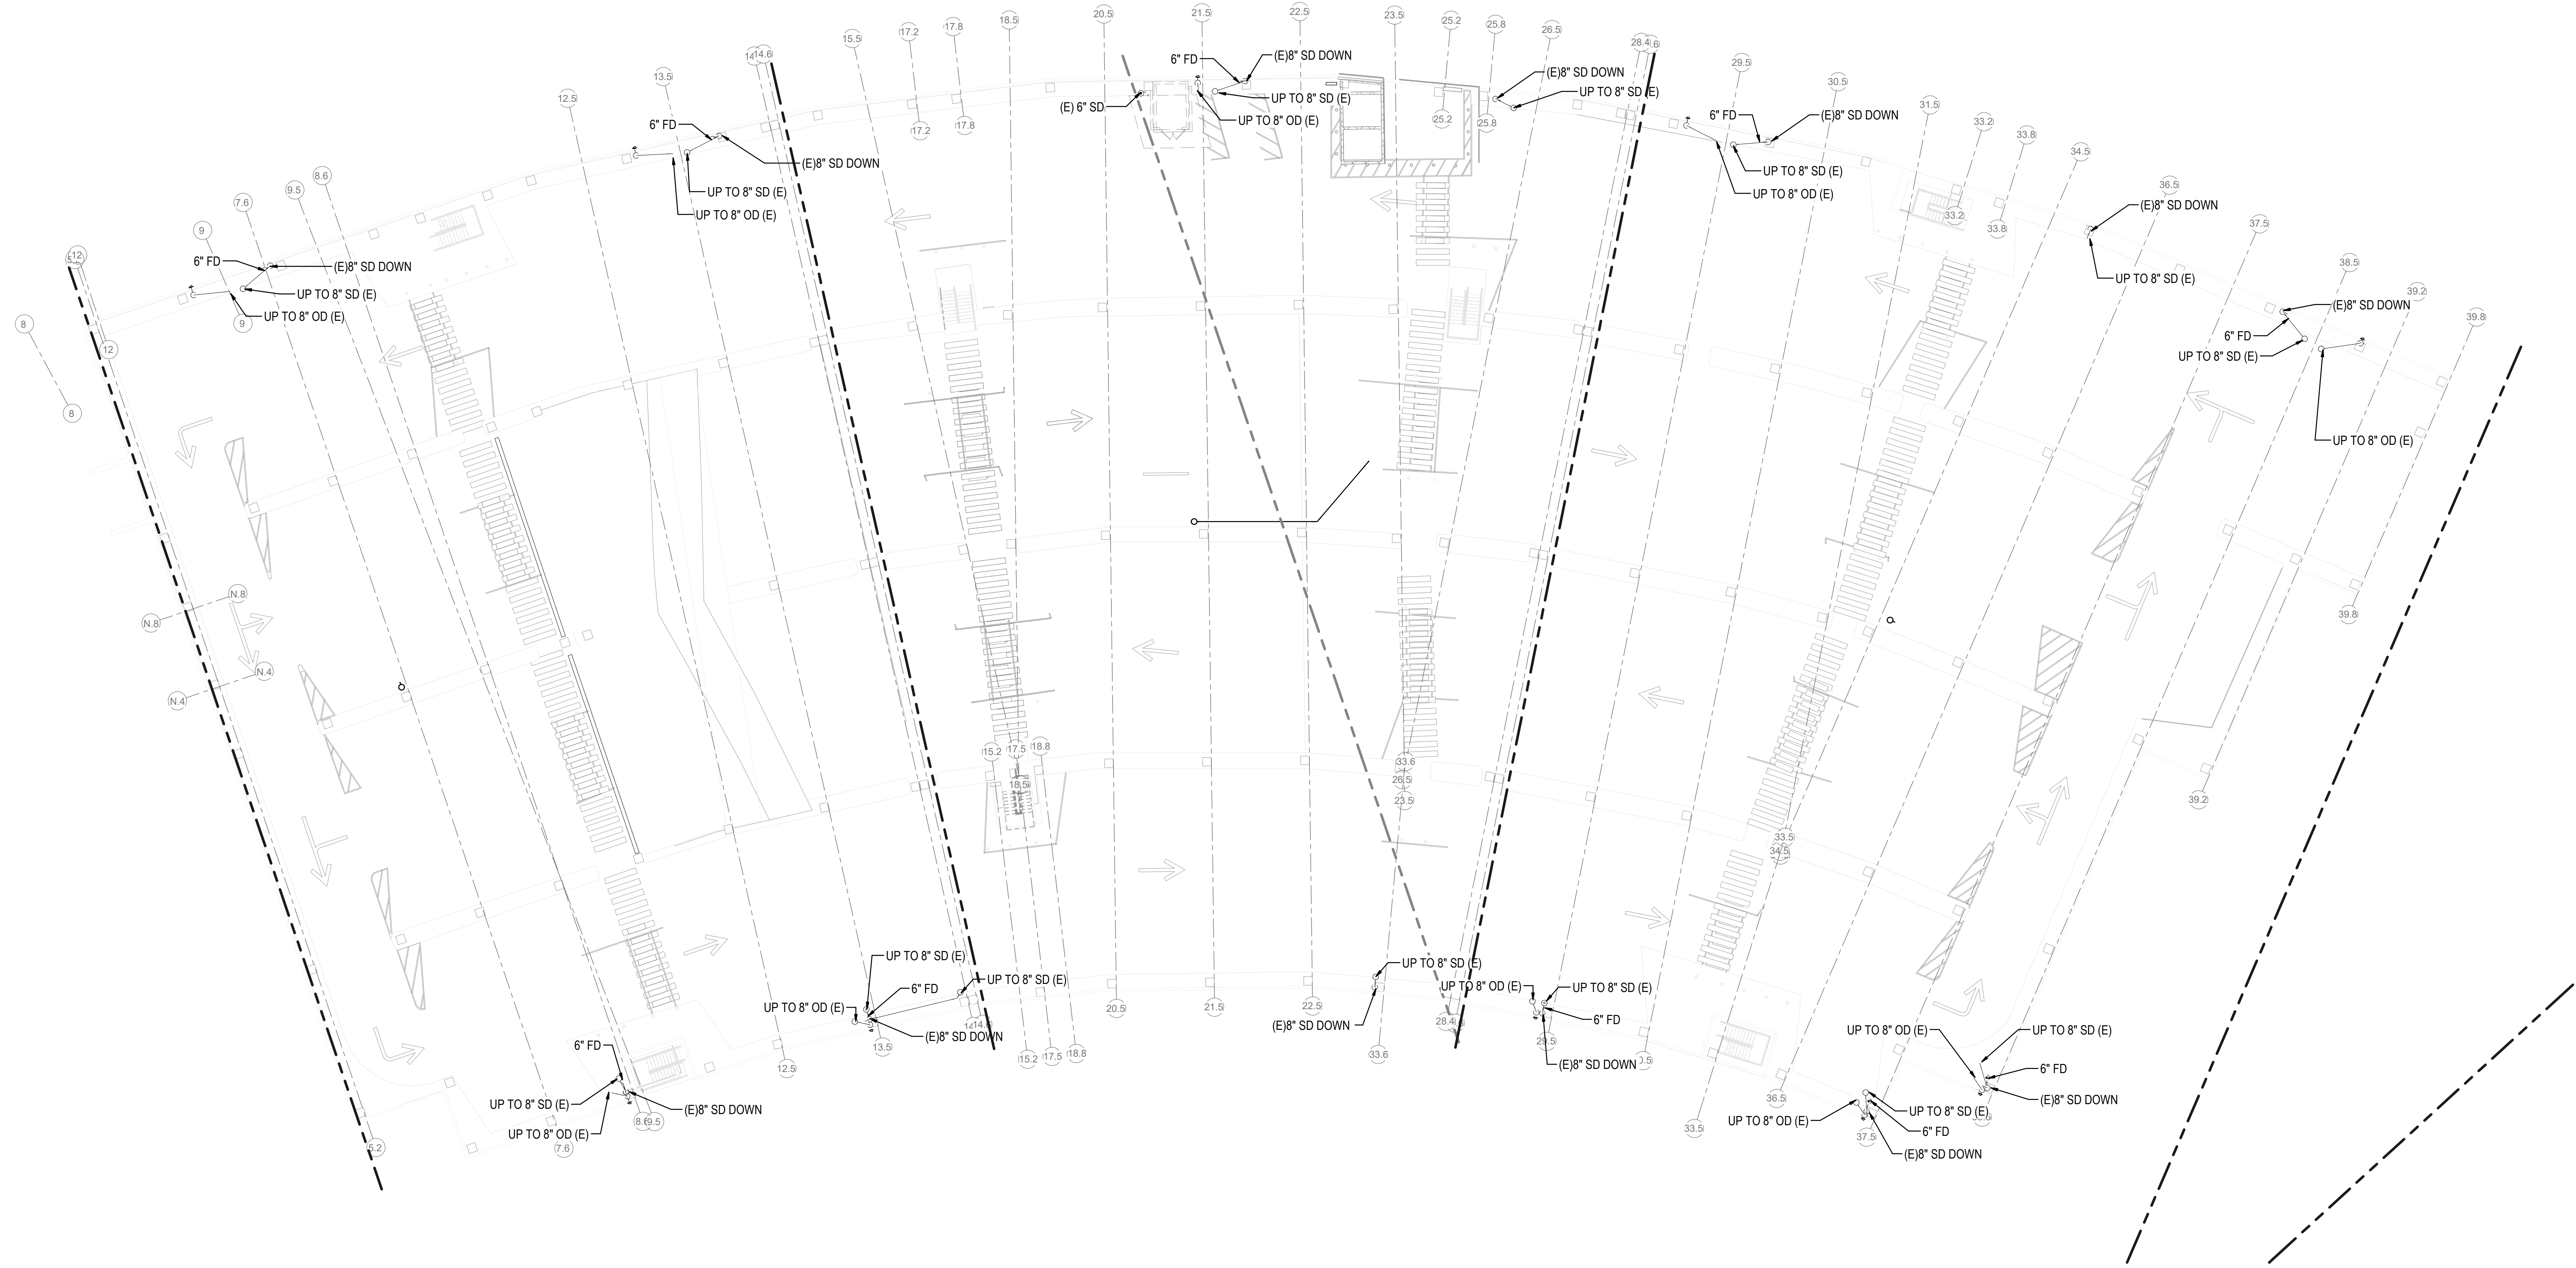

SHEET NOTES


1. REFER TO SHEET P-001 FOR PLUMBING GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

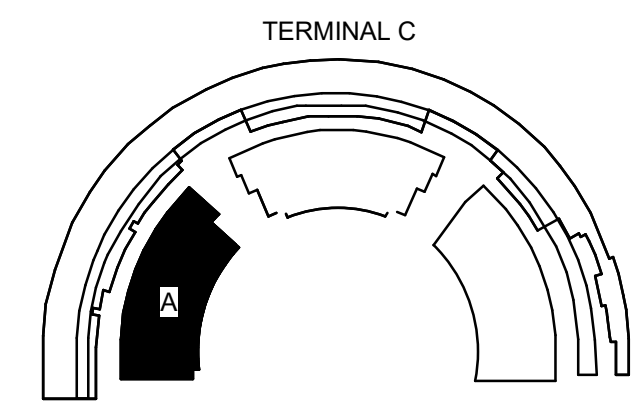

DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

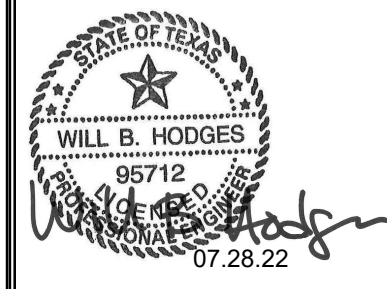

h+k
SYSKA HENNESSY
GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com
Heinrich, Clark & Koenigsmann, Inc.
717 North Riverfront Street
Suite 200, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28


**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2022-07-28	100% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


Garage A
GARAGE A PLUMBING PLAN - LEVEL D - PHASE 3
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
P-204-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

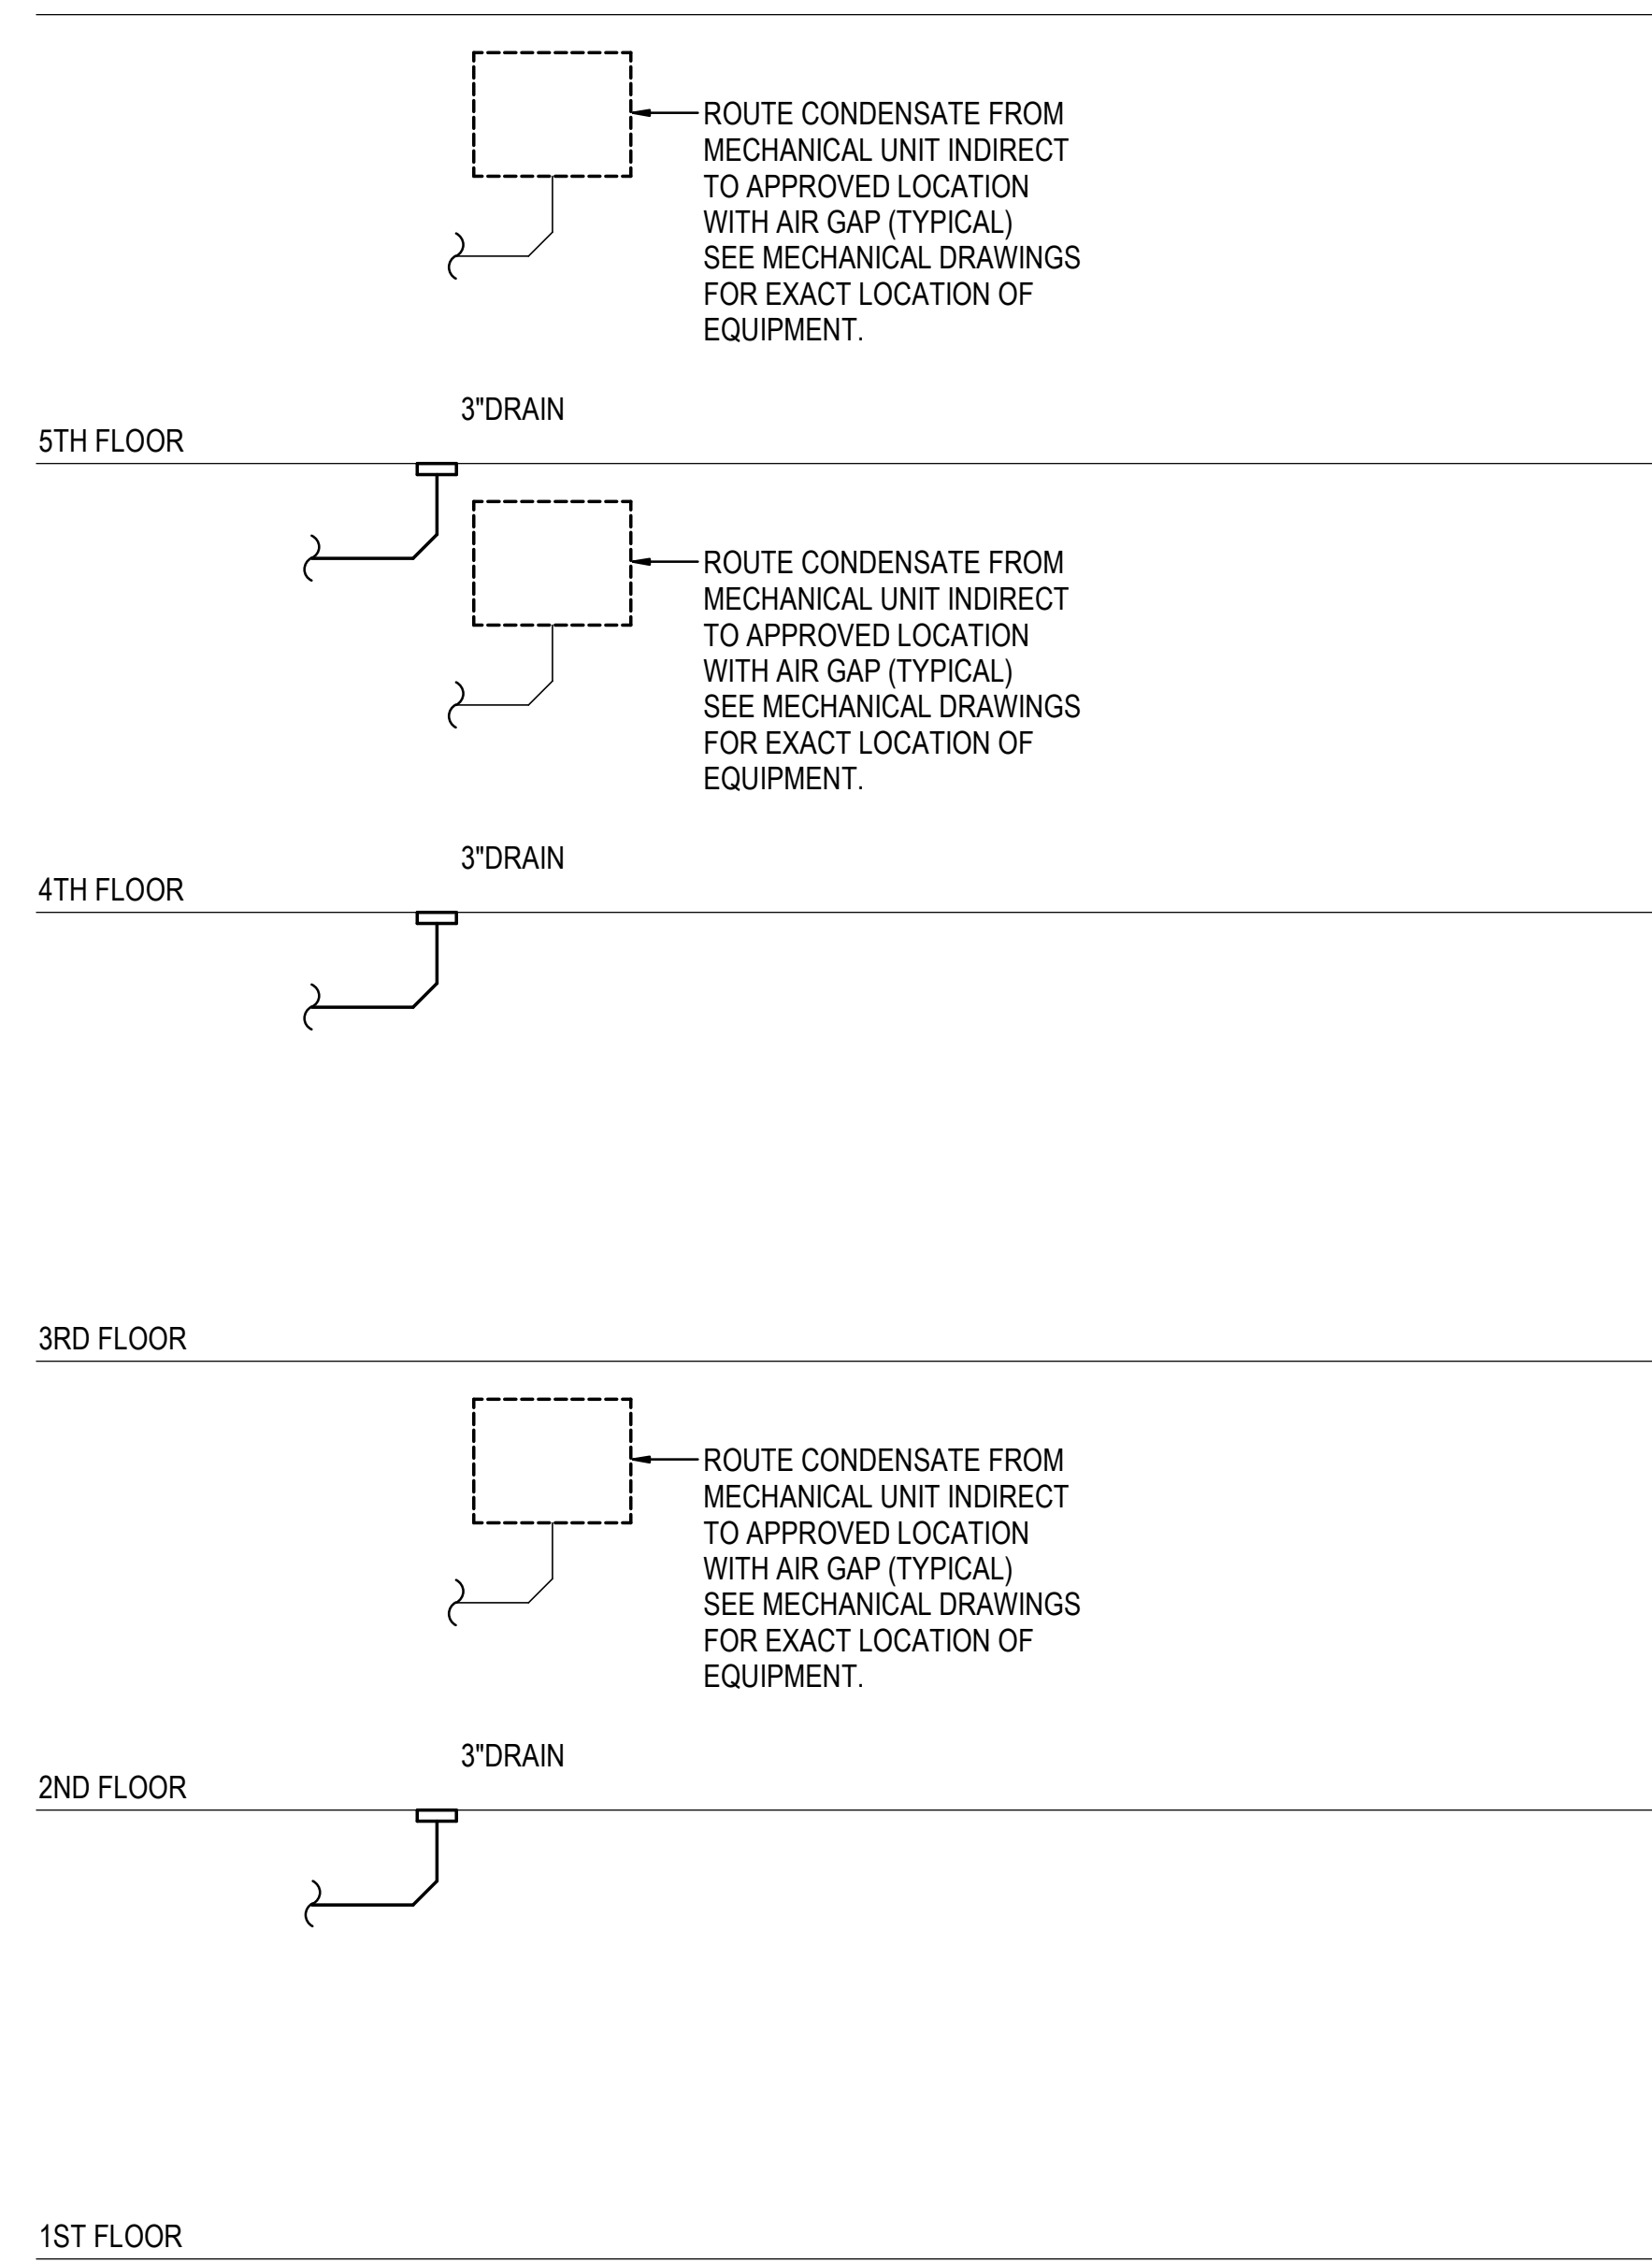


6 CONDENSATE RISER
SCALE: N.T.S.

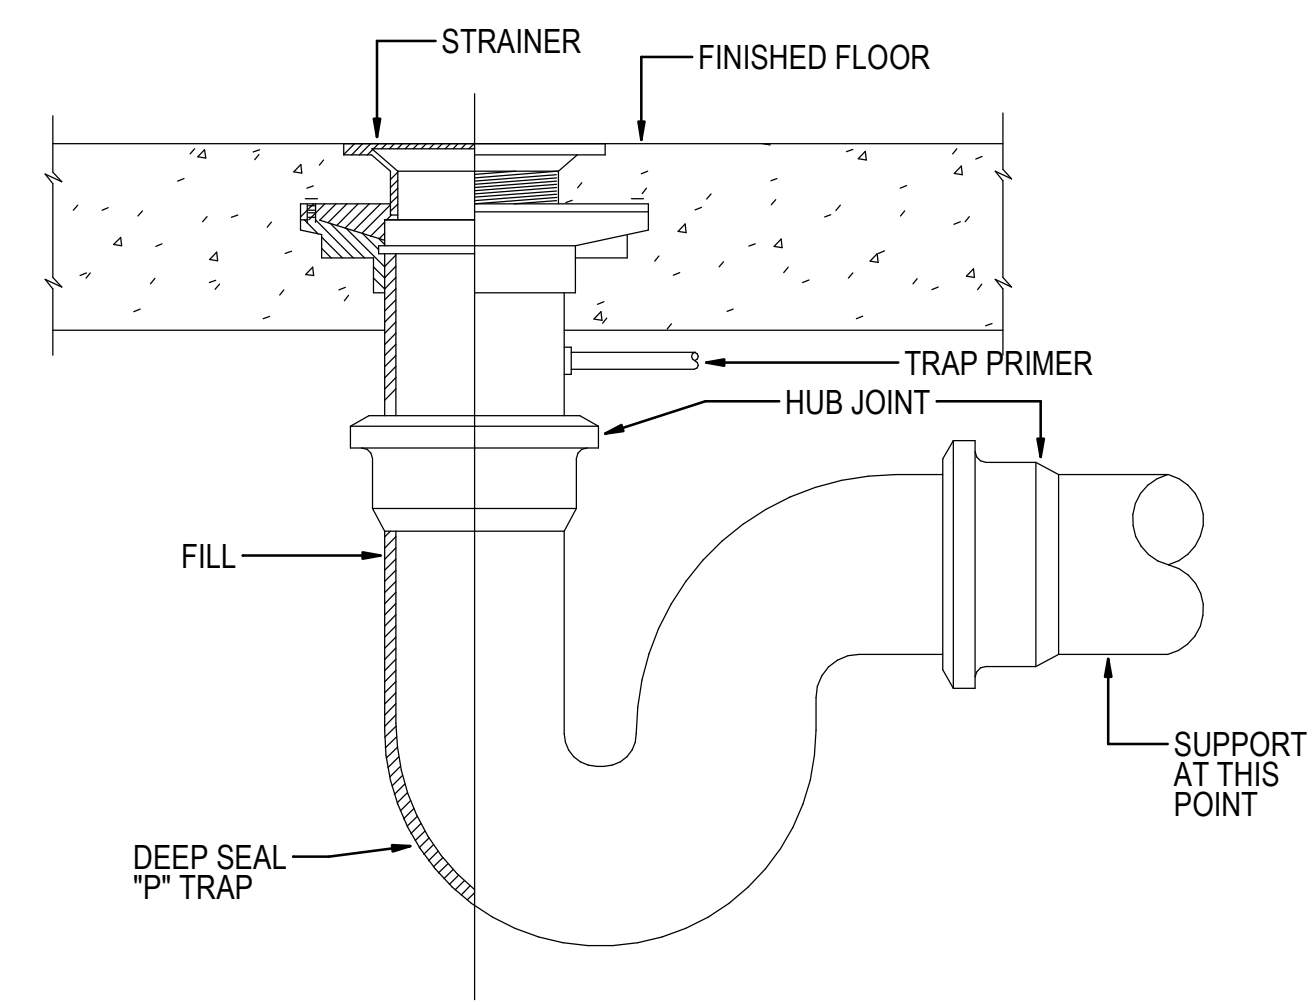


4 FLOOR SINK DETAIL
SCALE: N.T.S.

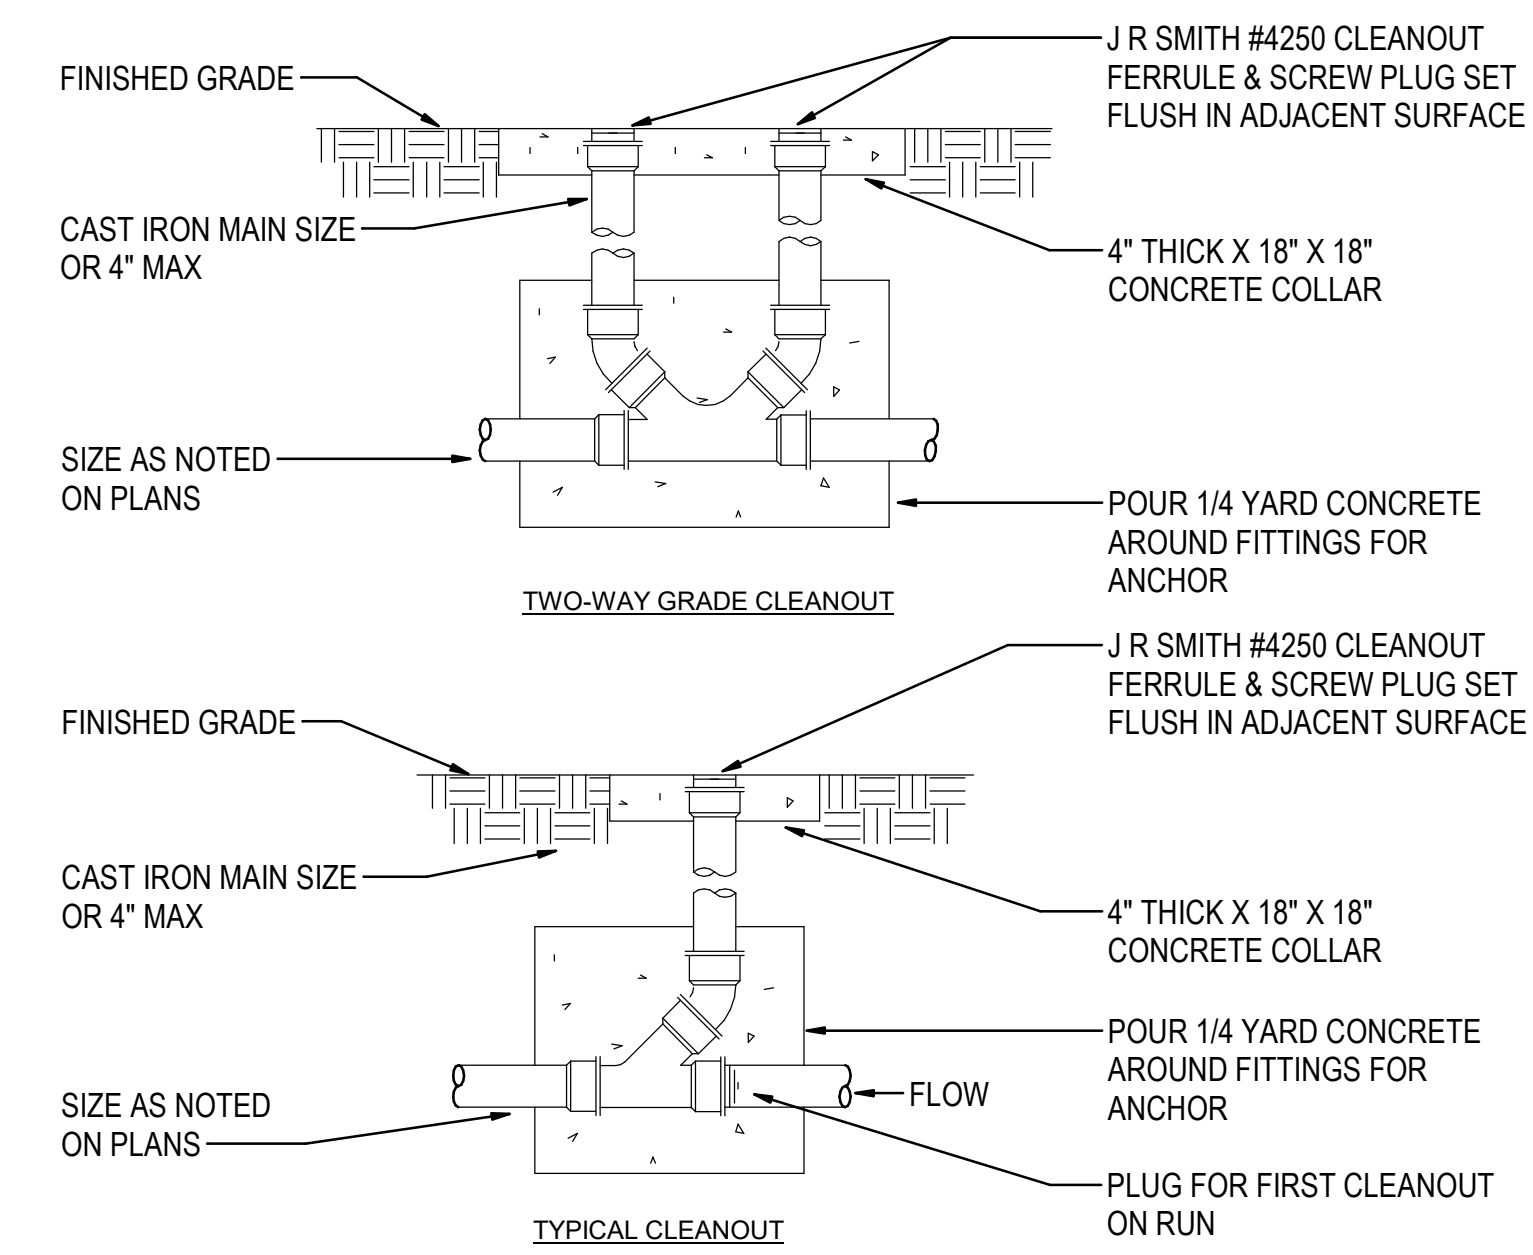

2 CLEANOUT DETAILS
SCALE: NONE

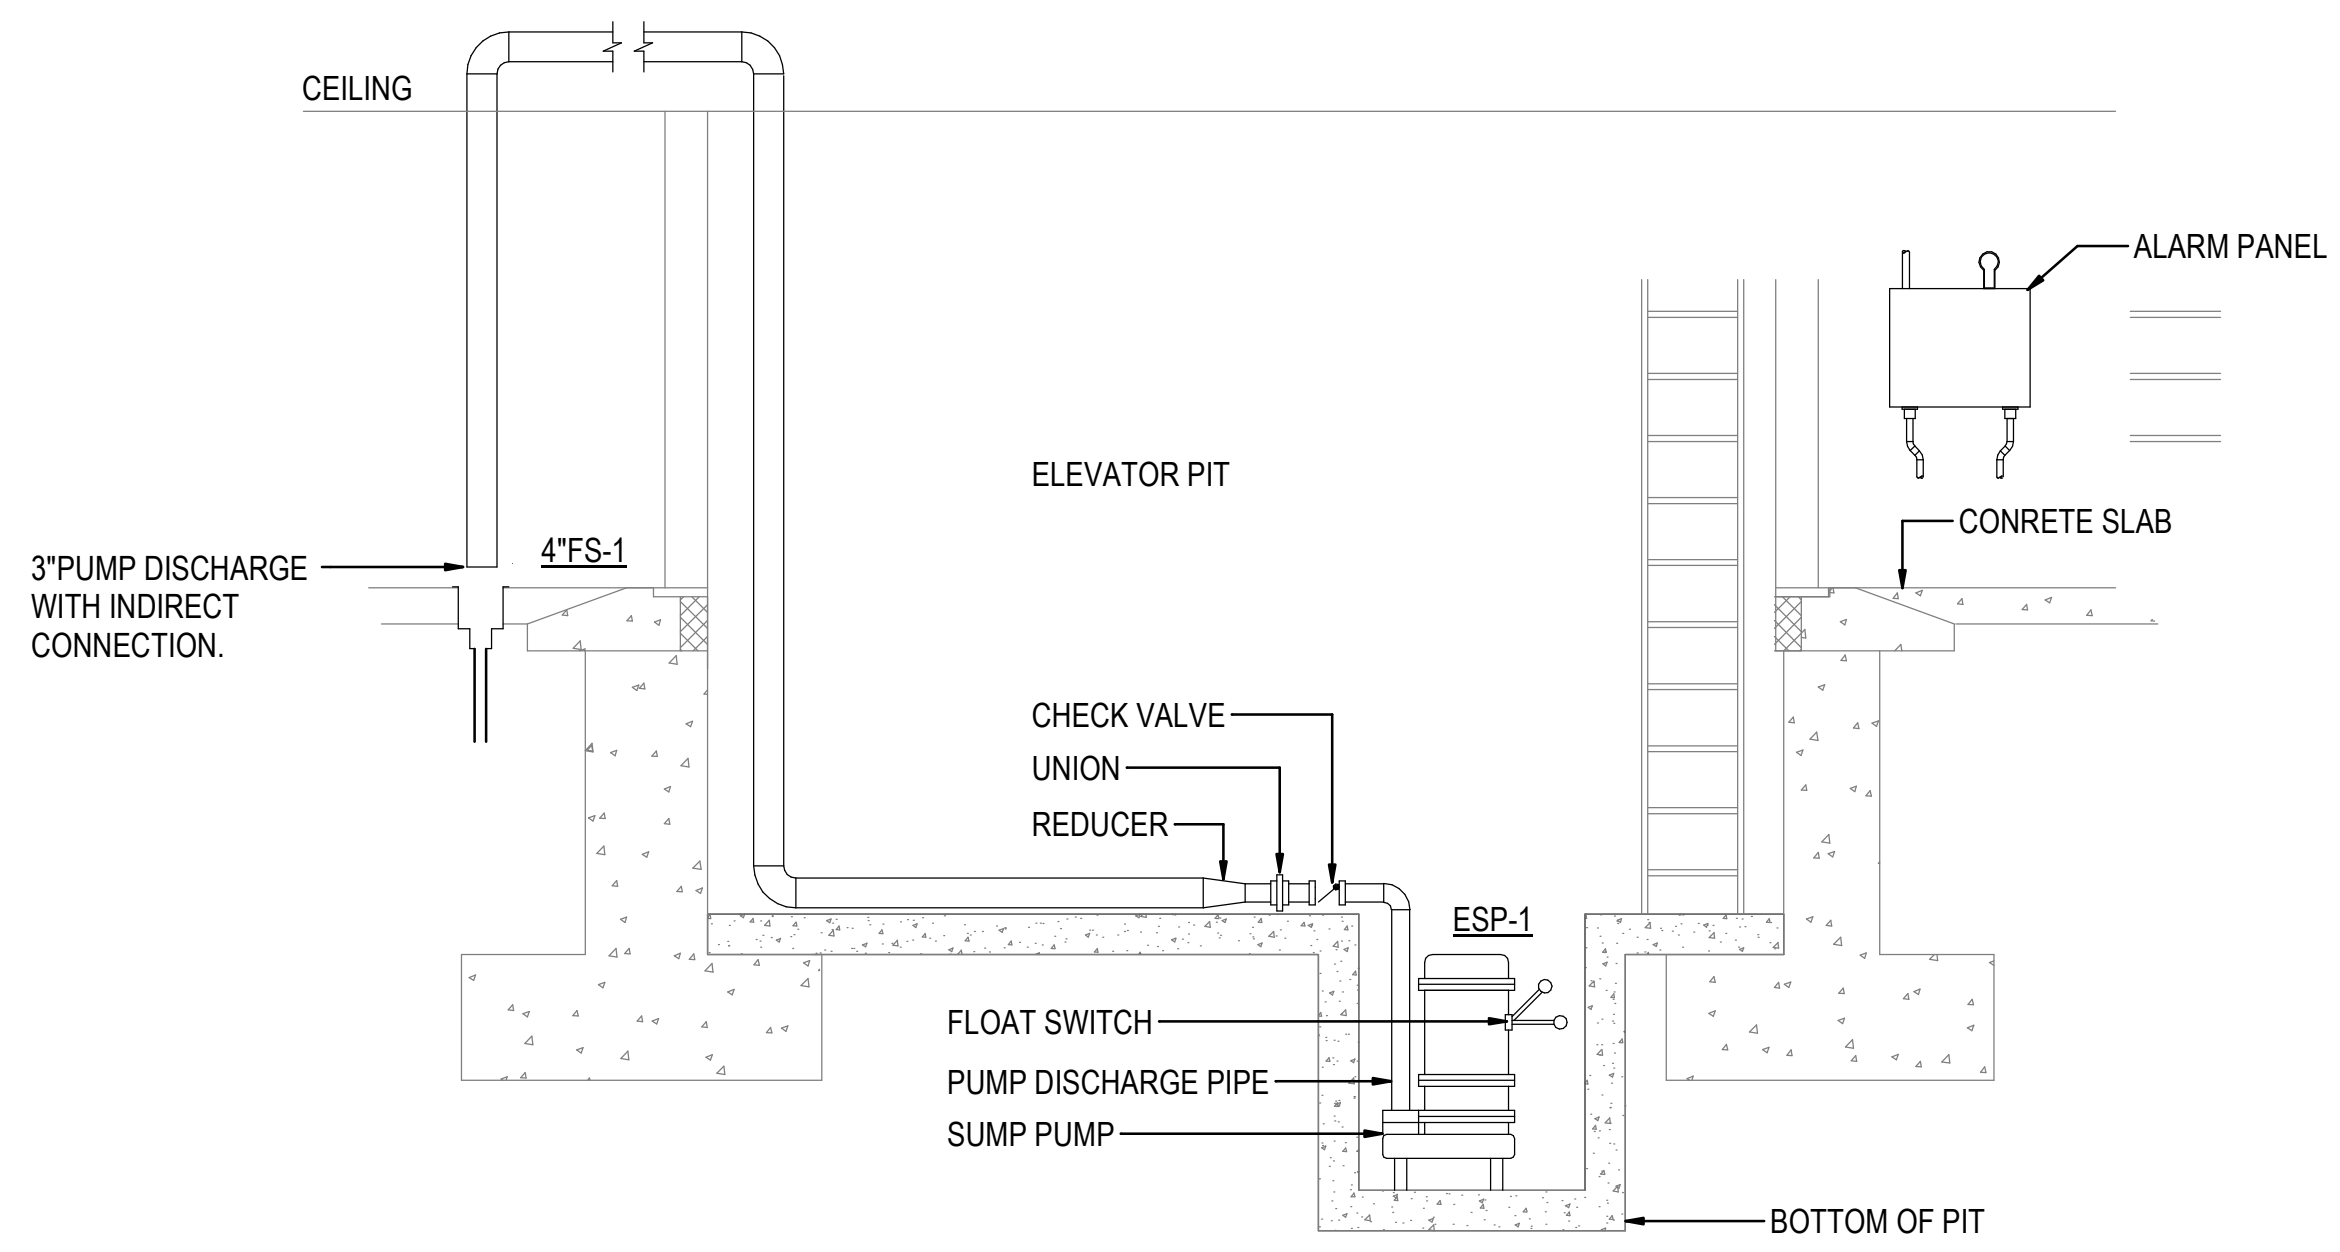


5 TRACTION ELEVATOR SUMP PUMP DETAIL
SCALE: N.T.S.

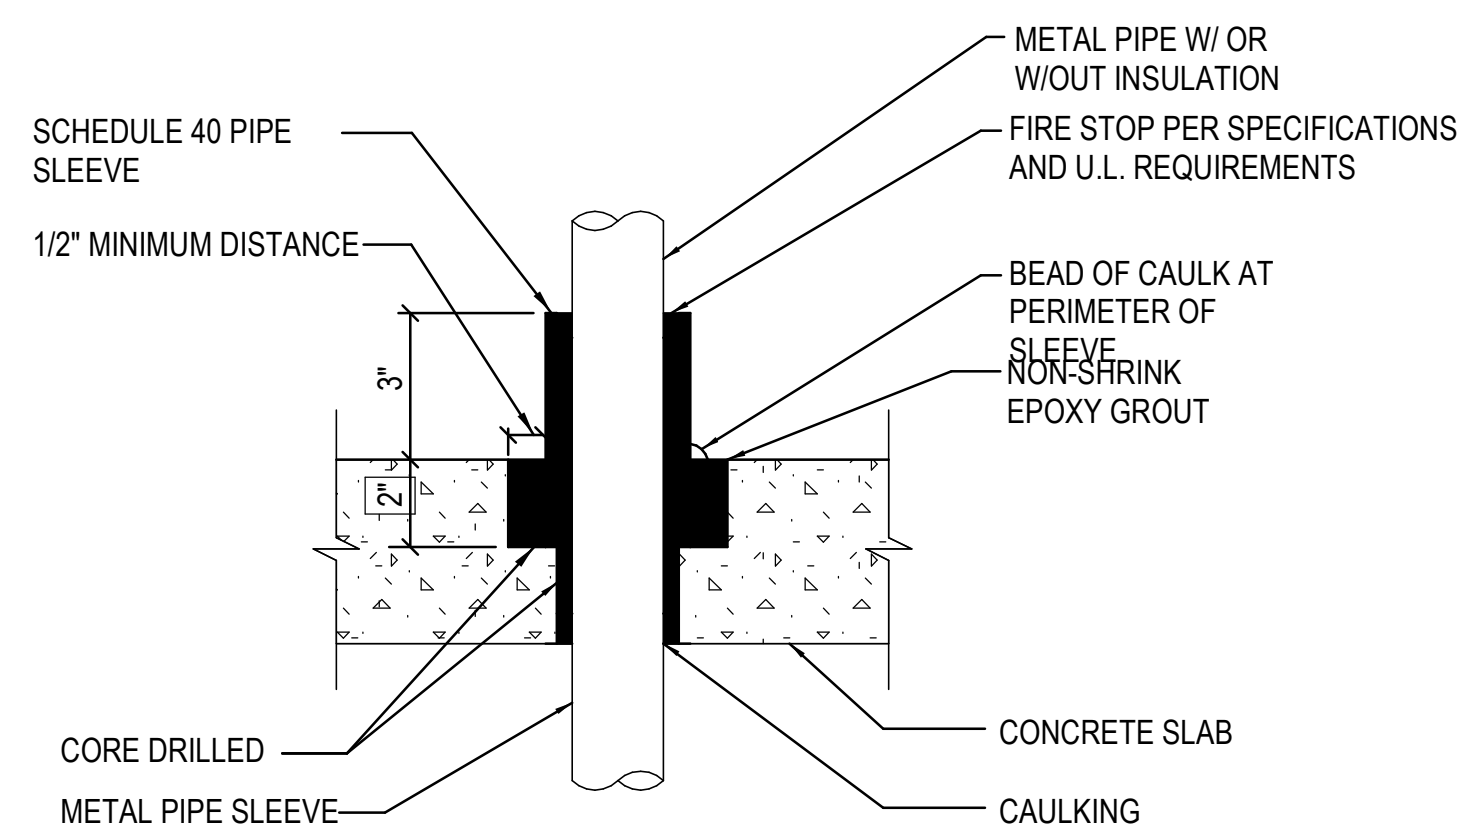

CORE DRILL AND SLEEVE DIAMETERS AS REQUIRED TO ACCOMMODATE PIPE, PIPE INSULATION AND FIRE STOP SYSTEM - ALL THAT APPLY. PRIOR TO ANY CORING, ALL PENETRATION LOCATIONS SHALL BE SUBMITTED TO THE BASE BUILDING STRUCTURAL ENGINEER FOR APPROVAL.

3 SLEEVE THRU FLOOR DETAIL
SCALE: NONE

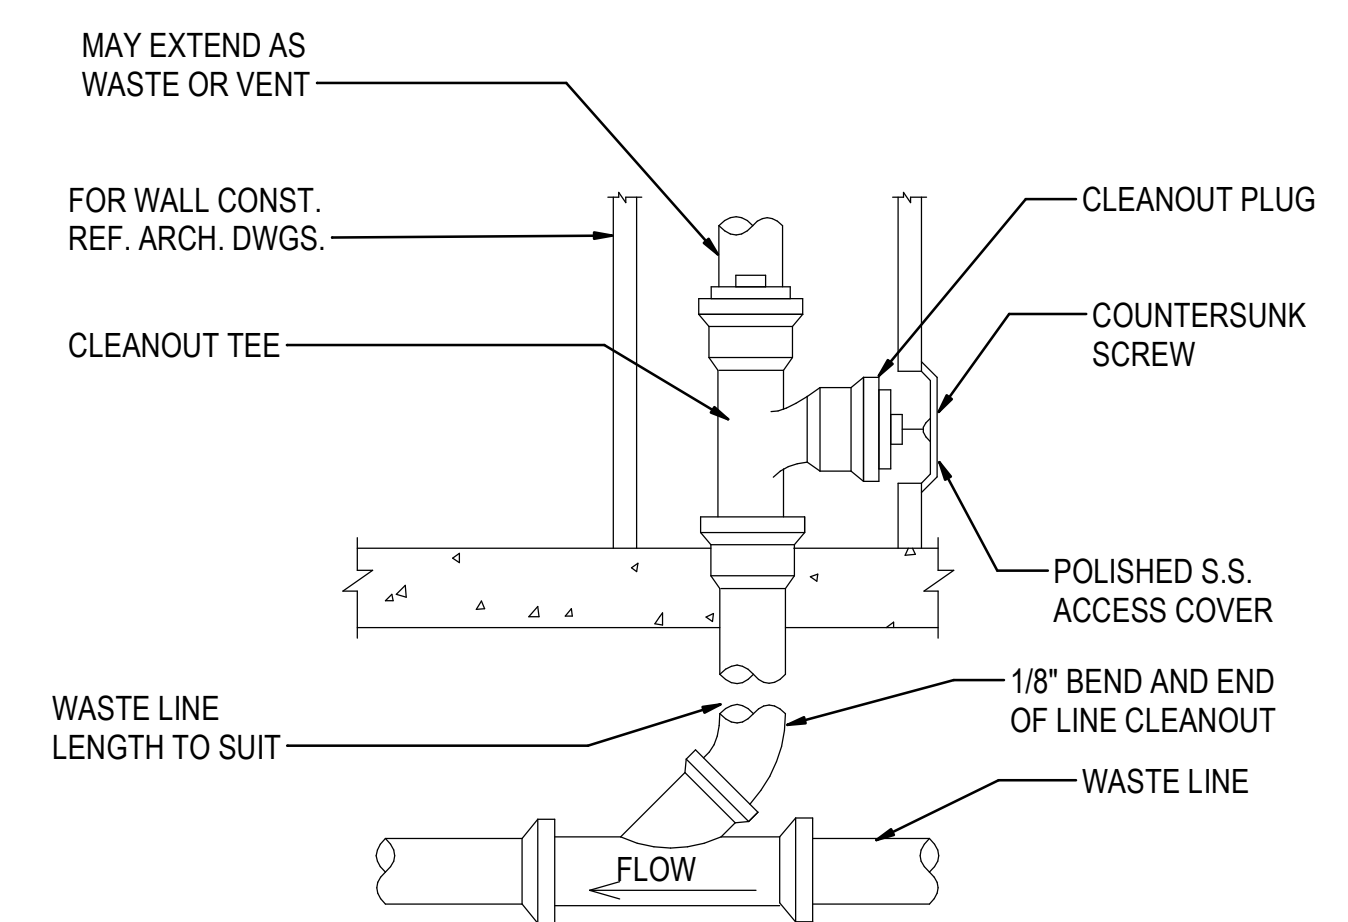

1 CONCEALED WALL CLEANOUT DETAIL
SCALE: N.T.S.

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

ABBREVIATIONS

#	TWO-WAY	HVAC	HEATING, VENTILATION, & AIR CONDITIONING
2WAY	TWO-WAY	HWP	HOT WATER PUMP
3WAY	THREE-WAY	HWR	HOT WATER RETURN
-A	AIR CONDITION	HWS	HOT WATER SUPPLY
A/C	AIR CONDITION	HZ	HERTZ
AD	ACCESS DOOR	-I	INSIDE DIMENSION
ADA	AMERICAN DISABILITIES ACT	IN	INCH
ADDL	ADDITIONAL	INSUL	INSULATION
ADJ	ADJUSTABLE	-K	KILOWATT
AFF	ABOVE FINISHED FLOOR	KW	KILOWATT
AHJ	AUTHORITY HAVING JURISDICTION	-L-	LINED
AHU	AIR HANDLING UNIT	L	LENGTH
AIA	AMERICAN INSTITUTE OF ARCH	LAT	LEAVING AIR TEMPERATURE
AMP	AMPERE	LBS	POUND(S)
ARCH	ARCHITECT	LH	LATENT HEAT
ASHRAE	AMERICAN SOCIETY OF HEATING, REFRIGERATION & AIR CONDITIONING ENGINEERS	LTH	LENGTH
AUTO	AUTOMATIC	LVR	LOUVER
AVG	AVERAGE	LWT	LEAVING WATER TEMPERATURE
-B-	BACKDRAFT DAMPER	-M-	MIXED AIR TEMPERATURE
BDD	BACKFLOW PREVENTOR	MAT	MAXIMUM
BFP	BACKFLOW PREVENTOR	MAX	MAXIMUM
BLDG	BUILDING	MBTUH	THOUSAND BTU PER HOUR
BLW	BELOW / UNDERGROUND	MECH	MECHANICAL
BTU	BRITISH THERMAL UNIT	MED	MEDIUM
BTUH	BRITISH THERMAL UNIT/HOUR	MER	MECHANICAL EQUIPMENT ROOM
-C	CAPACITY, CAPACITOR	MFR	MANUFACTURER
CAP	CAPACITY, CAPACITOR	MHP	MOTOR HORSEPOWER
CC	COOLING COIL	MIN	MINIMUM, MINUTE
CD	CEILING DIFFUSER, CONSTRUCTION DOCUMENT	MOT	MOTOR
CFM	CUBIC FEET PER MINUTE	MS	MOTOR STARTER
CFSD	COMBINATION FIRE/SMOKE DAMPER	MTD	MEAN TEMP DIFFERENCE
CH	CHILLER	MTGHT	MOUNTING HEIGHT
CHWP	CHILLED WATER PUMP	MU	MAKE UP WATER LINE
CHWR	CHILLED WATER RETURN	-N-	NOT IN CONTRACT
CHWS	CHILLED WATER SUPPLY	NO	NORMALLY OPEN, NUMBER NOT TO SCALE
CL	CENTER LINE, CLOSE, CLOSET	NTS	NOT TO SCALE
CLG	CEILING	-O-	OUTSIDE AIR
CNDS	CONDENSATE DRAIN	OA	OUTSIDE AIR
CO2	CARBON DIOXIDE	OD	OUTSIDE DIAMETER
COND	CONDENSER	-P-	PRESSURE DROP / DIFFERENCE
CONN	CONNECT, CONNECTION	PD	PRESSURE DROP / DIFFERENCE
CP	CONTROL PANEL, CHROME PLATED	PERF	PERFORATED
CV	CONSTANT VOLUME	PH	PHASE
CWP	CONDENSER WATER PUMP	PLBG	PLUMBING
CWR	CONDENSER WATER RETURN	POS	POSITIVE
CWS	CONDENSER WATER SUPPLY	PRV	PRESSURE REDUCING VALVE
-D-	EXISTING TO BE DEMOLISHED	PSI	POUNDS PER SQUARE INCH
(D)	EXISTING TO BE DEMOLISHED	-R-	REMOVE EXISTING
DB	DRY BULB	(R)	REMOVE EXISTING
dB	DECIBEL	R	RISE
DBA	UNIT OF SOUND LEVEL	RA	RETURN AIR
DBT	DRY BULB TEMPERATURE	RAG	RETURN AIR GRILLE
DDC	DIRECT DIGITAL CONTROL	REC	RECESSED
DEG	DEGREE	REFR	REFRIGERATION
DIA	DIAMETER	REG	REGISTER
DMPR	DAMPER	REM	REMOVABLE
DN	DOWN	REQD	REQUIRED
DPT	DEW POINT TEMPERATURE	RFGT	REFRIGERANT
DR	DRAIN	RH	RELATIVE HUMIDITY
DWG	DRAWING	RHC	REHEAT COIL
-E-	EXISTING TO REMAIN	RLA	RUNNING LOAD AMPERES
(E) / EX	EXISTING TO REMAIN	RL	REFRIGERANT LIQUID LINE
(ER)	EXISTING TO BE RELOCATED	RM	ROOM
EA	EXHAUST AIR	RPM	REVOLUTIONS PER MINUTE
EAR	EXHAUST AIR REGISTER	RSL	REFRIGERANT SUCTION LINE
EAT	ENTERING AIR TEMPERATURE	-S-	SUPPLY AIR, SHOCK ABSORBER
EDBT	ENTERING DRY BULB TEMP	SA	SUPPLY AIR REGISTER
EER	ENERGY EFFICIENCY RATIO	SAR	SUPPLY AIR REGISTER
EF	EXHAUST FAN	SD	SMOKE DAMPER / DETECTOR, STORM DRAIN
EL	ELEVATION / ELEVATOR LOBBY	SEER	SEASONAL ENERGY EFFICIENCY
ELEC	ELECTRIC / ELECTRICAL	SEER	SEASONAL ENERGY EFFICIENCY
EQ	EQUAL	SF	SQUARE FOOT (FEET)
ESP	EXTERNAL STATIC PRESSURE	SF	SUPPLY FAN
EWBT	ENTERING WET BULB TEMP	SP	STATIC PRESSURE
EWT	ENTERING WATER TEMP	SPEC	SPECIFICATION (SEE DETAILS)
EXH	EXHAUST	SS	STAINLESS STEEL
EXIST	EXISTING	STRUC	STRUCTURAL
-F-	FAHRENHEIT, FIRE SERVICE, FEMALE	-T-	THROAT
F	FAHRENHEIT, FIRE SERVICE, FEMALE	T	THROAT
FA	FACE, FREE AREA, FIRE ALARM	TA	TRANSFER AIR
FCU	FAN COIL UNIT	TDH	TOTAL DYNAMIC HEAD
FD	FIRE DAMPER	TEMP	TEMPERATURE
FIN FLR	FINISH FLOOR	TSTAT	THERMOSTAT
FLA	FULL LOAD AMPERES	TYP	TYPICAL
FLEX	FLEXIBLE	-V-	VOLT, VENT, VIDEO
FLTR	FILTER	V	VOLT, VENT, VIDEO
FPM	FEET PER MINUTE	VAV	VARIABLE AIR VOLUME
FT	FOOT, FEET	VD	VOLUME DAMPER
-G-	GALLON	VFD	VARIABLE FREQUENCY DRIVE
GAL	GALLON	W	WIDTH, WIRE, WATT, WASTE
GALV	GALVANIZED	W	WIDTH, WIRE, WATT, WASTE
GPM	GALLONS PER MINUTE	W	WIDTH, WIRE, WATT, WASTE
GRL	GRILLE	W/O	WITHOUT
-H-	HEAD	WB	WET BULB
HD	HEAD	WMS	WIRE MESH SCREEN
HORIZ	HORIZONTAL	WP	WEATHERPROOF, WORKING PRESSURE
HP	HORSEPOWER	WP	WEATHERPROOF, WORKING PRESSURE

SYMBOLS LEGEND

ANNOTATION	
	VIEW TITLE SCALE: NTS PLAN TITLE NO. -1
	TITLE MARK DETAIL OR PLAN NO. -1 FOUND IN M-201
	DETAIL REFERENCE DETAIL NO. -1 FOUND IN M-501
	SECTION MARK SECTION NO. -1 FOUND IN M-501
	DETAIL BOUNDARY B DETAIL NO. -2
	SHEET KEYNOTE
	REVISION CLOUD (DELTA 1)
	EQUIPMENT TAG DESIGNATION AC DESIGNATION NUMBER 1-1
	LOUVER IN DOOR MINIMUM 1.0 SQ FT. FREE AREA
	POINT OF CONNECTION
	POINT OF DISCONNECTION
DUCT	
	DUCTWORK (NEW)
	DUCTWORK (EXISTING)
	DUCTWORK (EXISTING TO BE DEMOLISHED)
	DUCTWORK WITH ACOUSTIC LINING
	DUCT UNDER POSITIVE PRESSURE
	DUCT UNDER NEGATIVE PRESSURE
	RISE IN DUCT (IN DIRECTION OF AIR FLOW)
	DROP IN DUCT (IN DIRECTION OF AIR FLOW)
	REHEAT COIL
	FLEX DUCT
	DUCT TRANSITION
	VANED ELBOW
	RADIUS ELBOW
	DUCT FITTING (SEE DETAILS)
	FLEXIBLE DUCT CONNECTION
	TRANSFER AIR BOOT (STRAIGHT) SEE SCHEDULE REQUIREMENTS
	TRANSFER AIR ELBOW WITH ACOUSTIC LINING
	SOUND ATTENUATOR
	ACCESS PANEL

DIFFUSERS	
	CEILING SUPPLY DIFFUSER, TYPE A, THROW PATTERN 4-WAY, 100 CFM
	CEILING RETURN REGISTER (GRILLE), TYPE A, 100 CFM
	CEILING EXHAUST TYPE A, 100 CFM
	CEILING SUPPLY WITH BLANKING PLATE (3-WAY)
	EXISTING TO REMAIN
	EXISTING TO BE DEMOLISHED
	SIDEWALL SUPPLY DIFFUSER
	LINEAR SLOT DIFFUSER
	12"x6" SIDEWALL SUPPLY REGISTER, 150 CFM
	12"x6" SIDEWALL RETURN / EXHAUST REGISTER, 150 CFM
	ROUND SUPPLY DIFFUSER
	ROUND RETURN DIFFUSER
	FLOOR REGISTER (GRILLE)
VAV BOXES	
	SINGLE DUCT VAV BOX
	SINGLE DUCT VAV WITH REHEAT
	SINGLE DUCT VAV BOX WITH ATTENUATOR
	SINGLE DUCT VAV BOX WITH REHEAT AND ATTENUATOR
	SHUT-OFF VAV BOX WITH HYDRONIC HEATING COIL AND OUTLET BOX
DAMPERS AND CONTROLS	
	COMBINATION SMOKE/FIRE DAMPER
	SMOKE DAMPER
	BACK DRAFT DAMPER
	VOLUME DAMPER
	THERMOSTAT
PIPING	
	NEW PIPING (SEE ABBREVIATION FOR PIPE I.D.)
	EXISTING TO REMAIN
	EXISTING TO BE DEMOLISHED
CONTROL DEVICES	
	PIPE HEAT TRACER
VALVES	
	BALL VALVE
	BUTTERFLY VALVE
	CHECK VALVE
	FLOAT VALVE
	FUSIBLE LINK
	GATE VALVE
	GATE VALVE - OS&Y
	GLOBE VALVE
	MOTORIZED BALL VALVE
	PLUG VALVE
	PLUG SAFETY VALVE
	PRESSURE REDUCING VALVE
	SOLENOID VALVE
	VALVED AND CAPPED OUTLET
	BACK FLOW PREVENTER
FITTINGS	
	ELBOW DOWN
	ELBOW DOWN TO TEE
	ELBOW UP
	END CAP
	TEE DOWN
	TEE UP
	UNION

GENERAL NOTES

- WHERE THERE IS A DISCREPANCY BETWEEN THE DRAWINGS AND SPECIFICATIONS, NOTIFY THE ENGINEER PRIOR TO BID. FOR BIDDING PURPOSES THE MORE STRINGENT SHALL APPLY.
- THE CONTRACTOR SHALL EXAMINE THE COMPLETE SET OF CONTRACT DOCUMENTS FOR ALL TRADES, AS ISSUED BY THE ARCHITECT AND REVIEW DIMENSIONS, SPACE REQUIREMENTS AND POINT OF CONNECTIONS TO ALL EQUIPMENT. MAKE ANY MINOR ADJUSTMENTS NECESSARY TO AVOID CONFLICTS WITH THE BUILDING STRUCTURE AND THE WORK OF OTHER TRADES.
- UNLESS INSTRUCTED OTHERWISE, THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, LICENSES, AND FEES REQUIRED FOR INSTALLATION OF THE MECHANICAL WORK. FURNISH FINAL CERTIFICATE OF INSPECTION OR WRITTEN EVIDENCE OF ACCEPTANCE BY INSPECTION AUTHORITIES FOR ALL WORK INSTALLED.
- REFER TO COMPLETE DRAWING PACKAGE FOR EXTENT OF CONSTRUCTION, AND EXACT LOCATION OF FIXTURES, EQUIPMENT, DEVICES, ETC.
- CONTRACTOR SHALL COORDINATE WITH ALL TRADES TO ENSURE AN UNDERSTANDING OF THE COMPLETE SCOPE OF PROJECT PRIOR TO START OF WORK.
- ALL EQUIPMENT & MATERIALS SHALL MATCH DESIGN SPECIFICATIONS AND MANUFACTURER'S RECOMMENDED INSTALLATION INSTRUCTIONS.
- LOCATION OF DUCTWORK IS APPROXIMATE. ALL DRAWINGS AND LAYOUT ARE DIAGRAMMATIC TO SHOW DESIGN INTENT ONLY. CONTRACTOR TO COORDINATE ALL DUCTWORK AND PIPING WITH ALL OTHER WORK IF FIELD CONDITIONS DIFFER SIGNIFICANTLY FROM THOSE SHOWN ON THE DRAWINGS AND AFFECT WORK, INFORM ARCHITECT IMMEDIATELY BEFORE PROCEEDING WITH THAT AREA.
- INSTALL FIRE DAMPER OR COMBINATION FIRE/SMOKE DAMPER ON ALL DUCTS PENETRATING FIRE RATED ENCLOSURES AND PARTITIONS, AND RATED CEILINGS OF HORIZONTAL EXITS. THE CONTRACTOR SHALL INTERLOCK ALL COMBINATION FIRE/SMOKE DAMPERS WITH LISTED AREA TYPE SMOKE DETECTORS IN THE BUILDING FIRE LIFE SAFETY SYSTEM. VERIFY WITH LIFE SAFETY SYSTEM CONTRACTOR. SEE FIRE ALARM SPECIFICATION AND SMOKE CONTROL NOTES FOR ADDITIONAL INFORMATION.
- AIR HANDLING UNITS AND FAN COIL UNITS SHALL BE PROVIDED WITH DUCT SMOKE DETECTORS AT THE UNITS' OUTLET WHEN THE UNITS CAPACITY EQUALS 2000 CFM OR GREATER.
- A MINIMUM OF 36" CLEAR WORKING SPACE, NOT LESS THAN 30" WIDE, SHALL BE MAINTAINED IN FRONT OF ALL SWITCHES, OVERCURRENT DEVICES AND ELECTRIC CONTROL COMPONENTS. THE WORKING SPACE SHALL BE CLEAR AND EXTEND FROM THE GRADE, FLOOR, OR PLATFORM TO A MINIMUM OF 6'-8" FT. WHERE THE ELECTRICAL EQUIPMENT EXCEEDS 6'-1/2 FT IN HEIGHT, THE MINIMUM HEADROOM SHALL NOT BE LESS THAN THE HEIGHT OF THE EQUIPMENT
- A MINIMUM OF 24" CLEAR WORKING SPACE SHALL BE PROVIDED IN FRONT OF THE ACCESS PANELS.
- THE SMOKE DETECTORS LOCATED AT AIR MOVING EQUIPMENT SHALL SHUT DOWN ALL AIR HANDLING EQUIPMENT VIA THE LIFE SAFETY SYSTEM. WHEN SMOKE IS DETECTED AT EQUIPMENT, ALL OTHER AIR MOVING EQUIPMENT LOCATED IN OR CONNECTED TO COMMON PLENUM OR SMOKE ZONE SHALL SHUT DOWN.
- ALL ELECTRICAL CONTROLS FOR THE SMOKE CONTROL SHALL BE RATED FOR SUCH USE.
- PROVIDE ACCESS PANELS (MATCH WALL OR CEILING RATING) IN ALL WALLS OR CEILINGS WHERE ACCESS TO DAMPERS, CONTROLS, ETC ARE REQUIRED BY CODE. COORDINATE LOCATIONS WITH ARCHITECT.
- CONTRACTOR SHALL NOTE THE CRITICAL SPACE AVAILABLE ABOVE CEILINGS. PROVIDE TRANSITION PIECES AT CROSSOVERS, UNDER BEAMS, OVER/UNDER PIPES, AS REQUIRED TO ACCOMMODATE DUCTS WITHIN SPACE AVAILABLE, PROVIDING EQUIVALENT DUCT SIZE TO THE DIAMETER SHOWN. COORDINATE CLOSELY WITH OTHER TRADES TO REDUCE NECESSITY OF TRANSITIONS TO A MINIMUM. NO ADDITIONAL COSTS WILL BE PAID FOR ANY REQUIRED TRANSITIONS OR OTHER SPECIAL CHANGE SHAPE PIECES. ALL DUCTWORK SHALL BE SUPPORTED AND SEISMICALLY RESTRAINED PER THE LOCAL BUILDING CODES AND SMACNA STANDARD.
- THERE SHALL BE NO PIPING AND/OR DUCTWORK RUN THROUGH ELECTRICAL ROOMS UNLESS THAT DUCTWORK AND/OR PIPING IS SERVING THAT ELECTRICAL SPACE.
- ALL FLEXIBLE DUCT CONNECTIONS TO AIR DISTRIBUTION DEVICES TO BE MAX. 5'-0" ACOUSTICAL FLEX DUCT PER SPECIFICATIONS.
- NOT ALL SYMBOLS, NOTES, DETAILS AND EQUIPMENT IN SCHEDULES ON GENERAL SHEETS WILL APPLY TO EACH BUILDING. THEY ARE TO COVER ALL BUILDINGS AND WILL APPLY BASED ON SCOPE IN BUILDING.
- LOCATE EXISTING REINFORCING STEEL UTILIZING ANY SUITABLE METAL DETECTION SYSTEM. DO NOT CUT ANY EXISTING STEEL REINFORCEMENT. SHIFT ANCHOR OR CORE TO MISS THE REBAR.
- BOLTS MUST BE INSTALLED TO AVOID DAMAGING EXISTING STEEL REINFORCEMENT. IN CASE OF CONFLICT, ADJUST BOLT LOCATION, ALLOWING FOR 1" CONCRETE COVER BETWEEN REBAR AND BOLT.
- PROVIDE TRANSFER DUCTS AS NECESSARY ABOVE CEILING FOR RETURN AIR PATH TO AIR HANDLING EQUIPMENT SERVING THAT SPACE. REFER TO DETAILS FOR TRANSFER DUCT SIZES.


SHEET INDEX

NO.	TITLE	SCALE
M-001-900A	MECHANICAL COVER SHEET	NONE
M-002-900A	SCHEDULES	NONE
M-101-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL A - PHASE 3	1" = 20'-0"
M-102-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL B - PHASE 3	1" = 20'-0"
M-103-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL C - PHASE 3	1" = 20'-0"
M-104-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL D - PHASE 3	1" = 20'-0"
M-105-900A	GARAGE A HVAC DEMOLITION PLAN - LEVEL E - PHASE 3	1" = 20'-0"
M-201-900A	GARAGE A HVAC PLAN - LEVEL A - PHASE 3	1" = 20'-0"
M-202-900A	GARAGE A HVAC PLAN - LEVEL B - PHASE 3	1" = 20'-0"
M-203-900A	GARAGE A HVAC PLAN - LEVEL C - PHASE 3	1" = 20'-0"
M-204-900A	GARAGE A HVAC PLAN - LEVEL D - PHASE 3	1" = 20'-0"
M-205-900A	GARAGE A HVAC PLAN - LEVEL E - PHASE 3	1" = 20'-0"
M-901-900A	DETAILS	NONE



DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

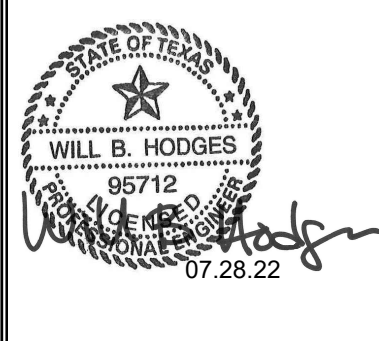

h+k
SYSKA HENNESSY
GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7009
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A

MECHANICAL COVER SHEET

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER

M-001-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

WALL LOUVER SCHEDULE

MARK	SERVES	TYPE	AIRFLOW (CFM)	SIZE		FREE AREA (%)	MANUFACTURER	MODEL	NOTES
				WIDTH	HEIGHT				
L-1	ELECTRICAL ROOMS	STATIONARY EXHAUST LOUVER	1,200	36"	24"	50	RUSKIN	ELF6375DX	ALL

- NOTES:
- COORDINATE LOUVER THICKNESS WITH WALL CONSTRUCTION. COORDINATE EXACT DIMENSIONS WITH FIELD CONDITIONS.
 - ALUMINUM CONSTRUCTION.
 - COORDINATE PAINT COLOR WITH ARCHITECT.
 - DRAINABLE BLADES.
 - PROVIDE WITH INSECT SCREEN.
 - PROVIDE WITH GRAVITY BACKDRAFT DAMPER.
 - REFER TO MECHANICAL PLANS AND CONTROLS DRAWINGS FOR ADDITIONAL INFORMATION.

DOOR LOUVER SCHEDULE

MARK	SERVES	TYPE	AIRFLOW (CFM)	SIZE		FREE AREA (%)	MANUFACTURER	MODEL	NOTES
				WIDTH	HEIGHT				
L-2	ELECTRICAL ROOMS	DOOR MOUNTED INTAKE LOUVER	1,200	26"	26"	50	DAYTON	SNKN3	ALL

- NOTES:
- COORDINATE LOUVER AND PAINT COLOR WITH ARCHITECT.
 - COORDINATE LOUVER THICKNESS WITH DOOR CONSTRUCTION.
 - ALUMINUM CONSTRUCTION.
 - PROVIDE WITH INSECT SCREEN.
 - REFER TO MECHANICAL PLANS AND CONTROLS DRAWINGS FOR ADDITIONAL INFORMATION.

ELECTRIC UNIT HEATER SCHEDULE

MARK	AIRFLOW (CFM)	SERVES	ELECTRICAL DATA		MANUFACTURER	MODEL	MONITOR	CONTROL	NOTES
			KW	V / PH					
EUH-A-A-1	310	ELEC 46 (LEVEL A)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-A-2	310	ELEC 45 (LEVEL A)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-C-1	310	ELEC 300 (LEVEL C)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-C-2	310	ELEC 307 (LEVEL C)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-C-3	310	COMM (CR) (LEVEL C)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-C-4	310	COMM (CR) (LEVEL C)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL
EUH-A-C-5	310	COMM (MCR) (LEVEL C)	3.0	277 / 1	REZNOR	EGEB	N / A	LOCAL TSTAT	ALL

- NOTES:
- PROVIDE 24V CONTROLS TRANSFORMER.
 - PROVIDE WITH FACTORY FURNISHED WALL-MOUNTED THERMOSTAT. SET TO 45°F.
 - PROVIDE WITH FACTORY FURNISHED MOUNTING KIT.
 - PROVIDE WITH AUTO-RESET THERMAL OVERLOAD.
 - INSTALL PER MANUFACTURER RECOMMENDATIONS AND GUIDELINES.

ROOFTOP UNIT SCHEDULE		
MANUFACTURER:	TRANE	TRANE
Unit Configuration Data		
Tag Name	RTU-A-5-1	RTU-A-5-2
Unit Model	THC060F4RRGA	THC060F4RRGA
Unit Size	060 (5 Tons)	060 (5 Tons)
Volts-Phase-Hertz	460-3-60	460-3-60
Duct Configuration	Vertical Supply / Vertical Return	
Base Unit Length (ft)	7.39	7.39
Base Unit Width (ft)	4.44	4.44
Base Unit Height (ft)	3.41	3.41
Base Unit Weight (lb)	679	679
Total Oper. Weight (lb)	942	942
Cooling Performance		
Actual Airflow (CFM)	2400	2400
Condenser Entering Air DB (F)	115.0	115.0
Evaporator Entering Air DB (F)	75.00	75.00
Evaporator Entering Air WB (F)	56.80	56.80
Ambient Temp	105.0	105.0
Leaving Coil Dry Bulb (F)	55.31	55.31
Leaving Coil Wet Bulb (F)	48.32	48.32
Leaving Unit Dry Bulb (F)	57.32	57.32
Leaving Unit Wet Bulb (F)	49.23	49.23
Gross Cooling Capacity (MBH)	52.12	52.12
Gross Sensible Cooling Capacity (MBH)	51.03	51.03
Net Cooling Capacity (MBH)	47.90	47.90
Net Sensible Cooling Capacity (MBH)	46.81	46.81
Compressor Power Input (KW)	4.31	4.31
Heating Performance		
Heat Type	ELECTRIC	ELECTRIC
Heating Stages	2	2
Output Heating Capacity	61.47 MBH	61.47 MBH
Heating EAT	70.00	70.00
Heating LAT	93.59	93.59
Heating Temp Rise	23.59	23.59
Supply Fan		
External Static Pressure (in wg)	1.00	1.00
Total Static Pressure (in wg)	1.26	1.26
Supply Fan RPM	1172	1172
Supply Fan Power (BHP)	1.33	1.33
Supply Motor Horsepower	1.00	1.00
Electrical Data		
Rooftop MCA	30.0	30.0
Rooftop MOCP	30.0	30.0
Heater KW Rating	17.4	17.4

- NOTES:
- PROVIDE INTEGRAL DISCONNECT SWITCH.
 - UNIT SHALL BE COMPLETELY PRE-WIRED AT FACTORY INCLUDING CONTROLS.
 - 120V, GFI CONVENIENCE OUTLET (POWERED) AND 208V/120V CONTROL TRANSFORMER MOUNTED UPSTREAM OF MAIN EQUIPMENT DISCONNECT.
 - FIRE ALARM CONTRACTOR TO FURNISH WIRE AND CONNECT SMOKE DETECTOR IN THE SUPPLY AND RETURN AIR DUCT. MECHANICAL CONTRACTOR TO INSTALL.
 - PROVIDE NEW ROOF CURB. ENSURE OUTSIDE AIR INTAKE IS MINIMUM 3'-0" A.F.R.
 - HINGED ACCESS DOORS.
 - T.S.P. = I.S.P. + E.S.P. E.S.P. INCLUDES DUCTWORK PRESSURE LOSSES + DIRTY FILTER ALLOWANCES. I.S.P. INCLUDES INTERNAL COMPONENT LOSSES + CLEAN FILTER.
 - PROVIDE WATER LEVEL SENSING DEVICE LOCATED IN PRIMARY DRAIN. WATER LEVEL SENSING DEVICE (FLOAT SWITCH) SHALL SHUT OFF UNIT IN THE EVENT THAT PRIMARY DRAIN BECOMES RESTRICTED.
 - PROVIDE A COMPARATIVE ENTHALPY ECONOMIZER.

EXHAUST FAN SCHEDULE

MARK	LOCATION	TYPE	DRIVE	AIRFLOW (CFM) DAY 2 / DAY 1	E.S.P. (IN. W.G.)	FAN RPM	MOTOR		MANUFACTURER / MODEL NUMBER	NOTES
							VOLT / PHASE	HP		
EF-A-A-1	ELEC 46 - LEVEL A	INLINE	DIRECT	1,200 / 600	0.3 @ 1,200 CFM	1,353	208 / 1	1/2	LOREN COOK / 120SQN (VF)	ALL
EF-A-A-2	ELEC 45 - LEVEL A	INLINE	DIRECT	1,200 / 600	0.3 @ 1,200 CFM	1,353	208 / 1	1/2	LOREN COOK / 120SQN (VF)	ALL
EF-A-C-1	ELEC 50 - LEVEL C	INLINE	DIRECT	1,200 / 600	0.3 @ 1,200 CFM	1,353	208 / 1	1/2	LOREN COOK / 120SQN (VF)	ALL
EF-A-C-2	ELEC 49 - LEVEL C	INLINE	DIRECT	1,200 / 600	0.3 @ 1,200 CFM	1,353	208 / 1	1/2	LOREN COOK / 120SQN (VF)	ALL

- NOTES:
- CENTRIFUGAL SQUARE INLINE, DIRECT DRIVE, EXHAUST FAN.
 - PROVIDE WITH LOREN COOK VARI-FLOW EC MOTOR WITH FAN MOUNTED AIR BALANCING KIT (VFABK) AND WALL MOUNTED TEMPERATURE CONTROL (VFTC) OR EQUAL. FAN SHALL RUN WHEN SPACE TEMP REACHES 100°F.
 - FAN SHALL BE BALANCED TO 600 CFM FOR DAY-1 OPERATION AND SHALL BE BALANCED TO 1,200 CFM FOR DAY-2 OPERATION VIA FAN MOUNTED AIR BALANCING KIT.
 - PROVIDE WITH FACTORY FURNISHED GRAVITY BACK DRAFT DAMPER.
 - PROVIDE WITH FACTORY FURNISHED DISCONNECT.
 - SUSPEND FAN FROM SLAB ABOVE WITH SPRING-TYPE VIBRATION ISOLATORS.

DX SPLIT SYSTEM SCHEDULE

MARK	AC-A-C-1	AC-A-C-2	AC-A-C-3 & AC-A-C-4
SERVES	LEVEL C TELECOMM (CR)	LEVEL C TELECOMM (CR)	LEVEL C TELECOMM (MCR)
SUPPLY FAN DATA	CFM	775	775
	VOLTS / PH	208 / 1	208 / 1
	RFS	25	30
	TYPE	DX	DX
COOLING DATA	EAT °F DB / WB	77.0 / 64	77.0 / 64
	TOTAL MBH	27.7	20.8
	AMBIENT TEMP. (°F)	105.0	105.0
HEATING DATA	EAT °F DB / WB	70 / 59	70 / 59
	TOTAL MBH	31.6	26.4
	AMBIENT TEMP. (°F) DB / WB	115 / 0	115 / 0
CU ELEC. DATA	MARK	CU-A-C-1	CU-A-C-2
	MCA	19	29
	MOCP	26.0	44.0
	VOLTS / PHASE	208 / 1	208 / 1
	SEER	19.80	19.55
MANUFACTURER/MODEL NO.	TRANEMITSUBISHI	TRANEMITSUBISHI	TRANEMITSUBISHI
EVAPORATOR UNIT (INDOOR)	TPKA0A0361KA70A	TPKA0A0361KA70A	TPKFYP024KM142A
CONDENSING UNIT (OUTDOOR)	TRUZA0301HA70NA	TRUZA0301HA70NA	TUMYP0481AK43NA
CONTROLS	MONITOR	BMS	BMS
	CONTROL	LOCAL TSTAT	LOCAL TSTAT
NOTES	ALL	ALL	ALL

- NOTES:
- PROVIDE WITH FACTORY FURNISHED MOUNTING KIT.
 - PROVIDE WITH FACTORY FURNISHED CONDENSATE PUMP. ROUTE CONDENSATE LINE TO NEAREST APPROVED DRAIN.
 - PROVIDE WITH WALL MOUNTED WIRED THERMOSTAT.
 - R410A REFRIGERANT TO BE USED.
 - PROVIDE LOW AMBIENT CAPACITY CONTROL TO 0 °F.
 - EQUIPMENT ROOMS OPERATE 24 HOURS A DAY, 7 DAYS A WEEK.
 - SUPPORT CONDENSING UNIT ON HOUSE KEEPING PAD.
 - REFER TO MANUFACTURER GUIDELINES AND RECOMMENDATIONS FOR SIZING AND ROUTING OF REFRIGERANT LINES.
 - INDOOR UNIT INVERTER DRIVEN; SINGLE POINT CONNECTION AT CONDENSING UNIT.
 - INDOOR UNIT IN FRONT DISCHARGE, TOP RETURN CONFIGURATION.


MINI SPLIT SYSTEM SCHEDULE

MARK	AC-A-5-1	
SERVES	MACHINE ROOM	
SUPPLY FAN DATA	LOW/MED/HIGH CFM	705/810/920
	VOLTS / PH	208 / 1
	RFS	30
	TYPE	DX
COOLING DATA	EAT °F DB / WB	72.0 / 66
	TOTAL MBH	36
	AMBIENT TEMP. (°F)	105.0
HEATING DATA	EAT °F DB / WB	77 / 59
	TOTAL MBH	40
	AMBIENT TEMP. (°F) DB / WB	115 / 0
CU ELEC. DATA	MARK	CU-A-5-1
	MCA	25
	MOCP	31.0
	VOLTS / PHASE	208 / 1
	SEER	18.80
MANUFACTURER/MODEL NO.	TRANEMITSUBISHI	
EVAPORATOR UNIT (INDOOR)	TPKA0A0361KA70A	
CONDENSING UNIT (OUTDOOR)	TRUZA0361KA70NA	
CONTROLS	MONITOR	BMS
	CONTROL	LOCAL TSTAT
NOTES	ALL	

- NOTES:
- PROVIDE WITH FACTORY FURNISHED MOUNTING KIT.
 - PROVIDE WITH FACTORY FURNISHED CONDENSATE PUMP. ROUTE CONDENSATE LINE TO NEAREST APPROVED DRAIN.
 - PROVIDE WITH WALL MOUNTED WIRED THERMOSTAT.
 - R410A REFRIGERANT TO BE USED.
 - PROVIDE LOW AMBIENT CAPACITY CONTROL TO 0 °F.
 - EQUIPMENT ROOMS OPERATE 24 HOURS A DAY, 7 DAYS A WEEK.
 - PROVIDE SUPPORTS FOR CONDENSING UNIT ON ROOF.
 - REFER TO MANUFACTURER GUIDELINES AND RECOMMENDATIONS FOR SIZING AND ROUTING OF REFRIGERANT LINES.
 - INDOOR UNIT INVERTER DRIVEN; SINGLE POINT CONNECTION AT CONDENSING UNIT.
 - INDOOR UNIT IN FRONT DISCHARGE, TOP RETURN CONFIGURATION.
 - PROVIDE VIBRATION ISOLATION MOUNTS FOR CONDENSING UNIT ON THE ROOF.

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

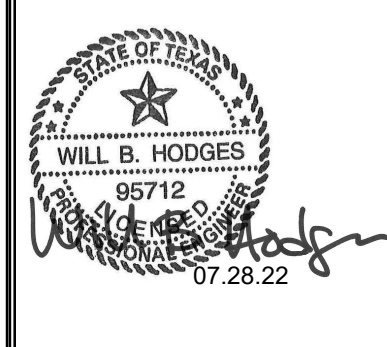

SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
PEM REGISTRATION NUMBER F-7069

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-07-28	75% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007


Garage A
SCHEDULES

SHEET NUMBER

M-002-900A

PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

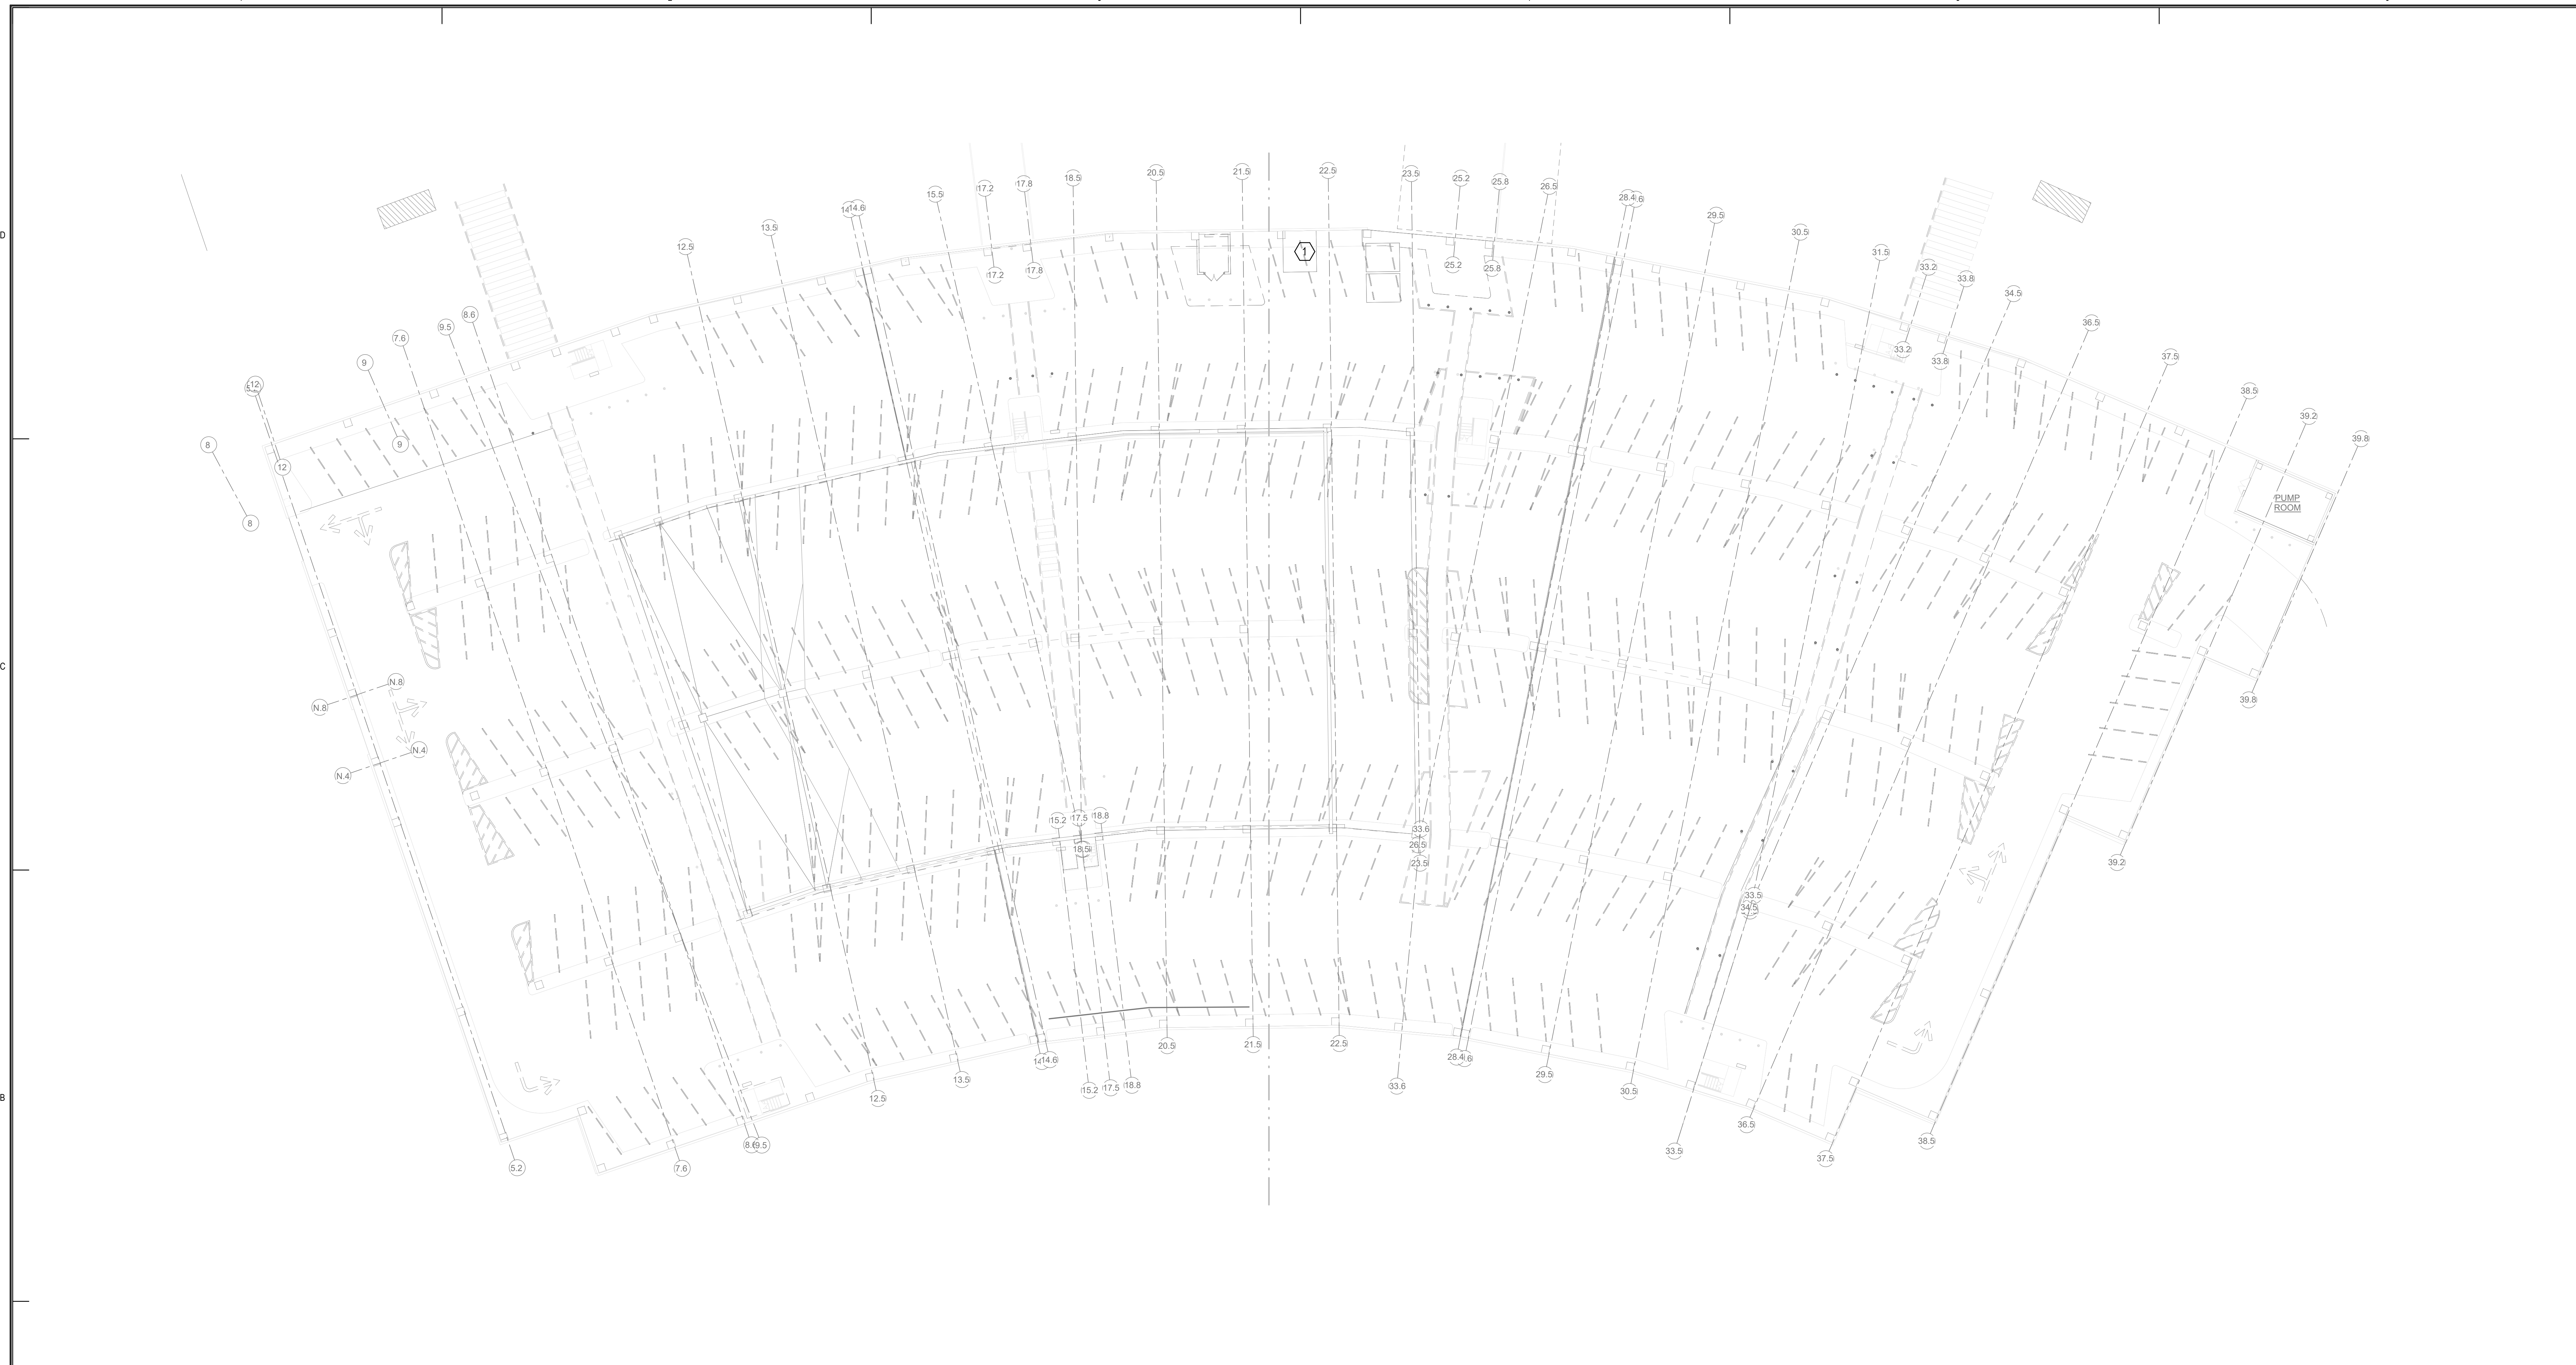


SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

1. DEMOLISH ALL MECHANICAL EQUIPMENT AND ACCESSORIES IN THIS EXISTING ELECTRICAL ROOM TO BE DEMOLISHED.

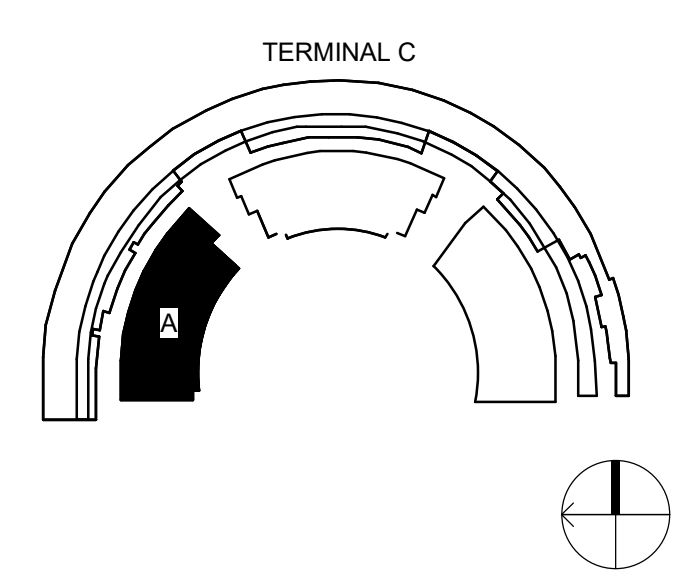

NO.	DATE	DESCRIPTION
	2022-07-28	75% DESIGN
	2022-09-01	100% DESIGN
	2022-07-28	100% ISSUED FOR PERMIT (IFP)

DRAWN BY: SHG
 APPROVED BY: WH
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

Garage A

GARAGE A HVAC DEMOLITION PLAN - LEVEL A - PHASE 3


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

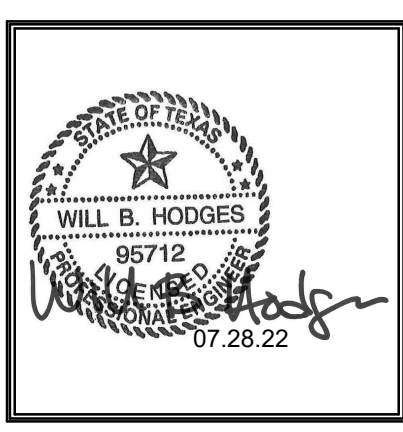


h+k SYSKA HENNESSY GROUP

A member company of SH Group, Inc.
 TEXAS BOARD OF PROFESSIONAL ENGINEERS
 FIRM REGISTRATION NUMBER F-7069

4925 Greenville Avenue
 Suite 415
 Dallas, TX 75206
 Tel: 972-470-0704
 www.syska.com

SHEET NUMBER
M-101-900A

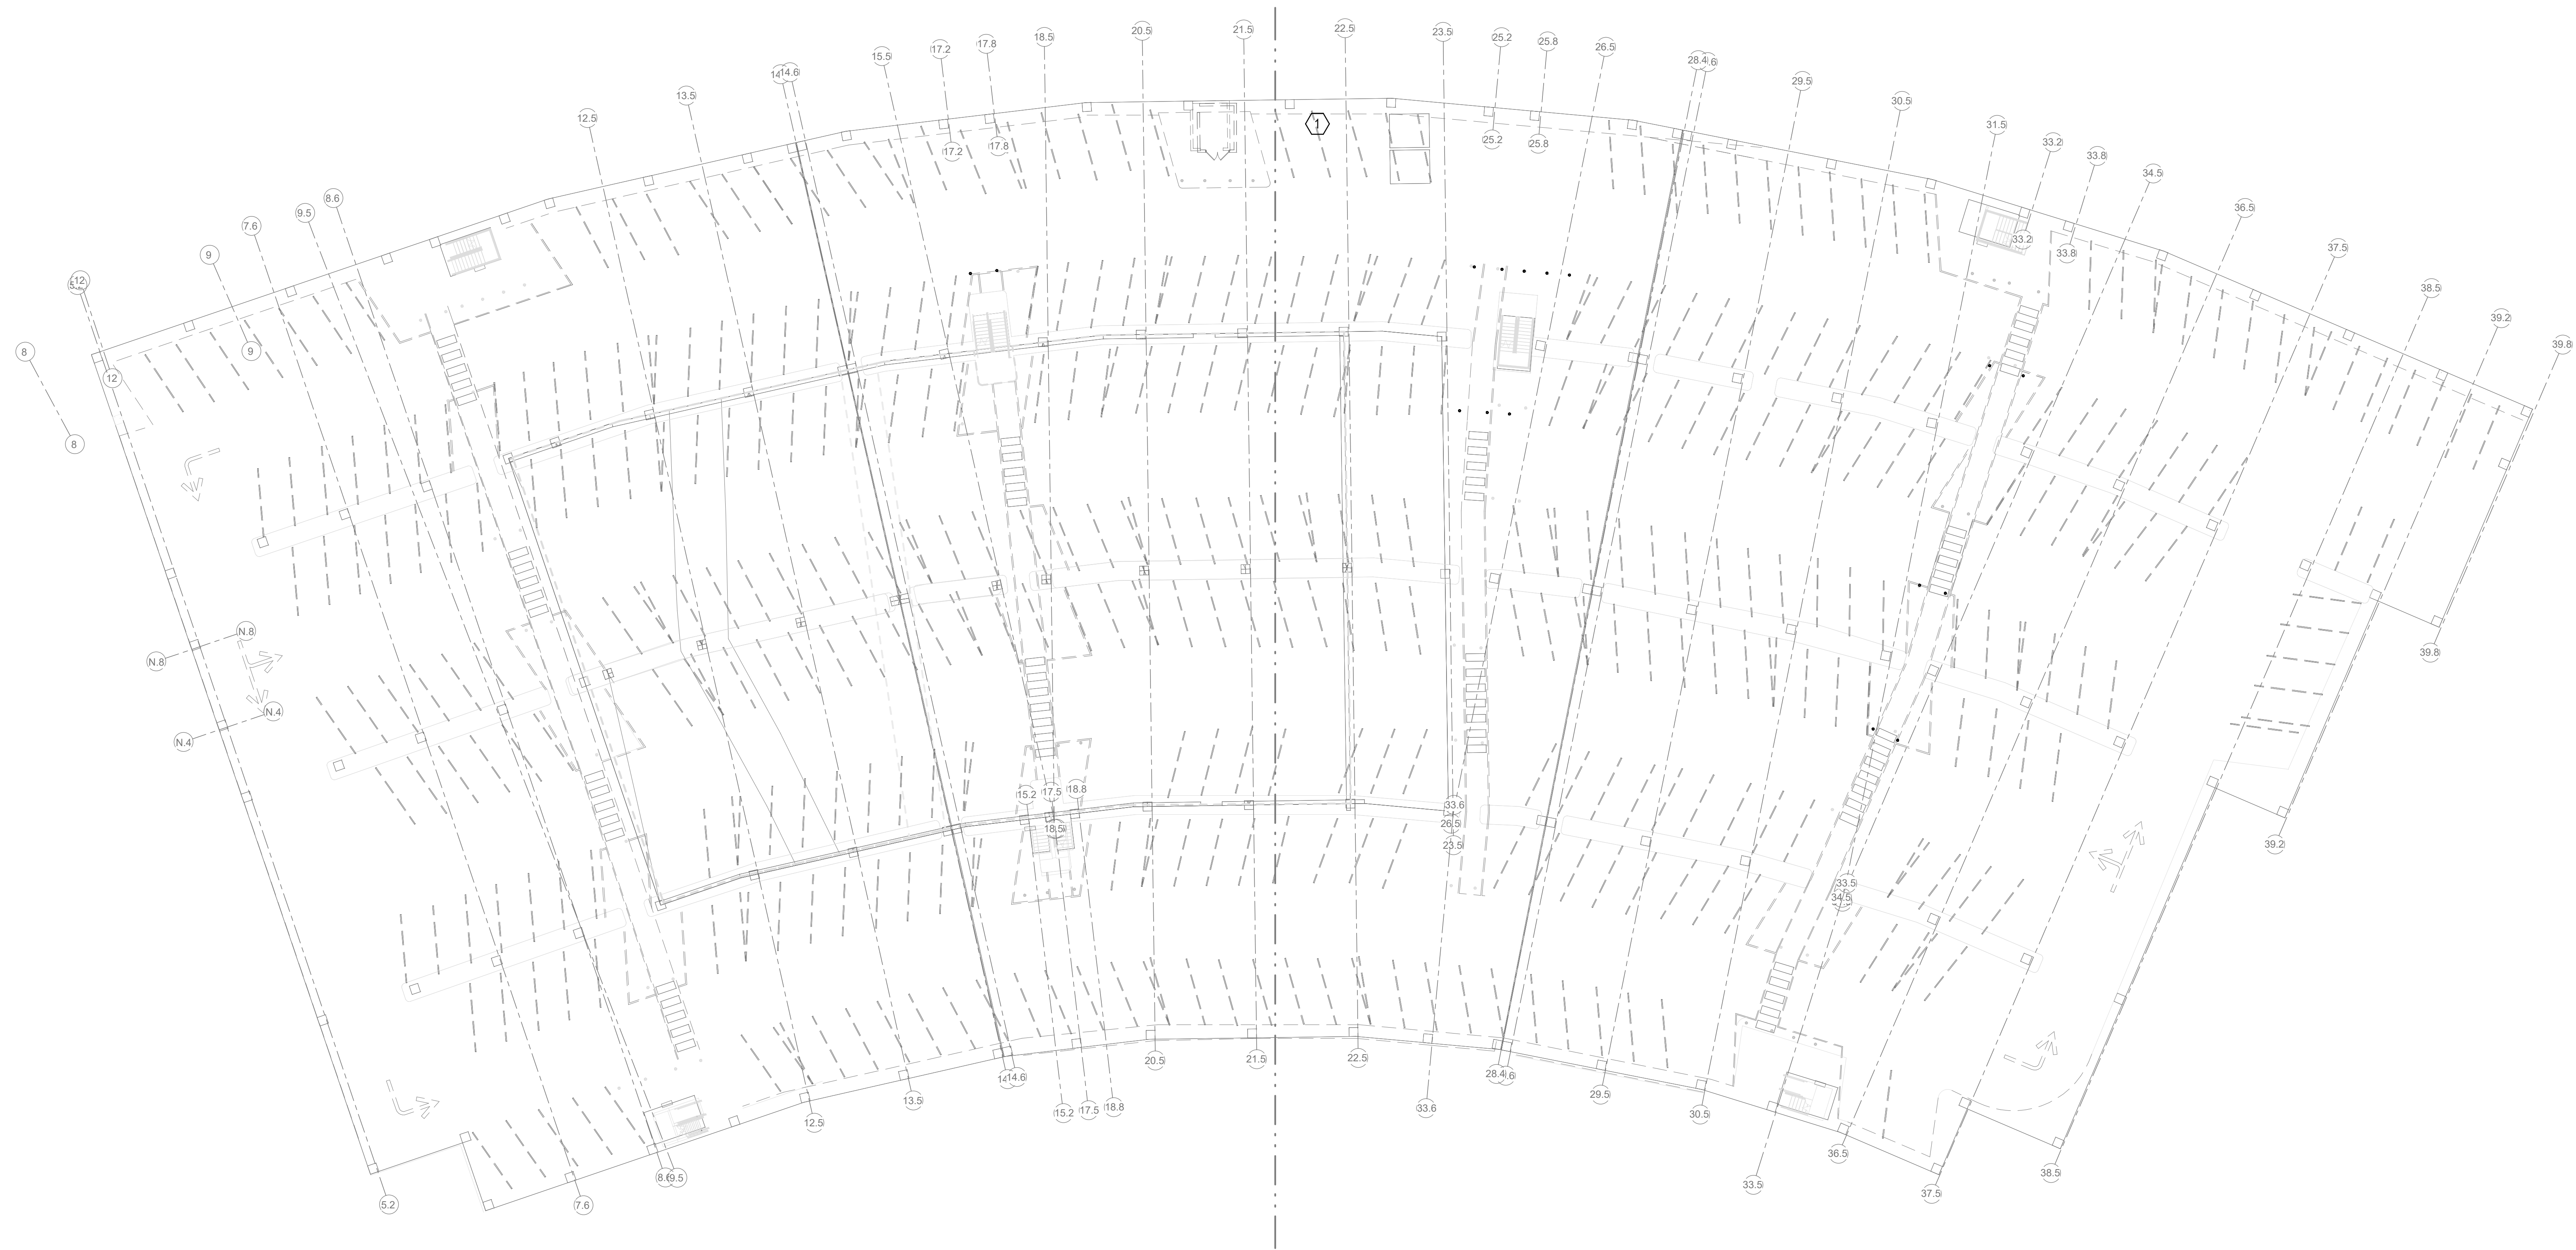


SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. DEMOLISH ALL MECHANICAL EQUIPMENT AND ACCESSORIES IN THIS EXISTING ELECTRICAL ROOM TO BE DEMOLISHED.

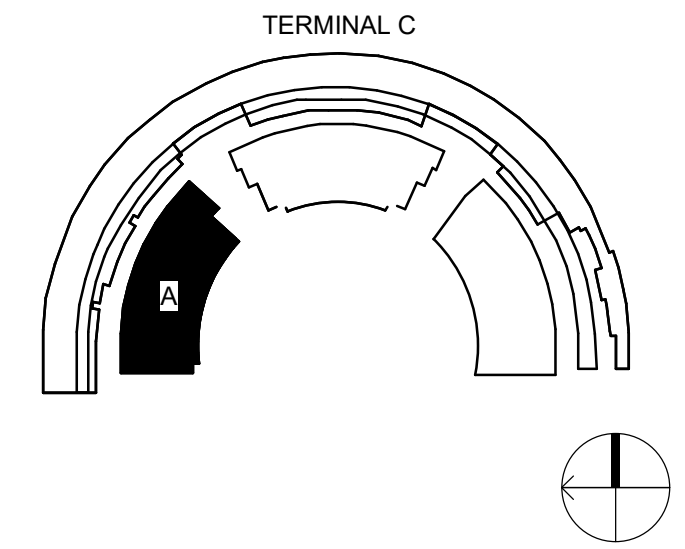

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

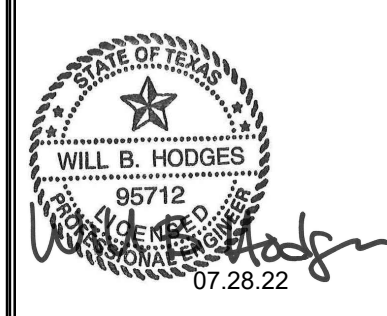

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7009

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

Hodgson, Clark & Koenigsmann, Inc.
777 North Harvard Street
Suite 200, LB #
Dallas, TX 75201
1-214-728-6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

Garage A


GARAGE A HVAC DEMOLITION PLAN - LEVEL B - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
M-102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

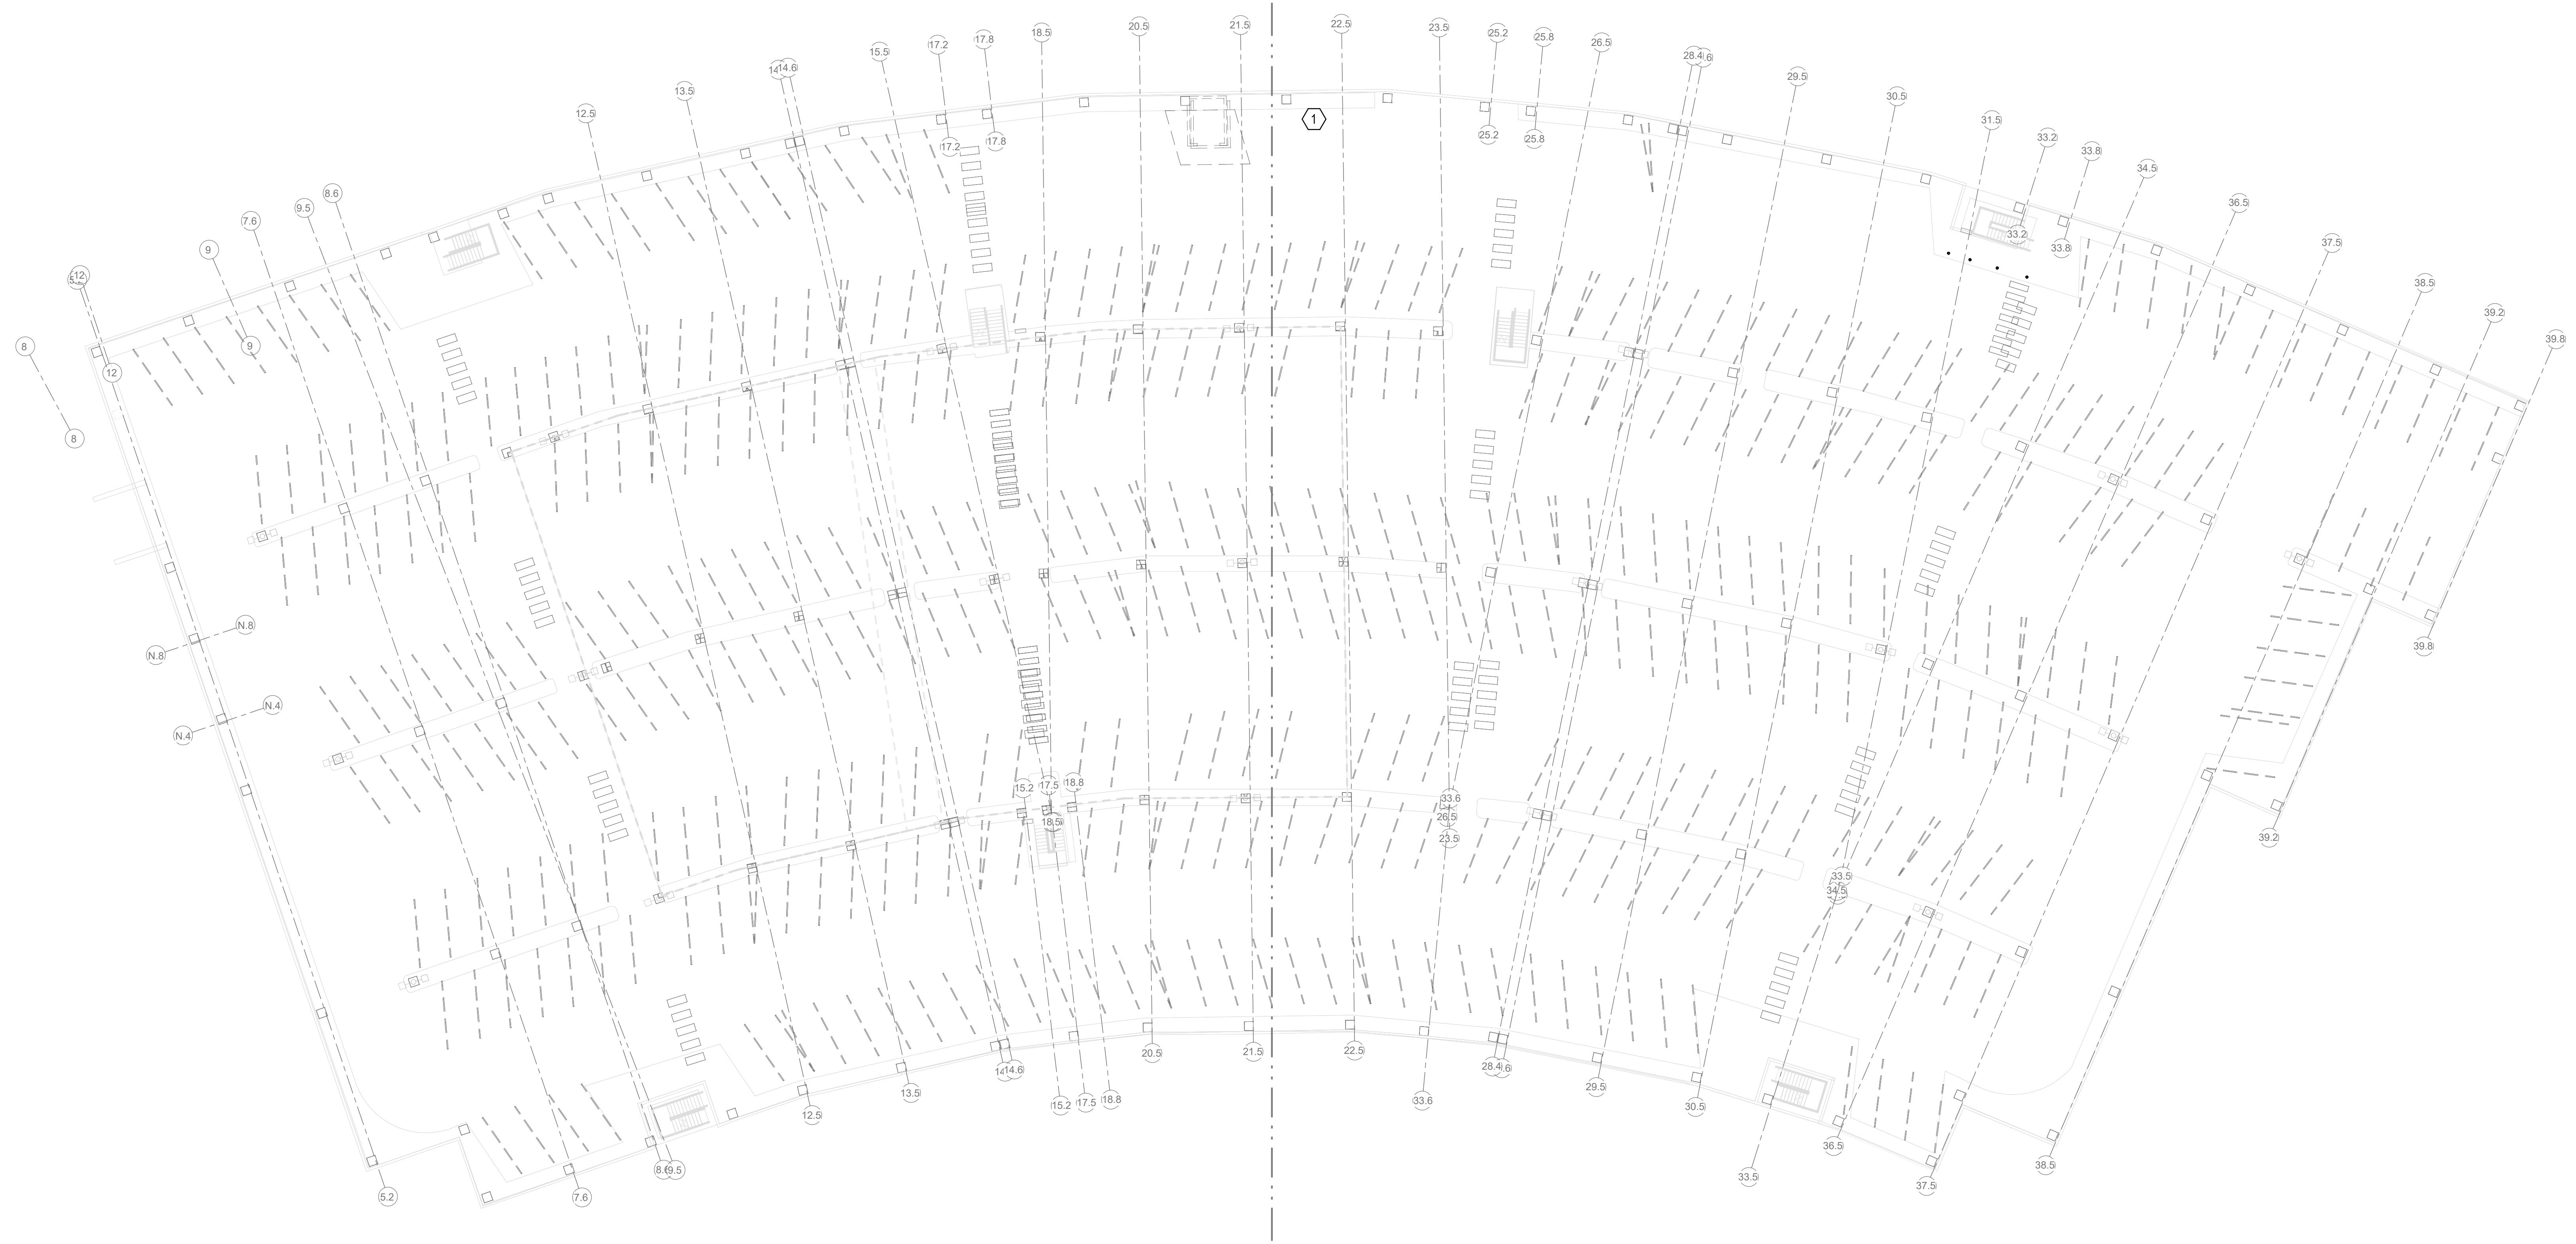


SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. DEMOLISH ALL MECHANICAL EQUIPMENT AND ACCESSORIES IN THIS EXISTING ELECTRICAL ROOM TO BE DEMOLISHED.

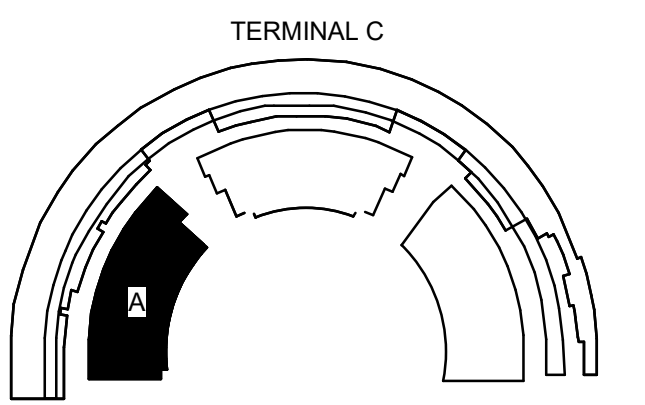

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

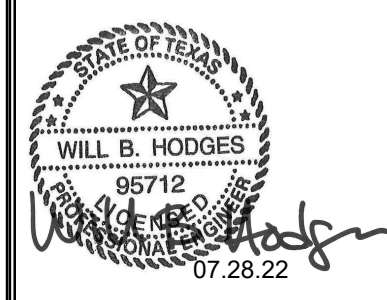

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7009

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

Helmuth, Obata & Kassabaum, Inc.
717 North Harwood Street
Suite 2000, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION

Garage A


GARAGE A HVAC DEMOLITION PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
M-104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

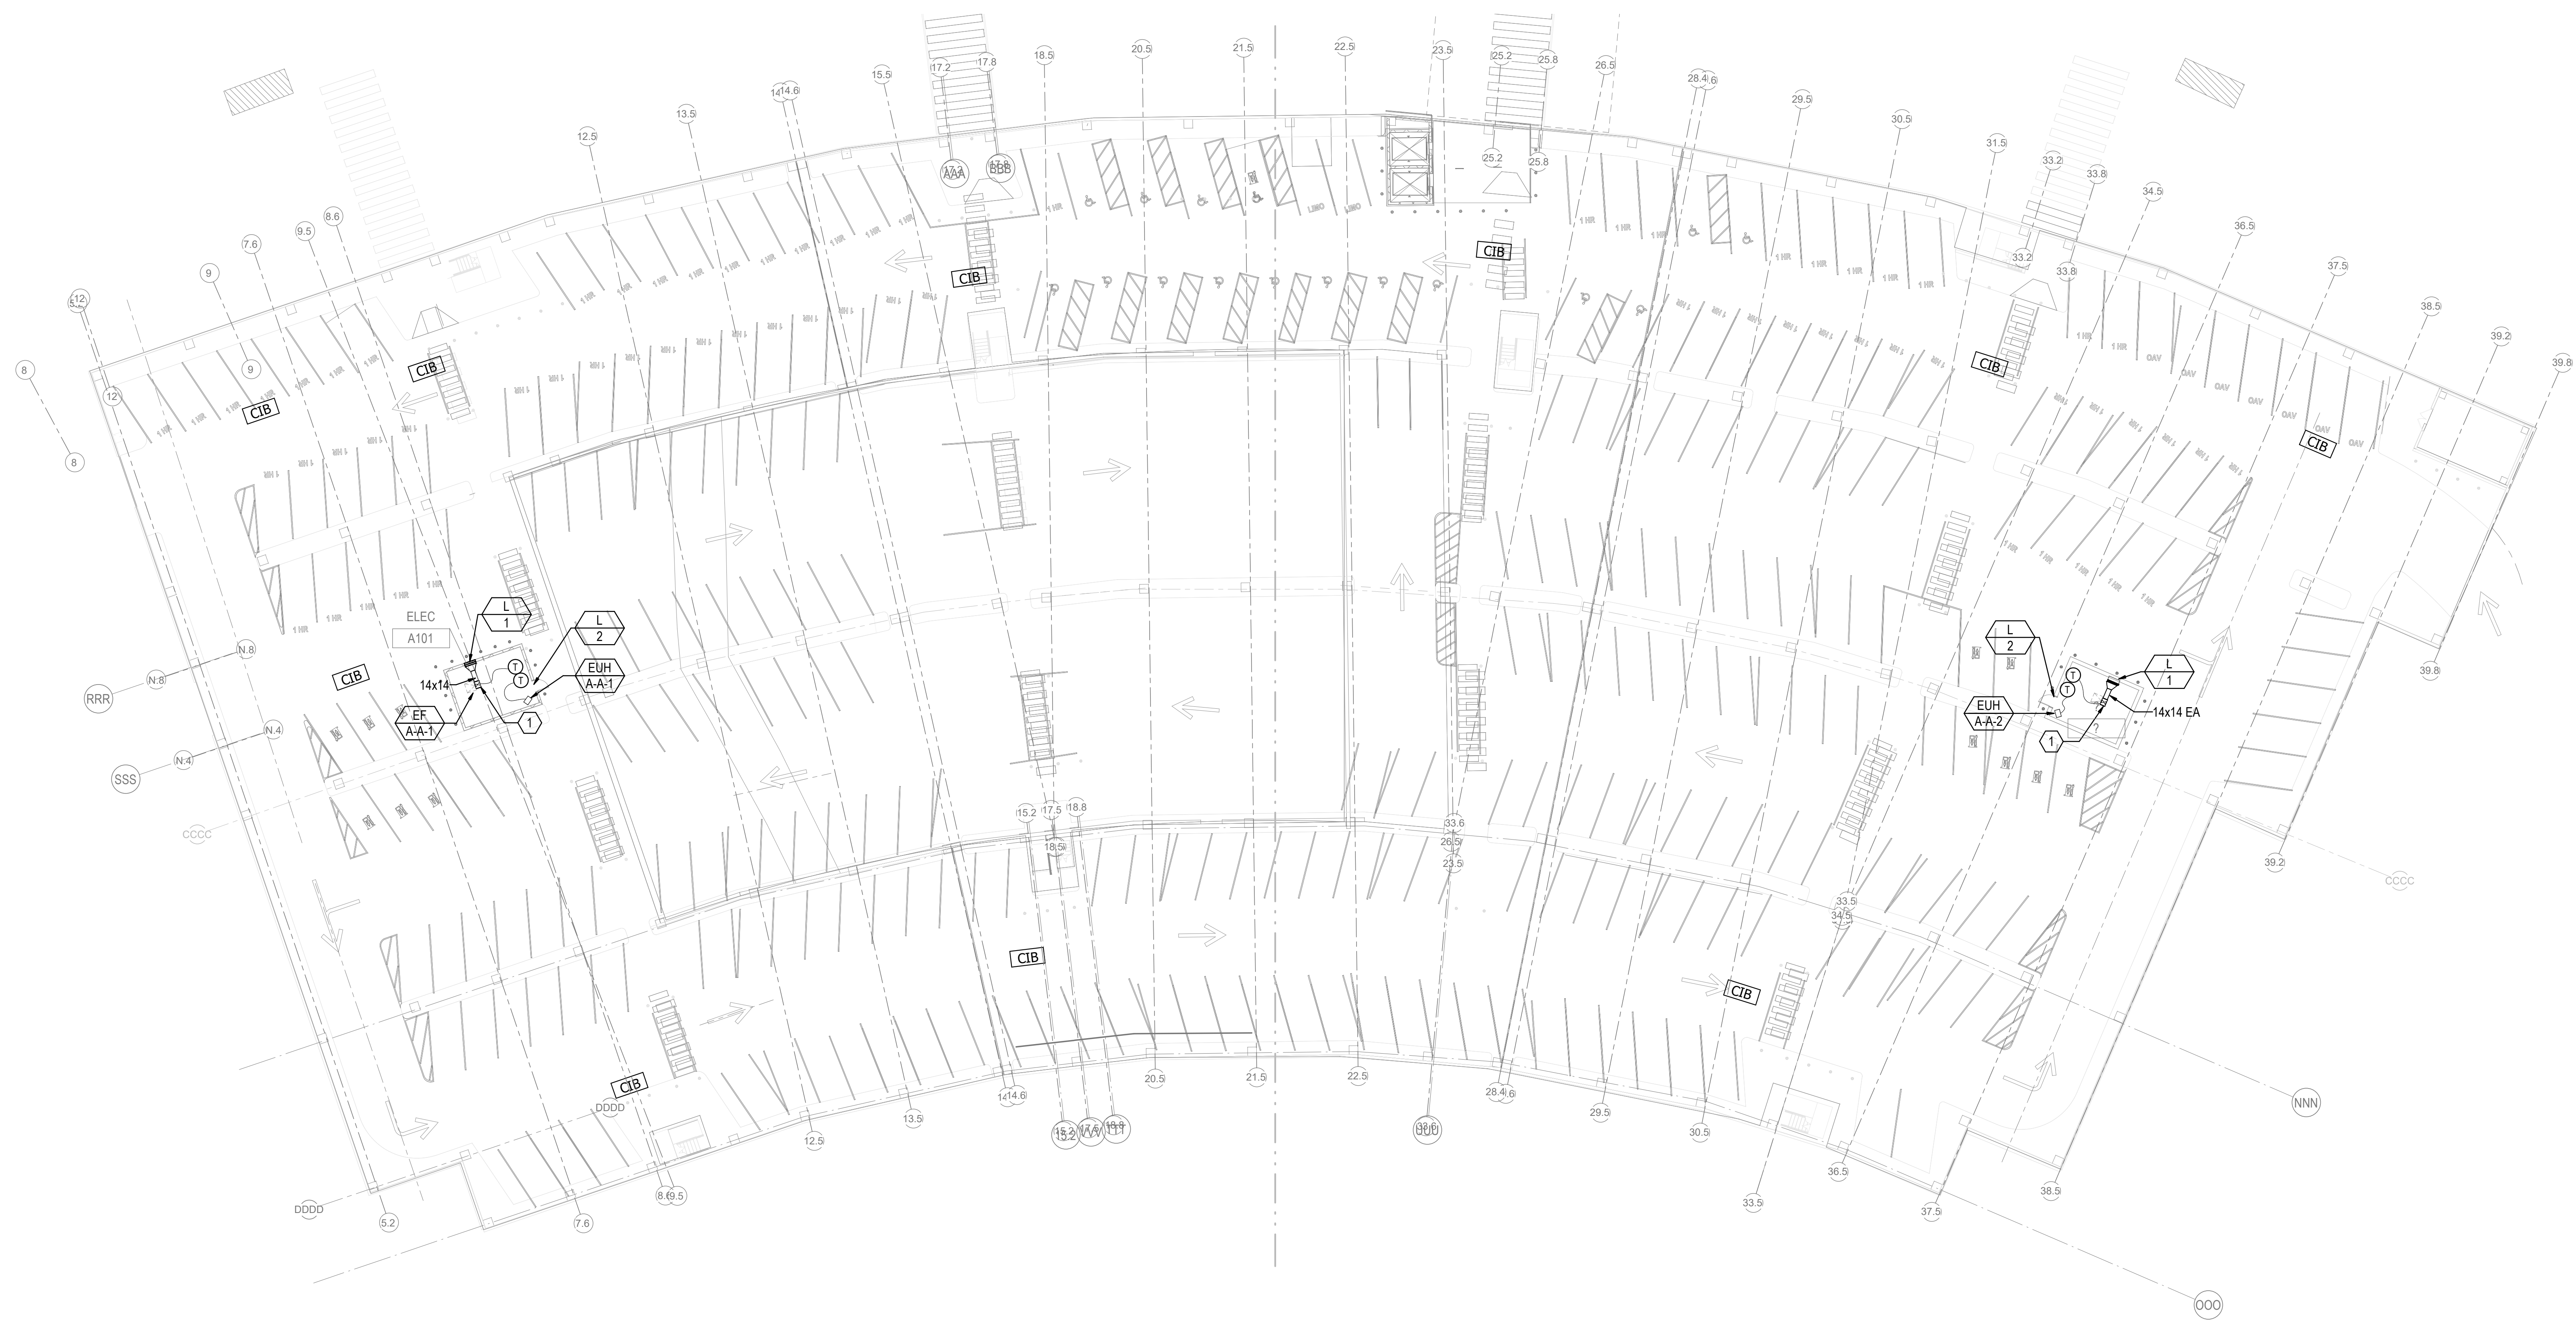


SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. UPON SPACE TEMPERATURE RISING ABOVE 92F (ADJ) FOR 10 MINUTES (ADJ) EF SHALL ENERGIZE AND AN ALARM AT THE BMS SHALL BE GENERATED.

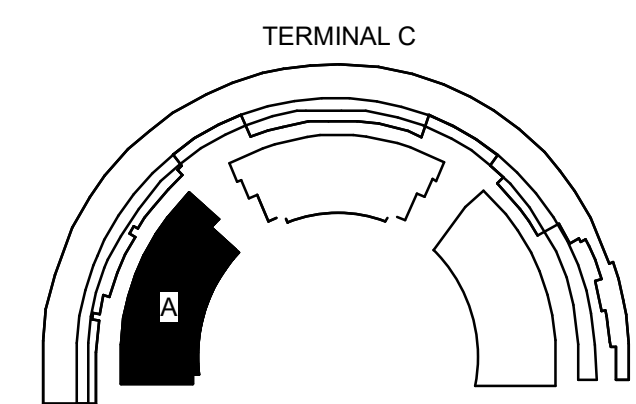

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

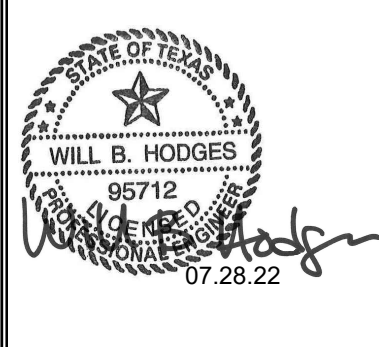

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue, Suite 415, Dallas, TX 75206
Tel: 972.470.0704, www.syska.com
Hodges, Class & Rosenbaum, Inc. 717 North Harvard Street, Suite 200, LB # Dallas, TX 75201, 4124 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-07-28	75% DESIGN	
2022-09-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


PROJECT NUMBER: TFD-007

Garage A
GARAGE A HVAC PLAN - LEVEL A - PHASE 3

PERMIT NUMBER: 822-0022

SHEET NUMBER
M-201-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

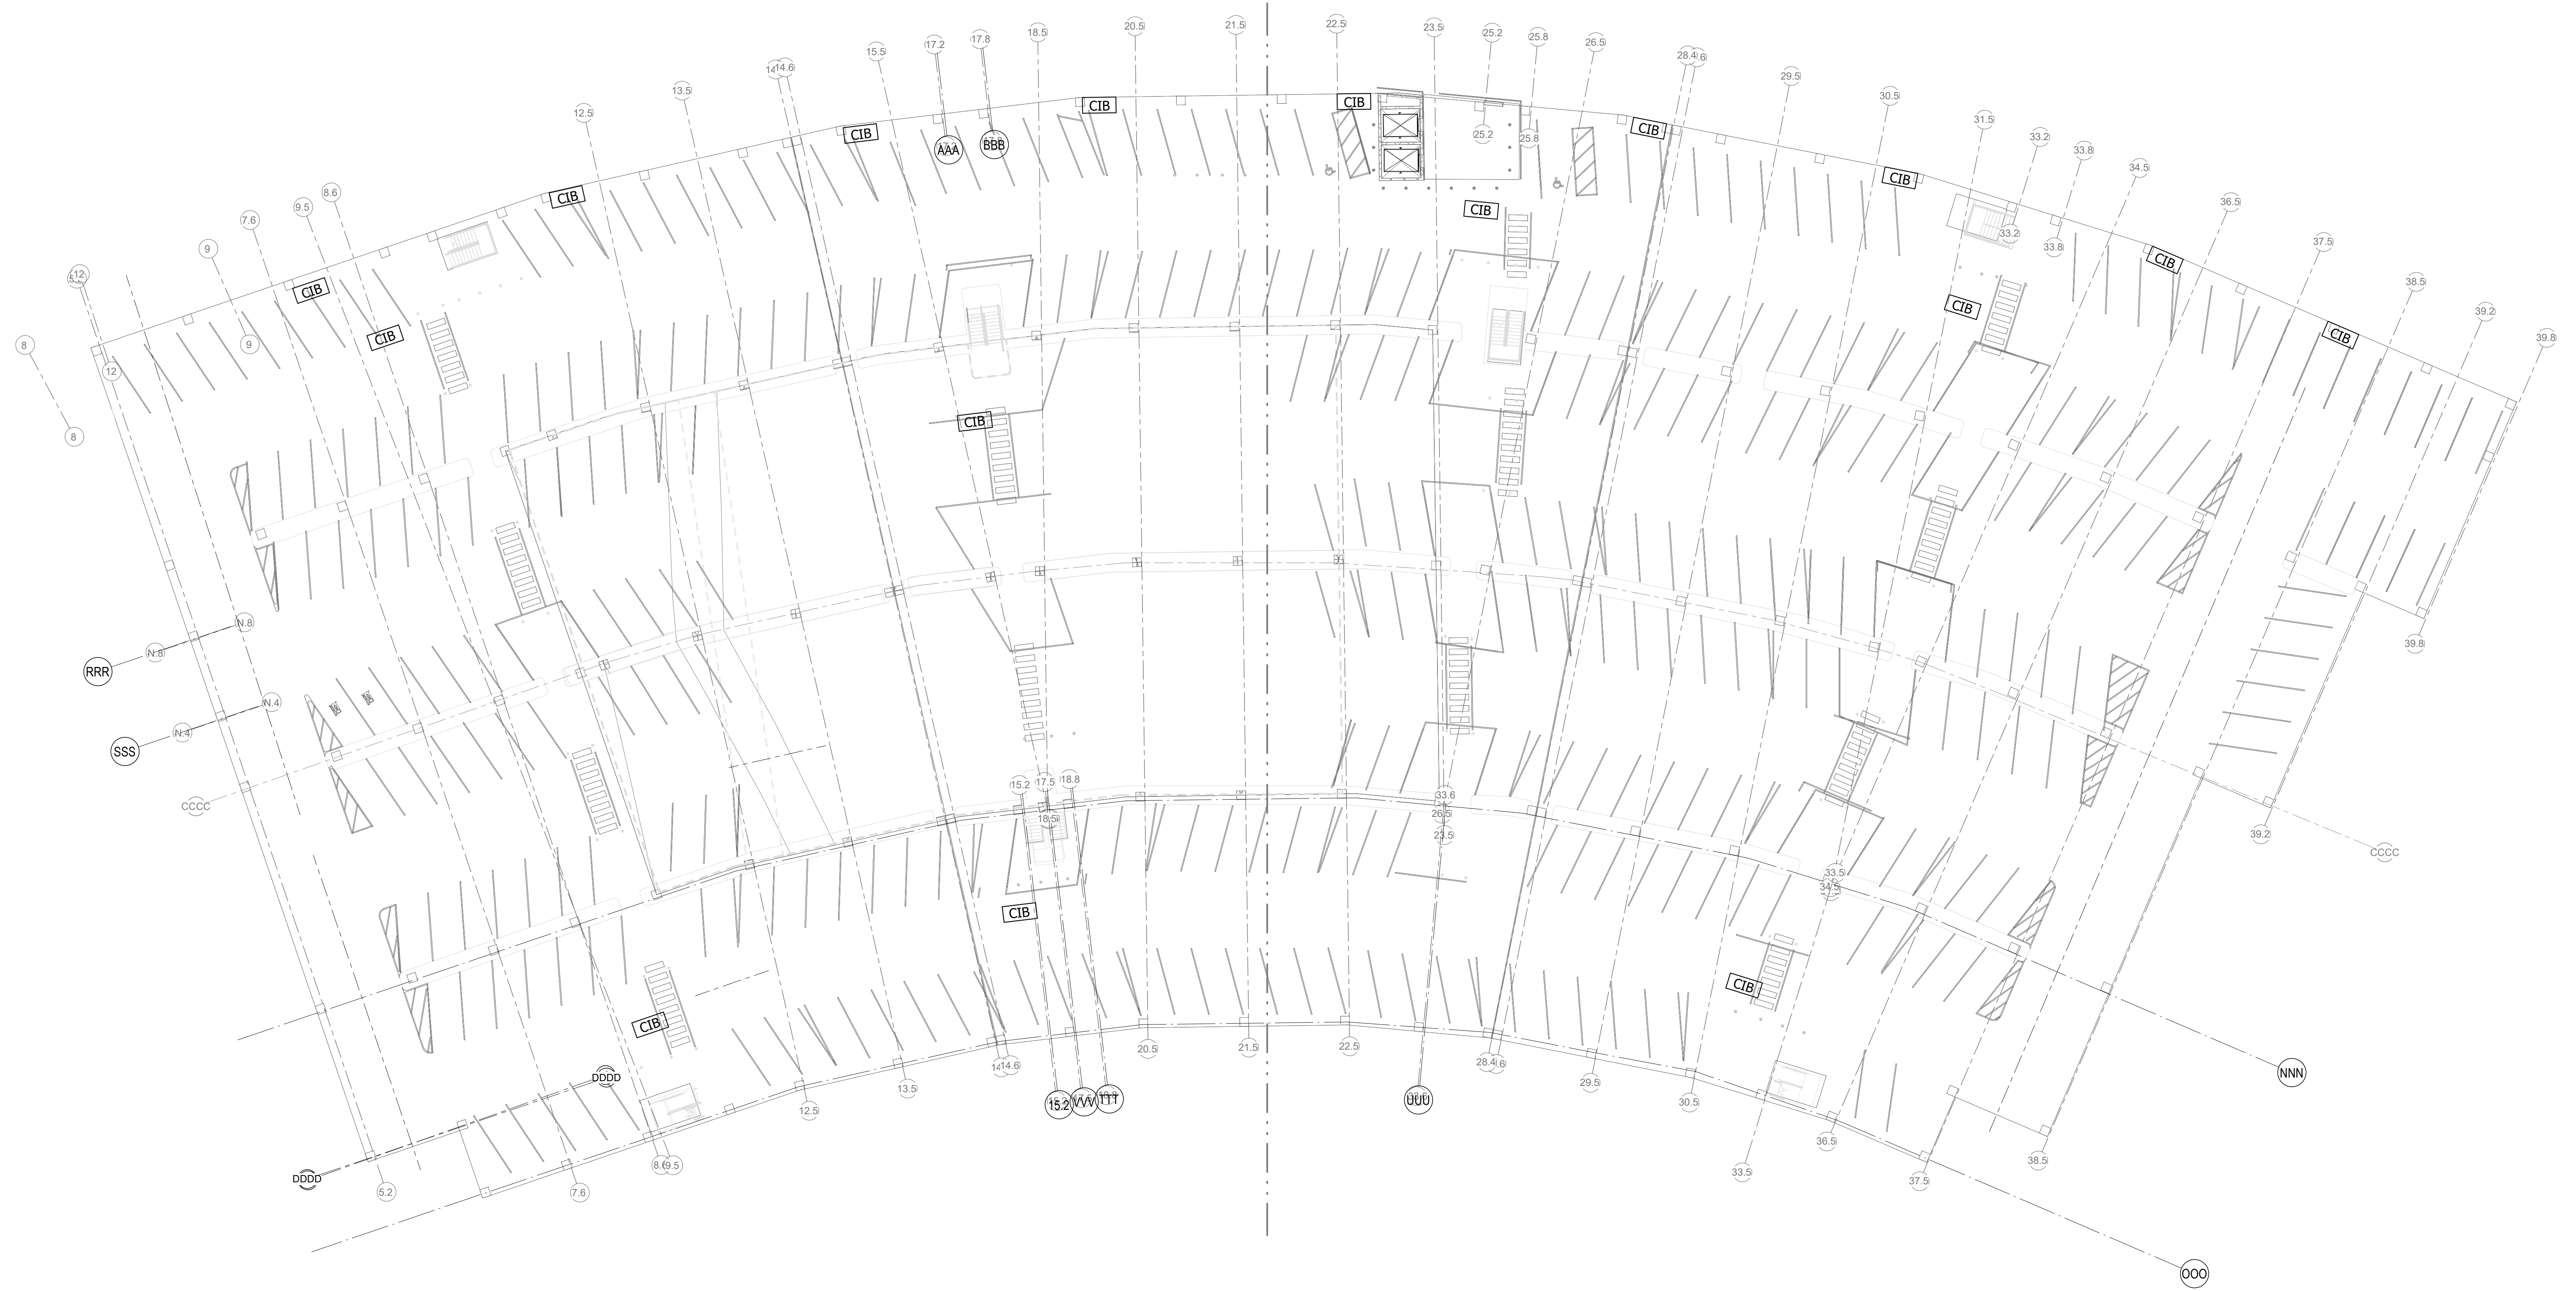

SHEET NOTES


1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.

SHEET KEYNOTES

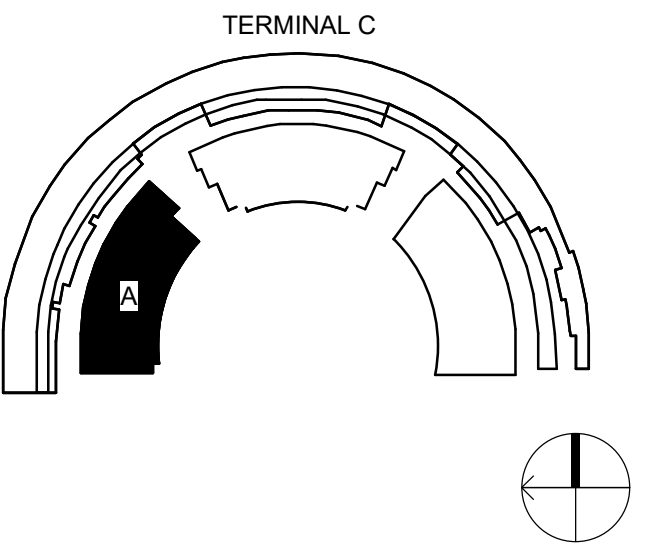

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

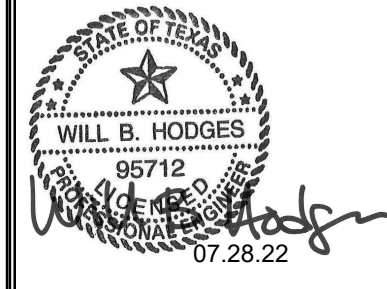

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
Heinrich, Clark & Koenigsmann, Inc.
717 North Harvard Street
Dallas, TX 75201
41214 728 6000

4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7069

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A HVAC PLAN - LEVEL B - PHASE 3

PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
M-202-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

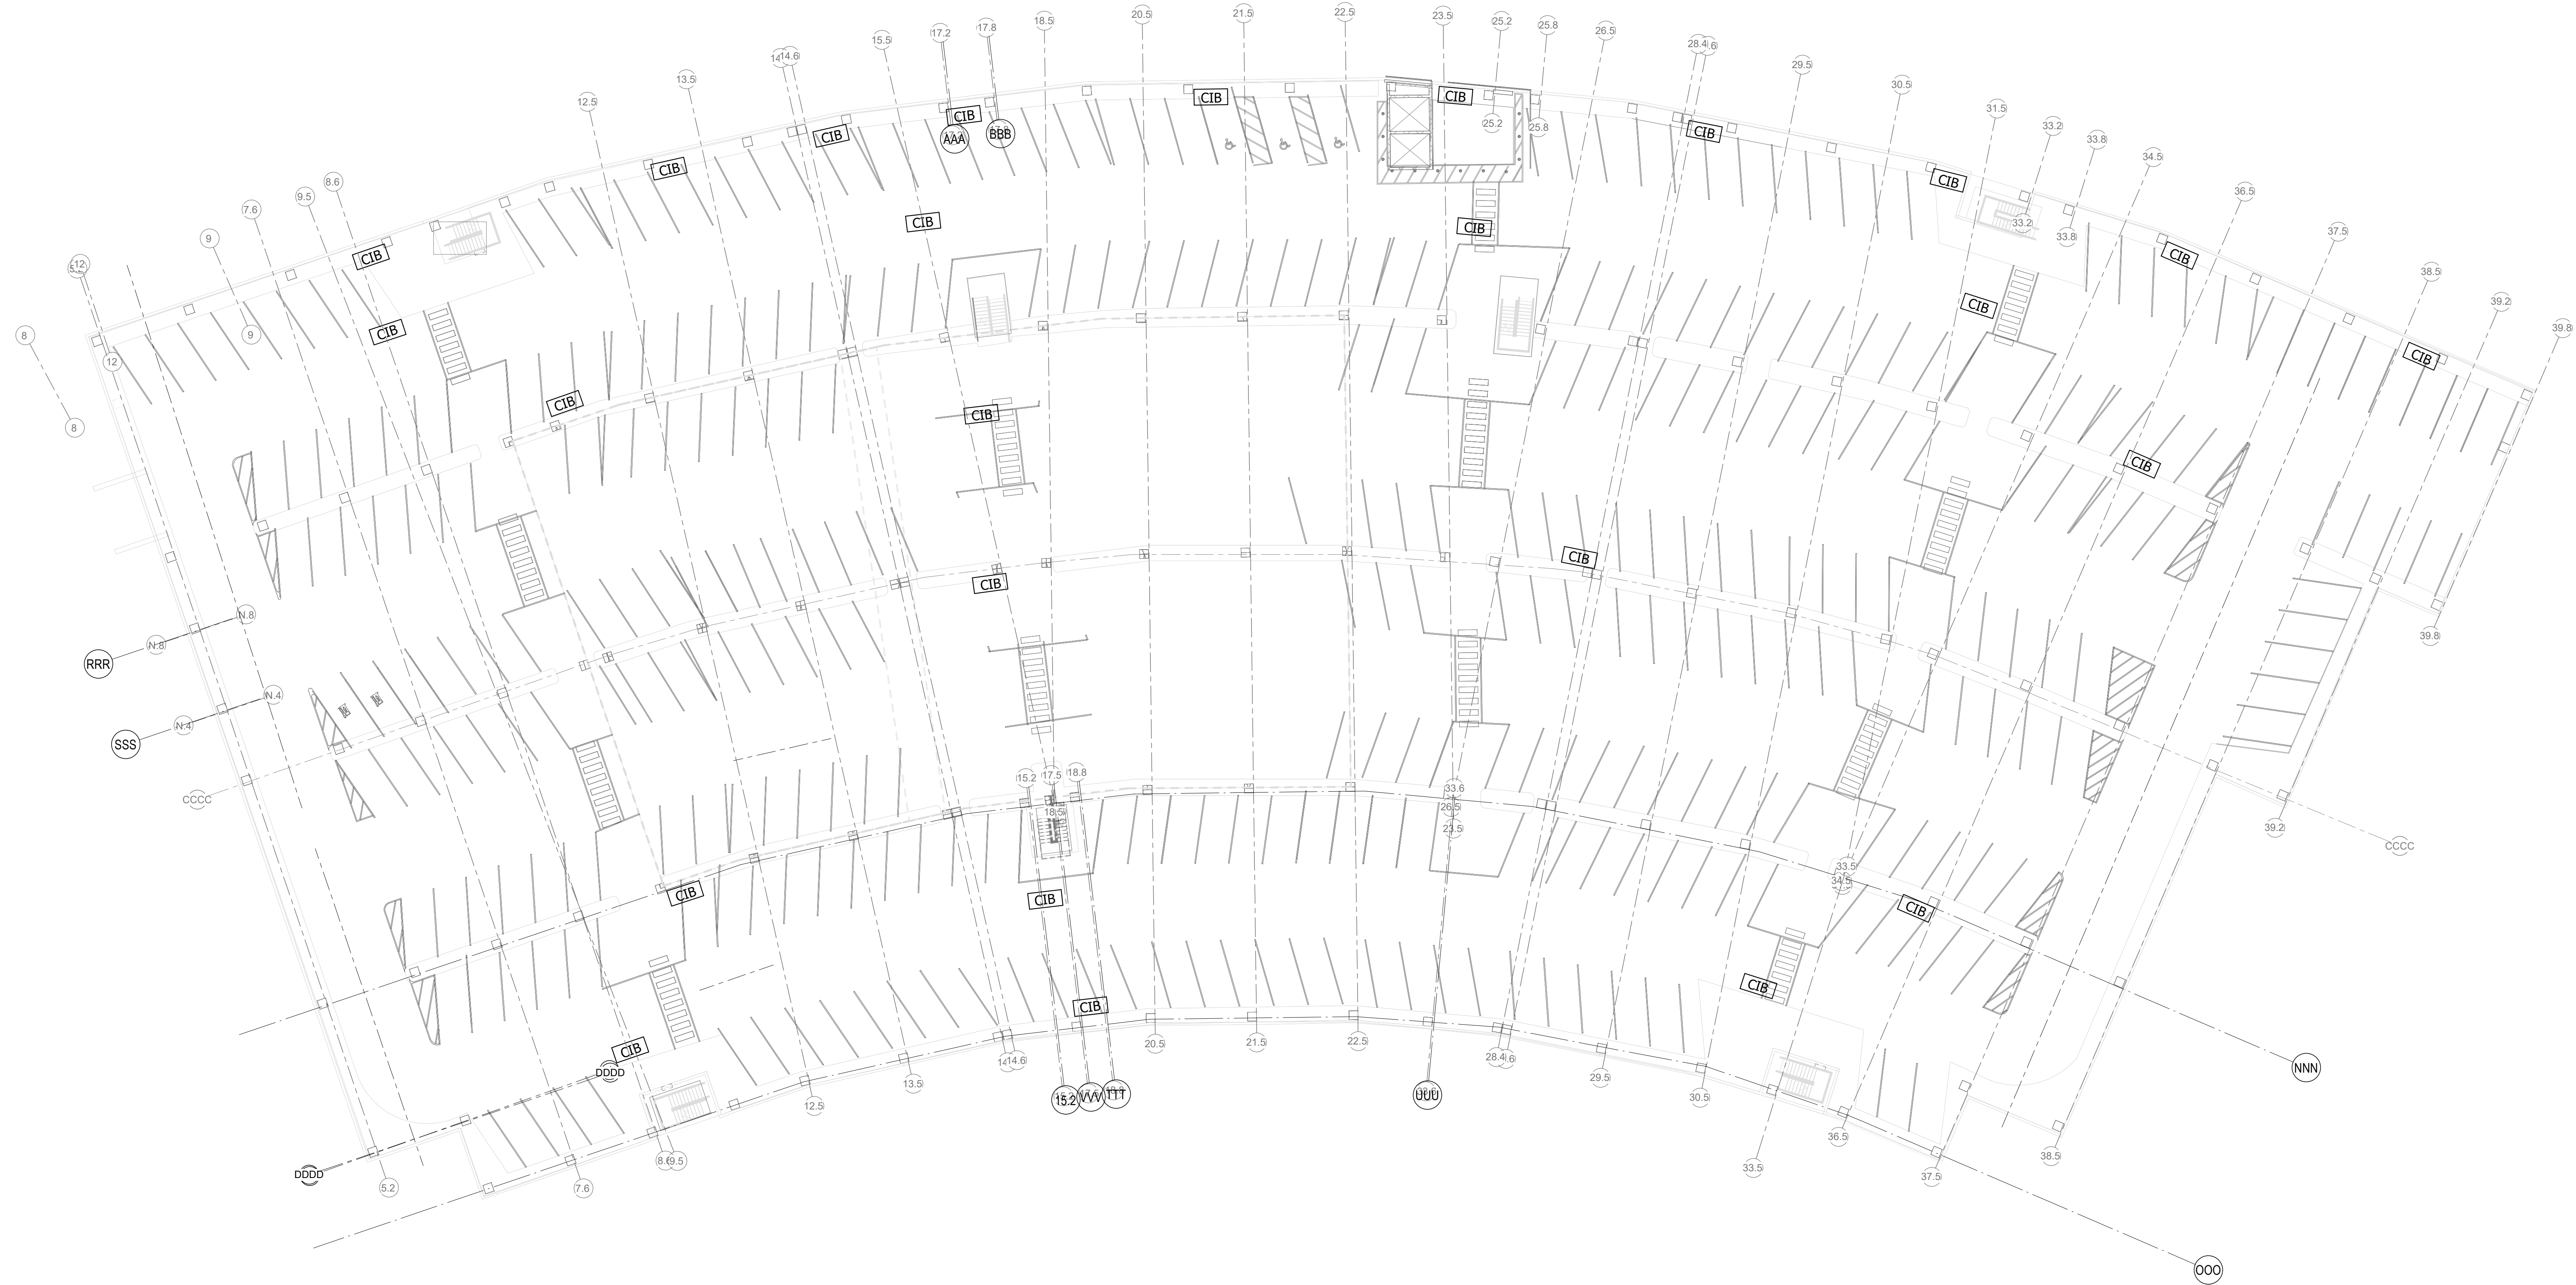


SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. ROUTE 1" CONDENSATE TO FLOOR DRAIN LOCATED OUTSIDE ELEC / IT ROOM (NEAR CONDENSING UNIT) AND TERMINATE WITH AIR GAP. REFER TO PLUMBING DRAWINGS.

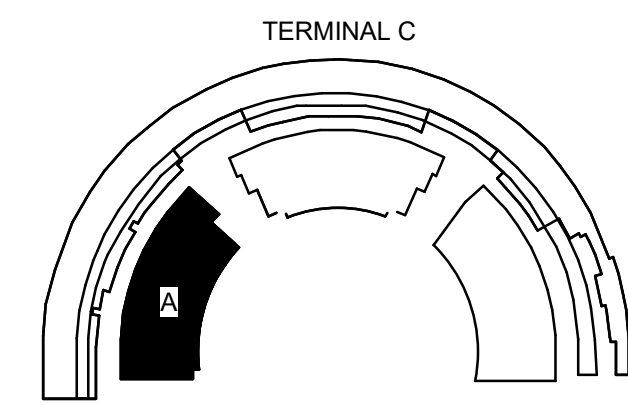

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

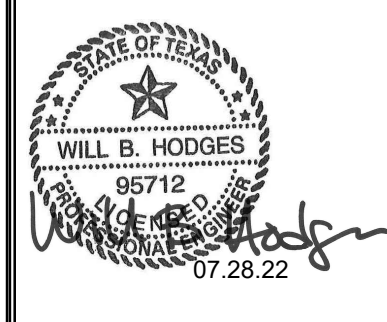

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue, Suite 415, Dallas, TX 75206
Tel: 972-470-0704, www.syska.com
Heidrich, Claus & Koenigsmann, Inc. 717 North Harvard Street, Suite 200, LB # Dallas, TX 75201, 1-214-728-6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

Garage A
GARAGE A HVAC PLAN - LEVEL D - PHASE 3
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
M-204-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




SHEET NOTES

1. REFER TO SHEET M-001 FOR MECHANICAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS.


SHEET KEYNOTES

1. ROUTE 1" CONDENSATE TO FLOOR DRAIN LOCATED OUTSIDE ELEVATOR MACHINE ROOM AND TERMINATE WITH AIR GAP. REFER TO PLUMBING DRAWINGS.
2. ROOFTOP UNIT OUTDOOR CONDENSATE DRAIN PIPING SHALL BE PVC SCHEDULE 80 AND INSULATED WITH 1" ARMAFLEX INSULATION MODEL ARMACELL WITH WB COATINGS. CONTRACTOR TO PROVIDE SUPPORTS FOR CONDENSATION PIPE. ROUTE 1" CONDENSATE PVC PIPING FROM RTU'S AND TRANSITION INTO 1-1/2" CONDENSATE PVC. ROUTE PIPING TO FLOOR DRAIN LOCATED OUTSIDE MACHINE ROOM AND TERMINATE WITH APPROVED AIR GAP. CONTRACTOR TO PROVIDE A WATER LEVEL SENSING DEVICE (FLOAT SWITCH) TO SHUT OFF UNIT IN THE EVENT THAT THE PRIMARY DRAIN BECOMES RESTRICTED.
3. PROVIDE NEW REFRIGERANT PIPING WITH ASSOCIATED VALVES, HANGERS AND SUPPORTS. ROUTE REFRIGERANT LINES TO CONDENSING UNIT ON ROOF. INSTALL PER MANUFACTURER'S REQUIREMENTS AND REFRIGERANT LINE LENGTHS LIMITS. PROVIDE NEW WALL MOUNTED INDOOR AC UNIT WITH ASSOCIATED OUTDOOR CONDENSING UNIT, CONTROLS, POWER, ACCESSORIES, HANGERS AND SUPPORTS. COORDINATE WITH ELECTRICAL DRAWINGS.

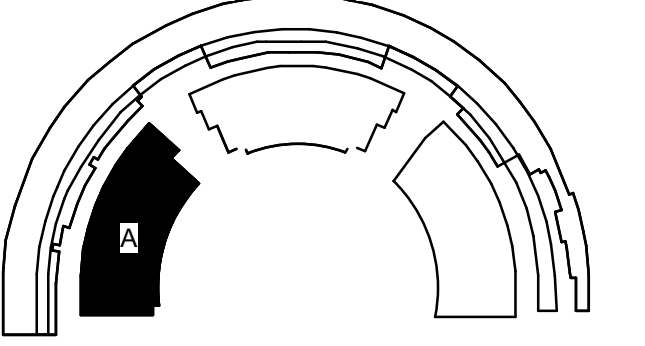

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

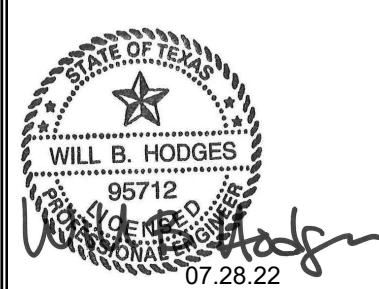

h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
FIRM REGISTRATION NUMBER F-7069
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)



Garage A

GARAGE A HVAC PLAN - LEVEL E - PHASE 3


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022


SHEET NUMBER
M-205-900A

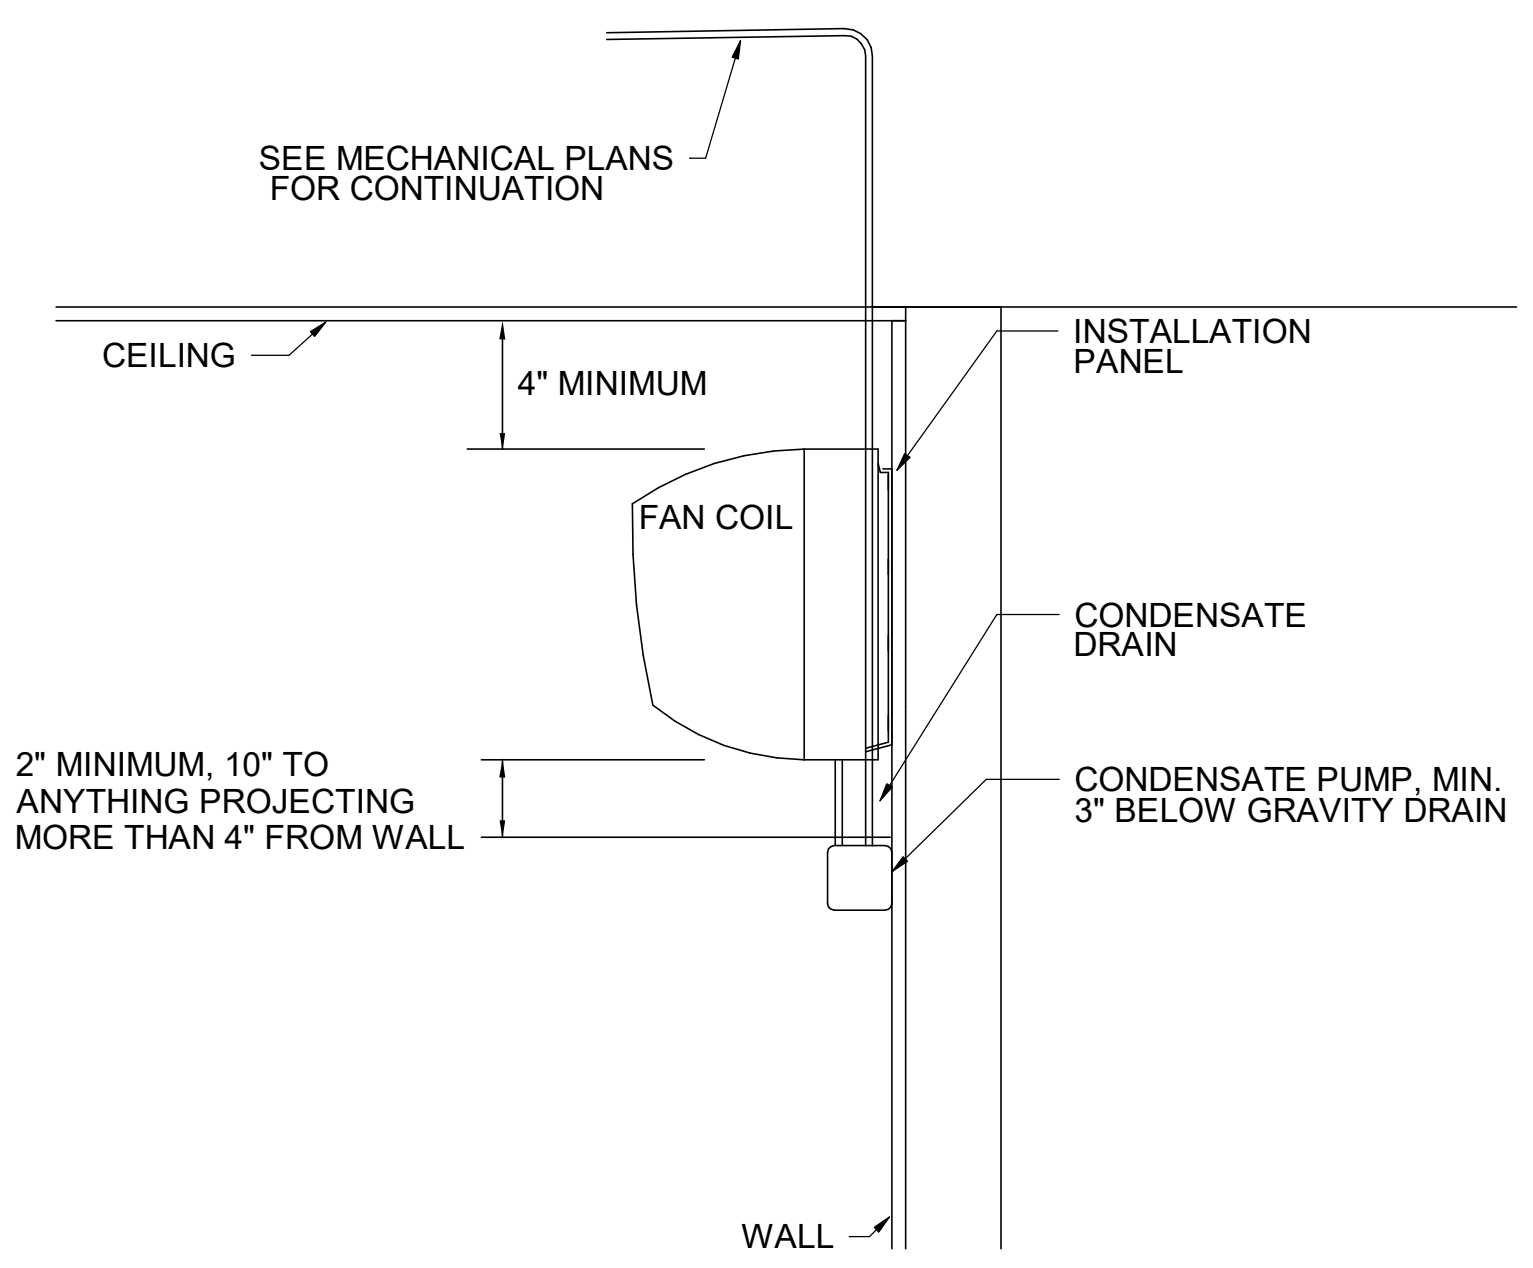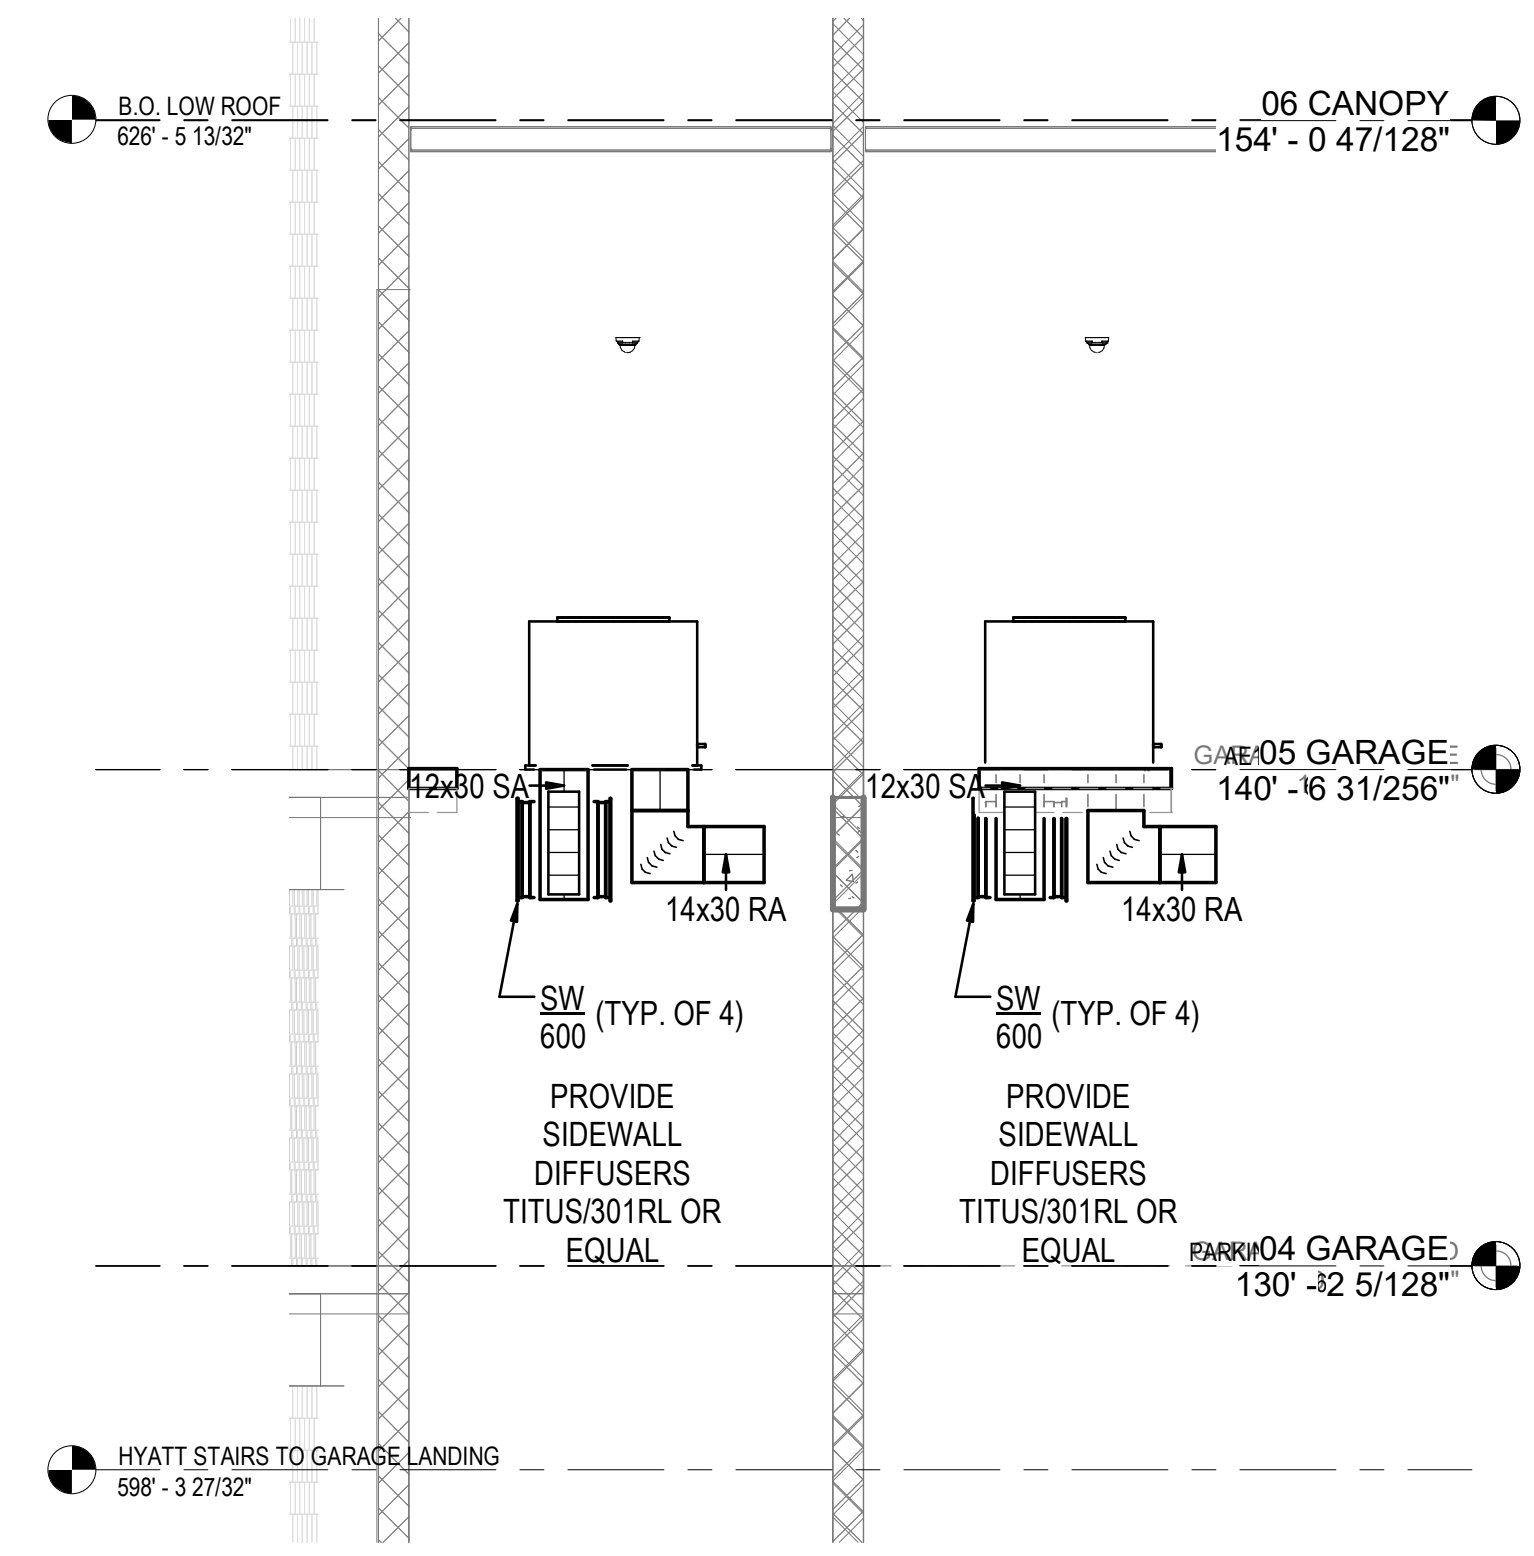


3 MINI-SPLIT DETAIL
SCALE: NONE

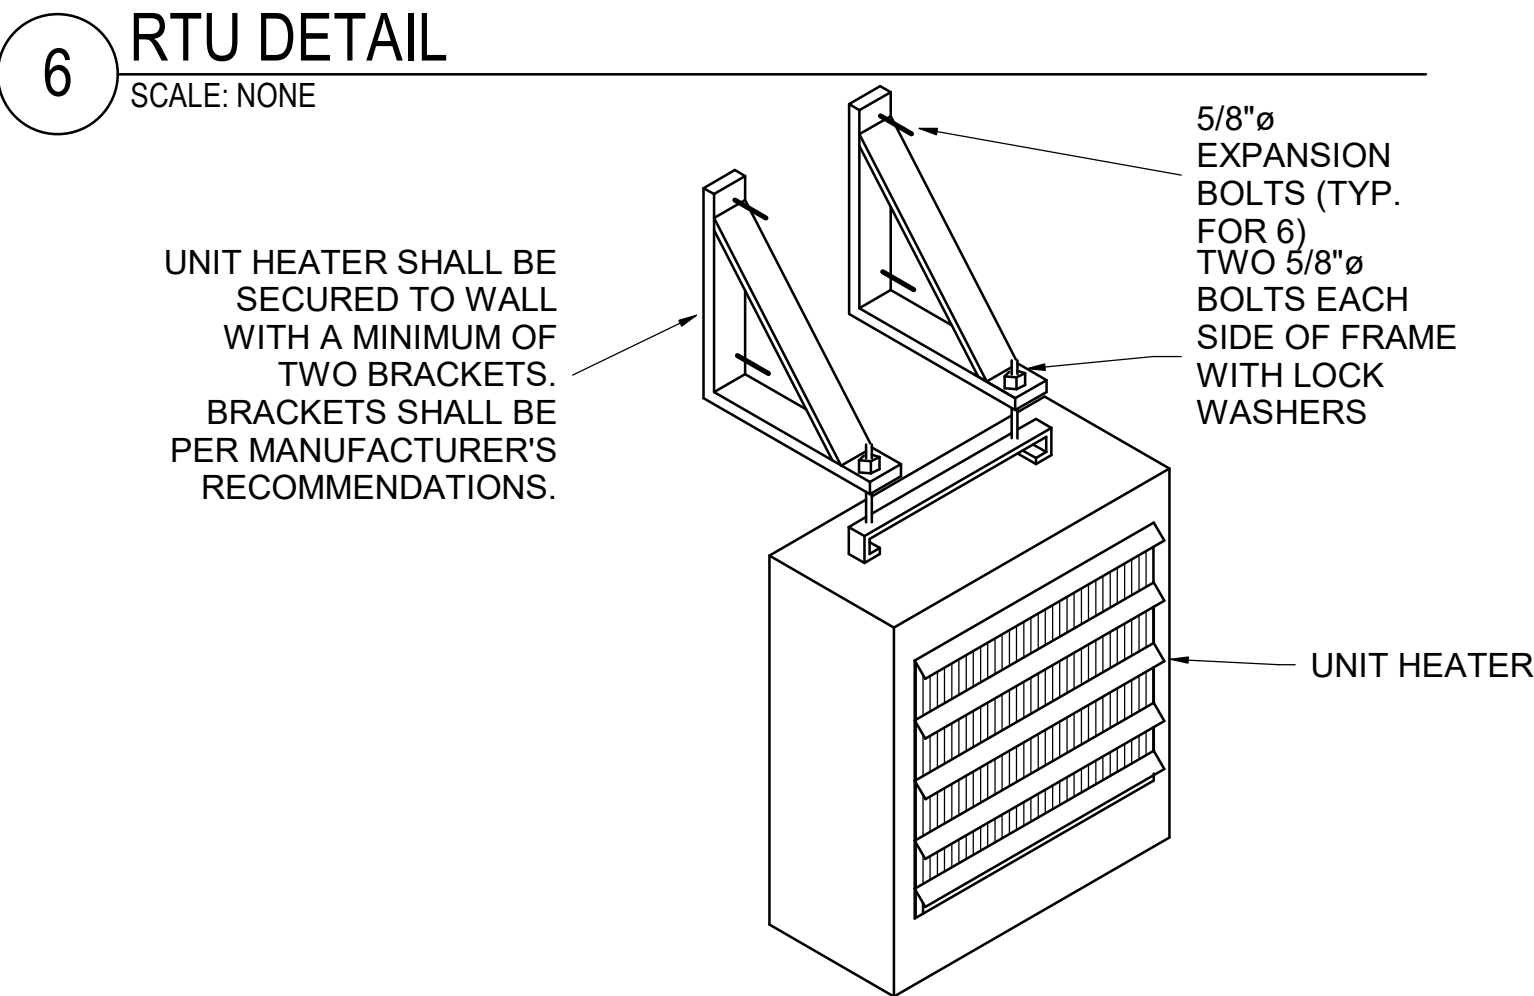


6 RTU DETAIL
SCALE: NONE

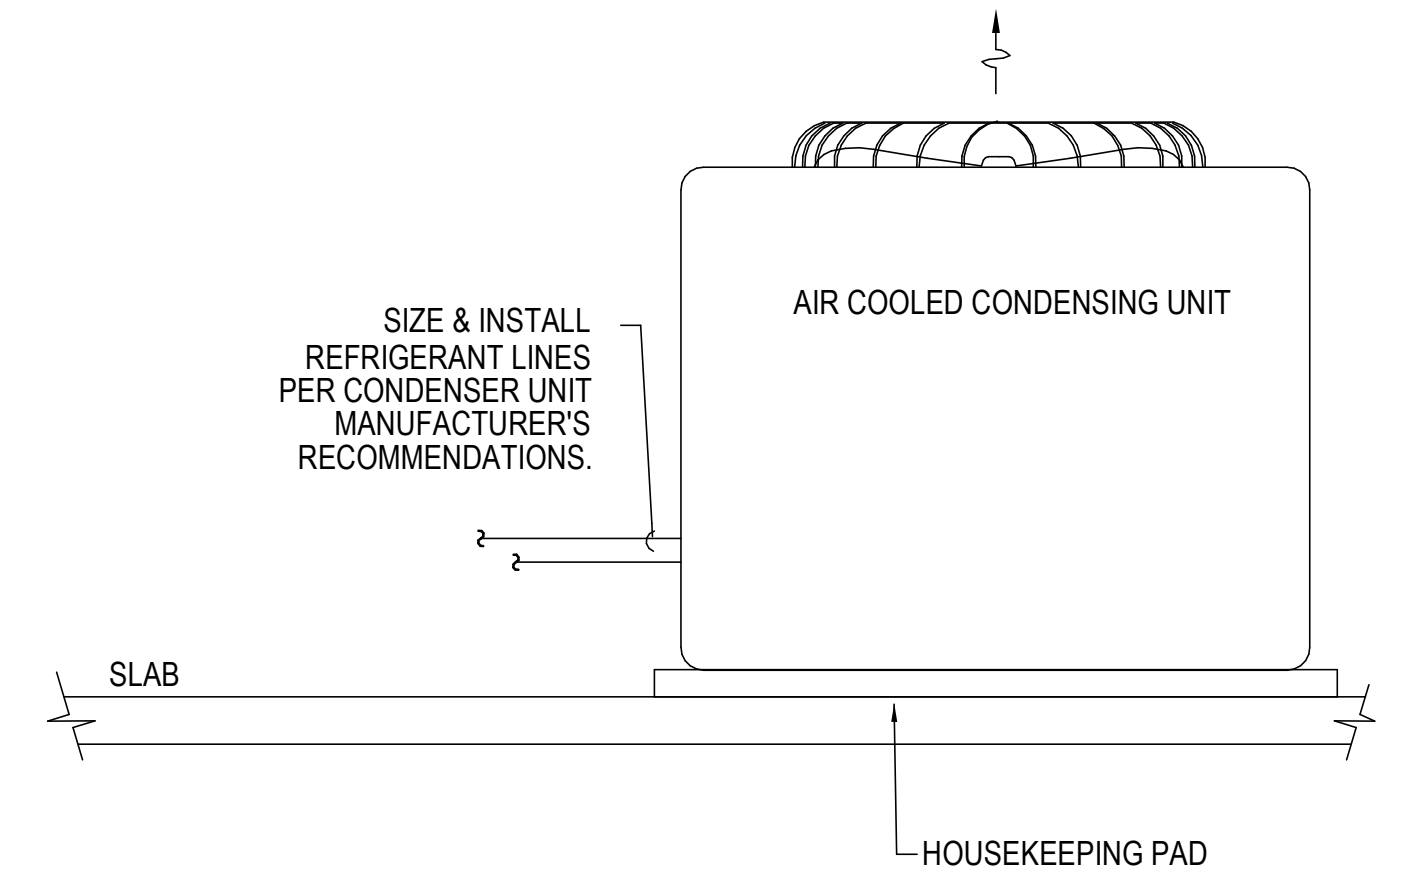

2 CONDENSING UNIT DETAIL
SCALE: NONE

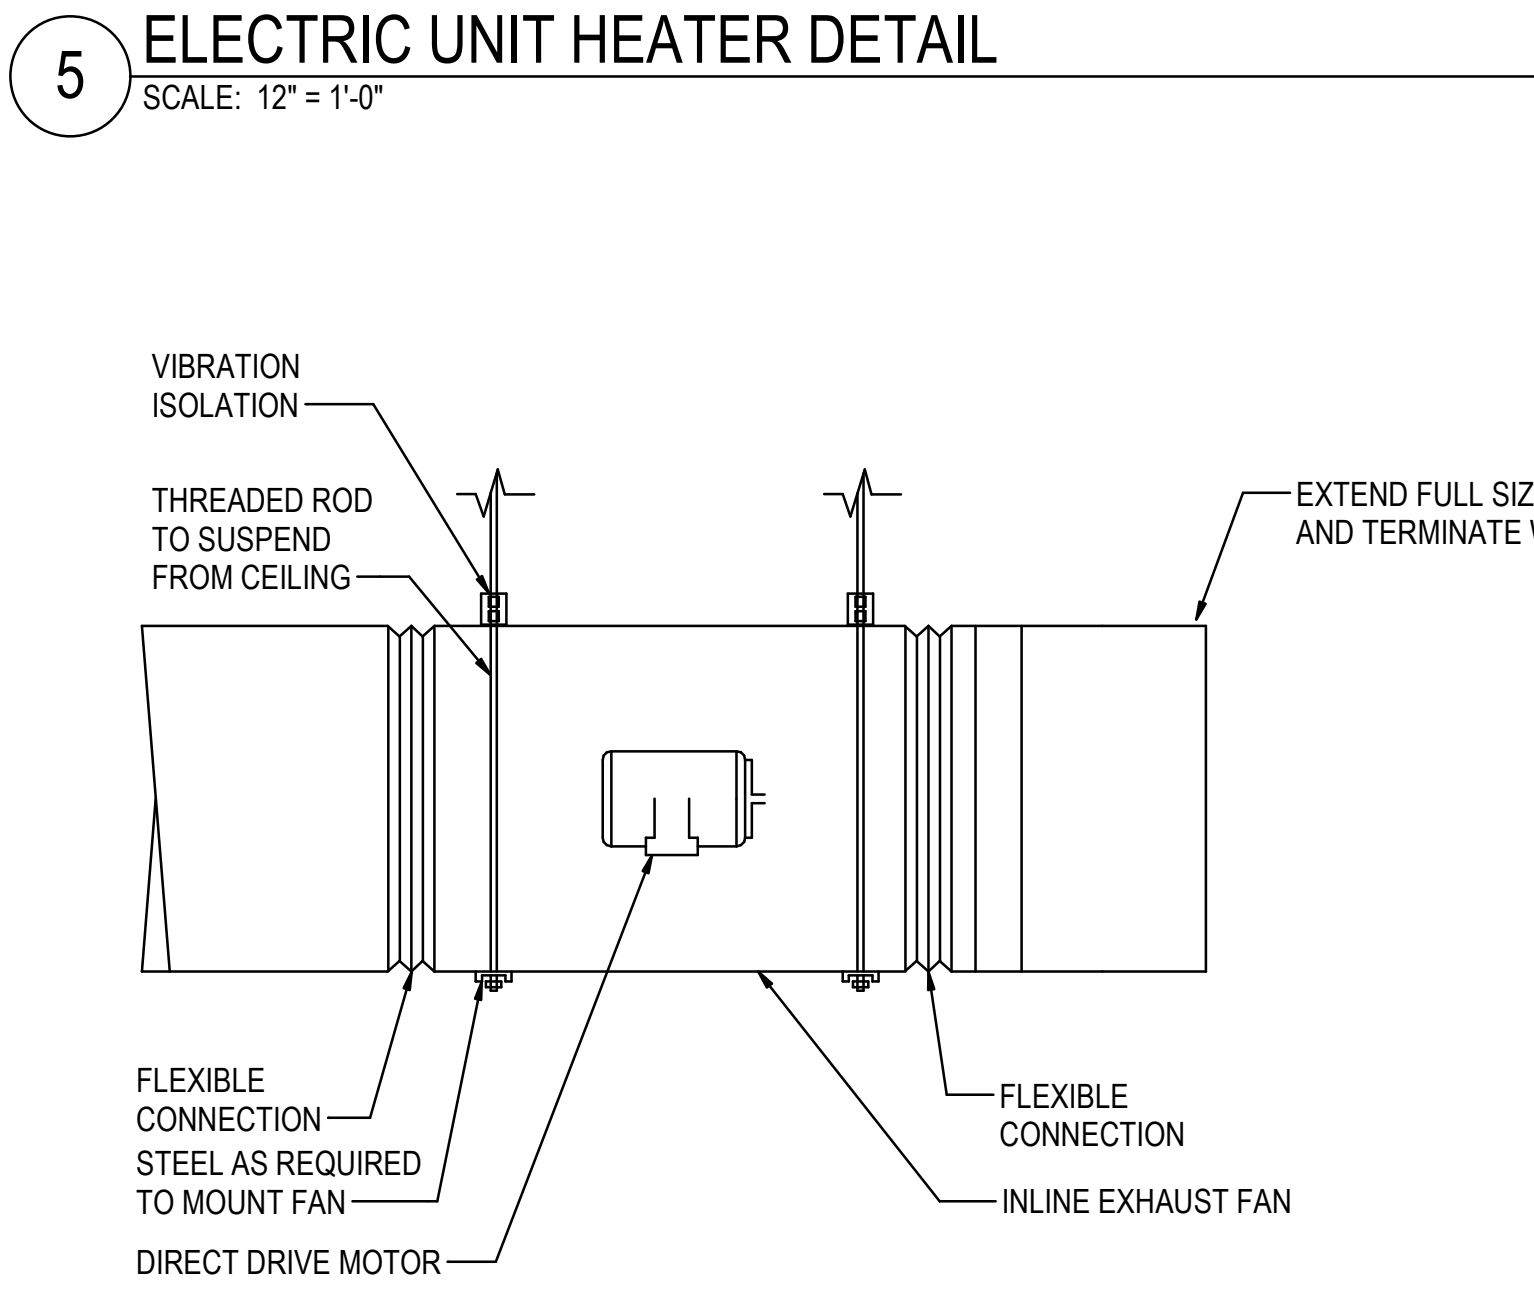

4 IN-LINE EXHAUST FAN
SCALE: NONE

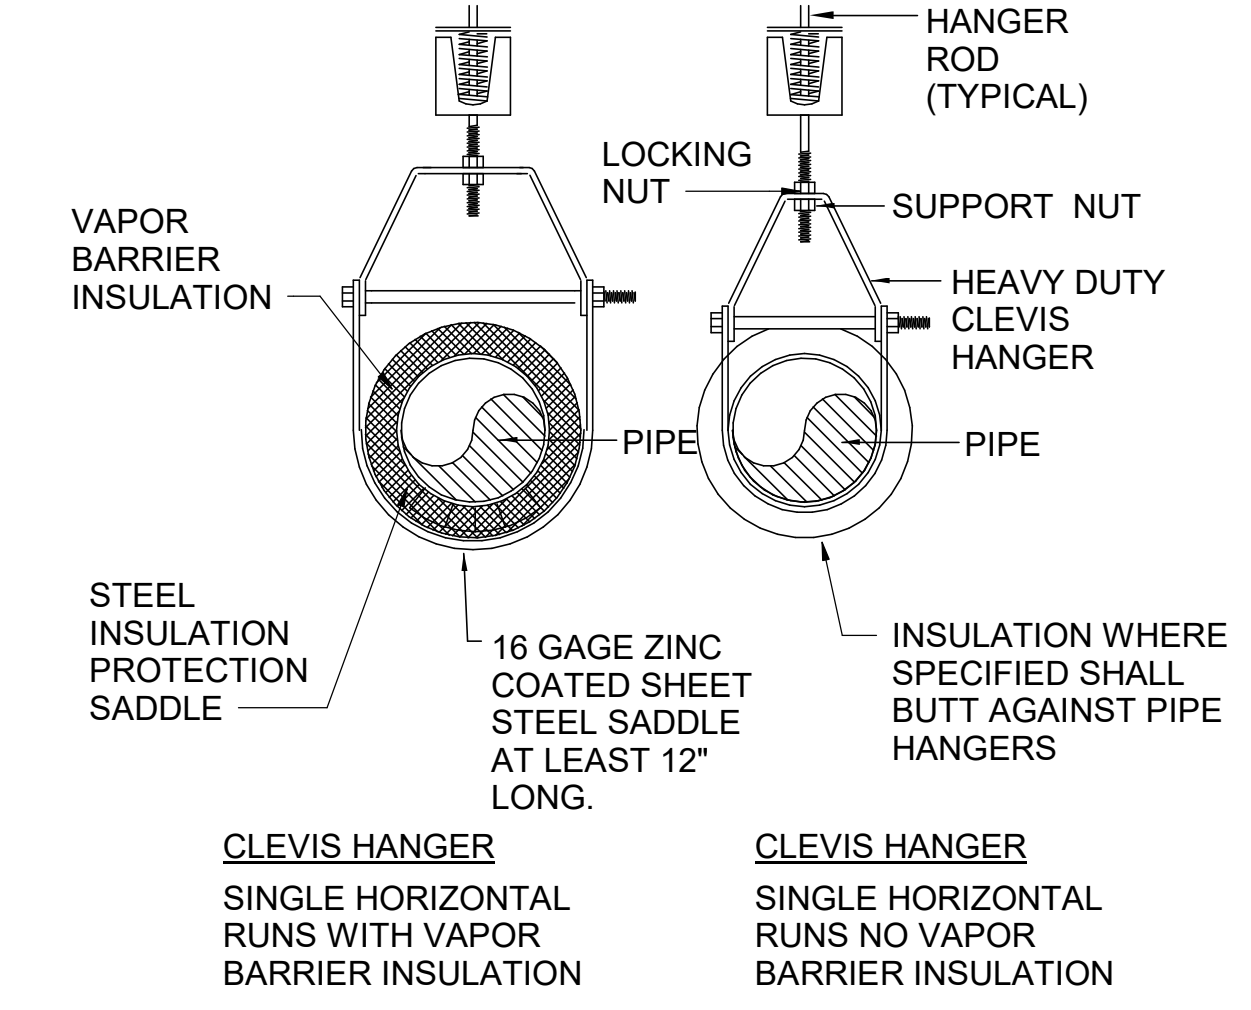

1 PIPE SUPPORTS DETAIL
SCALE: NONE

5 ELECTRIC UNIT HEATER DETAIL
SCALE: 1/2" = 1'-0"

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

ABBREVIATIONS

-A-	ADDITIONAL	EXT	EXTERNAL
ADDL	ADDITIONAL	-F-	FAHRENHEIT, FIRE SERVICE, FEMALE
AFF	ABOVE FINISHED FLOOR	FA	FIRE ALARM, FACE, FREE AREA
AIC	AMPERE INTERRUPTING CAPACITY	FAAP	FIRE ALARM ANNUNCIATOR PANEL
AMP	AMPERE	FACP	FIRE ALARM CONTROL PANEL
ANN	ANNUNCIATOR	FC	FOOTCANDLE
APPD	APPROVED	FCA	FAULT CURRENT AVAILABLE, FLOOR CONTROL VALVE ASSEMBLY
APX	APPENDIX	FDR	FEEDER
ARCH	ARCHITECT	FL / FLR	FLOOR
ATCH	ATTACHMENT	FLEX	FLEXIBLE
ATS	AUTOMATIC TRANSFER SWITCH	FLUOR	FLUORESCENT
AUTO	AUTOMATIC	FR	FIRE RATING, FLOOR RECEPTACLE
AUX	AUXILIARY	FREQ	FREQUENCY
AV	AUDIO VISUAL, ALARM VALVE	FT	FOOT, FEET
AVG	AVERAGE	FU	FUSE
AWG	AMERICAN WIRE GAUGE	FU SW	FUSED SWITCH
-B-		FUT	FUTURE
BAS	BUILDING AUTOMATION SYSTEM	-G-	
BAT	BATTERY	G	GROUND, GAS, GREEN
BFF	BELOW FINISH FLOOR	GC	GENERAL CONTRACTOR
BKGD	BACKGROUND	GEN	GENERATOR
BLDG	BUILDING	GFCI	GROUND FAULT CIRCUIT INTERRUPTER
BLW	BELOW / UNDERGROUND	-H-	
BOS	BOTTOM OF STEEL	HP	HORSEPOWER
BOT	BOTTOM	HZ	HERTZ
BRKR	BREAKER	-J-	
BSMT	BASEMENT	JB	JUNCTION BOX
BSTR	BOOSTER	-L-	
BTWN	BETWEEN	LTG	LIGHTING
-C-		LV	LOW VOLTAGE
CAB	CABINET	-M-	
CAP	CAPACITOR, CAPACITY	MAX	MAXIMUM
CB	CIRCUIT BREAKER, CATCH BASIN	MCB	MAIN CIRCUIT BREAKER
CCT	CORRELATED COLOR TEMPERATURE	MCC	MOTOR CONTROL CENTER
CCTV	CLOSED CIRCUIT TELEVISION	MECH	MECHANICAL
CD	CONSTRUCTION DOCUMENT, CEILING DIFFUSER	MIN	MINIMUM, MINUTE
CERT	CERTIFY	MV	MEDIUM VOLTAGE
CH	CHILLER	-N-	
CHK	CHECK	NC	NORMALLY CLOSED
CKT	CIRCUIT	NEUT	NEUTRAL
CL	CENTER LINE, CLOSE, CLOSET	NO	NORMALLY OPEN, NUMBER
CLG	CEILING	NTS	NOT TO SCALE
CONC	CONCRETE	-P-	
CONN	CONNECT, CONNECTION	P	POLE
COORD	COORDINATE	PB	PULL BOX, PUSH BUTTON
CORR	CORRIDOR	PH	PHASE
CP	CONTROL PANEL, CHROME PLATED	PNL	PANEL
CR	CONTROL RELAY, CARD READER, CASING RELIEF VALVE	PWR	POWER
CS	CONTROL SWITCH	-R-	
CTRL	CONTROL	(R)	REMOVE EXISTING
CTV	CABLE TELEVISION, CONTROL VALVE	REC	RECESSED
-D-		RECPT	RECEPTACLE
(D)	EXISTING TO BE DEMOLISHED	REQD	REQUIRED
DC	DIRECT CURRENT	RM	ROOM
DDC	DIRECT DIGITAL CONTROL	-S-	
DEF	DEFINITION	SCHED	SCHEDULE
DEG	DEGREE	SD	SMOKE DETECTOR/DAMPER, STORM DRAIN
DEG F	DEGREES FAHRENHEIT	SECT	SECTION
DEMO	DEMOLITION	SPEC	SPECIFICATION
DESCR	DESCRIPTION	SPKR	SPEAKER
DET	DETAIL	SWBD	SWITCHBOARD
DGTL	DIGITAL	SWGR	SWITCHGEAR
DIAG	DIAGRAM	SYS	SYSTEM
DIM	DIMENSION	-T-	
DIR	DIRECTION	TELECOM	TELECOMMUNICATIONS
DISC	DISCONNECT	TV	TELEVISION, TURNING VANES
DISCH	DISCHARGE	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
DISTR	DISTRIBUTION PANEL	TYP	TYPICAL
PNL		-U-	
DIV	DIVISION	UC	UNDERCOUNTER
DMR	DIMMER	UGND	UNDERGROUND
DS	DISCONNECT SWITCH	UL	UNDERWRITERS LABORATORIES
DWG	DRAWING	UON	UNLESS OTHERWISE NOTED
-E-		UPS	UNINTERRUPTIBLE POWER SUPPLY
(E) / EX	EXISTING TO REMAIN	UTIL	UTILITY
(ER)	EXISTING TO BE RELOCATED	-V-	
EA	EACH	V	VOLT, VENT, VIDEO
EH	ELECTRIC HEATER	VA	VOLT AMPERE
EL	ELEVATION, ELEVATOR LOBBY	VFD	VARIABLE FREQUENCY DRIVE
ELEC	ELECTRIC, ELECTRICAL	VHO	VERY HIGH OUTPUT
EMER	EMERGENCY	VOLT	VOLTAGE
ENVIR	ENVIRONMENT	-W-	
EPO	EMERGENCY POWER OFF	W	WATT, WIRE, WIDTH, WALL, PHONE, WASTE
EQ	EQUAL	W/O	WITHOUT
EQUIP	EQUIPMENT	WP	WEATHERPROOF, WORKING PRESSURE
EQUIV	EQUIVALENT	-X-	
EXCL	EXCLUDE	XFER	TRANSFER
EXH FN	EXHAUST FAN	XFMR	TRANSFORMER
EXIST	EXISTING		

SYMBOLS LEGEND

ANNOTATION		FLR	WALL	CLG	DESCRIPTION
1	VIEW TITLE SCALE: NTS		\$TO		SWITCH - WITH THERMAL OVERLOAD
1	TITLE E-201 / SCALE: NTS		D		DIMMER
1	DETAIL REFERENCE DETAIL NO. - 1 FOUND IN E-501		OS	OS	OCCUPANCY SENSOR
1	SECTION MARK SECTION NO. - 1 FOUND IN E-501			PP	OCCUPANCY SENSOR POWER PACK
1	2				PHOTOCELL
1	REVISION CLOUD (DELTA 1)				OVERRIDE SWITCH
1	EQUIPMENT TAG DESIGNATION AC DESIGNATION NUMBER 1-1				
LP4:12	PANEL CIRCUIT				
	POINT OF CONNECTION				
	POINT OF DISCONNECTION				
POWER OUTLETS					
FLR	WALL	CLG			DISTRIBUTION BOARD
					RECESSED PANEL
					SURFACE MOUNTED PANEL
					TRANSFORMER
					DISCONNECT SWITCH
					FUSED DISCONNECT SWITCH
					MAGNETIC MOTOR STARTER
					STARTER - DISCONNECT SWITCH
					SWITCH - MOTOR RATED
					MOTOR
					RELAY
					VARIABLE FREQUENCY DRIVE
					PULL BOX
					CABLE TRAY
SINGLE LINE DIAGRAMS					
					CIRCUIT BREAKER SWITCH
					FUSE - INLINE
					FUSED - SWITCH BUS PLUG
					CIRCUIT BREAKER - ENCLOSED
					KIRK KEY INTERLOCK
					BUSDUCT
					SWITCHGEAR BUSWAY
					GROUND FAULT RELAY
					AMMETER
					DIGITAL METER UON
					TRANSFORMER - DELTA WYE-GROUNDED
					ATS - 3-POLE UON BP - WITH BYPASS ISOLATION
					BATTERY
					GENERATOR
					PANEL
					2000 = AMPACITY 3-NO. 4-SINGLE, 5-DOUBLE = NEUTRAL (+) = ADDITIONAL INFO AS REQUIRED
GROUNDING SYSTEM					
					GROUND ROD WITH TEST WELL
					GROUND ROD
					GROUND BAR
					AIR TERMINAL - STRIKE TERMINATION DEVICE, FLAT MTD
					AIR TERMINAL - STRIKE TERMINATION DEVICE, PARAPET MTD
					GROUND, LPS CABLE CONNECTION
					EQUIPMENT CONNECTION
SWITCHES / CONTROLS					
FLR	WALL	CLG			
			\$T		LIGHT SWITCH - TIME OPERATED
			\$		LIGHT SWITCH - SINGLE POLE
			\$3		LIGHT SWITCH - THREE WAY
			\$K		LIGHT SWITCH - KEY OPERATED
			\$P		LIGHT SWITCH - WITH PILOT LIGHT

GENERAL NOTES

- UNLESS LISTED OTHERWISE, THE AMPACITY OF 600 VOLTS OR LESS CONDUCTORS SHALL BE BASED ON THE TERMINALS NOT TO EXCEED 60°C(140°F) FOR CONDUCTOR SIZE 14 THROUGH 1 AWG OR 75°C(167°F) FOR CONDUCTOR SIZES OVER 1AWG.
- NO PIPING, DUCTS OR EQUIPMENT FOREIGN TO ELECTRICAL EQUIPMENT SHALL BE PERMITTED TO BE LOCATED WITHIN THE DEDICATED SPACE ABOVE THE ELECTRICAL EQUIPMENT.
- FUSES SHALL BE PROVIDED WITH REJECTION TYPE FUSE HOLDERS.
- GREEN INSULATED COPPER GROUNDING CONDUCTOR SHALL BE INSTALLED IN ALL BRANCH CIRCUITS AND FEEDERS.
- ALL EXTERIOR ELECTRICAL EQUIPMENT SHALL BE WEATHERPROOF.
- PROJECT SPECIFICATIONS ARE AN INTEGRAL PART OF THESE DRAWINGS.
- A SINGLE RECEPTACLE INSTALLED ON AN INDIVIDUAL BRANCH CIRCUIT SHALL HAVE AN AMPERE RATING OF NOT LESS THAN THAT OF THE BRANCH CIRCUIT. INDICATE THE RECEPTACLES RATING.
- MINIMUM SIZE OF CONDUIT SHALL BE 3/4". MINIMUM SIZE OF NEUTRAL CONDUCTOR SHALL BE #10 AWG, UON MINIMUM SIZE OF CONDUCTOR SHALL BE #12 AWG, UON MINIMUM CONDUCTOR SIZE AT 120 VOLTS AND OVER 100FT CIRCUIT LENGTH SHALL BE #10 AWG, UON MINIMUM CONDUCTOR SIZE AT 277 VOLTS AND OVER 200FT. CIRCUIT LENGTH SHALL BE #10AWG UON.

SHEET INDEX

NO.	TITLE	SCALE
E-001-900A	ELECTRICAL COVER SHEET	NONE
E-002-900A	SINGLE LINE DIAGRAM	NONE
EL101-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL A - PHASE 3	1" = 20'-0"
EL102-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL B - PHASE 3	1" = 20'-0"
EL103-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL C - PHASE 3	1" = 20'-0"
EL104-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL D - PHASE 3	1" = 20'-0"
EL105-900A	GARAGE A LIGHTING DEMOLITION PLAN - LEVEL E - PHASE 3	1" = 20'-0"
EP101-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL A - PHASE 3	1" = 20'-0"
EP102-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL B - PHASE 3	1" = 20'-0"
EP103-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL C - PHASE 3	1" = 20'-0"
EP104-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL D - PHASE 3	1" = 20'-0"
EP105-900A	GARAGE A POWER DEMOLITION PLAN - LEVEL E - PHASE 3	1" = 20'-0"
EL201-900A	GARAGE A LIGHTING PLAN - LEVEL A - PHASE 3	1" = 20'-0"
EL202-900A	GARAGE A LIGHTING PLAN - LEVEL B - PHASE 3	1" = 20'-0"
EL203-900A	GARAGE A LIGHTING PLAN - LEVEL C - PHASE 3	1" = 20'-0"
EL204-900A	GARAGE A LIGHTING PLAN - LEVEL D - PHASE 3	1" = 20'-0"
EP201-900A	GARAGE A POWER PLAN - LEVEL A - PHASE 3	1" = 20'-0"
EP202-900A	GARAGE A POWER PLAN - LEVEL B - PHASE 3	1" = 20'-0"
EP203-900A	GARAGE A POWER PLAN - LEVEL C - PHASE 3	1" = 20'-0"
EP204-900A	GARAGE A POWER PLAN - LEVEL D - PHASE 3	1" = 20'-0"
EP205-900A	GARAGE A ELECTRICAL PLAN - LEVEL E - PHASE 3	1" = 20'-0"
E-402-900A	ENLARGED ELECTRICAL PLANS	AS NOTED
E-501-900A	DETAILS	NONE
E-502-900A	DETAILS	NONE
E-601-900A	SCHEDULES	NONE
E-603-900A	SCHEDULES	NONE
E-604-900A	SCHEDULES	NONE



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
TEXAS BOARD OF PROFESSIONAL ENGINEERS
PEM REGISTRATION NUMBER F-7069
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


PROJECT NUMBER: TFD-007

Garage A
ELECTRICAL COVER SHEET


PERMIT NUMBER: 822-0022

SHEET NUMBER
E-001-900A


ELECTRICAL ROOM 302 LEVEL C (NORTH)

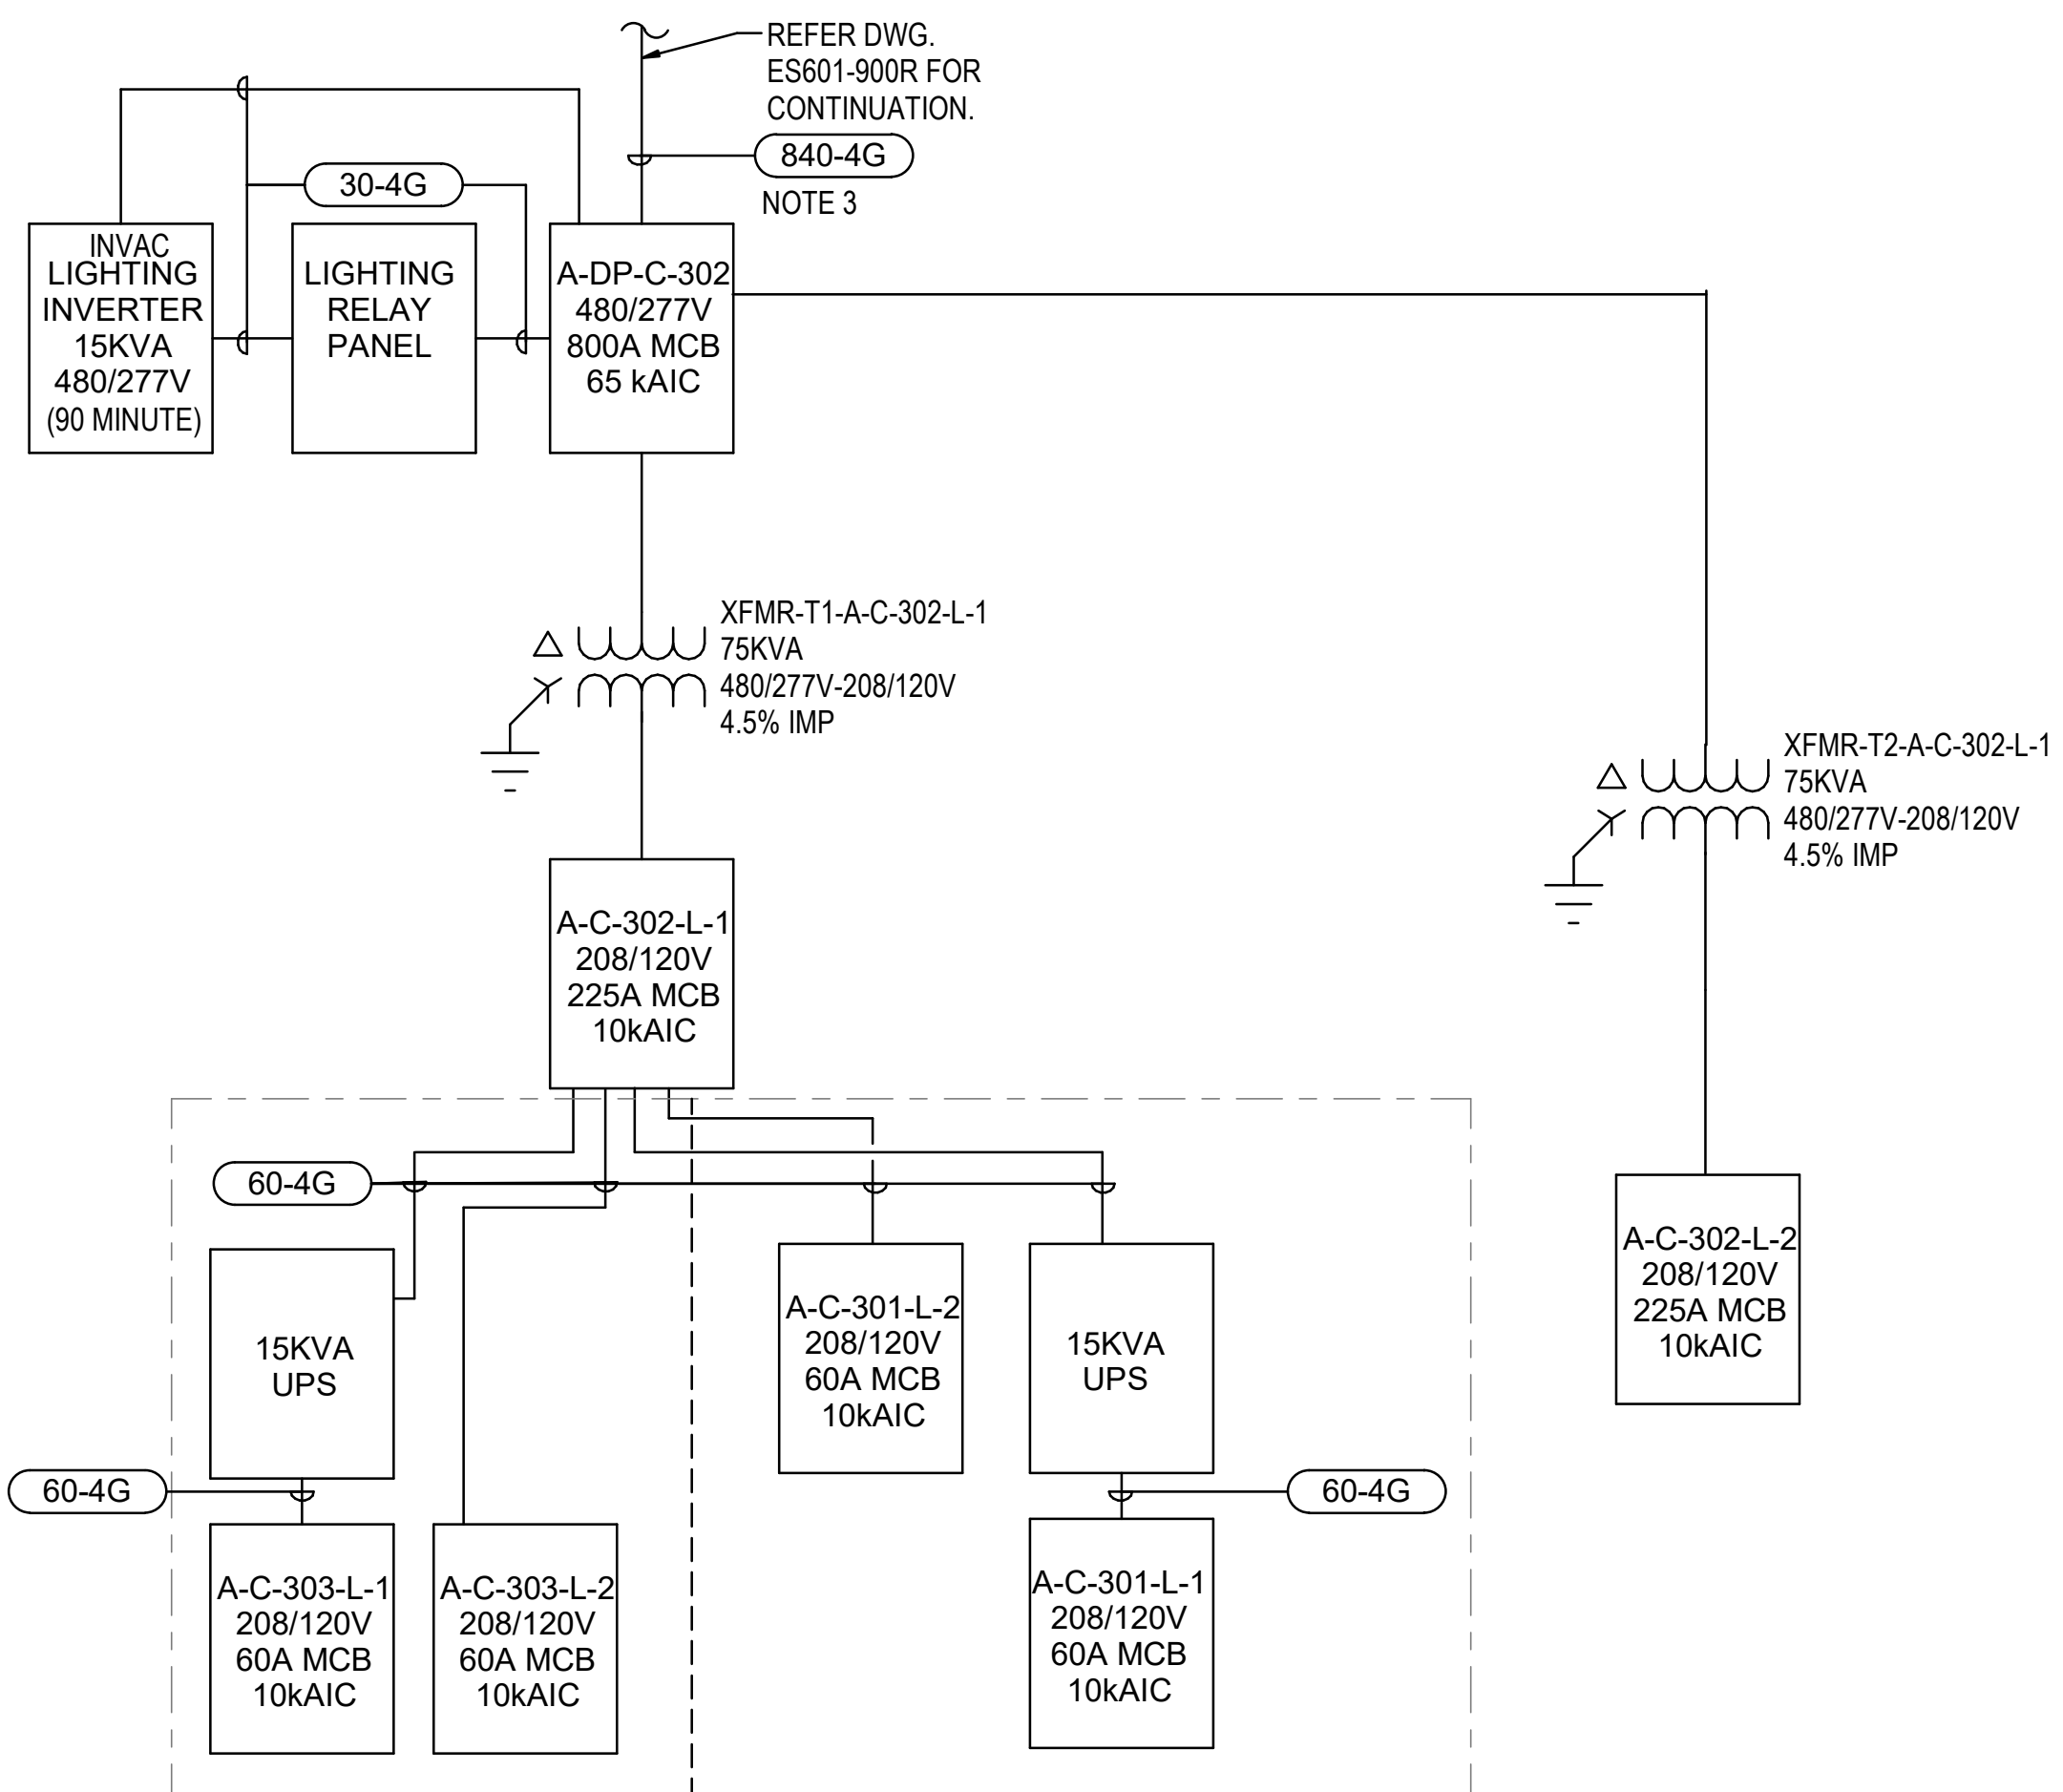


ELECTRICAL ROOM 305 LEVEL C (SOUTH)

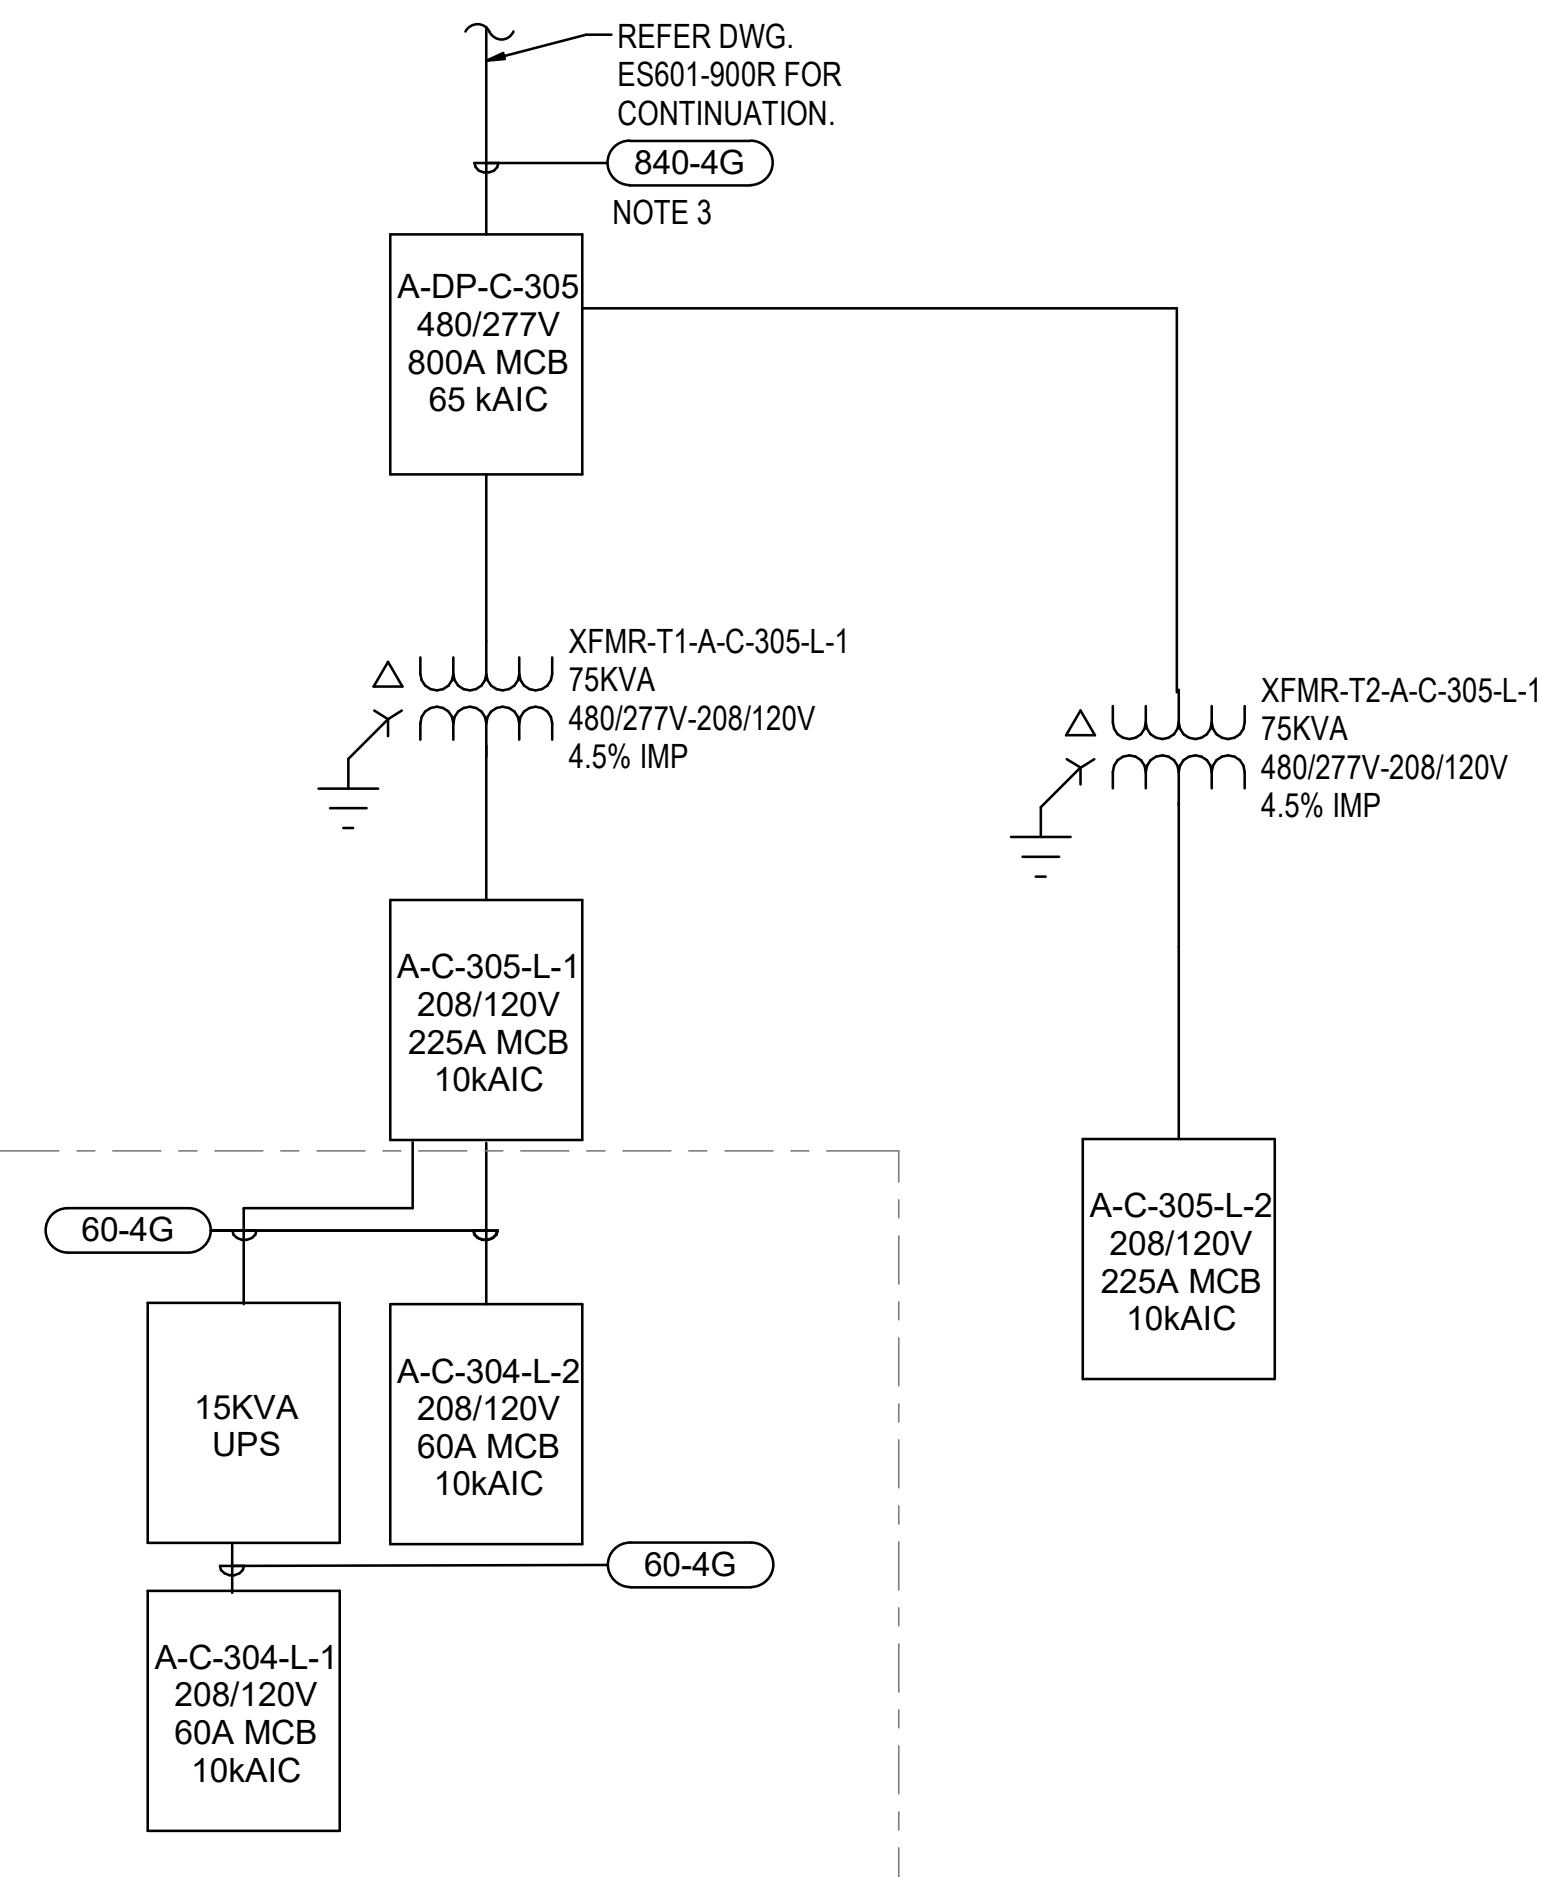

ELECTRICAL ROOM 100 LEVEL A (NORTH)

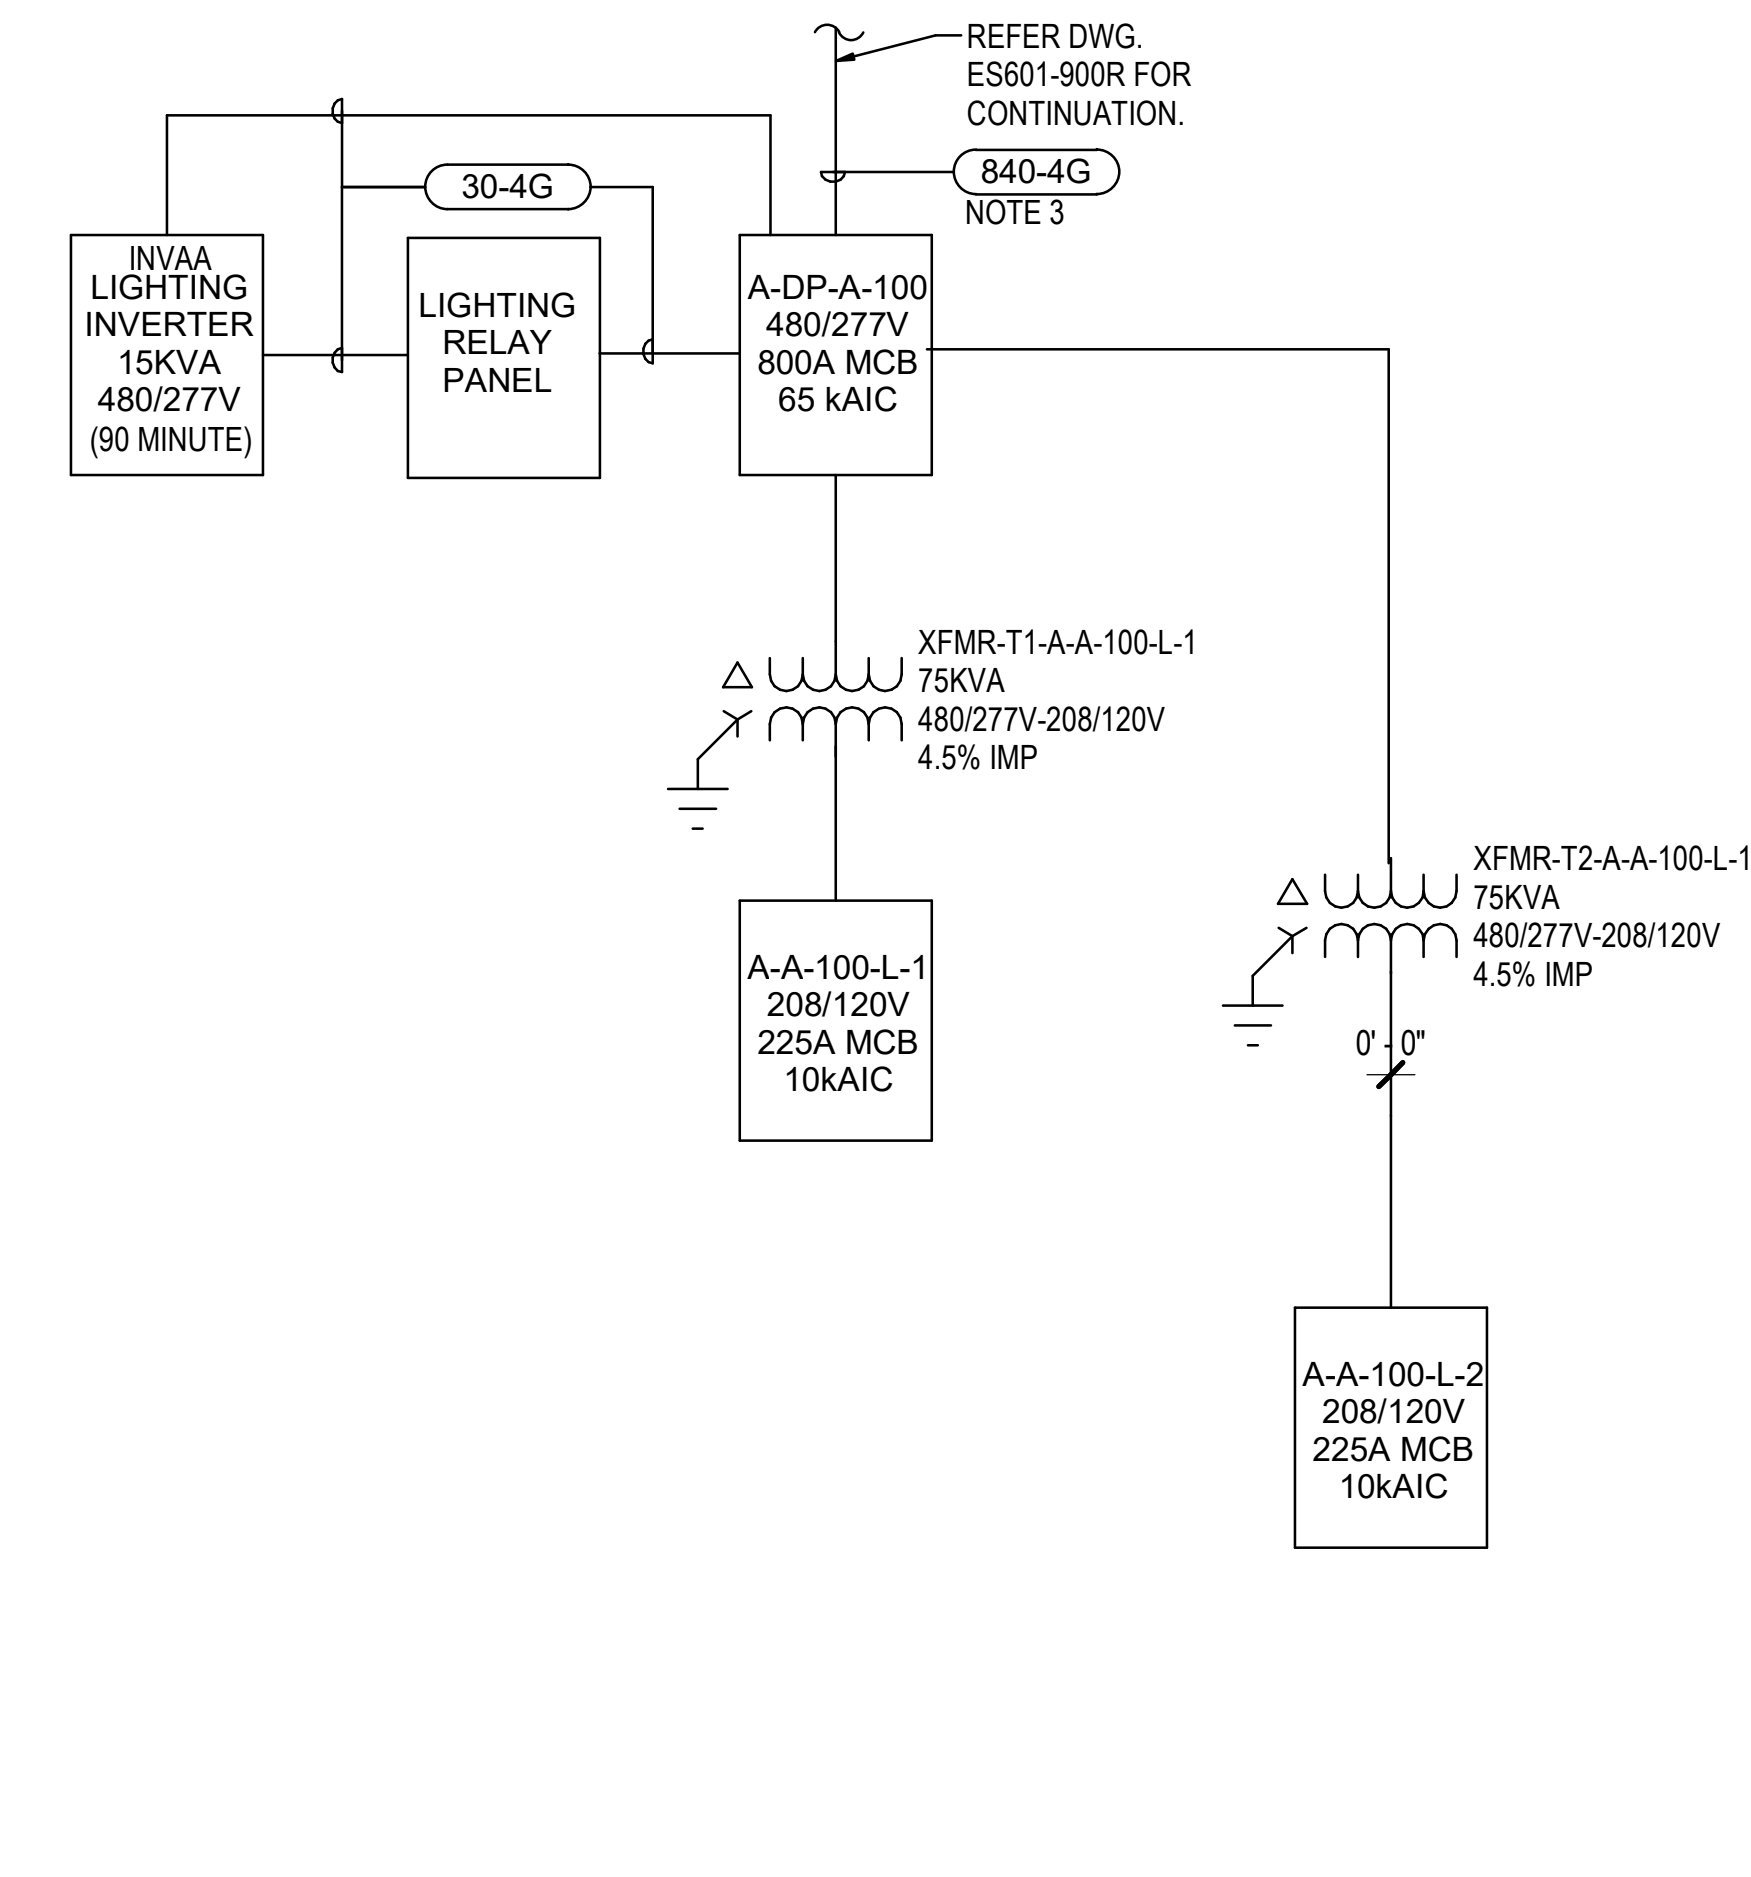

ELECTRICAL ROOM 102 LEVEL A (SOUTH)

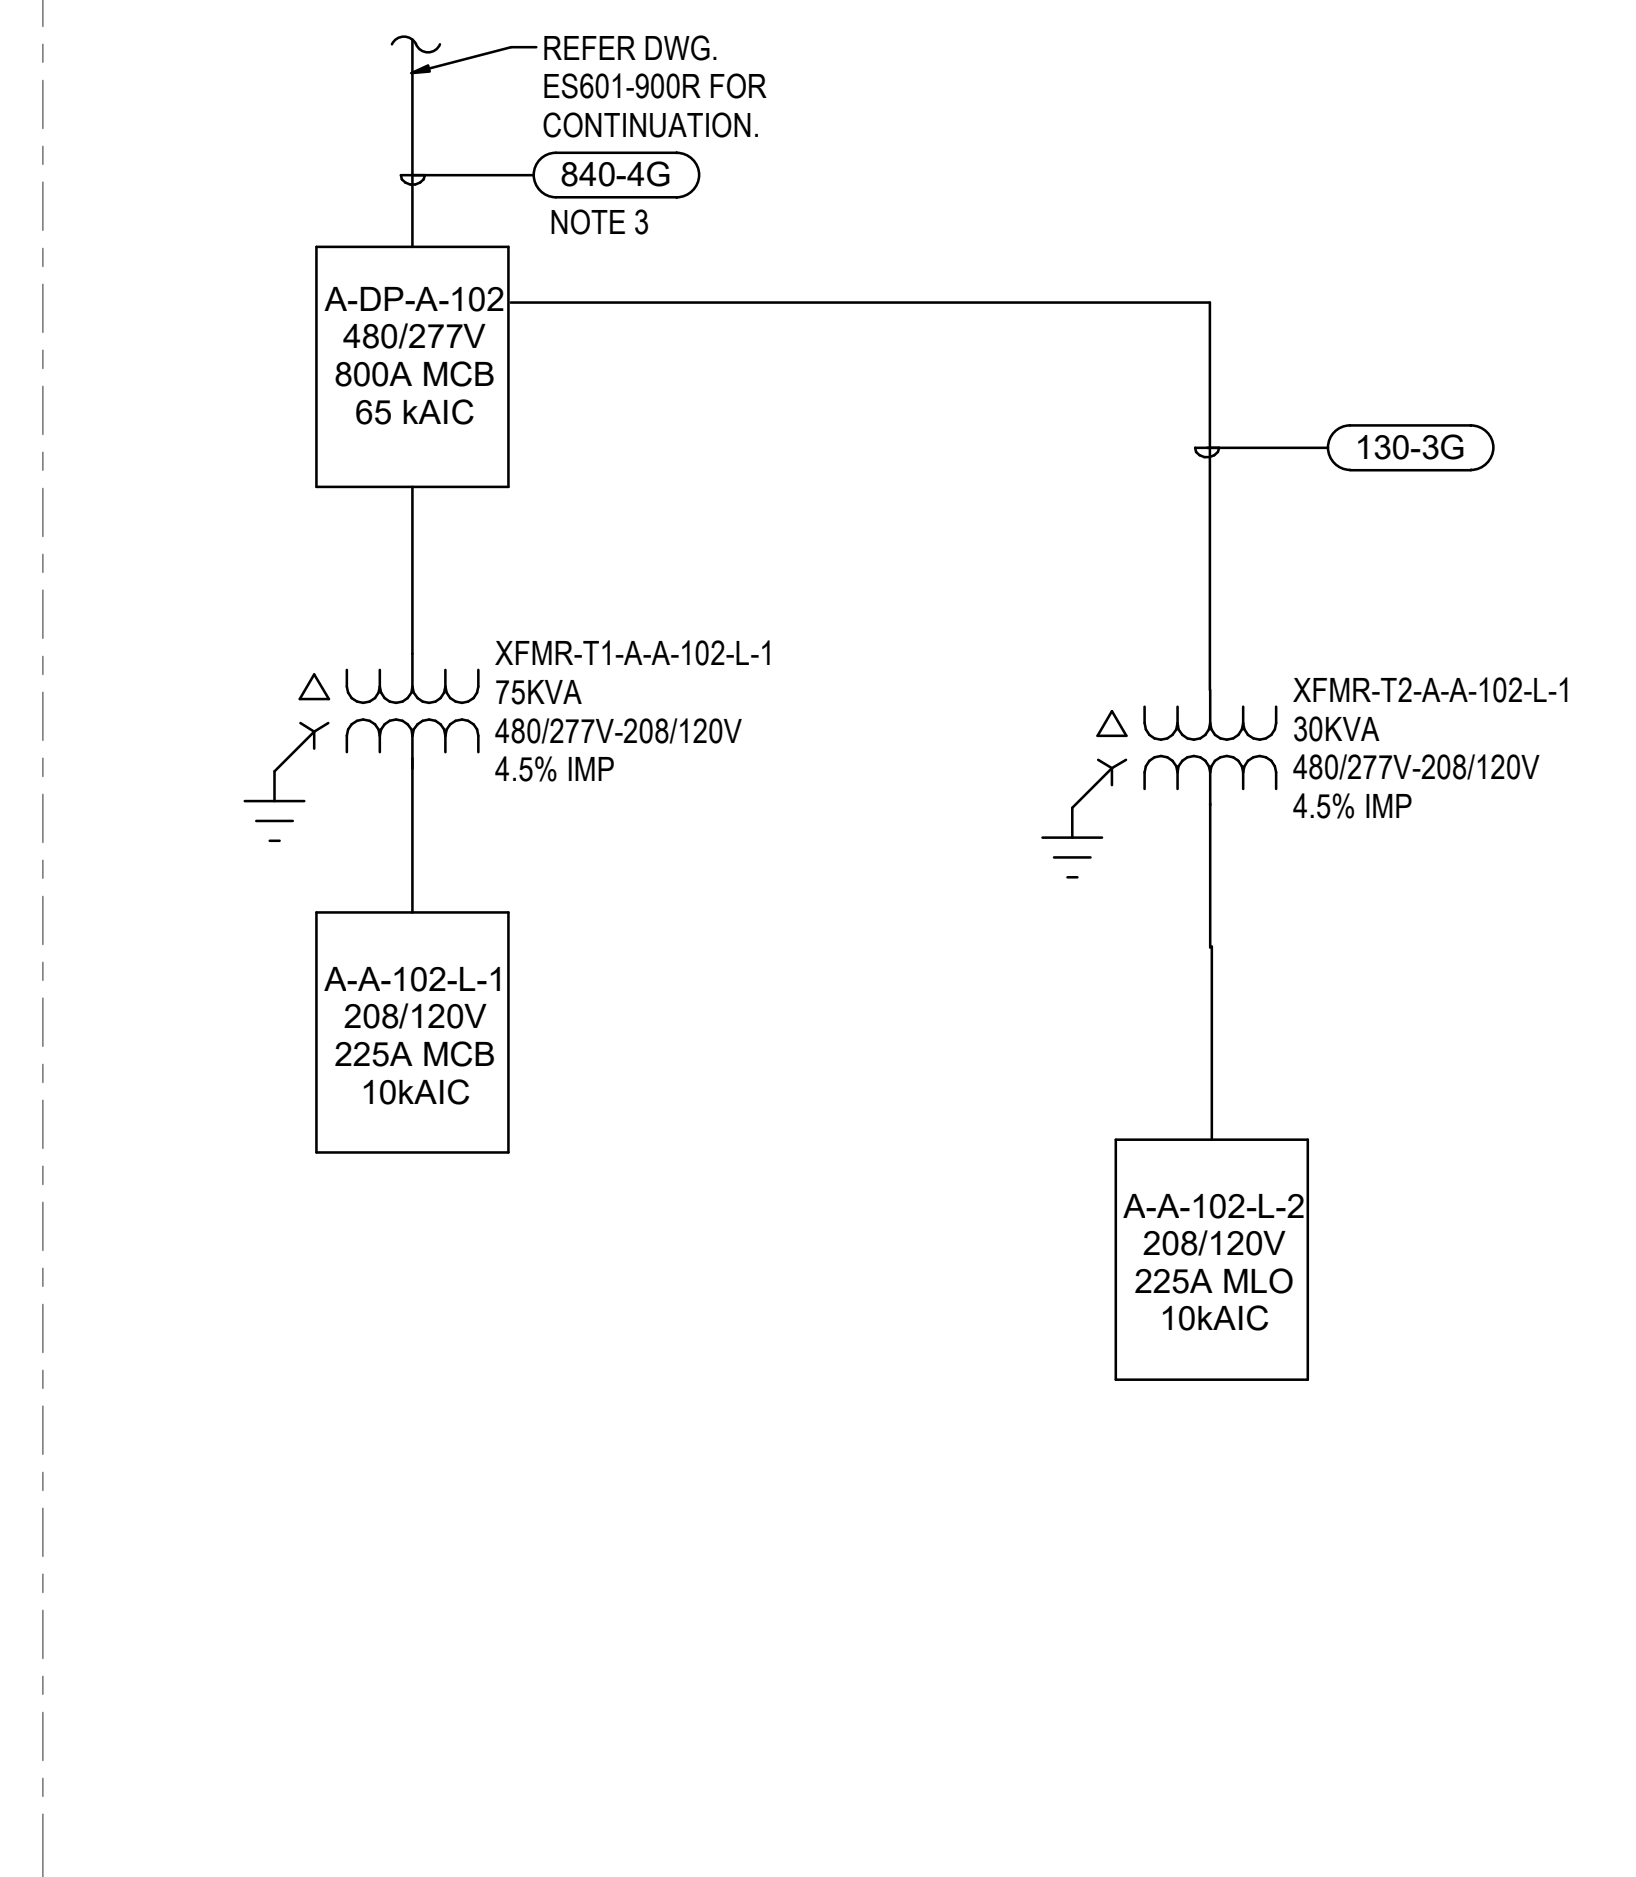

IT ROOM 303 (REFER E-402) IT ROOM 301 (REFER E-402)

IT ROOM 302 (REFER E-402)

1 SINGLE-LINE DIAGRAM
SCALE: NONE

TRANSFORMER SCHEDULE - COPPER

KVA	OCP A/P	PRIMARY		SECONDARY		GROUNDING ELECTRODE
		CONDUCTORS/CONDUIT	CONDUCTORS/CONDUIT	CONDUCTORS/CONDUIT	CONDUCTORS/CONDUIT	
15	25/3	3#10, #10G, 3/4" C	6/3	4#4, #8G, 1-1/4" C		1#8G
30	50/3	3#6, #10G, 3/4" C	100/3	4#1, #6G, 1-1/2" C		1#6G
45	70/3	3#4, #8G, 1" C	150/3	4#1/0, #6G, 2" C		1#6G
75	125/3	3#1, #6G, 1-1/4" C	225/3	4#4/0, #2G, 2-1/2" C		1#2G
112.5	175/3	3#2/0, #6G, 2" C	400/3	4#600KCMIL, #1/0G, 3-1/2" C		1#1/0G
150	225/3	3#4/0, #4G, 2" C	500/3	2 SETS OF 4#250KCMIL, #1/0G, 2-1/2" C		1#1/0G
225	350/3	3#500KCMIL, #3G, 3-1/2" C	800/3	2 SETS OF 4#600KCMIL, #3/0G, 4" C		1#3/0G

OCP - OVERCURRENT PROTECTION
A/P - AMPS/POLES

NOTES:
1. COPPER CONDUCTOR AMPACITY SIZES BASED ON 2017 NEC TABLE 310.15(B)(15). CONDUCTORS LESS THAN 110 AMPS UTILIZE 60°C. CONDUCTORS GREATER THAN 110 AMPS UTILIZE 75°C.
2. CONDUIT SIZES ARE BASED ON 2017 NEC TABLE C.1 (EMT).
3. CONDUIT SIZES FOR OTHER INSULATION CHARACTERISTIC, USE THE 2017 NEC, ANNEX C TABLE.

3 TRANSFORMER SCHEDULE
SCALE: NONE

600VAC AND BELOW FEEDER SCHEDULE

Cu FEEDER SCHEDULE 3G				Cu FEEDER SCHEDULE 4G			
WIRE/BKR MAX AMPS	DESIG.	DESCRIPTION	NOTES	WIRE/BKR MAX AMPS	DESIG.	DESCRIPTION	NOTES
20	20-3G	3#12, 1#12G, 1/2" C	1,2	20	20-4G	3#12, 1#10G, 1#12G, 1/2" C	1,2
30	30-3G	3#10, 1#10G, 3/4" C	1,2	30	30-4G	4#10, 1#10G, 3/4" C	1,2
40	40-3G	3#8, 1#10G, 3/4" C	1,2	40	40-4G	4#8, 1#10G, 3/4" C	1,2
60	60-3G	3#6, 1#10G, 3/4" C	1,2	60	60-4G	4#6, 1#10G, 1" C	1,2
70	70-3G	3#4, 1#8G, 1" C	1,2	70	70-4G	4#4, 1#8G, 1-1/4" C	1,2
85	85-3G	3#3, 1#6G, 1" C	1,2	85	85-4G	4#3, 1#8G, 1-1/4" C	1,2
100	100-3G	3#2, 1#6G, 1-1/4" C	1,2	100	100-4G	4#2, 1#8G, 1-1/4" C	1,2
130	130-3G	3#1, 1#6G, 1-1/4" C	1,2	130	130-4G	4#1, 1#6G, 1-1/2" C	1,2
150	150-3G	3#1/0, 1#6G, 1-1/2" C	1,2	150	150-4G	4#1/0, 1#6G, 2" C	1,2
175	175-3G	3#2/0, 1#6G, 1-1/2" C	1,2	175	175-4G	4#2/0, 1#6G, 2" C	1,2
200	200-3G	3#3/0, 1#6G, 2" C	1,2	200	200-4G	4#3/0, 1#6G, 2" C	1,2
230	230-3G	3#4/0, 1#4G, 2" C	1,2	230	230-4G	4#4/0, 1#4G, 2-1/2" C	1,2
255	255-3G	3#250KCMIL, 1#4G, 2" C	1,2	255	255-4G	4#250KCMIL, 1#4G, 2-1/2" C	1,2
310	310-3G	3#350KCMIL, 1#3G, 2-1/2" C	1,2	310	310-4G	4#350KCMIL, 1#3G, 3" C	1,2
380	380-3G	3#500KCMIL, 1#3G, 3" C	1,2	380	380-4G	4#500KCMIL, 1#3G, 4" C	1,2
400	400-3G	2 SETS, EA: 3#3/0, 1#3G, 2-1/2" C	1,2	400	400-4G	2 SETS, EA: 4#3/0, 1#3G, 2-1/2" C	1,2
420	420-3G	3#600KCMIL, 1#3G, 4" C	1,2	420	420-4G	4#600KCMIL, 1#3G, 4" C	1,2
475	450-3G	3#750KCMIL, 1#2G, 4" C	1,2	475	450-4G	4#750KCMIL, 1#2G, 4" C	1,2
510	510-3G	2 SETS, EA: 3#250KCMIL, 1#2G, 3" C	1,2	510	510-4G	2 SETS, EA: 4#250KCMIL, 1#2G, 3" C	1,2
620	620-3G	2 SETS, EA: 3#350KCMIL, 1#1/0G, 3" C	1,2	620	620-4G	2 SETS, EA: 4#350KCMIL, 1#1/0G, 3-1/2" C	1,2
840	840-3G	2 SETS, EA: 3#600KCMIL, 1#1/0G, 4" C	1,2	840	840-4G	2 SETS, EA: 4#600KCMIL, 1#1/0G, 4" C	1,2
855	855-3G	3 SETS, EA: 3#300KCMIL, 1#2/0G, 3" C	1,2	855	855-4G	3 SETS, EA: 4#300KCMIL, 1#2/0G, 3-1/2" C	1,2
1000	1000-3G	3 SETS, EA: 3#400KCMIL, 1#2/0G, 2-1/2" C	1,2	1000	1000-4G	3 SETS, EA: 4#400KCMIL, 1#2/0G, 3" C	1,2
1240	1200-3G	4 SETS, EA: 3#350KCMIL, 1#3/0G, 3-1/2" C	1,2	1240	1200-4G	4 SETS, EA: 4#350KCMIL, 1#3/0G, 3-1/2" C	1,2
1520	1500-3G	4 SETS, EA: 3#500KCMIL, 1#3/0G, 3 1/2" C	1,2	1520	1500-4G	4 SETS, EA: 4#500KCMIL, 1#3/0G, 3-1/2" C	1,2
1680	1680-3G	4 SETS, EA: 3#600KCMIL, 1#4/0G, 3-1/2" C	1,2	1680	1680-4G	4 SETS, EA: 4#600KCMIL, 1#4/0G, 4" C	1,2
2100	2000-3G	5 SETS, EA: 3#600KCMIL, 1#250KCMILG, 3" C	1,2	2100	2000-4G	5 SETS, EA: 4#600KCMIL, 1#250KCMILG, 4" C	1,2
2520	2500-3G	6 SETS, EA: 3#600KCMIL, 1#350KCMILG, 3-1/2" C	1,2	2520	2500-4G	6 SETS, EA: 4#600KCMIL, 1#350KCMILG, 4" C	1,2
2660	2660-3G	7 SETS, EA: 3#500KCMIL, 1#360KCMILG, 4" C	1,2	2660	2660-4G	7 SETS, EA: 4#500KCMIL, 1#360KCMILG, 4" C	1,2
3040	3000-3G	8 SETS, EA: 3#500KCMIL, 1#350KCMILG, 4" C	1,2	3040	3000-4G	8 SETS, EA: 4#500KCMIL, 1#350KCMILG, 4" C	1,2
3325	3325-3G	7 SETS, EA: 3#750KCMIL, 1#500KCMILG, 4" C	1,2	3325	3325-4G	7 SETS, EA: 4#750KCMIL, 1#500KCMIL IN 4" C	1,2
3780	3780-3G	9 SETS, EA: 3#600KCMIL, 1#500KCMILG, 4" C	1,2	3780	3780-4G	9 SETS, EA: 4#600KCMIL, 1#500KCMILG, 3-1/2" C	1,2
4200	4000-3G	10 SETS, EA: 3#600KCMIL, 1#500KCMILG, 4" C	1,2	4200	4000-4G	10 SETS, EA: 4#600KCMIL, 1#500KCMILG, 4" C	1,2
5040	5000-3G	12 SETS, EA: 3#600KCMIL, 1#600KCMIL, 4" C	1,2	5040	5000-4G	12 SETS, EA: 4#600KCMIL, 1#600KCMIL, 4" C	1,2

CONDUIT BASED ON THHN/THWN WITH 40% FILL CALCULATION.
CONDUCTOR SIZE BASED ON NEC 110-14C WITH 60 DEGREE CELSIUS AMPACITY TABLES FOR 20AMP THROUGH 100AMPS AND 75 DEGREE CELSIUS TABLES FOR VALUES > 100AMPS.

NOTES:
1. IN GENERAL, THE ACTUAL BREAKER AMPERAGE SHALL BE EQUAL TO OR NEXT STANDARD SIZE SMALLER THAN THE MAXIMUM WIRE AMPS. EXCEPTIONS SHALL BE MOTOR AND SPECIAL EQUIPMENT BREAKERS WHICH SHALL BE SIZED PER N.E.C. AND VENDOR REQUIREMENTS. OMIT GROUND CONDUCTORS ON SERVICE ENTRANCE FEEDERS (TYPICAL). USE #12 AWG WIRE UNLESS NOTED OTHERWISE. PRIOR TO ROUGH-IN, CONTRACTOR SHALL COORDINATE BREAKERS AND WIRING WITH ACTUAL REQUIREMENTS OF EQUIPMENT BEING FURNISHED FOR THIS SPECIFIC PROJECT.
2. UNLESS NOTED OTHERWISE, ALL 20A/1P BREAKERS TO UTILIZE #12 AWG CONDUCTORS EXCEPT WHERE BRANCH CIRCUIT IS IN EXCESS OF 90 LINEAR FEET CONDUCTORS TO BE #10 AWG AND OVER 175 LINEAR FEET CONDUCTORS TO BE #8 AWG. EQUIPMENT GROUNDING CONDUCTOR SHALL BE INCREASED PROPORTIONATELY TO PHASE CONDUCTORS, PER N.E.C. 250.122(B).
3. PROVIDE WITH #4/0 AWG EQUIPMENT GROUND CONDUCTOR.

2 FEEDER SCHEDULE
SCALE: NONE

6 CONTROL ROOM 501 - LEVEL E - NORTH
SCALE: 1/4" = 1'-0"

3 ELECTRICAL ROOM 102 POWER PLAN - LEVEL A SOUTH
SCALE: 1/4" = 1'-0"

1 ELECTRICAL ROOM 100 POWER PLAN - LEVEL A NORTH
SCALE: 1/4" = 1'-0"


5 IT ROOM 304 / ELECTRICAL ROOM 305 POWER PLAN - LEVEL C SOUTH
SCALE: 1/4" = 1'-0"

7 IT ROOM 303 POWER PLAN - LEVEL C CENTER
SCALE: 1/4" = 1'-0"

4 IT ROOM 301 / ELECTRICAL ROOM 302 POWER PLAN - LEVEL C NORTH
SCALE: 1/4" = 1'-0"

2 ELEVATOR PIT & STORAGE ROOM POWER PLAN - TYPICAL
SCALE: 1/4" = 1'-0"

- # SHEET KEYNOTES
1. WALL-MOUNTED JUNCTION BOX FOR UPS POWER FEEDER.
 2. BOTTOM OF EACH EQUIPMENT RACK (20 RACK UNITS PER RACK) RESERVED FOR UPS EQUIPMENT. INSTALL 15 KVA, 3-PHASE, 208/120V UPS WITH 4-HOUR BACKUP BATTERY SUPPLY. ALL EQUIPMENT TO BE COMPATIBLE WITH INSTALLATION IN INDUSTRY-STANDARD 19-INCH WIDE RACK INSIDE 30-INCH DEEP CABINET.

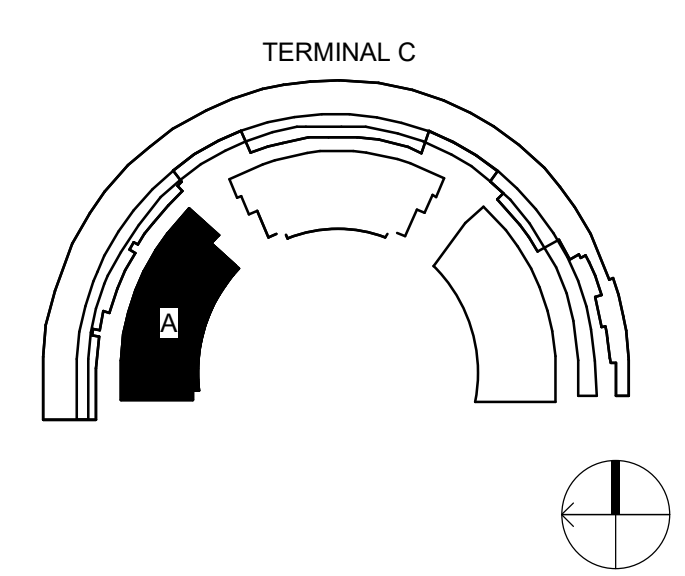

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue, Suite 415, Dallas, TX 75206
Tel: 972-470-0704 www.syska.com

DRAWN BY: Author
APPROVED BY: WH
ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	100% DESIGN
2	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
ENLARGED ELECTRICAL PLANS
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
E-402-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


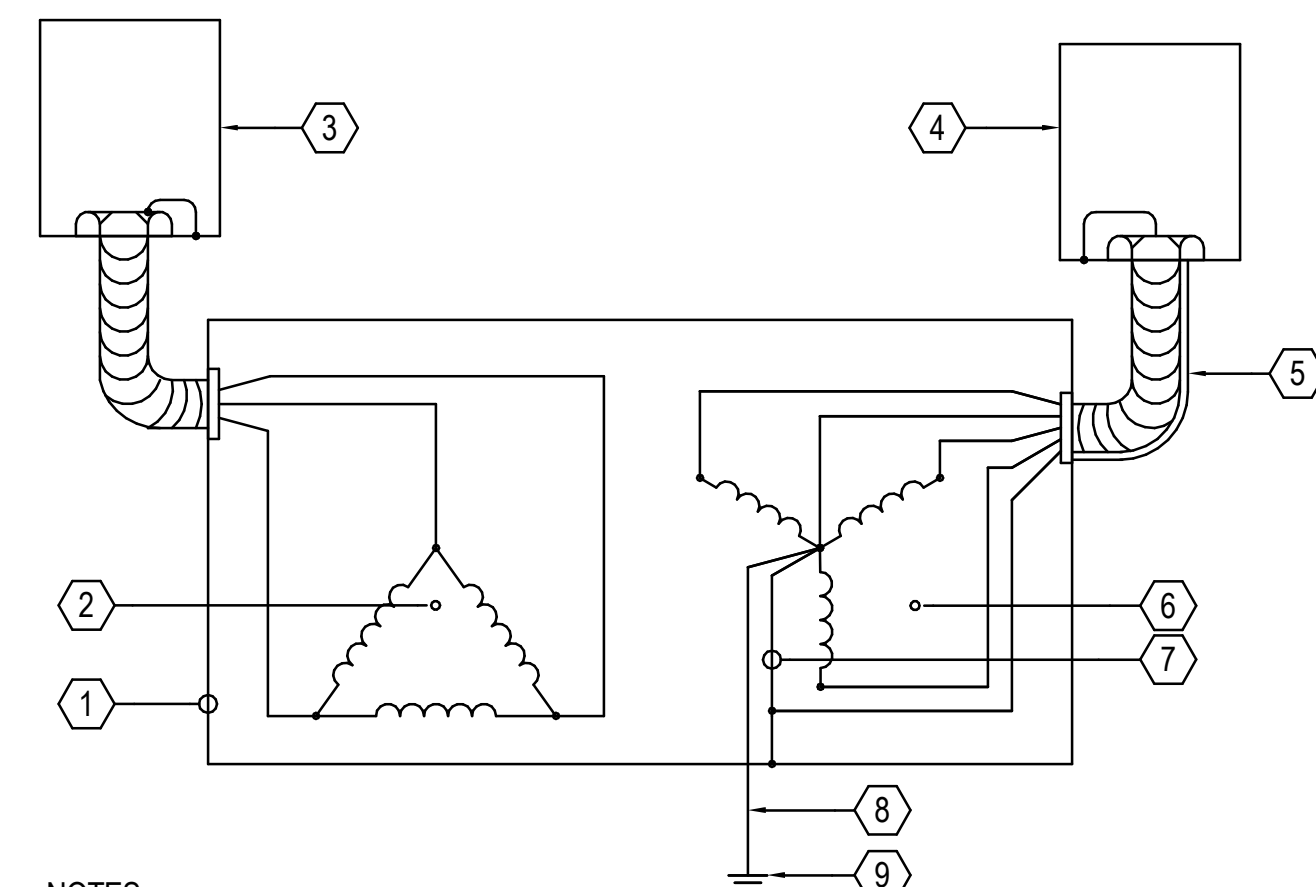


- NOTES:
- 1 ENCLOSURE
 - 2 PRIMARY WINDING
 - 3 PRIMARY DISCONNECT SWITCH
 - 4 SECONDARY DISCONNECT SWITCH
 - 5 FLEXIBLE CONDUIT WITH GROUNDING ELECTRODE CONDUCTOR
 - 6 SECONDARY WINDING
 - 7 BOND TO ENCLOSURE
 - 8 GROUNDING ELECTRODE CONDUCTOR
 - 9 GROUNDING ELECTRODE

TRANSFORMER GROUNDING


5 TRANSFORMER GROUNDING

SCALE: 12" = 1'-0"

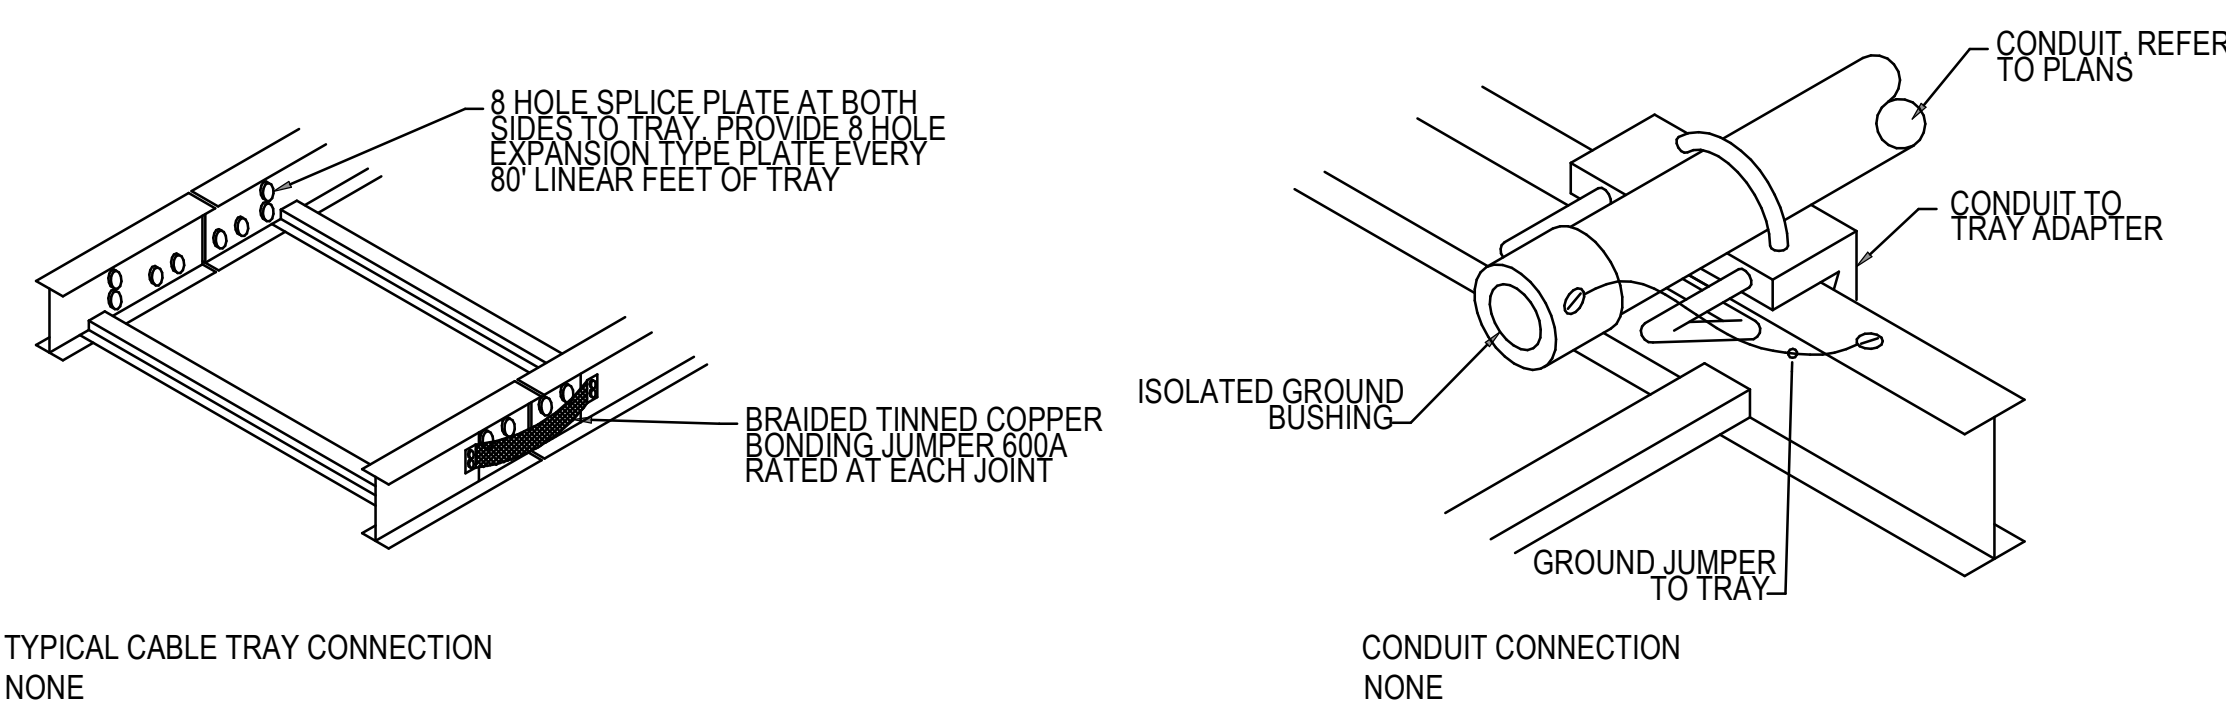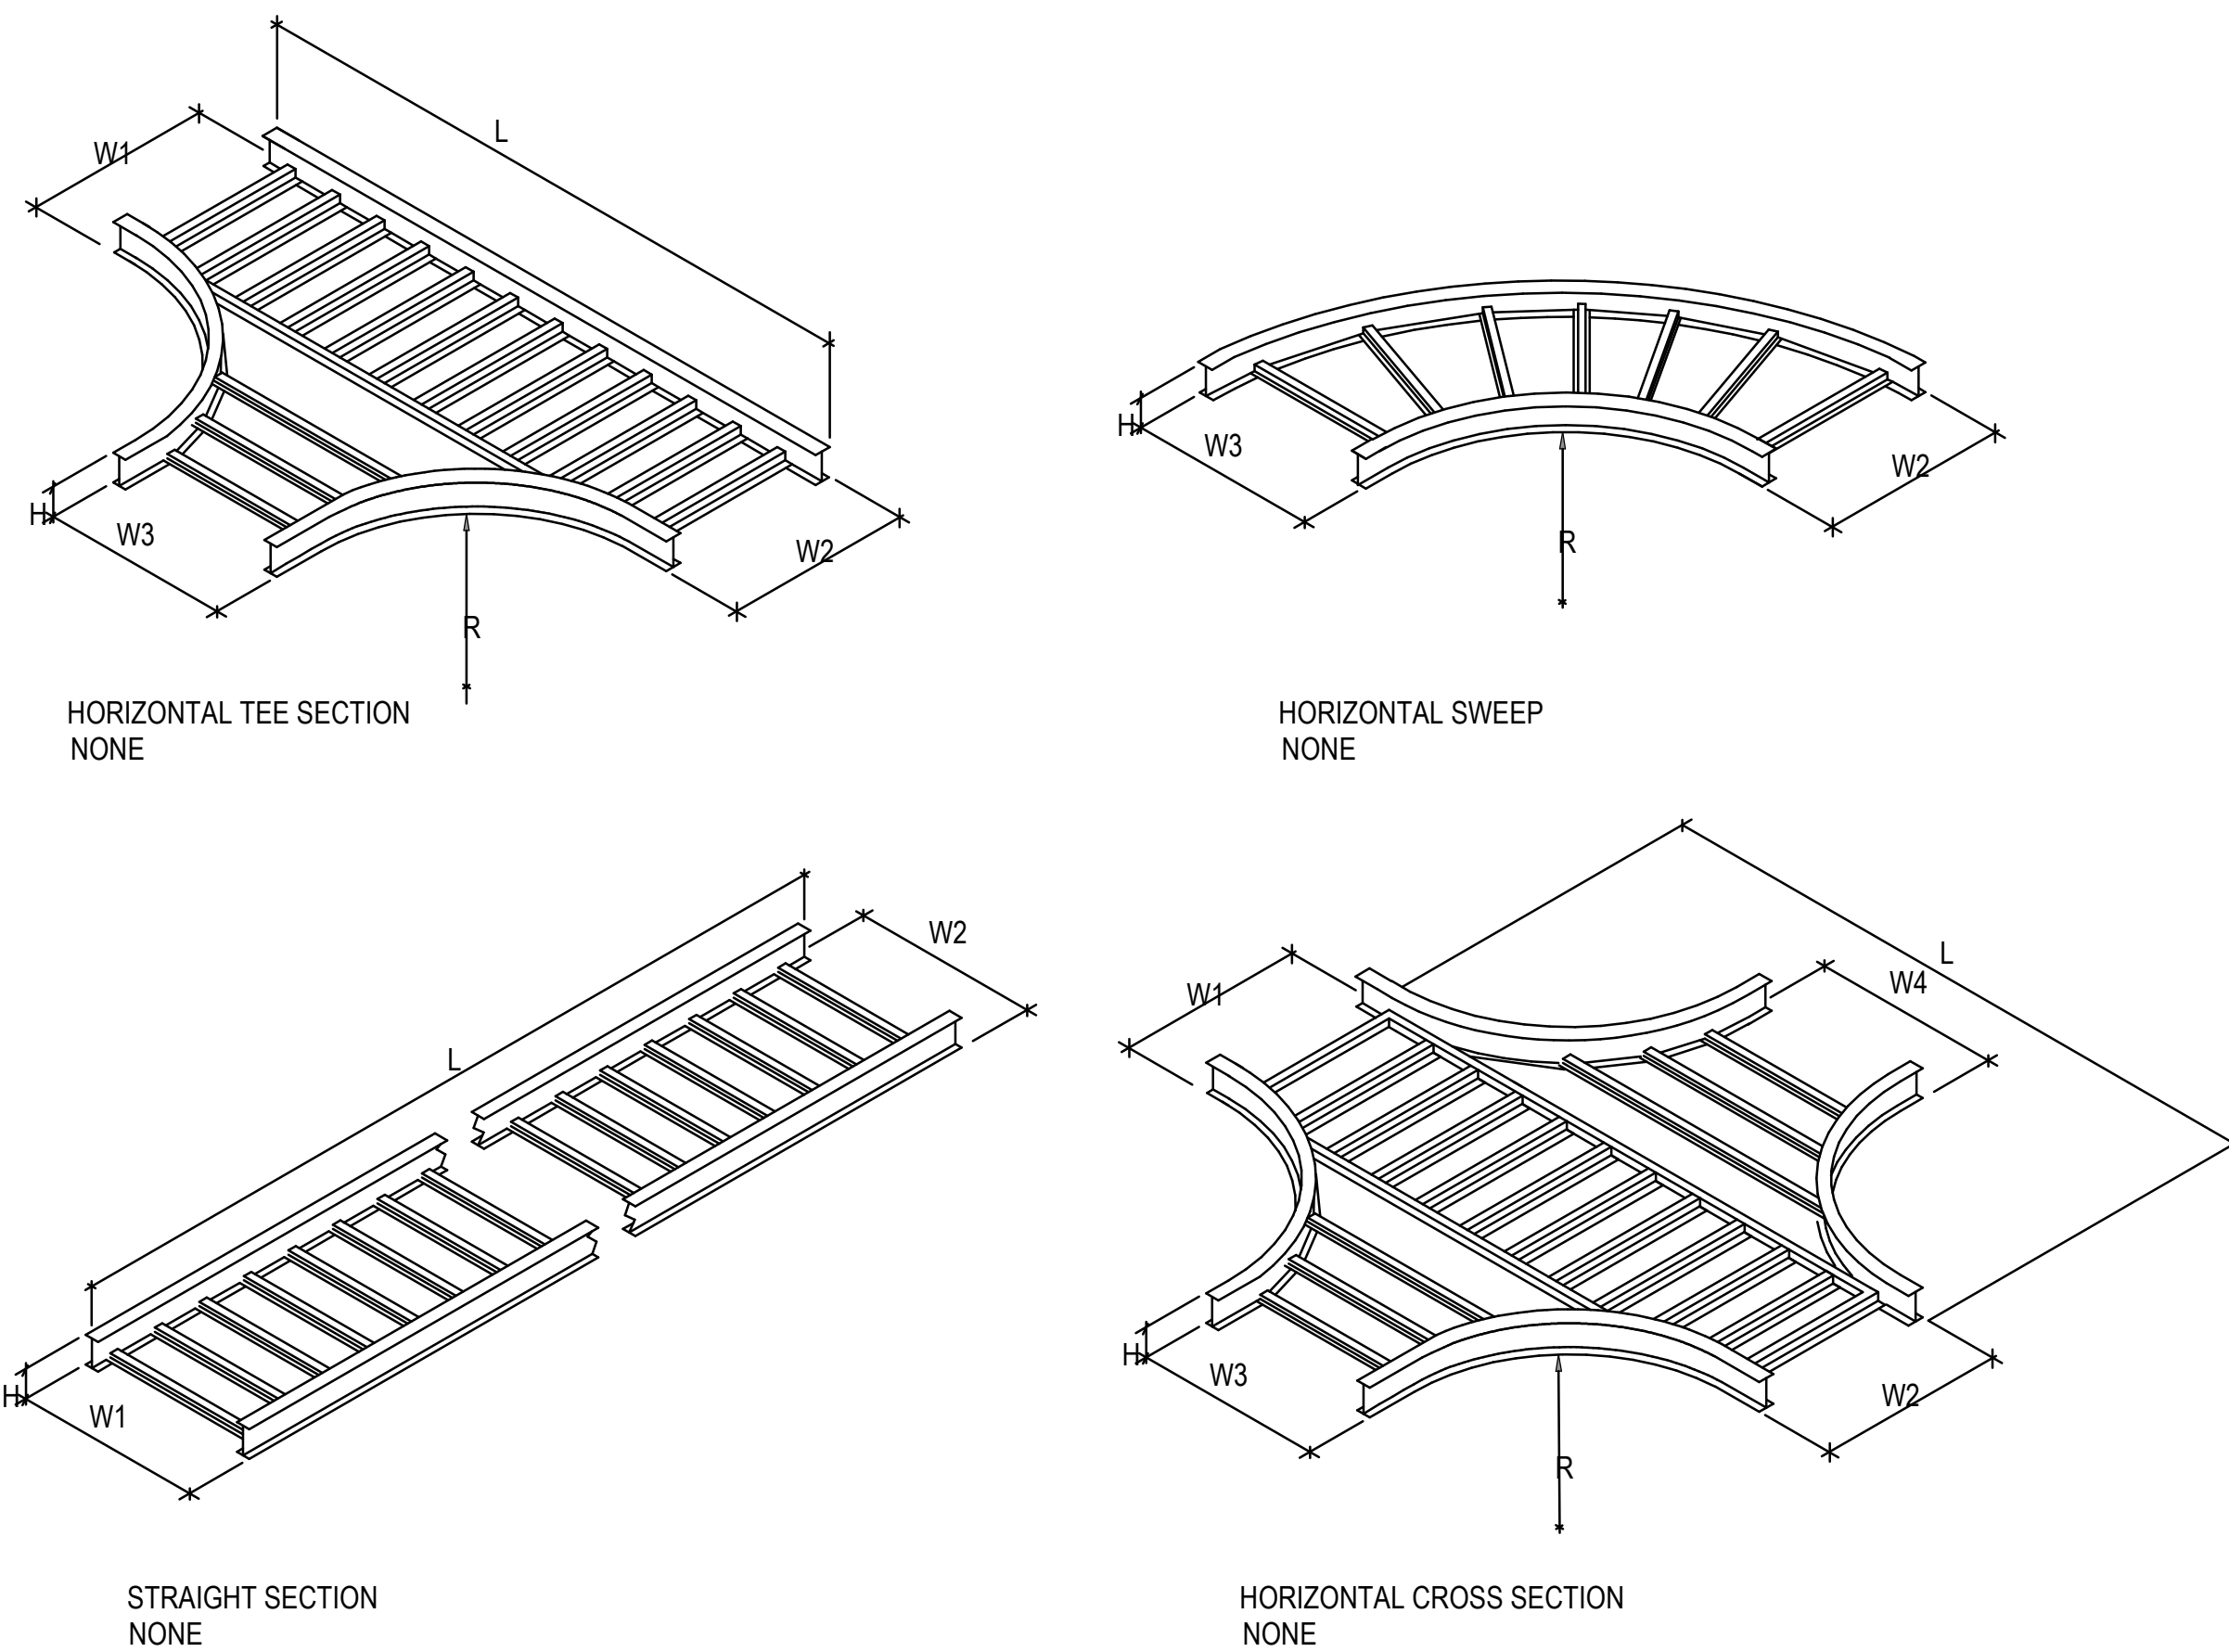

1 CABLE TRAY DETAIL


SCALE: NONE

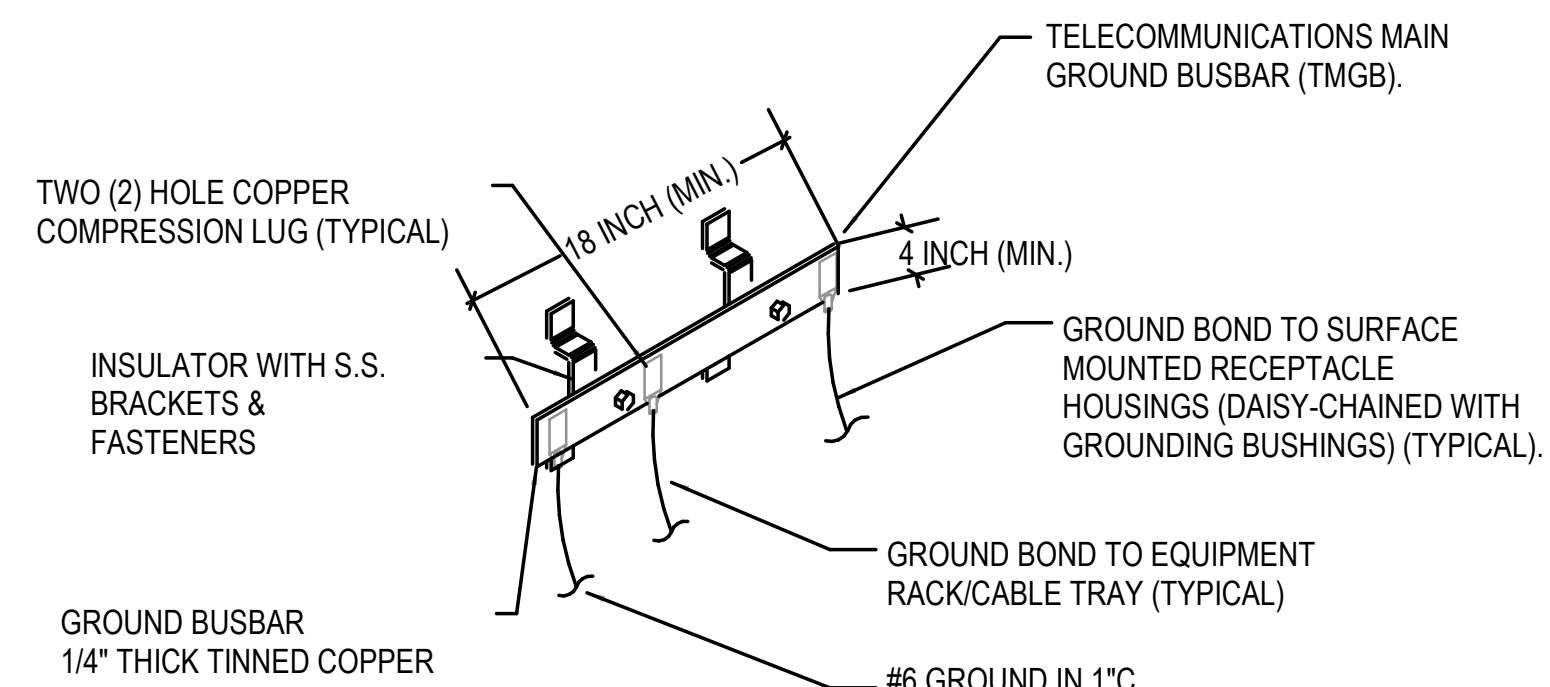

- NOTES:
- GROUNDING BUSBAR TO BE INSTALLED AND GROUNDED TO NEAREST GROUND BAR. GROUND BAR SHALL BE 'ERICO' MAKE.
 - FURNISH AND INSTALL A MINIMUM OF A 6-AWG STRANDED GROUNDING CONDUCTOR AND A TWO (2) HOLE COPPER COMPRESSION LUG FOR EACH INDIVIDUAL EQUIPMENT RACK AND CABLE TRAY BY IT EQUIPMENT VENDOR.
 - ALL GROUND BONDS SHALL BE PROVIDED AS GREEN INSULATED COPPER.
 - ALL GROUND BAR CONNECTIONS SHALL BE MADE WITH DOUBLE LUG COMPRESSION FITTINGS.

4 IT ROOM LOCAL COPPER GROUND BAR


SCALE: NONE

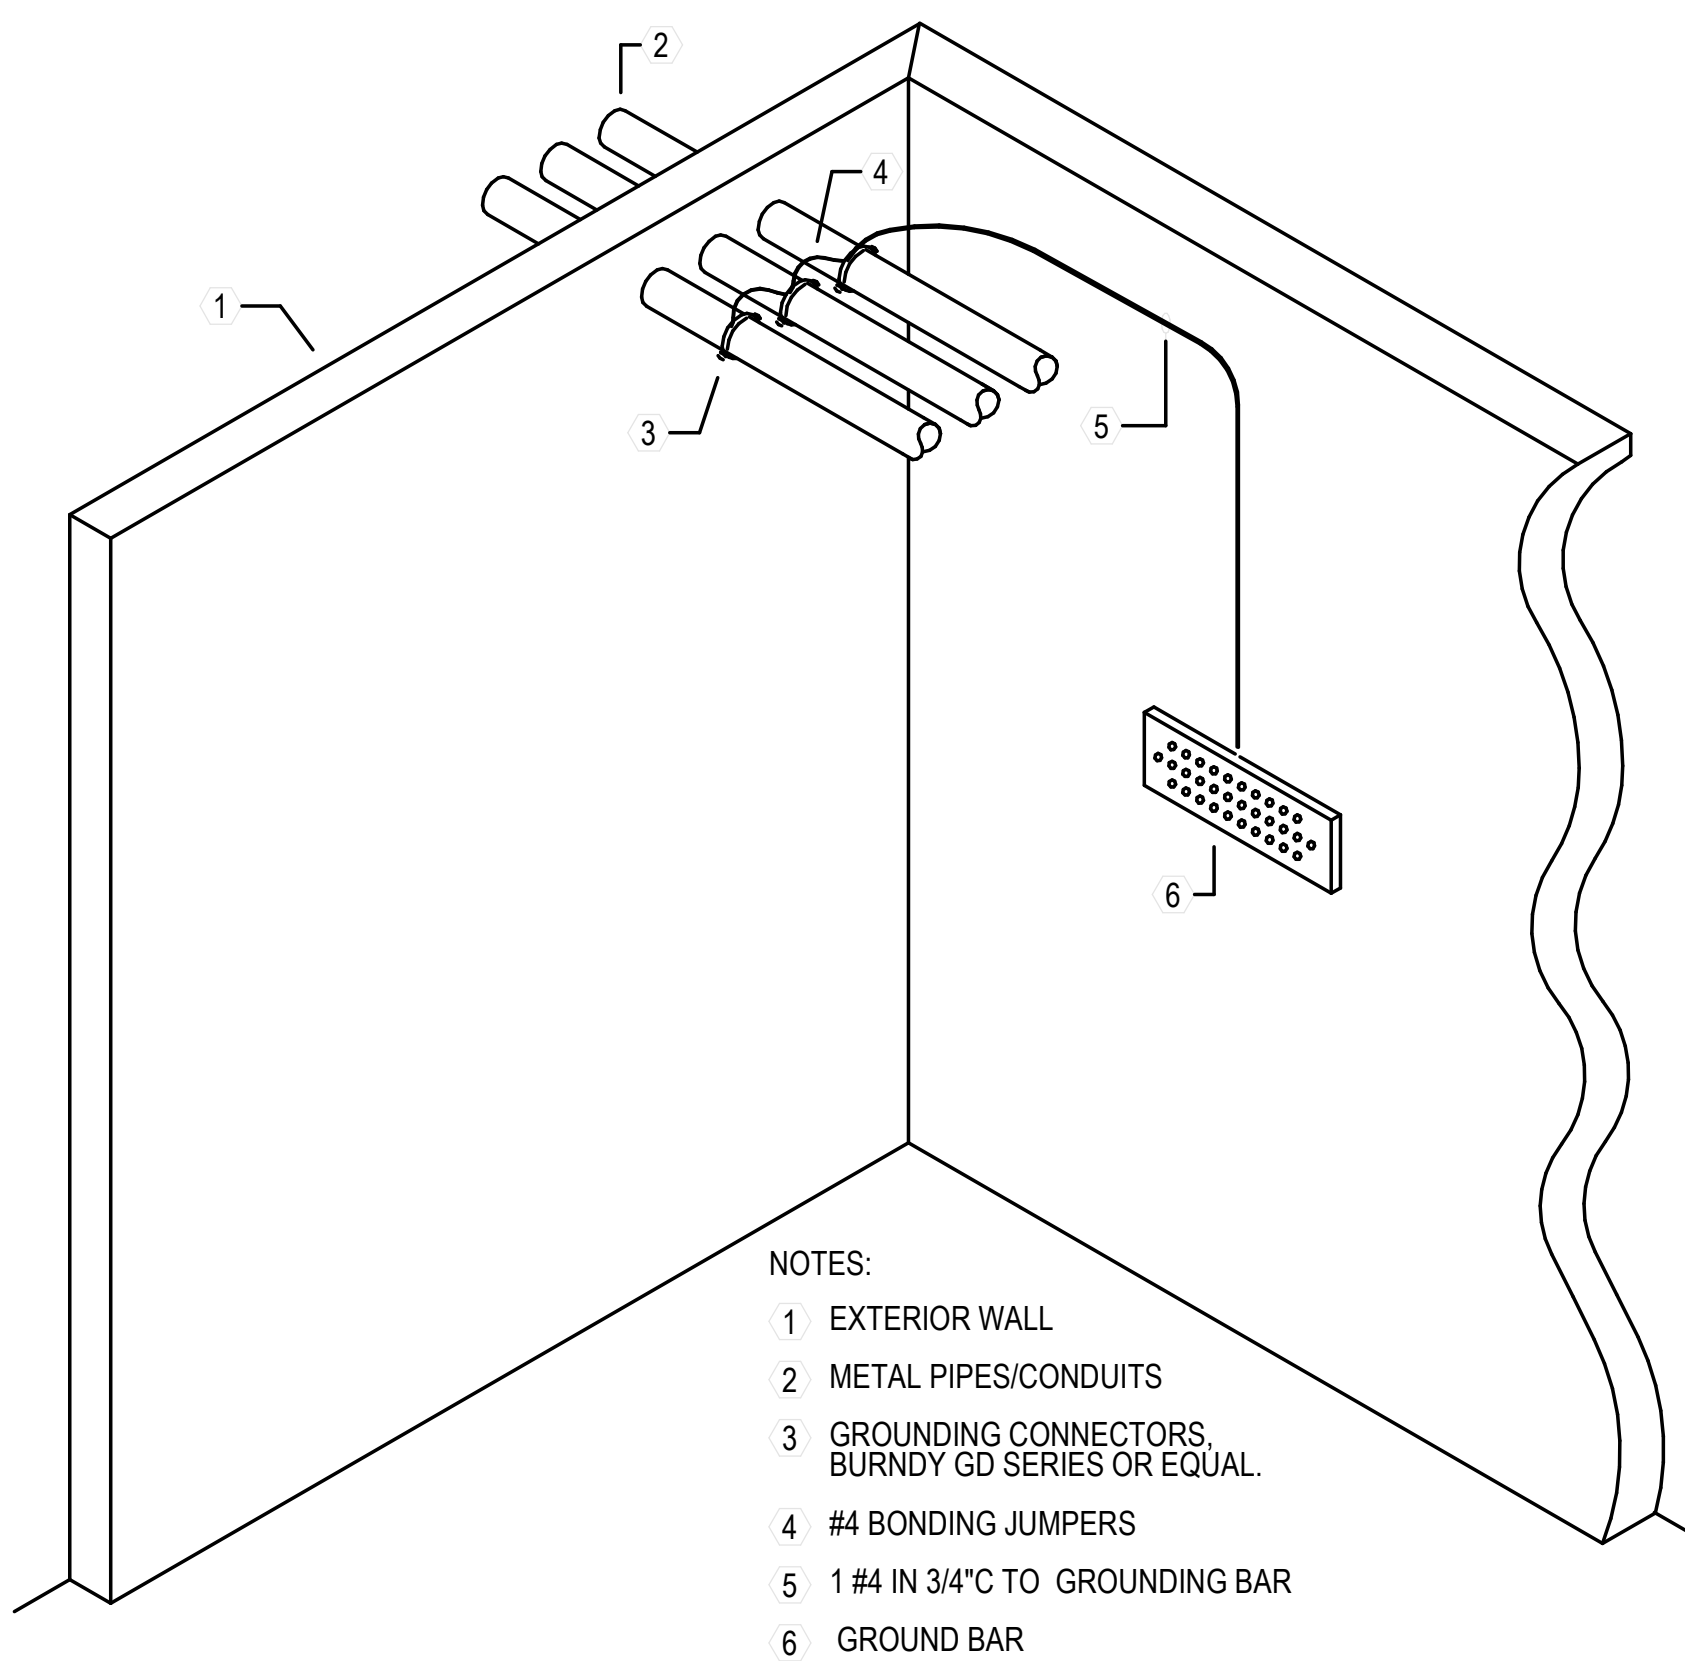

- NOTES:
- EXTERIOR WALL
 - METAL PIPES/CONDUITS
 - GROUNDING CONNECTORS, BURNDY GD SERIES OR EQUAL.
 - #4 BONDING JUMPERS
 - 1 #4 IN 3/4" TO GROUNDING BAR
 - GROUND BAR


3 IT ROOM CONDUIT PENETRATION GROUNDING

SCALE: NONE

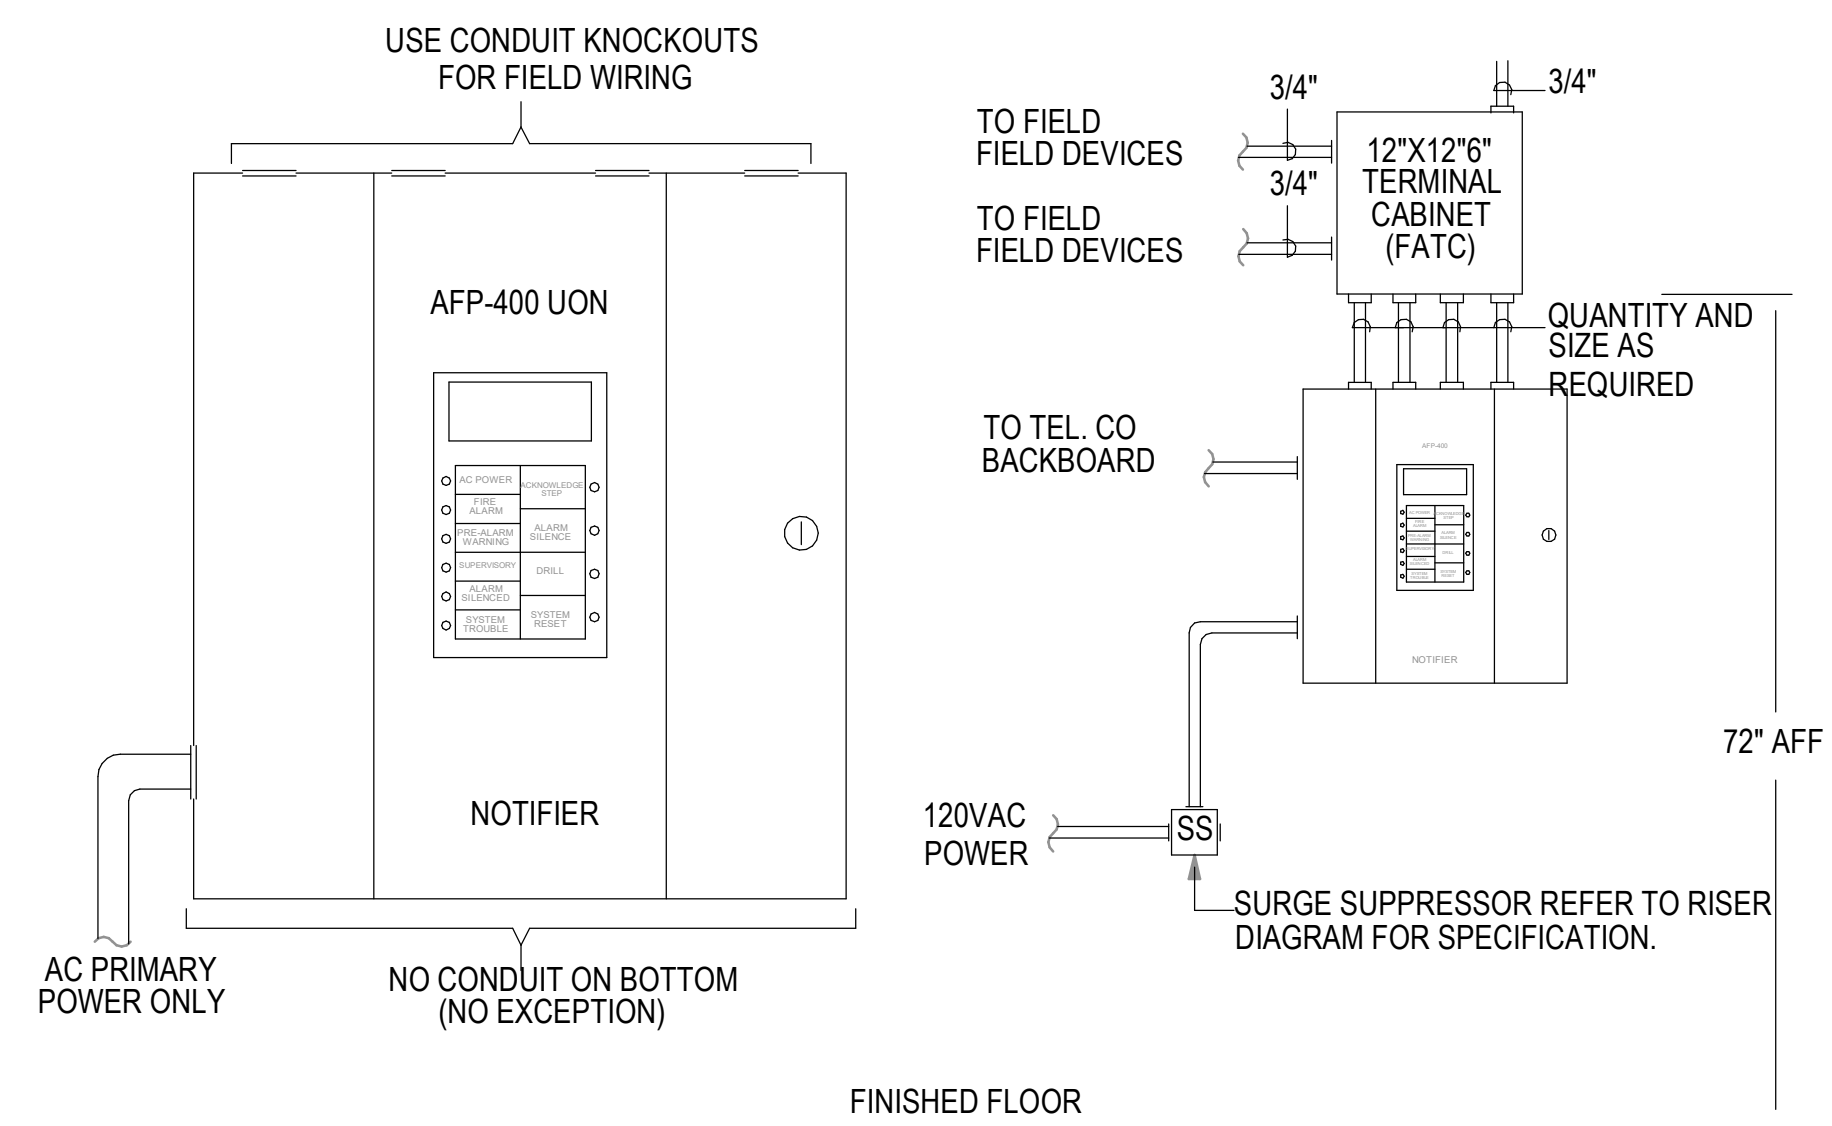

2 FIRE ALARM DEVICE PANEL MOUNTING

SCALE: NONE

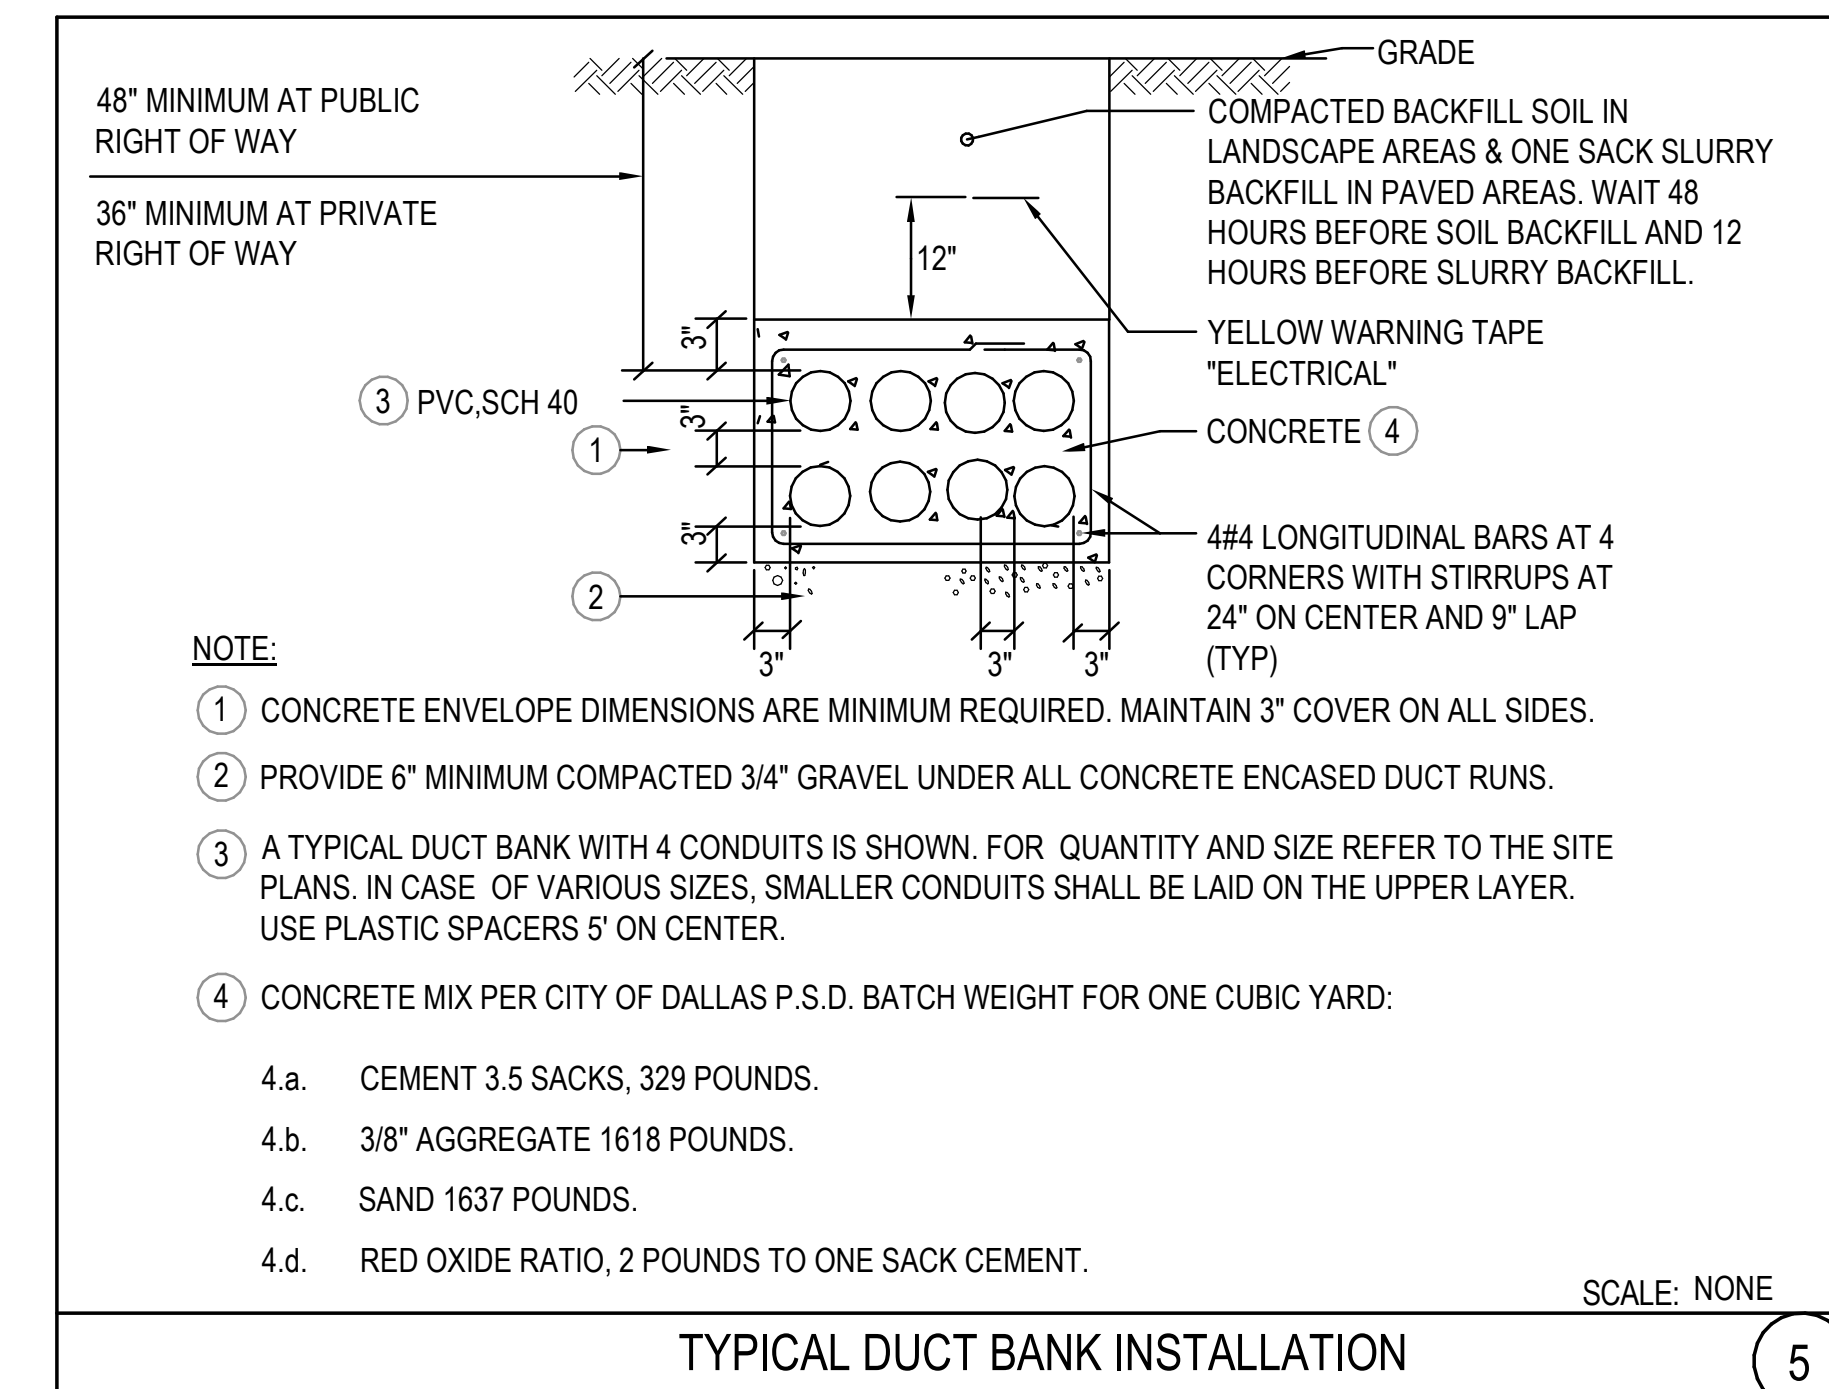

6 TYPICAL DUCT BANK INSTALLATION

SCALE: 12" = 1'-0"

SHEET NOTES

- REFER DRAWING E-501-900C AND E-502-900C FOR ADDITIONAL PROJECT DETAILS.

SHEET KEYNOTES

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PANEL: A-A-102-L-2		LOCATION: ELEC. LEVEL A, SOUTH		VOLTAGE: 120/208 Wye		NEW/EXISTING: 3PH / 4W		New Construction		MAIN: 225 A MCB	
FED FROM: XFMR-T2 - A-A-102-L-1		PHASE / WIRE: 1		BRACING (AMPS):		AVAILABLE FAULT CURRENT:		10kA		BUS RATING: 225 A	
BRANCH:		NEMA: 1								Surface	
CKT NO / CODE	CB TRIP-POLE	LOAD TYPE	A (kVA)	B (kVA)	C (kVA)	LOAD TYPE	CB TRIP-POLE	CKT NO / CODE			
1	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00					2			
3	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00	3.12 / 0.00				4			
5	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00		3.12 / 0.00			6			
9	N 40 A 2	FUTURE EV CHARGING STATION		3.12 / 0.00				8			
11	N 40 A 2	FUTURE EV CHARGING STATION			3.12 / 0.00			10			
13	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00					14			
15	N 40 A 2	FUTURE EV CHARGING STATION		3.12 / 0.00				16			
17	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00		3.12 / 0.00			18			
19	N 40 A 2	FUTURE EV CHARGING STATION						20			
21	N 40 A 2	FUTURE EV CHARGING STATION		3.12 / 0.00				22			
23	N 40 A 2	FUTURE EV CHARGING STATION			3.12 / 0.00			24			
25	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00					26			
27	N 40 A 2	FUTURE EV CHARGING STATION		3.12 / 0.00				28			
29	N 40 A 2	FUTURE EV CHARGING STATION			3.12 / 0.00			30			
31	N 40 A 2	FUTURE EV CHARGING STATION	3.12 / 0.00					32			
33	N 40 A 2	FUTURE EV CHARGING STATION		3.12 / 0.00				34			
35	N 40 A 2	FUTURE EV CHARGING STATION			3.12 / 0.00			36			
37								38			
39								40			
41								42			
			18.72 kVA	18.72 kVA	18.72 kVA						

LOAD CLASSIFICATION	CONNECTED VA / AMPS	DEMAND %	DEMAND VA / AMPS
N	56,160 VA / 156 A	100.00%	56,160 VA / 156 A

LOAD CLASSIFICATIONS - CODE LEGEND
L = LIGHTING R = RECEPTACLE
H = HEATING M = MOTOR
C = CONTINUOUS N = NON-CONTINUOUS
E = ELEVATOR K = KITCHEN

CONNECTED VA / AMPS 56,160 VA / 156 A
DEMAND VA / AMPS 56,160 VA / 156 A

NOTES: 1. ALL SPARE BREAKERS SHALL BE 20A, UNLESS OTHERWISE NOTED.

PANEL: A-DP-A-102		LOCATION: ELEC. LEVEL A, SOUTH		VOLTAGE: 480/277 Wye		NEW/EXISTING: 3PH / 4W		New Construction		MAIN: 800 A MCB		
FED FROM: XFMR-T1 - A-A-102-L-1		PHASE / WIRE: 1		BRACING (AMPS):		AVAILABLE FAULT CURRENT:		65kA		BUS RATING: 1600 A		
BRANCH:		NEMA: 1								Surface		
CKT NO / CODE	CB TRIP-POLE	LOAD TYPE	A (kVA)	B (kVA)	C (kVA)	LOAD TYPE	CB TRIP-POLE	CKT NO / CODE				
1	L 20 A 1	LEVEL 1 LTG SE	1.68 / 0.00			ROADWAY LTG, LOWER	2	20 A	-	2		
3	L 20 A 1	LEVEL 1 LTG NW		1.51 / 0.00				20 A	-	4		
5	L 20 A 1	LEVEL 2 LTG NE			1.72 / 1.20	N ELEV PIT SUMP PUMP	2	20 A	N	6		
7	L 20 A 1	LEVEL 2 LTG SW	1.54 / 1.20			N ELEV PIT LIGHTING	1	20 A	L	10		
9	N 20 A 2	N ELEV PIT SUMP PUMP		1.20 / 0.08				20 A	-	12		
11	N 20 A 1	SPARE	0.00 / 0.00		1.20 / 0.00	SPARE	1	20 A	-	14		
13	N 20 A 1	SPARE		2.88 / 0.00		SPARE	1	20 A	-	16		
15	N 20 A 3	CU A-2-1 AC A-2-1			2.88 / 0.00	SPARE	1	20 A	-	18		
17	N 20 A 3	CU A-2-2 AC A-2-2			2.88 / 0.00	SPARE	1	20 A	-	20		
19	N 20 A 3	CU A-2-3 AC A-2-3			2.88 / 0.00	SPARE	1	20 A	-	22		
21	N 20 A 3	CU A-2-4 AC A-2-4			2.88 / 1.87	UPPER ROADWAY LIGHTING	1	20 A	L	26		
23	N 20 A 1	EUH-A-1		0.62 / 1.54		UPPER ROADWAY LIGHTING	1	20 A	L	28		
25	N 20 A 1	EUH-A-2			0.00 / 1.87	UPPER ROADWAY LIGHTING	1	20 A	L	30		
27	N 20 A 1	SPARE	0.00 / 1.87			UPPER ROADWAY LIGHTING	1	20 A	L	32		
29	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	34		
31	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	36		
33	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	38		
35	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	40		
37	N 20 A 1	SPARE		0.00 / 0.79		SIGNAGE LIGHTING	1	20 A	L	43		
39	N 20 A 1	SPARE		0.00 / 0.22		RING ROAD LIGHTING	1	20 A	L	40		
41	N 20 A 1	SPARE			0.00 / 0.22	RING ROAD LIGHTING	1	20 A	L	42		
43	N 20 A 1	SPARE	0.00 / 0.00			SPARE	1	20 A	-	44		
45	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	46		
47	N 20 A 1	SPARE			0.00 / 0.00	SPARE	1	20 A	-	48		
49	N 20 A 1	SPARE	0.00 / 0.00			SPARE	1	20 A	-	50		
51	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	52		
53	N 20 A 1	SPARE			0.00 / 0.00	SPARE	1	20 A	-	54		
55	N 20 A 1	SPARE	0.00 / 0.00			SPARE	1	20 A	-	56		
57	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	58		
59	N 20 A 1	SPARE			0.00 / 0.00	SPARE	1	20 A	-	60		
61	N 20 A 1	SPARE	0.00 / 0.00			SPARE	1	20 A	-	62		
63	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	64		
65	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	66		
67	N 20 A 1	SPARE	0.00 / 0.00			SPARE	1	20 A	-	68		
69	N 20 A 1	SPARE		0.00 / 0.00		SPARE	1	20 A	-	70		
71	N 20 A 1	SPARE			0.00 / 0.00	SPARE	1	20 A	-	72		
73	N 20 A 1	SPARE	0.00 / 18.72			SPARE	1	20 A	-	74		
75	N 20 A 1	SPARE		0.00 / 18.72		XFMR - T2-A-107-H-1 (45KVA)	3	70 A	N	76		
77	N 20 A 1	SPARE			0.00 / 18.72	SPARE	1	20 A	-	78		
79	Spa		14.71 / 0.00			SPARE	1	20 A	-	80		
81	Rec	125 A 3	XFMR - T1-A-100-H-1		11.07 / 0.00	SPARE	1	20 A	-	82		
83	Rec			48.14 kVA	40.72 kVA	42.20 kVA		1	20 A	-	84	

LOAD CLASSIFICATION	CONNECTED VA / AMPS	DEMAND %	DEMAND VA / AMPS
C	4,460 VA / 5 A	125.00%	5,575 VA / 7 A
L	14,901 VA / 18 A	125.00%	18,626 VA / 22 A
N	79,480 VA / 96 A	100.00%	79,480 VA / 96 A
Power	0 VA / 0 A	0.00%	0 VA / 0 A
R	28,800 VA / 35 A	67.26%	19,400 VA / 23 A
Receptacle	3,420 VA / 4 A	100.00%	3,420 VA / 4 A

LOAD CLASSIFICATIONS - CODE LEGEND
L = LIGHTING R = RECEPTACLE
H = HEATING M = MOTOR
C = CONTINUOUS N = NON-CONTINUOUS
E = ELEVATOR K = KITCHEN

CONNECTED VA / AMPS 131,061 VA / 158 A
DEMAND VA / AMPS 126,501 VA / 152 A

NOTES: 1. ALL SPARE BREAKERS SHALL BE 20A, UNLESS OTHERWISE NOTED.
2. PROVIDE MAIN BREAKER WITH ELECTRONIC TRIP UNIT 1600AF/800AT LSI.

PANEL: A-A-102-L-1		LOCATION: ELEC. LEVEL A, SOUTH		VOLTAGE: 120/208 Wye		NEW/EXISTING: 3PH / 4W		New Construction		MAIN: 225 A MCB	
FED FROM: XFMR-T1 - A-A-102-L-1		PHASE / WIRE: 1		BRACING (AMPS):		AVAILABLE FAULT CURRENT:		10kA		BUS RATING: 225 A	
BRANCH:		NEMA: 1								Surface	
CKT NO / CODE	CB TRIP-POLE	LOAD TYPE	A (kVA)	B (kVA)	C (kVA)	LOAD TYPE	CB TRIP-POLE	CKT NO / CODE			
1	N 20 A 2	EF-A-1-2		0.31 / 0.00		RECEPT LEVEL 1	1	20 A	-	2	
3	N 20 A 2	EF-A-1-2			0.31 / 0.00	RECEPT LEVEL 2	1	20 A	-	4	
5	C 20 A 1	WAYFINDER LEVEL A			1.26 / 0.00			20 A	-	6	
7	C 20 A 1	WAYFINDER LEVEL A	0.72 / 0.18			CONTROL ROOM RECEPT	1	20 A	Rec.	8	
9	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A SE		0.72 / 0.00			20 A	-	10	
11	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A NE		0.72 / 0.00			20 A	-	12	
13	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A N	1.26 / 0.00				20 A	-	14	
15	C 20 A 1	WAYFINDER LEVEL B		0.72 / 0.00				20 A	-	16	
17	C 20 A 1	WAYFINDER LEVEL B			0.54 / 0.00			20 A	-	18	
19	C 20 A 1	WAYFINDER LEVEL B	0.72 / 0.00					20 A	-	20	
21	Rec.	20 A 1	RECEPTACLE		0.18 / 0.00			20 A	-	22	
23	Rec.	20 A 1	N. ELEV PIT RECEPT		0.36 / 0.00			20 A	-	24	
25				2.88 / 0.00						26	
27	R 60 A 3	A-B-100-L-1		2.88 / 0.00						28	
29					2.88 / 0.00					30	
31				5.76 / 0.00						32	
33	R C 60 A 3	A-B-211-L-1		3.38 / 0.00						34	
35					2.88 / 0.00					36	
37				2.88 / 0.00						38	
39	R 60 A 3	A-B-207-L-1		2.88 / 0.00						40	
41					2.88 / 0.00					42	
			14.71 kVA	11.07 kVA	11.52 kVA						


LOAD CLASSIFICATION	CONNECTED VA / AMPS	DEMAND %	DEMAND VA / AMPS
C	4,460 VA / 5 A	125.00%	5,575 VA / 7 A
N	624 VA / 2 A	100.00%	624 VA / 2 A
R	28,800 VA / 35 A	67.26%	19,400 VA / 23 A
Receptacle	3,420 VA / 4 A	100.00%	3,420 VA / 4 A

LOAD CLASSIFICATIONS - CODE LEGEND
L = LIGHTING R = RECEPTACLE
H = HEATING M = MOTOR
C = CONTINUOUS N = NON-CONTINUOUS
E = ELEVATOR K = KITCHEN

CONNECTED VA / AMPS 37,304 VA / 104 A
DEMAND VA / AMPS 29,919 VA / 81 A


NOTES: 1. ALL SPARE BREAKERS SHALL BE 20A, UNLESS OTHERWISE NOTED.

PANEL: A-A-100-L-1		LOCATION: ELEC. LEVEL A, NORTH		VOLTAGE: 120/208 Wye		NEW/EXISTING: 3PH / 4W		New Construction		MAIN: 225 A MCB	
FED FROM: XFMR-T1 - A-A-100-L-1		PHASE / WIRE: 1		BRACING (AMPS):		AVAILABLE FAULT CURRENT:		10kA		BUS RATING: 225 A	
BRANCH:		NEMA: 1								Surface	
CKT NO / CODE	CB TRIP-POLE	LOAD TYPE	A (kVA)	B (kVA)	C (kVA)	LOAD TYPE	CB TRIP-POLE	CKT NO / CODE			
1	N 20 A 2	EF-A-1-2		3.96 / 0.00		RECEPT LEVEL 1	1	20 A	-	2	
3	R 60 A 3	A-B-200-L-2		2.88 / 0.00		RECEPT LEVEL 2	1	20 A	-	4	
5										6	
7	R 60 A 3	A-B-207-L-2	3.96 / 0.18			CONTROL ROOM RECEPT	1	20 A	Rec.	8	
9				2.88 / 0.72		WAYFINDER LEVEL B	1	20 A	C	10	
11					2.88 / 0.72	WAYFINDER LEVEL B	1	20 A	C	12	
13			5.76 / 0.00							14	
15	R 60 A 3	A-B-211-L-2		3.96 / 0.00		EF-A-1-2	2	20 A	N	16	
17					2.88 / 0.00					18	
19	C 20 A 1	FIRE ALARM PANEL	0.50 / 0.00					20 A	-	20	
21	R 20 A 1	ELEC ROOM CONV RECEPT		0.72 / 0.00				20 A	-	22	
23	N 20 A 2	EF-A-1-1		0.31 / 0.00				20 A	-	24	
25										26	
27	C 20 A 1	WAYFINDER LEVEL A		0.72 / 0.00				20 A	-	28	
29	C 20 A 1	WAYFINDER LEVEL A			0.72 / 0.00			20 A	-	30	
31	C 20 A 1	WAYFINDER LEVEL A	0.72 / 0.00					20 A	-	32	
33	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A SW		0.36 / 0.00			20 A	-	34	
35	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A NW		0.72 / 0.00			20 A	-	36	
37	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A NN	0.72 / 0.00				20 A	-	38	
39	Rec.	20 A 1	STARCASE CONV RECEPT LEVEL A SW		0.72 / 0.00			20 A	-	40	
41	C 20 A 1	WAYFINDER LEVEL B			0.72 / 0.00			20 A	-	42	
			16.11 kVA	12							

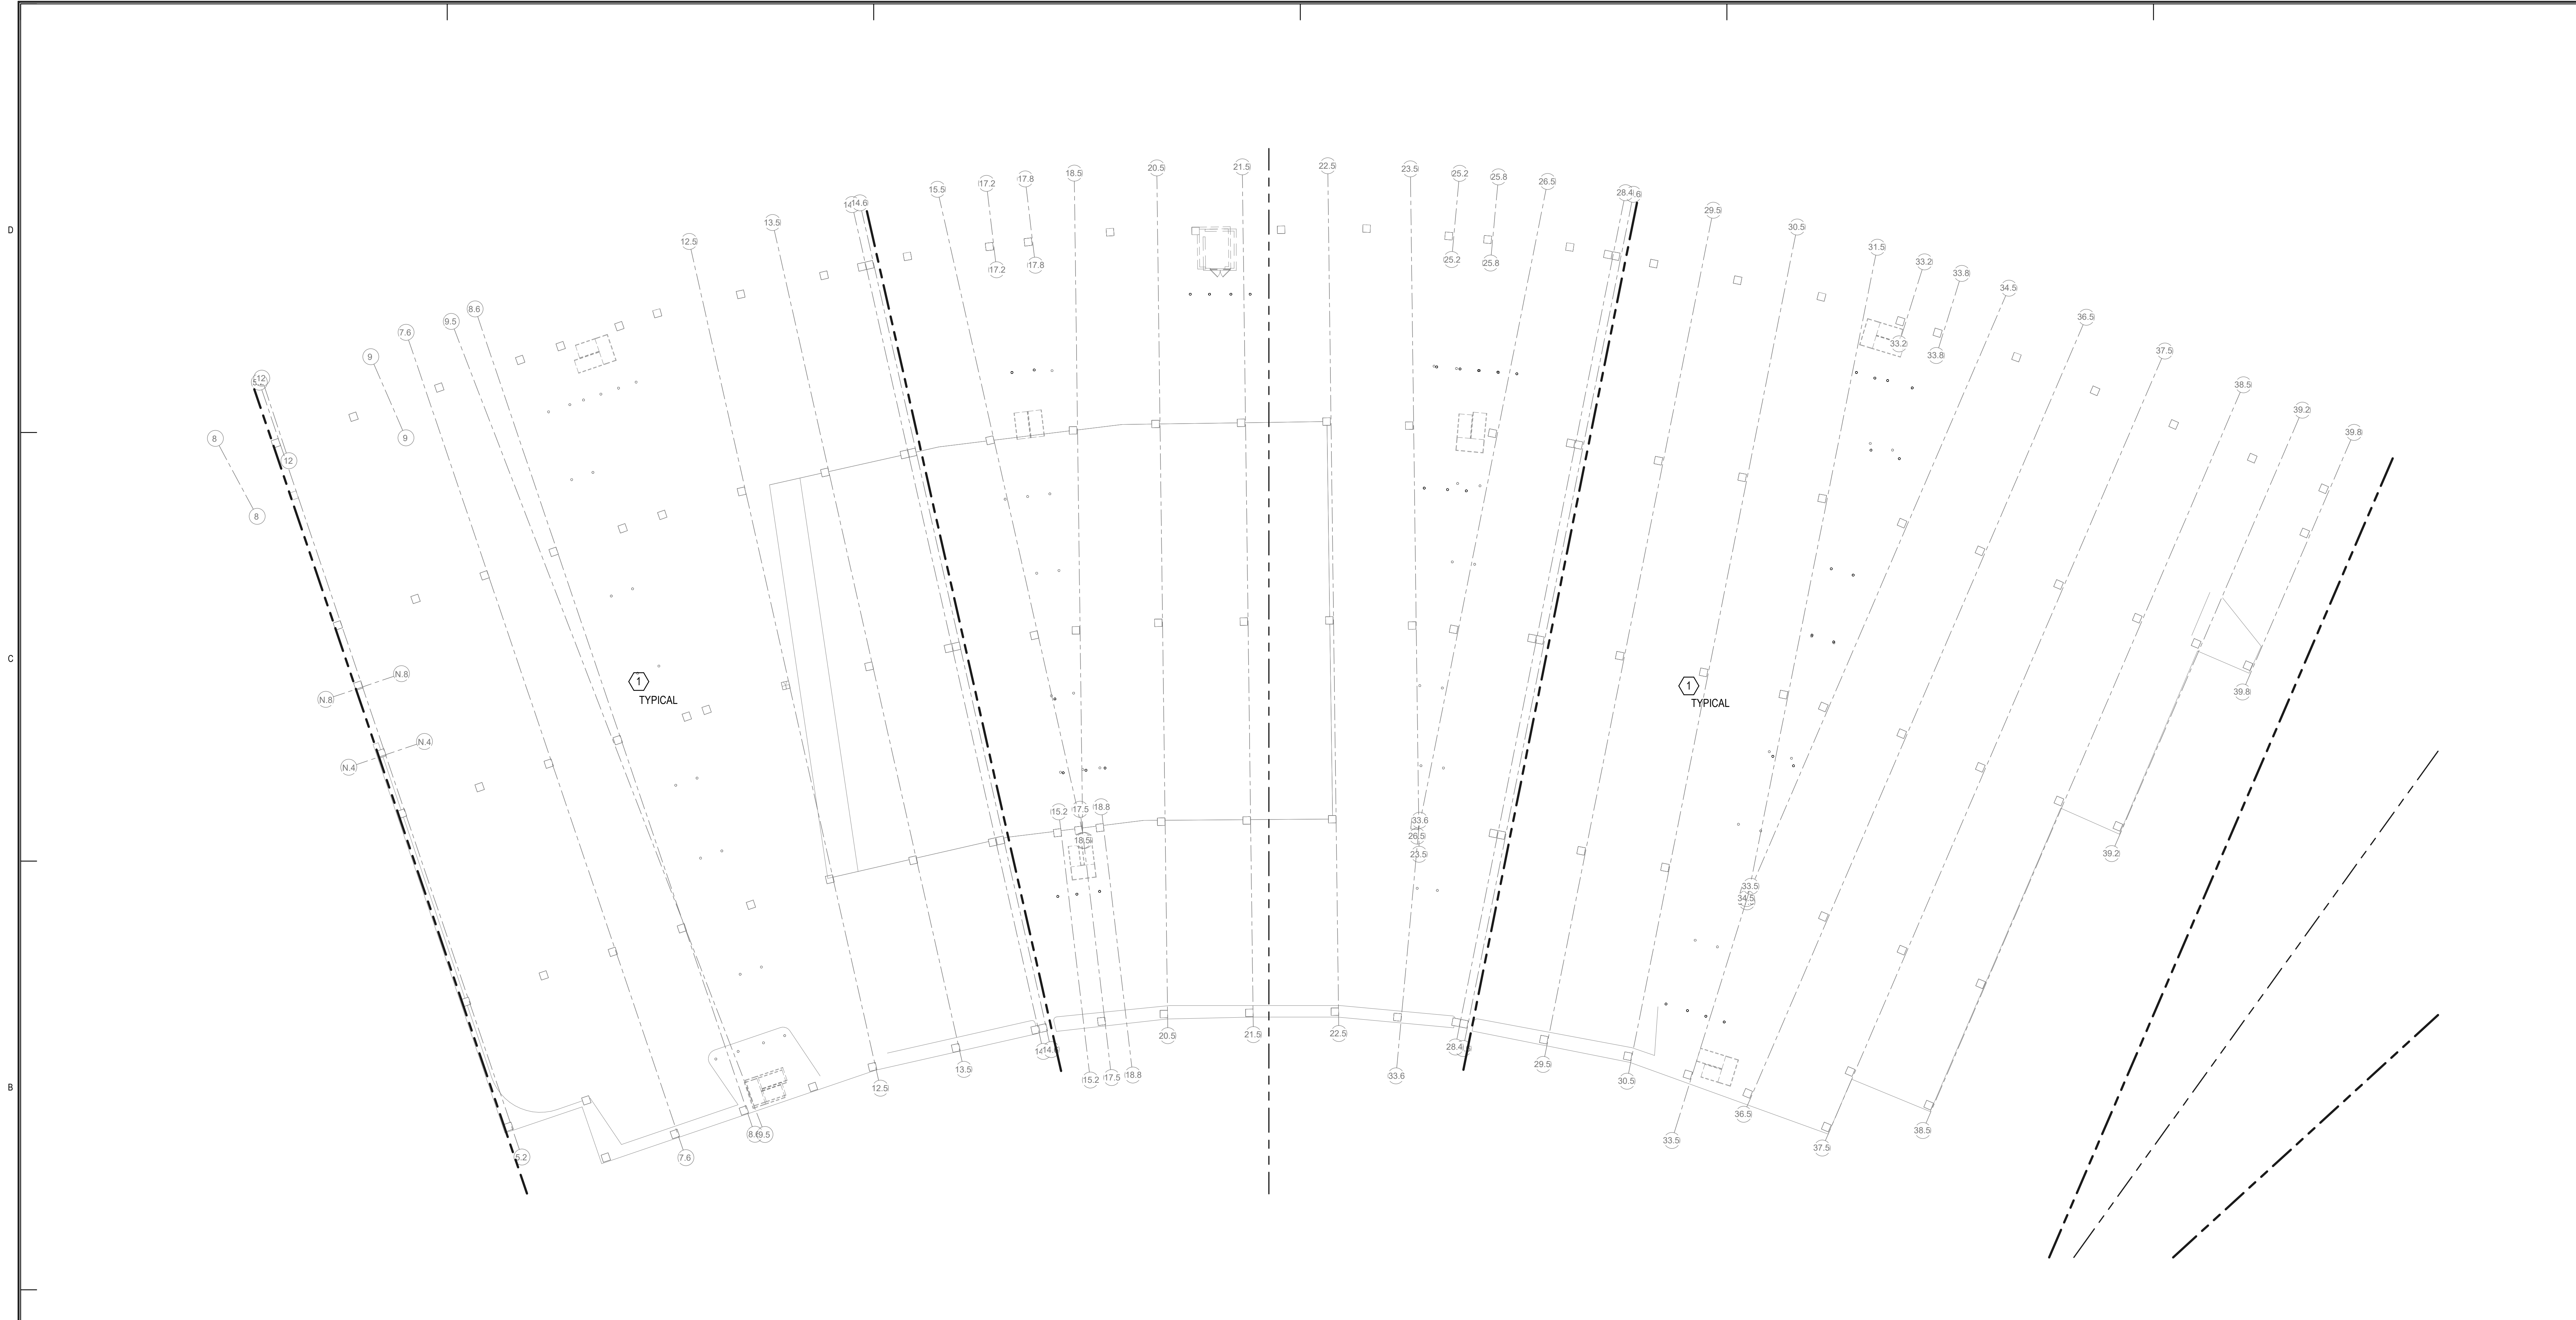


- SHEET NOTES**
- REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
 - REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
 - WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
 - REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
 - DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
 - WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
 - COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
 - WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
 - REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

- SHEET KEYNOTES**
- UNLESS NOTED OTHERWISE, EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS (NOT SHOWN) SHALL BE REMOVED. REFER TO NOTES AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

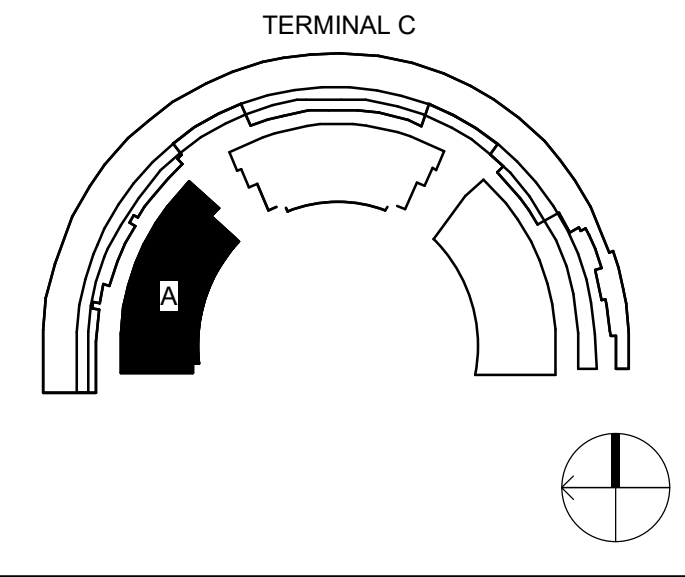

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

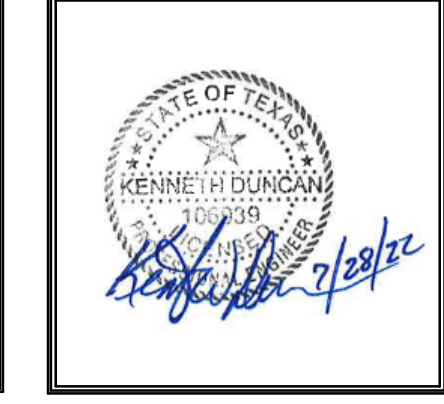

h+k SYSKA HENNESSY GROUP
 A member company of SH Group, Inc.
 4925 Greenville Avenue
 Suite 415
 Dallas, TX 75206
 Tel: 972.470.0704
 www.syska.com

DRAWN BY: SHG
 APPROVED BY: WH
 ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

Garage A
GARAGE A LIGHTING DEMOLITION PLAN - LEVEL B - PHASE 3
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
EL102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

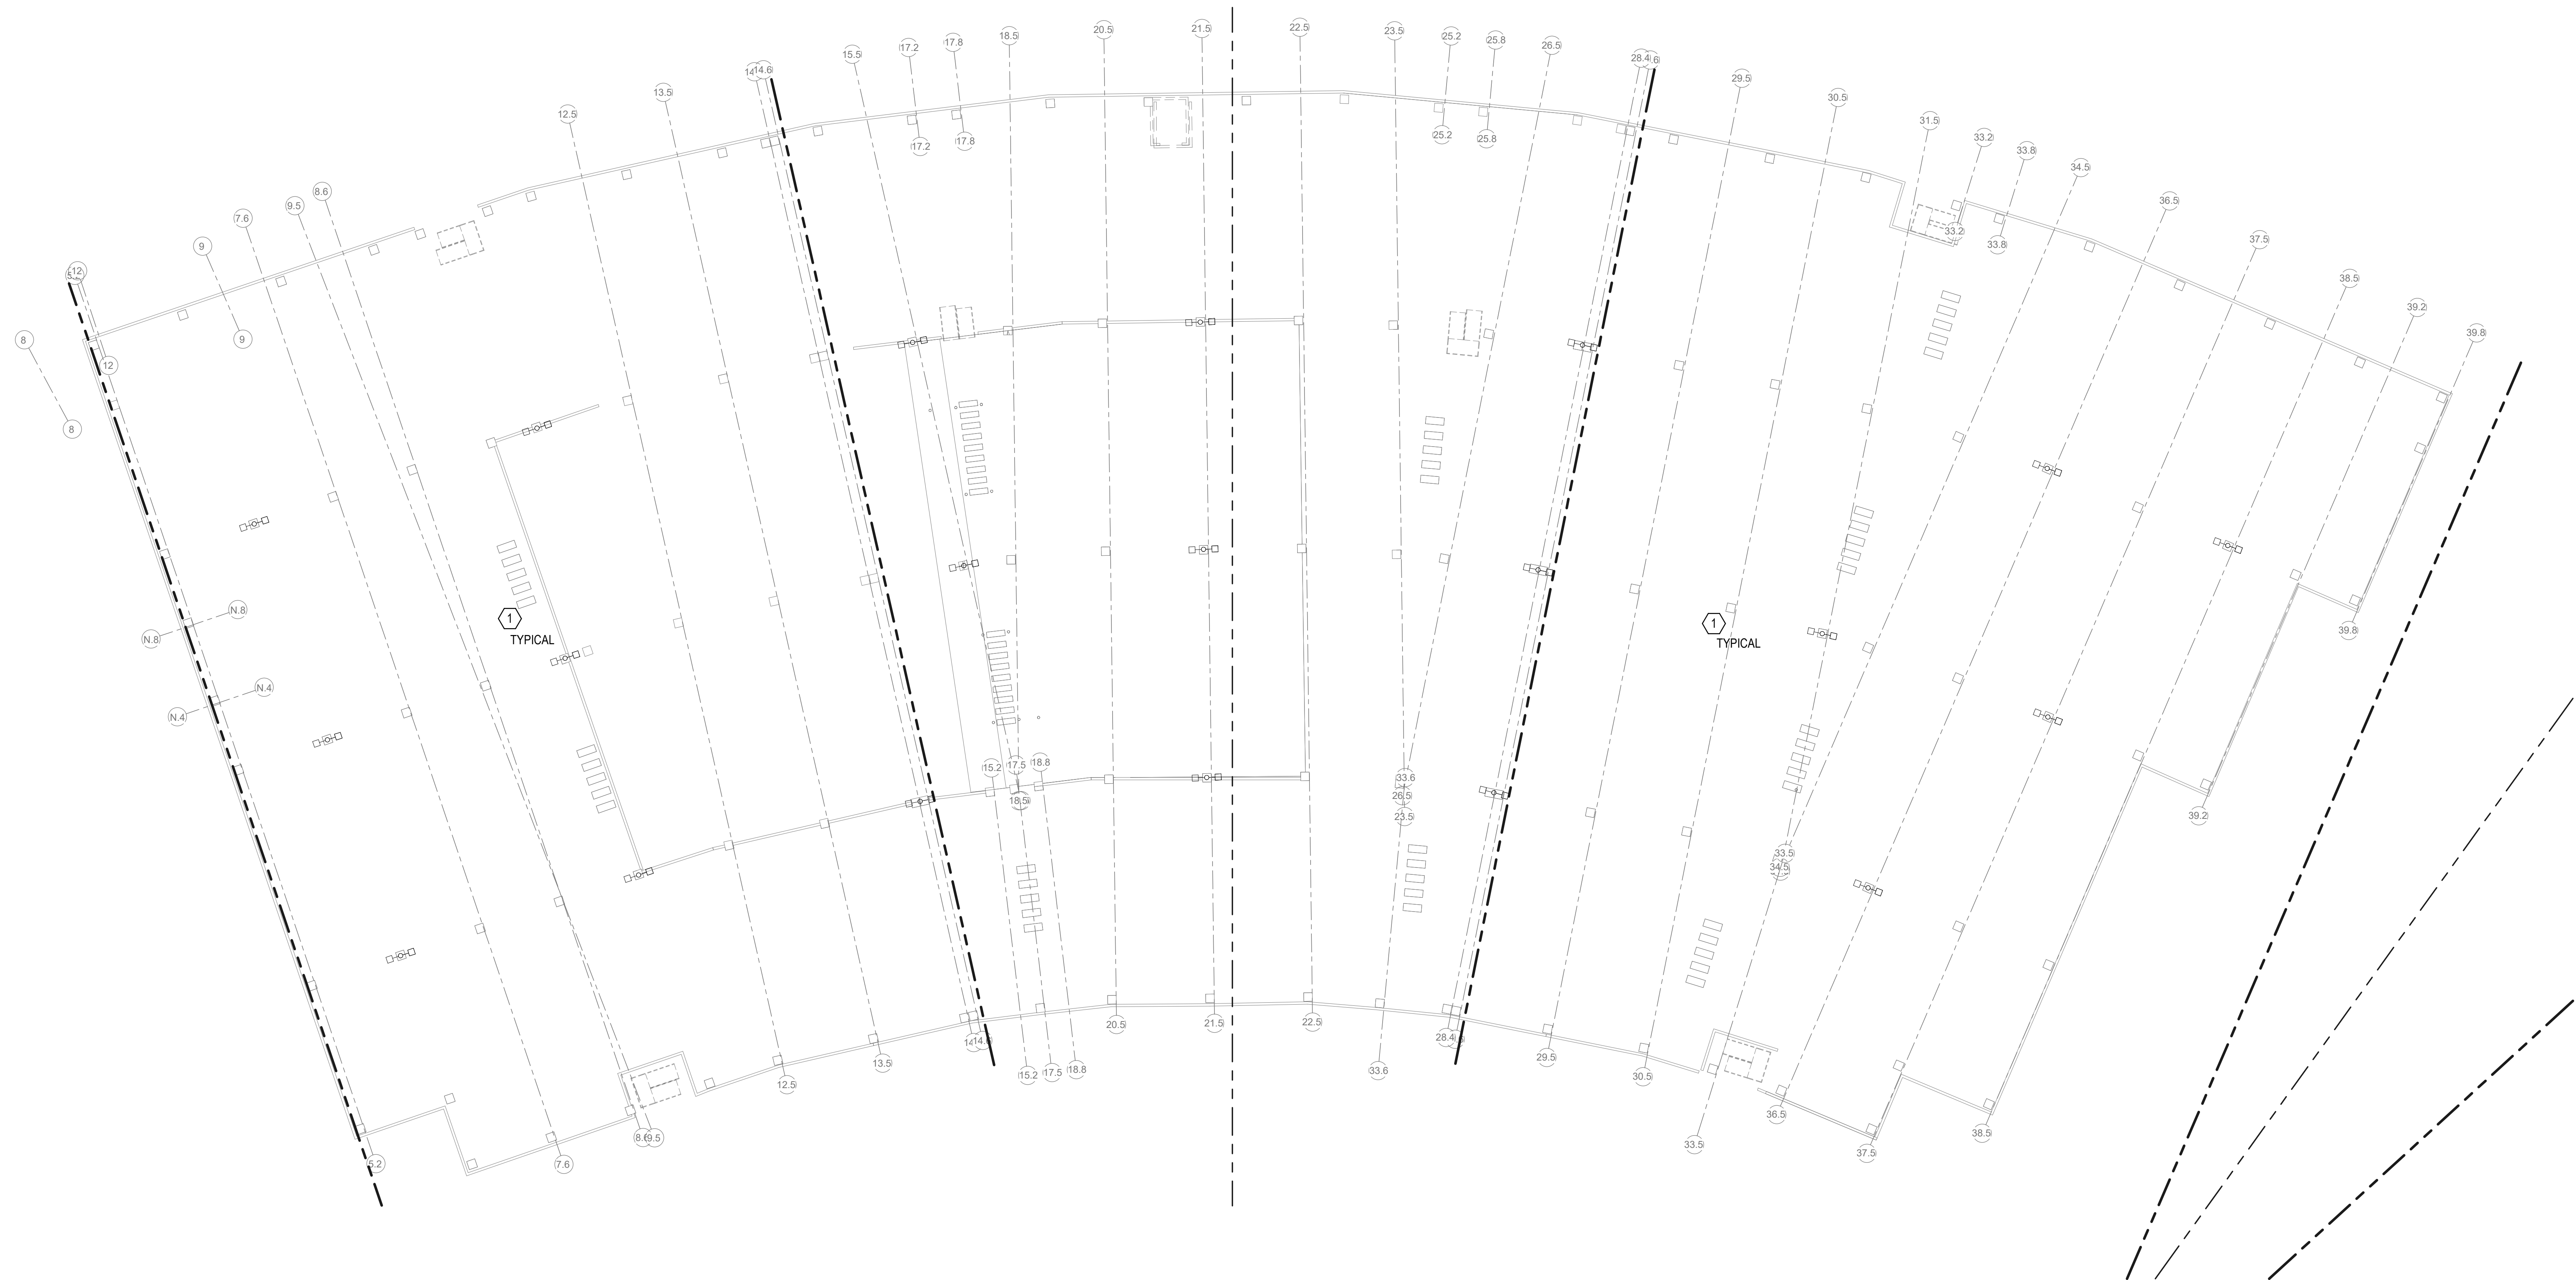


SHEET NOTES

1. REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
2. REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
3. WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
4. REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
5. DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
6. WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
7. COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
8. WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
9. REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

SHEET KEYNOTES

1. UNLESS NOTED OTHERWISE, EXISTING GARAGE LIGHTING FIXTURES AND EXIT SIGNS (NOT SHOWN) SHALL BE REMOVED. REFER TO NOTES AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

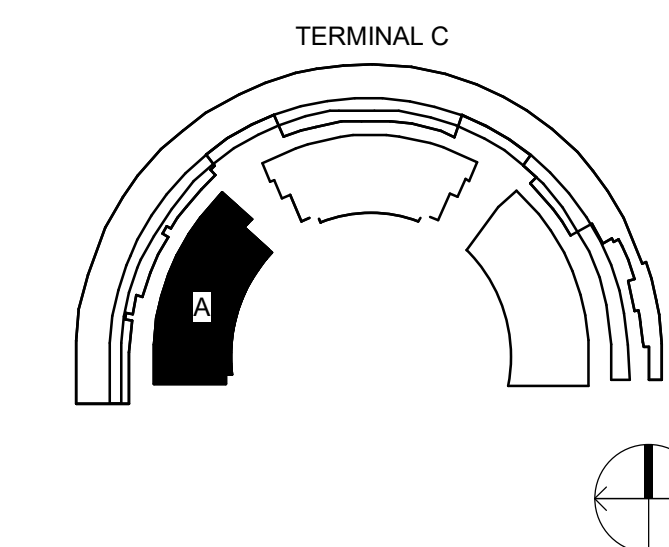

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

Garage A
GARAGE A LIGHTING DEMOLITION PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EL104-900A

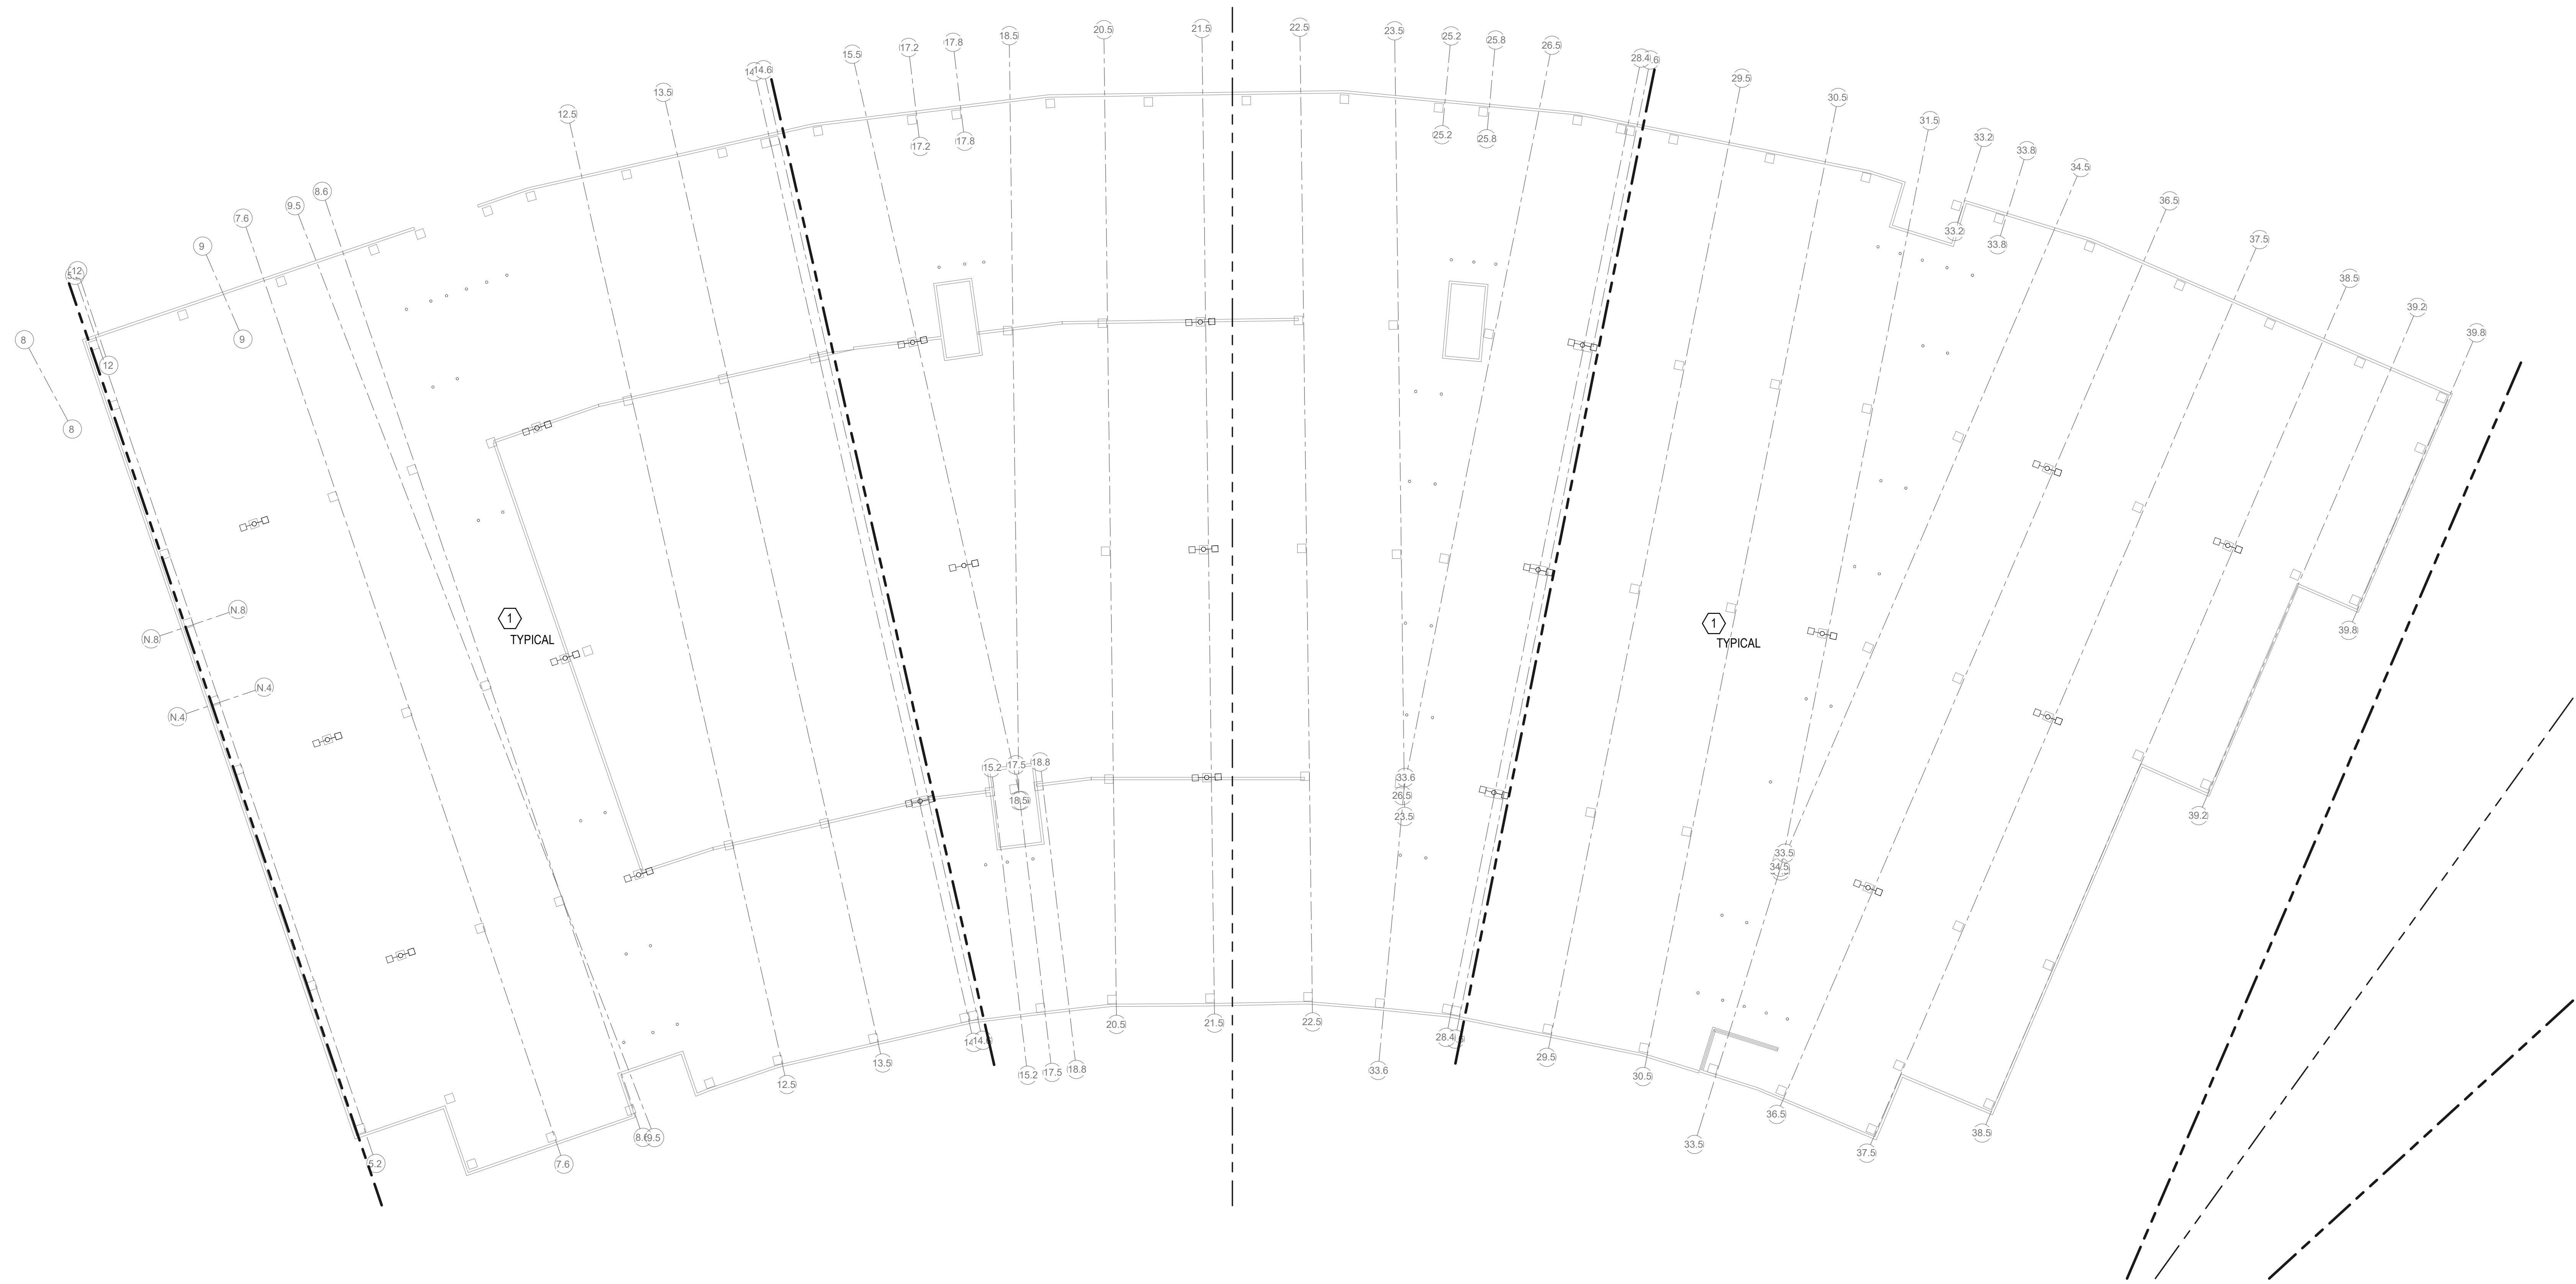


SHEET NOTES

1. REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
2. REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
3. WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
4. REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
5. DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
6. WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
7. COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
8. WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
9. REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

SHEET KEYNOTES

1. UNLESS NOTED OTHERWISE, EXISTING LIGHTING FIXTURES (INCLUDING LIGHT POLES AS APPLICABLE) SHALL BE REMOVED. REFER TO SHEET NOTED AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

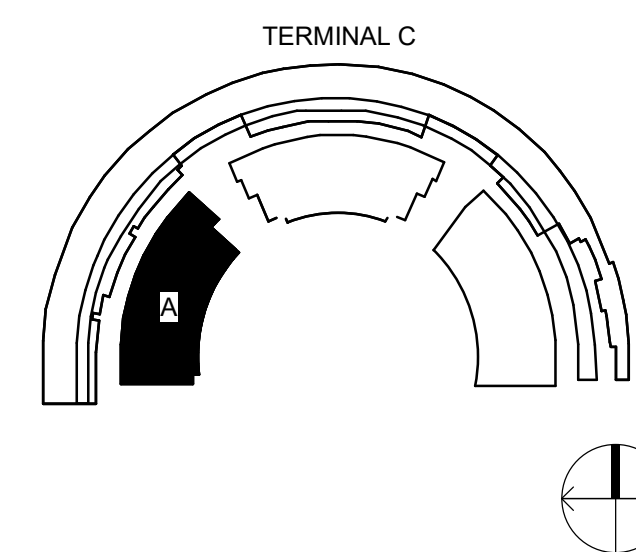

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

HENNESSY, Clark & Kesteven, Inc.
777 North Meadows Drive
Suite 200, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

Garage A
GARAGE A LIGHTING DEMOLITION PLAN - LEVEL E - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EL105-900A

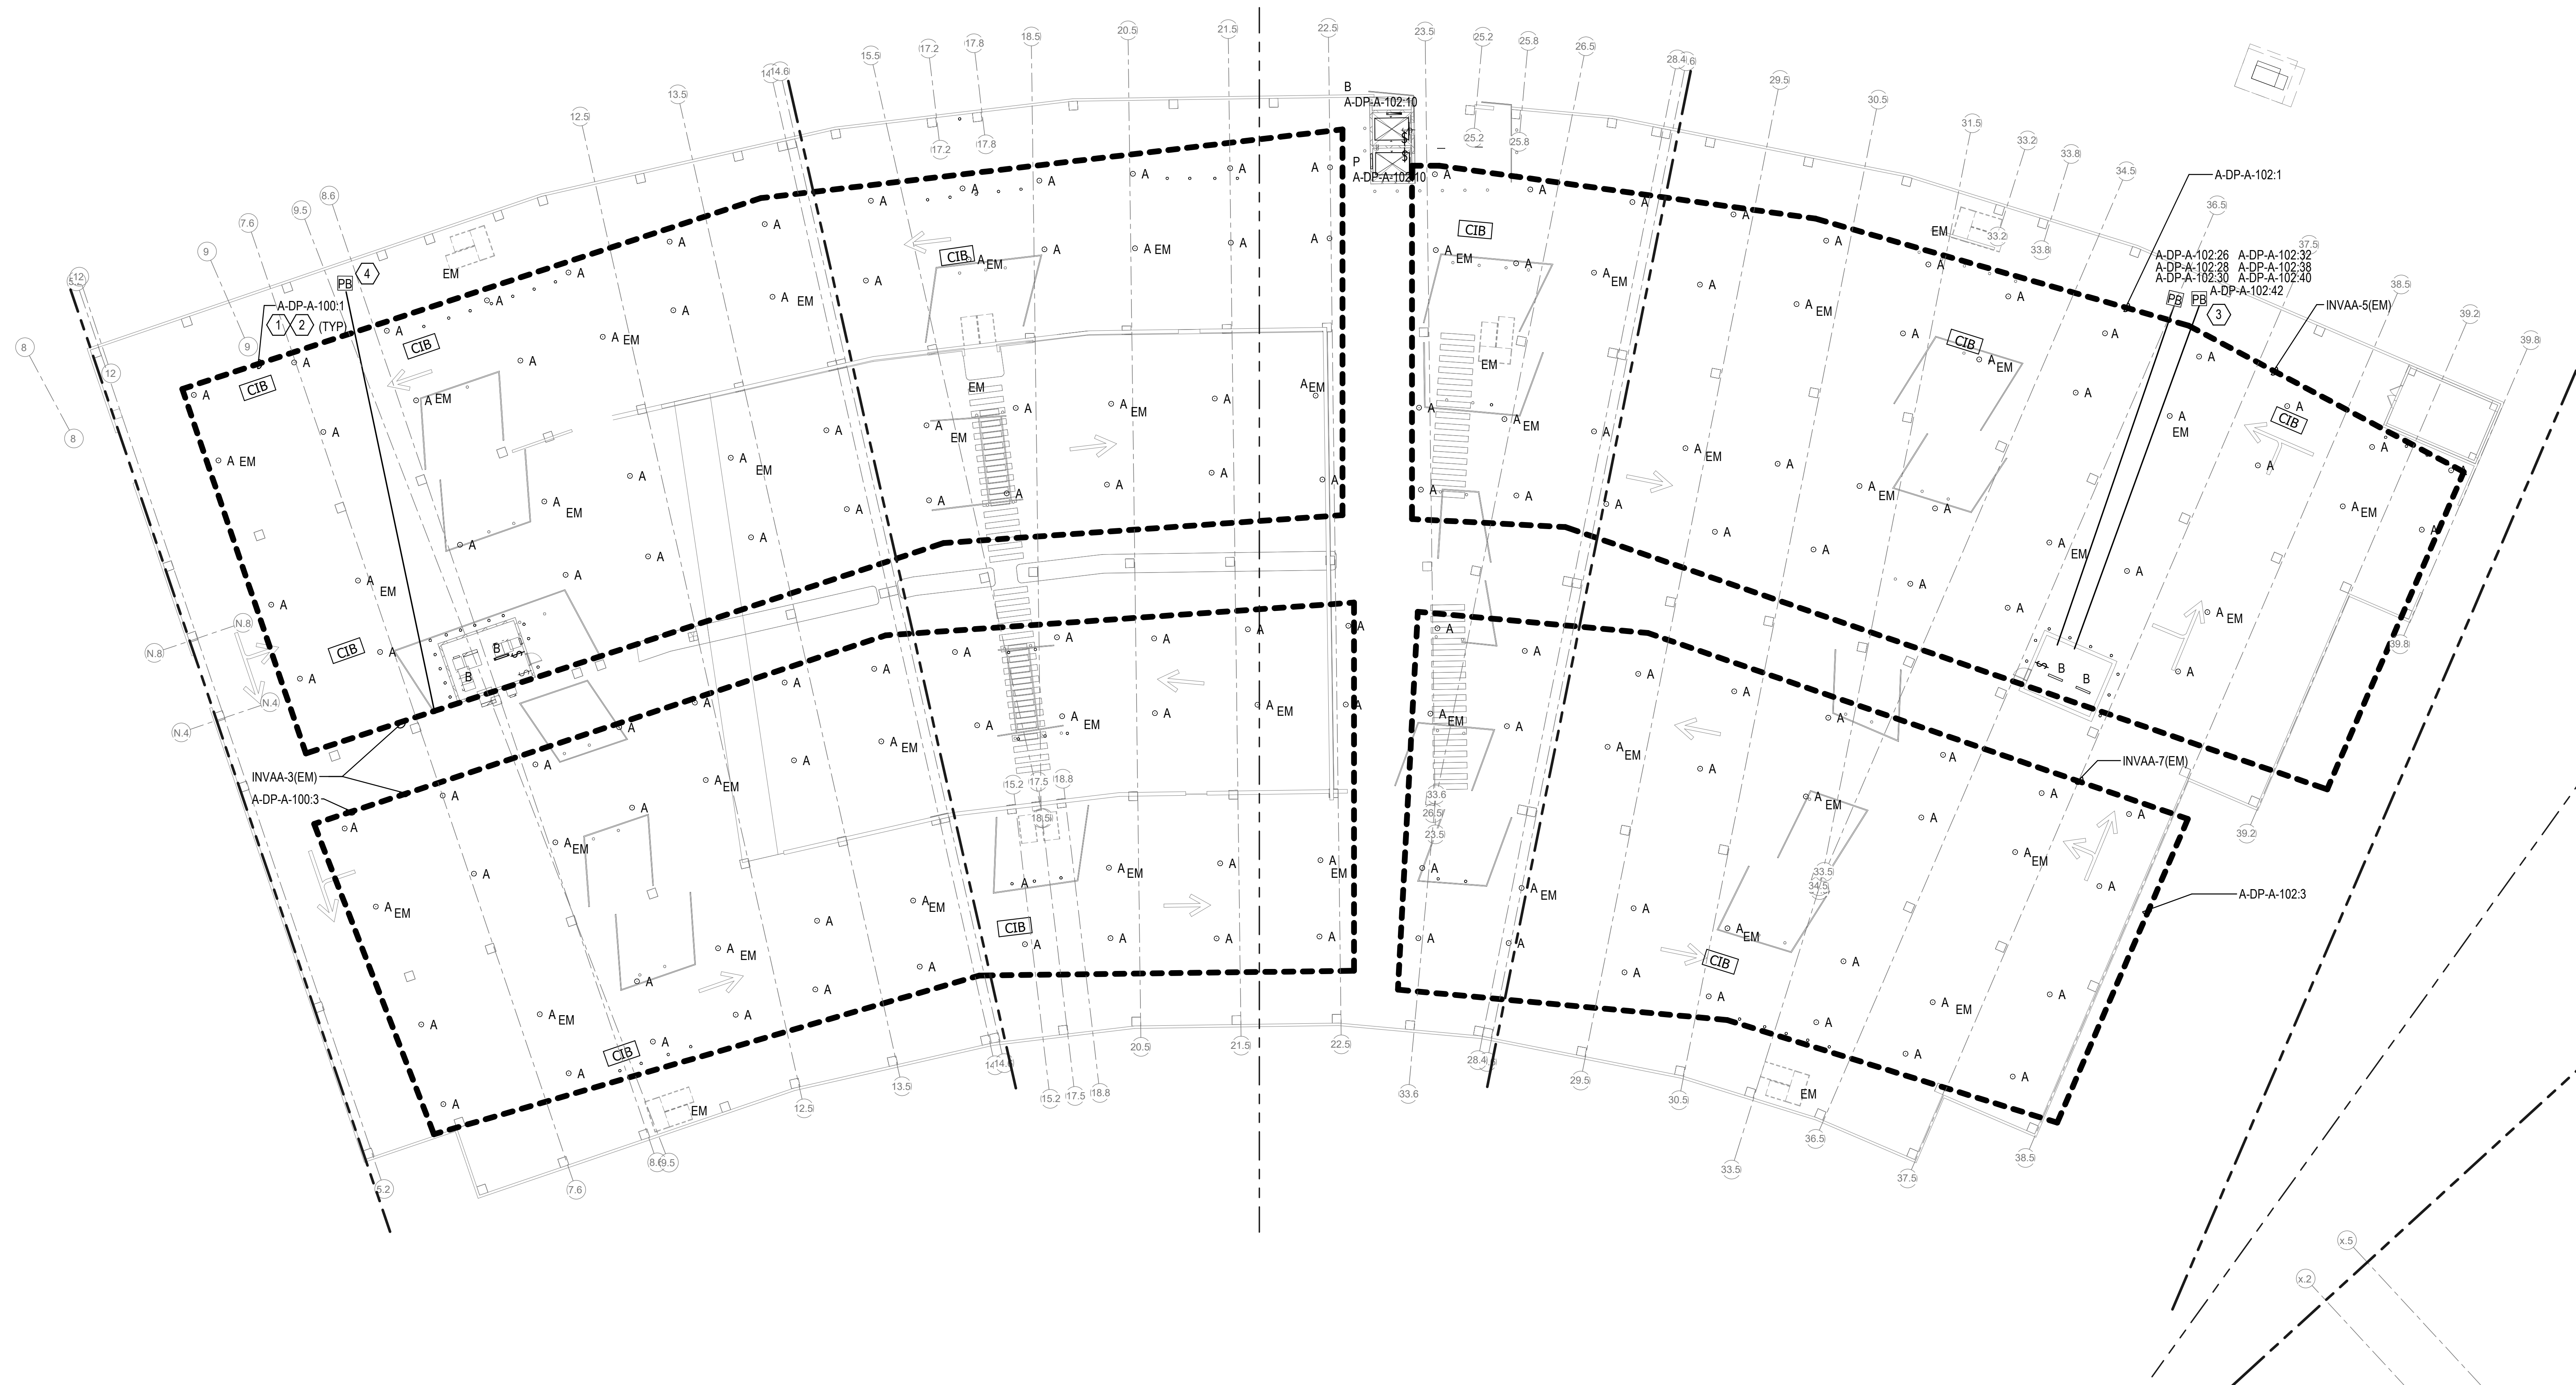


SHEET NOTES

1. REFER TO DRAWINGS E-001 FOR LEGEND, ABBREVIATIONS, GENERAL NOTES. REFER TO DRAWING E-00-900C FOR LIGHT FIXTURE SCHEDULE.
2. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH, AND SECURITY REQUIREMENTS.
3. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
4. MINIMUM LIGHTING CIRCUIT SIZE SHALL BE 2#10,#10G-3/4" UNLESS NOTED OTHERWISE.
5. SITE COORDINATE FINAL WORK LOCATIONS OF SWITCHES AND JUNCTION BOXES WITH WALL TREATMENT AND SURFACES. PRIOR TO ROUGH-IN.
6. REFERENCE SHEET E-601-604 FOR PANEL SCHEDULES.
7. REFERENCE SHEET E-002 FOR SINGLE-LINE DIAGRAM.
8. ALL EXIT LIGHTS SHALL BE UN-SWITCHED. ALL EMERGENCY FIXTURES SHALL BE UNSWITCHED.
9. FIXTURES WITH EMERGENCY BATTERY PACKS SHALL BE SWITCHED WITH NORMAL FIXTURES IN ZONE. UPON LOSS OF POWER FIXTURE SHALL ILLUMINATE.
10. ALL VACANCY SENSORS SHALL BE SET AS MANUAL ON/AUTO OFF EXCEPT FOR SWITCHES CONTROLLING RESTROOMS AND CORRIDORS.
11. UNLESS NOTED OTHERWISE, THE SWITCH SHOWN IN A ROOM/AREA SHALL CONTROL ALL LIGHT FIXTURES IN THE ROOM/AREA.

SHEET KEYNOTES

1. ZONE BLOCK DESIGNATES CIRCUIT NUMBER FOR ALL LIGHTING FIXTURES WITHIN. UNO. FIXTURES WITH "EM" DESIGNATION TO BE POWERED VIA INVERTER CIRCUIT.
2. ALL GARAGE FIXTURES SHALL FEATURE INTEGRAL SENSORS FOR LIGHTING CONTROL.
3. PULL BOXES FOR ROADWAY LIGHTING CIRCUITS PER ROADWAY LIGHTING PLAN 1/ES105-900R. PROVIDE CIRCUITS A-DP-A-107, 26, 28, 30, 32, 38, 40 AND 42. REFER PANEL SCHEDULES.
4. PULLBOX FOR ROADWAY EMERGENCY (EM) LIGHTING CIRCUITS. PROVIDE CIRCUITS INVAA-2. REFER PANEL SCHEDULES.

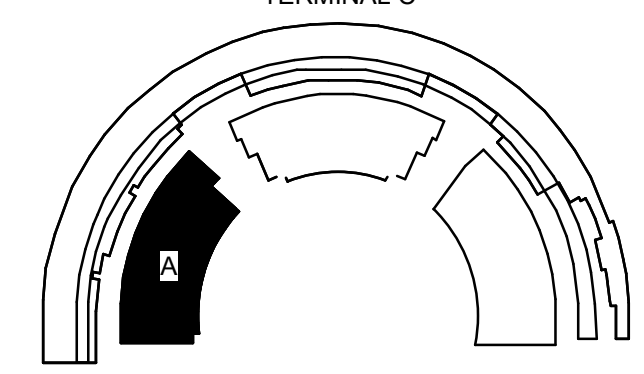

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


Garage A

GARAGE A LIGHTING PLAN - LEVEL A - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EL201-900A

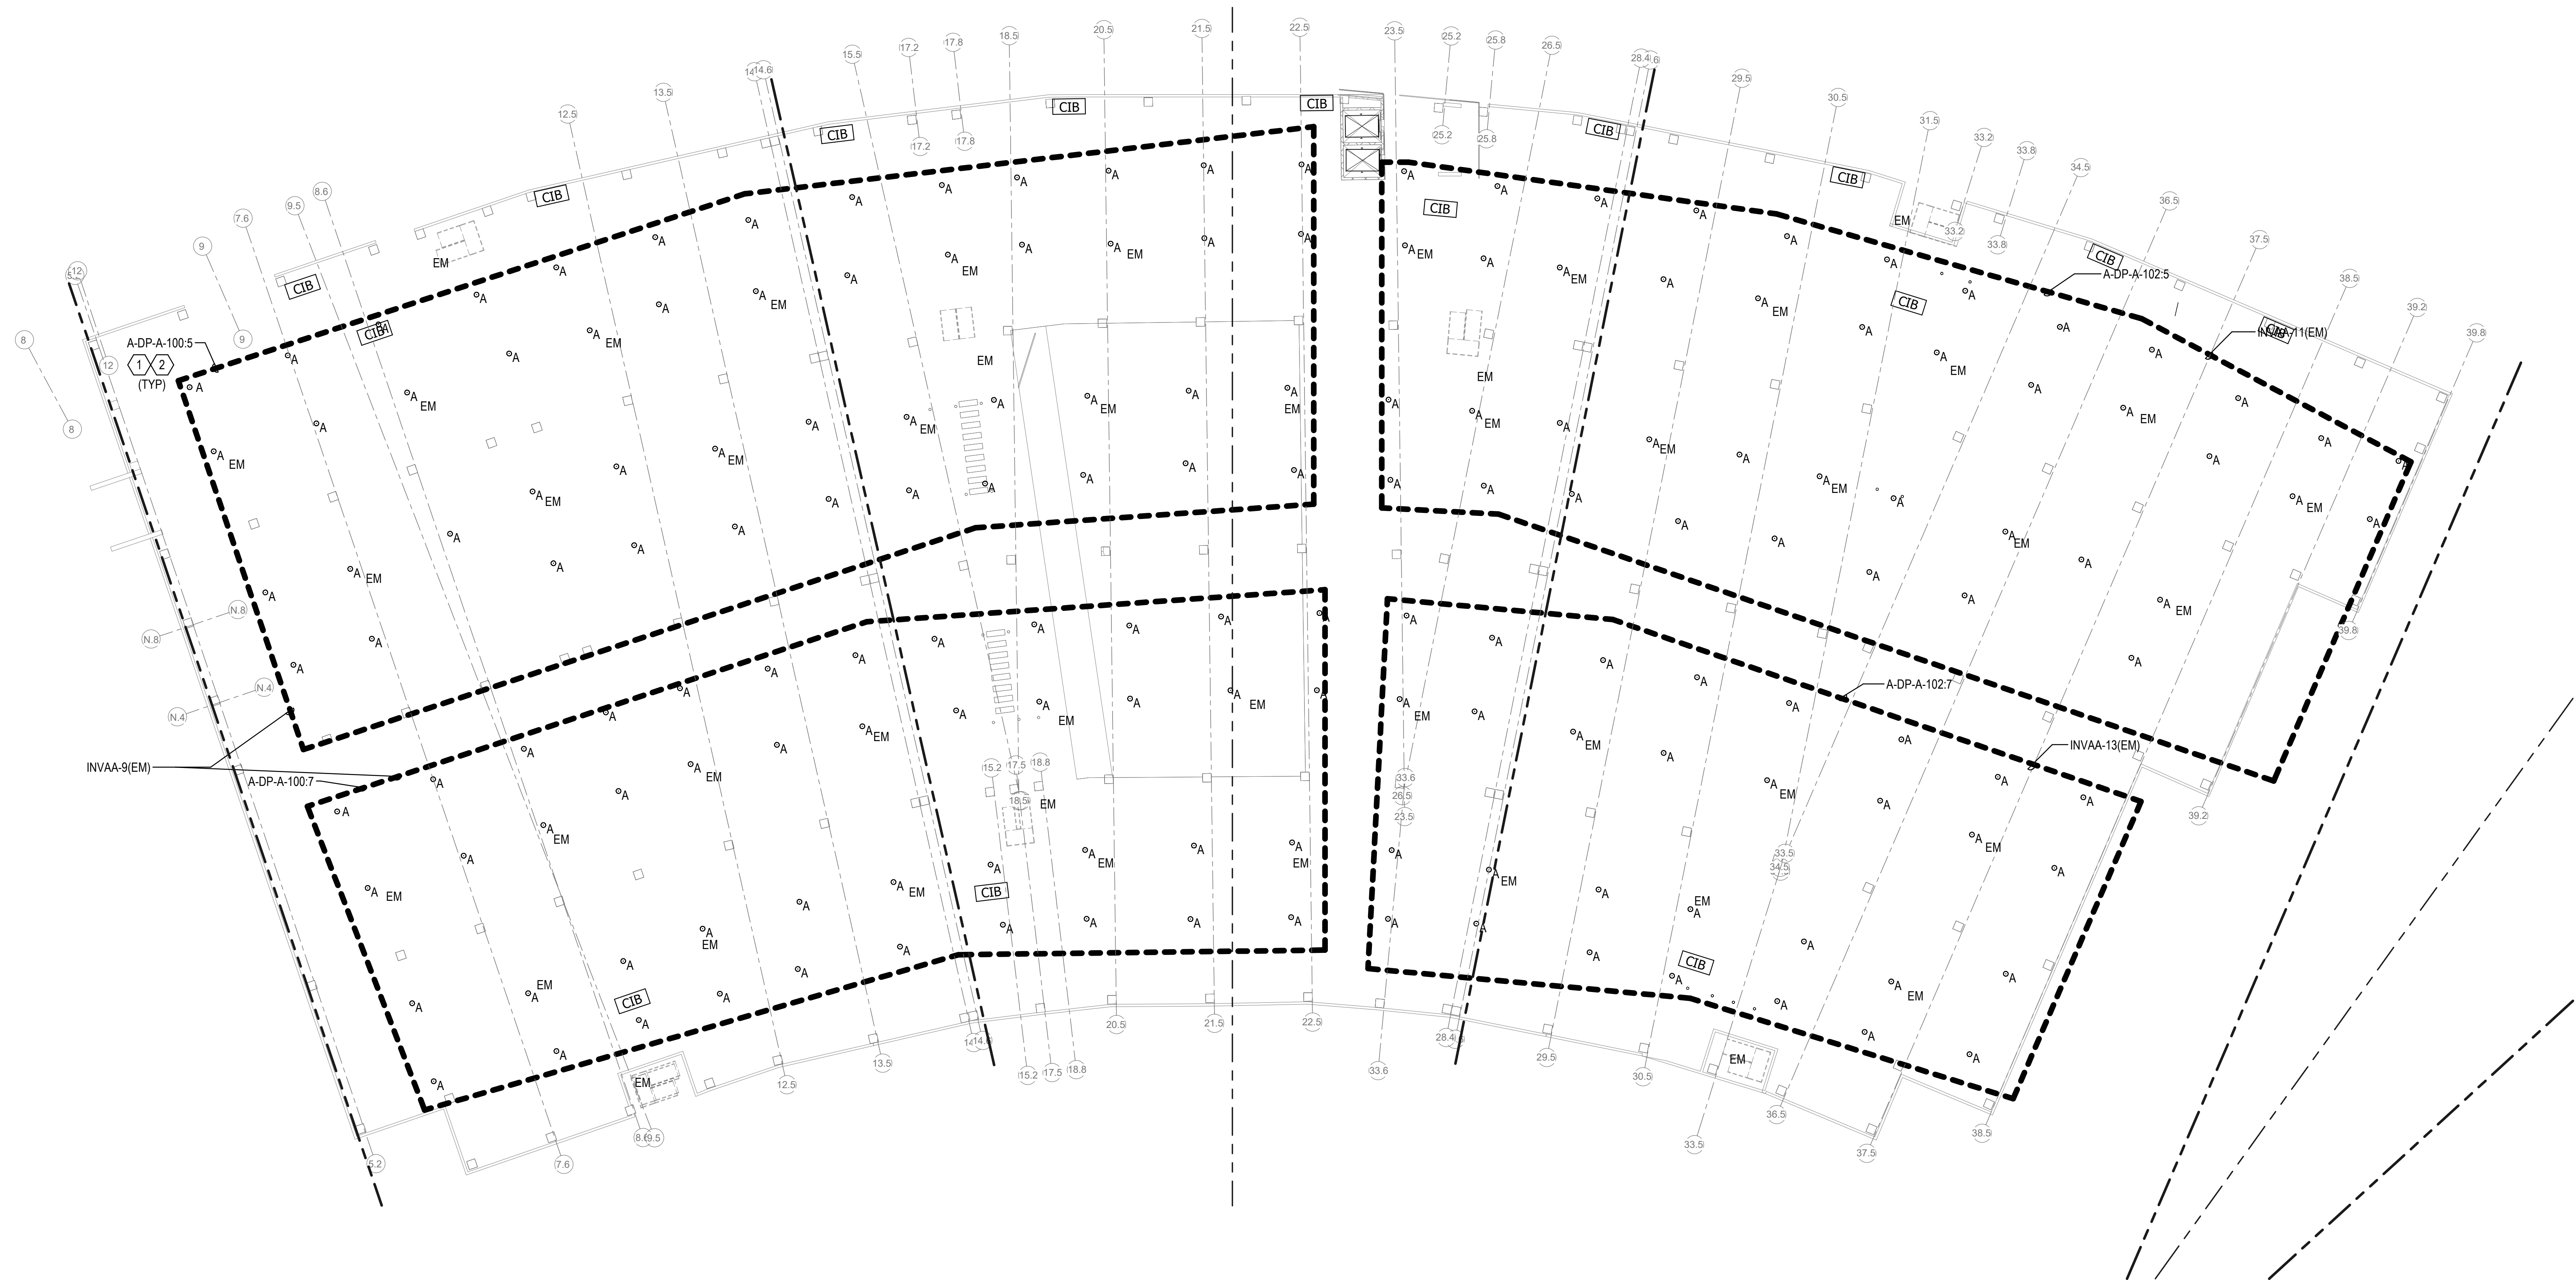


SHEET NOTES

1. REFER TO DRAWINGS E-001 FOR LEGEND, ABBREVIATIONS, GENERAL NOTES. REFER TO DRAWING E-00-900C FOR LIGHT FIXTURE SCHEDULE.
2. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH, AND SECURITY REQUIREMENTS.
3. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
4. MINIMUM LIGHTING CIRCUIT SIZE SHALL BE 2#10,#10G-3/4" UNLESS NOTED OTHERWISE.
5. SITE COORDINATE FINAL WORK LOCATIONS OF SWITCHES AND JUNCTION BOXES WITH WALL TREATMENT AND SURFACES. PRIOR TO ROUGH-IN.
6. REFERENCE SHEET E-601-604 FOR PANEL SCHEDULES.
7. REFERENCE SHEET E-002 FOR SINGLE-LINE DIAGRAM.
8. ALL EXIT LIGHTS SHALL BE UN-SWITCHED. ALL EMERGENCY FIXTURES SHALL BE UNSWITCHED.
9. FIXTURES WITH EMERGENCY BATTERY PACKS SHALL BE SWITCHED WITH NORMAL FIXTURES IN ZONE. UPON LOSS OF POWER FIXTURE SHALL ILLUMINATE.
10. ALL VACANCY SENSORS SHALL BE SET AS MANUAL ON/AUTO OFF EXCEPT FOR SWITCHES CONTROLLING RESTROOMS AND CORRIDORS.
11. UNLESS NOTED OTHERWISE, THE SWITCH SHOWN IN A ROOM/AREA SHALL CONTROL ALL LIGHT FIXTURES IN THE ROOM/AREA.

SHEET KEYNOTES

1. ZONE BLOCK DESIGNATES CIRCUIT NUMBER FOR ALL LIGHTING FIXTURES WITHIN. UNO. FIXTURES WITH "EM" DESIGNATION TO BE POWERED VIA INVERTER CIRCUIT.
2. ALL GARAGE FIXTURES SHALL FEATURE INTEGRAL SENSORS FOR LIGHTING CONTROL.

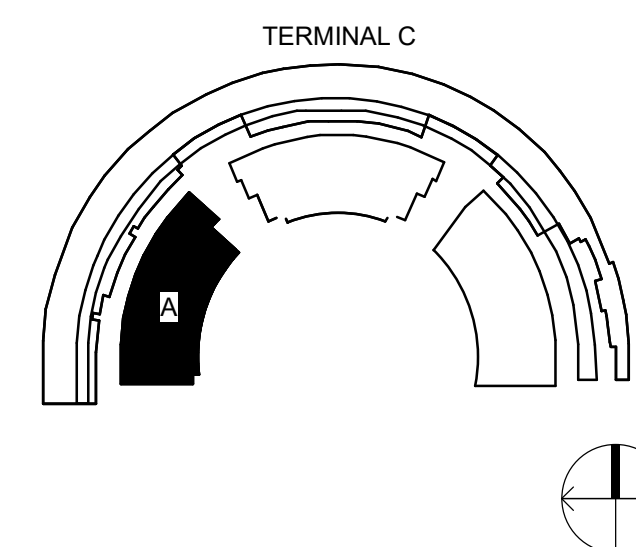

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com


DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A LIGHTING PLAN - LEVEL B - PHASE 3
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
EL202-900A

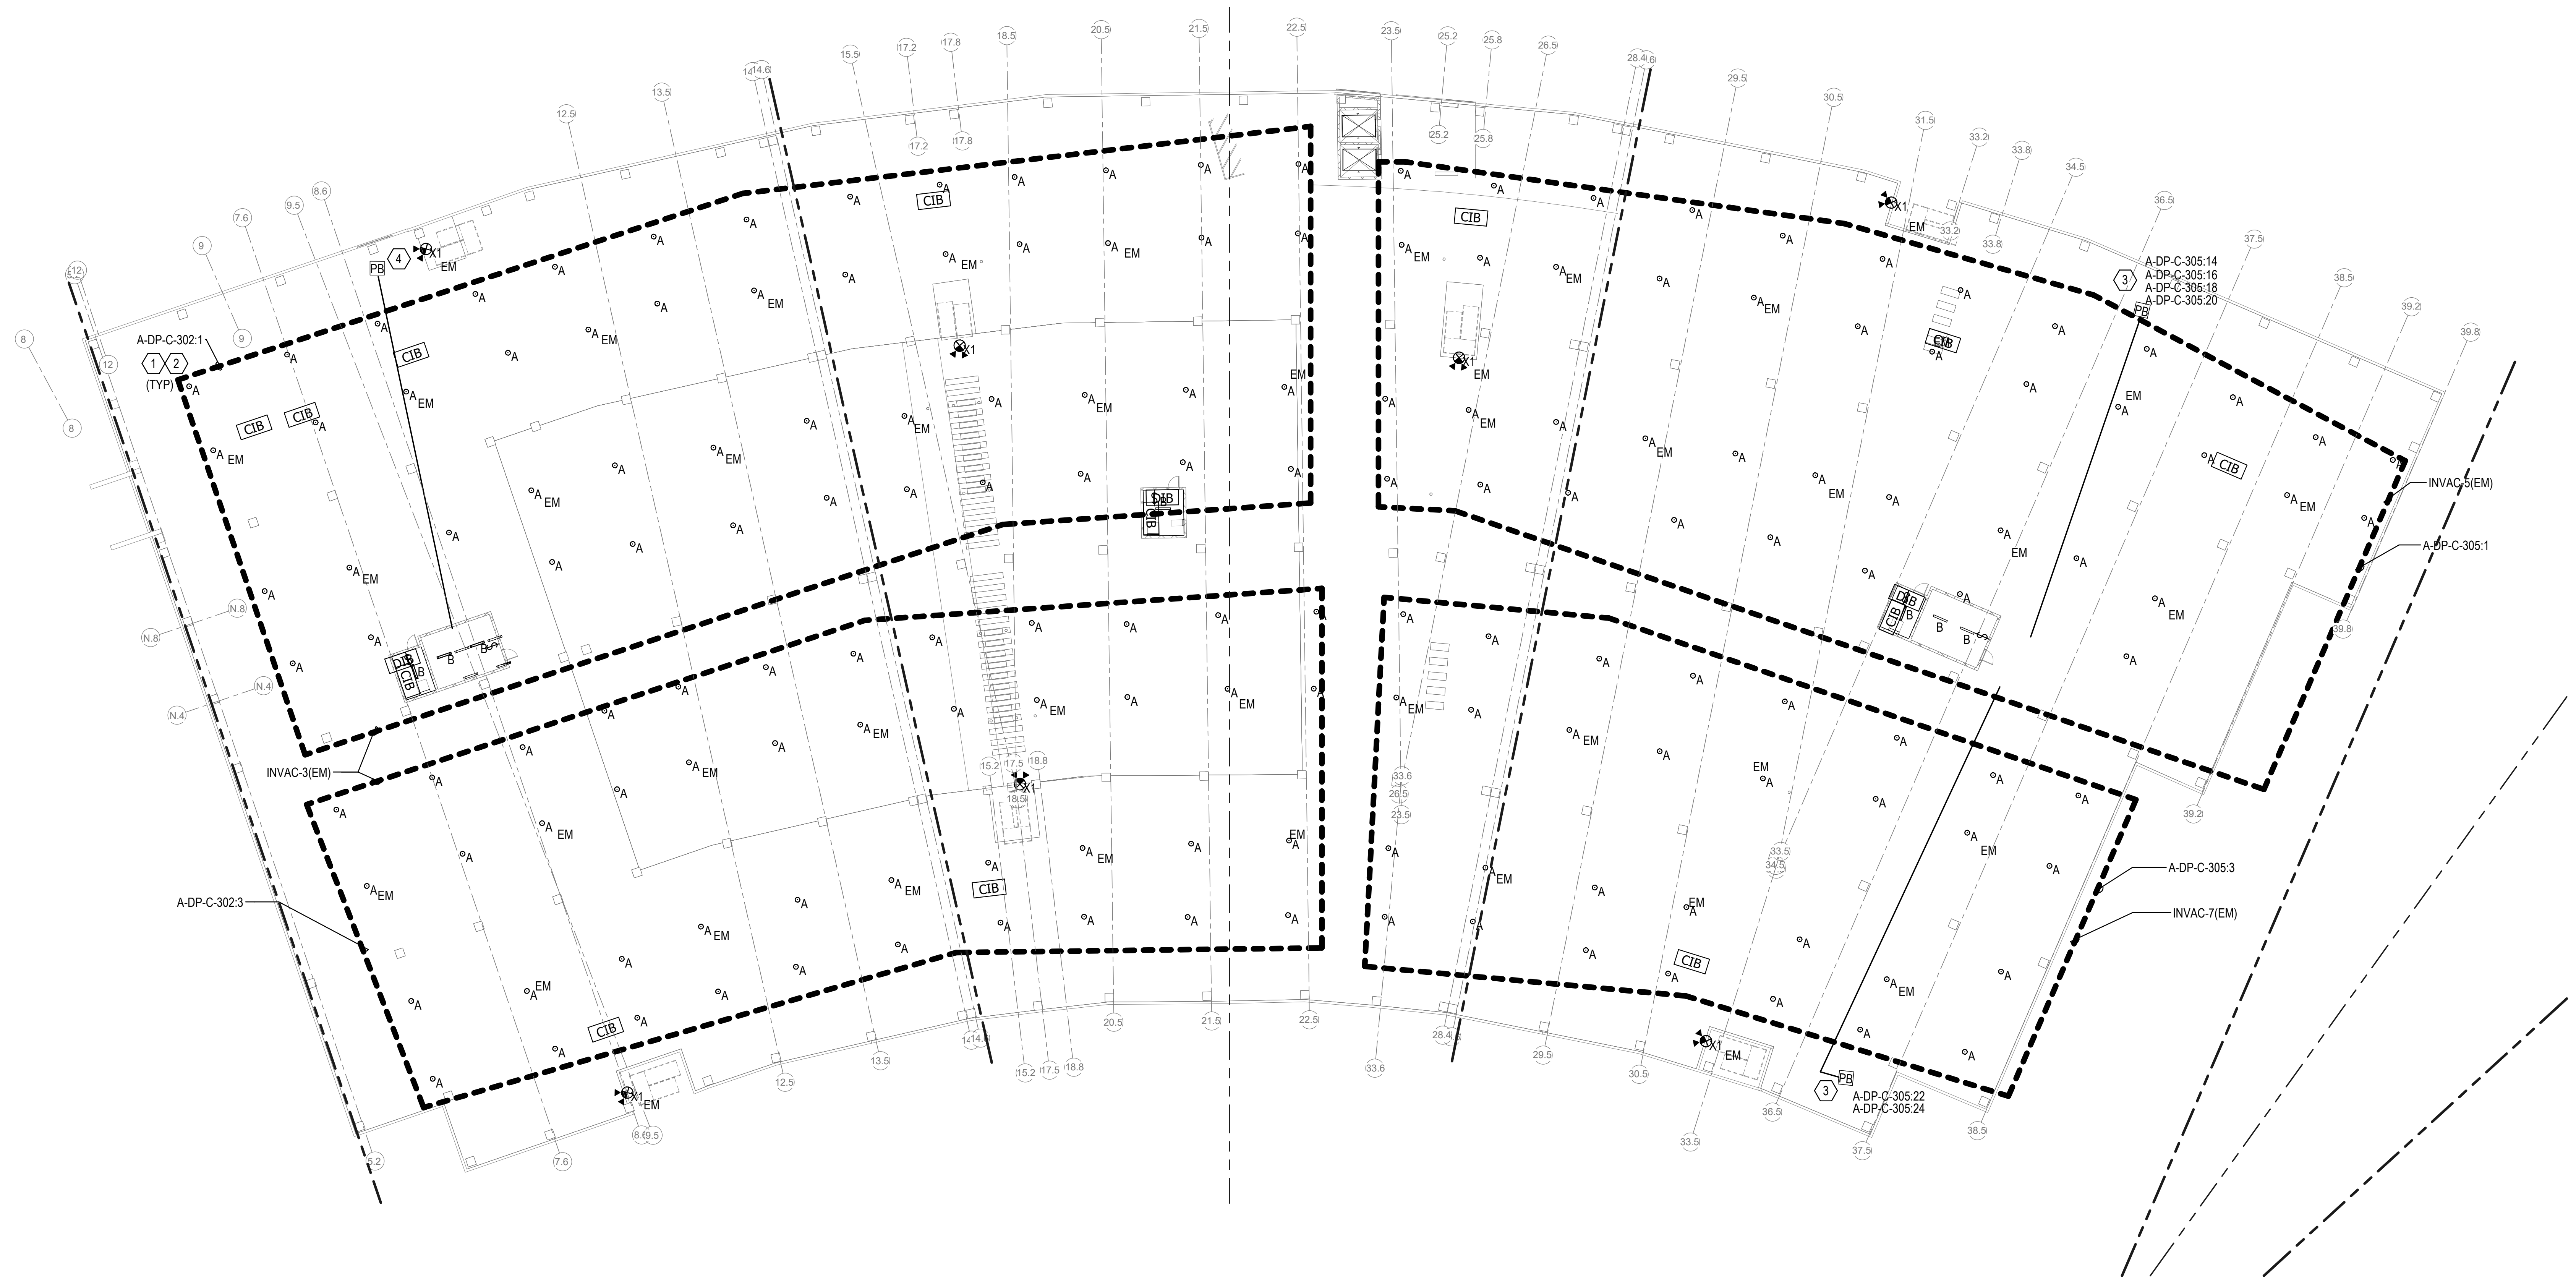


SHEET NOTES

1. REFER TO DRAWINGS E-001 FOR LEGEND, ABBREVIATIONS, GENERAL NOTES. REFER TO DRAWING E-000-900C FOR LIGHT FIXTURE SCHEDULE.
2. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH, AND SECURITY REQUIREMENTS.
3. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
4. MINIMUM LIGHTING CIRCUIT SIZE SHALL BE 2#10,#10G-3/4" UNLESS NOTED OTHERWISE.
5. SITE COORDINATE FINAL WORK LOCATIONS OF SWITCHES AND JUNCTION BOXES WITH WALL TREATMENT AND SURFACES. PRIOR TO ROUGH-IN.
6. REFERENCE SHEET E-601-604 FOR PANEL SCHEDULES.
7. REFERENCE SHEET E-002 FOR SINGLE-LINE DIAGRAM.
8. ALL EXIT LIGHTS SHALL BE UN-SWITCHED. ALL EMERGENCY FIXTURES SHALL BE UNSWITCHED.
9. FIXTURES WITH EMERGENCY BATTERY PACKS SHALL BE SWITCHED WITH NORMAL FIXTURES IN ZONE. UPON LOSS OF POWER FIXTURE SHALL ILLUMINATE.
10. ALL VACANCY SENSORS SHALL BE SET AS MANUAL ON/AUTO OFF EXCEPT FOR SWITCHES CONTROLLING RESTROOMS AND CORRIDORS.
11. UNLESS NOTED OTHERWISE, THE SWITCH SHOWN IN A ROOM/AREA SHALL CONTROL ALL LIGHT FIXTURES IN THE ROOM/AREA.

SHEET KEYNOTES

1. ZONE BLOCK DESIGNATES CIRCUIT NUMBER FOR ALL LIGHTING FIXTURES WITHIN. UNO. FIXTURES WITH "EM" DESIGNATION TO BE POWERED VIA INVERTER CIRCUIT.
2. ALL GARAGE FIXTURES SHALL FEATURE INTEGRAL SENSORS FOR LIGHTING CONTROL.
3. PULL BOX FOR ROADWAY LIGHTING CIRCUITS PER ROADWAY LIGHTING PLAN 1/ES107-900R.
4. PULLBOX FOR ROADWAY EMERGENCY (EM) LIGHTING CIRCUITS. PROVIDE CIRCUITS INVAA-7. REFER PANEL SCHEDULES.

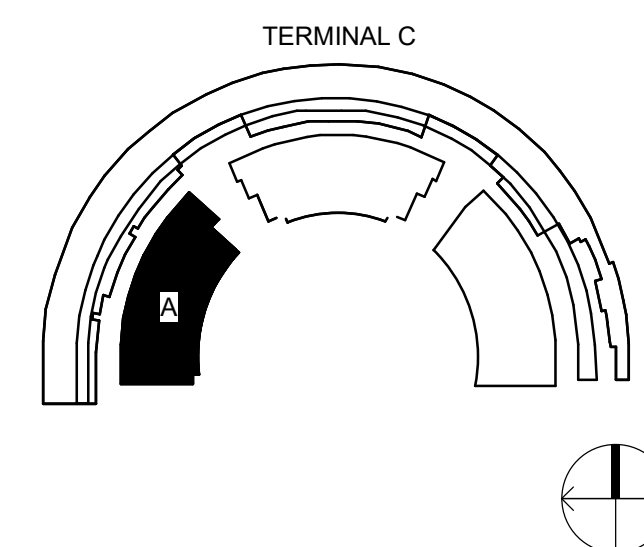

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com
Texas Board of Professional Engineers
Firm Registration Number F-7009

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


Garage A

GARAGE A LIGHTING PLAN - LEVEL C - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EL203-900A

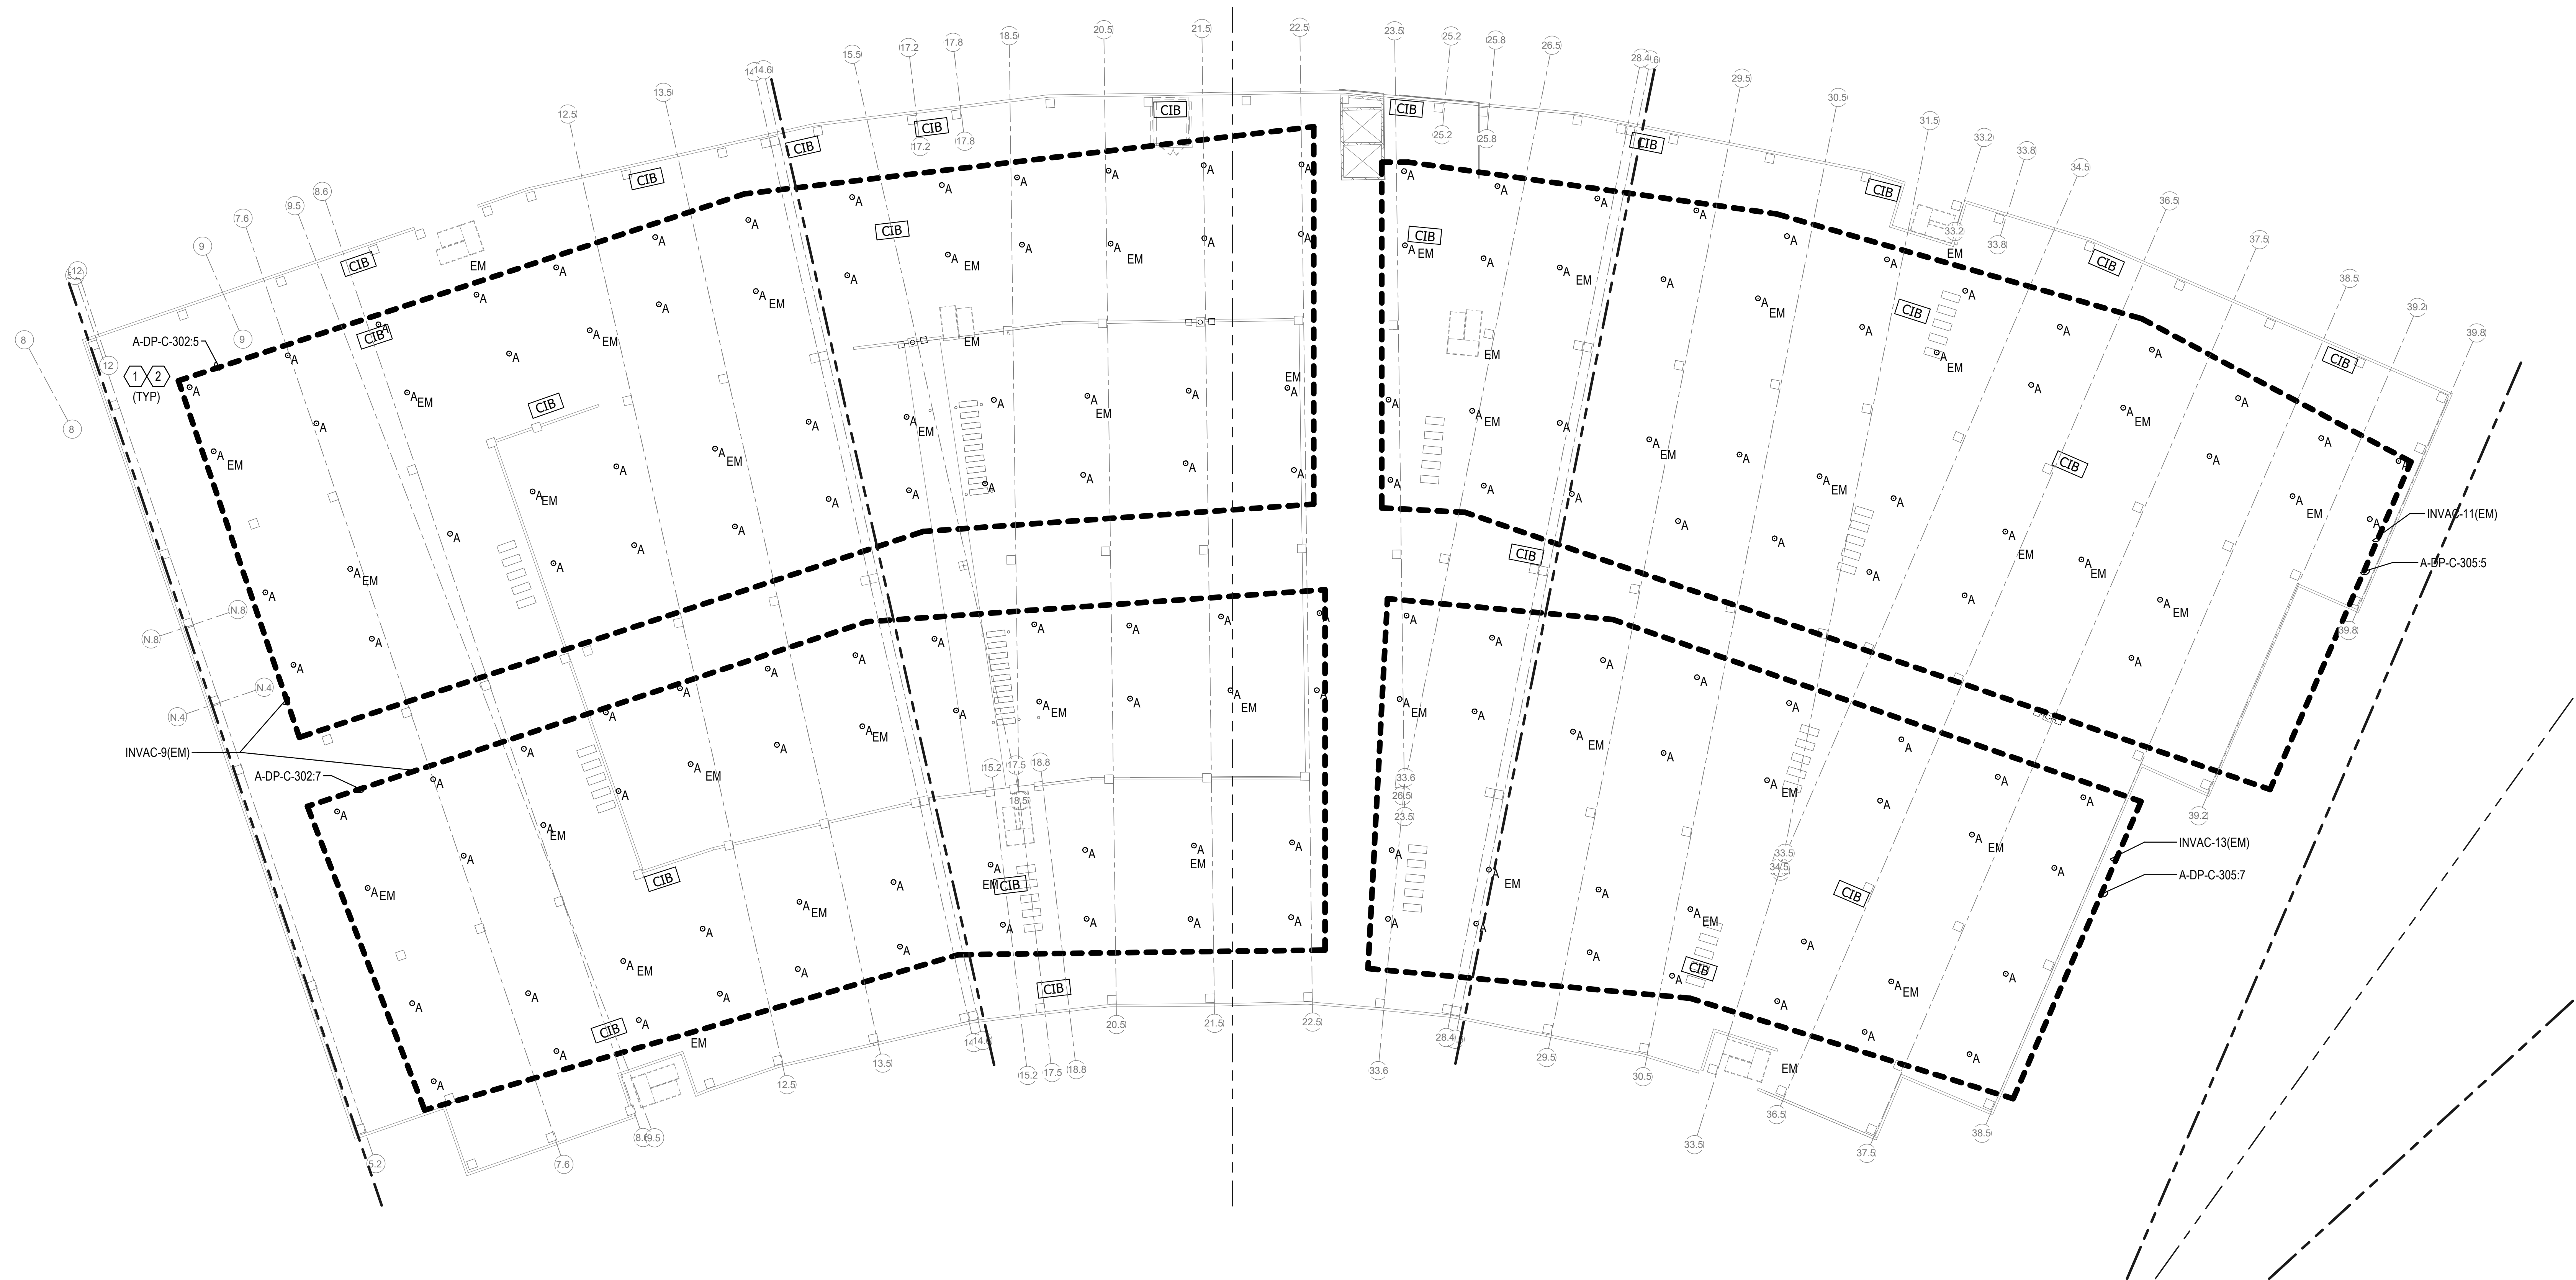


SHEET NOTES

1. REFER TO DRAWINGS E-001 FOR LEGEND, ABBREVIATIONS, GENERAL NOTES. REFER TO DRAWING E-00-900C FOR LIGHT FIXTURE SCHEDULE.
2. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH, AND SECURITY REQUIREMENTS.
3. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
4. MINIMUM LIGHTING CIRCUIT SIZE SHALL BE 2#10,#10G-3/4" UNLESS NOTED OTHERWISE.
5. SITE COORDINATE FINAL WORK LOCATIONS OF SWITCHES AND JUNCTION BOXES WITH WALL TREATMENT AND SURFACES. PRIOR TO ROUGH-IN.
6. REFERENCE SHEET E-601-604 FOR PANEL SCHEDULES.
7. REFERENCE SHEET E-002 FOR SINGLE-LINE DIAGRAM.
8. ALL EXIT LIGHTS SHALL BE UN-SWITCHED. ALL EMERGENCY FIXTURES SHALL BE UNSWITCHED.
9. FIXTURES WITH EMERGENCY BATTERY PACKS SHALL BE SWITCHED WITH NORMAL FIXTURES IN ZONE. UPON LOSS OF POWER FIXTURE SHALL ILLUMINATE.
10. ALL VACANCY SENSORS SHALL BE SET AS MANUAL ON/AUTO OFF EXCEPT FOR SWITCHES CONTROLLING RESTROOMS AND CORRIDORS.
11. UNLESS NOTED OTHERWISE, THE SWITCH SHOWN IN A ROOM/AREA SHALL CONTROL ALL LIGHT FIXTURES IN THE ROOM/AREA.

SHEET KEYNOTES

1. ZONE BLOCK DESIGNATES CIRCUIT NUMBER FOR ALL LIGHTING FIXTURES WITHIN. UNO. FIXTURES WITH "EM" DESIGNATION TO BE POWERED VIA INVERTER CIRCUIT.
2. ALL GARAGE FIXTURES SHALL FEATURE INTEGRAL SENSORS FOR LIGHTING CONTROL.

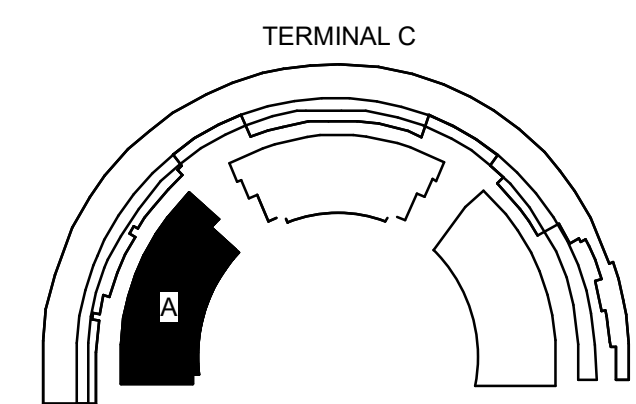

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com


DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A LIGHTING PLAN - LEVEL D - PHASE 3
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
EL204-900A

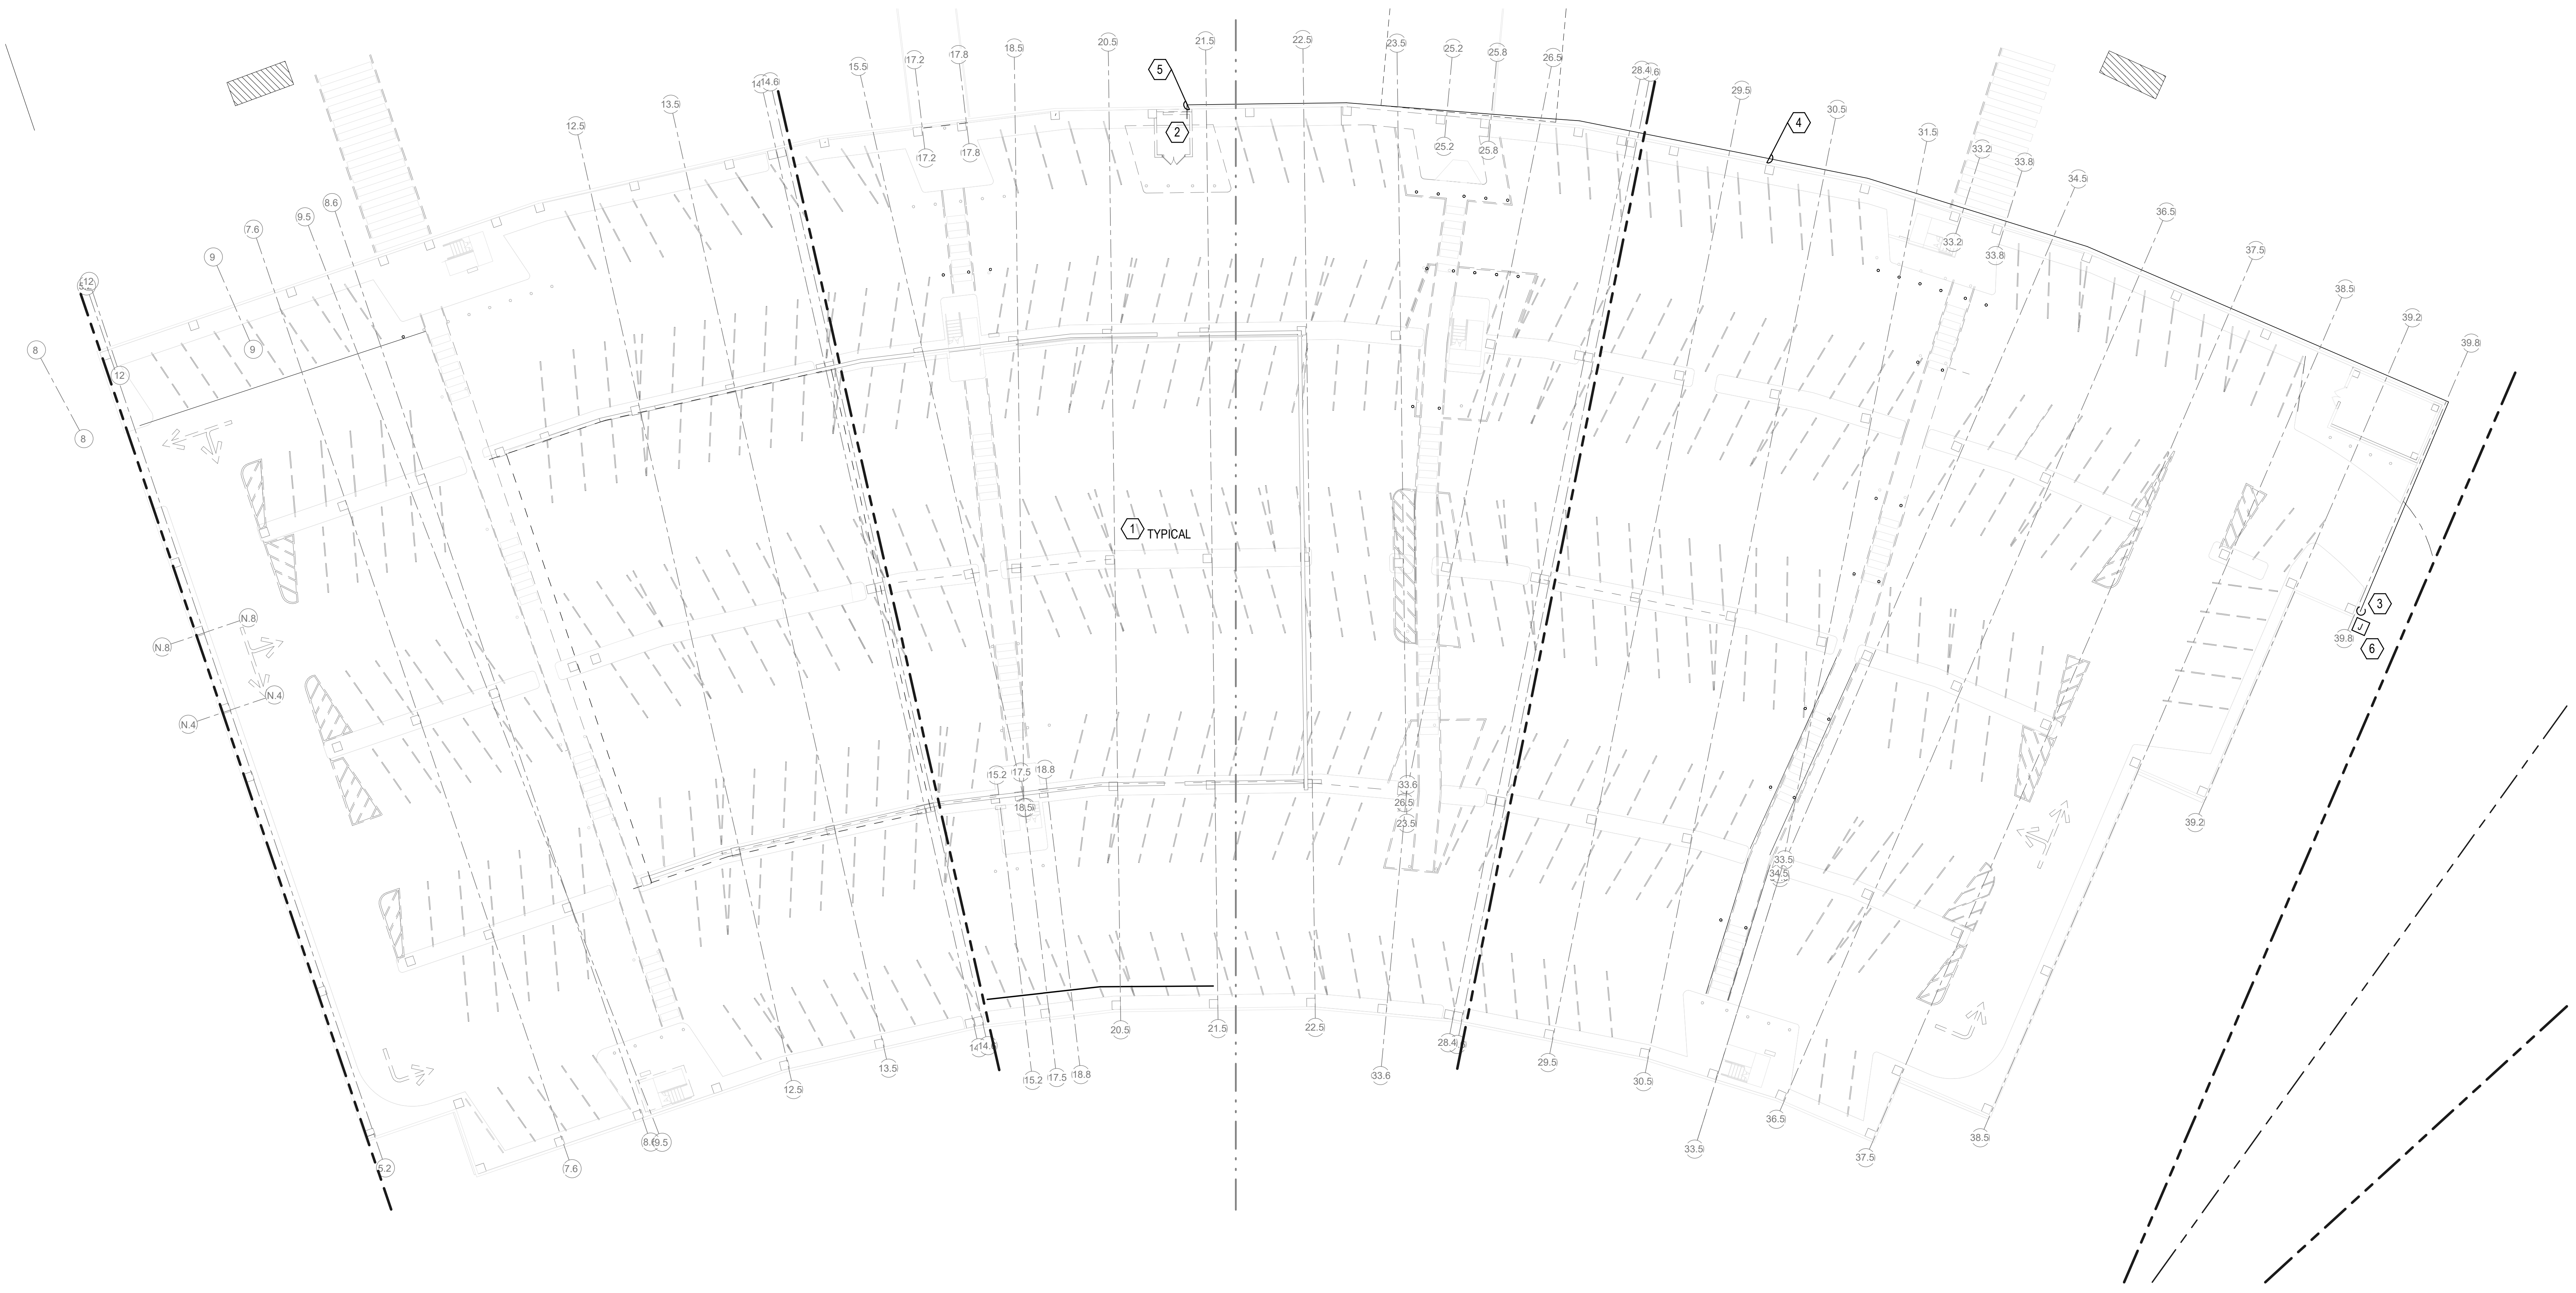


SHEET NOTES

- REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
- REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
- WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
- REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
- DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
- WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
- COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
- WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
- REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

SHEET KEYNOTES

- DEMOLISH EXISTING ELECTRICAL AND SPECIAL SYSTEMS DEVICES AND EQUIPMENT (LIGHT FIXTURES, FIRE ALARM DEVICES, WIRING DEVICES, SPEAKERS, ETC.) UNLESS OTHERWISE NOTED. REMOVE ALL ASSOCIATED WIRING AND CONDUIT BACK TO SOURCE PANEL OR LAST KNOWN ELECTRICAL DEVICE. CIRCUITS TAKEN BACK TO SOURCE PANEL SHALL BE LABELED AS SPARE UNLESS DESIGNATED TO BE USED DURING NEW CONSTRUCTION.
- RETAIN MAIN POWER ROOM AND EQUIPMENT FOR TEMPORARY USAGE.
- ROUTE CONDUIT FOR TEMPORARY POWER DOWN EXTERIOR OF GARAGE TO PULLBOX FOR POWER FEEDERS TO NEW ELECTRICAL ROOMS. REFER POWER PLAN EP201-900A.
- PROVIDE 400-AMP CIRCUIT (4-500 MCM, 1-#3-G IN 3" C) SURFACE-MOUNTED BELOW UPPER ROADWAY ON EXTERIOR OF GARAGE.
- ROUTE CONDUIT INSIDE EXISTING ELECTRICAL ROOM TO EXISTING 400-AMP PANEL 3EA-MDP. REFEED PANEL 3EA-MDP (BOTTOM-FED) WITH TEMPORARY POWER FROM SWITCHGEAR A-B.
- ROUTE TEMPORARY POWER FROM SWITCH GEAR A-B UNDER ROADWAY TO SWITCHGEAR A-B FACILITY. USE (1) OF SPARE 4" CONDUITS SCHEDULED FOR FUTURE USE BY OTHERS. REFER LEVEL A POWER PLAN EP201-900A.

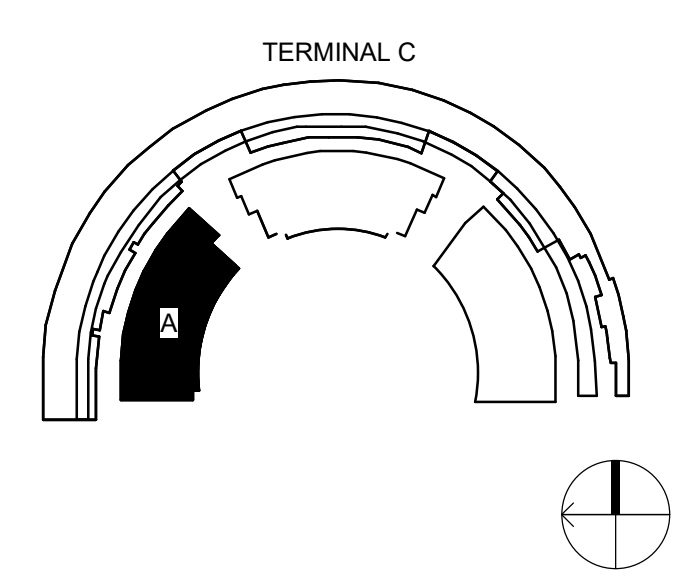

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261



h+k
 SYSKA HENNESSY GROUP
 A member company of SH Group, Inc.
 TEXAS BOARD OF PROFESSIONAL ENGINEERS
 FIRM REGISTRATION NUMBER F-7099
 4925 Greenville Avenue
 Suite 415
 Dallas, TX 75206
 Tel: 972-470-0704
 www.syska.com

DRAWN BY: SHG
 APPROVED BY: WH
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A


GARAGE A POWER DEMOLITION PLAN - LEVEL A - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP101-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

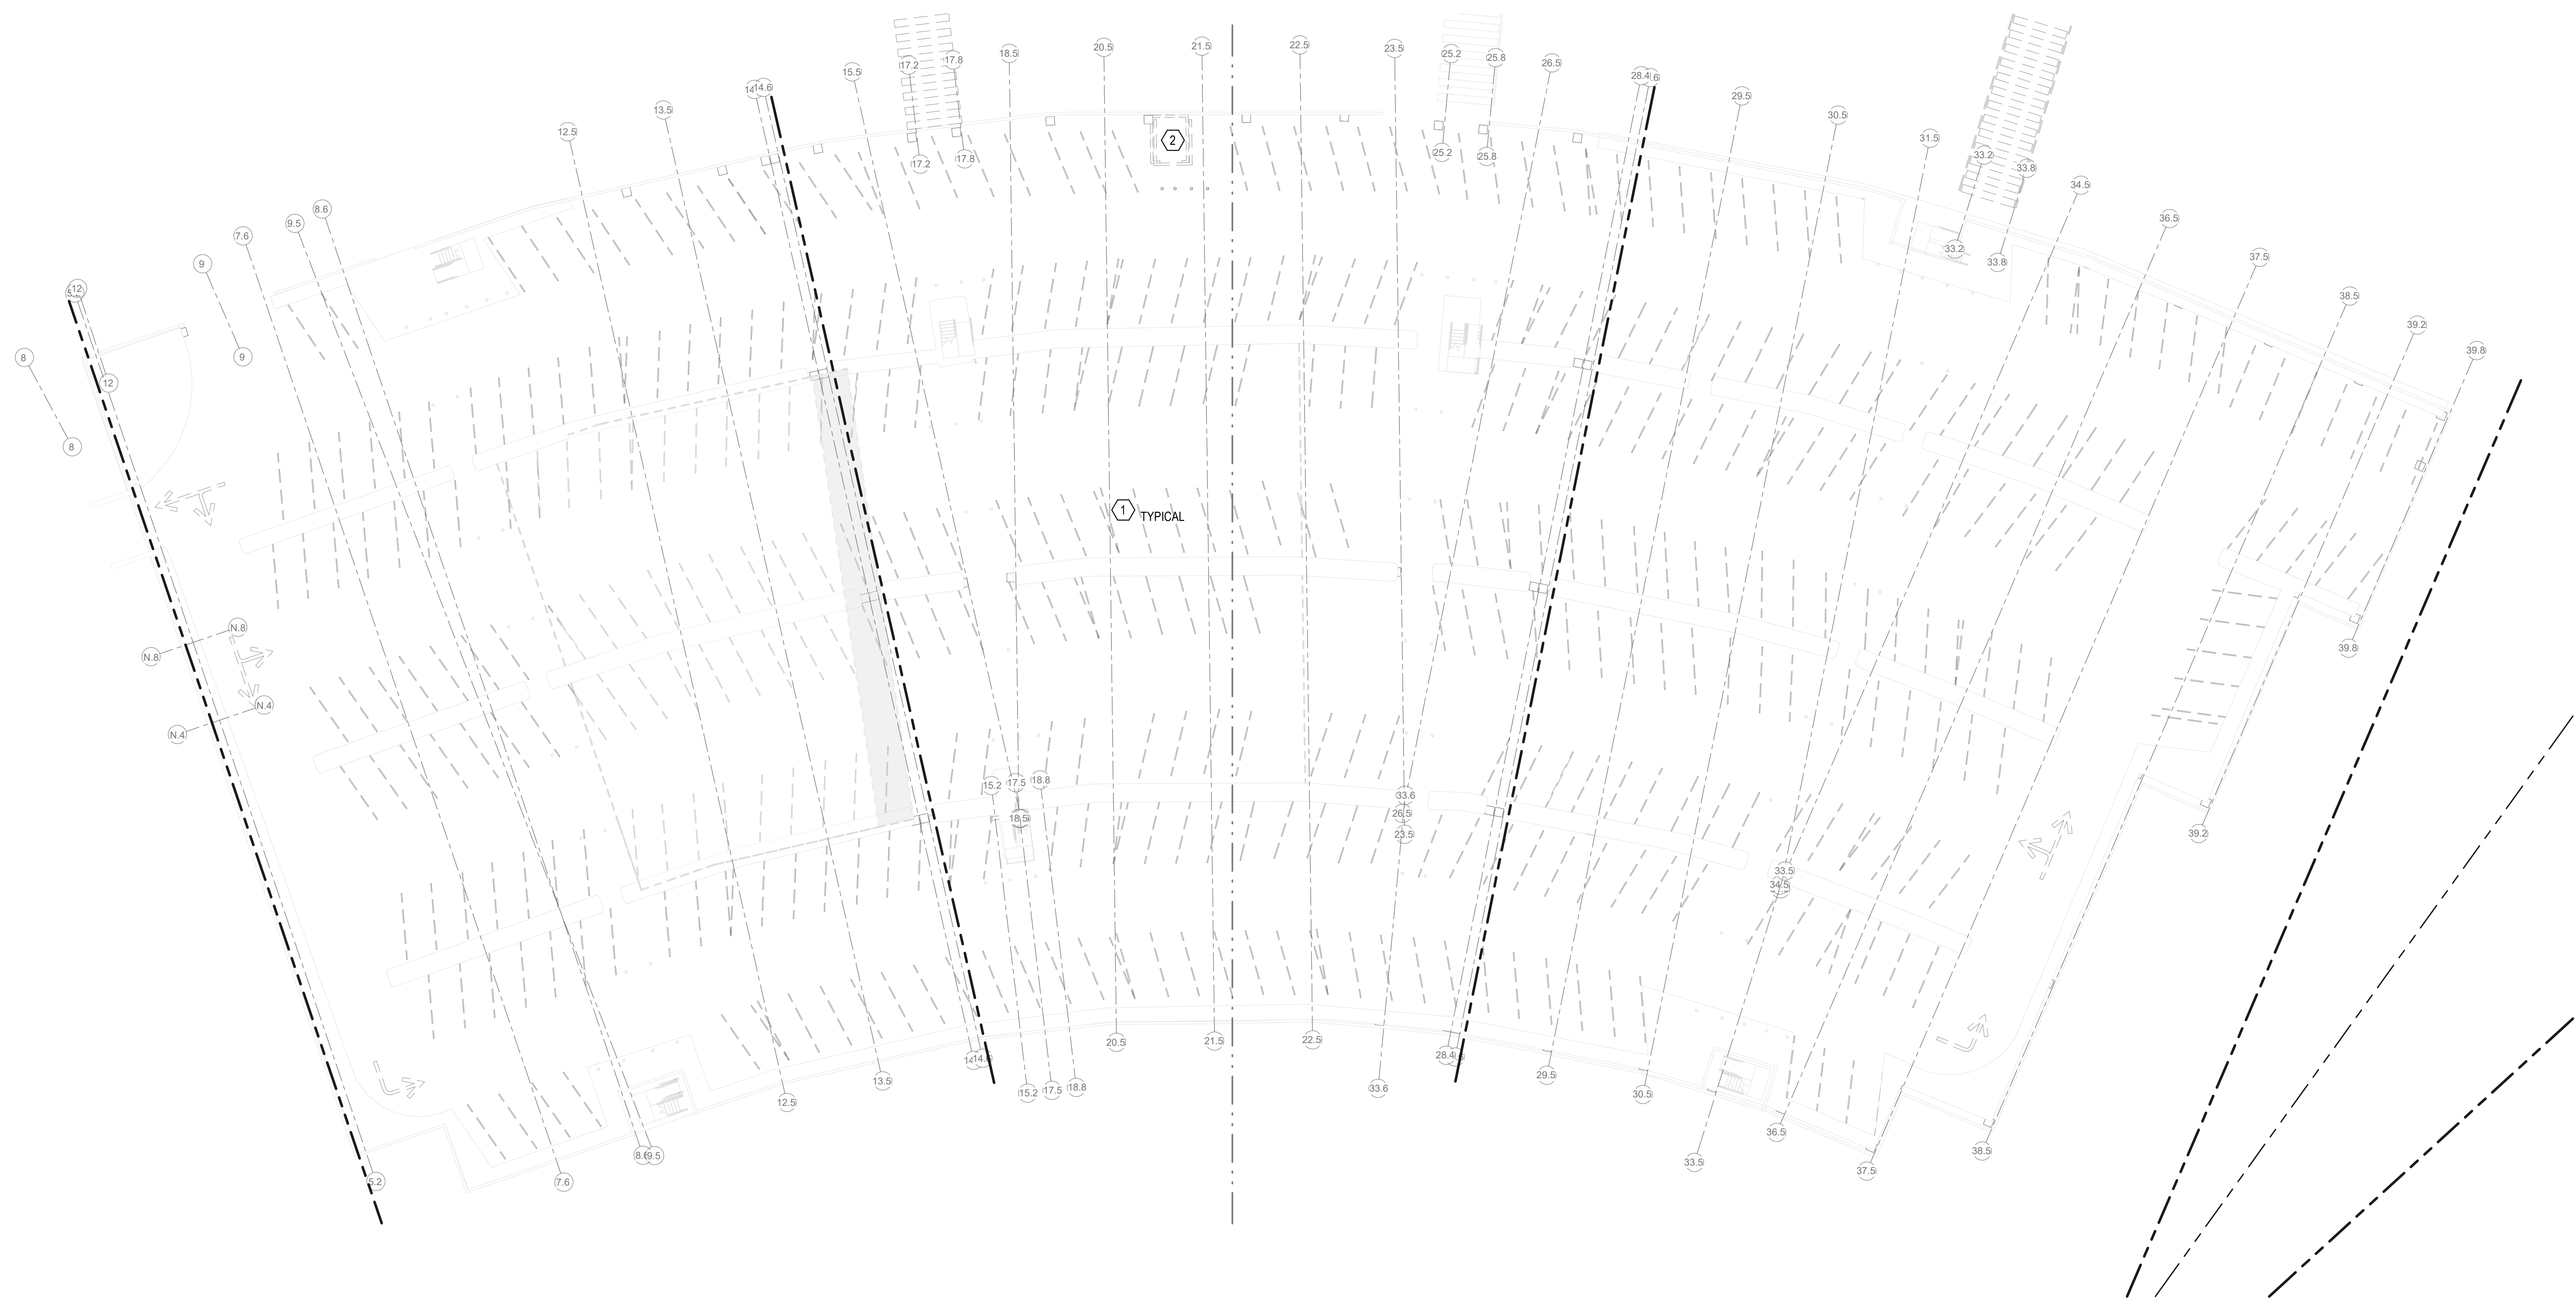


SHEET NOTES

1. REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
2. REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
3. IN AREAS WHERE NO WORK IS SHOWN, ALL EXISTING ELECTRICAL DEVICES AND EQUIPMENT ARE TO REMAIN, UNLESS NOTED OTHERWISE. ALL PROPOSED WORK SHALL BE THOROUGHLY COORDINATED WITH THE LANDLORD PRIOR TO COMMENCING WORK.
4. WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
5. REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
6. DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
7. WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
8. COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
9. WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
10. REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

SHEET KEYNOTES

1. DEMOLISH EXISTING ELECTRICAL AND SPECIAL SYSTEMS DEVICES AND EQUIPMENT (LIGHT FIXTURES, FIRE ALARM DEVICES, WIRING DEVICES, SPEAKERS, ETC.) UNLESS OTHERWISE NOTED. REMOVE ALL ASSOCIATED WIRING AND CONDUIT BACK TO SOURCE PANEL OR LAST KNOWN ELECTRICAL DEVICE. CIRCUITS TAKEN BACK TO SOURCE PANEL SHALL BE LABELED AS SPARE UNLESS DESIGNATED TO BE USED DURING NEW CONSTRUCTION.
2. ELECTRICAL ROOM SCHEDULED FOR DEMOLITION BY THE ARCHITECT. REMOVE POWER AND LIGHTING EQUIPMENT ACCORDINGLY.

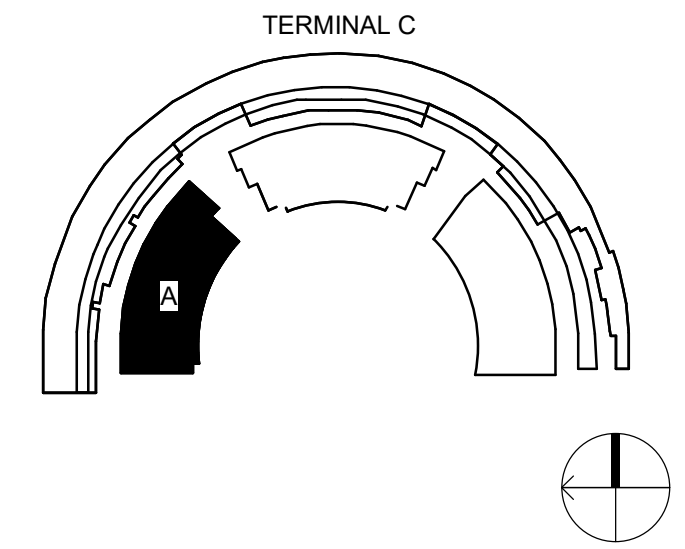

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**


NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A POWER DEMOLITION PLAN - LEVEL C - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP103-900A

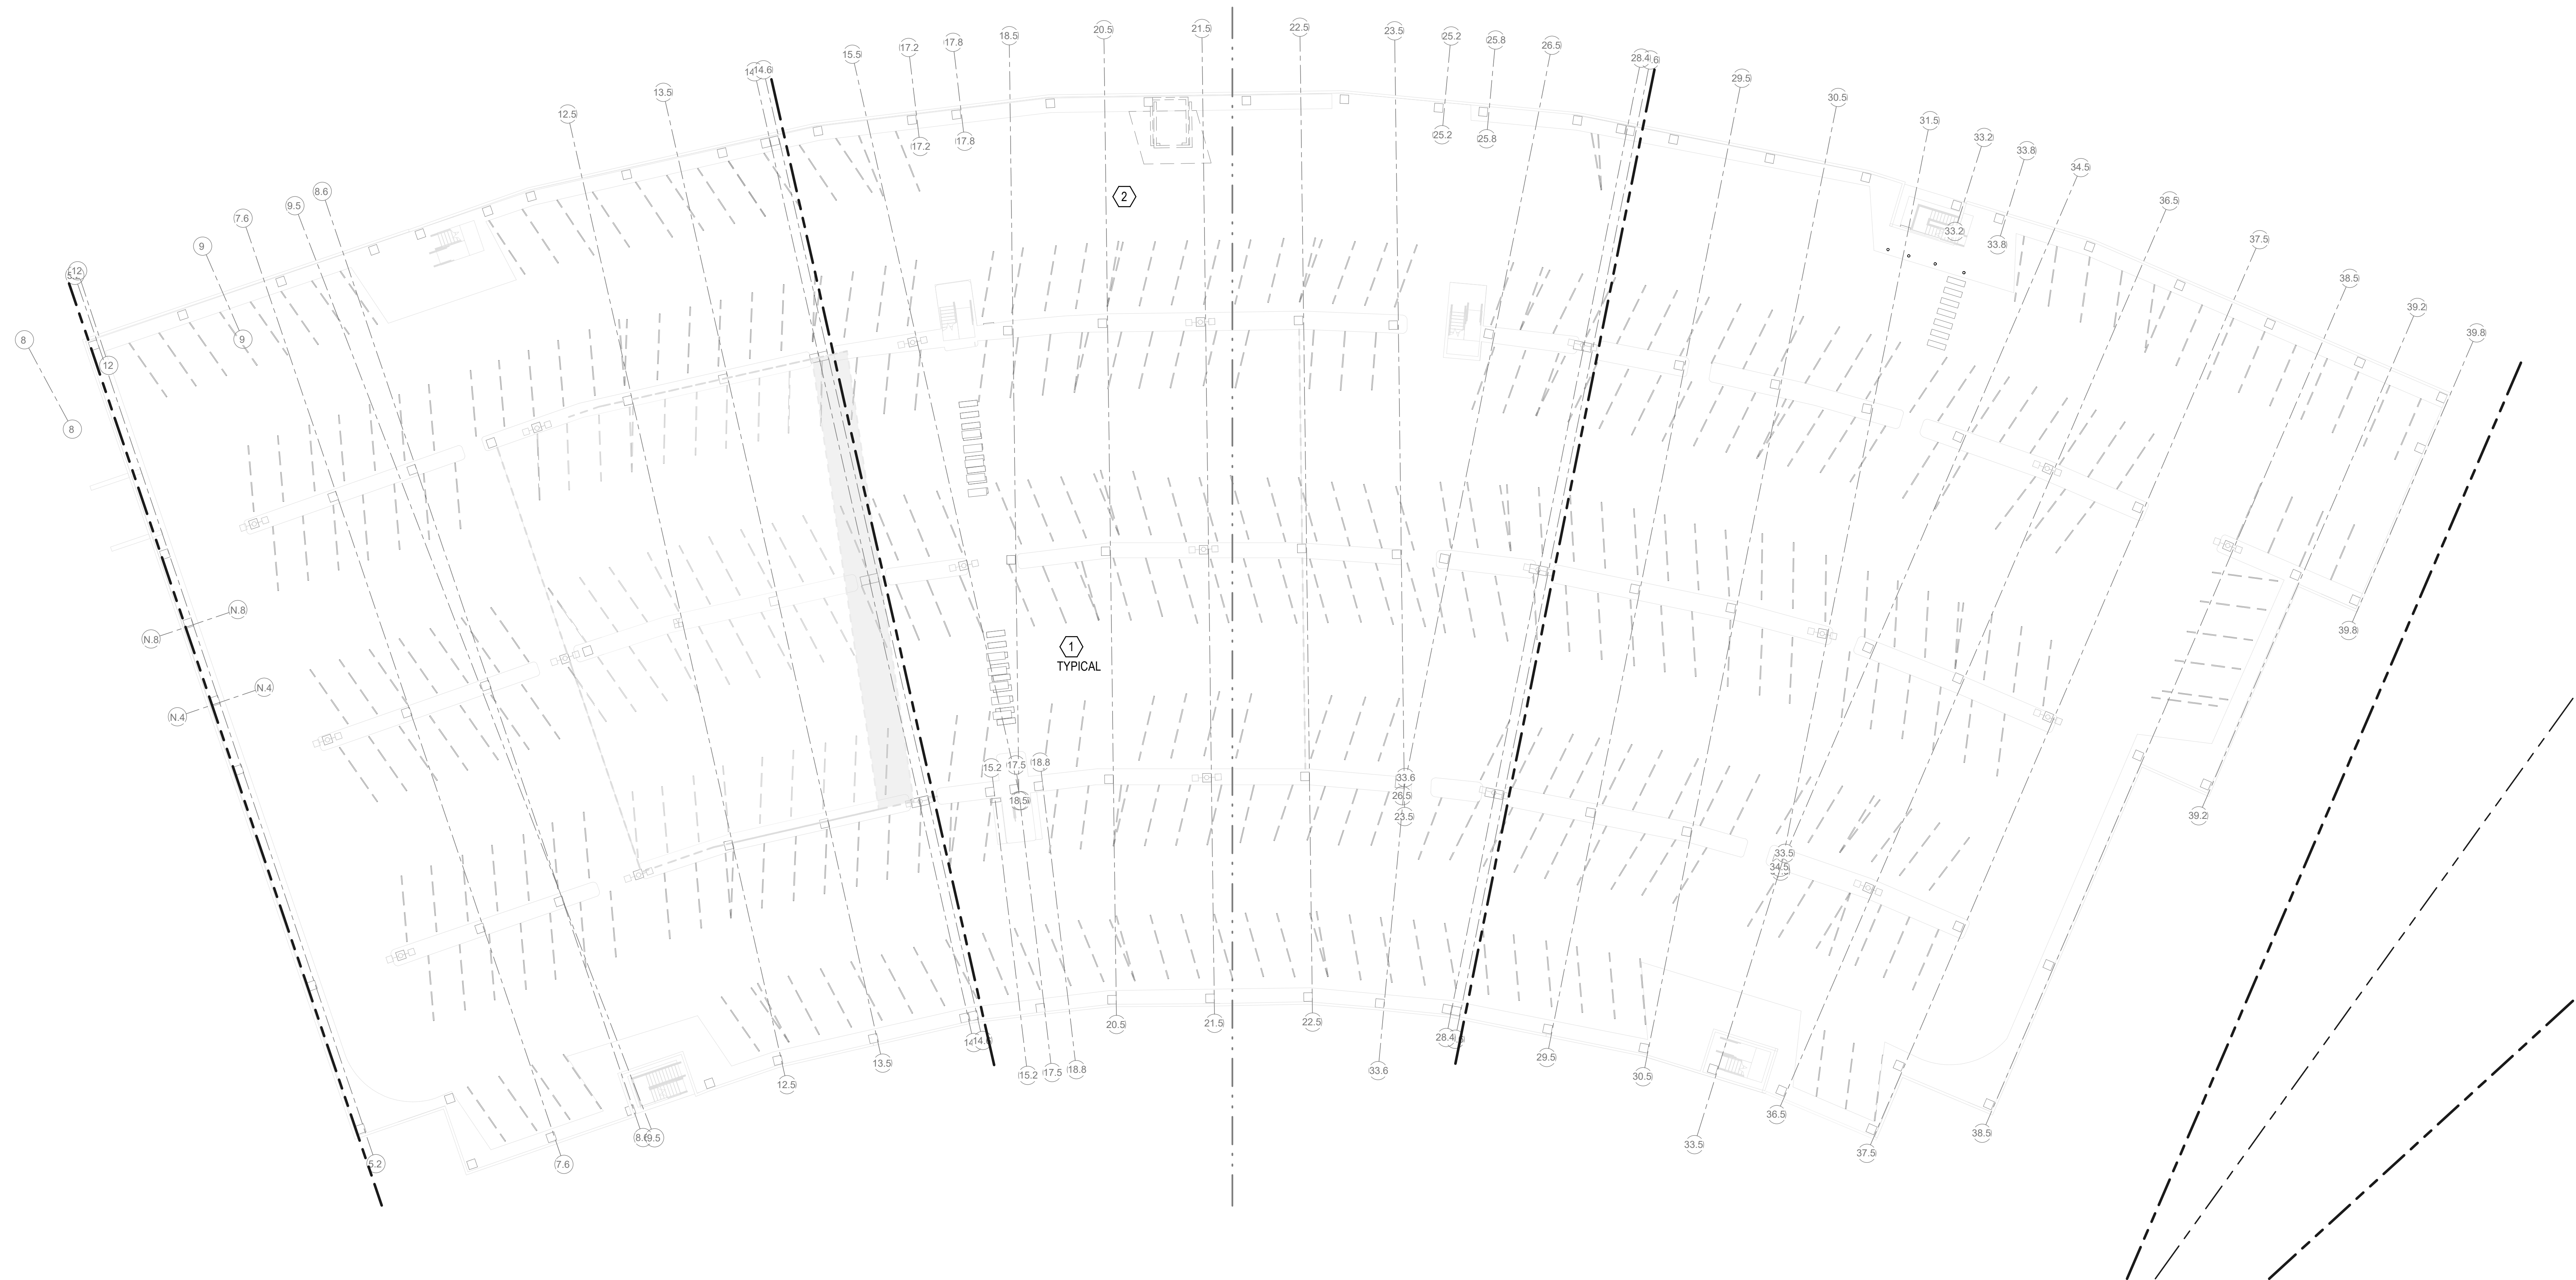


SHEET NOTES

1. REFER TO DRAWING E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
2. REFER DEMOLITION SECTION OF THE SPECIFICATION COORDINATE WORK WITH OTHER DISCIPLINES.
3. IN AREAS WHERE NO WORK IS SHOWN, ALL EXISTING ELECTRICAL DEVICES AND EQUIPMENT ARE TO REMAIN, UNLESS NOTED OTHERWISE. ALL PROPOSED WORK SHALL BE THOROUGHLY COORDINATED WITH THE LANDLORD PRIOR TO COMMENCING WORK.
4. WHERE EXPOSED, REMOVE ABANDONED CONDUIT. ALL CONDUIT ABANDONED IN THE SLAB OR CEILING SHALL HAVE ITS WIRING REMOVED AND SHALL BE LEFT PLUGGED-FLUSH WITH ITS COINCIDING SLAB OR CEILING.
5. REMOVE ALL ABANDONED HANGERS, SUPPORTS, ETC. FOR ELECTRICAL ITEMS.
6. DISCONNECT AT THE SOURCE AND REMOVE ALL EXISTING ELECTRICAL MATERIALS AND EQUIPMENT; INCLUDING BUT NOT LIMITED TO, WIRING DEVICES, SIGNAL EQUIPMENT, TELECOMMUNICATION DEVICES, RACEWAYS, CONDUITS, JUNCTION BOXES, WIRING AND ALL OTHER ELECTRICAL ITEMS WHICH ARE RENDERED OBSOLETE BY THESE ALTERATIONS AND/OR ADDITIONS. PATCH ALL ABANDONED BACK BOXES TO MATCH EXISTING WALL CONSTRUCTION OR PREPARE WALLS TO RECEIVE NEW SCHEDULED FINISHES. NO BLANK COVER PLATES ALLOWED.
7. WHERE ENCOUNTERED IN THE RENOVATION AREA, MAINTAIN OR RESTORE (WHERE INTERRUPTED) ANY WIRING DEVICES, RACEWAY OR CIRCUITS SERVING UNDISTURBED AREAS OF THE FACILITY.
8. COORDINATE WITH THE MECHANICAL CONTRACTOR AND PROVIDE ANY RACEWAY AND/OR CABLING FACILITATING MECHANICAL EQUIPMENT RELOCATION RESULTING FROM THIS WORK.
9. WHERE ELECTRICAL DEVICES AND/OR CONDUIT ARE REMOVED, PATCH ALL HOLES IN SLABS, WALLS AND CEILINGS TO MATCH EXISTING CONSTRUCTION. ALL PATCHING SHALL BE MADE USING INTUMESCING FIRE SEALING MATERIAL.
10. REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL INFORMATION AND DEMOLITION REQUIREMENTS. GENERAL CONTRACTOR TO NOTIFY ENGINEER IN WRITING OF AN DISCREPANCIES BETWEEN DOCUMENTS PRIOR TO WORK AND BID SUBMISSION.

SHEET KEYNOTES

1. DEMOLISH EXISTING ELECTRICAL AND SPECIAL SYSTEMS DEVICES AND EQUIPMENT (LIGHT FIXTURES, FIRE ALARM DEVICES, WIRING DEVICES, SPEAKERS, ETC.) UNLESS OTHERWISE NOTED. REMOVE ALL ASSOCIATED WIRING AND CONDUIT BACK TO SOURCE PANEL OR LAST KNOWN ELECTRICAL DEVICE. CIRCUITS TAKEN BACK TO SOURCE PANEL SHALL BE LABELED AS SPARE UNLESS DESIGNATED TO BE USED DURING NEW CONSTRUCTION.
2. ELECTRICAL ROOM SCHEDULED FOR DEMOLITION BY THE ARCHITECT. REMOVE POWER AND LIGHTING EQUIPMENT ACCORDINGLY.

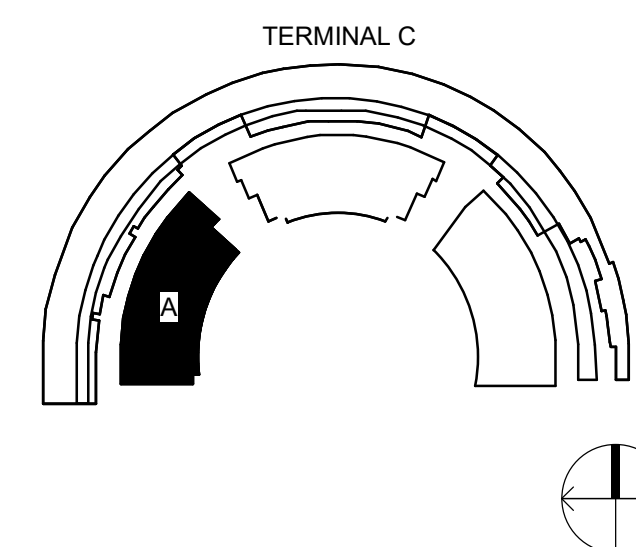

DFW
DALLAS
FORT WORTH
INTERNATIONAL
AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
1	2022-07-28	100% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


Garage A
GARAGE A POWER DEMOLITION PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

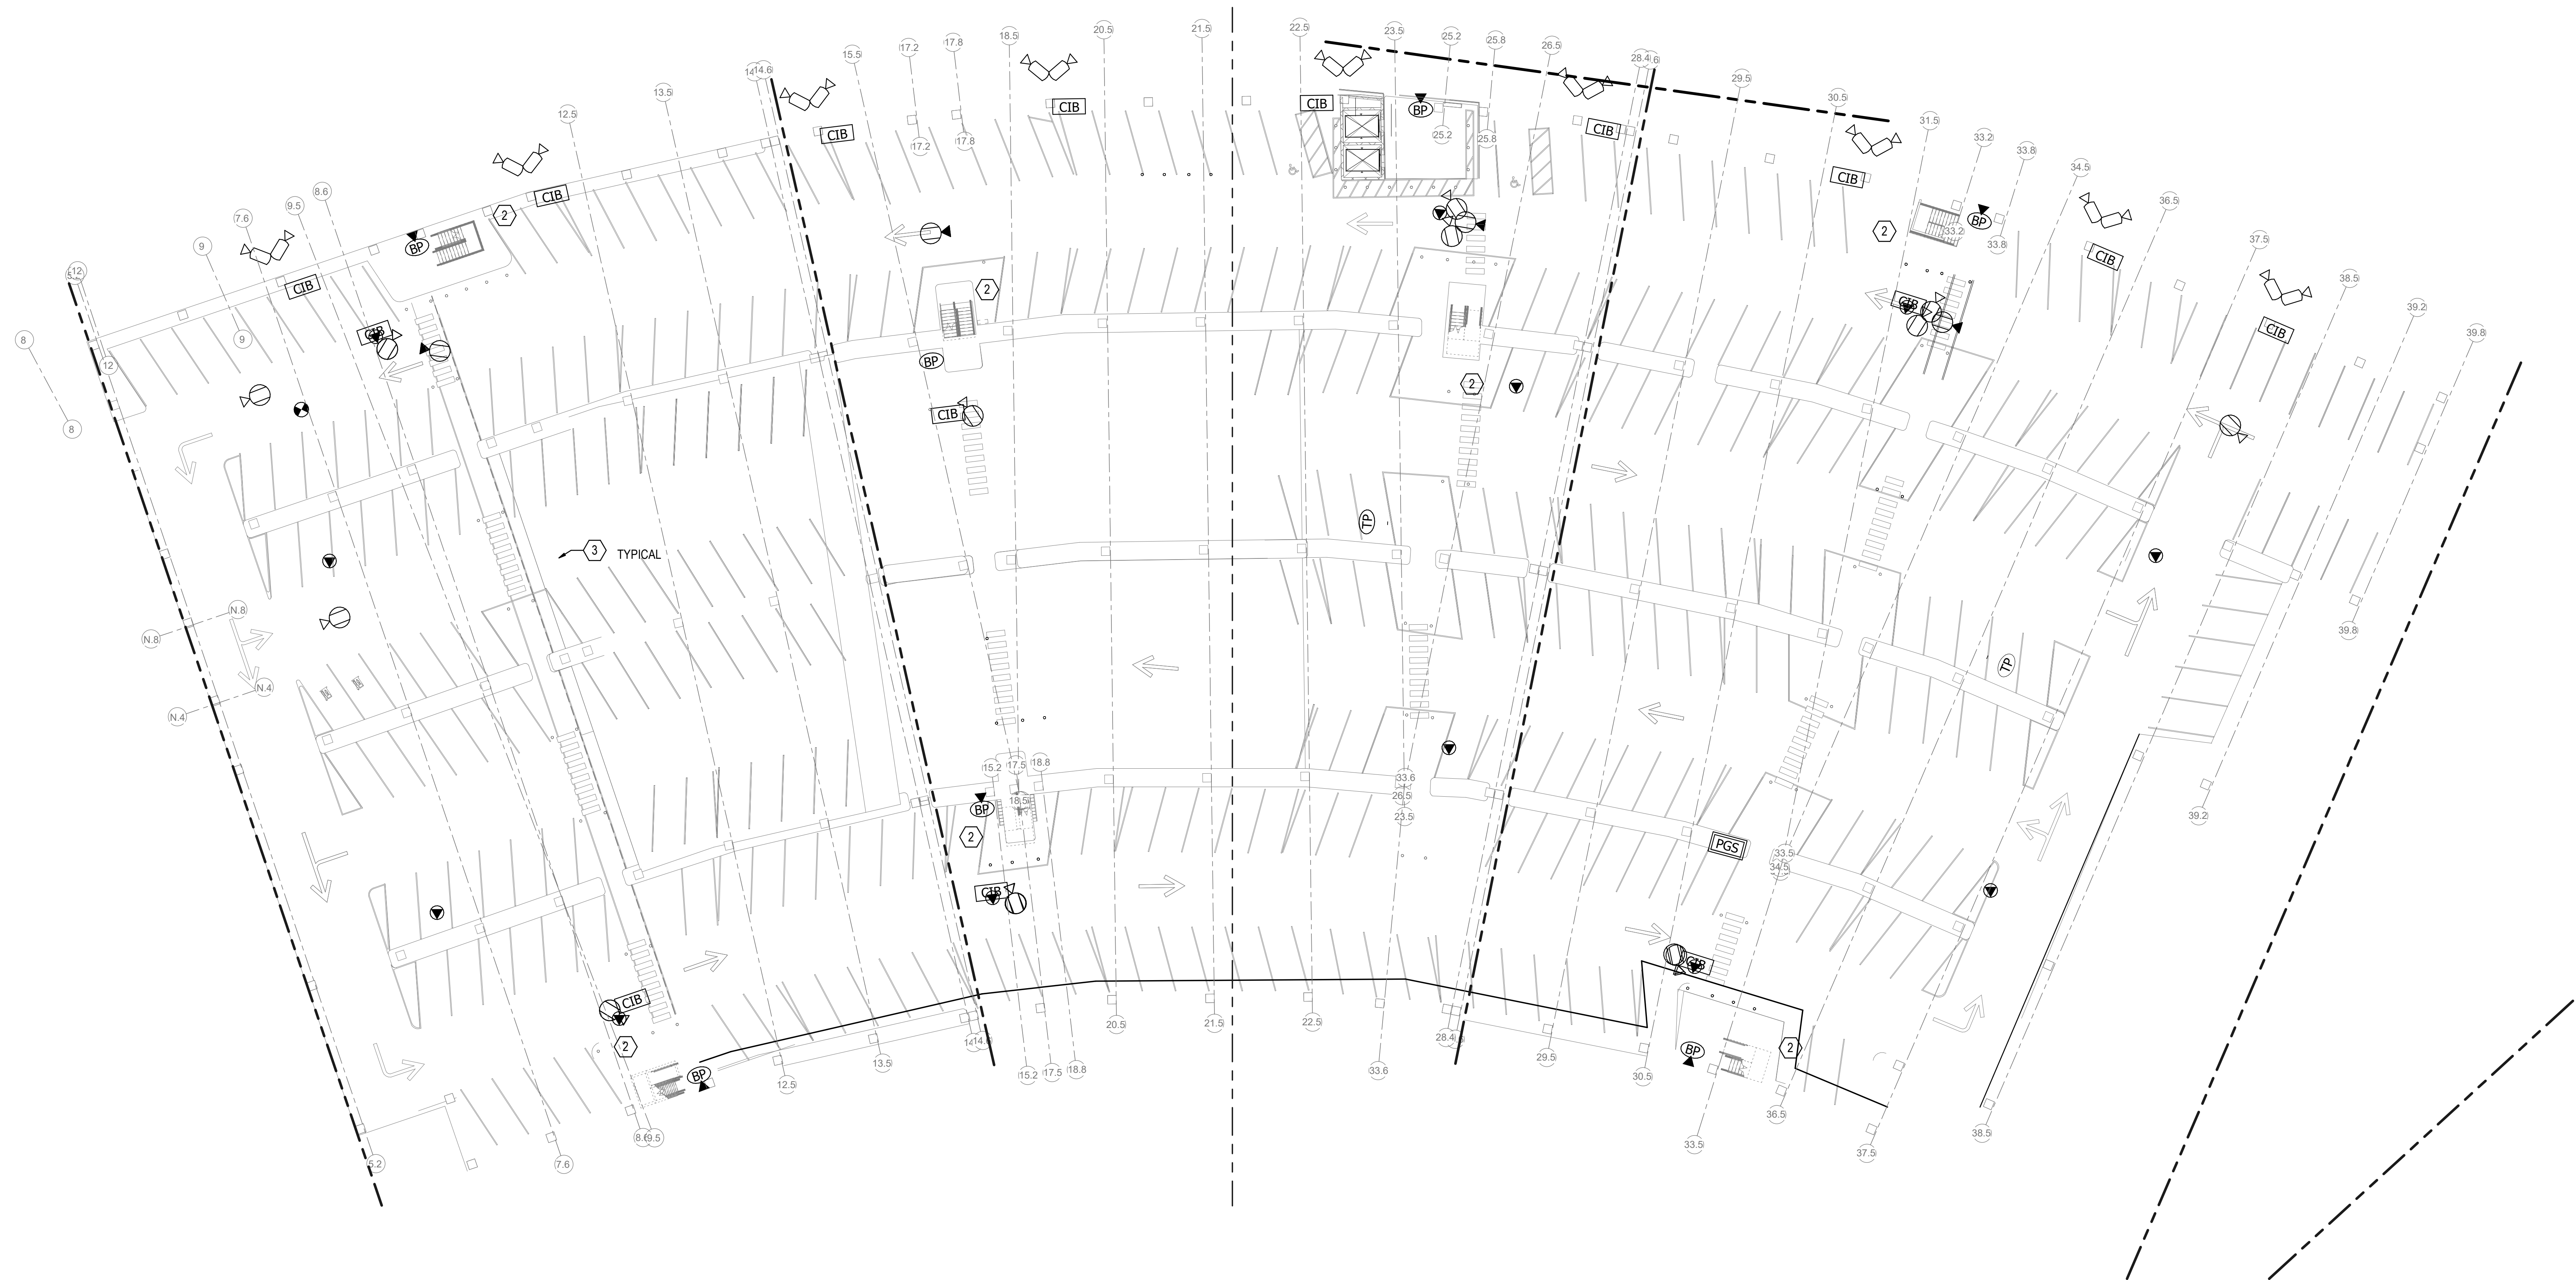


SHEET NOTES

1. REFER TO SHEET E-001-900A FOR ELECTRICAL SYMBOL, LEGENDS ABBREVIATIONS, AND ANY OTHER GENERAL REQUIREMENT.
2. REFER TO SHEET E-002-900A FOR SINGLE LINE DIAGRAM.
3. REFER TO SHEET E-501-900A FOR DETAILS.
4. REFERENCE SHEET SERIES E-601-900A TO E-604-900A FOR PANELBOARD SCHEDULES.
5. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
6. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH AND SECURITY REQUIREMENTS. VERIFY RECEPTACLE AND FACEPLATE COLOR WITH ARCHITECT.
7. CONTRACTOR SHALL COORDINATE DIRECTLY WITH THE OWNER'S AV/IT AND SECURITY SYSTEM VENDORS AS NECESSARY TO OBTAIN INSTALLATION DRAWINGS, WIRING DIAGRAMS ETC. THIS INFORMATION SHALL BE CONSIDERED PRIOR TO SUBMITTING A BID FOR THE WORK, AND ALL LABOR AND INCIDENTAL MATERIALS INCLUDED IN BID FOR A COMPLETE FUNCTIONING INSTALLATION.
8. PROVIDE NEW TYPE WRITTEN PANELBOARD DIRECTORIES FOR NEW AND EXISTING ELECTRICAL EQUIPMENT. PROVIDE PLASTIC LAMINATE LABELS SERVING ALL ELECTRICAL IDENTIFYING SUITE NUMBER, EQUIPMENT NAME FEED-BY AND VOLTAGE.
9. CIRCUIT NUMBERS ARE SHOWN FOR DESIGN INTENT ONLY. CONTRACTOR TO VERIFY CIRCUIT NUMBERS IN THE FIELD AND MAKE NECESSARY CHANGES AS REQUIRED.
10. OVERHEAD CONDUIT RUNS SHALL BE INSTALLED TO PROVIDE MAXIMUM CLEARANCE FOR VEHICLES.

SHEET KEYNOTES

1. POWER FOR ACTIVE WAYFINDER SIGNAGE. COORDINATE WITH WAYFINDER INSTALLER TO EXTEND POWER TO ACTIVE SIGNS IN PROXIMITY OF JUNCTION BOX. REFER AG100 SERIES DRAWINGS.
2. POWER FOR BLUE-LIGHT EMERGENCY CALL BOX. COORDINATE EXACT LOCATION PRIOR TO ROUGH-IN.

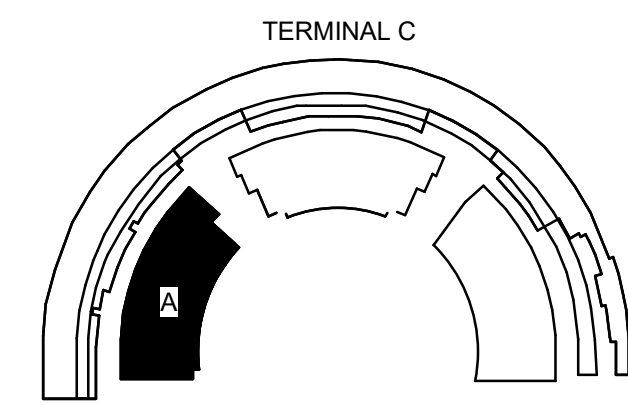

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972.470.0704
www.syska.com
Heidrich, Clark & Koenigsmann, Inc.
717 North Raveland Street
Suite 200, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-01-09	75% DESIGN
2	2022-03-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)


PROJECT NUMBER: TFD-007

Garage A
GARAGE A POWER PLAN - LEVEL B - PHASE 3

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP202-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

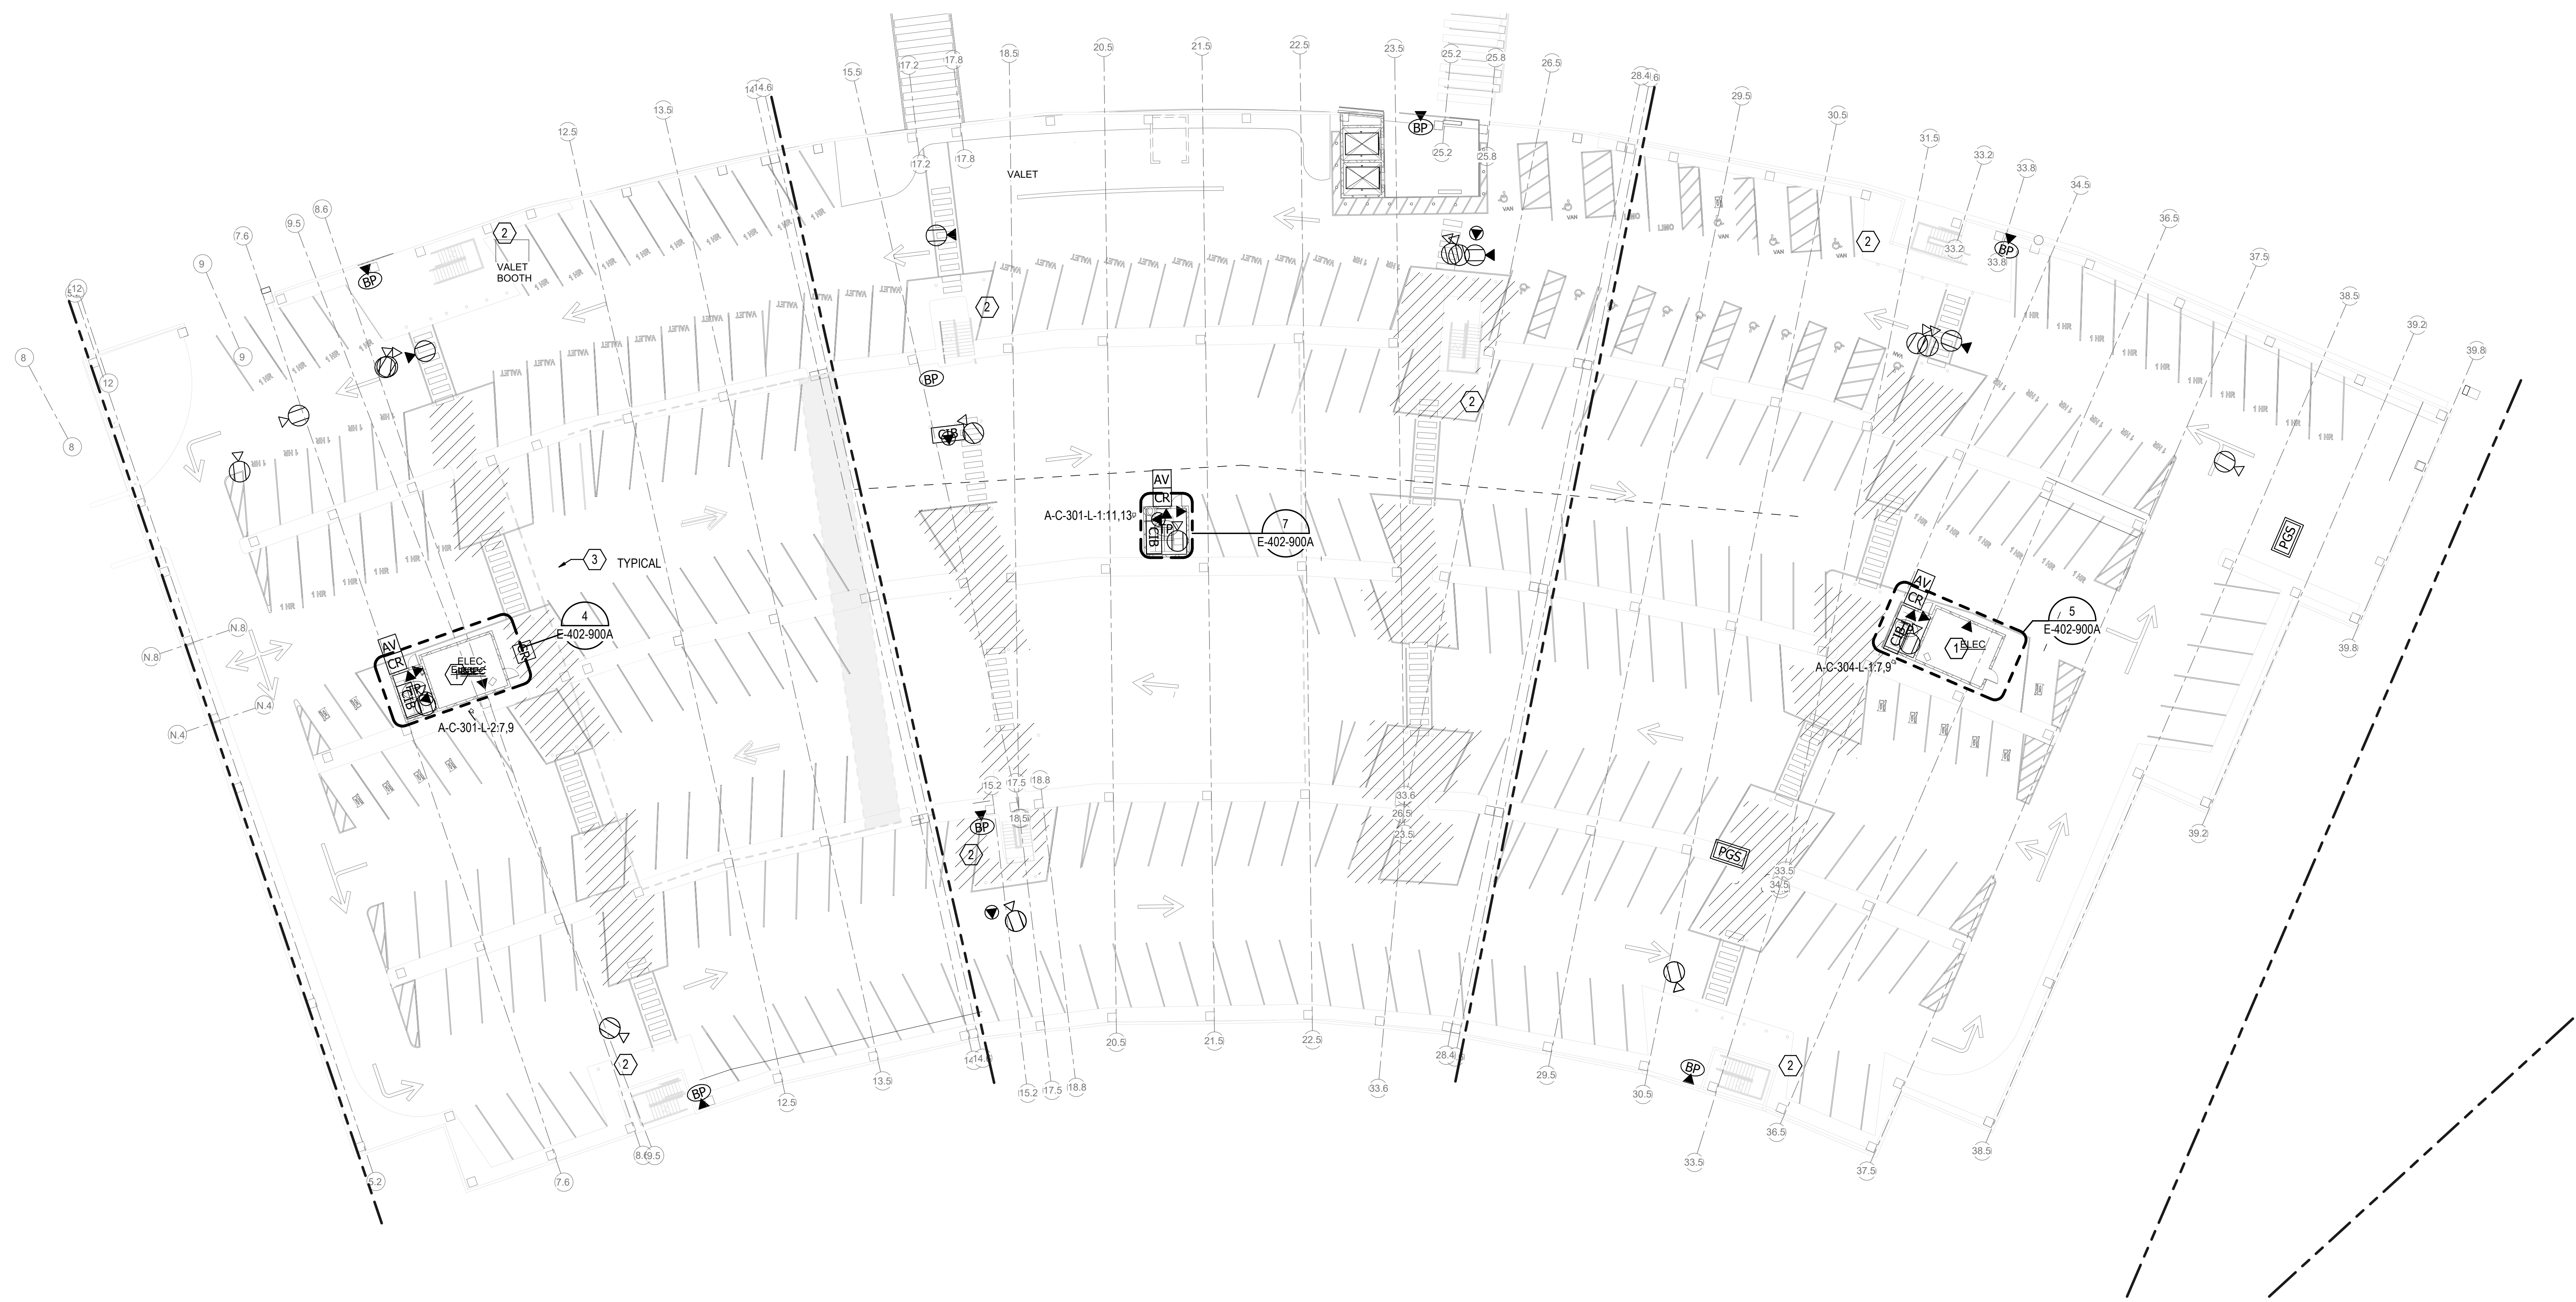


SHEET NOTES

1. REFER TO SHEET E-001-900A FOR ELECTRICAL SYMBOL, LEGENDS ABBREVIATIONS, AND ANY OTHER GENERAL REQUIREMENT.
2. REFER TO SHEET E-002-900A FOR SINGLE LINE DIAGRAM.
3. REFER TO SHEET E-501-900A FOR DETAILS.
4. REFERENCE SHEET SERIES E-601-900A TO E604-900A FOR PANELBOARD SCHEDULES.
5. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
6. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH AND SECURITY REQUIREMENTS. VERIFY RECEPTACLE AND FACEPLATE COLOR WITH ARCHITECT.
7. CONTRACTOR SHALL COORDINATE DIRECTLY WITH THE OWNER'S AV/VI AND SECURITY SYSTEM VENDORS AS NECESSARY TO OBTAIN INSTALLATION DRAWINGS, WIRING DIAGRAMS ETC. THIS INFORMATION SHALL BE CONSIDERED PRIOR TO SUBMITTING A BID FOR THE WORK, AND ALL LABOR AND INCIDENTAL MATERIALS INCLUDED IN BID FOR A COMPLETE FUNCTIONING INSTALLATION.
8. PROVIDE NEW TYPE WRITTEN PANELBOARD DIRECTORIES FOR NEW AND EXISTING ELECTRICAL EQUIPMENT. PROVIDE PLASTIC LAMINATE LABELS SERVING ALL ELECTRICAL IDENTIFYING SUITE NUMBER, EQUIPMENT NAME FEED-BY AND VOLTAGE.
9. CIRCUIT NUMBERS ARE SHOWN FOR DESIGN INTENT ONLY. CONTRACTOR TO VERIFY CIRCUIT NUMBERS IN THE FIELD AND MAKE NECESSARY CHANGES AS REQUIRED.
10. OVERHEAD CONDUIT RUNS SHALL BE INSTALLED TO PROVIDE MAXIMUM CLEARANCE FOR VEHICLES.

SHEET KEYNOTES

1. STUB-UP (2) 4" INTO ELECTRICAL ROOM FROM LEVEL A ELECTRICAL ROOM.
2. POWER FOR BLUE-LIGHT EMERGENCY CALL BOX. COORDINATE EXACT LOCATION PRIOR TO ROUGH-IN.
3. POWER FOR ACTIVE WAYFINDING SIGNAGE. COORDINATE WITH WAYFINDER INSTALLER TO EXTEND POWER TO ACTIVE SIGNS IN PROXIMITY OF JUNCTION BOX. REFER AG100 SERIES DRAWINGS.

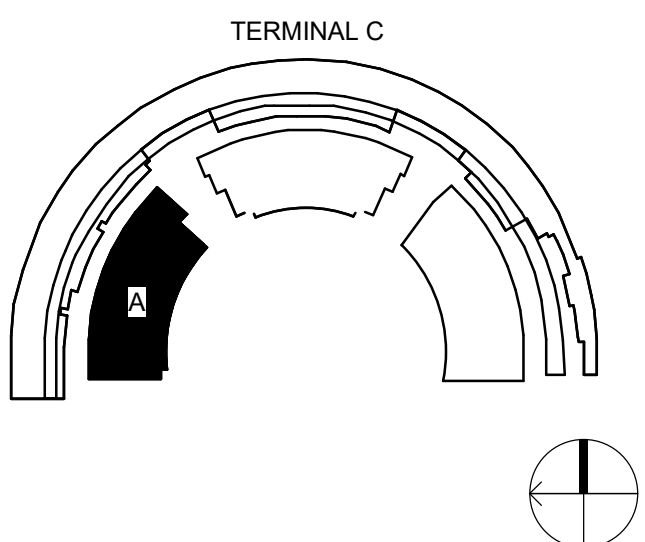

DRAWN BY: SHG
 APPROVED BY: WH
 ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	100% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A POWER PLAN - LEVEL C - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022


SHEET NUMBER
EP203-900A



2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261



h+k
 SYSKA HENNESSY GROUP
 A member company of SH Group, Inc.
 4925 Greenville Avenue
 Suite 415
 Dallas, TX 75206
 Tel: 972.470.0704
 www.syska.com

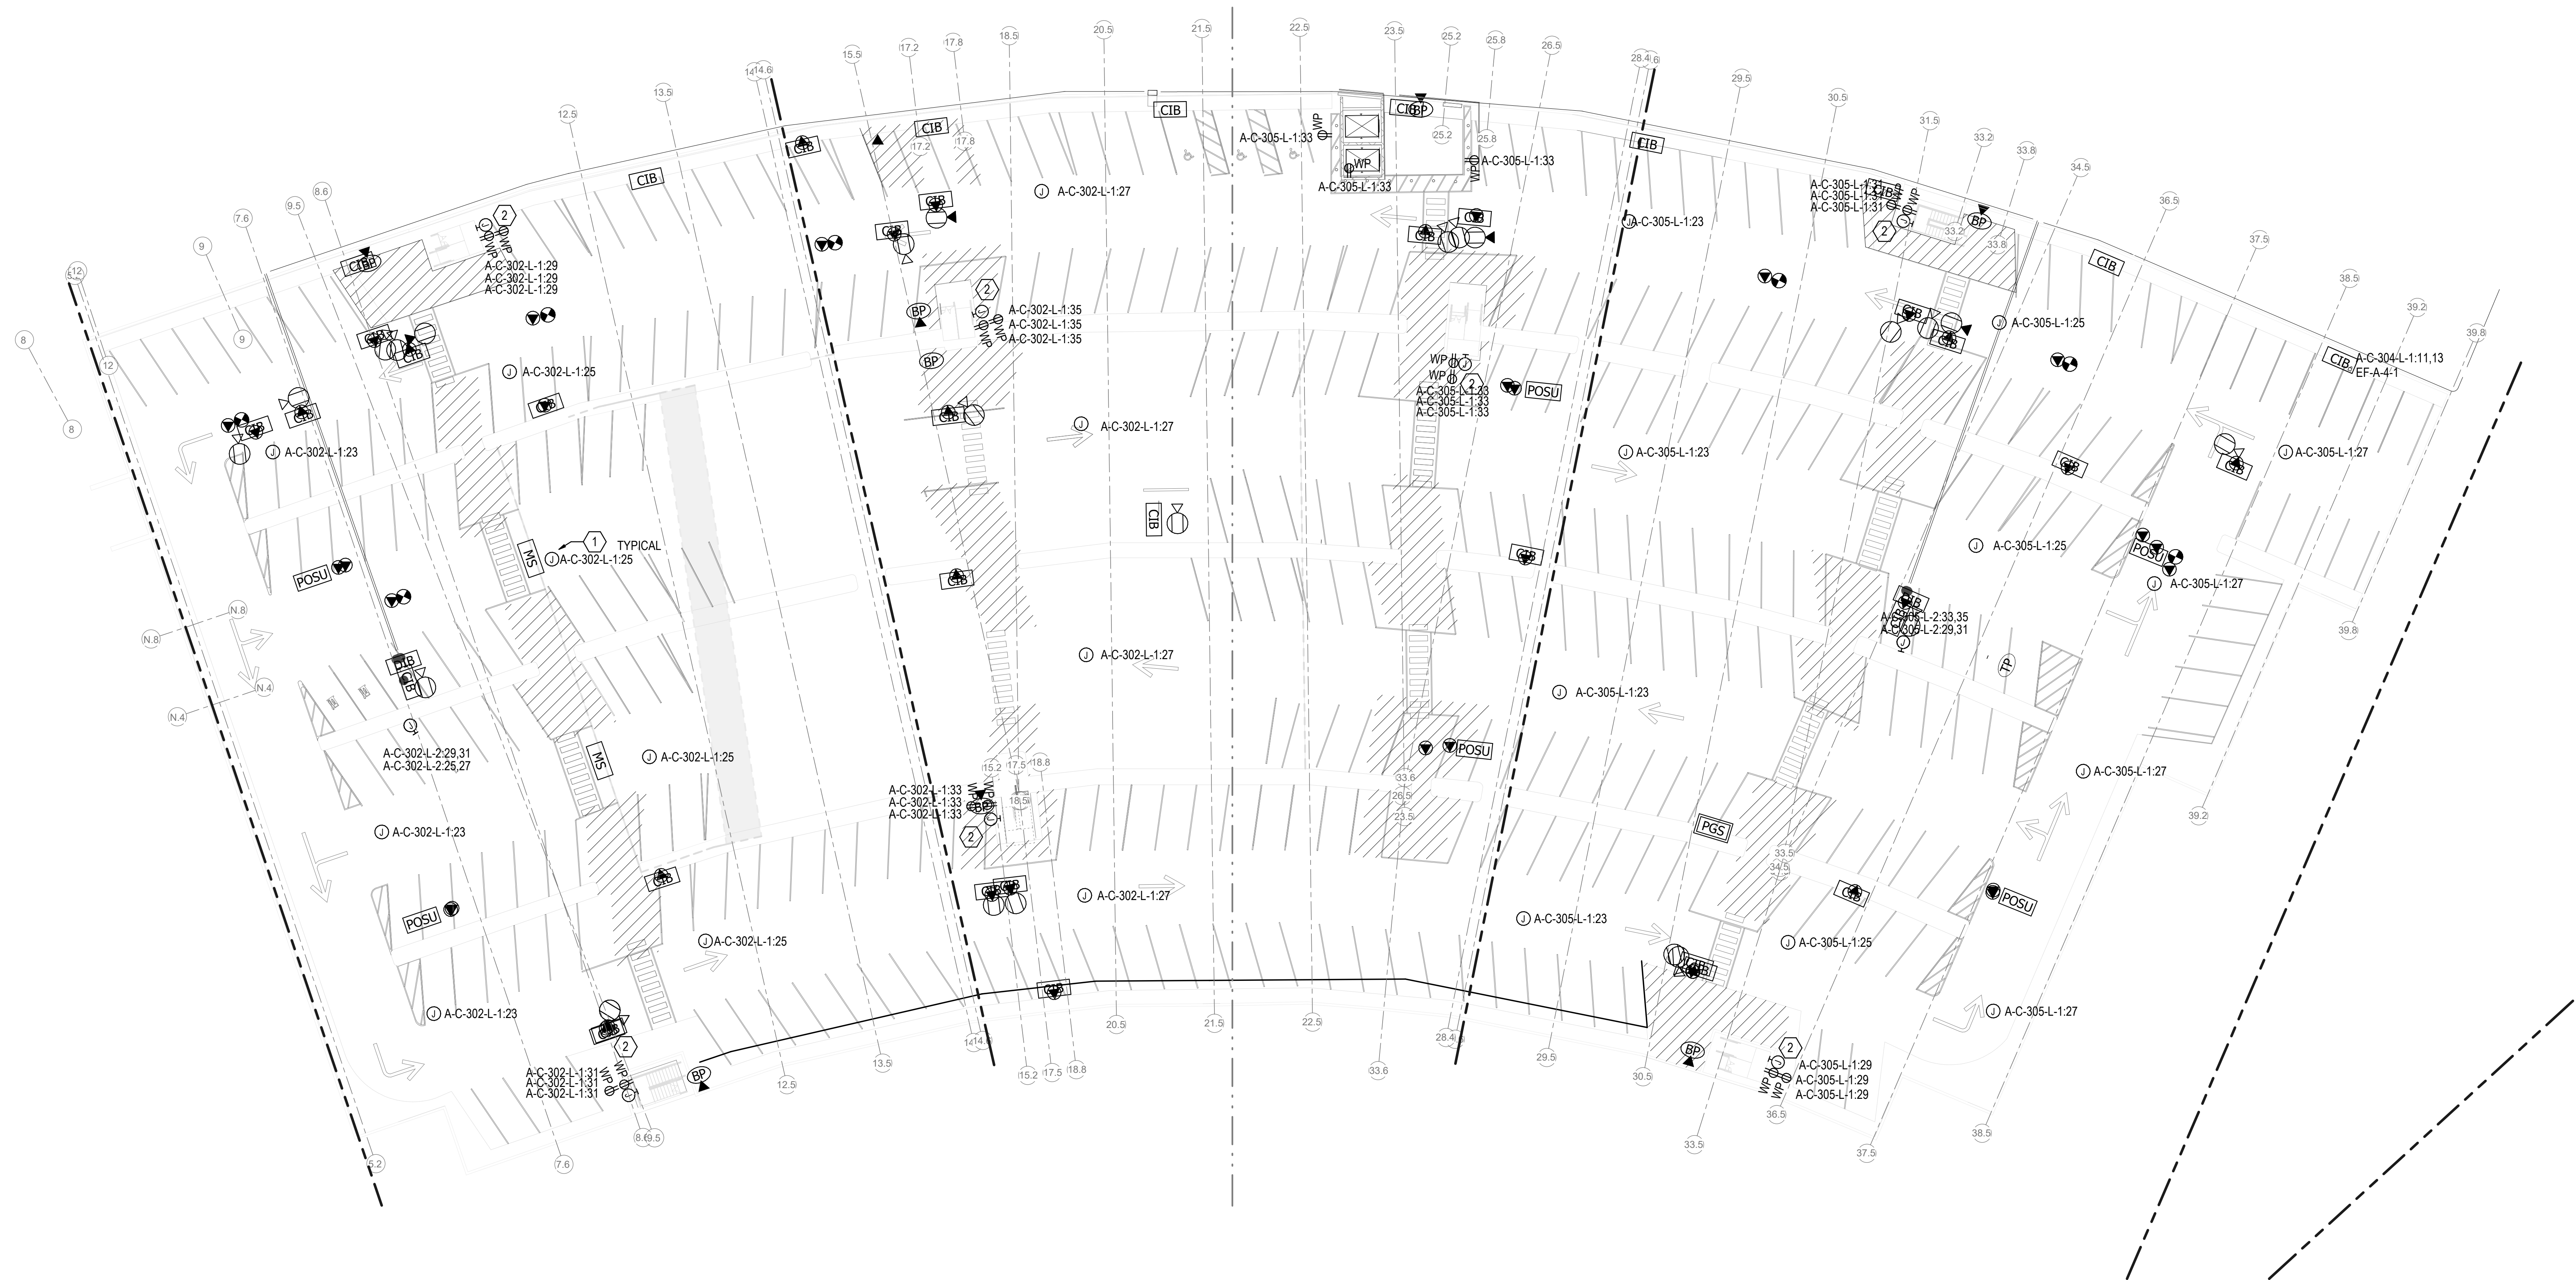


SHEET NOTES

1. REFER TO SHEET E-001-900A FOR ELECTRICAL SYMBOL, LEGENDS ABBREVIATIONS, AND ANY OTHER GENERAL REQUIREMENT.
2. REFER TO SHEET E-002-900A FOR SINGLE LINE DIAGRAM.
3. REFER TO SHEET E-501-900A FOR DETAILS.
4. REFERENCE SHEET SERIES E-601-900A TO E-604-900A FOR PANELBOARD SCHEDULES.
5. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
6. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH AND SECURITY REQUIREMENTS. VERIFY RECEPTACLE AND FACEPLATE COLOR WITH ARCHITECT.
7. CONTRACTOR SHALL COORDINATE DIRECTLY WITH THE OWNER'S AV/IT AND SECURITY SYSTEM VENDORS AS NECESSARY TO OBTAIN INSTALLATION DRAWINGS, WIRING DIAGRAMS ETC. THIS INFORMATION SHALL BE CONSIDERED PRIOR TO SUBMITTING A BID FOR THE WORK, AND ALL LABOR AND INCIDENTAL MATERIALS INCLUDED IN BID FOR A COMPLETE FUNCTIONING INSTALLATION.
8. PROVIDE NEW TYPE WRITTEN PANELBOARD DIRECTORIES FOR NEW AND EXISTING ELECTRICAL EQUIPMENT. PROVIDE PLASTIC LAMINATE LABELS SERVING ALL ELECTRICAL IDENTIFYING SUITE NUMBER, EQUIPMENT NAME FEED-BY AND VOLTAGE.
9. CIRCUIT NUMBERS ARE SHOWN FOR DESIGN INTENT ONLY. CONTRACTOR TO VERIFY CIRCUIT NUMBERS IN THE FIELD AND MAKE NECESSARY CHANGES AS REQUIRED.
10. OVERHEAD CONDUIT RUNS SHALL BE INSTALLED TO PROVIDE MAXIMUM CLEARANCE FOR VEHICLES.

SHEET KEYNOTES

1. POWER FOR ACTIVE WAYFINDER SINGAGE. COORDINATE WITH WAYFINDER INSTALLER TO EXTEND POWER TO ACTIVE SIGNS IN PROXIMITY OF JUNCTION BOX. REFER AG100 SERIES DRAWINGS
2. POWER FOR BLUE-LIGHT EMERGENCY CALL BOX. COORDINATE EXACT LOCATION PRIOR TO ROUGH-IN.

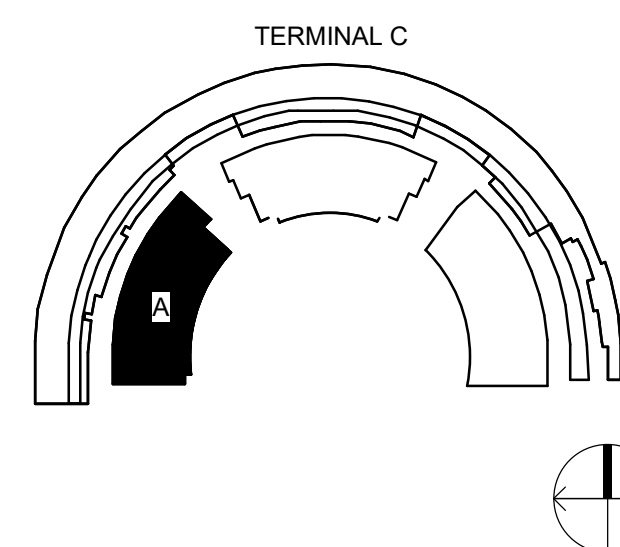

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
4925 Greenville Avenue
Suite 415
Dallas, TX 75206
Tel: 972-470-0704
www.syska.com

Helmuth, Obata & Kassabaum, Inc.
717 North River Street
Suite 2000, LB #
Dallas, TX 75201
+1214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	100% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A

GARAGE A POWER PLAN - LEVEL D - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP204-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




SHEET NOTES

1. REFER TO SHEET E-001-900A FOR ELECTRICAL SYMBOL, LEGENDS, ABBREVIATIONS, AND ANY OTHER GENERAL REQUIREMENT.
2. REFER TO SHEET E-002-900A FOR SINGLE LINE DIAGRAM.
3. REFER TO SHEET E-501-900A FOR DETAILS.
4. REFERENCE SHEET SERIES E-601-900A TO E-604-900A FOR PANELBOARD SCHEDULES.
5. COORDINATE EXACT LOCATION OF ALL EQUIPMENT WITH ALL TRADES PRIOR TO INSTALLATION.
6. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, HEIGHT, FINISH AND SECURITY REQUIREMENTS. VERIFY RECEPTACLE AND FACEPLATE COLOR WITH ARCHITECT.
7. CONTRACTOR SHALL COORDINATE DIRECTLY WITH THE OWNER'S AV/IT AND SECURITY SYSTEM VENDORS AS NECESSARY TO OBTAIN INSTALLATION DRAWINGS, WIRING DIAGRAMS ETC. THIS INFORMATION SHALL BE CONSIDERED PRIOR TO SUBMITTING A BID FOR THE WORK, AND ALL LABOR AND INCIDENTAL MATERIALS INCLUDED IN BID FOR A COMPLETE FUNCTIONING INSTALLATION.
8. PROVIDE NEW TYPE WRITTEN PANELBOARD DIRECTORIES FOR NEW AND EXISTING ELECTRICAL EQUIPMENT. PROVIDE PLASTIC LAMINATE LABELS SERVING ALL ELECTRICAL IDENTIFYING SUITE NUMBER, EQUIPMENT NAME FEED-BY AND VOLTAGE.
9. CIRCUIT NUMBERS ARE SHOWN FOR DESIGN INTENT ONLY. CONTRACTOR TO VERIFY CIRCUIT NUMBERS IN THE FIELD AND MAKE NECESSARY CHANGES AS REQUIRED.

SHEET KEYNOTES

1. POWER FOR BLUE-LIGHT EMERGENCY CALL BOX. COORDINATE EXACT LOCATION PRIOR TO ROUGH-IN.

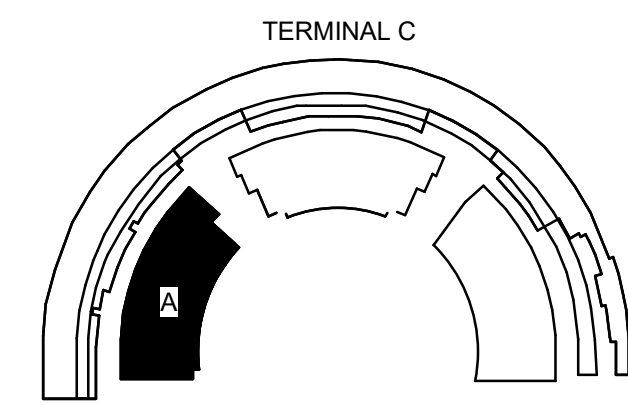

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k
SYSKA HENNESSY GROUP
A member company of SH Group, Inc.
Heidrich, Gluck & Krumboltz, Inc.
717 North Meadows Drive
Suite 2000, LB #
Dallas, TX 75201
+1 214 728 6000

DRAWN BY: SHG
APPROVED BY: WH
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2022-07-28	75% DESIGN
2	2022-09-01	100% DESIGN
3	2022-07-28	100% ISSUED FOR PERMIT (IFP)

Garage A
GARAGE A ELECTRICAL PLAN - LEVEL E - PHASE 3

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
EP205-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

LEGEND NOTES	
1.	THIS IS A STANDARD SYMBOL LIST. ALL SYMBOLS MAY NOT APPEAR ON THIS PROJECT.
2.	COORDINATE THE INSTALLATION OF ALL DATA COMMUNICATION JACKS WITH THE LOCATION OF ALL 120 VAC CIRCUITS PROVIDED FOR THE PROPER CONNECTION OF ALL TECHNOLOGY EQUIPMENT. REFER TO ELECTRICAL POWER DRAWINGS AND FURNITURE PLANS FOR EXACT DEVICE LOCATIONS.
3.	ALL MOUNTING HEIGHTS ARE TO CENTERLINE OF ALL DEVICES AND EQUIPMENT, UNLESS OTHERWISE NOTED.
4.	IN GENERAL, SYMBOLS SHOWN WITH LIGHT LINES DENOTE EXISTING WORK, SYMBOLS SHOWN WITH HEAVY LINES DENOTE NEW WORK.

BUILDING LEGEND	
300	TERMINAL C
900	TERMINAL C GARAGES
900A	TERMINAL C GARAGE A
900B	TERMINAL C GARAGE B
900C	TERMINAL C GARAGE C

GENERAL SYMBOLS	
	DETAIL PLAN DETAIL REFERENCE SHEET
	ELEVATION REFERENCE
	SECTION REFERENCE SHEET
	NORTH ARROW PLAN
	ROOM NAME AND NUMBER
	SHEET KEYED NOTE DESIGNATION
	DETAIL / DIAGRAM SPECIFIC KEYED NOTE DESIGNATION
	REVISION OR ADDENDUM DESIGNATION
	MATCHLINE

DATA	
SYMBOL	DESCRIPTION
	WALL OUTLET
	FLOOR OUTLET
	CEILING OUTLET

MOUNT CONFIGURATIONS	
TYPE	DESCRIPTION
A	GENERIC FLUSH MOUNTED
B	GENERIC SURFACE MOUNTED
E	EMERGENCY PHONES
G	PARKING GUIDANCE SYSTEM
P	PANEL
S	SURVEILLANCE DEVICES
W	WIRELESS ACCESS POINTS

JUNCTION BOXES AND PULLBOXES	
	JUNCTION BOX
	HANDHOLE
	PULL BOX
	MAINTENANCE HOLE

GROUNDING	
	TELECOM GROUNDING BUSBAR
	TELECOM MAIN GROUNDING BUSBAR

CONDUIT AND RACEWAY	
	CONDUIT OR SLEEVE TURNING UP
	CONDUIT OR SLEEVE TURNING DOWN
	CONDUIT CONCEALED IN CEILING OR WALL
	CONDUIT IN SLAB OR UNDERGROUND
	CONDUIT SLEEVE
	CONDUIT CAPPED
	LADDER RACK
	HOMERUN

EQUIPMENT	
SYMBOL	DESCRIPTION
	ENCLOSED EQUIPMENT CABINET
	OPEN FRAME EQUIPMENT RACK VERTICAL WIRE MANAGEMENT, TYP
	WALL MOUNTED CABINET
	PANEL/WALL MOUNT EQUIPMENT


WIRELESS NETWORK	
	WIRELESS ACCESS POINT ENCLOSURE WIRELESS ACCESS POINT PROVIDED AND INSTALLED BY OWNER

PARKING GUIDANCE	
	PARKING GUIDANCE SENSOR
	PARKING GUIDANCE SIGNAGE
	POWER SUPPLY AND COMMUNICATION MODULE
	MICROWAVE SENSOR

TELEPHONE	
	WALL MOUNT TELEPHONE (BY OWNER)

EMERGENCY	
	EMERGENCY BLUE PHONE

ABBREVIATIONS	
A/AMP	AMPERE
AC	ABOVE COUNTER
ADA	AMERICANS WITH DISABILITIES ACT
ADGS	AUTOMATIC DOCKING GUIDANCE SYSTEM
AEC	ACOUSTIC ECHO CANCELLATION
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
AL	ALUMINUM
ALP	AIRPORT LAYOUT PLAN
AMP	AMPLIFIER
AODB	AIRPORT OPERATIONAL DATABASE
AP	WIRELESS ACCESS POINT
ATBPP	AUTOMATIC TICKET AND BOARDING PASS PRINTER
ATO	AIRLINE TICKET OFFICE
AV	AUDIO VIDEO
AVGDS	AIRCRAFT VISUAL DOCKING GUIDANCE SYSTEM
AWG	AMERICAN WIRE GAUGE
BC	BELOW CEILING
BFC	BELOW FINISHED CEILING
BIDS	BAGGAGE INFORMATION DISPLAY SYSTEM
BMS	BUILDING MANAGEMENT SYSTEM
BP	BLUE PHONE
BPP	BOARDING PASS PRINTER
BPR	BOARDING PASS READER
BSO	BAGGAGE SERVICE OFFICE
BTP	BAGGAGE TAG PRINTER
C	CONDUIT
CAT	CATEGORY
CATV	CABLE TELEVISION
CBP	CUSTOMS AND BORDER PATROL
CH	CHANNEL
CIDS	COUNTER INFORMATION DISPLAY SYSTEM
CM	CENTIMETER
CMPT	COMPONENT
CNN	CABLE NEWS NETWORK
COMM	COMMUNICATIONS
CPST	COMPOSITE
CPU	CENTRAL PROCESSING UNIT
CR	COMMUNICATIONS ROOM
CRT	CATHODE RAY TUBE
CU	COPPER
CUPPS	COMMON USE PASSENGER PROCESSING SYSTEM
CUSS	COMMON USE SELF-SERVICE
CUW	COMMON USE WORKSTATION
DAS	DISTRIBUTED ANTENNA SYSTEM
DB	DECIBEL
DBS	DIRECT BROADCAST SATELLITE
DEMO	DEMOLISH
DHS	DEPARTMENT OF HOMELAND SECURITY
DIA	DIAMETER
DSP	DIGITAL SIGNAL PROCESSING
DWG	DRAWING
EA	EACH
EC	ELECTRICAL CONTRACTOR
EDID	EXTENDED DIGITAL IDENTIFICATION DATA
EIA	ELECTRONICS INDUSTRY ASSOCIATION
ELEC	ELECTRIC/ELECTRICAL
ELEV	ELEVATOR
EMER	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
EO	EQUAL
EQ	EQUALIZER
ERP	EMERGENCY RESPONSE PLAN
EVIDS	ELECTRONIC VISUAL INFORMATION DISPLAY SYSTEM
EX	EXISTING
FA	FIRE ALARM
FAA	FEDERAL AVIATION AUTHORITY
FAR	FEDERAL AVIATION REGULATION
FIDS	FLIGHT INFORMATION DISPLAY SYSTEM
FIS	FEDERAL INSPECTION SERVICE
FL	FLOOR
FMC	FLEXIBLE METAL CONDUIT
FO	FIBER OPTIC
FPD	FLAT PANEL DISPLAY
GC	GENERAL CONTRACTOR
GIDS	GATE INFORMATION DISPLAY SYSTEM
GRD	GROUND
GRS	GALVANIZED RIGID STEEL
HDCP	HIGH BANDWIDTH DIGITAL CONTENT PROTECTION
HDMI	HIGH DEFINITION MULTIMEDIA INTERFACE
HH	HANDHOLE
HVAC	HEATING VENTILATING AIR CONDITIONING
HZ	HERTZ
IDF	INTERMEDIATE DISTRIBUTION FRAME
IG	ISOLATED GROUND
IMC	INTERMEDIATE METAL CONDUIT
IP	INTERNET PROTOCOL
IP	INPUT PANEL
IR	INFRARED
ISC	INTELLIGENT SYSTEM CONTROLLER
IT	INFORMATION TECHNOLOGY
ITO	INFORMATION TECHNOLOGY OUTLET
JB	JUNCTION BOX
KVA	KILOVOLT AMPERE
KW	KILOWATT
LA	LIGHTNING ARRESTER
LAN	LOCAL AREA NETWORK
LBA	LOCAL BOARDING APPLICATION
LCD	LIQUID CRYSTAL DISPLAY
LDSCS	LOCAL DEPARTURE CONTROL SYSTEM
LED	LIGHT EMITTING DIODE
LFMC	LIQUIT TIGHT FLEXIBLE METALLIC CONDUIT
LFNC	LIQUID TIGHT FLEXIBLE NONMETALLIC CONDUIT
LTG	LIGHTING
LV	LOW VOLTAGE
M	METER
MATV	MASTER ANTENNA TELEVISION
MC	MECHANICAL CONTRACTOR
MCR	MAIN COMMUNICATION ROOM
MDF	MAIN DISTRIBUTION FRAME
MFR	MANUFACTURER
MH	MANHOLE
MIC	MICROPHONE
MISC	MISCELLANEOUS
MM	MILLIMETER
MMFO	MULTI-MODE FIBER OPTIC
MNS	MASS NOTIFICATION SYSTEM
MUFIDS	MULTI-USER FLIGHT INFORMATION DISPLAY SYSTEM
N/A	NOT AVAILABLE/NOT APPLICABLE
NEC	NATIONAL ELECTRICAL CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NFFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
OAR	OWNER AUTHORIZED REPRESENTATIVE
OC	ON CENTER
OFNR	OPTICAL FIBER NON-CONDUCTIVE RISER CABLE
OLT	OPTICAL LINE TERMINAL
ONT	OPTICAL NETWORK TERMINAL
OP	OUTPUT PANEL
OTS	OFF THE SHELF
PA	PUBLIC ADDRESS
PB	PULL BOX
PBX	PRIVATE BRANCH EXCHANGE
PC	PERSONAL COMPUTER
PDS	PREMISE DISTRIBUTION SYSTEM
PGS	PARKING GUIDANCE SYSTEM
PLY	PLYWOOD
PNL	PANEL
PON	PASSIVE OPTICAL NETWORK
POSU	POWER SUPPLY MODULE
PP	PATCH PANEL/POWER PANEL
PR	PAIR
PSTN	PUBLIC SWITCHED TELEPHONE NETWORK
PVC	POLYVINYL CHLORIDE
RF	RADIO FREQUENCY
RGB	RED, GREEN, BLUE SIGNAL
RGS	RIGID GALVANIZED STEEL
RIDS	RAMP INFORMATION DISPLAY SYSTEM
RM	ROOM
RMC	RIGID METAL CONDUIT
RMS	RESOURCE MANAGEMENT SYSTEM
RU	RACK UNIT
SBD	SELF BAG DROP
SCH/SCHED	SCHEDULE
SHLD	SHIELDED (AS IN CABLE)
SIDA	SECURE IDENTIFICATION DISPLAY AREA
SMATV	SATELLITE MASTER ANTENNA TELEVISION
SMFO	SINGLE-MODE FIBER OPTIC
SNMP	SIMPLE NETWORK MANAGEMENT PROTOCOL
SS	STAINLESS STEEL
SSCB	SECURITY SCREENING CHECKPOINT
STB	SET TOP BOX
TB	TIE BOX
TBD	TO BE DETERMINED
TDC	TUBE DISTRIBUTION CABINET
TDM	TIME DIVISION MULTIPLEXING
TDS	TELECOMMUNICATION DISTRIBUTION SYSTEM
TE	TELECOM ENCLOSURE
TELE	TELEPHONE
TELECOM	TELECOMMUNICATIONS
TGB	TELECOMMUNICATIONS GROUND BUSBAR
TIA	TELECOMMUNICATIONS INDUSTRY ASSOCIATION
TMGB	TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
TS	TOUCH SCREEN
TSA	TRANSPORTATION SECURITY ADMINISTRATION
TSP	TWISTED SHIELDED PAIR
TV	TELEVISION
TYP	TYPICAL
UL	UNDERWRITER'S LABORATORIES
UON	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTIBLE POWER SUPPLY
USCBP	UNITED STATES CUSTOMS AND BORDER PROTECTION
USCS	UNITED STATES CUSTOMS SERVICE
UTP	UNSHIELDED TWISTED PAIR
V	VOLT
VAC	VOLT ALTERNATING CURRENT
VC	VIDEO CONFERENCE
VC	VOLUME CONTROL
VDC	VOLT DIRECT CURRENT
VE	VOICE EVACUATION
VGA	VIDEO GRAPHICS ARRAY
VOIP	VOICE OVER INTERNET PROTOCOL
W/	WITH
W/IN	WITHIN
W/O	WITHOUT
WAP	WIRELESS ACCESS POINT
WIFI	WIRELESS FIDELITY
WLAN	WIRELESS LAN
WP	WEATHERPROOF
WT	WATERTIGHT
XFMR	TRANSFORMER
XLR	ELECTRICAL AUDIO CONNECTOR
XMTR	TRANSMITTER
XP	EXPLOSION PROOF

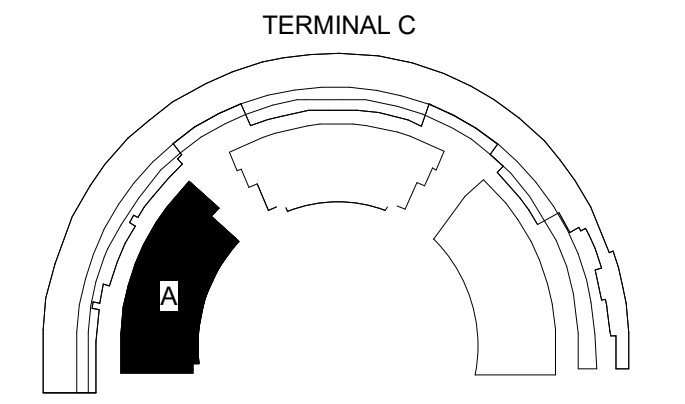

DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: BURNS/HOK
APPROVED BY: MM/FR
ISSUE DATE: 2022-07-28

NO.	DATE	DESCRIPTION
1	2021-10-23	30% DESIGN
2	2022-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM LEGEND AND ABBREVIATIONS

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN001-900A

TELECOM PACKAGE NOTES

- ALL ITEMS NOTED ON THE LEGENDS DO NOT NECESSARILY APPEAR ON PLANS.
- THESE NOTES APPLY TO ALL SYSTEMS IN THE DRAWING PACKAGE. SYSTEM SPECIFIC NOTES ARE IN ADDITION TO THE GENERAL NOTES.
- DRAWINGS FOR THIS WORK ARE DIAGRAMMATIC AND INTENDED TO CONVEY THE EXTENT, GENERAL ARRANGEMENT AND LOCATIONS OF THE WORK. DUE TO THE DRAWING SCALE, ALL ITEMS SUCH AS ACCESS PANELS, CONDUITS, PENETRATION SLEEVES, PULL BOXES, BACKBOXES AND JUNCTION BOXES MAY NOT BE SHOWN. PROVIDE ALL EQUIPMENT AND WORK FOR A COMPLETELY OPERATIONAL SYSTEM, MEETING CODE REQUIREMENTS, MANUFACTURER RECOMMENDATIONS, AND SPECIFICATION SECTIONS.
- DUE TO DRAWING SCALE, EQUIPMENT SYMBOLS ARE SHOWN AS CLOSE AS POSSIBLE TO THEIR INTENDED LOCATION. CONTRACTOR SHALL FIELD COORDINATE THE PROPER INSTALLATION OF ALL EQUIPMENT, DEVICES, CONTROLS AND CABLING. REFER TO RELATED SPECIFICATION SECTIONS FOR FUNCTIONAL OPERATION AND ADDITIONAL REQUIREMENTS.
- LOCATION OF ALL DEVICES ON PLANS ARE APPROXIMATE ONLY. VERIFY EXACT LOCATIONS, HEIGHTS, ETC. WITH OWNER AND/OR ARCHITECT PRIOR TO ROUGH-IN.
- COORDINATE CONDITIONS RELATED TO THE INSTALLATION OF WORK WITH THE GENERAL CONTRACTOR, RELATED TRADES, AND SYSTEM INTEGRATORS.
- COORDINATE WITH THE APPROPRIATE TRADE ALL INSTALLATION REQUIREMENTS IMPACTING THE PLACEMENT OF SYSTEM COMPONENTS TO THE SATISFACTION OF ALL CONCERNED TRADES.
- ALL NEW EQUIPMENT AND DEVICES SHALL MATCH EXISTING SYSTEM COMPONENTS AND BE FULLY COMPATIBLE WITH EXISTING SYSTEM.

TELECOM SYSTEMS NOTES

- REFER TO RELATED DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION AND/OR REQUIREMENTS RELATED TO THE INSTALLATION, PROGRAMMING, TESTING, COMMISSIONING AND CERTIFICATION OF ALL COMMUNICATIONS SYSTEMS.

TELECOM PATHWAY AND CABLING NOTES

- INSTALL COMMUNICATIONS HORIZONTAL CABLE IN ACCORDANCE WITH NEC ARTICLE 800, APPLICATIONS FOR CABLE ROUTING AND ASSEMBLIES.
- INSTALL LISTED CABLES AS REQUIRED BY THEIR APPLICATION; INSTALL RISER RATED CABLE IN RACEWAY AND PLENUM RATED CABLE WHERE ROUTED IN ENVIRONMENTAL AIR SPACES.
- ROUTE BACKBONE CABLING IN DEDICATED TELECOMMUNICATIONS BACKBONE CONDUITS AND VERTICAL CONDUIT CHASES.
- PROVIDE PROTECTIVE INNERDUCT CONDUIT SYSTEM IN ALL TELECOMMUNICATIONS BACKBONE CONDUITS.
- ALIGN DATA OUTLETS WITH ELECTRICAL RECEPTACLES, SWITCHES, AND SIMILAR WALL MOUNTED EQUIPMENT.
- COORDINATE THE EXACT LOCATION OF DATA OUTLETS WITH ELECTRICAL RECEPTACLES AND FURNITURE PLANS PRIOR TO INSTALLATION.
- COORDINATE EXACT LOCATION OF ALL DESK, FURNITURE, COUNTER, CEILING MOUNTED EQUIPMENT, DATA, CONDUITS, WITH ALL ARCHITECTURAL PLANS, REFLECTED CEILING PLANS AND ALL TRADE PLANS PRIOR TO INSTALLATION.
- ALL CABLES AND RACEWAYS SHALL BE CONCEALED UNLESS SPECIFICALLY NOTED OTHERWISE OR APPROVED BY ENGINEER.
- ALL CONDUITS SHALL BE A MINIMUM OF 1" UNLESS OTHERWISE NOTED.
- ALL CONDUITS SHALL BE SIZED AND INSTALLED IN ACCORDANCE WITH NFPA 70 AND PROJECT SPECIFICATIONS.
- PROVIDE PULL STRINGS IN ALL EMPTY RACEWAYS/CONDUITS.
- ALL RACEWAY TERMINATIONS SHALL HAVE BUSHINGS AND BE GROUNDED WHERE RACEWAY IS METAL.
- WHERE EQUIPMENT AND/OR JUNCTION BOXES ARE INSTALLED ABOVE FINISHED CEILINGS, PROVIDE ACCESS HATCHES LISTED FOR THE INTENDED APPLICATION. ACCESS HATCHES SHALL BE LOCATED FOR UNIMPEDED SERVICE ACCESS TO THE CABLING AND EQUIPMENT.
- PENETRATIONS OF RATED WALLS AND/OR FLOORS SHALL BE FIRE STOPPED IN ACCORDANCE WITH ASTM AND NFPA REQUIREMENTS FOR THE RATING.
- INSTALLATION OF FIRE-STOPS SHALL BE PERFORMED BY A QUALIFIED APPLICATOR/INSTALLER TRAINED BY THE MANUFACTURER.
- INSTALLATION OF FIRE-STOPS SHALL BE PERFORMED IN STRICT ACCORDANCE WITH MANUFACTURER'S DETAILED INSTALLATION PROCEDURES.
- COORDINATE ALL EQUIPMENT AND CABINET RU SPACE REQUIREMENTS WITH THE APPROPRIATE SYSTEM INTEGRATOR.
- ALL SYSTEM WIRING, CONDUITS AND EQUIPMENT INSTALLATION SHALL BE IN ACCORDANCE WITH IEEE, EIA, NEC, AND INDUSTRY BEST PRACTICES, AND MANUFACTURER RECOMMENDATIONS.
- ALL WIRING SHALL COMPLY WITH ALL STATE AND LOCAL ELECTRICAL CODES AND SHALL TEST FREE FROM ALL GROUNDS, SHORTS, STRAY VOLTAGES AND EMI.
- PROVIDE ALL EQUIPMENT CLEARANCES IN ACCORDANCE WITH CODE REQUIREMENTS, NEC REQUIREMENTS, AND EQUIPMENT MANUFACTURER RECOMMENDED WORKING CLEARANCES.
- ARRANGE EQUIPMENT TO FACILITATE UNRESTRICTED ACCESS FOR MAINTENANCE AND SERVICE AROUND ALL EQUIPMENT, COMPONENTS AND/OR CABLE TERMINATIONS.
- PROPERLY GROUND ALL EQUIPMENT, RACKS, CABINETS, CONDUITS, CABLE TRAYS, AND CABLE SHIELDS IN ACCORDANCE WITH NFPA 70 AND EQUIPMENT MANUFACTURER RECOMMENDATIONS.
- ALL EQUIPMENT AND COMMUNICATIONS CIRCUITS SHALL BE PROPERLY SURGE PROTECTED AND GROUNDED TO MINIMIZE DAMAGE DUE TO LIGHTNING STRIKES, SNEAK CURRENTS AND OTHER TRANSIENT VOLTAGE SPIKES.
- SURGE PROTECTION AND GROUNDING SHALL BE IN ACCORDANCE WITH EQUIPMENT MANUFACTURER RECOMMENDATIONS AND NEC, IEEE, TIA/EIA.
- WHERE CIRCUITS LEAVE THE BUILDING, PROVIDE ADDITIONAL TRANSIENT PROTECTION FOR EACH CIRCUIT. ALL TRANSIENT PROTECTION DEVICES MUST BE UL LISTED UNDER STANDARD #497B FOR ISOLATED LOOP PROTECTORS.
- THE MINIMUM BEND RADIUS FOR CONDUITS SHALL BE AS FOLLOWS:
-2" OR LESS IN DIAMETER SHALL BE 6 TIMES THE INTERNAL CONDUIT DIAMETER.
-LARGER THAN 2" IN DIAMETER SHALL BE 10 TIMES THE INTERNAL CONDUIT DIAMETER PATHWAYS SHOWN ON THE FLOOR PLANS ARE DIAGRAMMATIC AND NOT INTENDED TO SHOW EXACT BEND RADIUS.
- WHEN PENETRATING THE SLAB, SLEEVES SHALL BE CUT A MINIMUM OF 3" ABOVE THE FINISHED FLOOR.
- WHENEVER CABLE TRAY, CONDUIT OR PULLBOXES ARE INSTALLED ABOVE INACCESSIBLE CEILINGS, ACCESS PANELS SHALL BE PROVIDED. SIZE OF ACCESS PANELS SHALL BE MINIMUM 24"x24". FOR CABLE TRAY ACCESS, SPACING BETWEEN ACCESS PANELS SHALL BE NO MORE THAN 10' APART. LOCATIONS SHALL BE COORDINATED WITH ARCHITECT AND OTHER TRADES TO CONSOLIDATE AND MINIMIZE THE QUANTITY. CONDUIT FROM OUTLETS SHALL BE TERMINATED WITHIN 2' OF AN ACCESS PANEL FOR ACCESS.
- PROVIDE A PULL BOX IN CONDUIT RUNS SUCH THAT:
-MAXIMUM CONTINUOUS CONDUIT RUN SHALL NOT EXCEED 100 FT
-NO MORE THAN TWO 90 DEGREE BENDS AND NO MORE THAN 180 DEGREES OF TOTAL OFFSET ALLOWED IN A CONTINUOUS CONDUIT RUN
-THERE IS AT LEAST ONE PULL BOX PER REVERSE (U-SHAPED BEND) IN CONDUIT RUN
-IT IS LOCATED IN THE STRAIGHT SECTION OF A CONDUIT AND NOT IN LIEU OF A BEND
-ALL PULLBOXES ARE SHOWN ON THE FLOOR PLAN FOR COORDINATION PURPOSES. CONTRACTOR TO FIELD COORDINATE BEFORE INSTALLATION
- ALL HORIZONTAL PATHWAYS SHALL BE ROUTED SUCH THAT THE TOTAL HORIZONTAL END TO END CABLE LENGTHS SHALL NOT EXCEED 295 FT. IF THIS REQUIREMENT CANNOT BE MET, NOTIFY THE ENGINEER PRIOR TO PATHWAY INSTALLATION.
- CONDUIT ROUTES AND PULL BOX SIZING, QUANTITY AND PLACEMENT ARE TO BE COORDINATED IN THE FIELD. THE CONTRACTOR SHALL PROVIDE ALL LENGTHS OF CONDUIT, PULL BOXES AND REQUIRED COMPONENTS NECESSARY TO ACHIEVE A COMPLETE INSTALLATION. IT IS NOT THE INTENT OF THESE DOCUMENTS TO SHOW EVERY CONDUIT RATHER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL CONDUIT ROUTES WITH THE STRUCTURE AND OTHER BUILDING SYSTEMS AND SHALL THEREFORE ASSUME FOR PRICING THAT MATERIAL QUANTITIES ARE NOT DEPENDENT UPON THE ROUTES SHOWN.
- LOCATE PULL BOXES OVER ACCESSIBLE CEILINGS WHERE POSSIBLE. WHERE THIS IS NOT FEASIBLE, THE CONTRACTOR SHALL PROVIDE ACCESS PANELS MEETING THE ARCHITECTURAL FINISH REQUIREMENTS OF THE SPACE, AND COORDINATE THOSE LOCATIONS WITH THE ARCHITECT. 17. LOCATIONS OF ALL DEVICES AND EQUIPMENT (IE HVAC, FAN COIL UNIT, SLEEVES, ETC) IN TELECOMMUNICATIONS ROOMS SHALL BE COORDINATED WITH ALL THE AFFECTED TRADES AND THE OWNER PRIOR TO INSTALLATION.
- ALL CONDUIT FITTINGS SHALL UTILIZE COMPRESSION FITTINGS AND BE APPROVED FOR USE AS PART OF THE TELECOMMUNICATIONS SYSTEM PATHWAYS PER BICSI GUIDELINES.
- THE CONTRACTOR MAY CONSOLIDATE INDIVIDUAL CONDUIT PATHWAYS DIRECTLY SERVING TELECOMMUNICATIONS OUTLETS INTO FEWER AND LARGER CONDUIT. ALL CONDUIT FILL CALCULATIONS SHALL INCLUDE AN ALLOWANCE FOR 25% GROWTH. ALL CONDUIT CONSOLIDATIONS SHALL COMPLY WITH TIA STANDARDS AND BICSI GUIDELINES IN GENERAL AND SPECIFICALLY FOR CAPACITY AND DERATING FOR CONDUIT BENDS.
- LABEL ALL TELECOMMUNICATIONS COMPONENTS ACCORDING TO THE TIA/EIA STANDARDS AND THE TELECOMMUNICATIONS SPECIFICATIONS.
- LOCATIONS OF ALL DEVICES AND EQUIPMENT (IE HVAC, FAN COIL UNIT, SLEEVES, ETC) IN TELECOMMUNICATIONS ROOMS SHALL BE COORDINATED WITH ALL THE AFFECTED TRADES AND THE OWNER PRIOR TO INSTALLATION.
- ALL CONDUIT RUNS ARE OVER HEAD OF PARKING SPACES AND PROVIDE MAXIMUM CLEARANCE FOR VEHICLES.


TELECOM SIZING CHARTS

CONDUIT CAPACITY								
TRADE SIZE (IN)	CABLE OUTSIDE DIAMETER (IN)							
	0.13	0.18	0.22	0.24	0.29	0.31	0.37	0.53
3/4	6	5	4	3	2	1	1	0
1	8	8	7	6	3	3	2	1
1 1/4	16	14	12	10	6	4	3	1
1 1/2	20	18	16	15	7	6	4	2
2	30	26	22	20	14	12	7	4
2 1/2	45	40	36	30	17	14	12	6
3	75	60	50	40	20	20	17	7
3 1/2	-	-	-	-	-	-	22	12
4	-	-	-	-	-	-	30	14


NOTE: SHALL NOT EXCEED 40% FILL FOR MIXED CABLE DIAMETERS.

PULLBOX SIZING				
CONDUIT TRADE SIZE	WIDTH (IN)	LENGTH (IN)	DEPTH (IN)	INCREASE FOR ADDITIONAL CONDUIT (IN)
1	4	16	3	2
1 1/4	6	20	3	3
1 1/2	8	27	4	4
2	8	36	4	5
2 1/2	10	42	5	6
3	12	48	5	6
3 1/2	12	54	6	6
4	15	60	8	8

CONDUCTOR SIZING		
MAXIMUM TMGGB (PBB) TO TGBB (SBB) LENGTH (L) METERS (FEET)	CONDUCTOR CROSS-SECTIONAL AREA (MINIMUM)	
	NOMINAL INT'L CONDUCTOR (MM2)	NOMINAL AWG CONDUCTOR
L < 4m (13ft)	16	6
4 < L < 6m (14 - 20ft)	25	4
6 < L < 8m (21 - 26ft)	35	3
8 < L < 10m (27 - 33ft)	35	2
10 < L < 13m (34 - 41ft)	50	1
13 < L < 16m (42 - 52ft)	60	1/0
16 < L < 20m (53 - 66ft)	70	2/0
20 < L < 26m (67 - 84ft)	95	3/0
26 < L < 32m (85 - 105ft)	120	4/0
32 < L < 38m (106 - 125ft)	150	250 kcmil
38 < L < 46m (126 - 150ft)	150	300 kcmil
46 < L < 53m (151 - 175ft)	185	350 kcmil
53 < L < 76m (176 - 250ft)	250	500 kcmil
76 < L < 91m (251 - 300ft)	300	600 kcmil
Greater than 91m (301ft)	400	750 kcmil

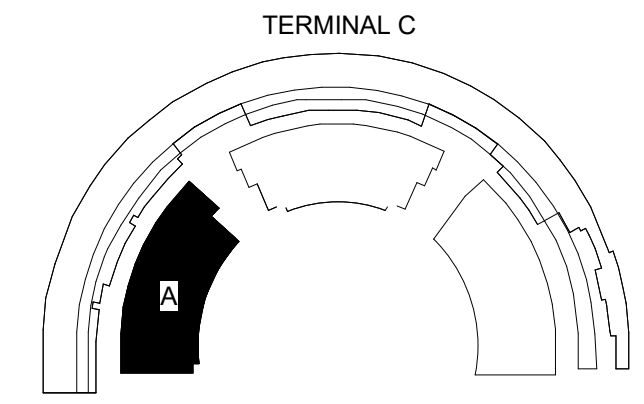

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

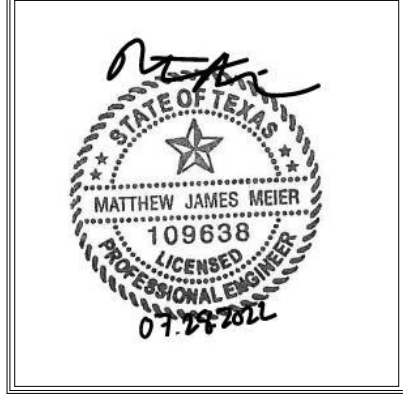

h+k Burns
 Hobbins, Clark & Koenigsmann, Inc. | 1311 14th Street
 77160 Houston, Texas | 2810 Commerce Center, 1811 Highway 77, Suite 600
 Houston, TX 77057 | 2810 Commerce Center, 1811 Highway 77, Suite 600
 Dallas, TX 75201 | 1+214 722 6000

DRAWN BY: BURNS/HOK
 APPROVED BY: MM/FR
 ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM SYSTEMS OVERVIEW AND GENERAL NOTES
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
TN002-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

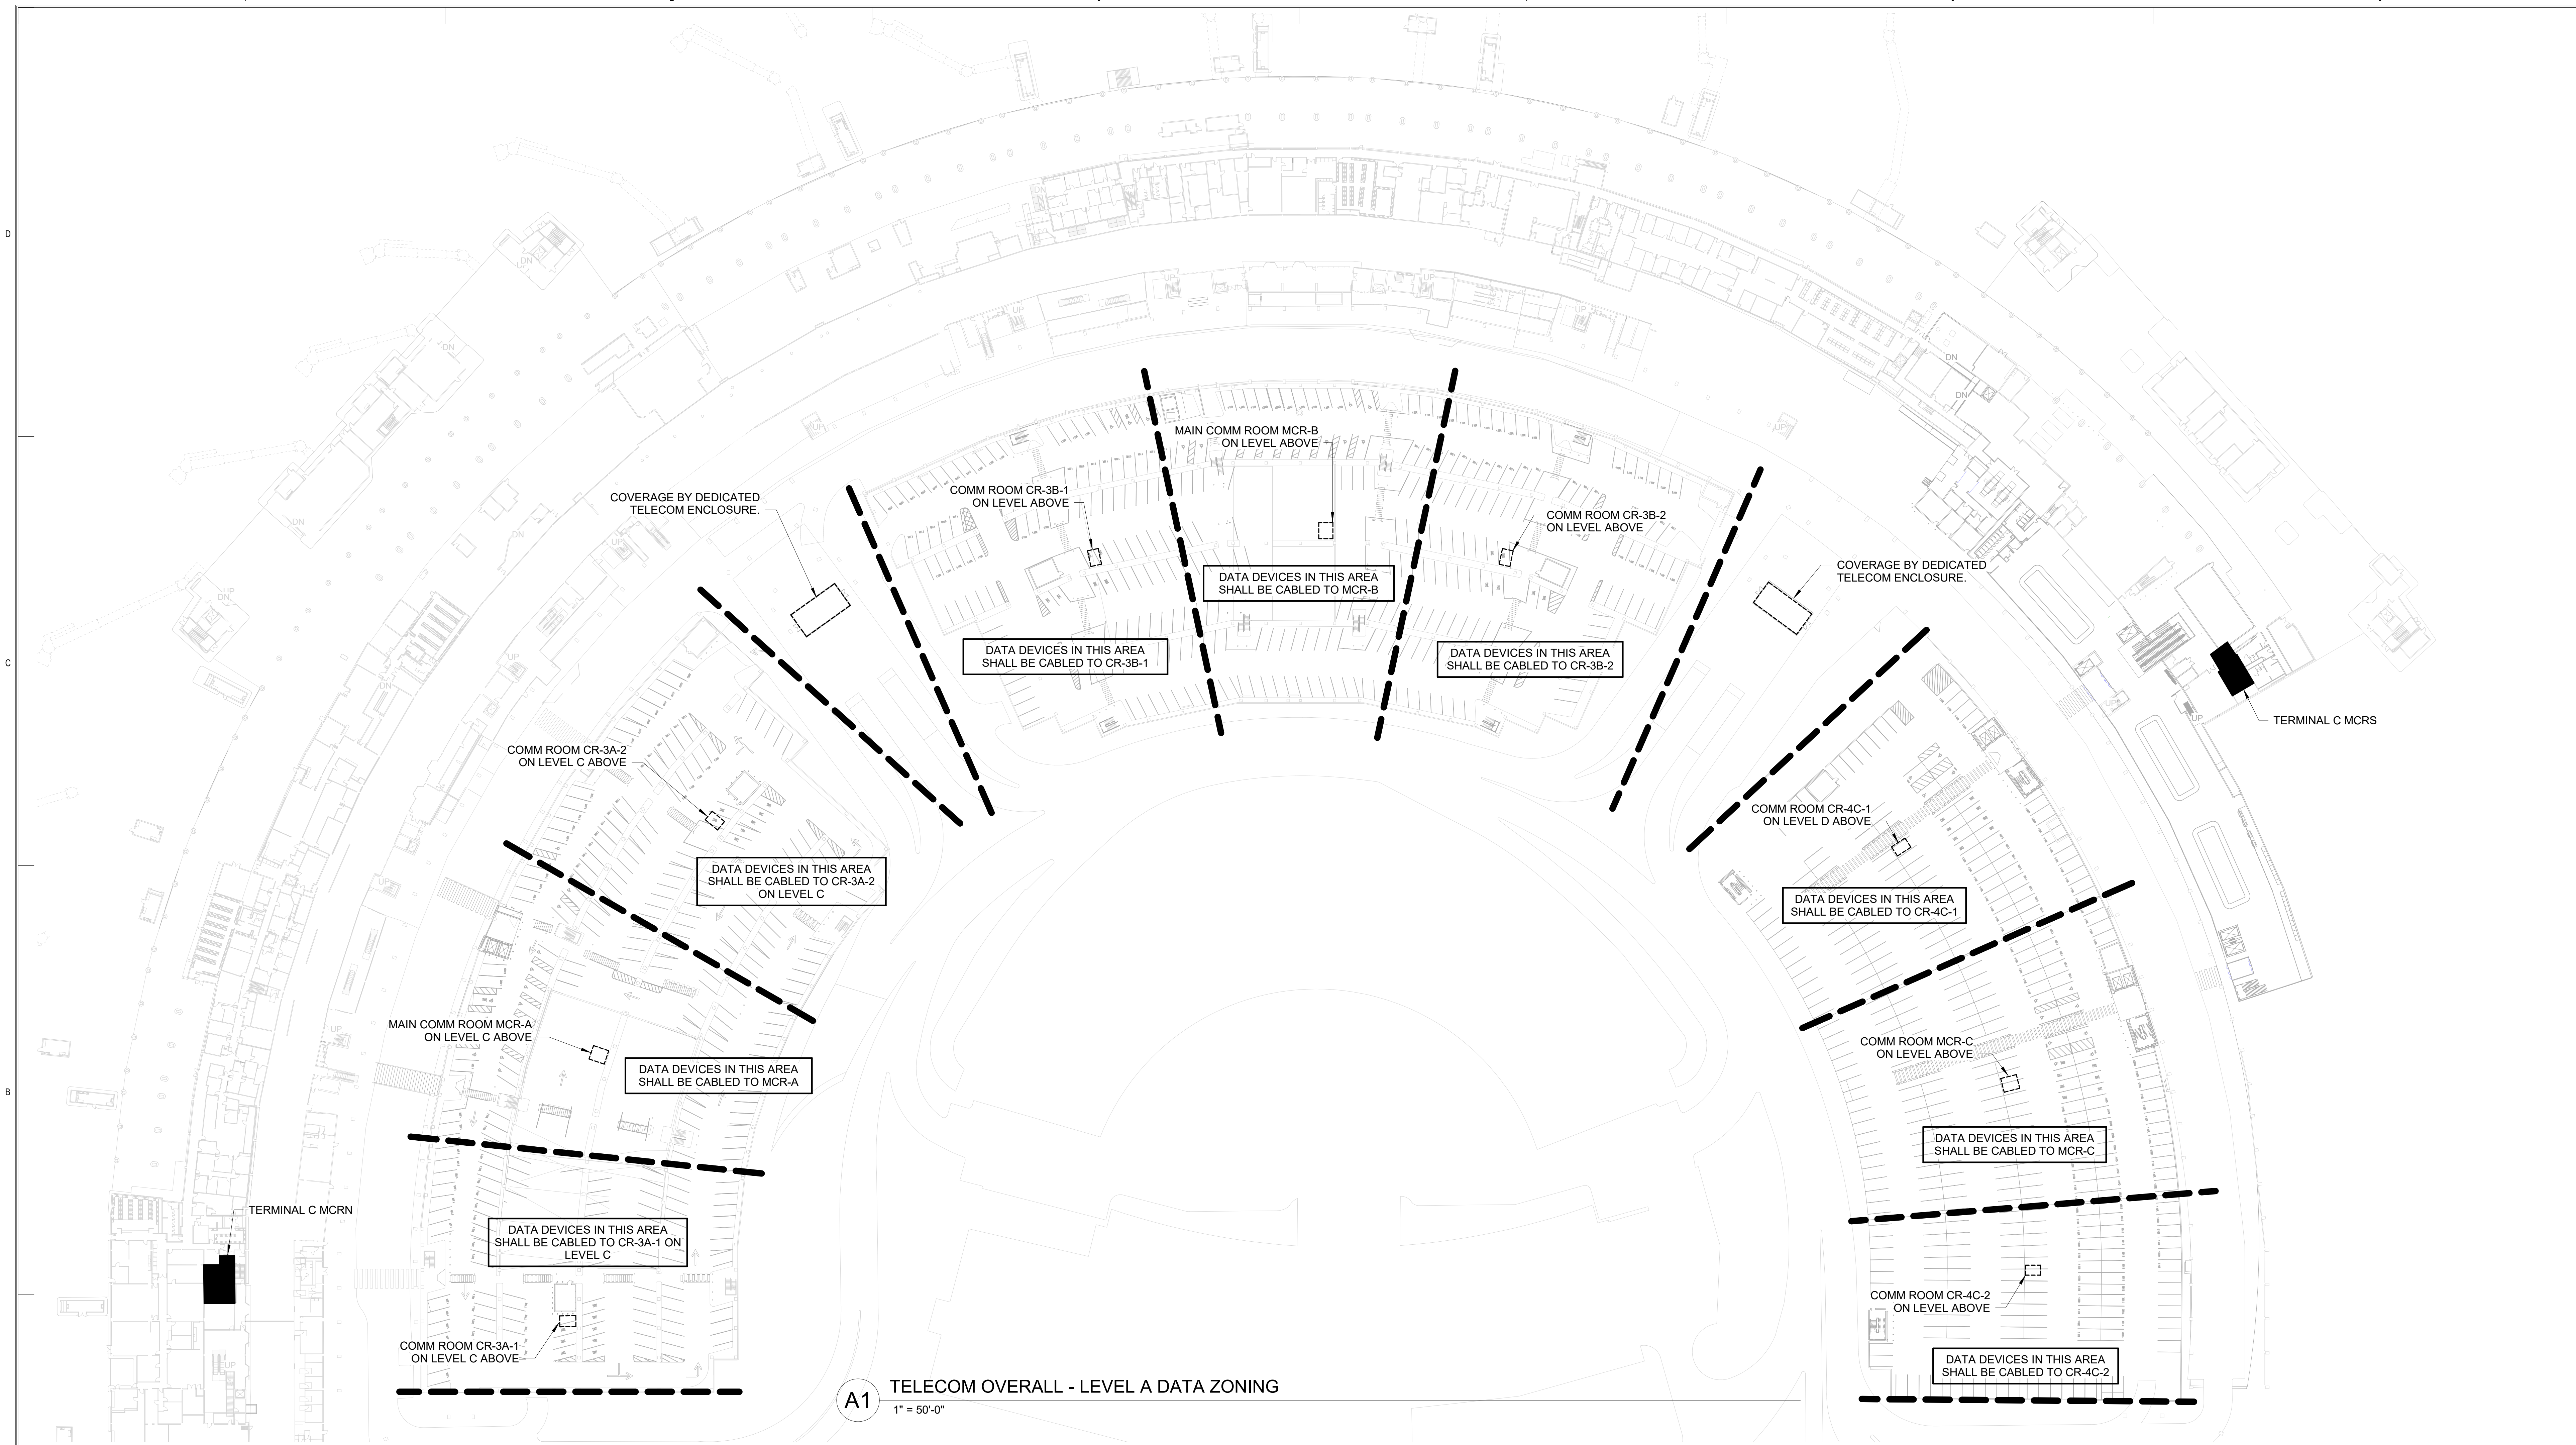


A1 TELECOM OVERALL - LEVEL A DATA ZONING
1" = 50'-0"

GENERAL NOTE

1. INDICATED TELECOM COVERAGE IS DIAGRAMMATIC IN NATURE AND BASED ON STANDARD MAXIMUM HORIZONTAL COPPER CABLING DISTANCE OF 295FT FROM RACK TERMINATION TO DEVICE. DUE TO CABLE ROUTING AND SITE CONDITIONS, FINAL COMM ROOM TERMINATION POINT MAY VARY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT ALL COPPER CABLING DOES NOT EXCEED THE STANDARD MAXIMUM HORIZONTAL LENGTH. IF UNAVOIDABLE, THE CONTRACTOR SHALL PROVIDE FIBER OPTIC CABLE AND MEDIA CONVERTERS TO PROVIDE NETWORK CONNECTIVITY. CONTRACTOR SHALL COORDINATE ANY ADDITIONAL POWER REQUIREMENTS WITH THE ELECTRICAL CONTRACTOR.

SHEET NOTE

KEY PLAN

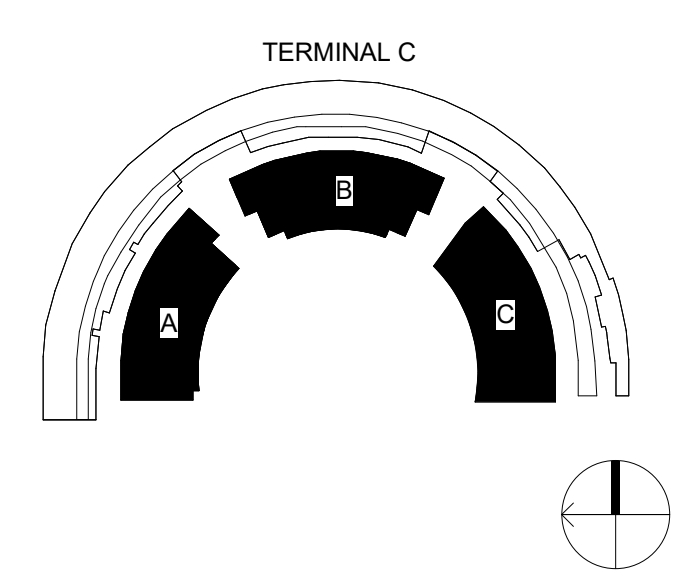

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k Burns
Heidrich, Clark & Kohnstamm, Inc.
717 South Northwest Street
Dallas, TX 75201
1-214-722-6000

DRAWN BY: KBI/K
APPROVED BY: MM
ISSUE DATE: 2022-07-28


NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM LEVEL A SITE DATA ZONING PLAN
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
TN010-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

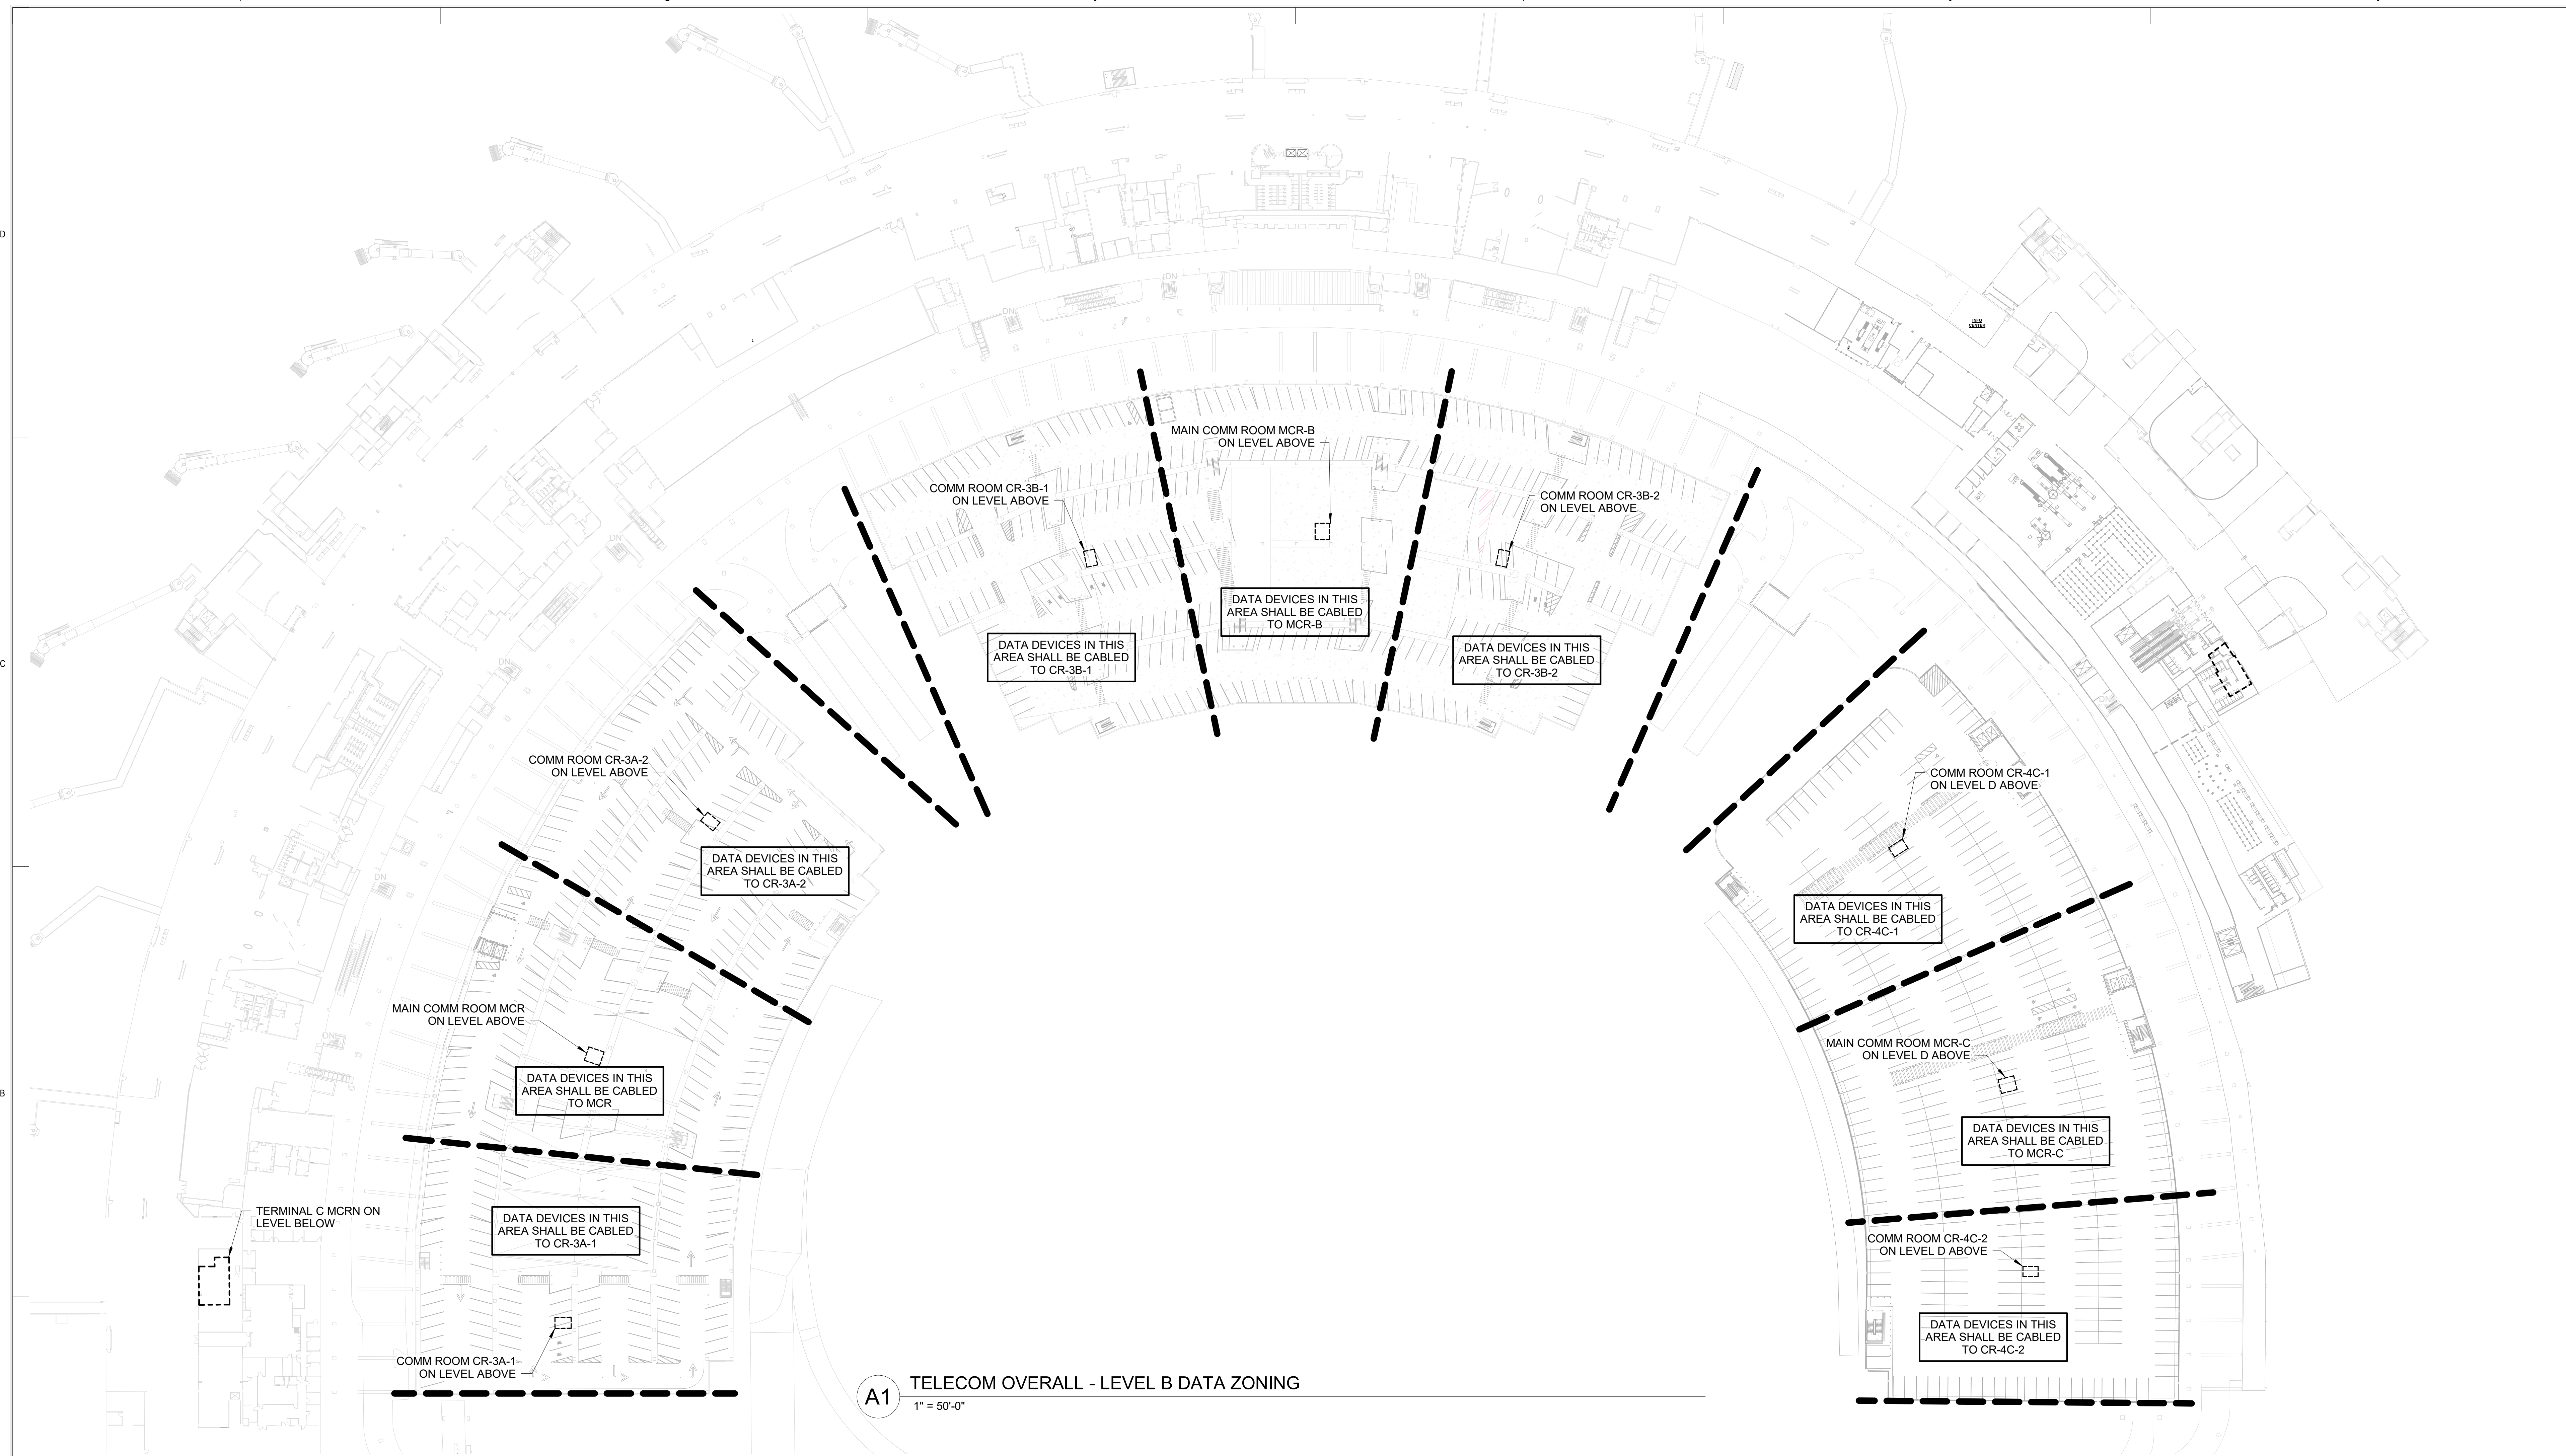


A1 TELECOM OVERALL - LEVEL B DATA ZONING
1" = 50'-0"

GENERAL NOTE

1. INDICATED TELECOM COVERAGE IS DIAGRAMMATIC IN NATURE AND BASED ON STANDARD MAXIMUM HORIZONTAL COPPER CABLING DISTANCE OF 295FT FROM RACK TERMINATION TO DEVICE. DUE TO CABLE ROUTING AND SITE CONDITIONS, FINAL COMM ROOM TERMINATION POINT MAY VARY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT ALL COPPER CABLING DOES NOT EXCEED THE STANDARD MAXIMUM HORIZONTAL LENGTH. IF UNAVOIDABLE, THE CONTRACTOR SHALL PROVIDE FIBER OPTIC CABLE AND MEDIA CONVERTERS TO PROVIDE NETWORK CONNECTIVITY. CONTRACTOR SHALL COORDINATE ANY ADDITIONAL POWER REQUIREMENTS WITH THE ELECTRICAL CONTRACTOR.

SHEET NOTE

KEY PLAN

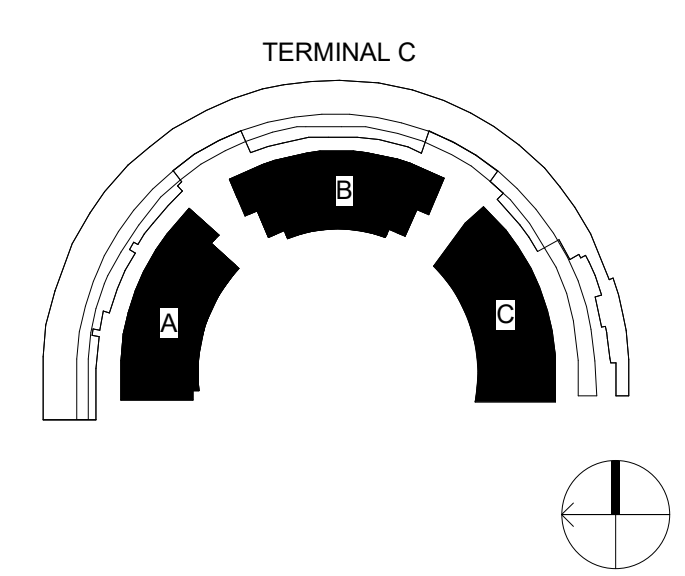

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



h+k Burns
Houston, Clark & Koenigsmann, Inc.
717 South Memorial Drive
Dallas, TX 75201
1-214-722-6000

DRAWN BY: KBI/K
APPROVED BY: MM
ISSUE DATE: 2022-07-28


NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM LEVEL B SITE DATA ZONING PLAN
PROJECT NUMBER: TFD-007
PERMIT NUMBER: 822-0022

SHEET NUMBER
TN020-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

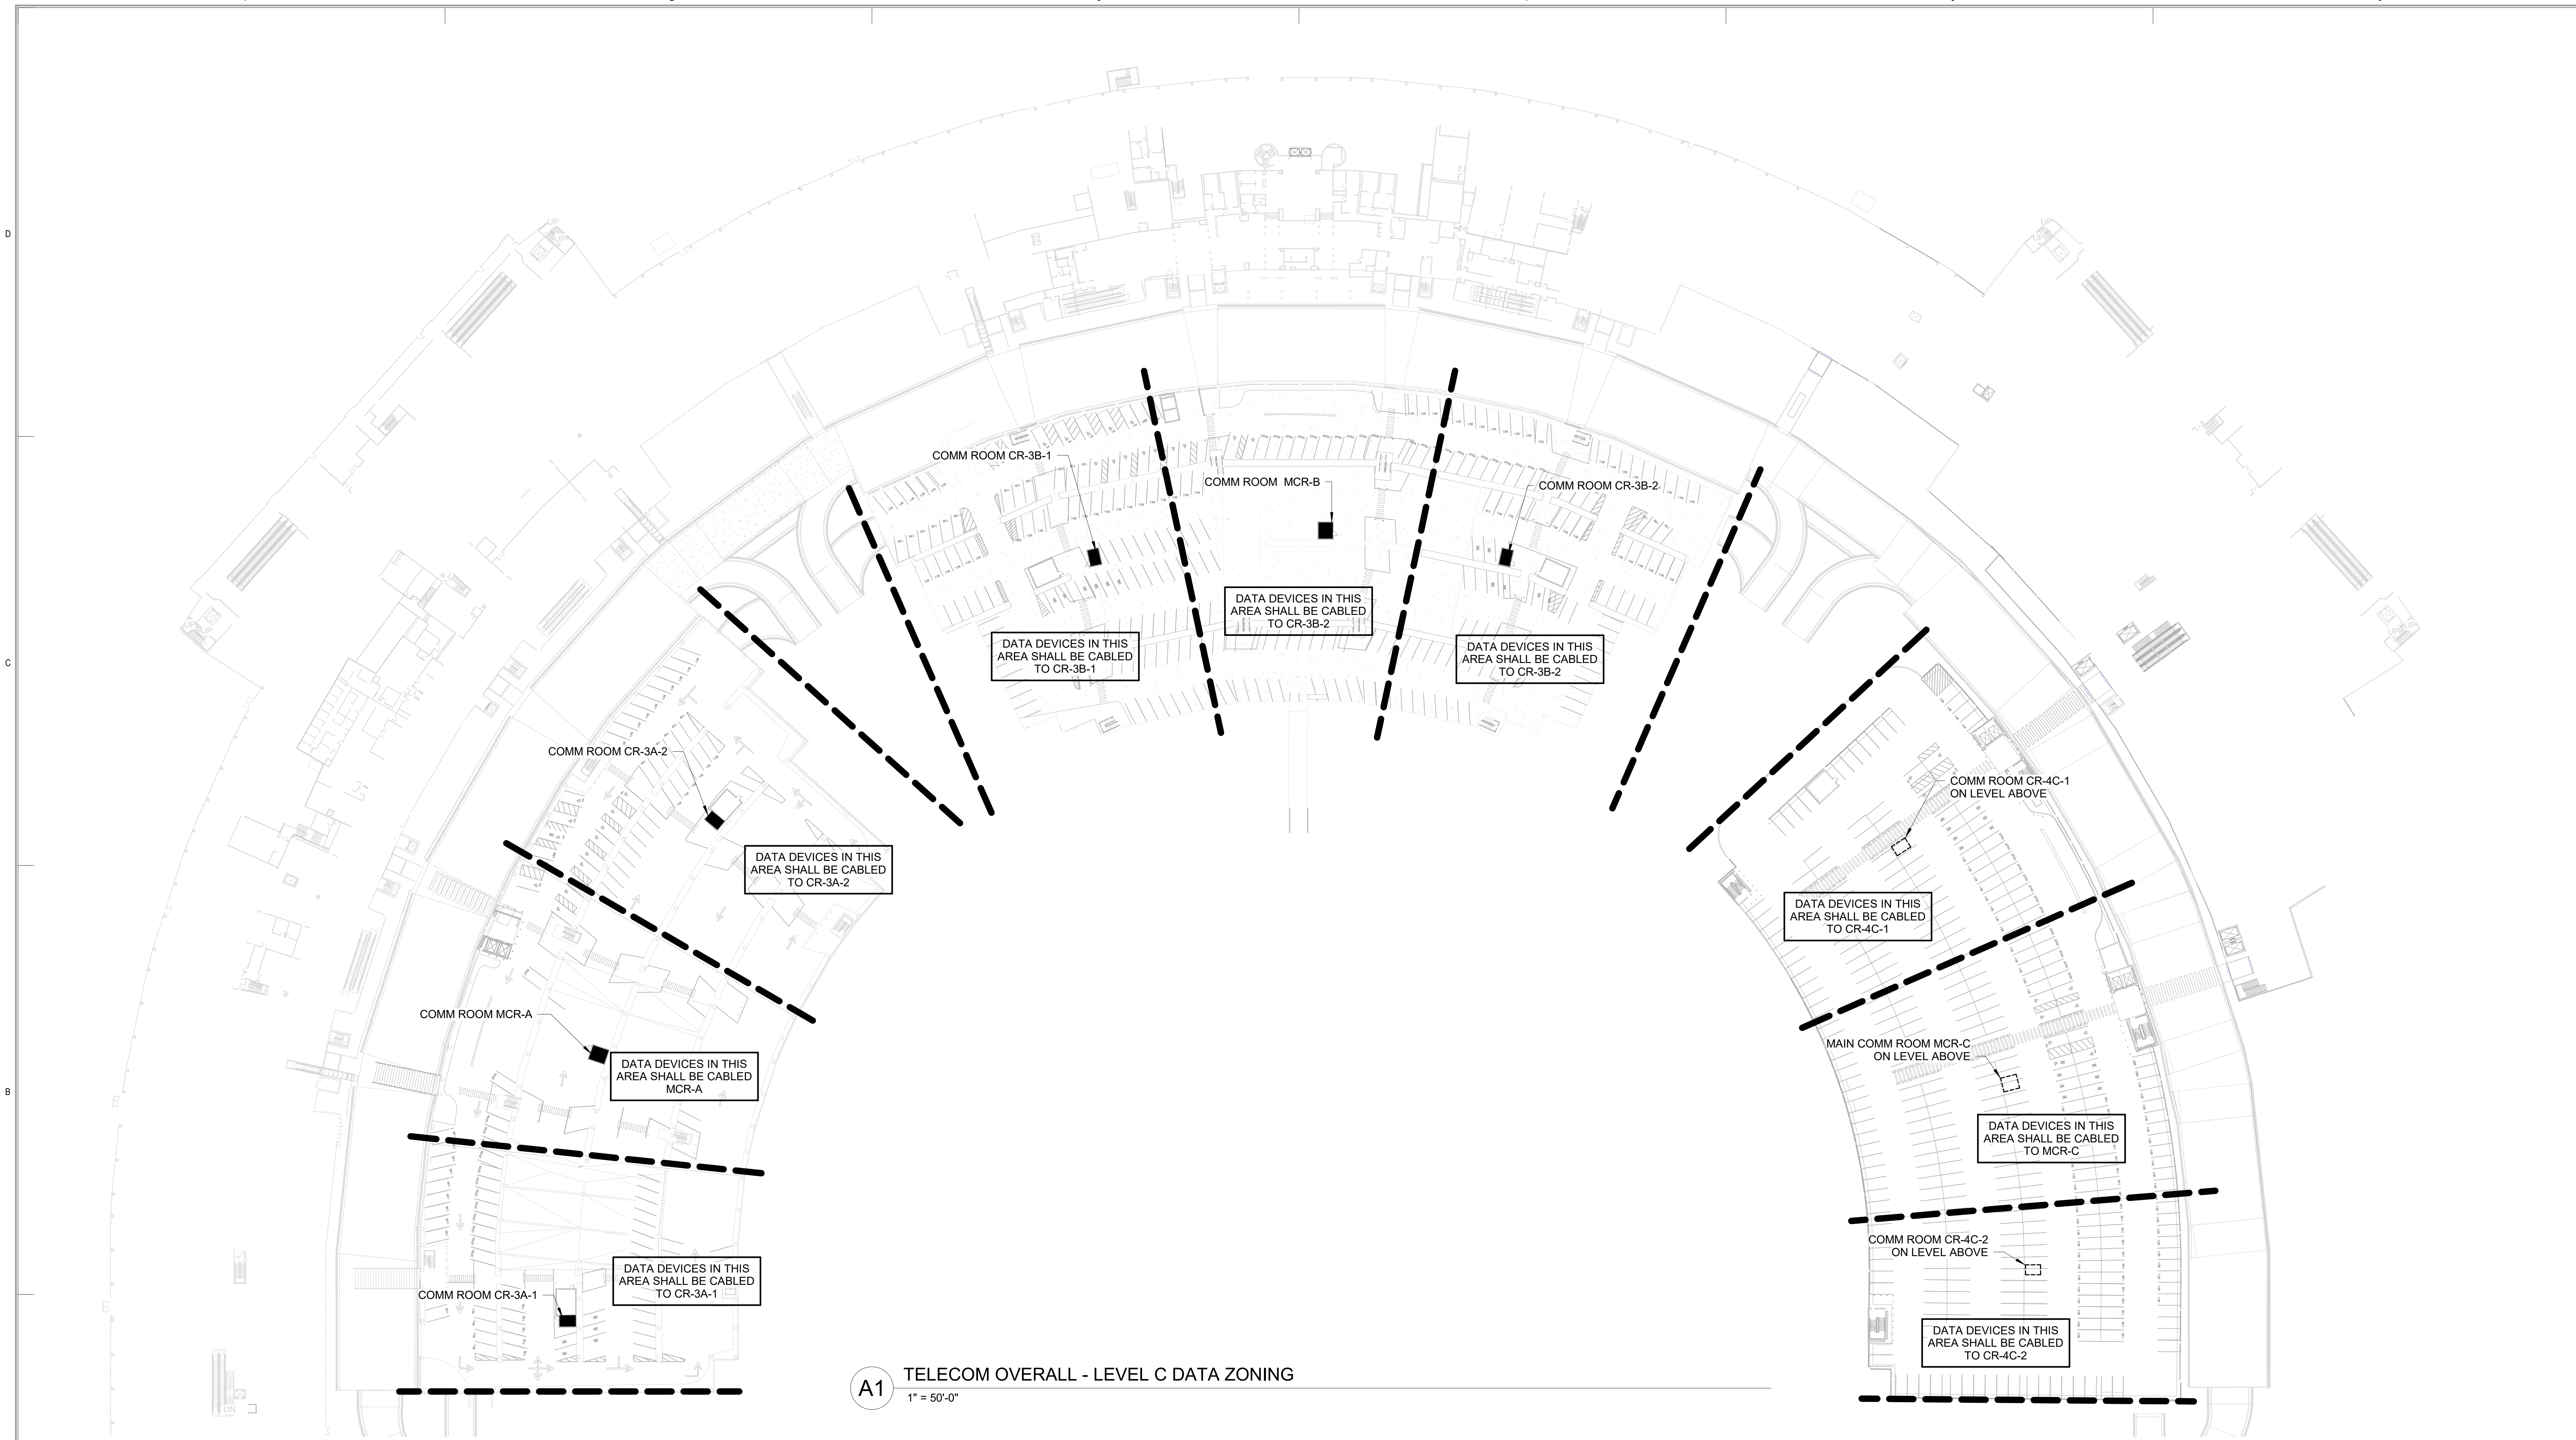


GENERAL NOTE


SHEET NOTE

KEY PLAN

1. INDICATED TELECOM COVERAGE IS DIAGRAMMATIC IN NATURE AND BASED ON STANDARD MAXIMUM HORIZONTAL COPPER CABLING DISTANCE OF 295FT FROM RACK TERMINATION TO DEVICE. DUE TO CABLE ROUTING AND SITE CONDITIONS, FINAL COMM ROOM TERMINATION POINT MAY VARY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT ALL COPPER CABLING DOES NOT EXCEED THE STANDARD MAXIMUM HORIZONTAL LENGTH. IF UNAVOIDABLE, THE CONTRACTOR SHALL PROVIDE FIBER OPTIC CABLE AND MEDIA CONVERTERS TO PROVIDE NETWORK CONNECTIVITY. CONTRACTOR SHALL COORDINATE ANY ADDITIONAL POWER REQUIREMENTS WITH THE ELECTRICAL CONTRACTOR.

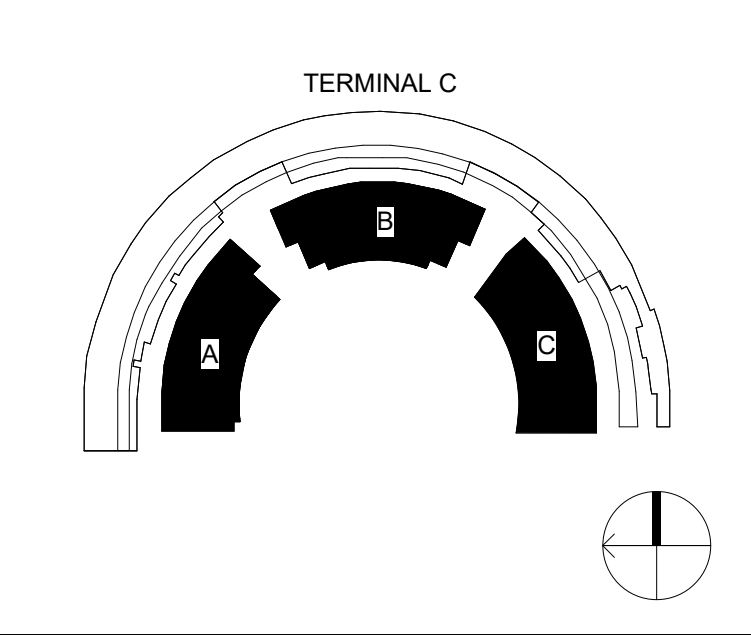

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
 2330 N INTERNATIONAL PARKWAY
 DFW AIRPORT, TX 75261

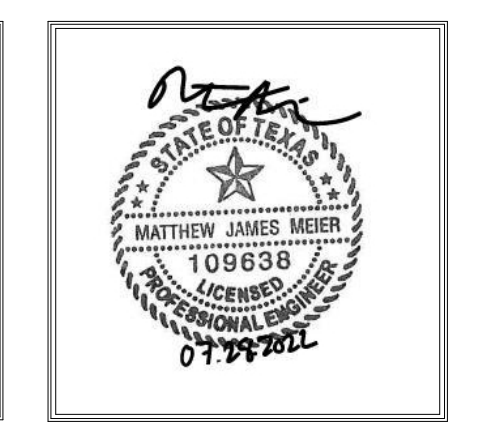

h+k Burns
 Hobbins, Clark & Robinson, Inc.
 717 South Memorial Drive
 Suite 2000, LB #
 Dallas, TX 75201
 1-214-722-6000

DRAWN BY: KBI/K
 APPROVED BY: MM
 ISSUE DATE: 2022-07-28


NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM LEVEL C SITE DATA ZONING PLAN
 PROJECT NUMBER: TFD-007
 PERMIT NUMBER: 822-0022

SHEET NUMBER
TN030-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

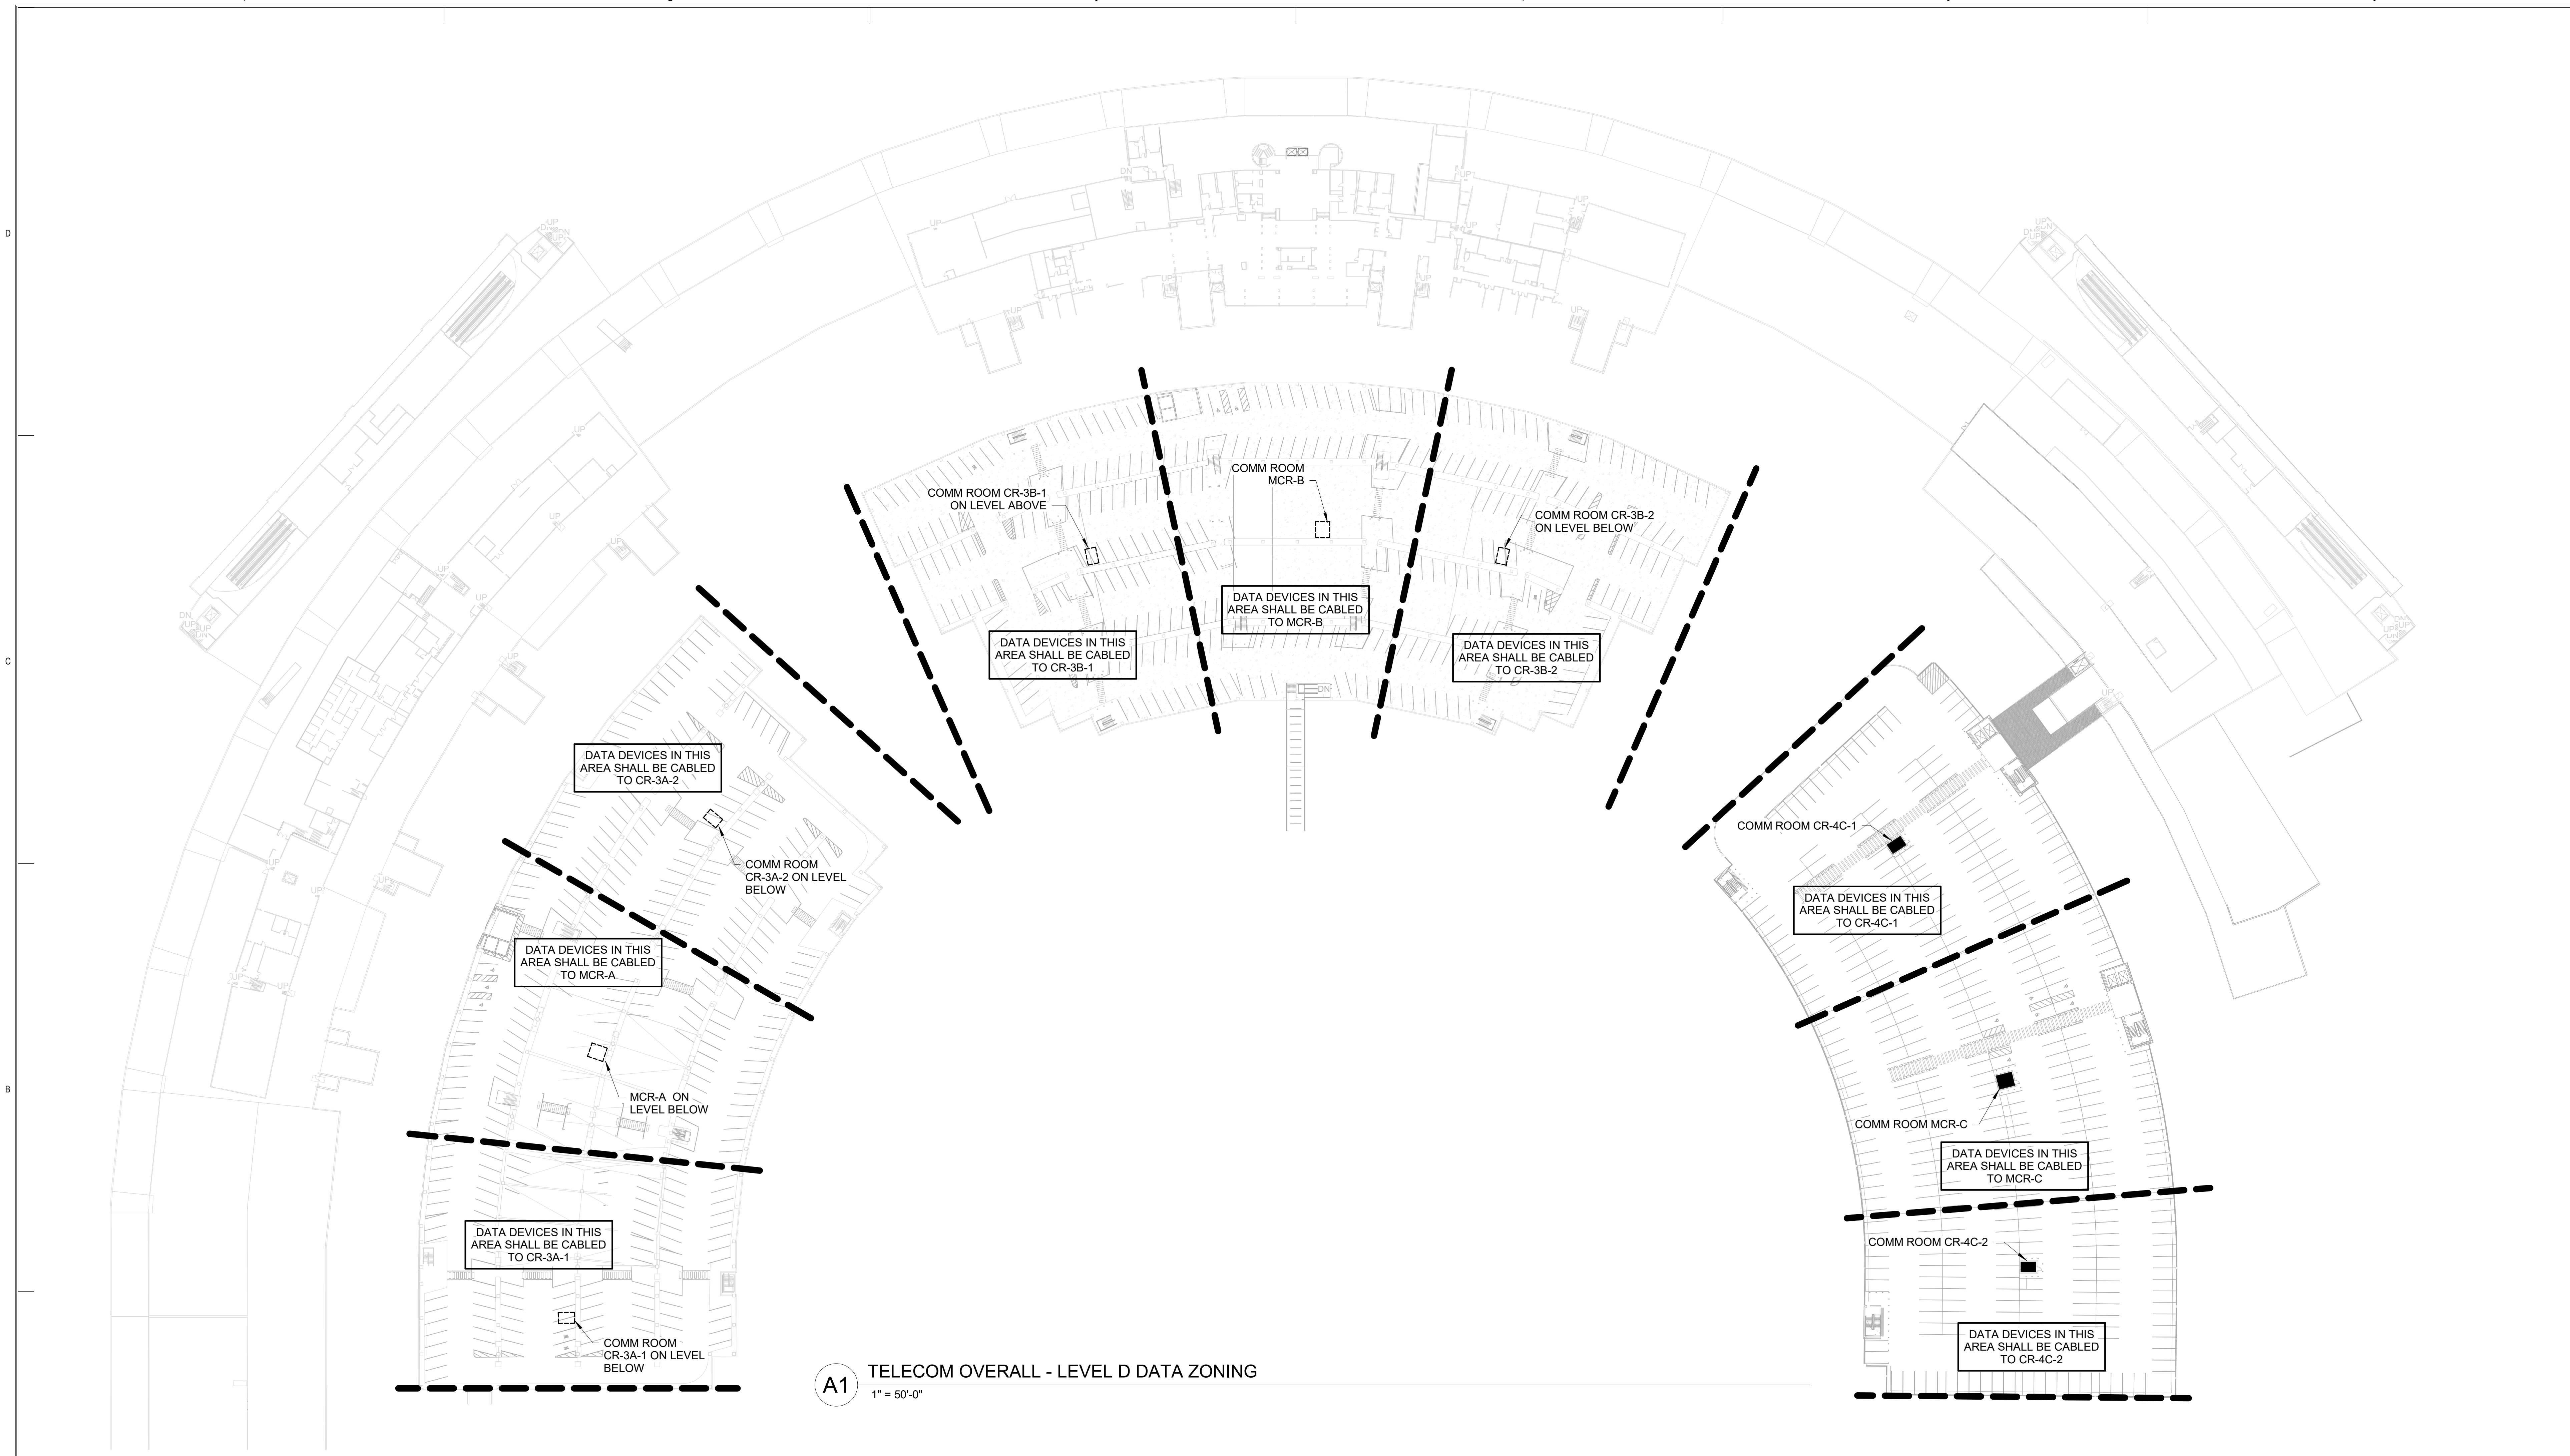


A1 TELECOM OVERALL - LEVEL D DATA ZONING
1" = 50'-0"

GENERAL NOTE

1. INDICATED TELECOM COVERAGE IS DIAGRAMMATIC IN NATURE AND BASED ON STANDARD MAXIMUM HORIZONTAL COPPER CABLING DISTANCE OF 295FT FROM RACK TERMINATION TO DEVICE. DUE TO CABLE ROUTING AND SITE CONDITIONS, FINAL COMM ROOM TERMINATION POINT MAY VARY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT ALL COPPER CABLING DOES NOT EXCEED THE STANDARD MAXIMUM HORIZONTAL LENGTH. IF UNAVOIDABLE, THE CONTRACTOR SHALL PROVIDE FIBER OPTIC CABLE AND MEDIA CONVERTERS TO PROVIDE NETWORK CONNECTIVITY. CONTRACTOR SHALL COORDINATE ANY ADDITIONAL POWER REQUIREMENTS WITH THE ELECTRICAL CONTRACTOR.

SHEET NOTE

KEY PLAN

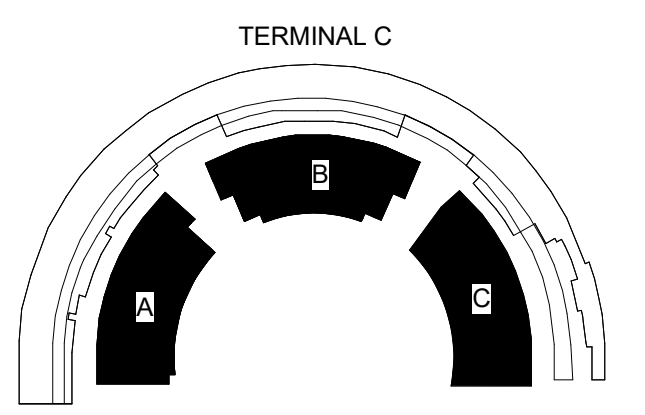

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KBI/K
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-26	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007

TERMINAL C GARAGE & ROADWAYS
TELECOM LEVEL D SITE DATA ZONING PLAN

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN040-900A

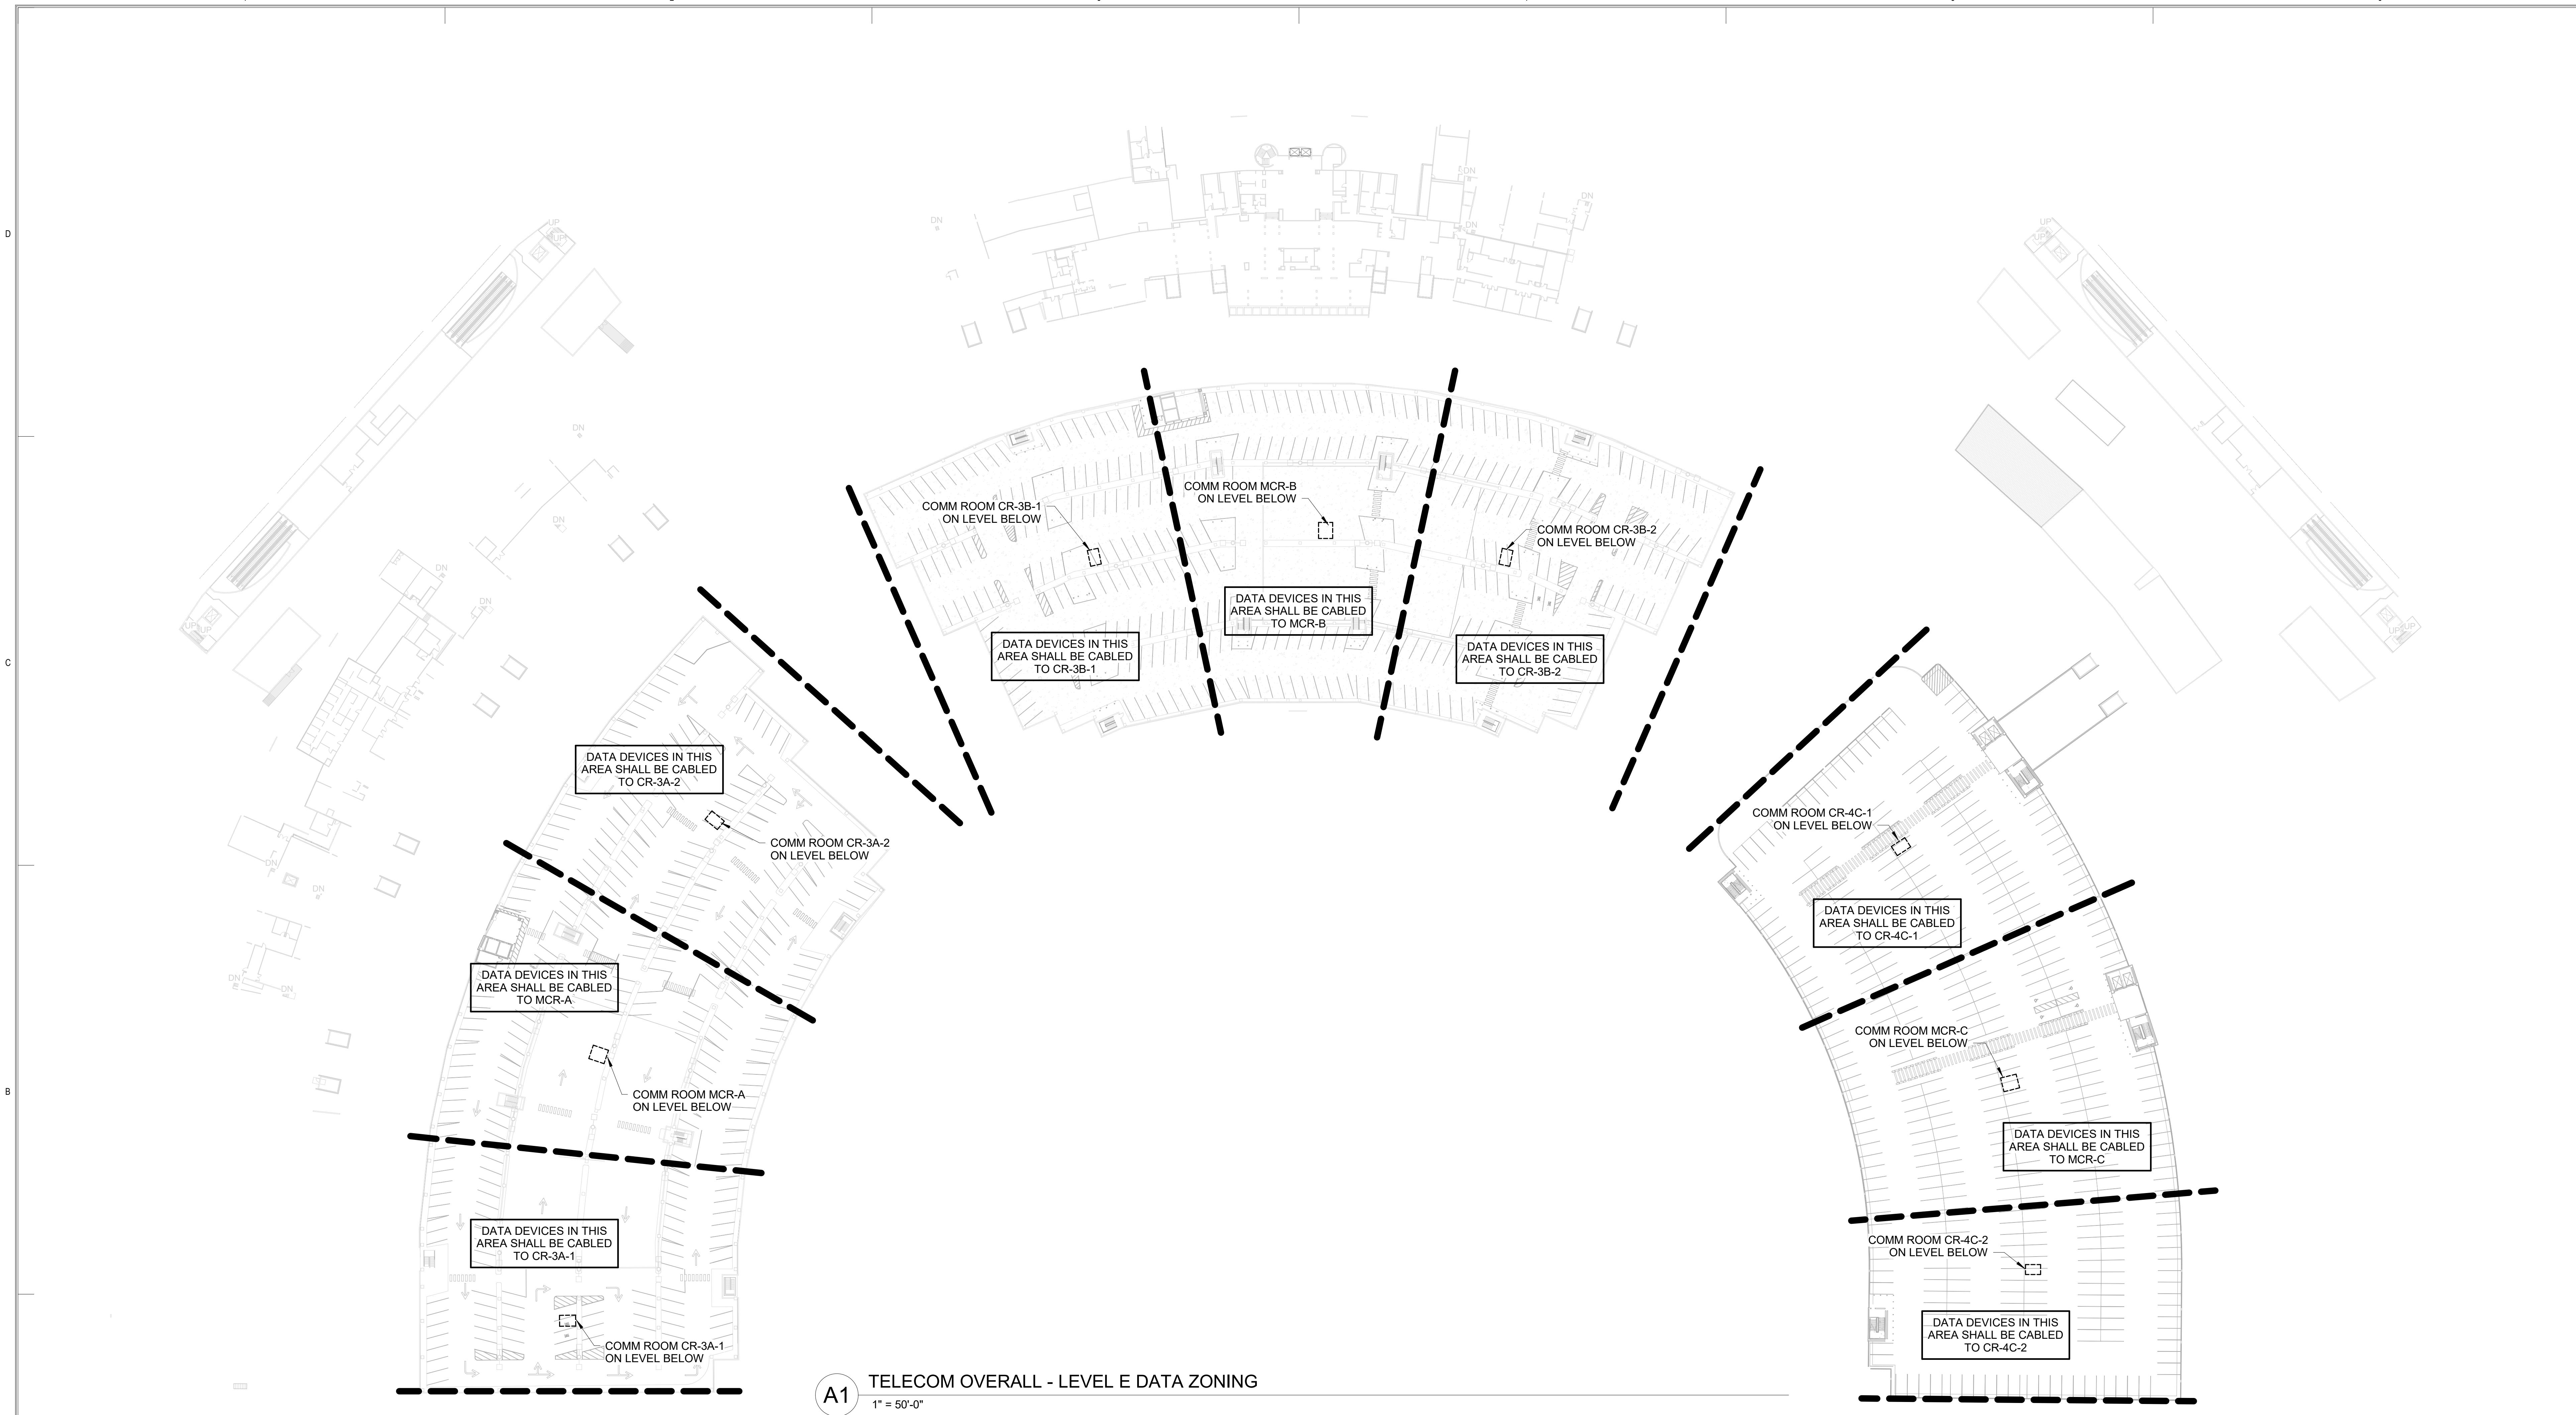


A1 TELECOM OVERALL - LEVEL E DATA ZONING
1" = 50'-0"

GENERAL NOTE


SHEET NOTE

KEY PLAN

1. INDICATED TELECOM COVERAGE IS DIAGRAMMATIC IN NATURE AND BASED ON STANDARD MAXIMUM HORIZONTAL COPPER CABLING DISTANCE OF 295FT FROM RACK TERMINATION TO DEVICE. DUE TO CABLE ROUTING AND SITE CONDITIONS, FINAL COMM ROOM TERMINATION POINT MAY VARY. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THAT ALL COPPER CABLING DOES NOT EXCEED THE STANDARD MAXIMUM HORIZONTAL LENGTH. IF UNAVOIDABLE, THE CONTRACTOR SHALL PROVIDE FIBER OPTIC CABLE AND MEDIA CONVERTERS TO PROVIDE NETWORK CONNECTIVITY. CONTRACTOR SHALL COORDINATE ANY ADDITIONAL POWER REQUIREMENTS WITH THE ELECTRICAL CONTRACTOR.

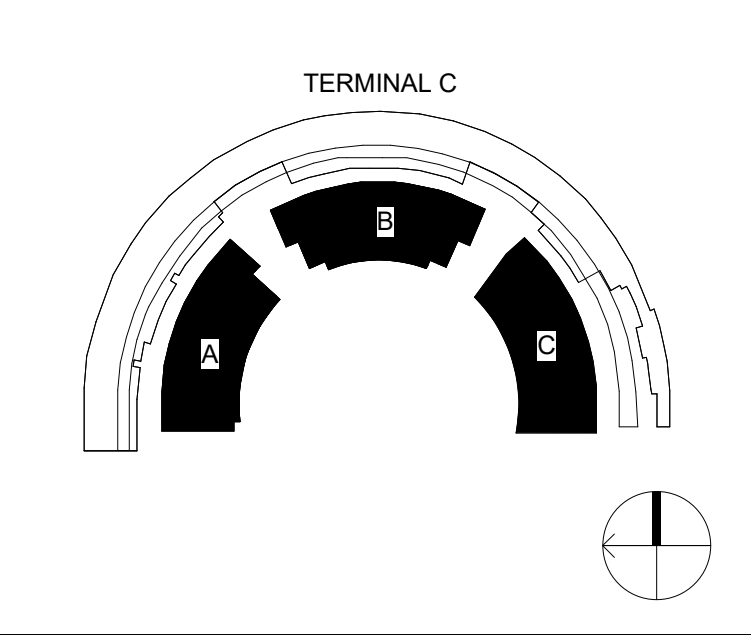

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

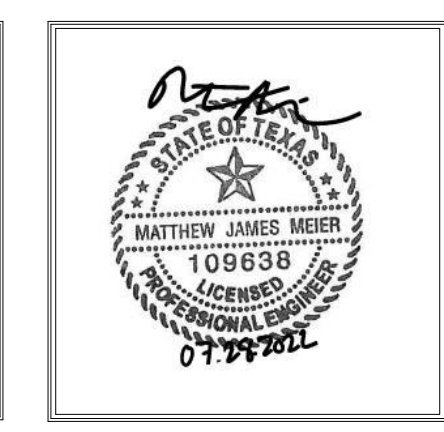

h+k Burns
Heidolph, Clark & Rosenbaum, Inc.
771 South Riverfront Street
Dallas, TX 75201
1-214-722-6000


DRAWN BY: KBI/K	NO:	DATE:	DESCRIPTION:
APPROVED BY: MM	2021-10-23	2022-01-26	30% DESIGN
ISSUE DATE: 2022-07-28	2022-03-01	2022-03-01	70% DESIGN
	2022-07-28	2022-07-28	100% DESIGN
			100% ISSUED FOR PERMIT (IFP)

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM LEVEL E SITE DATA ZONING PLAN
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022


SHEET NUMBER
TN050-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

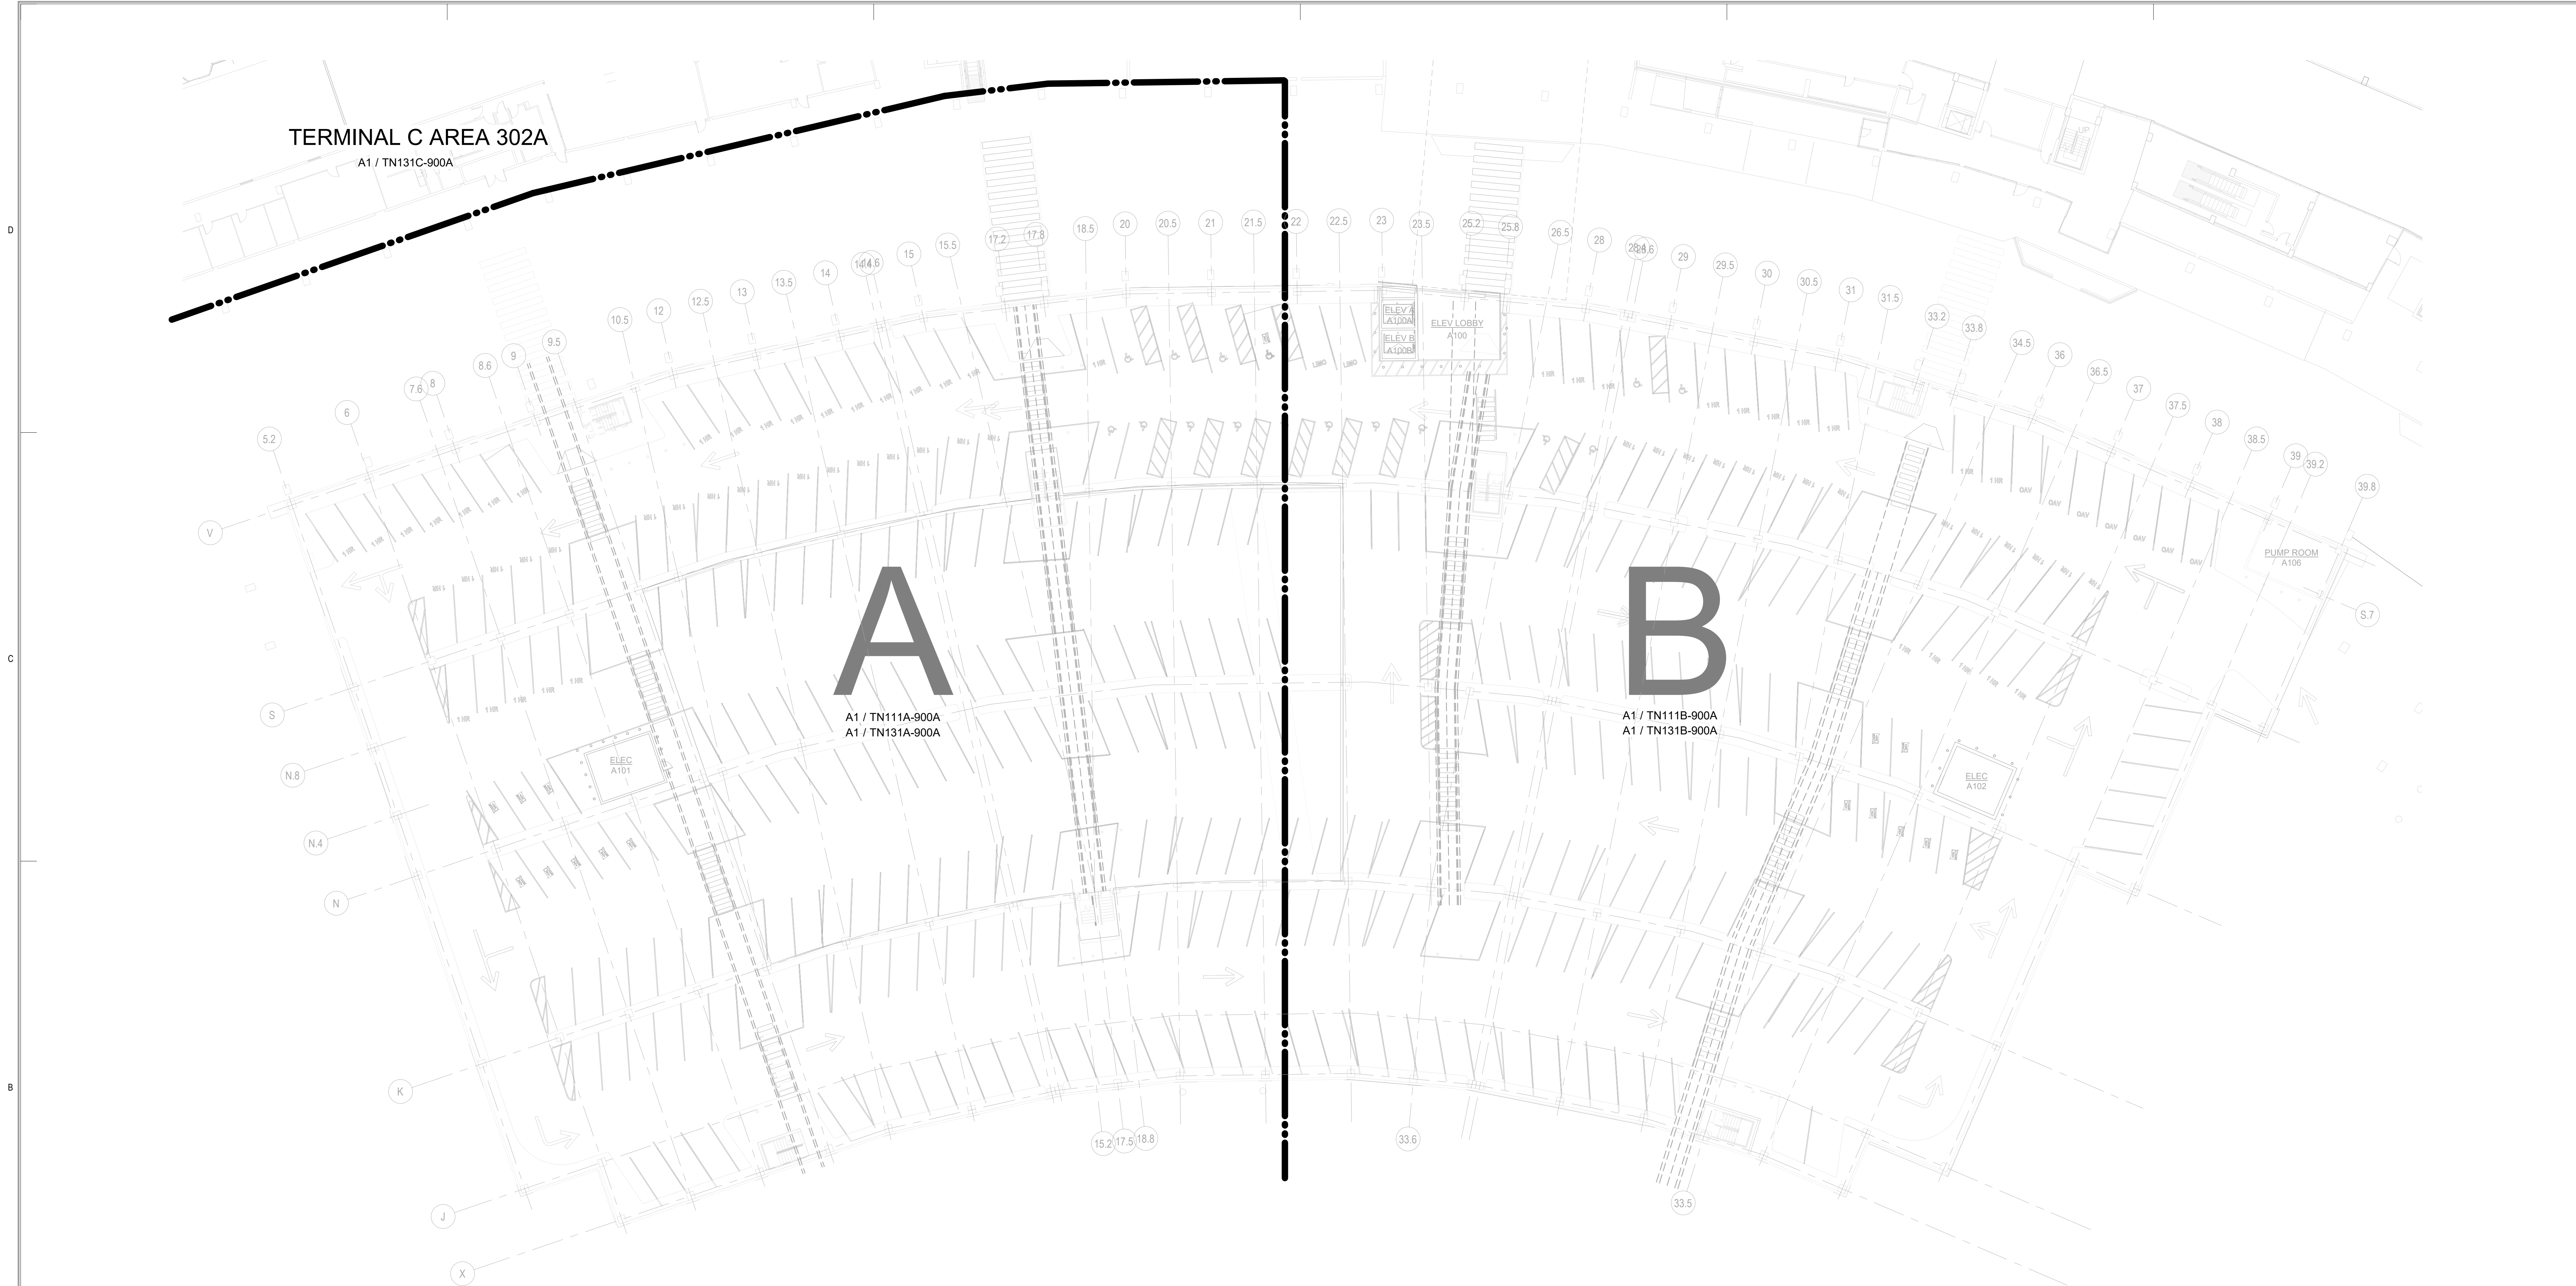


A1 TELECOM OVERALL - LEVEL A GARAGE A
1" = 20'-0"

GENERAL NOTE | **SHEET NOTE** | **KEY PLAN**

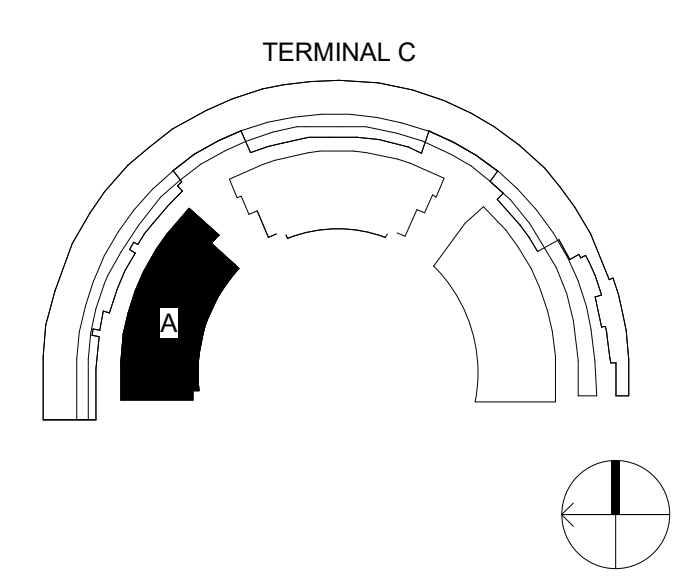

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

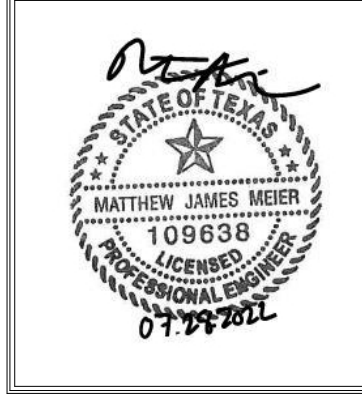

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-29	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) LEVEL A OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN101-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

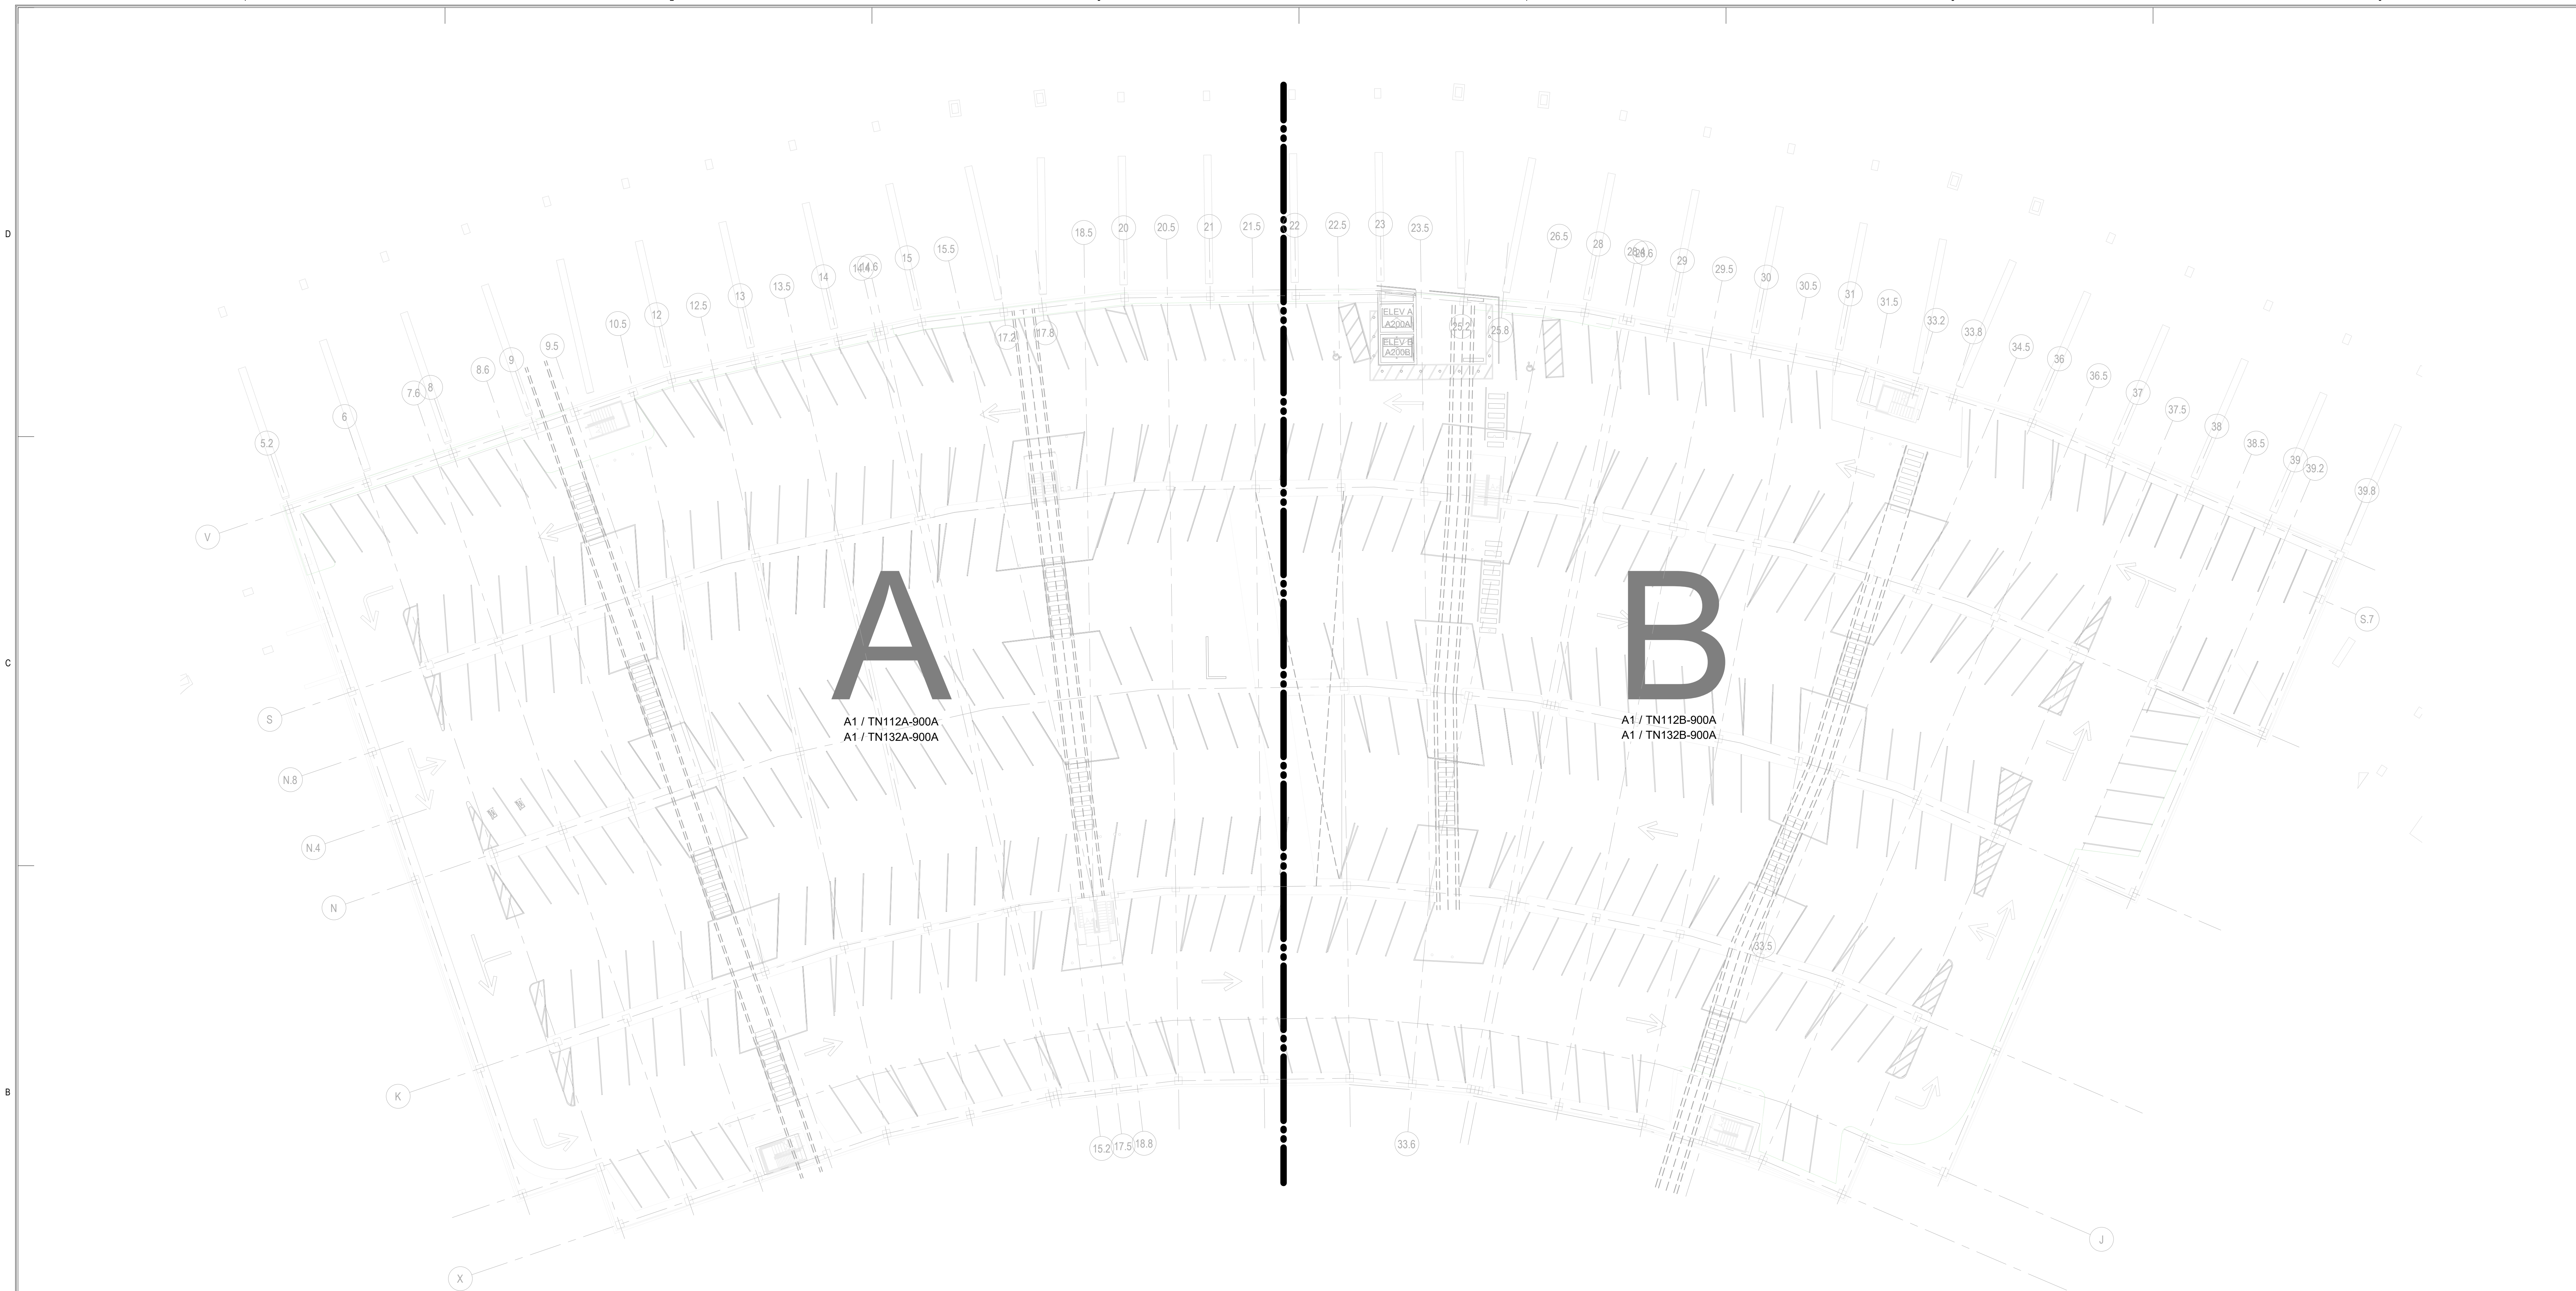

A


A1 / TN112A-900A
A1 / TN132A-900A

B


A1 / TN112B-900A
A1 / TN132B-900A

A1 TELECOM OVERALL - LEVEL B GARAGE A
1" = 20'-0"

GENERAL NOTE | **SHEET NOTE** | **KEY PLAN**

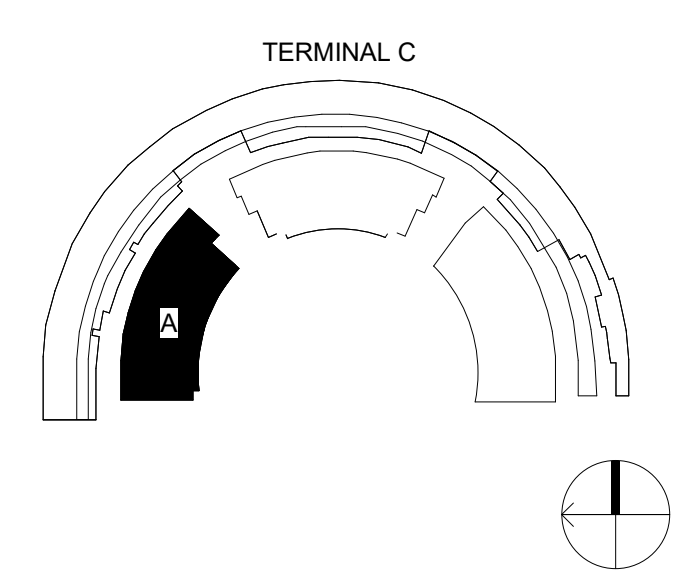

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

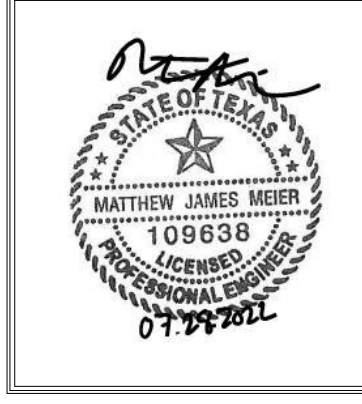

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28


NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
1	2021-10-29	30% DESIGN
2	2022-01-09	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) LEVEL B OVERALL
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022

SHEET NUMBER
TN102-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

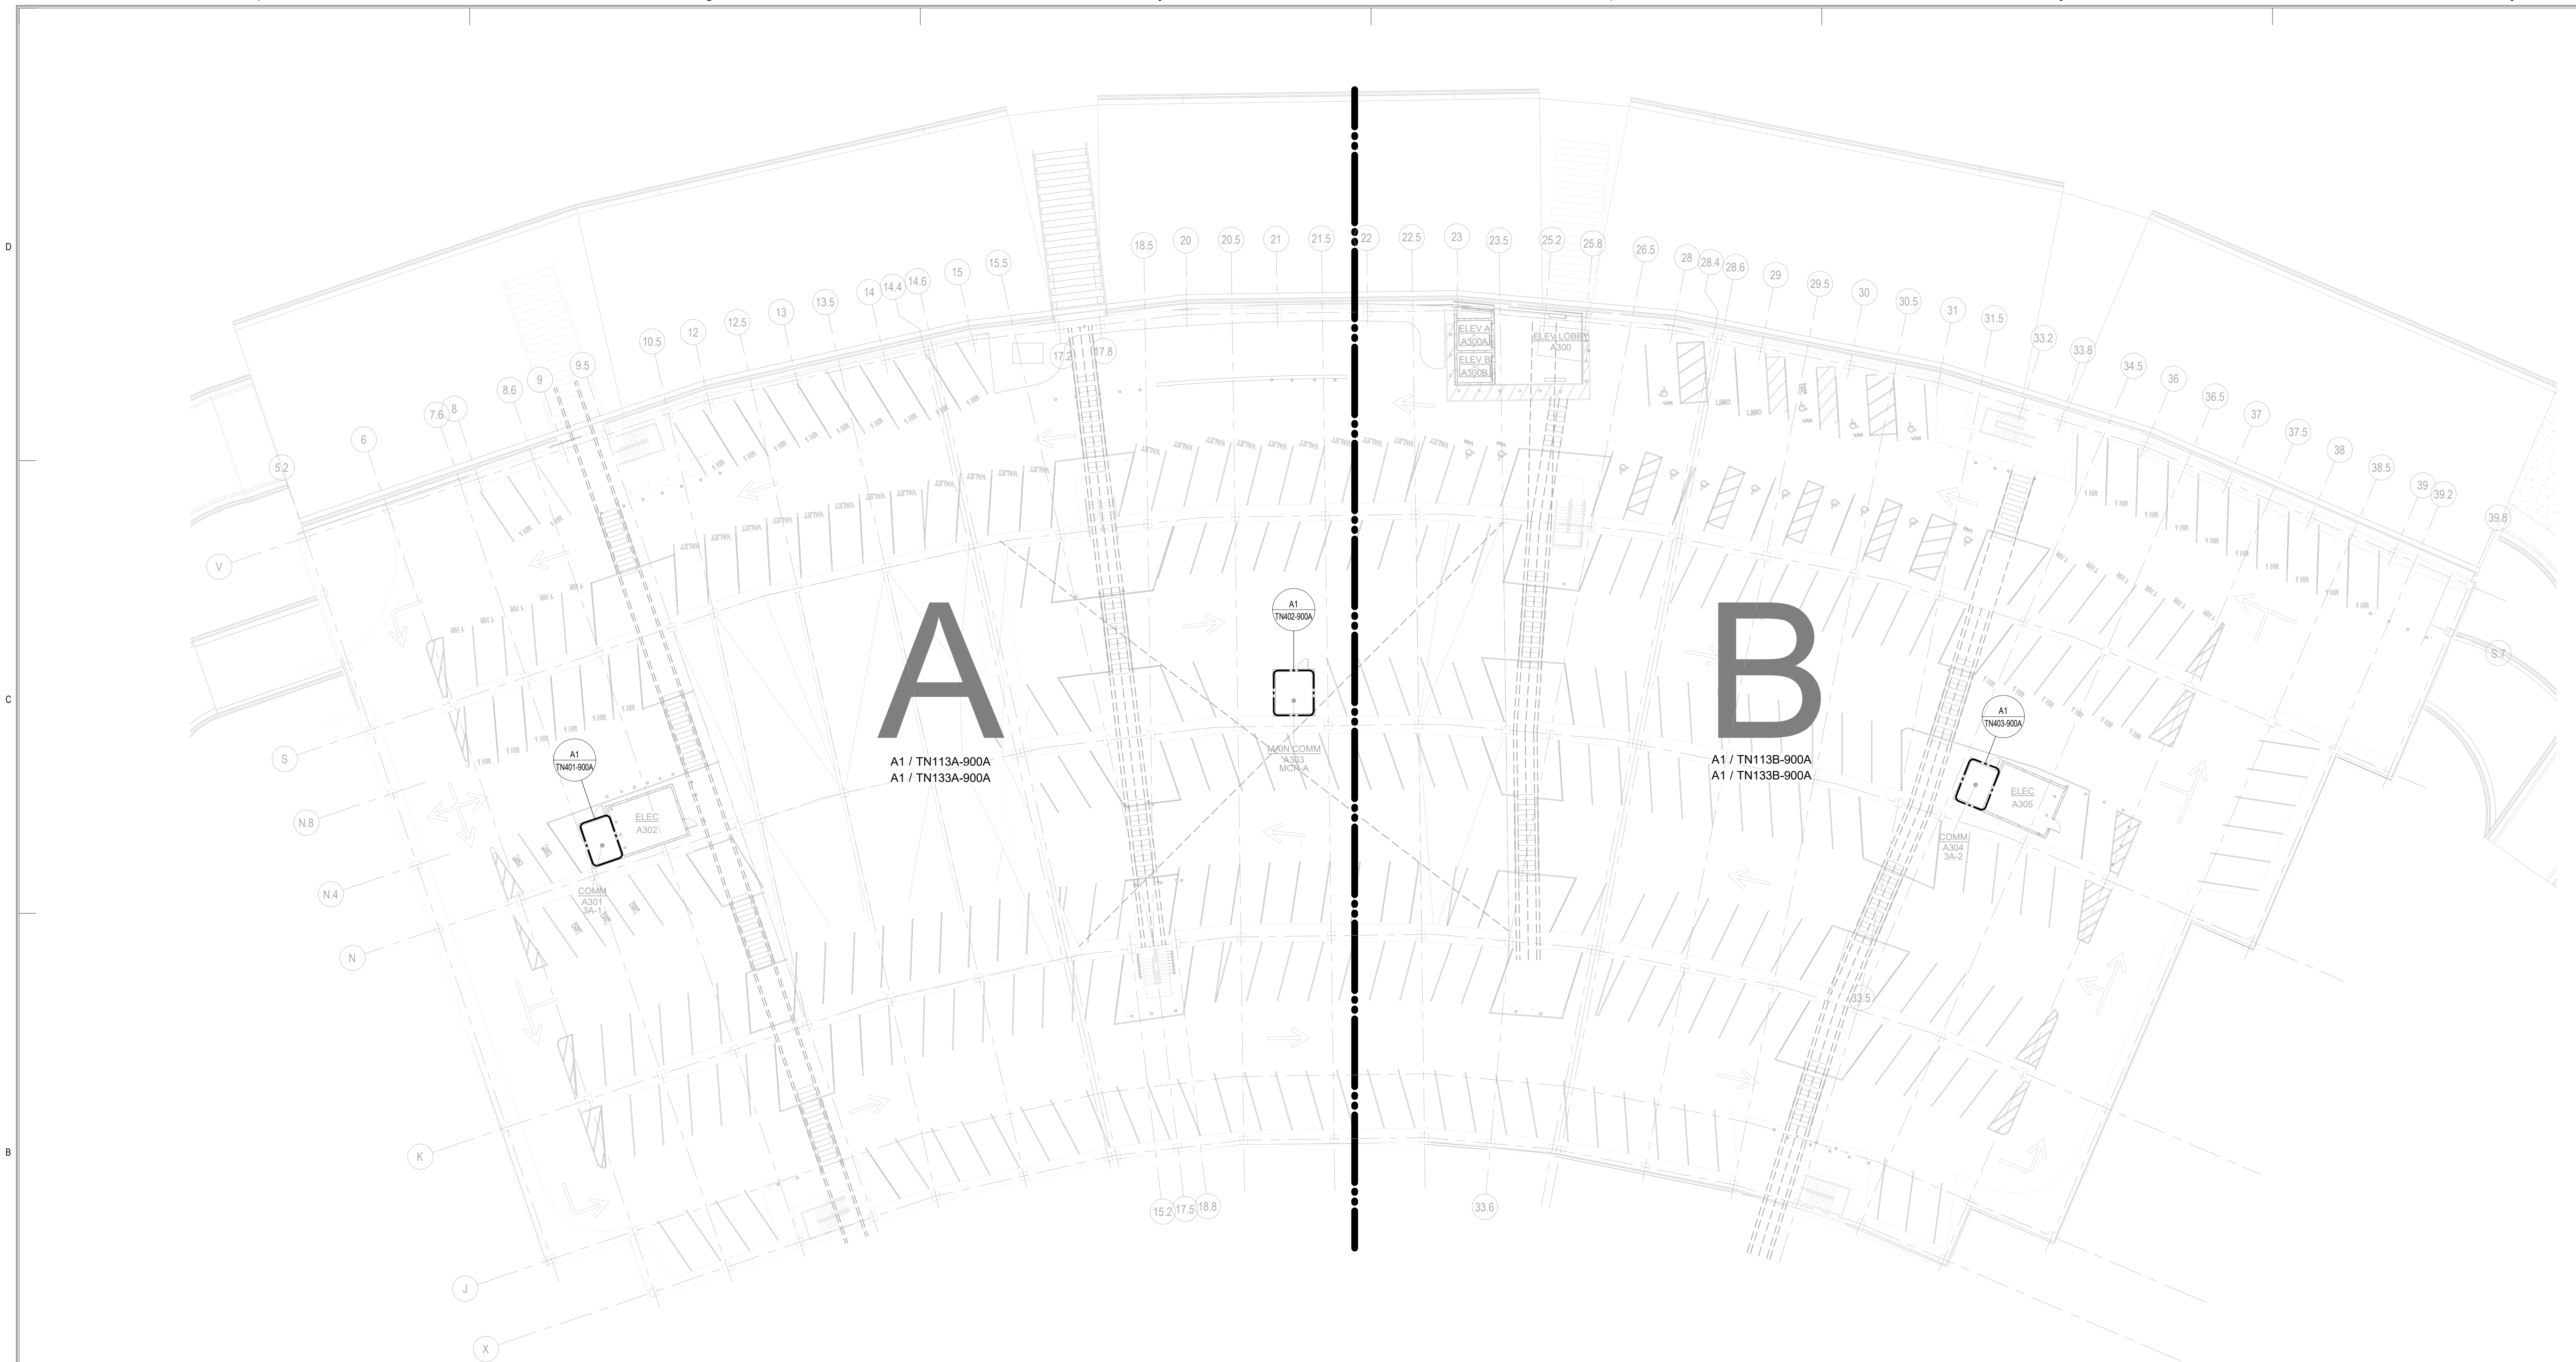


A1 TELECOM OVERALL - LEVEL C GARAGE A
1" = 20'-0"


GENERAL NOTE

SHEET NOTE

KEY PLAN

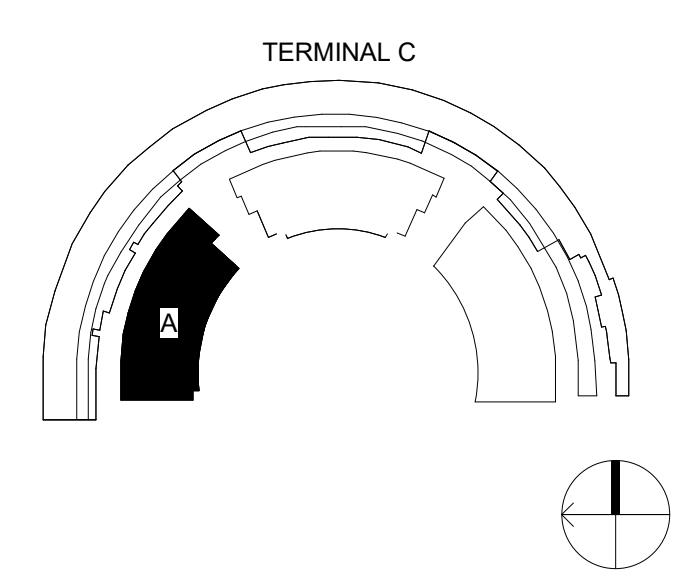

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

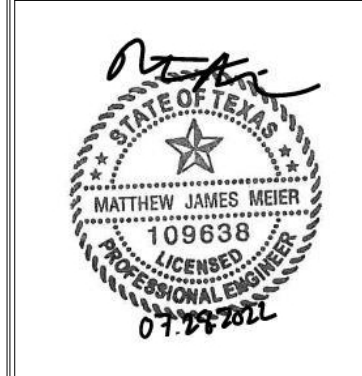

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-26	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) LEVEL C OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022


SHEET NUMBER
TN103-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

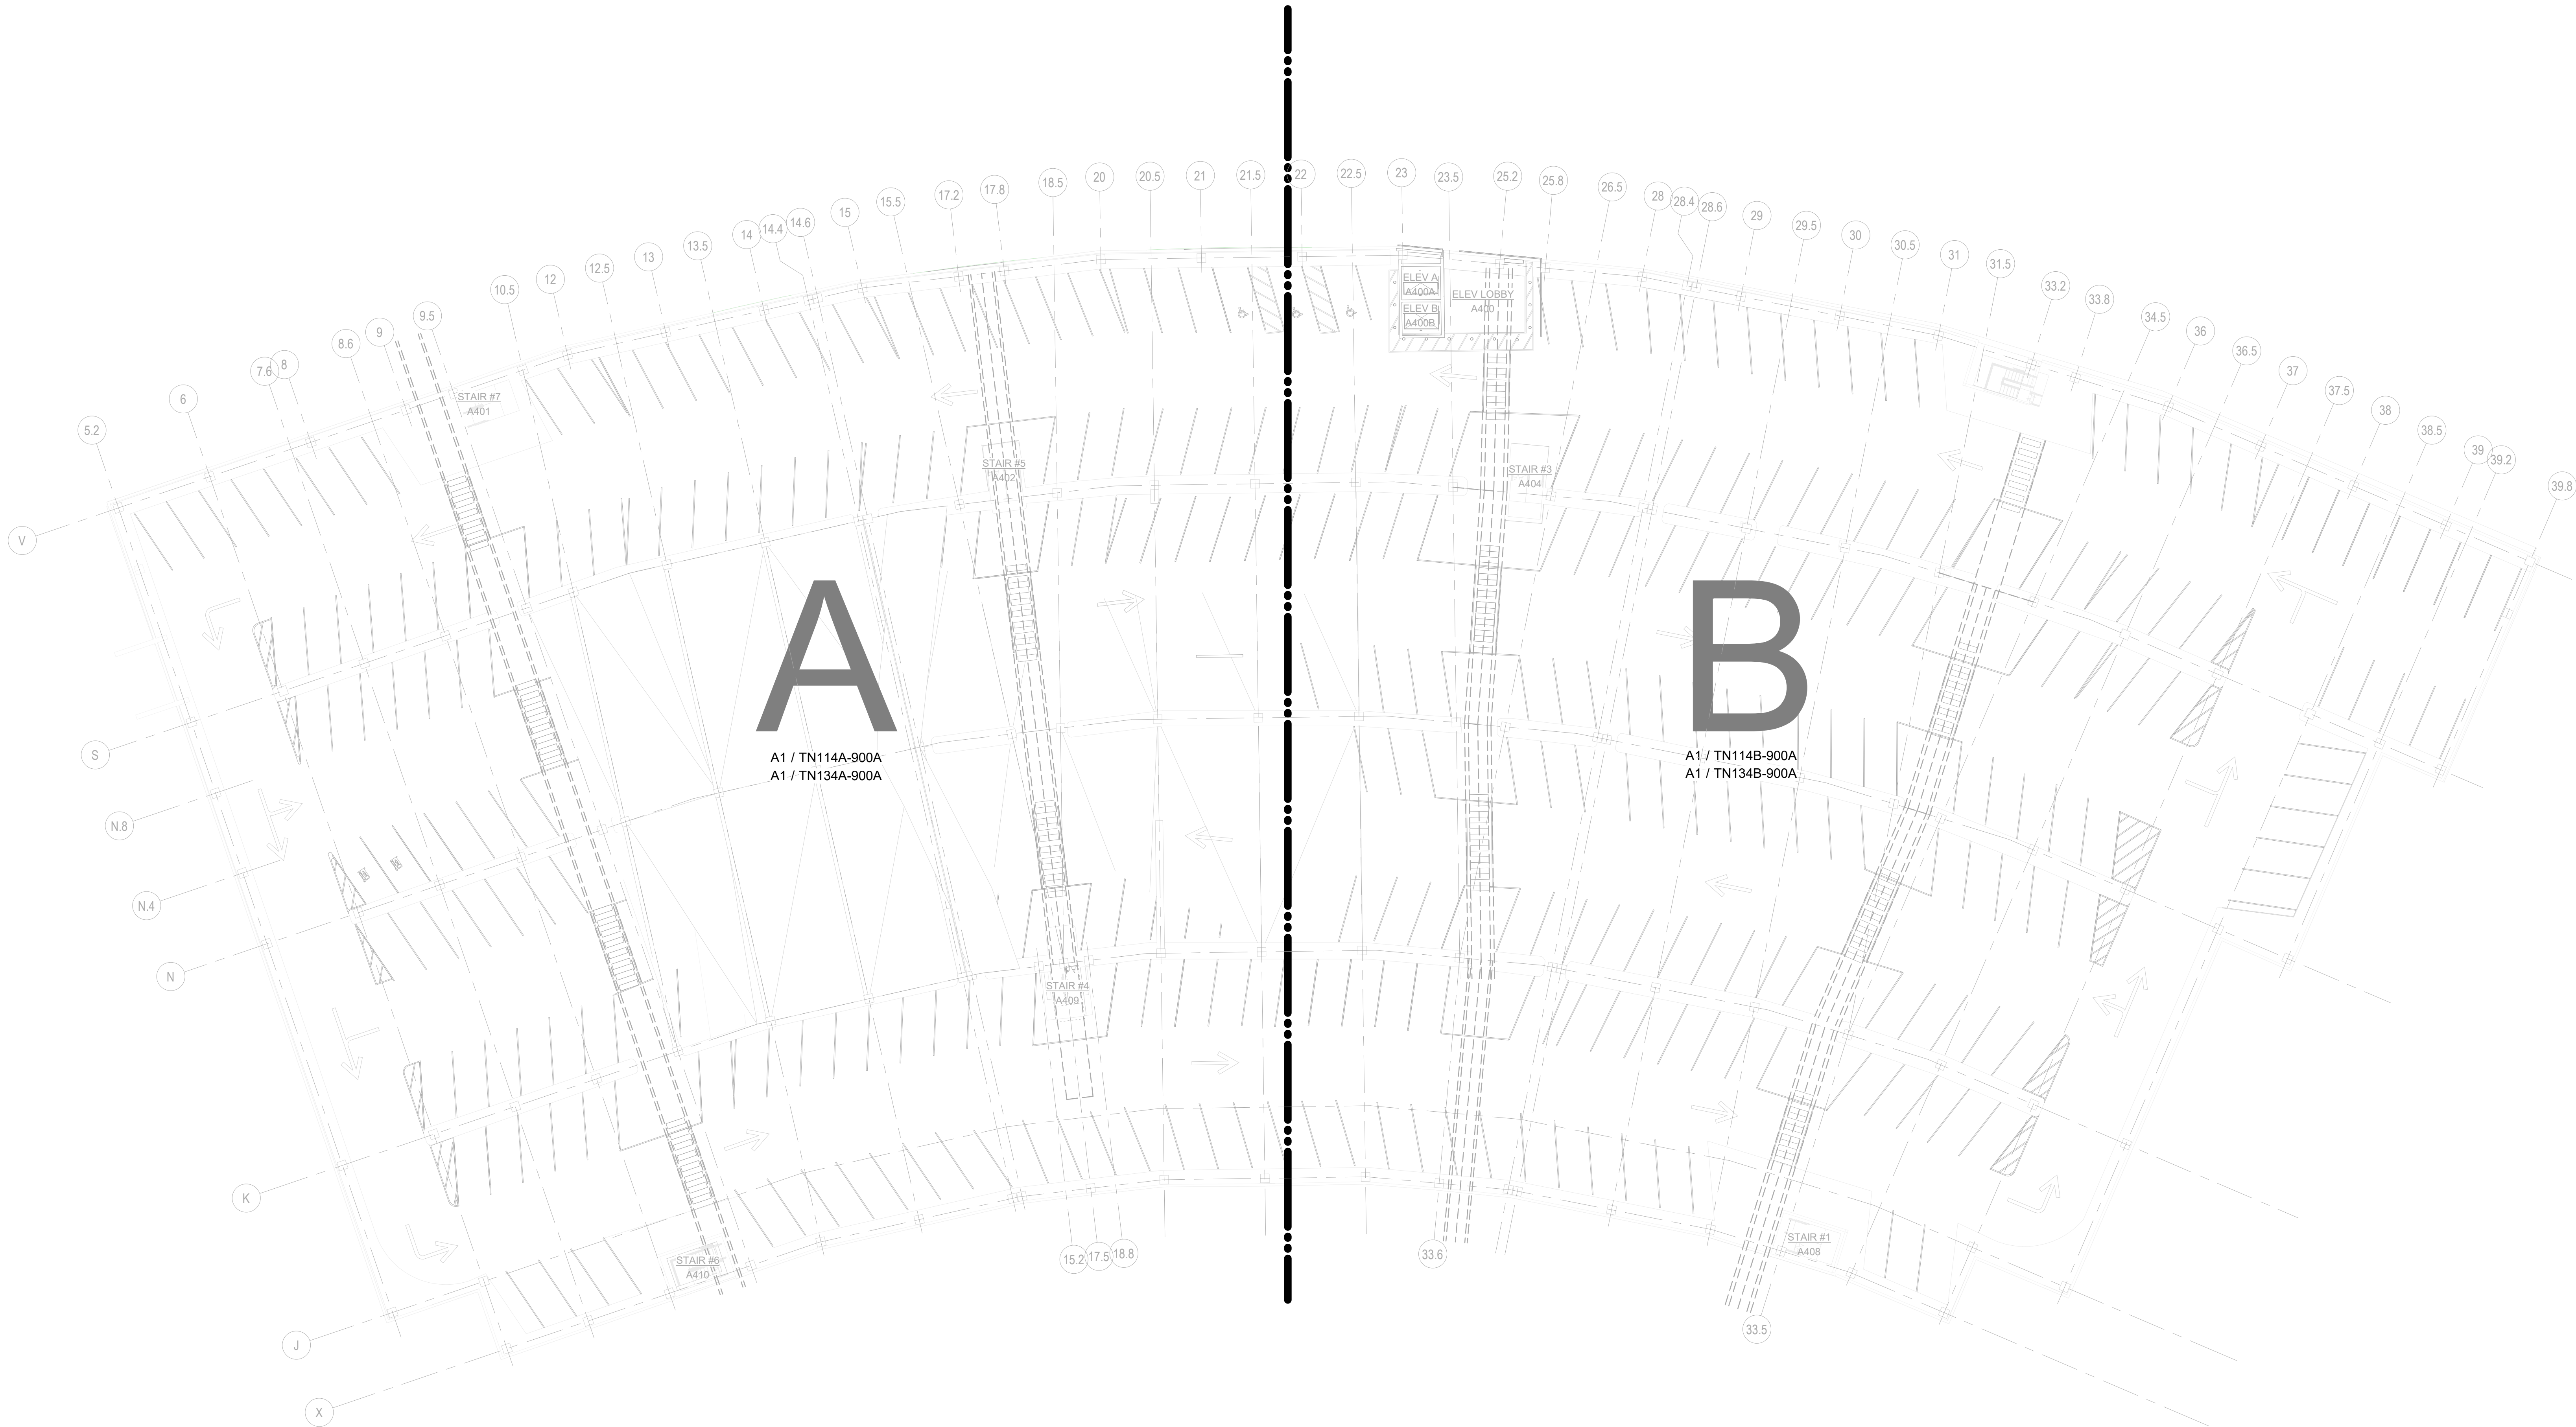


A1 TELECOM OVERALL - LEVEL D GARAGE A
1" = 20'-0"

GENERAL NOTE | **SHEET NOTE** | **KEY PLAN**

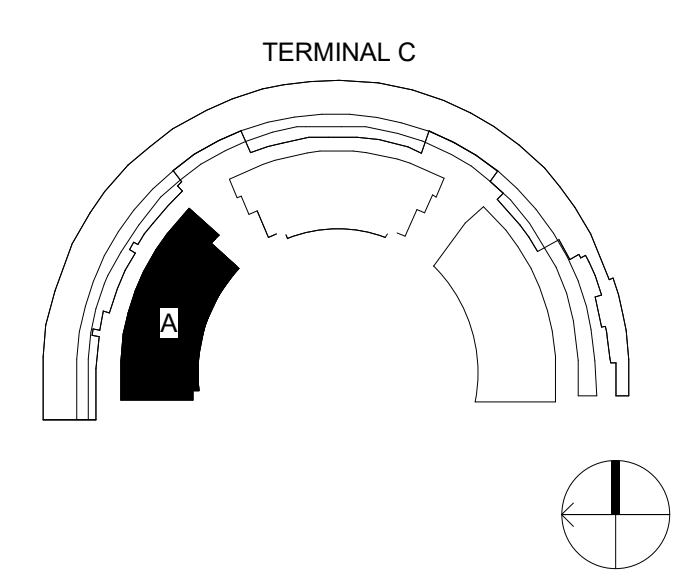

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

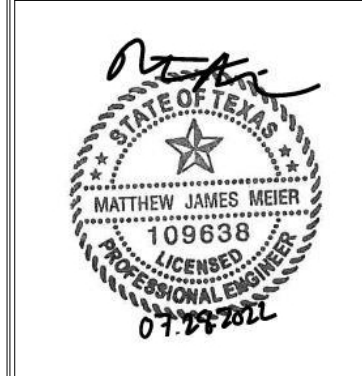

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) LEVEL D OVERALL

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN104-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

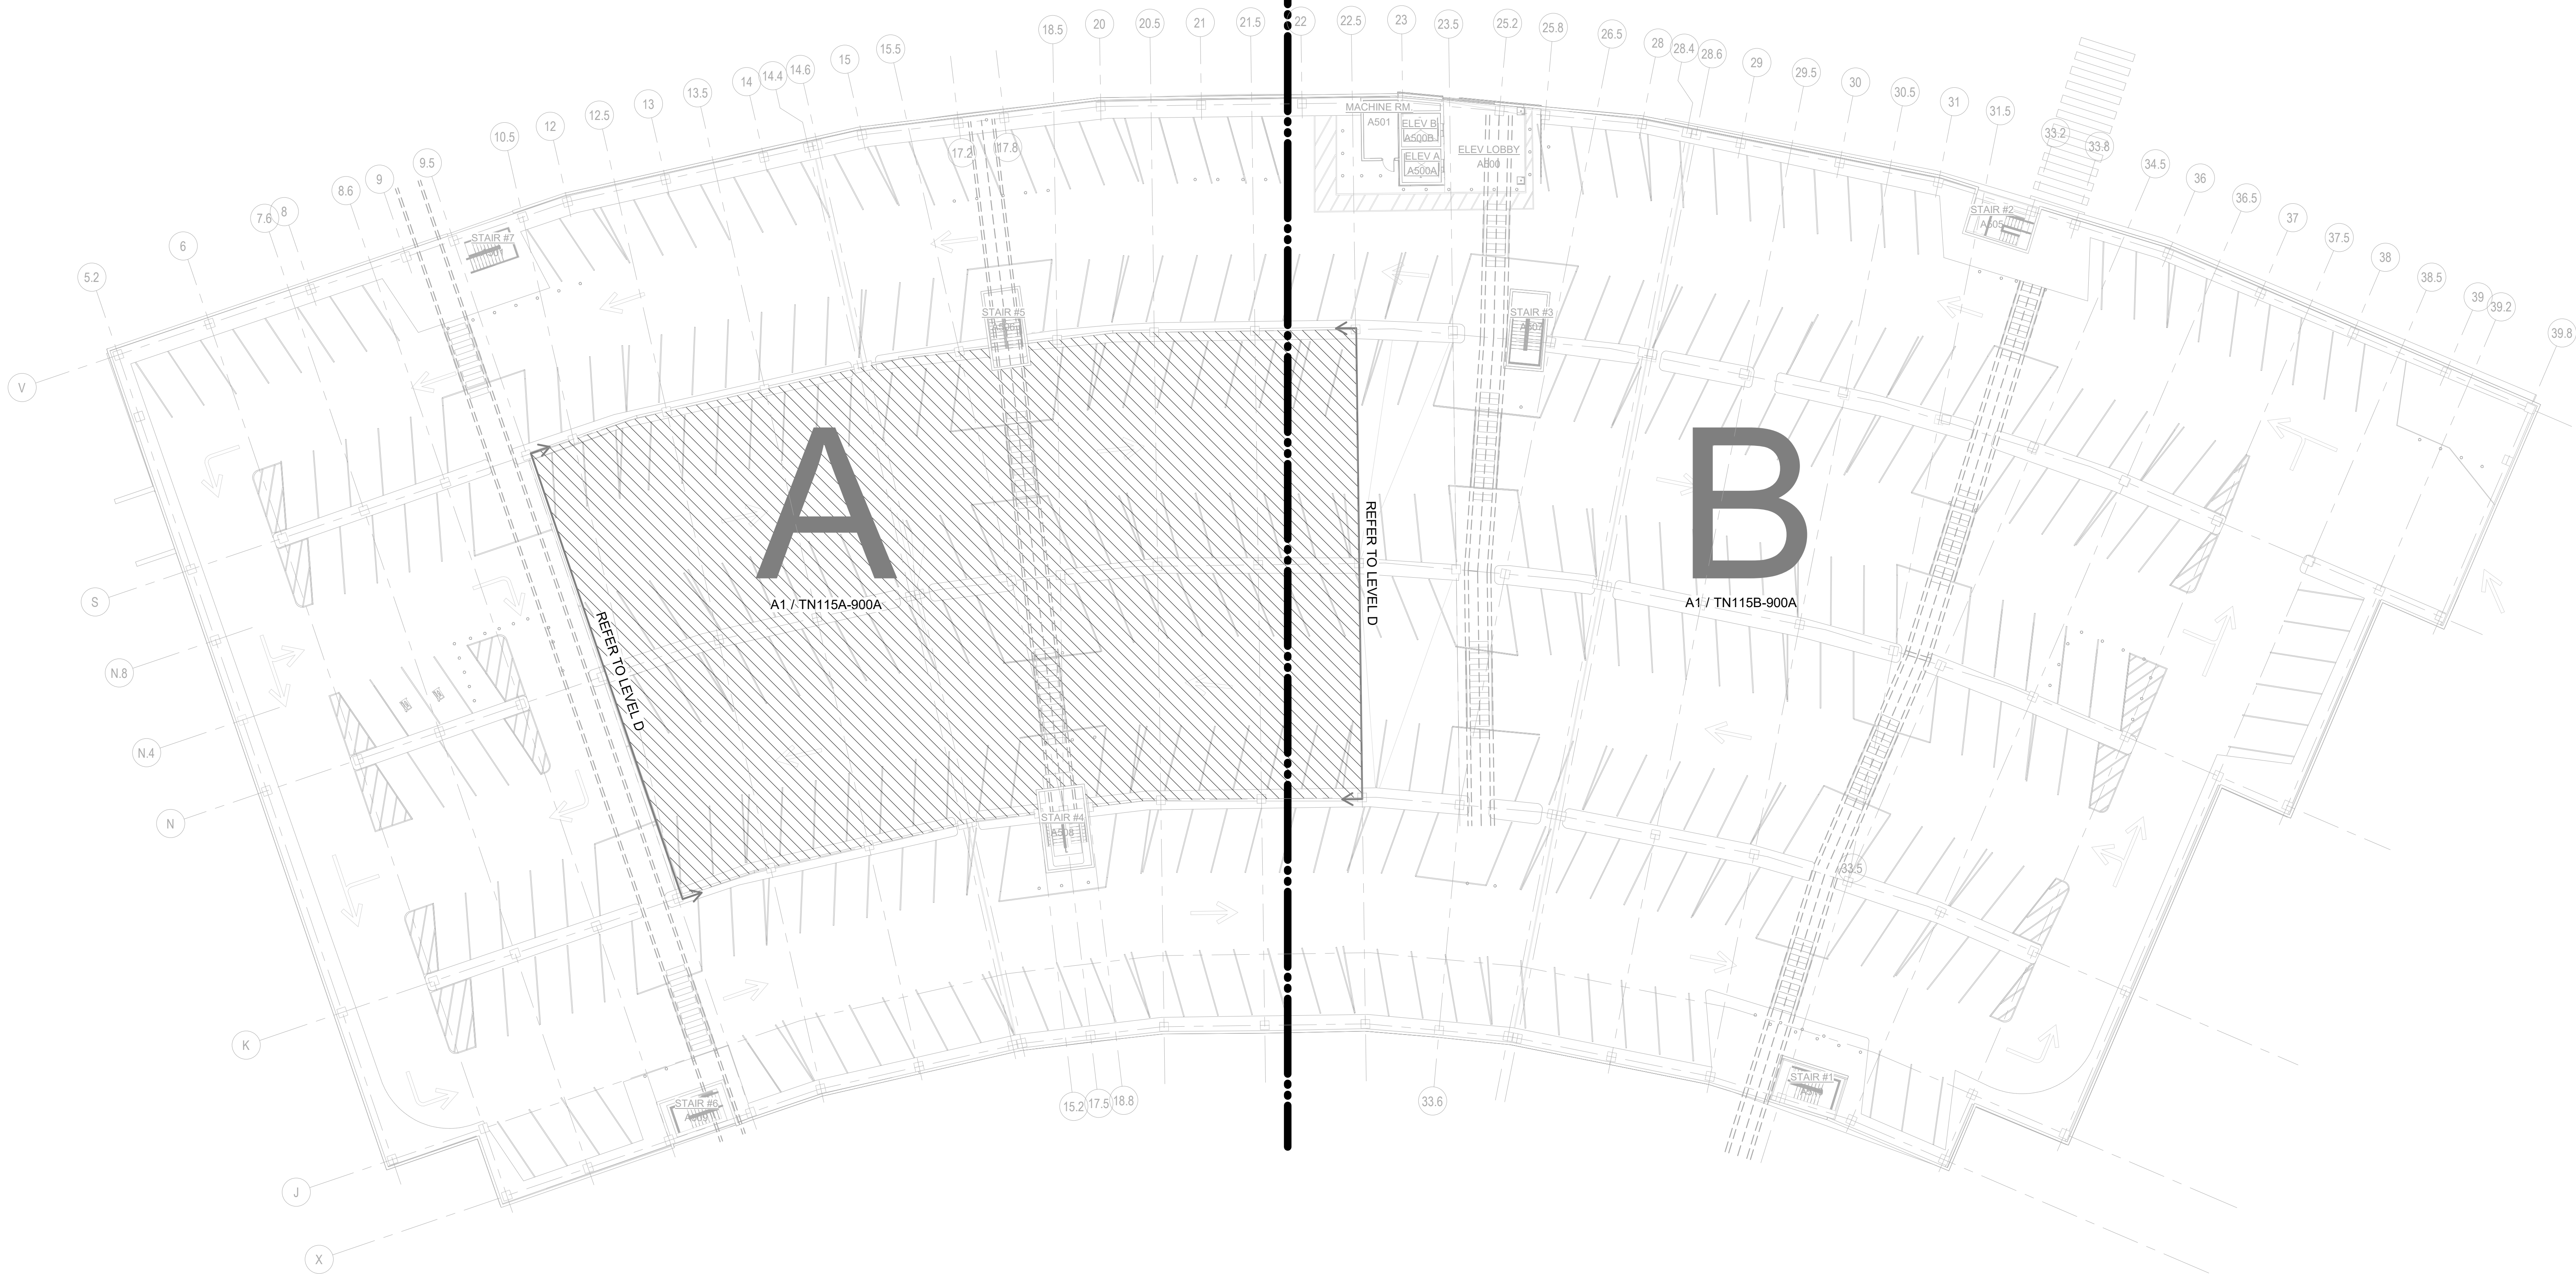


A1 TELECOM OVERALL - LEVEL E GARAGE A
1" = 20'-0"

GENERAL NOTE

SHEET NOTE

KEY PLAN

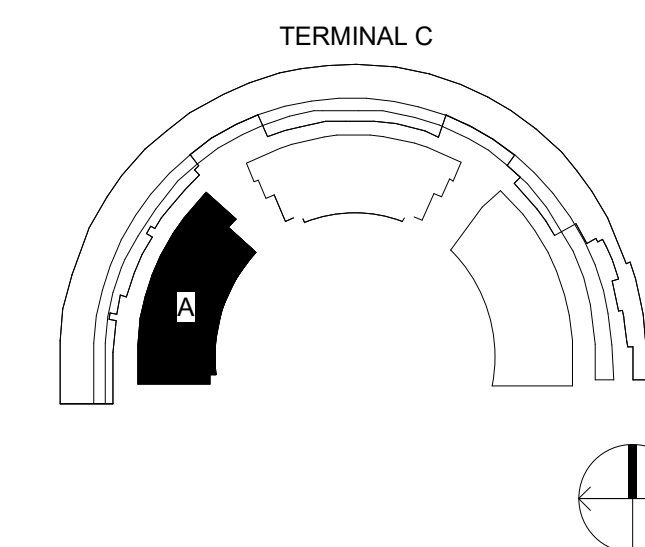

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

**NOT FOR BID OR
CONSTRUCTION**

NO.	DATE	DESCRIPTION
2021-02-23	30% DESIGN	
2022-01-26	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

PROJECT NUMBER: TFD-007

TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) LEVEL E OVERALL

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN105-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



GENERAL NOTE


1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.

SHEET NOTE


TN001 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR BUILDING AUTOMATION SYSTEM WITH ELECTRICAL CONTRACTOR.

A1 TELECOM FLOOR PLAN - GARAGE A LEVEL A AREA A
1/16" = 1'-0"

KEY PLAN

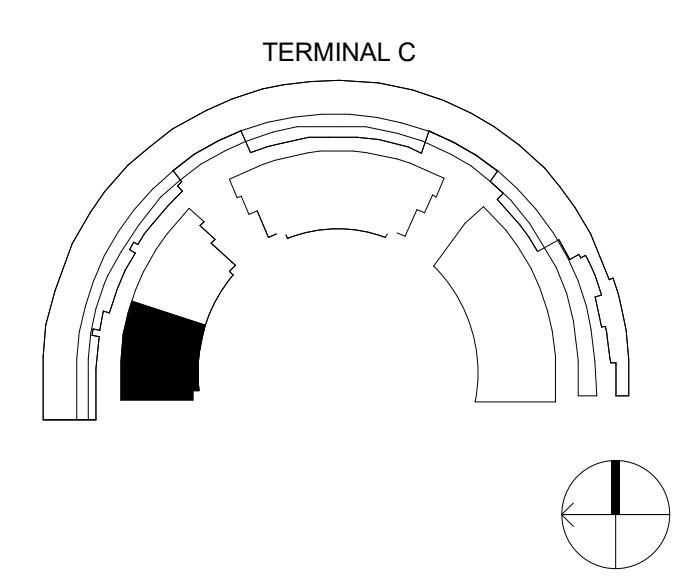

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

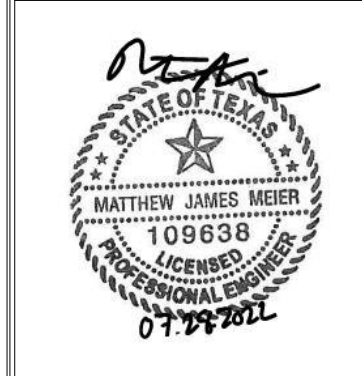

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL A AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN111A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM FLOOR PLAN - GARAGE A LEVEL A AREA B
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

TN001 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR BUILDING AUTOMATION SYSTEM WITH ELECTRICAL CONTRACTOR.

KEY PLAN

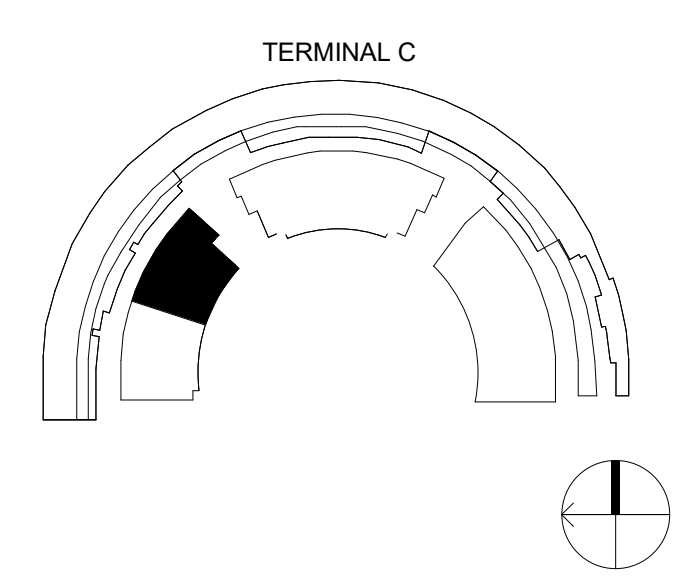

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

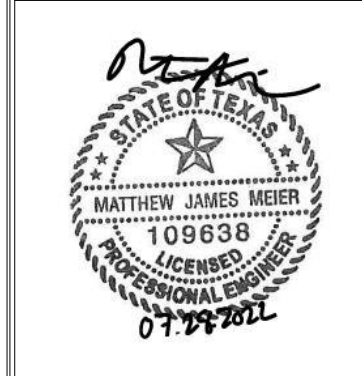

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL A AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN111B-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.

SHEET NOTE

TN006 SECURITY OUTLET MOUNTED AT CEILING WITHIN CIB. COORDINATE FINAL MOUNTING LOCATION WITH RELATED SECURITY CAMERAS. REFER TO CIB OUTLET TYPE S DETAIL ON SHEET TN510 FOR FURTHER DETAILS.


KEY PLAN

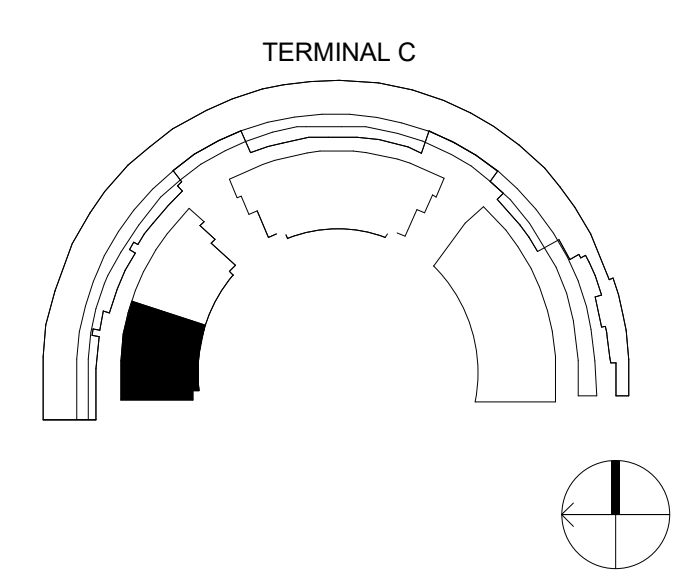

A1 TELECOM FLOOR PLAN - GARAGE A LEVEL B AREA A
1/16" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

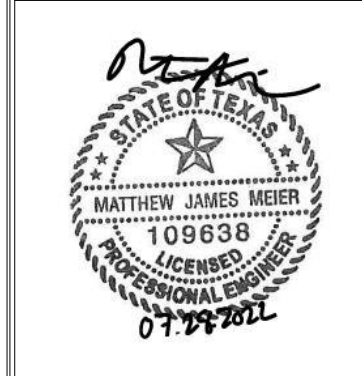

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL B AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN112A-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

TN006 SECURITY OUTLET MOUNTED AT CEILING WITHIN CIB. COORDINATE FINAL MOUNTING LOCATION WITH RELATED SECURITY CAMERAS. REFER TO CIB OUTLET TYPE S DETAIL ON SHEET TN510 FOR FURTHER DETAILS.

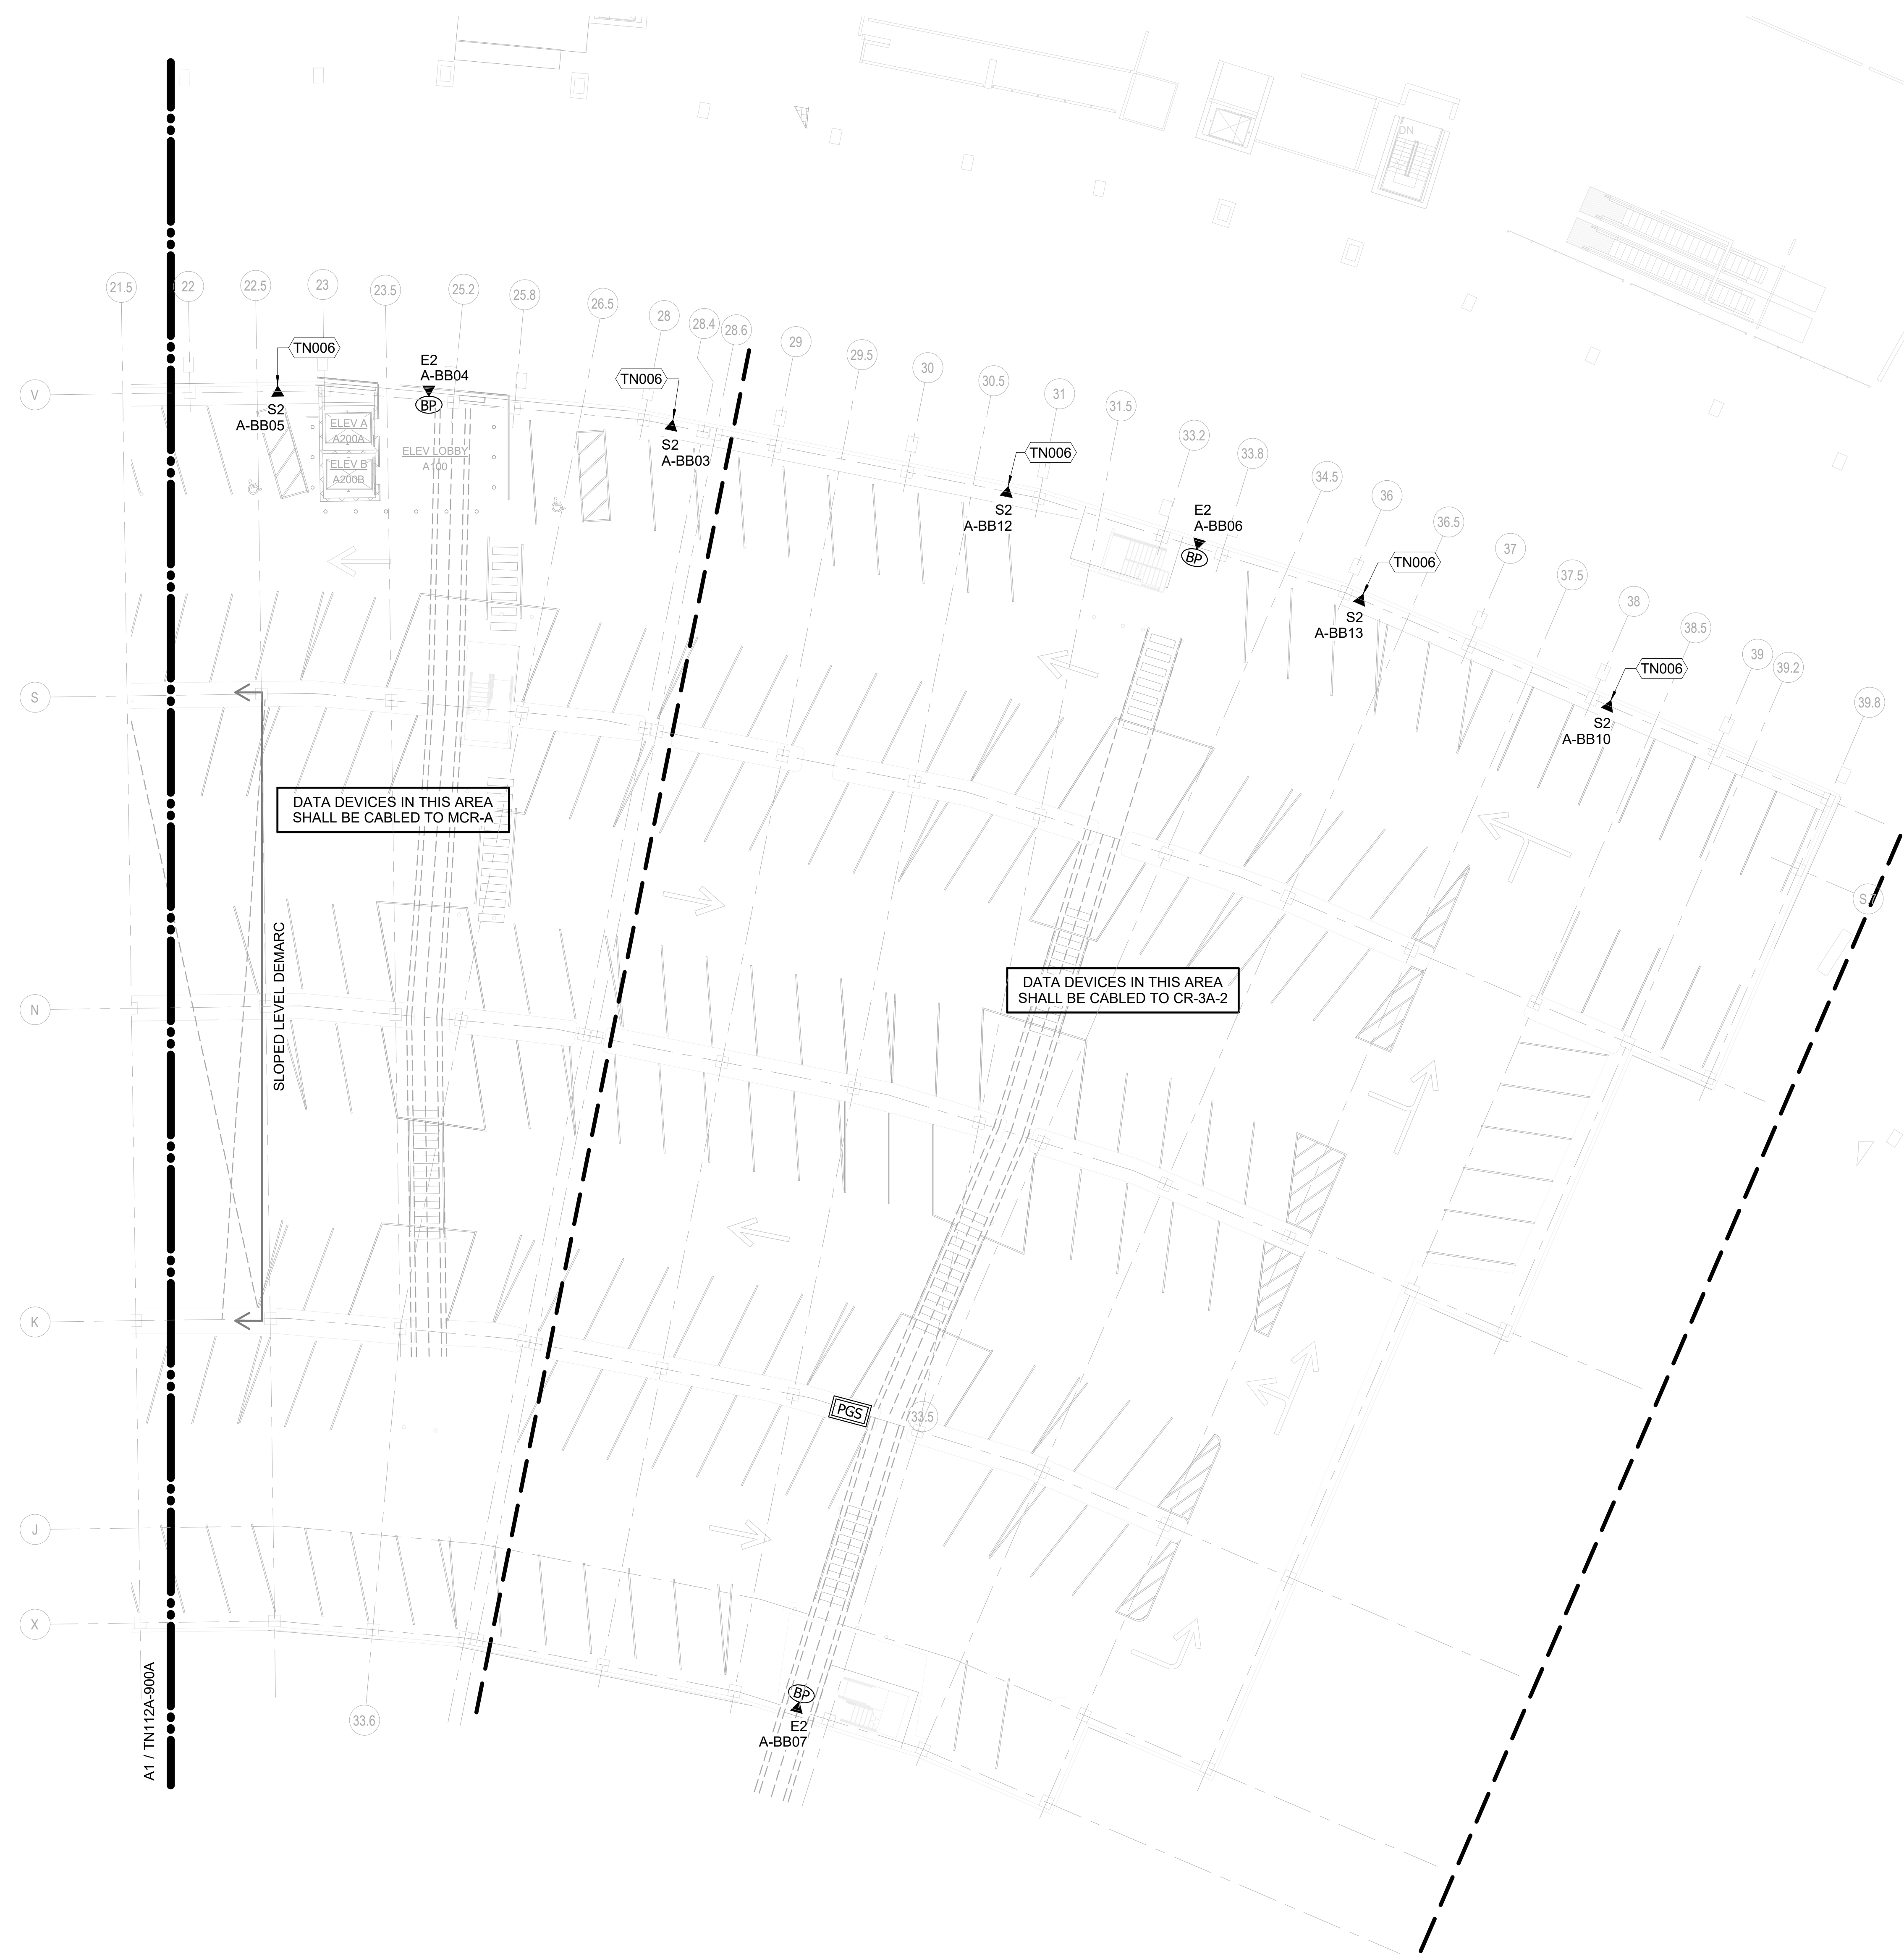


A1 TELECOM FLOOR PLAN - GARAGE A LEVEL B AREA B
1/16" = 1'-0"

KEY PLAN

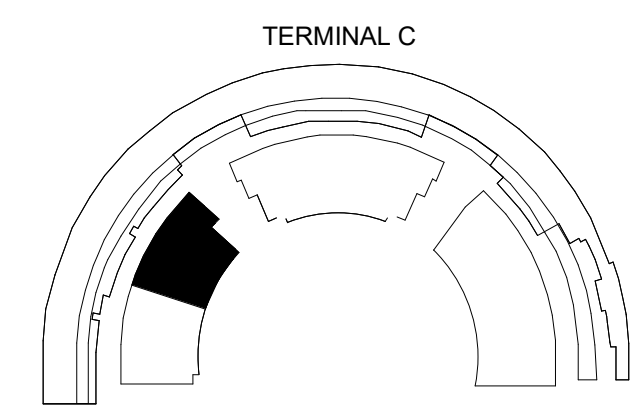

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

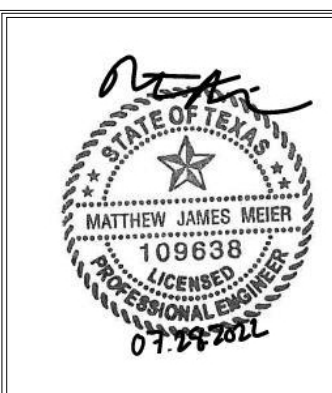

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION


NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL B AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN112B-900A

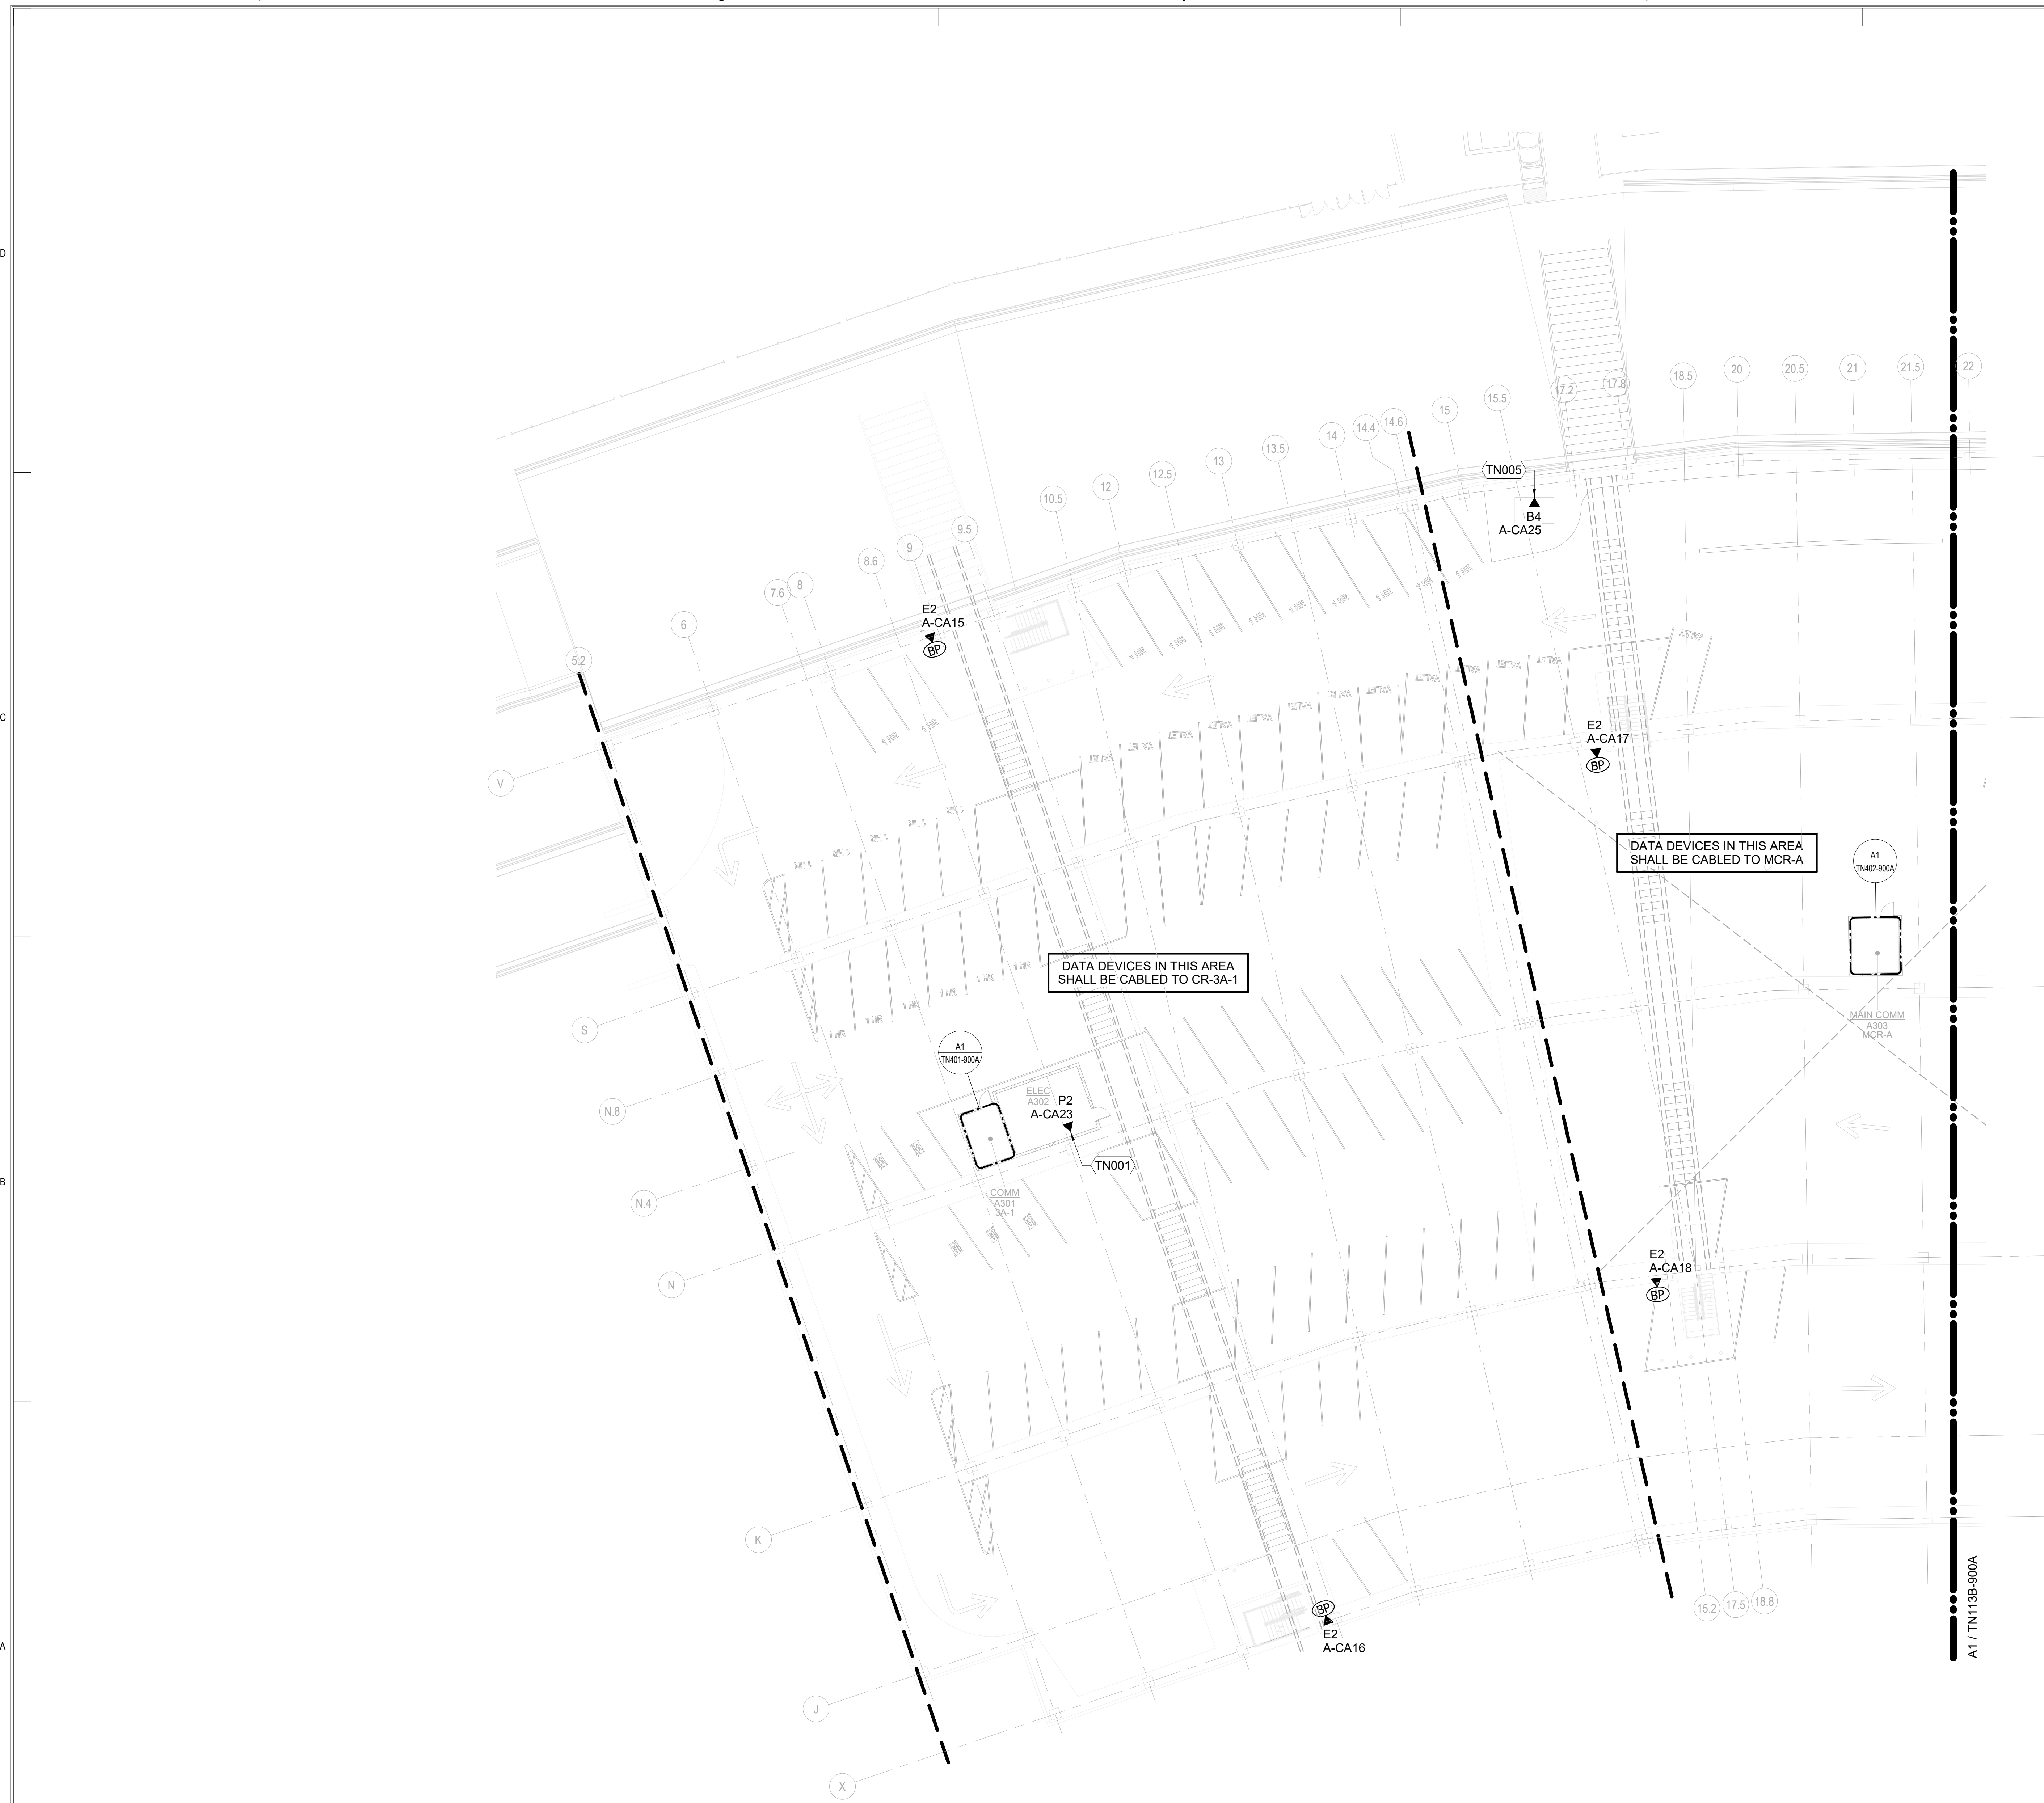

A1 TELECOM FLOOR PLAN - GARAGE A LEVEL C AREA A
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

- TN001 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR BUILDING AUTOMATION SYSTEM WITH ELECTRICAL CONTRACTOR.
- TN005 FIELD COORDINATE WITH VALET BOOTH FOR EXACT LOCATION OF DATA OUTLET PRIOR TO CONSTRUCTION.

KEY PLAN

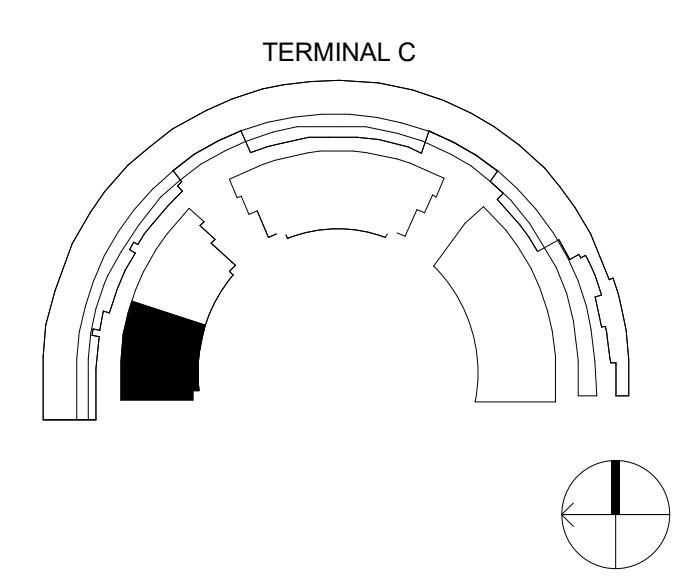

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

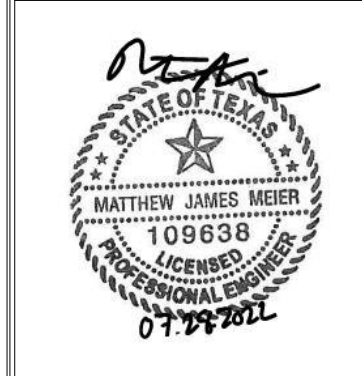

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL C AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN113A-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

TN001 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR BUILDING AUTOMATION SYSTEM WITH ELECTRICAL CONTRACTOR.

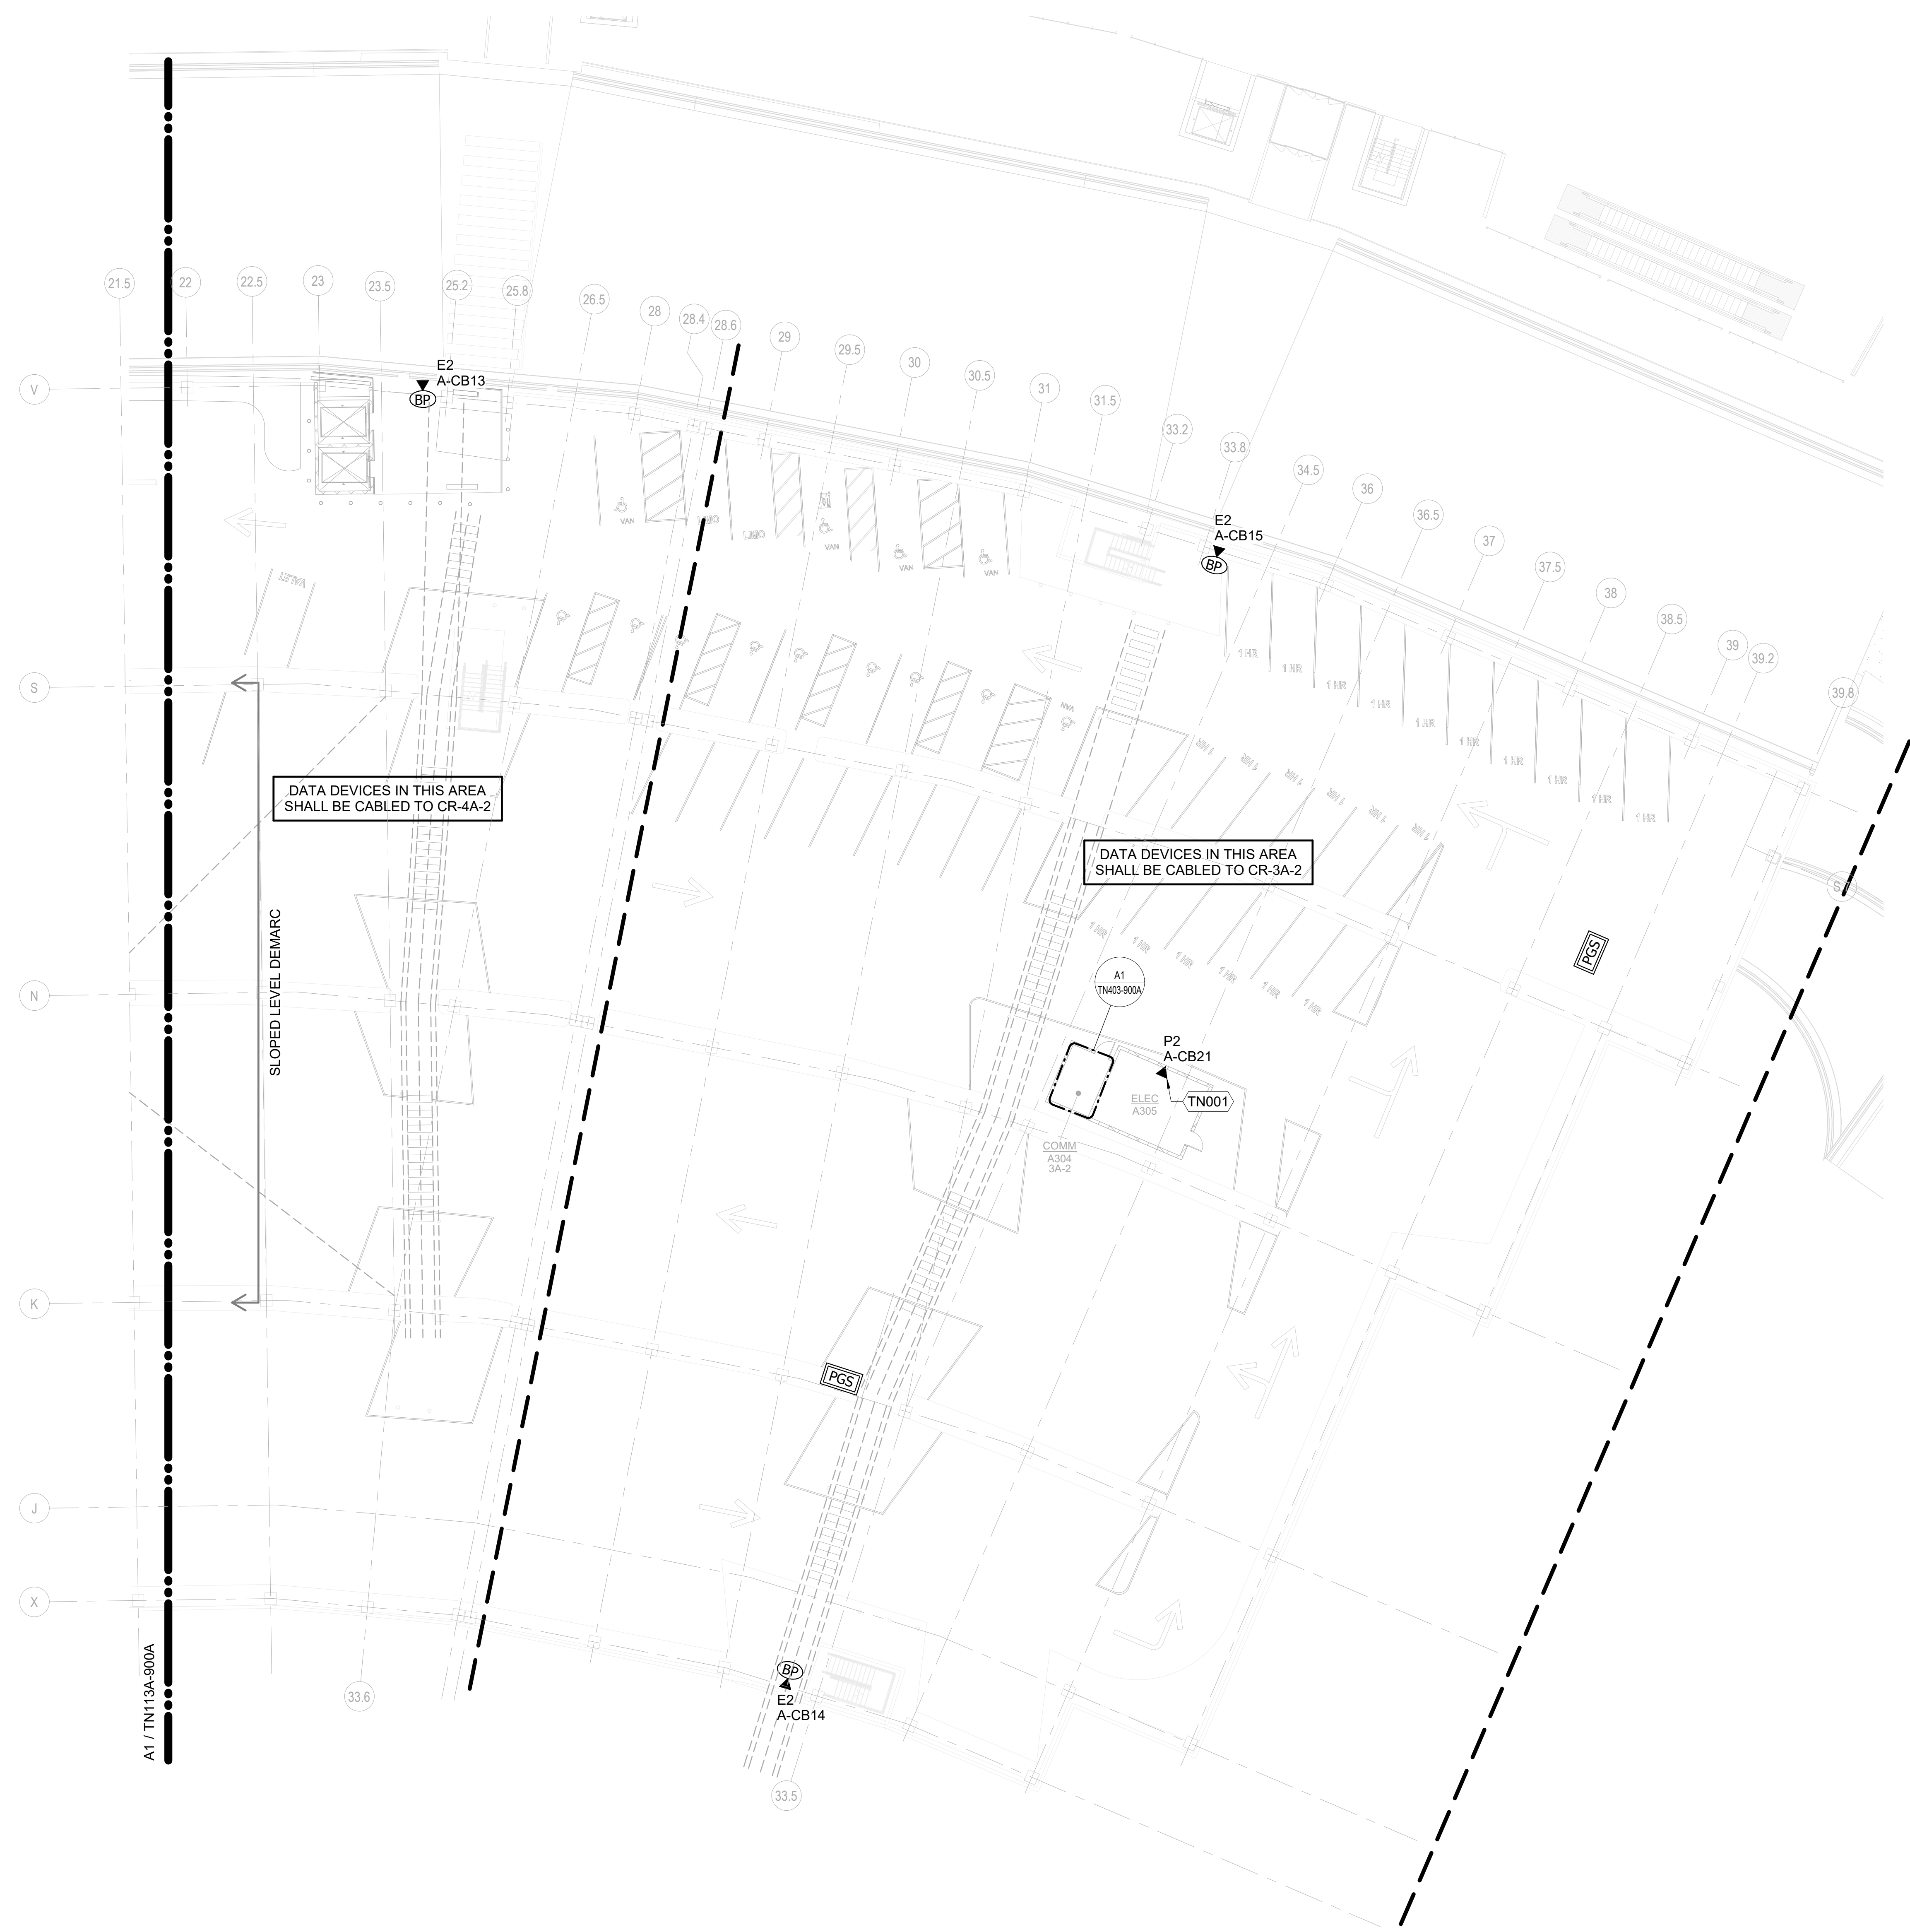

A1 TELECOM FLOOR PLAN - GARAGE A LEVEL C AREA B
1/16" = 1'-0"

KEY PLAN

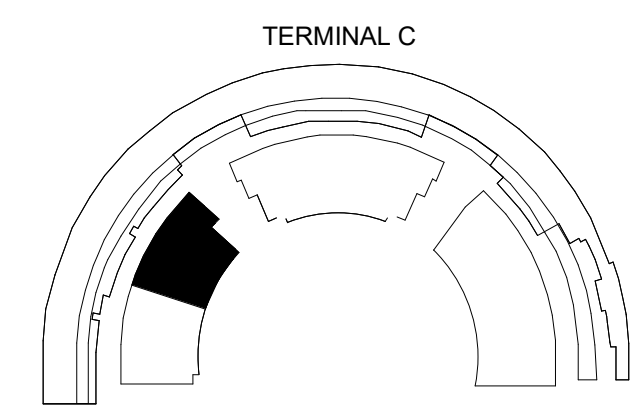

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL C AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN113B-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM FLOOR PLAN - GARAGE A LEVEL D AREA A
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

TN006 SECURITY OUTLET MOUNTED AT CEILING WITHIN CIB. COORDINATE FINAL MOUNTING LOCATION WITH RELATED SECURITY CAMERAS. REFER TO CIB OUTLET TYPE S DETAIL ON SHEET TN510 FOR FURTHER DETAILS.

KEY PLAN

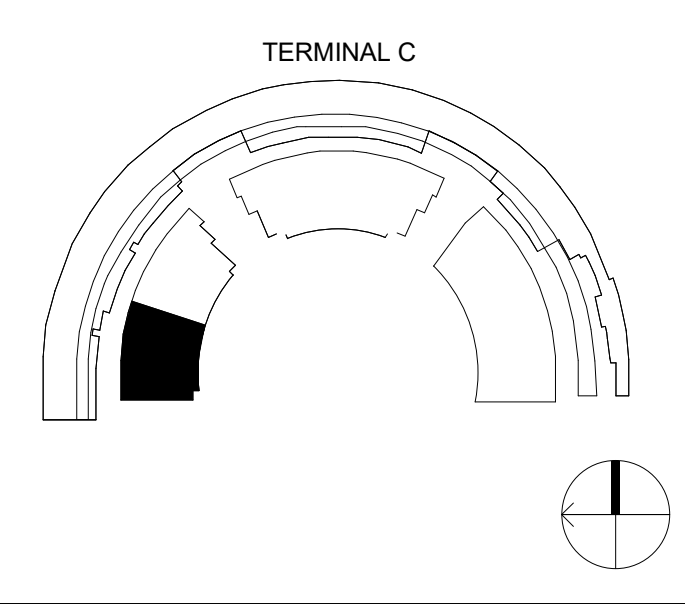

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

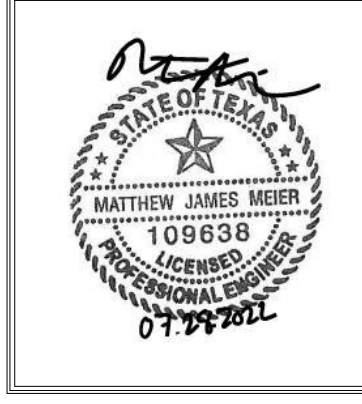

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL D AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN114A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

TN006 SECURITY OUTLET MOUNTED AT CEILING WITHIN CIB. COORDINATE FINAL MOUNTING LOCATION WITH RELATED SECURITY CAMERAS. REFER TO CIB OUTLET TYPE S DETAIL ON SHEET TN510 FOR FURTHER DETAILS.




A1 TELECOM FLOOR PLAN - GARAGE A LEVEL D AREA B
1/16" = 1'-0"

KEY PLAN

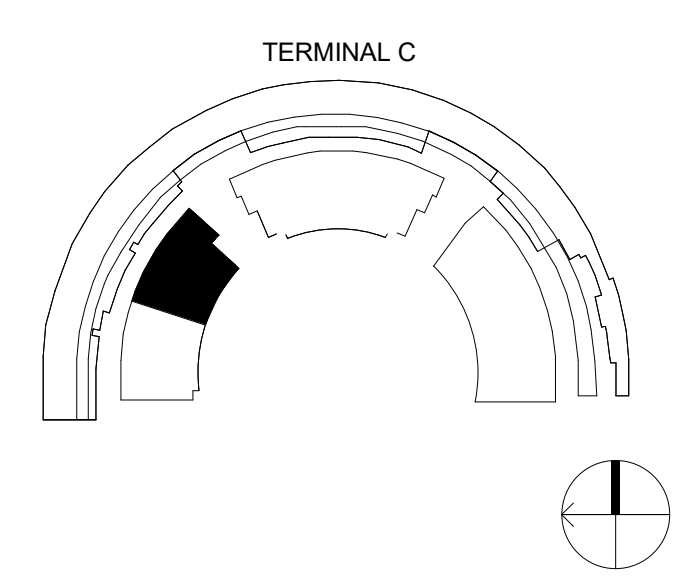

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

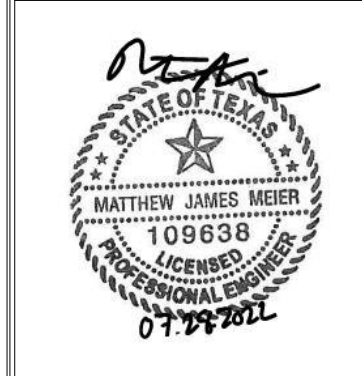

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL D AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN114B-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.


SHEET NOTE

KEY PLAN

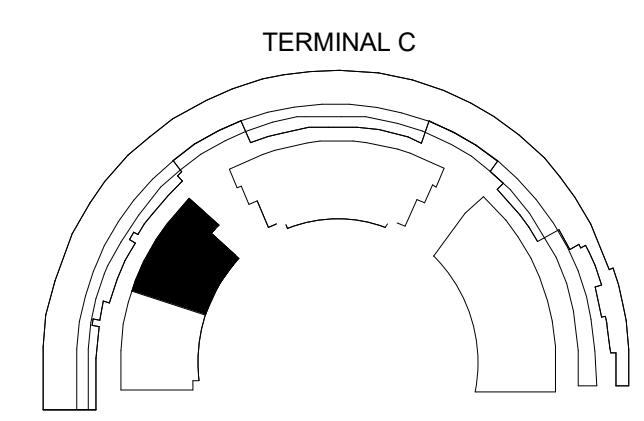


A1 TELECOM FLOOR PLAN - GARAGE A LEVEL E AREA A
1/16" = 1'-0"

D
C
B
A

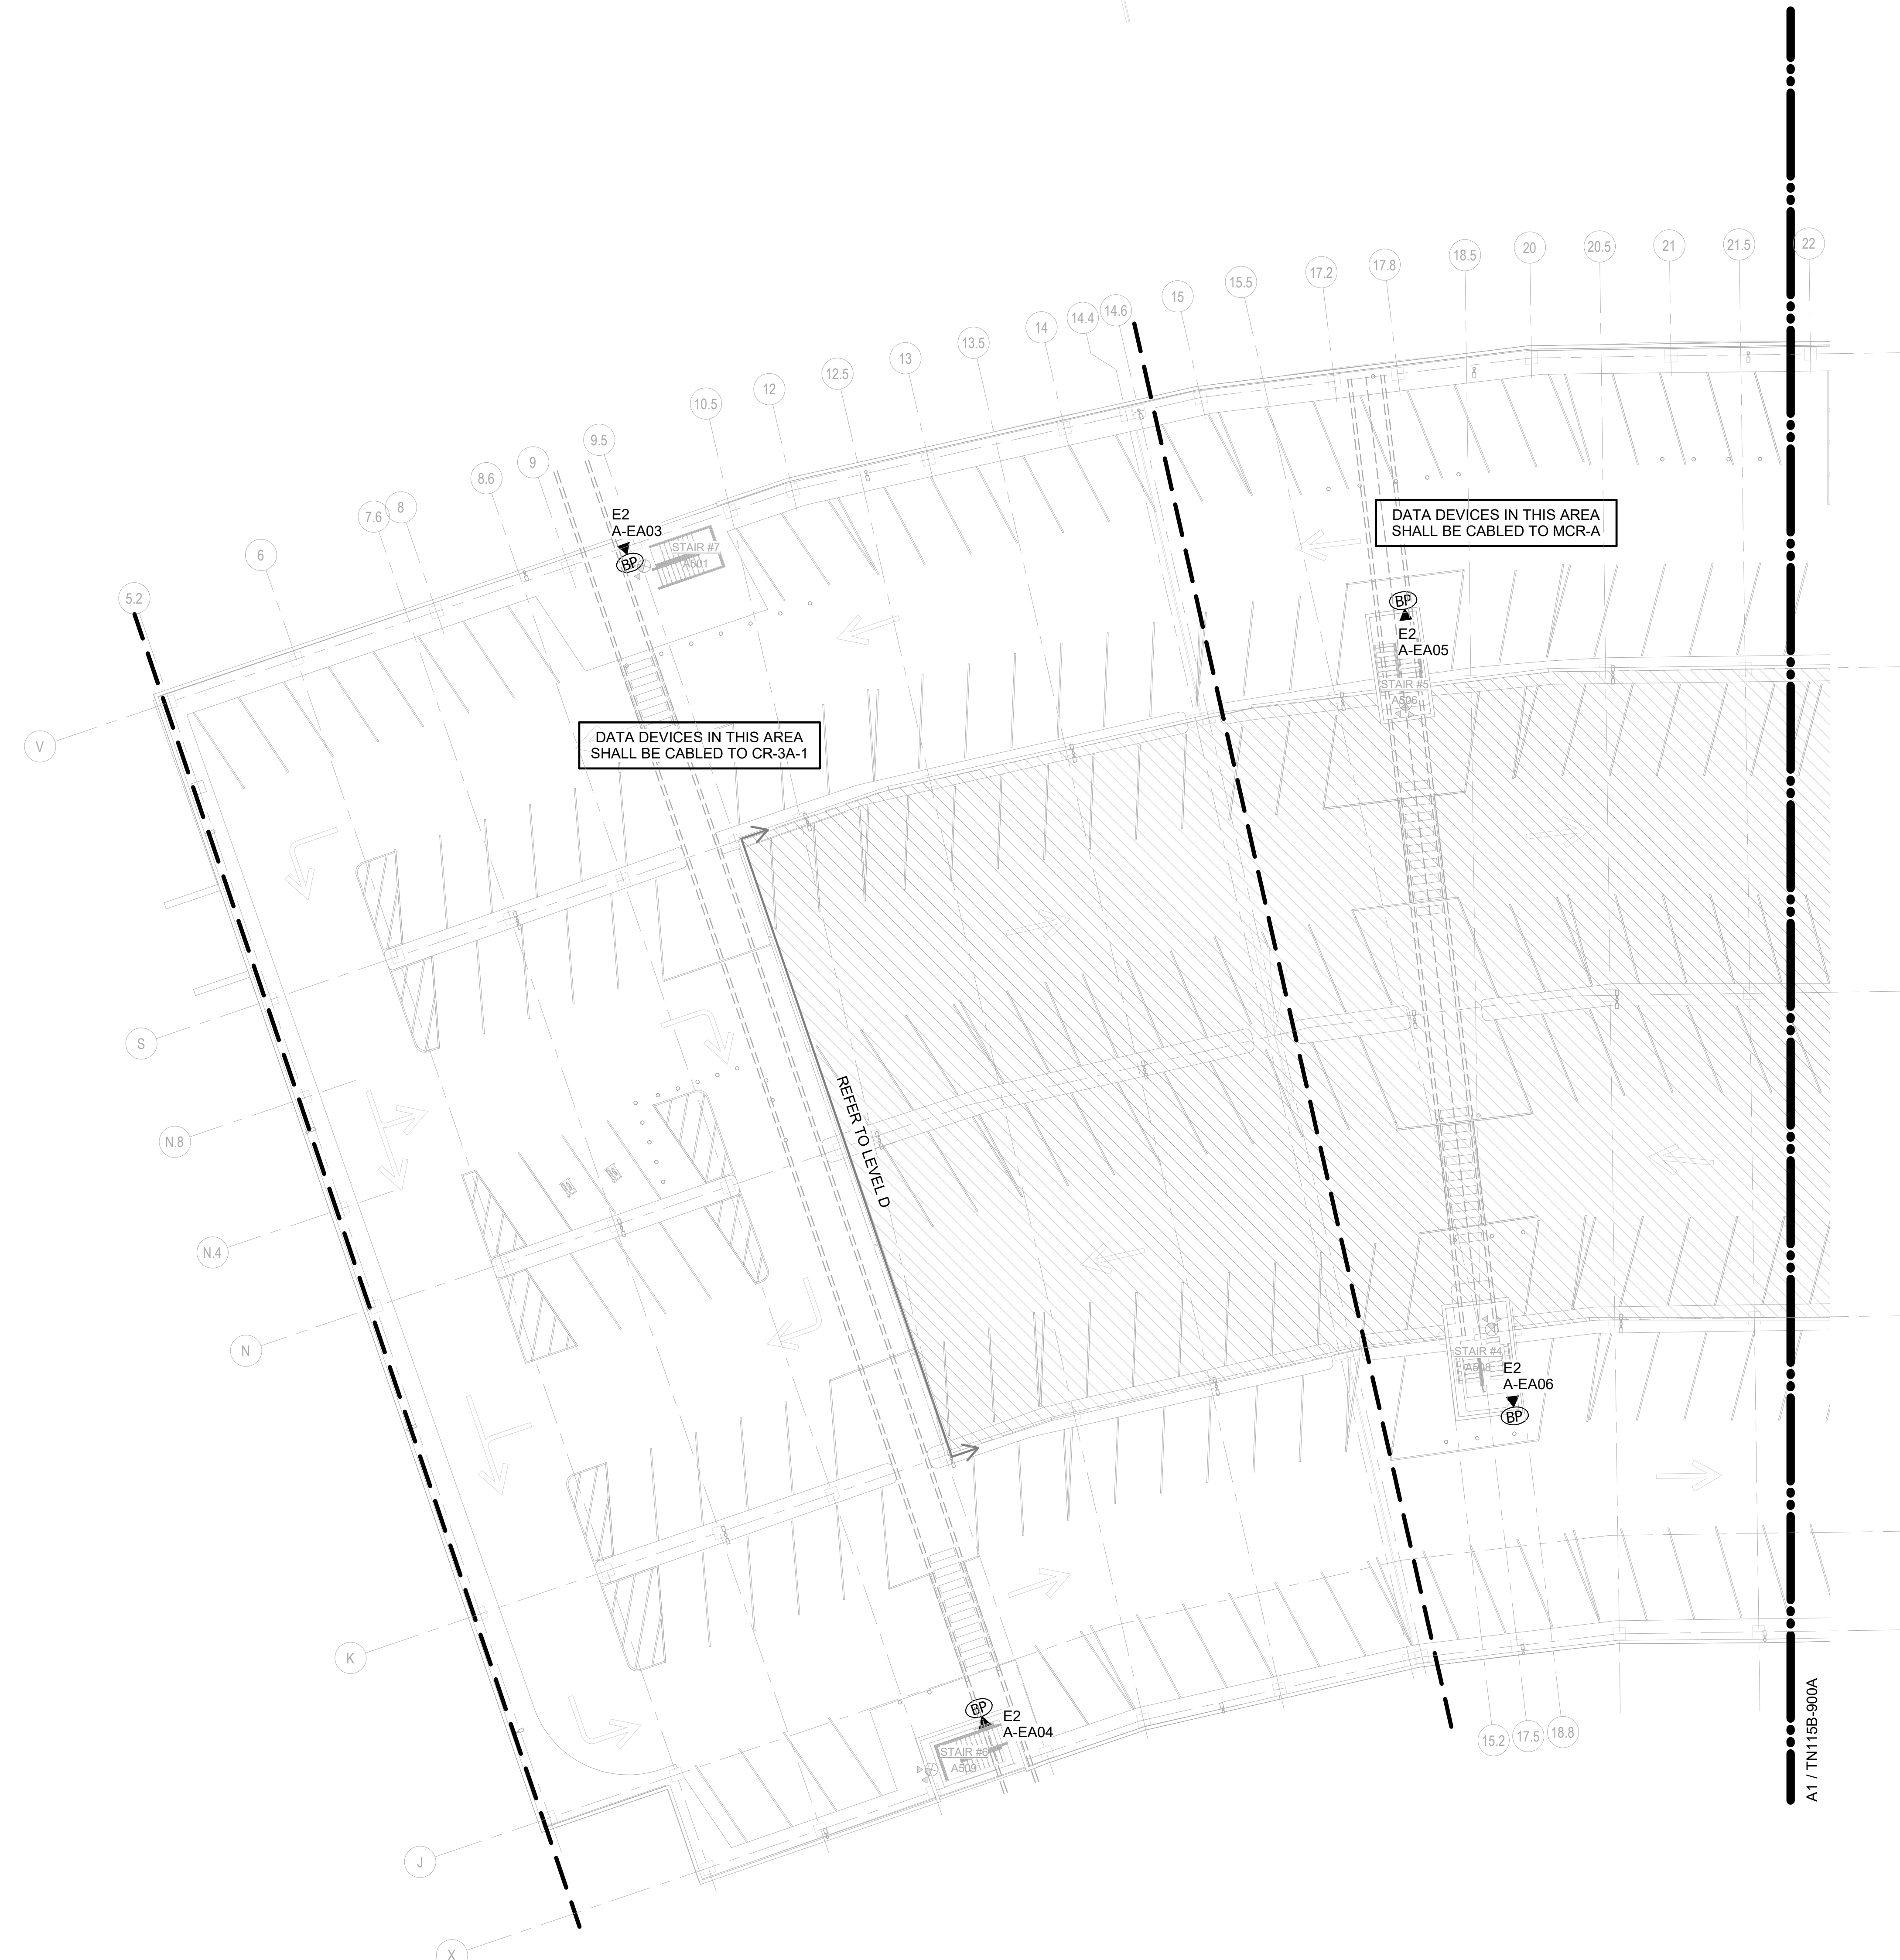

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

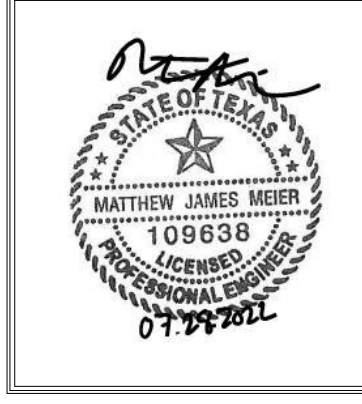

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL E AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN115A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM FLOOR PLAN - GARAGE A LEVEL E AREA B
1/16" = 1'-0"

GENERAL NOTE


1. REFER TO TN0 SERIES OF DRAWINGS FOR ALL SYMBOLS, LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.

SHEET NOTE

TN002 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR HVAC OR ELECTRICAL SYSTEMS MONITORING WITH ELECTRICAL AND MECHANICAL CONTRACTOR.

TN003 COORDINATE LOCATION OF OUTLETS AND ENCLOSURES WITHIN ELEVATOR CONTROL ROOM WITH ELEVATOR CONTRACTOR. REFER TO TY DRAWINGS FOR DETAILS ON SECURITY OUTLET. COORDINATE WITH ELECTRICAL CONTRACTORS TO PROVIDE POWER TO THE SECURITY OUTLET/ENCLOSURE.

KEY PLAN

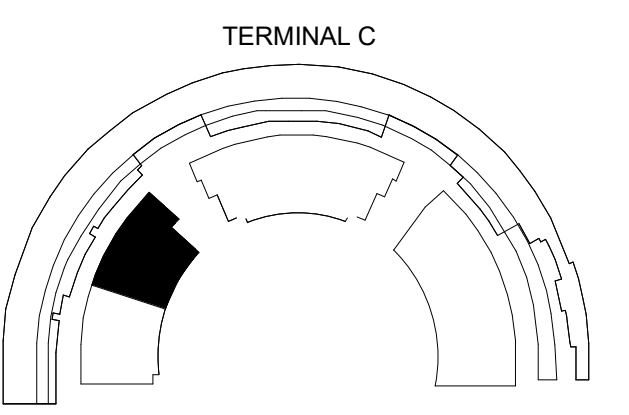

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM FLOOR PLAN - GARAGE A (PHASE 3) LEVEL E AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN115B-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

1. REFER TO TNO SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
2. REFER TO TN5 SERIES DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
4. CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.


SHEET NOTE

- TNA02 REFER TO TN131C-900A FOR PATHWAY CONTINUATION TO TERMINAL C MCRN.
- TNA08 BACKBONE PATHWAY FROM TERMINAL ROUTED UP TO LEVEL C. REFER TO TN133A-900A FOR PATHWAY CONTINUATION TO LEVEL C OF GARAGE A.
- TNA09 MOUNT CONDUIT TO UNDERSIDE OF ROADWAY

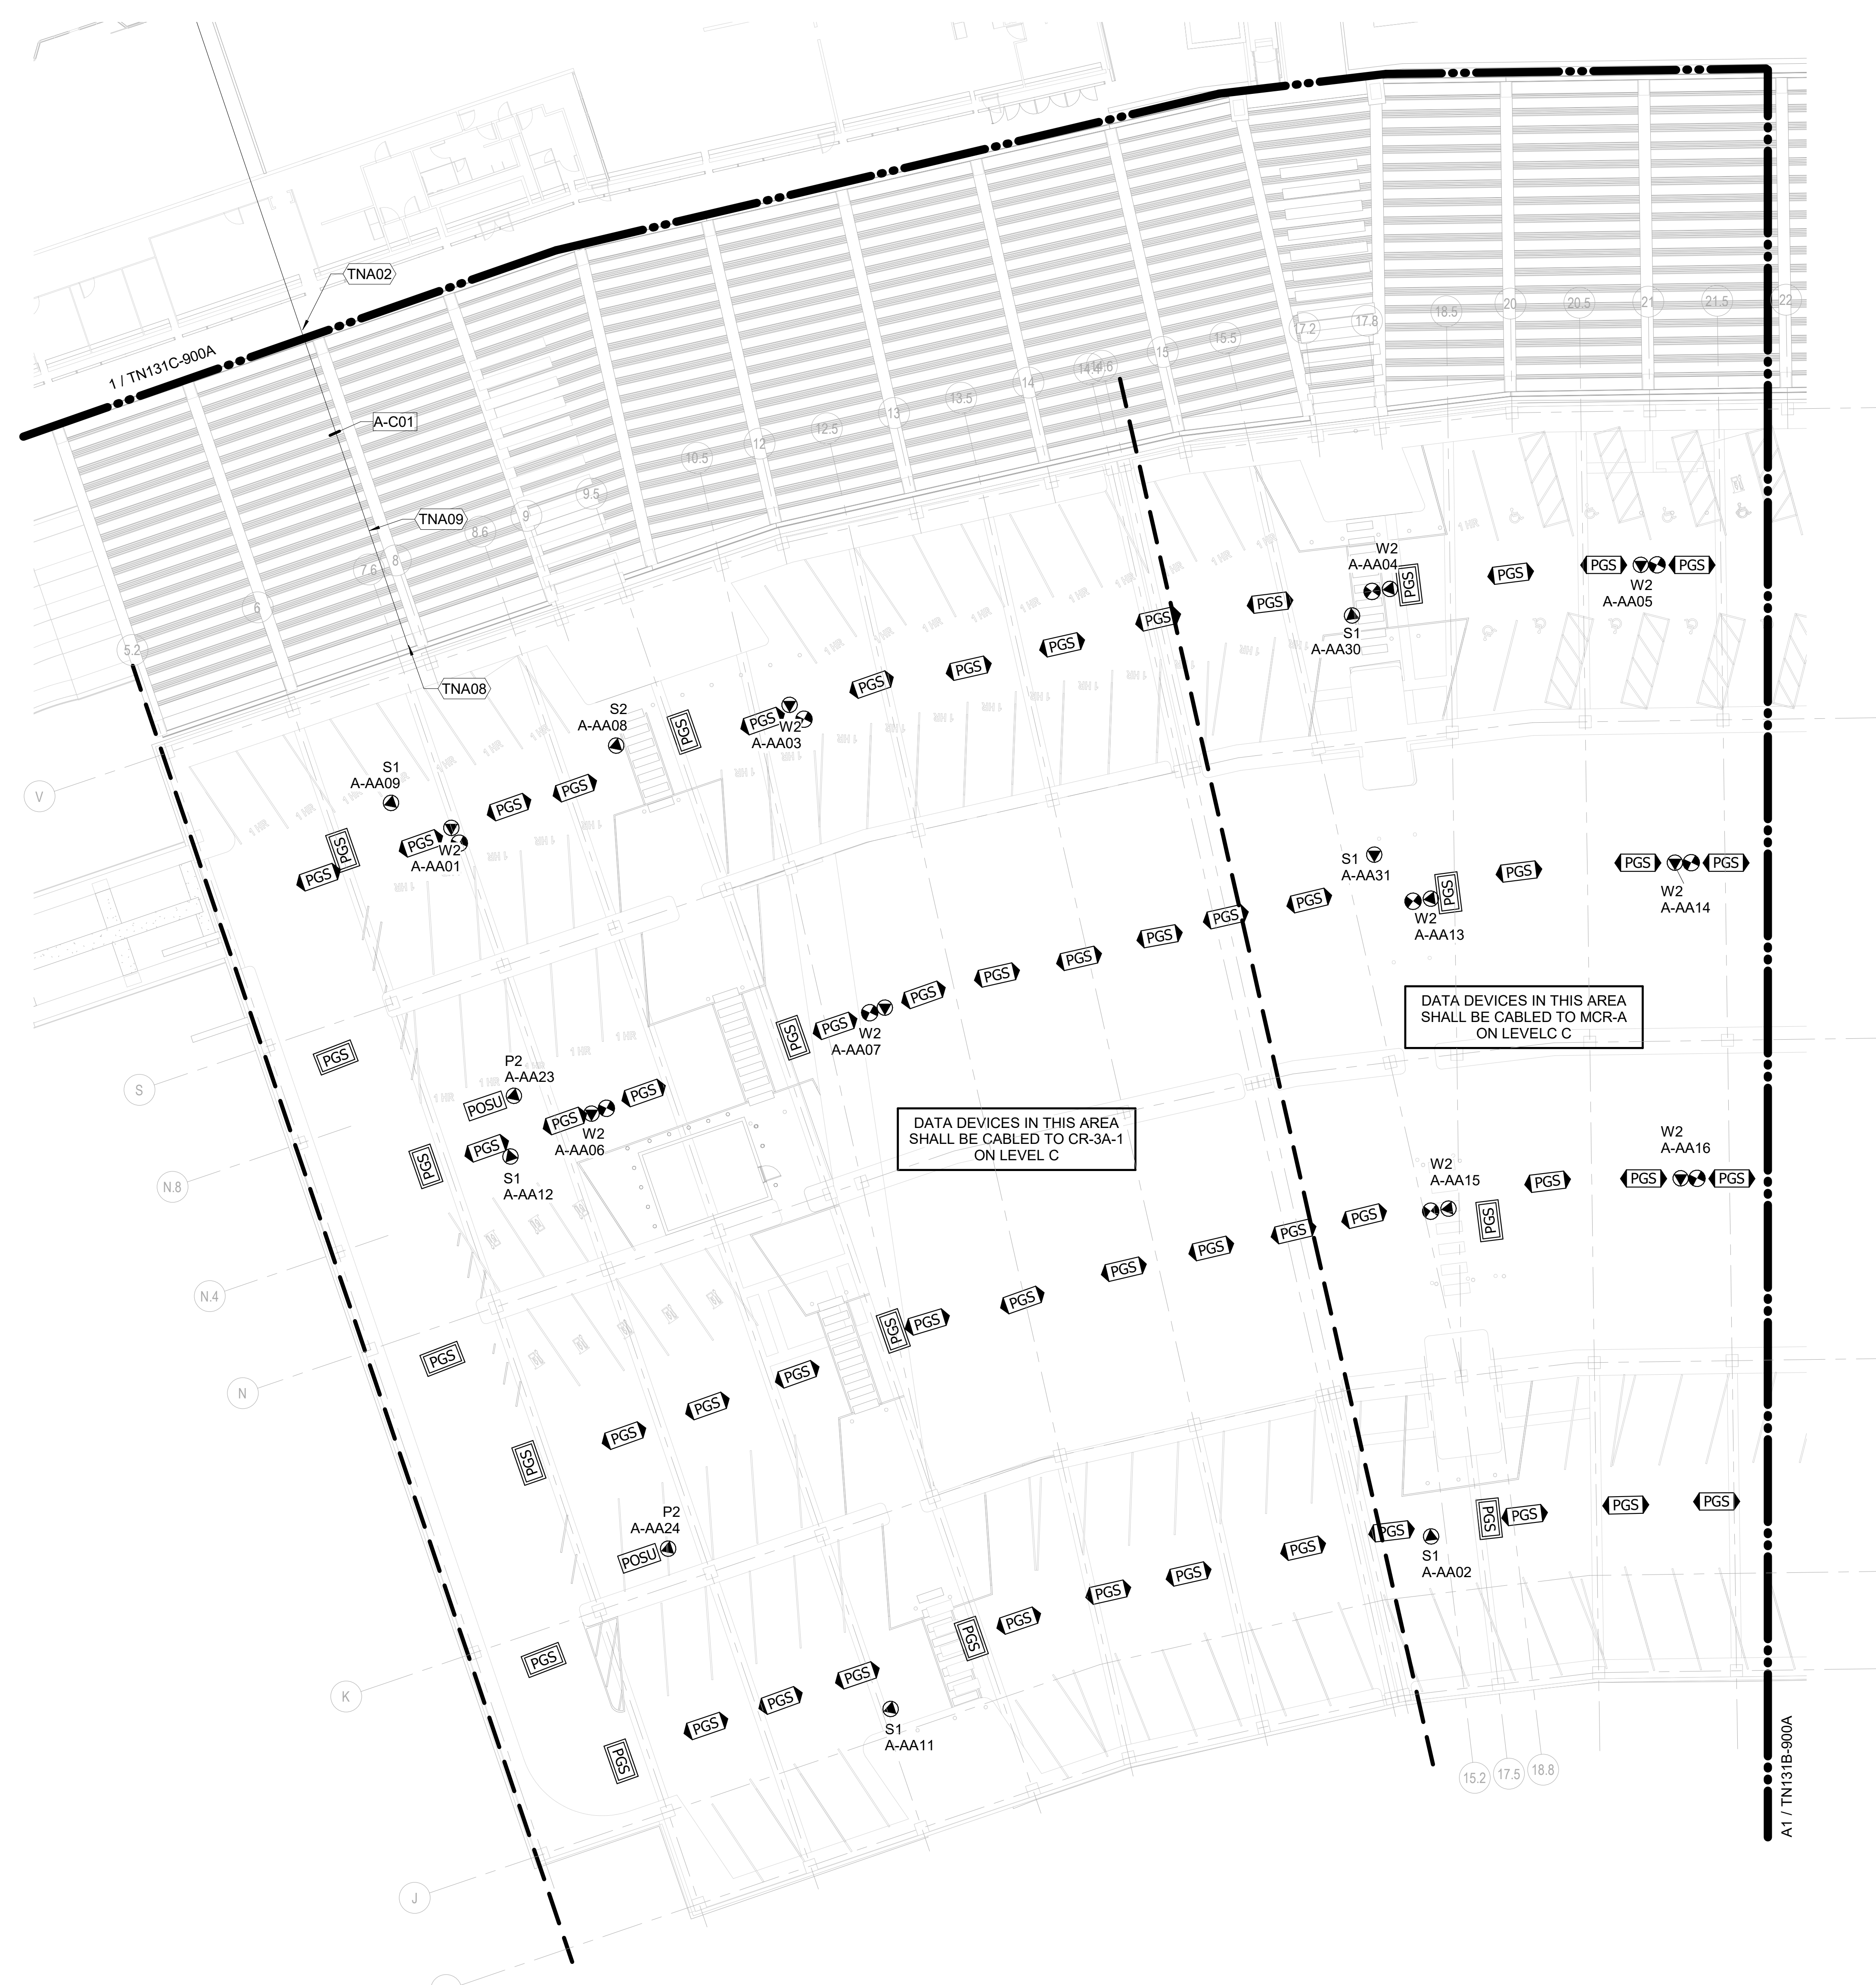


A1 TELECOM CEILING PLAN - GARAGE A LEVEL A AREA A
1/16" = 1'-0"

KEY PLAN

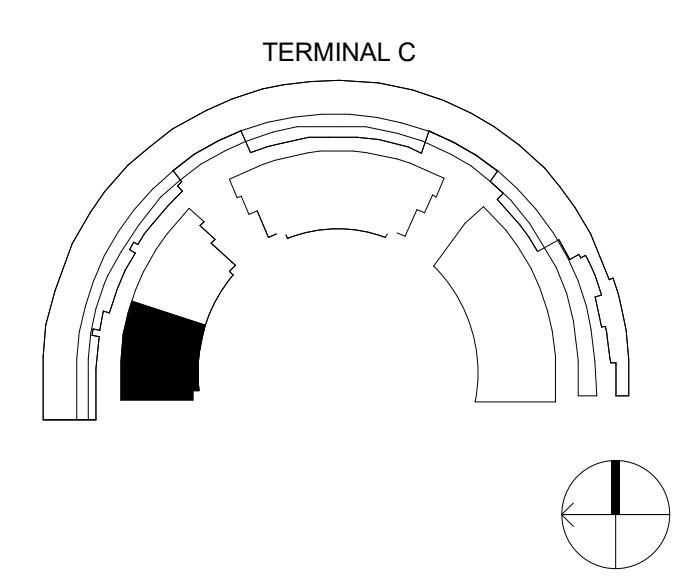

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

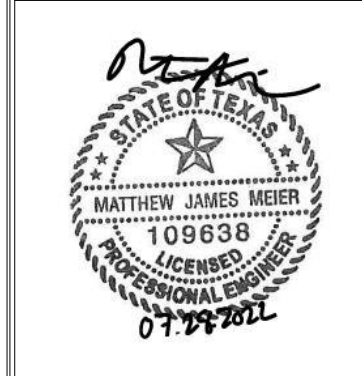

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL A AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN131A-900A



SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

- REFER TO TNO SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
- REFER TO TN5 SERIES DRAWINGS FOR TELECOM DETAILS
- REFER TO TN6 SERIES DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
- CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.

SHEET NOTE


KEY PLAN

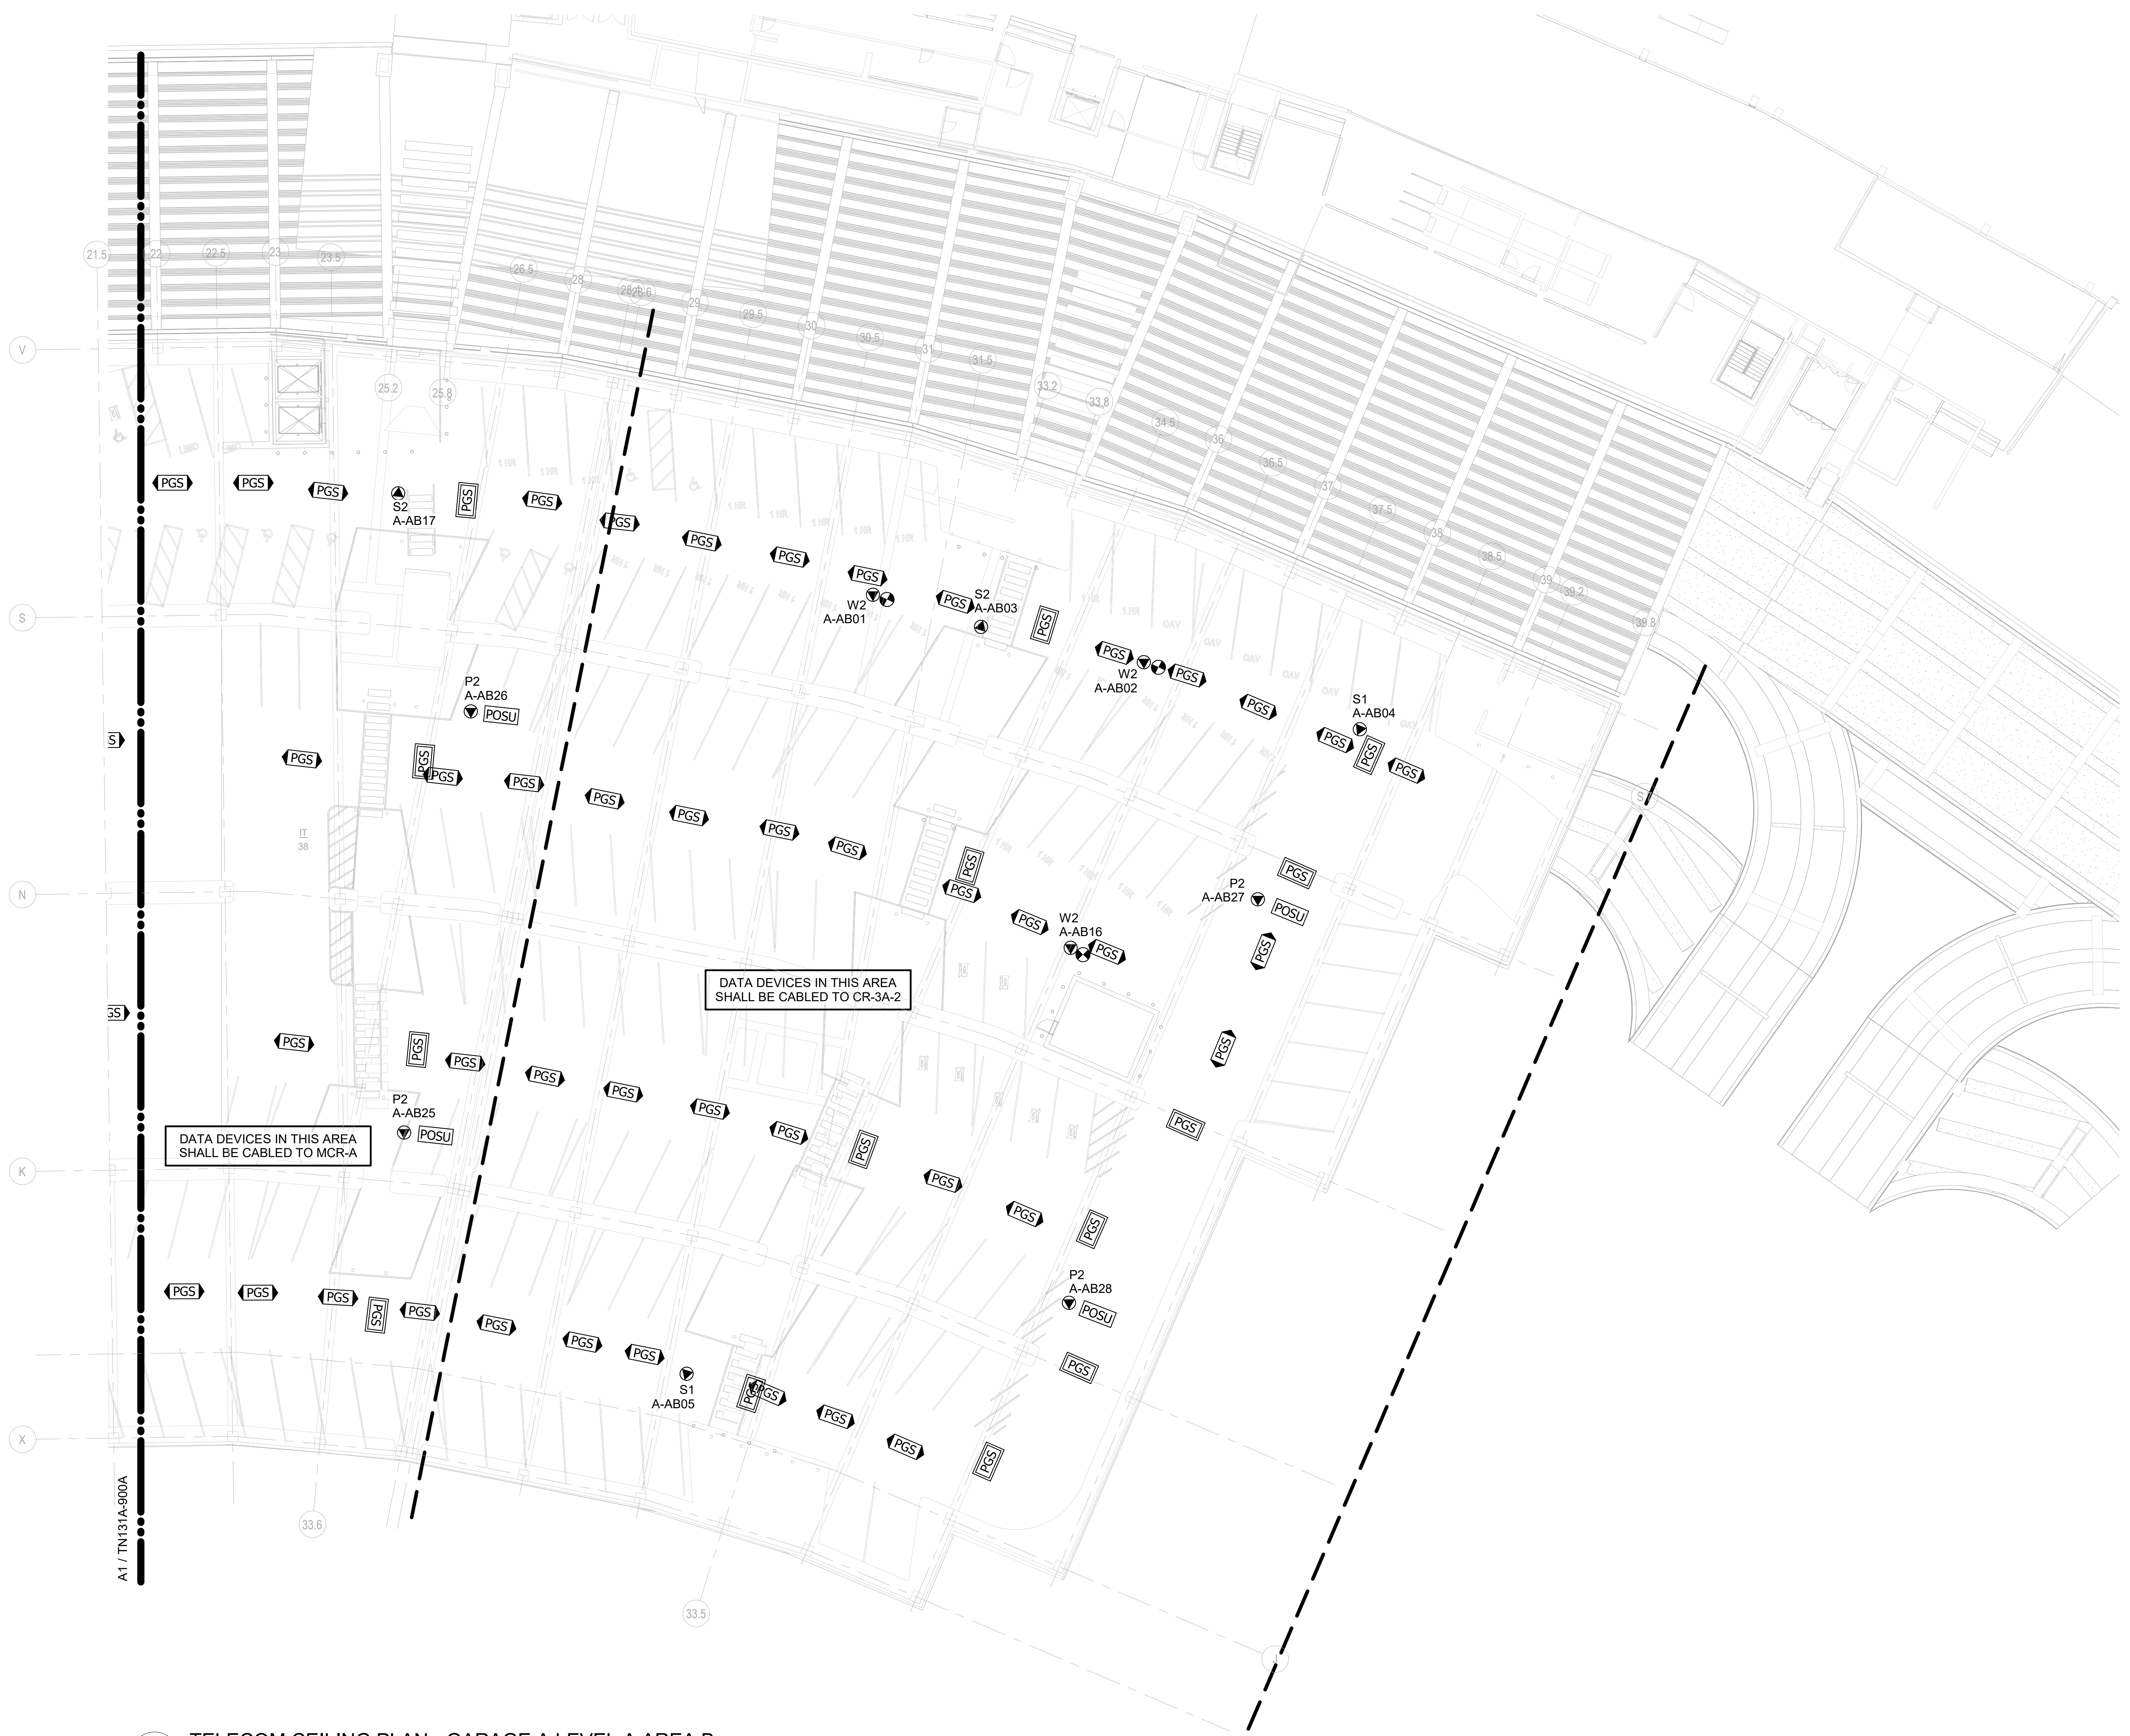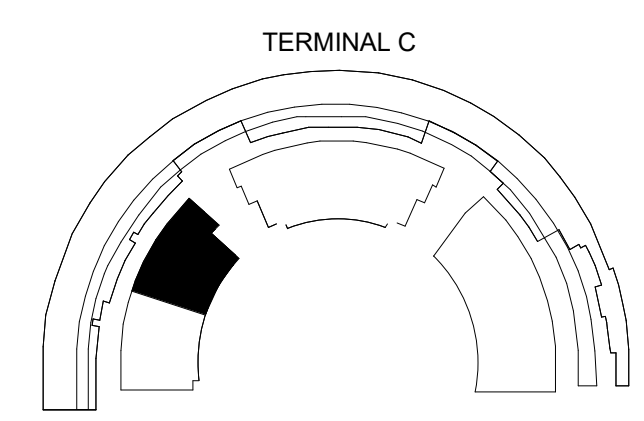

A1 TELECOM CEILING PLAN - GARAGE A LEVEL A AREA B
1/16" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

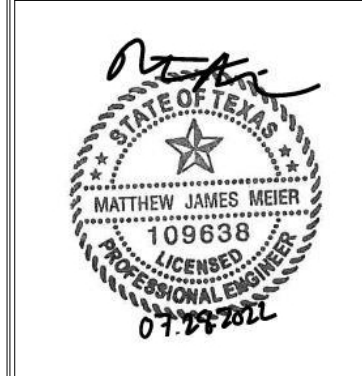

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL A AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN131B-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GENERAL NOTE

- REFER TO TNO SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
- REFER TO TN5 SERIES DRAWINGS FOR TELECOM DETAILS
- REFER TO TN6 SERIES DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
- CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.


SHEET NOTE

- TNA07 REFER TO TN131A-900A FOR PATHWAY CONTINUATION TO GARAGE A COMMUNICATION ROOM.
- TNA09 MOUNT CONDUIT TO UNDERSIDE OF ROADWAY
- TNA10 PATHWAY SPANS BETWEEN ROADWAY AND TERMINAL FACILITY. COORDINATE ENTRY POINT INTO THE TERMINAL WITH TERMINAL CONTRACTOR.
- TNA11 COORDINATE PATHWAY IN TERMINAL C TO MCR-N WITH TERMINAL CONTRACTOR.
- TNA12 TERMINATE CONDUIT IN MCR-N AND ROUTE FIBER TO EXISTING CABINETS. PROVIDE ALL NECESSARY HARDWARE AND MATERIAL TO FULLY TERMINATE THE FIBER CABLE INCLUDING ENCLOSURES, TUBE DISTRIBUTION CABINETS, AND SPLICE TERMINATION CASSETTES. COORDINATE EQUIPMENT MOUNTING LOCATIONS WITH DFW ITS PRIOR TO INSTALLATION.

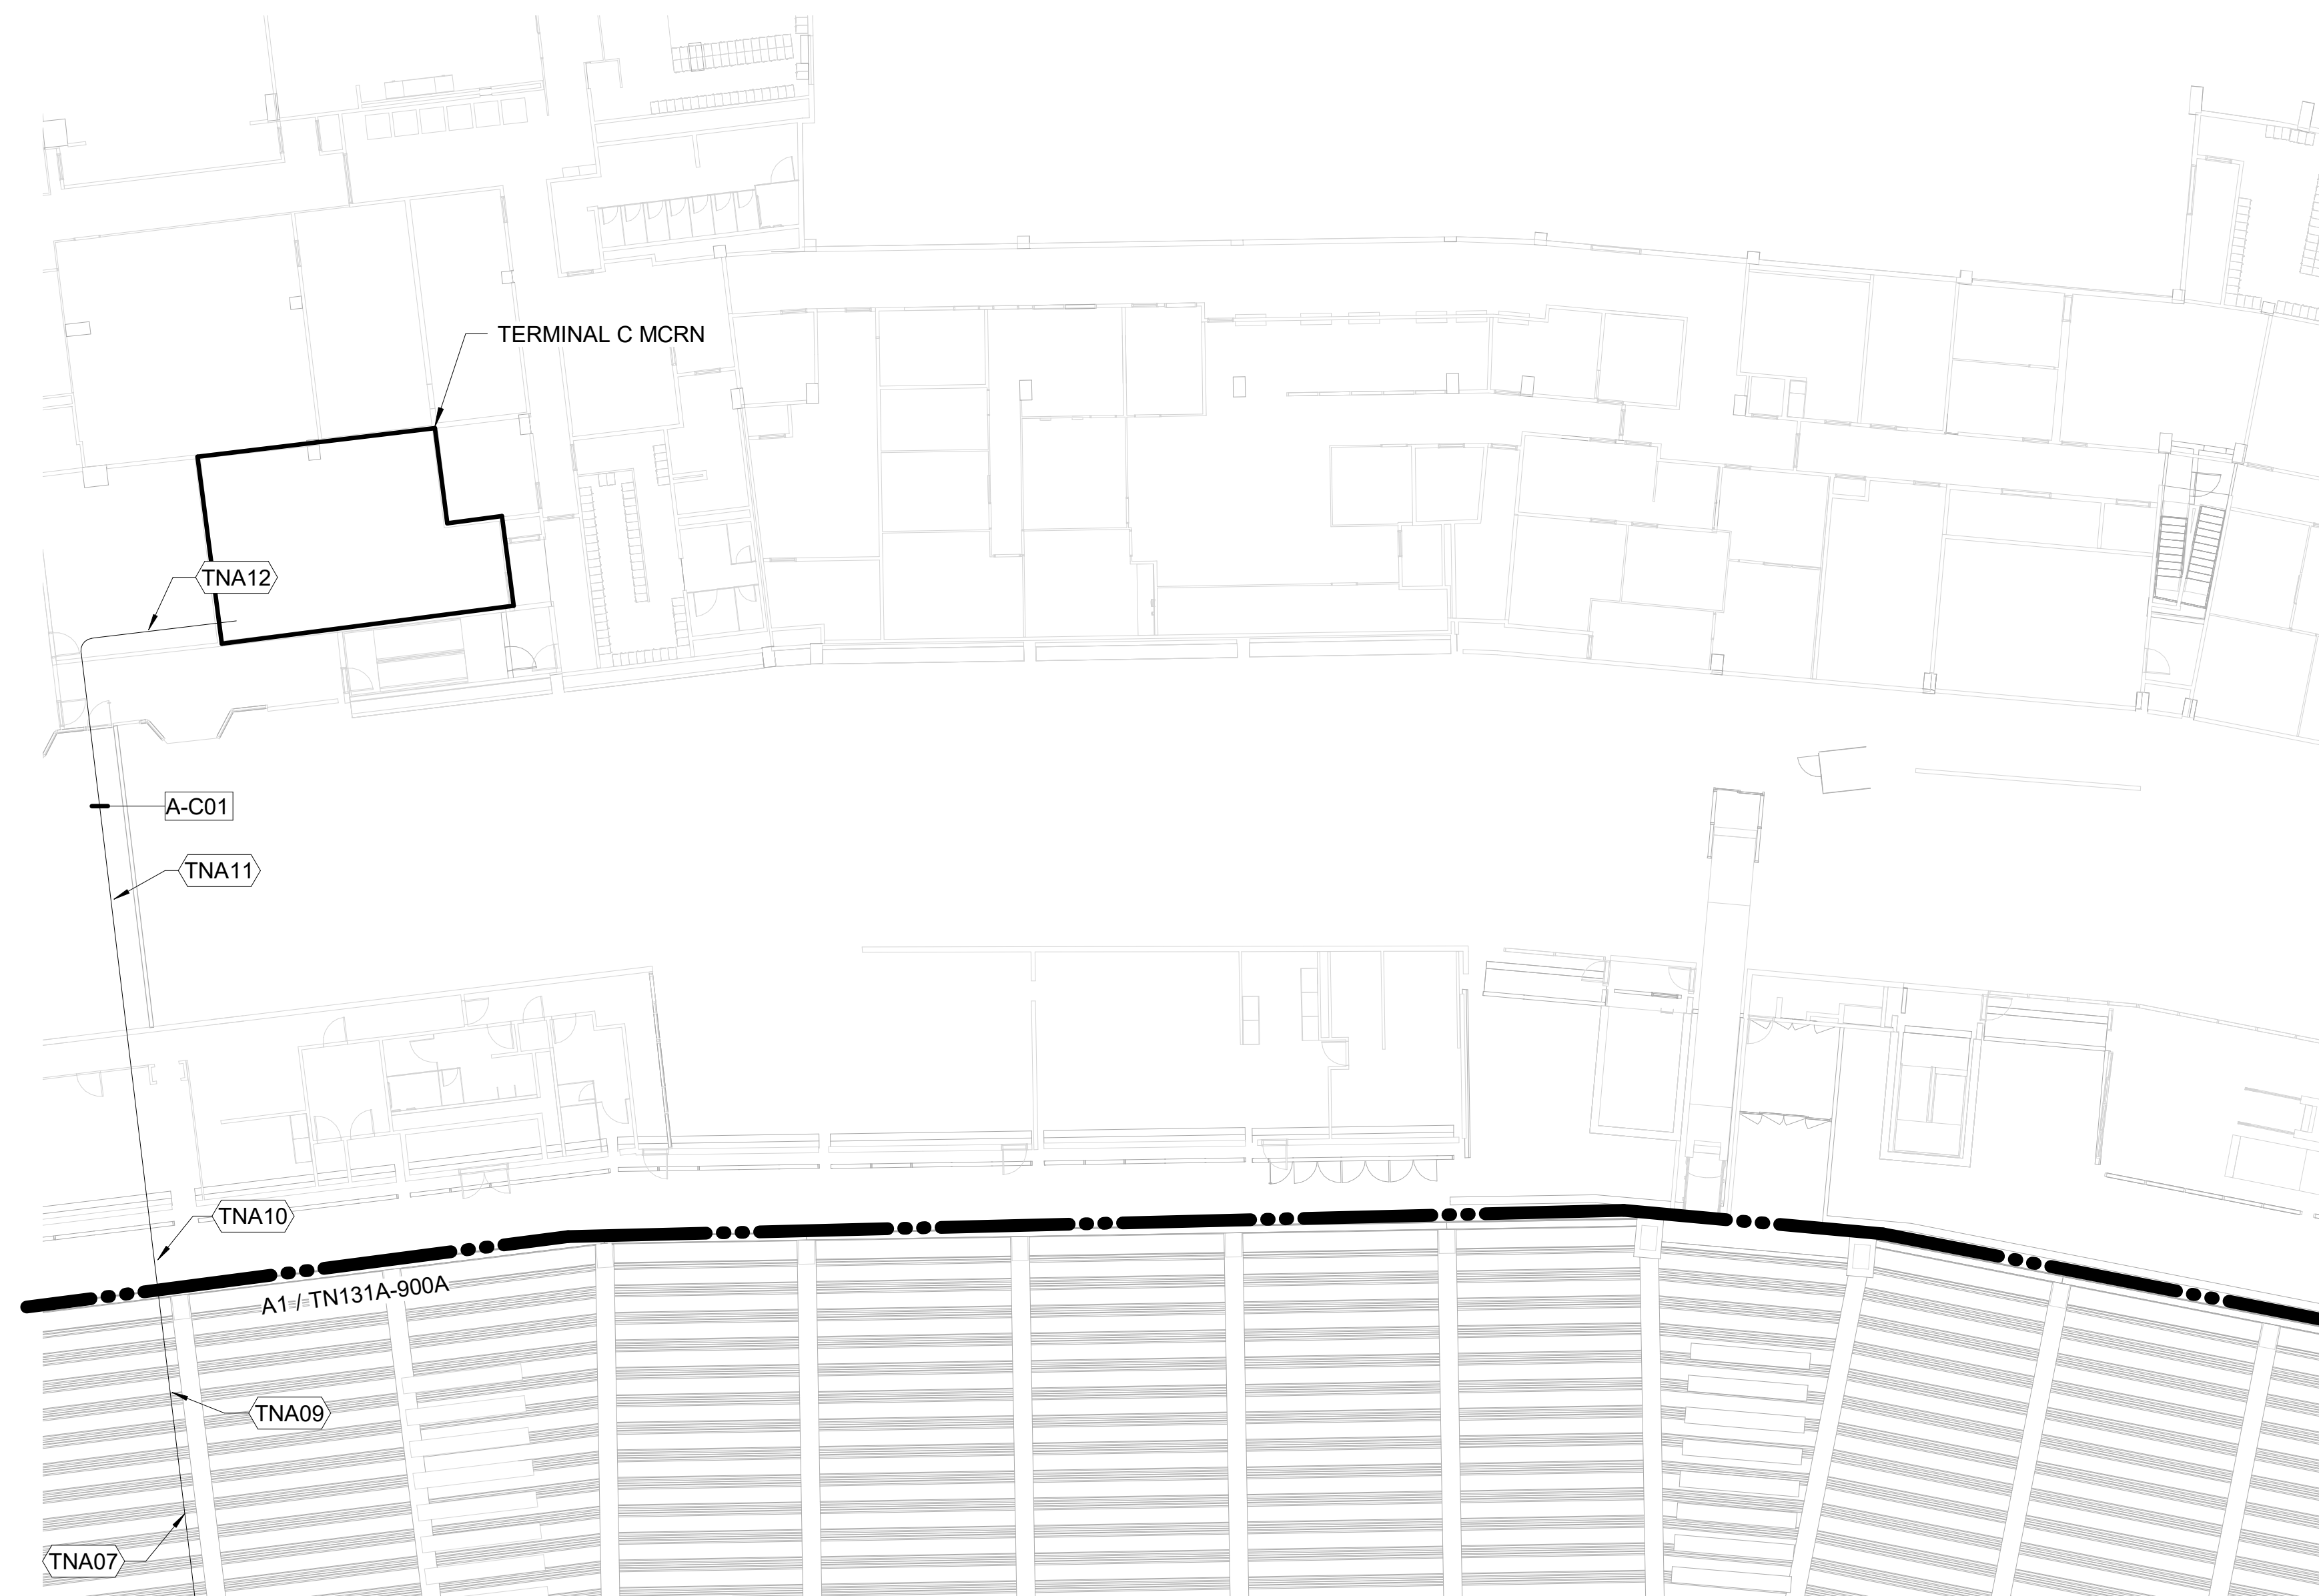

A1 TELECOM CEILING PLAN - TERMINAL C RAMP LEVEL AREA 302A
1/16" = 1'-0"

KEY PLAN

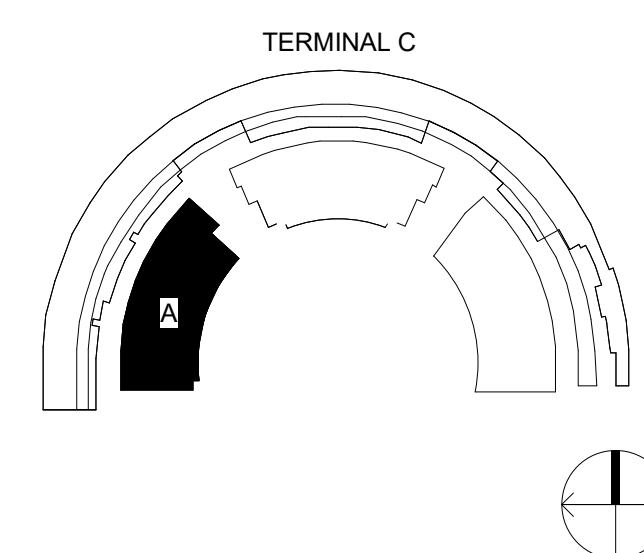

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - TERMINAL C RAMP LEVEL AREA 302

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN131C-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




A1 TELECOM CEILING PLAN - GARAGE A LEVEL B AREA A
1/16" = 1'-0"

GENERAL NOTE


1. REFER TO TN0 SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS.
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
4. CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.

SHEET NOTE

KEY PLAN

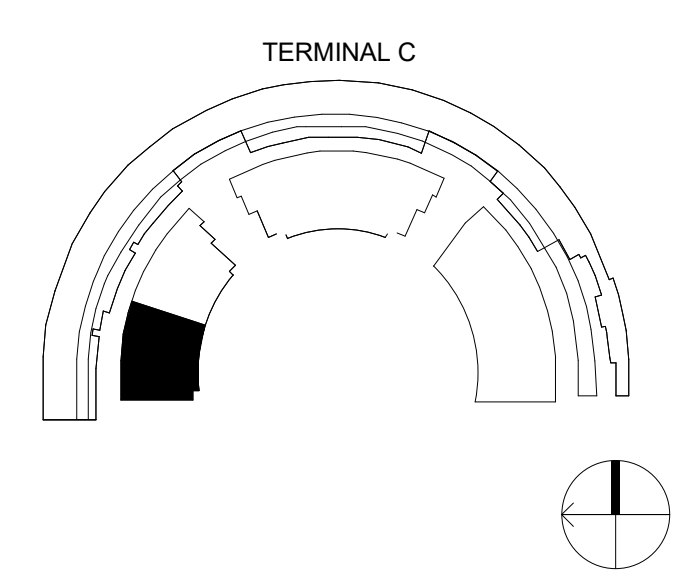

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

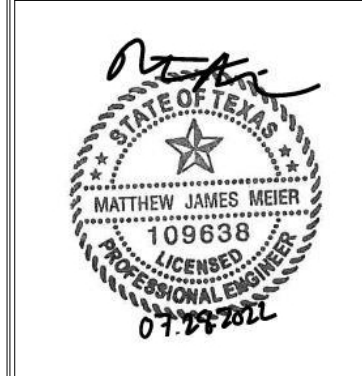

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL B AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN132A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




A1 TELECOM CEILING PLAN - GARAGE A LEVEL B AREA B
1/16" = 1'-0"

GENERAL NOTE


- REFER TO TN0 SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
- REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
- REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
- CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.

SHEET NOTE

KEY PLAN

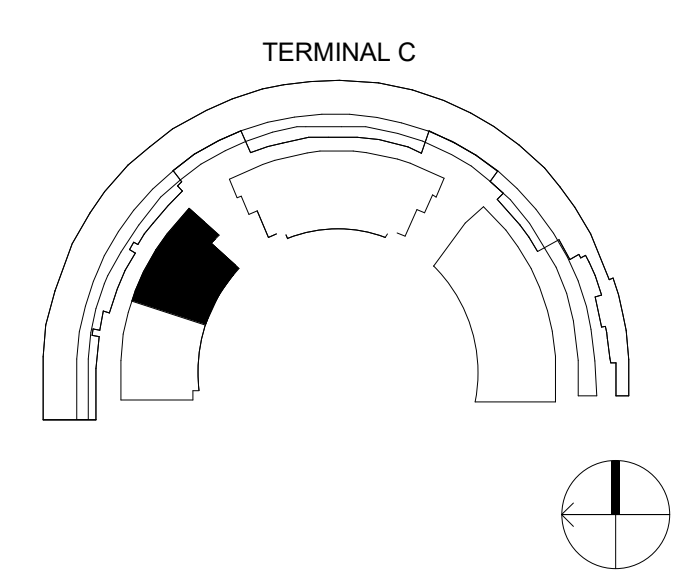

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

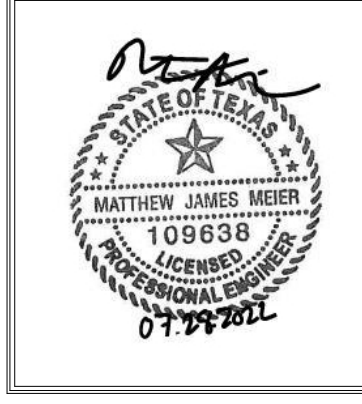

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL B AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN132B-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.




GENERAL NOTE

- REFER TO TN0 SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
- REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
- REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
- CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.

SHEET NOTE

- TN004 DATA FOR LEVEL E POLE MOUNT CAMERA.
- TNA02 REFER TO TN131C-900A FOR PATHWAY CONTINUATION TO TERMINAL C MCRN.
- TNA07 REFER TO TN131A-900A FOR PATHWAY CONTINUATION TO GARAGE A COMMUNICATION ROOM.
- TNA09 MOUNT CONDUIT TO UNDERSIDE OF ROADWAY


KEY PLAN

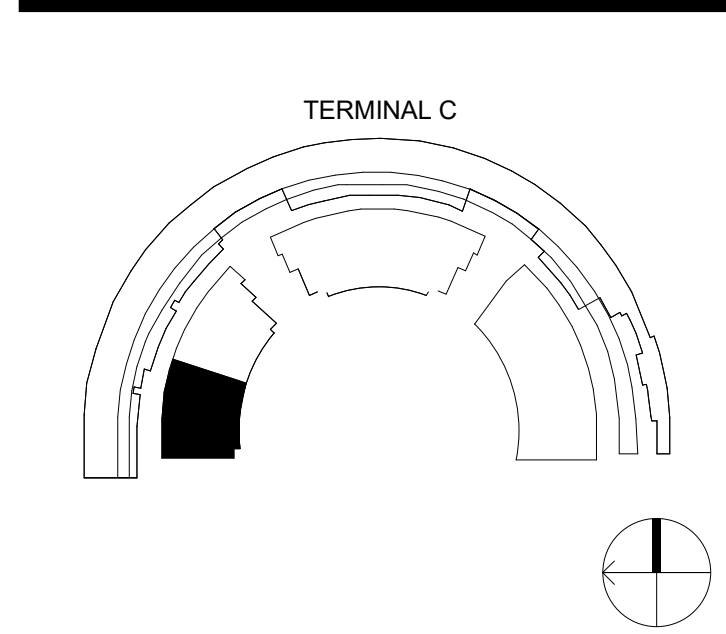

A1 TELECOM CEILING PLAN - GARAGE A LEVEL C AREA A
1/16" = 1'-0"



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

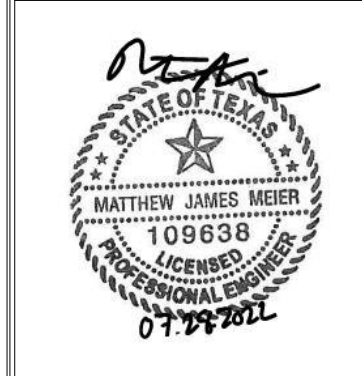

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL C AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN133A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM CEILING PLAN - GARAGE A LEVEL C AREA B
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TNO SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS.
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
4. CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.


SHEET NOTE

- TNA03 BACKBONE PATHWAY B-C01 CONTINUES ON TO GARAGE B. CONDUIT TO BE MOUNTED TO THE UNDERSIDE OF DEPARTURES ROADWAY AND RAMP. PROVIDE PULL BOXES WHERE NECESSARY. REFER TO GARAGE B DRAWINGS FOR PATHWAY CONTINUATION.
- TNA13 CONSTRUCT BACKBONE PATHWAY FROM GARAGE A TO GARAGE B IN PHASE 3. REFER TO TN610 AND TN611 FOR FURTHER INFORMATION.

KEY PLAN

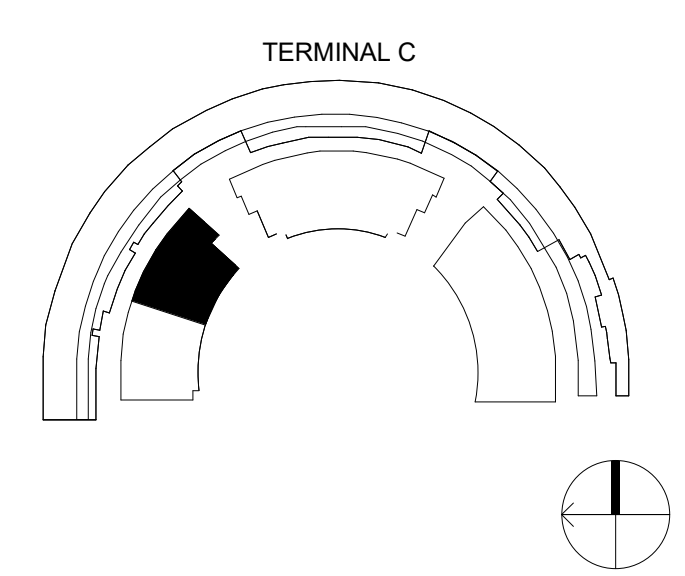

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

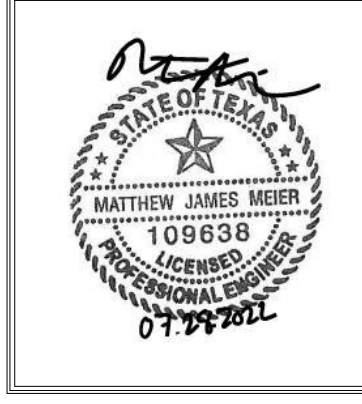

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL C AREA B

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN133B-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM CEILING PLAN - GARAGE A LEVEL D AREA A
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TN0 SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
4. CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.


SHEET NOTE

TN004 DATA FOR LEVEL E POLE MOUNT CAMERA.

KEY PLAN

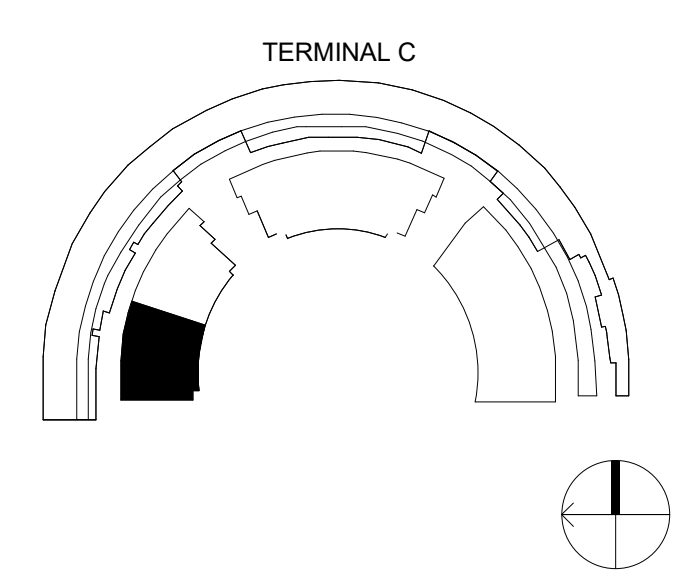

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

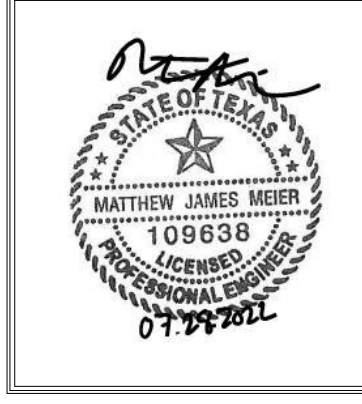

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL D AREA A

PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022

SHEET NUMBER
TN134A-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.



A1 TELECOM CEILING PLAN - GARAGE A LEVEL D AREA B
1/16" = 1'-0"


GENERAL NOTE

1. REFER TO TN0 SERIES DRAWINGS FOR SYSTEM SYMBOL LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
2. REFER TO TN5 SERIES OF DRAWINGS FOR TELECOM DETAILS
3. REFER TO TN6 SERIES OF DRAWINGS FOR TELECOM CONNECTIVITY DIAGRAMS.
4. CONDUIT ROUTING IS DIAGRAMMATIC ONLY AND HAS BEEN PROVIDED TO CONVEY THE SYSTEM DESIGN. CONTRACTOR SHALL FIELD VERIFY CONDUIT ROUTES AND COORDINATE ANY CONFLICTS WITH THE ENGINEER PRIOR TO INSTALLATION.


SHEET NOTE

TN004 DATA FOR LEVEL E POLE MOUNT CAMERA.

KEY PLAN

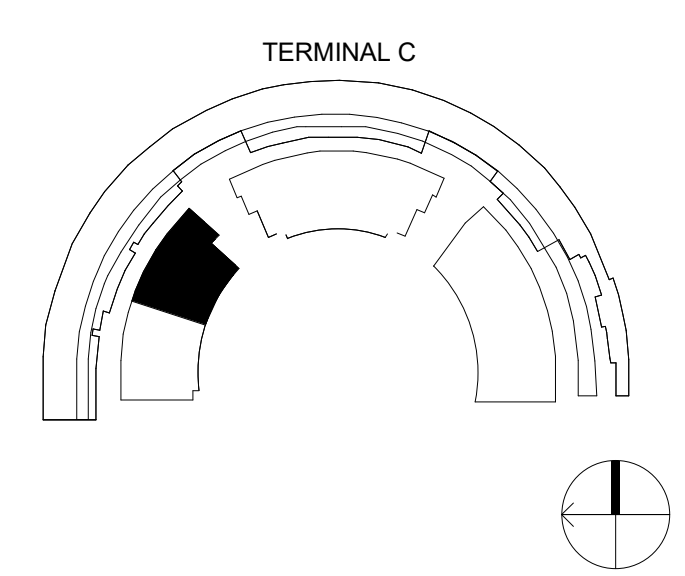

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

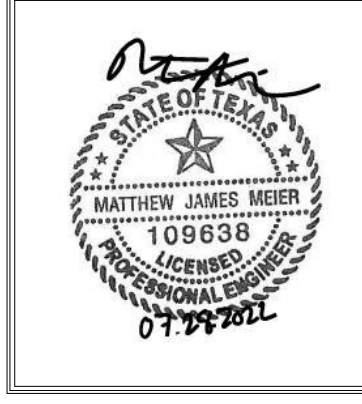

DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	


TERMINAL C GARAGE & ROADWAYS
TELECOM CEILING PLAN - GARAGE A (PHASE 3) LEVEL D AREA B

PROJECT NUMBER: TFD-007


PERMIT NUMBER: 822-0022

SHEET NUMBER
TN134B-900A


SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

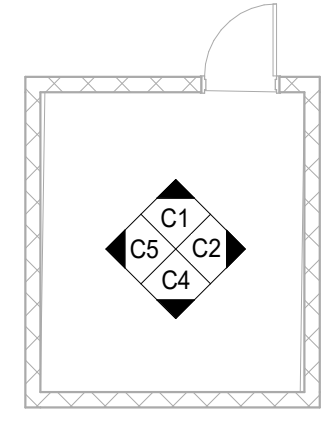


D1 WALL ELEVATION KEY - MCR-A
1/8" = 1'-0"

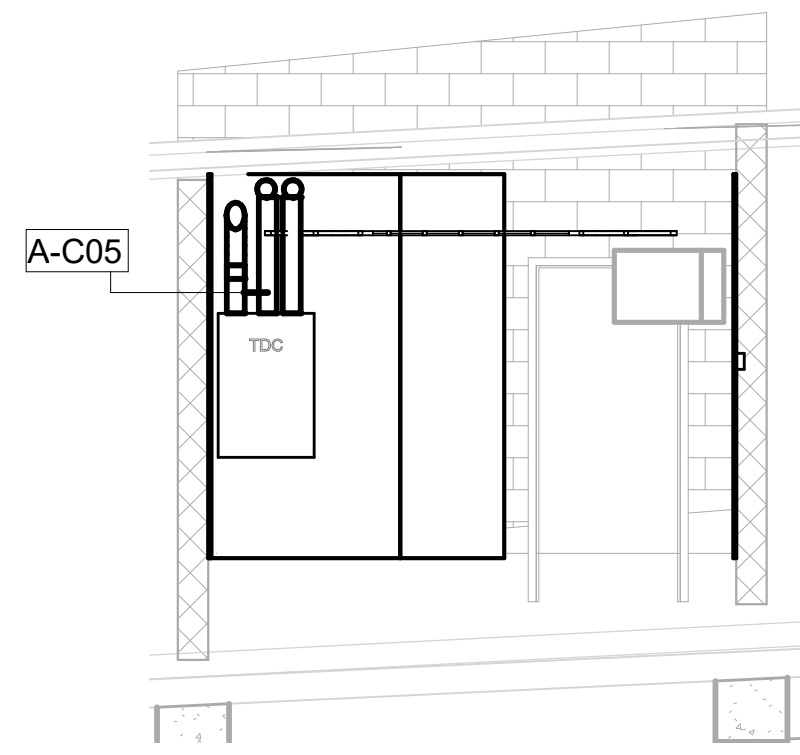


C1 WALL ELEVATION NORTH - MCR-A
1/4" = 1'-0"

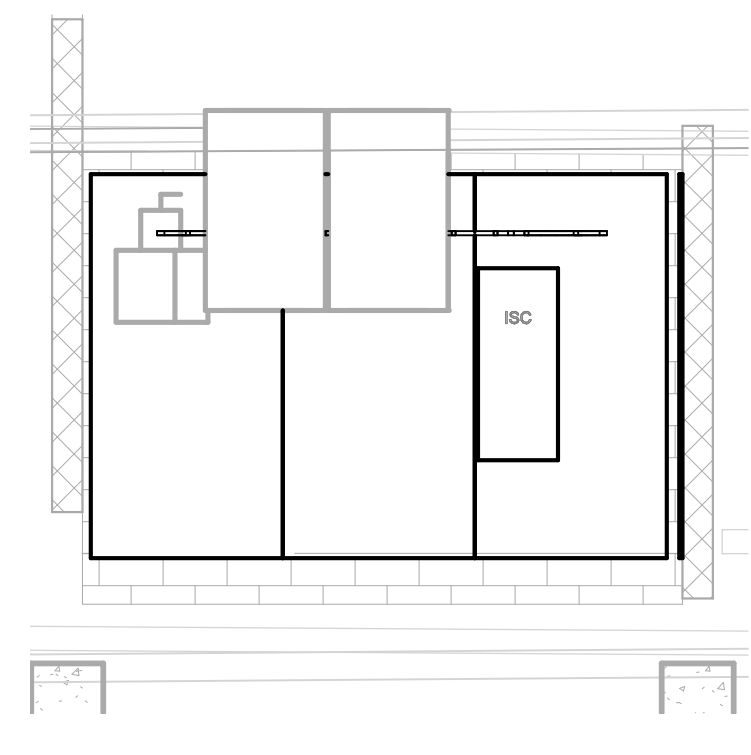

C2 WALL ELEVATION EAST - MCR-A
1/4" = 1'-0"

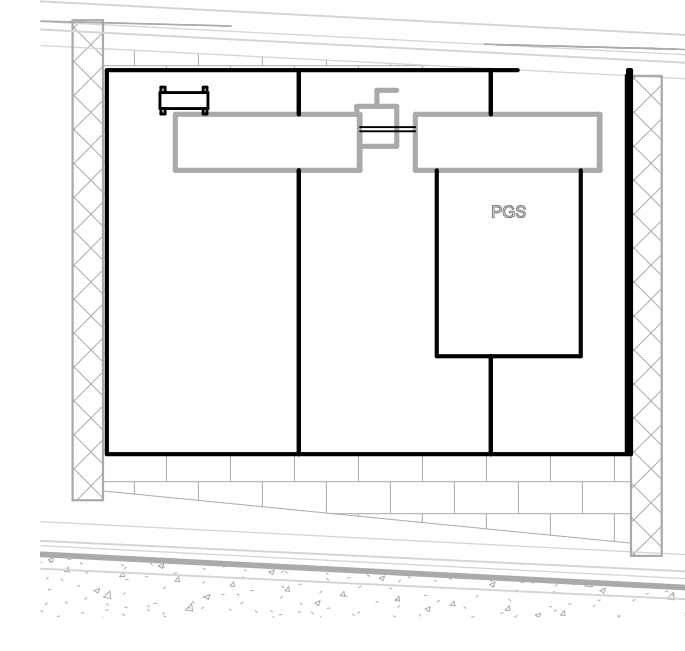

C4 WALL ELEVATION SOUTH - MCR-A
1/4" = 1'-0"

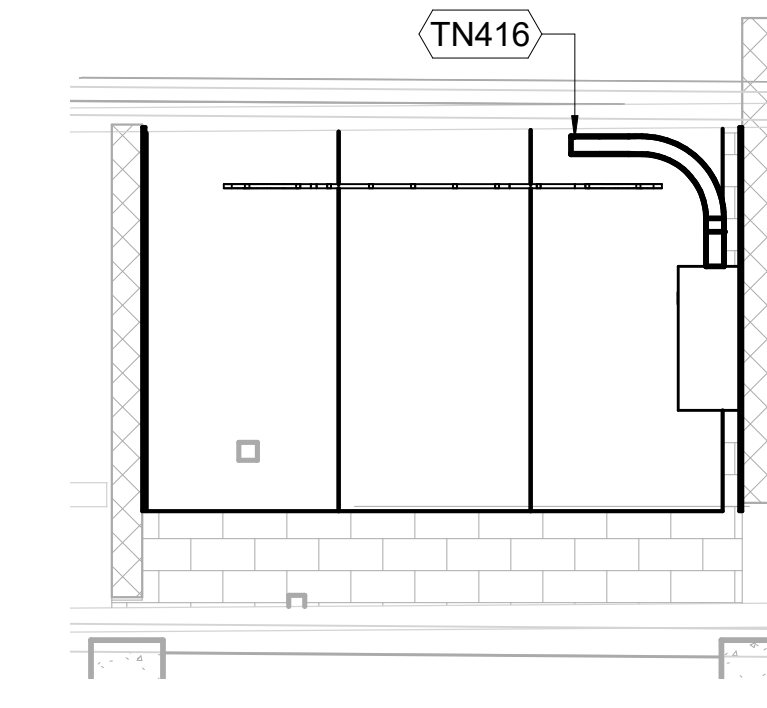

C5 WALL ELEVATION WEST - MCR-A
1/4" = 1'-0"



GENERAL NOTE

1. ELECTRICAL AND MECHANICAL EQUIPMENT SHOWN FOR REFERENCE ONLY.
2. ELECTRICAL DISTRIBUTION PANELS AND UPS MAY BE LOCATED WITHIN THE TELECOM SPACE ASSUMING THEY ARE DEDICATED TO THE SPACE AND DO NOT SERVICE EQUIPMENT OUTSIDE OF THE SPACE.
3. ELECTRICAL DISTRIBUTION SUPPORTING LIGHTING SHALL BE SEPARATE FROM THOSE SUPPORTING TELECOM EQUIPMENT.


SHEET NOTE

- TN401 FIRE-RATED PLYWOOD BACKBOARD, MASK OVER FIRE RATING PRINT BEFORE PAINTING PLYWOOD PANEL.
- TN402 18 INCH LADDER TRAY
- TN403 TELECOM GROUNDING BUSBAR
- TN404 WALL PHONE (BY OWNER)
- TN405 INTELLIGENT SYSTEM CONTROLLER (ISC)
- TN407 TUBE DISTRIBUTION CABINET (TDC)
- TN408 PGS WALL MOUNTED EQUIPMENT
- TN409 ELECTRICAL PANEL
- TN410 MECHANICAL HVAC UNIT
- TN413 COORDINATE FINAL LOCATION OF P-TYPE OUTLET FOR HVAC OR ELECTRICAL SYSTEMS MONITORING WITH ELECTRICAL AND MECHANICAL CONTRACTOR.
- TN414 ACTIVE NETWORK EQUIPMENT SHOWN LIGHT TO BE PROVIDED BY OTHERS. COORDINATE WITH DFW ITS AND DPS FOR REQUIREMENTS.
- TN415 PROVIDE FIBER TO COPPER MEDIA CONVERTERS AND FIBER OPTIC CABLING TO FIELD DEVICES THAT ARE MORE THAN 290FT FROM RACK TERMINATION TO FIELD DEVICE.
- TN416 FULL LENGTH OF CONDUIT FROM RACK TO TDC OMITTED FOR CLARITY.


KEY PLAN

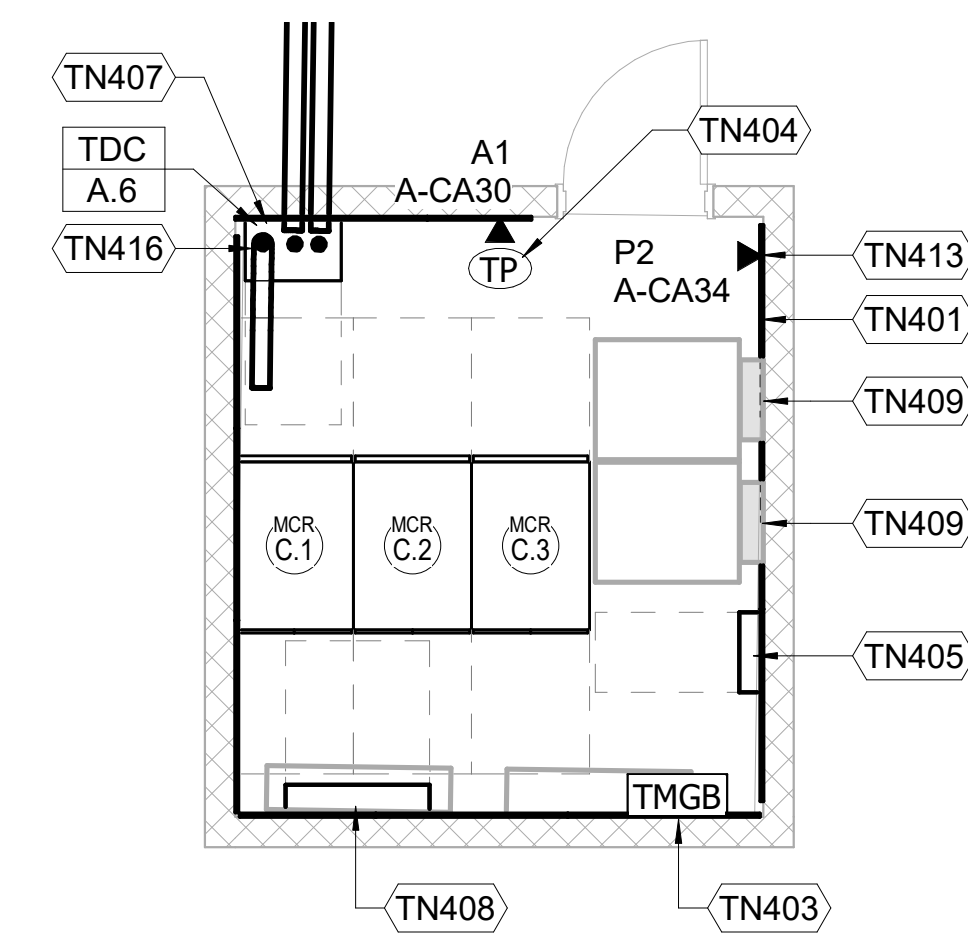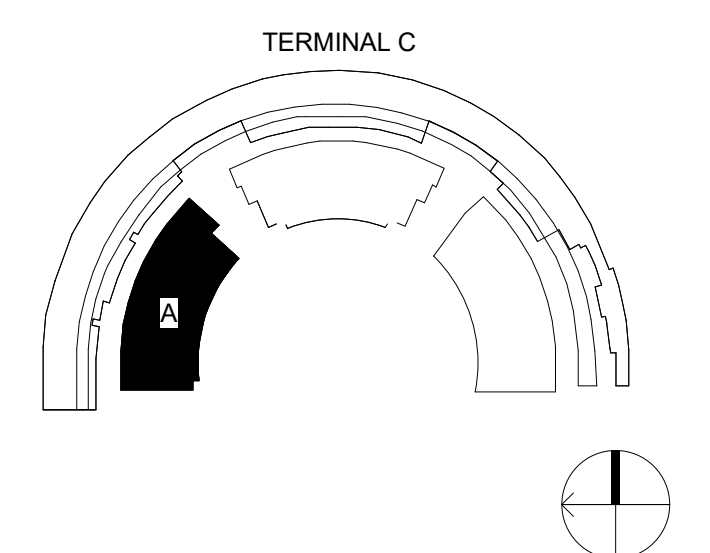

A1 ENLARGED PLAN - MCR-A
1/4" = 1'-0"

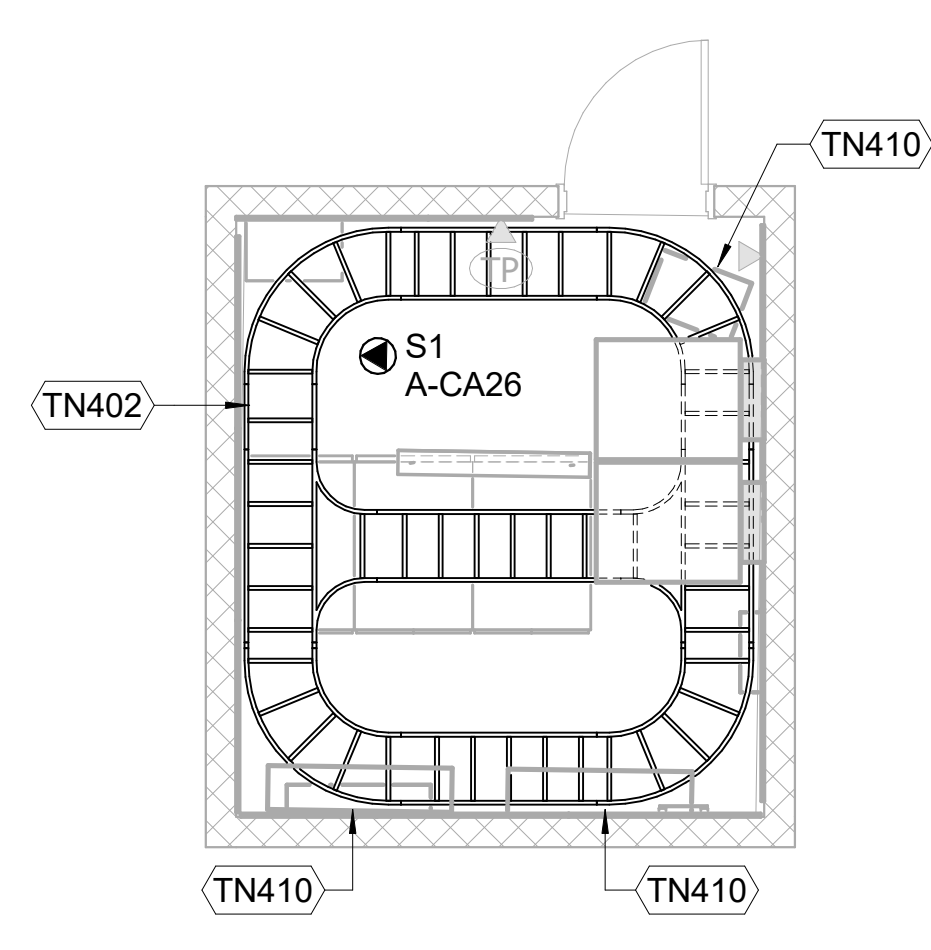

A2 ENLARGED OVERHEAD PLAN - MCR-A
1/4" = 1'-0"

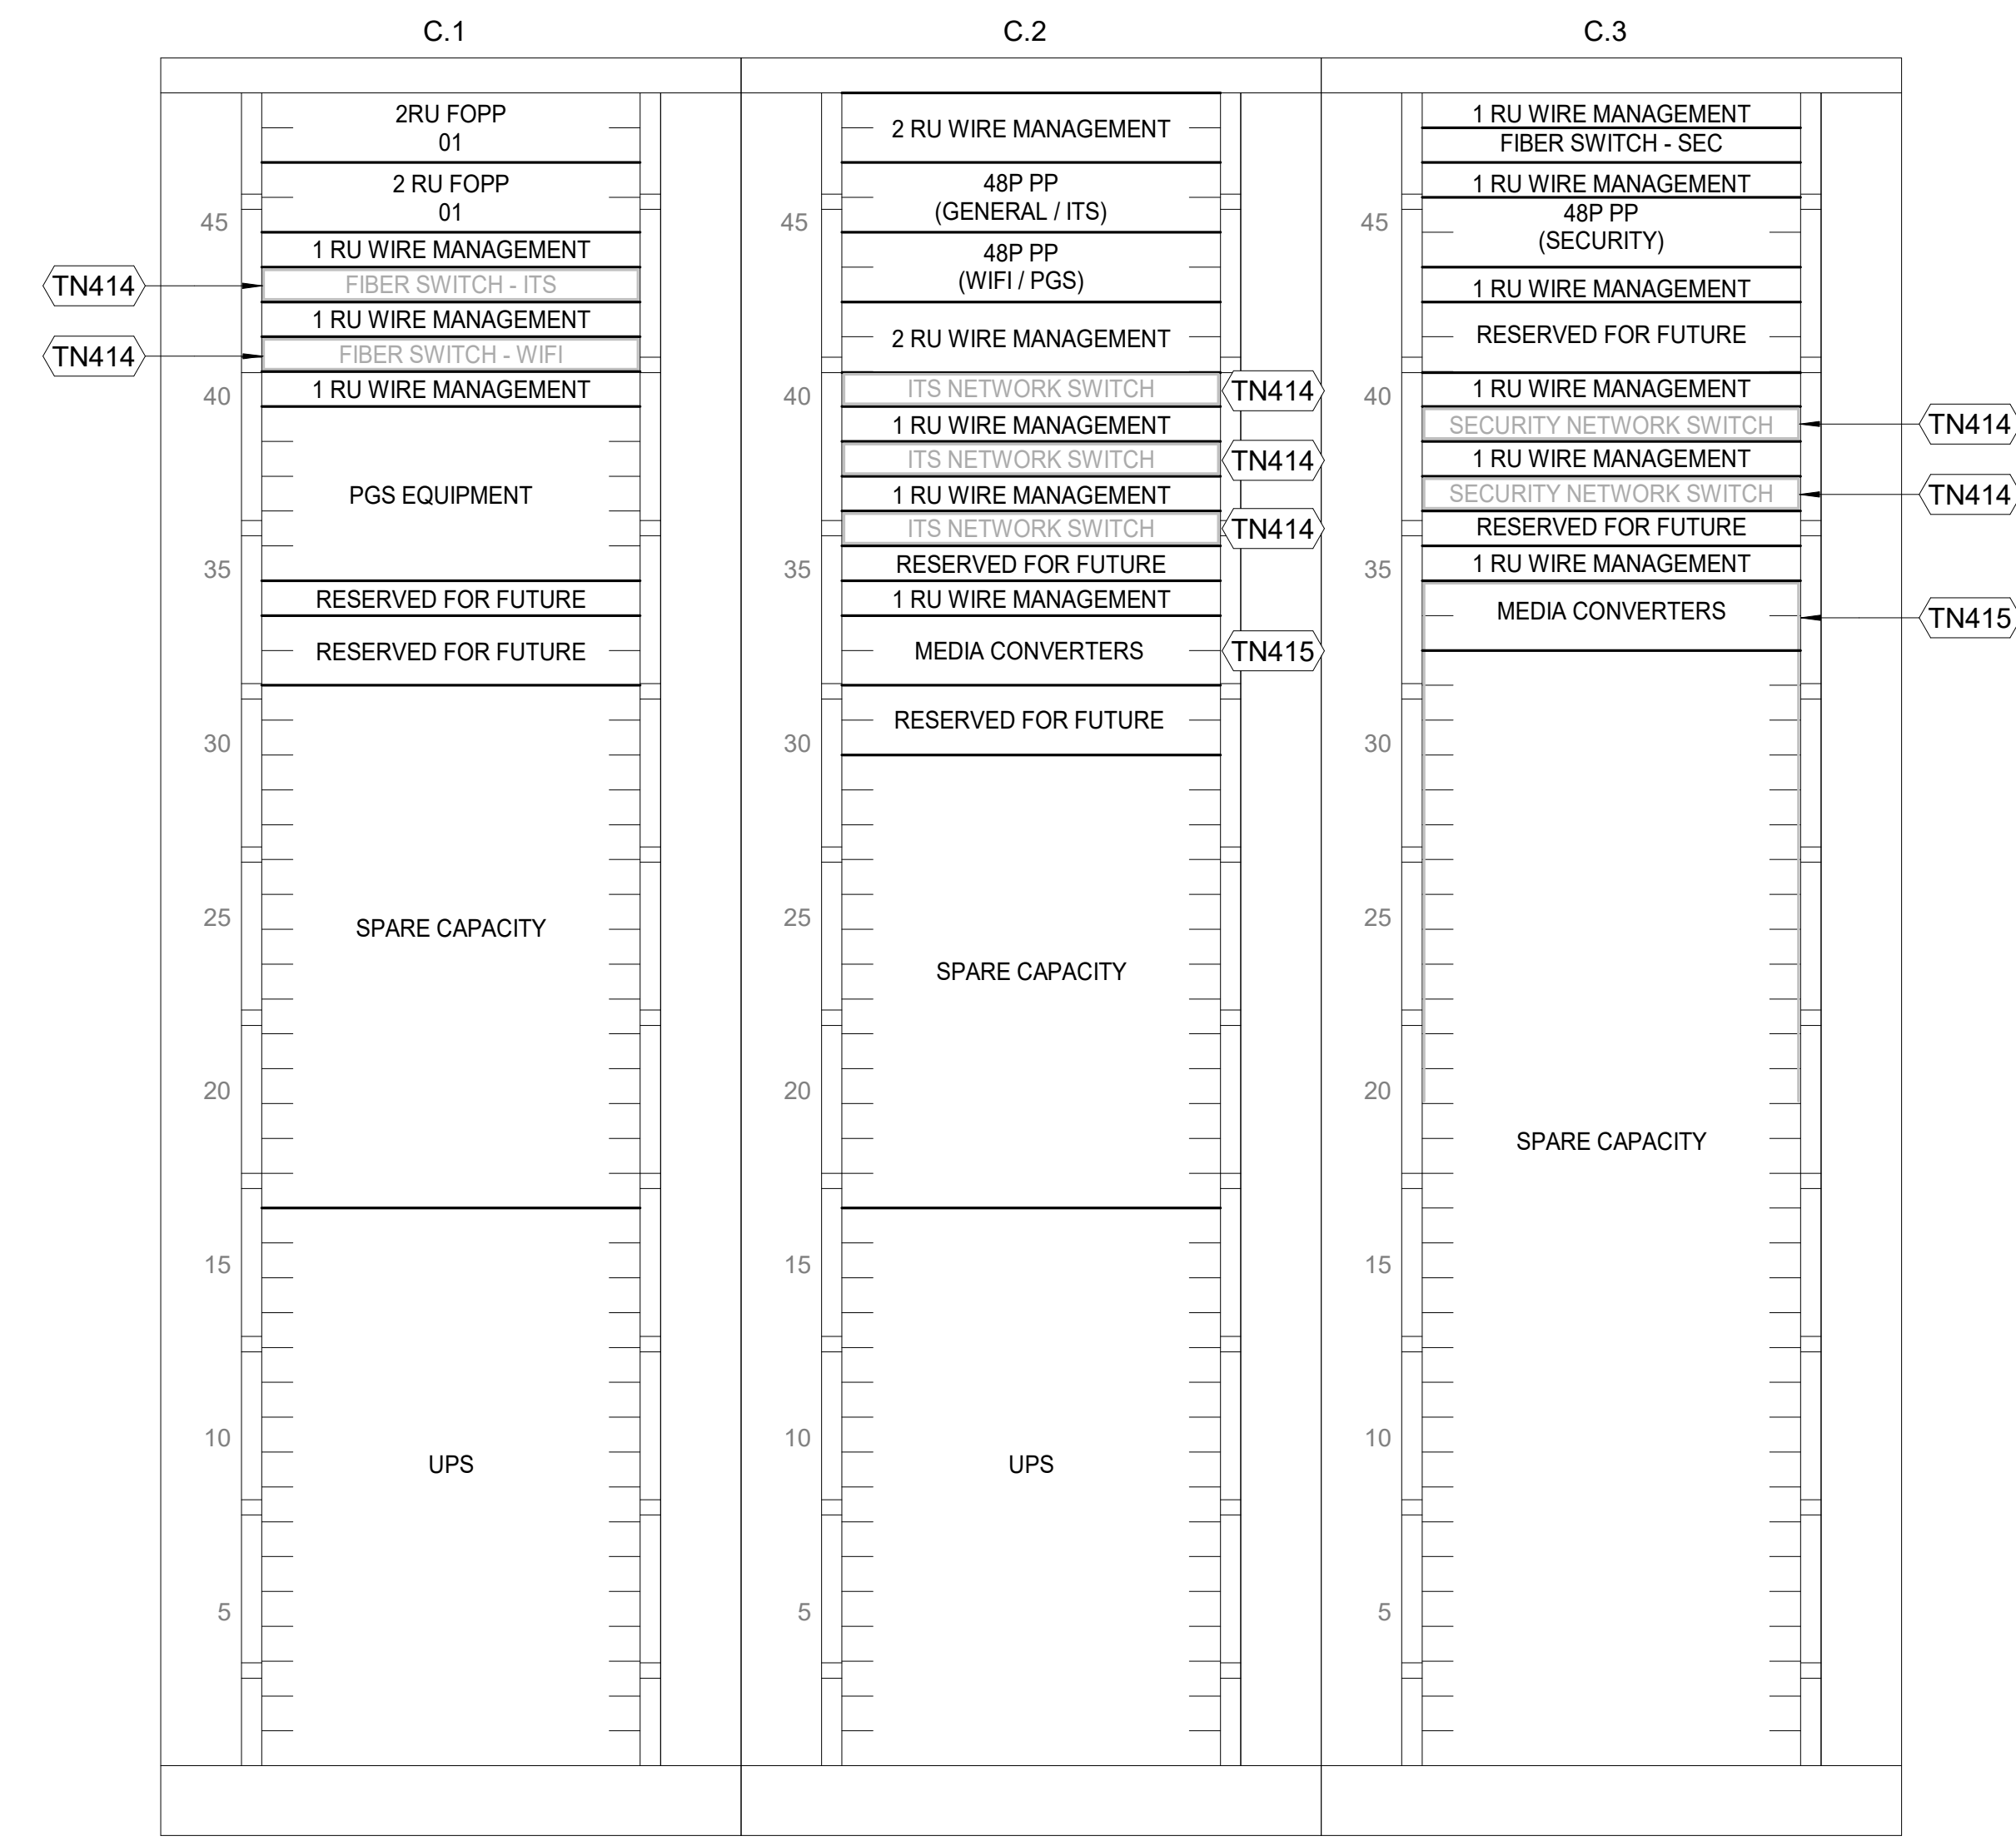

NOTE: EQUIPMENT AND TEXT SHOWN LIGHT DENOTES WORK BY OWNER OR OWNER'S VENDOR.

A4 CABINET ELEVATIONS - MCR-A
NTS



2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/AA
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION

TERMINAL C GARAGE & ROADWAYS
TELECOM ENLARGED PLAN - MCR-A


PROJECT NUMBER: TFD-007

PERMIT NUMBER: 822-0022


SHEET NUMBER
TN402-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.


- ALL DATA OUTLETS AND EQUIPMENT LOCATIONS SHOWN ARE DIAGRAMMATIC IN REFERENCE TO THE FLOOR PLAN. THE DEVICES SHOWN SHALL BE INSTALLED TO REFLECT THE INTENT OF THE DRAWINGS.
- CONTRACTOR SHALL COORDINATE WITH THE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHTS AND REQUIREMENTS.
- COORDINATE WITH ALL OTHER TRADES AND DRAWINGS PRIOR TO INSTALLATION AND PLACEMENT OF WORKSTATION OUTLETS AND EQUIPMENT.
- REFER TO DRAWING TN610 & TN611 TELECOM - BACKBONE PATHWAYS DIAGRAMS FOR ADDITIONAL INFORMATION ON BACKBONE CONDUITS AND PATHWAYS.
- CONTRACTOR SHALL FURNISH AND INSTALL PULL BOXES AS REQUIRED. PULL BOXES SHALL BE INSTALLED WITHIN 100' OF ANY CONTINUOUS RUN AND WHERE THERE IS MORE THAN TWO 90 DEGREE BENDS.
- CONTRACTOR SHALL FURNISH AND INSTALL EXPANSION JOINT CONDUITS AS REQUIRED. CONTRACTOR SHALL REFERENCE THE ARCHITECTURAL DRAWINGS FOR BUILDING EXPANSION JOINT LOCATIONS.

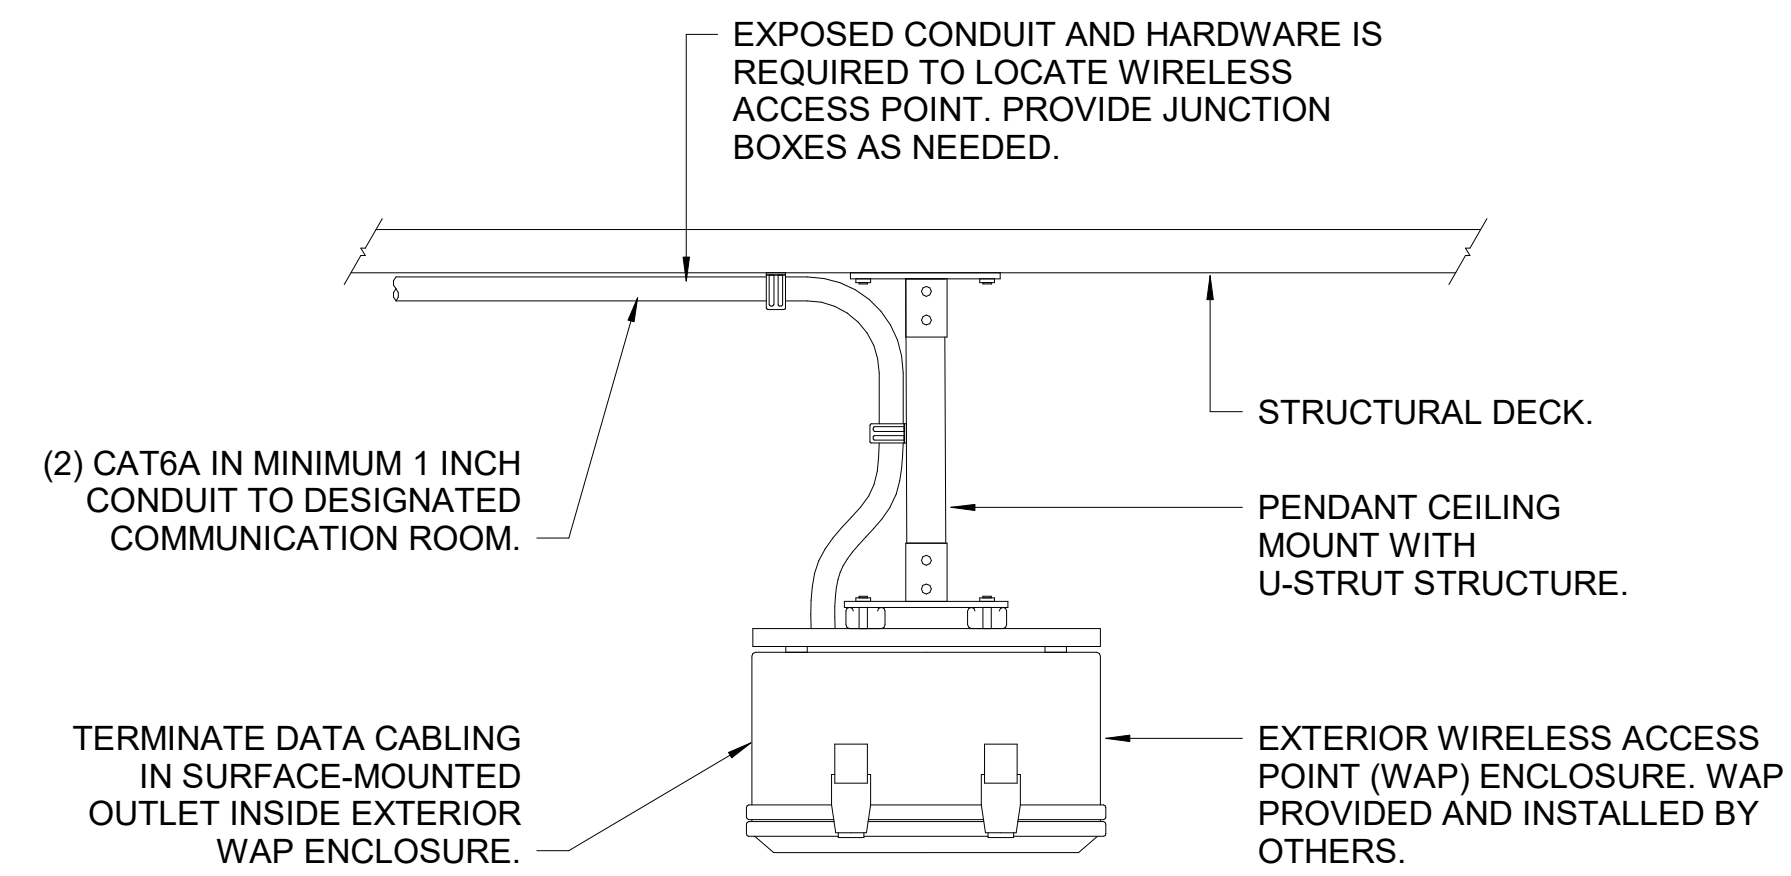

E4 WIRELESS ACCESS POINT / OUTLET DETAIL - TYPE W
NTS

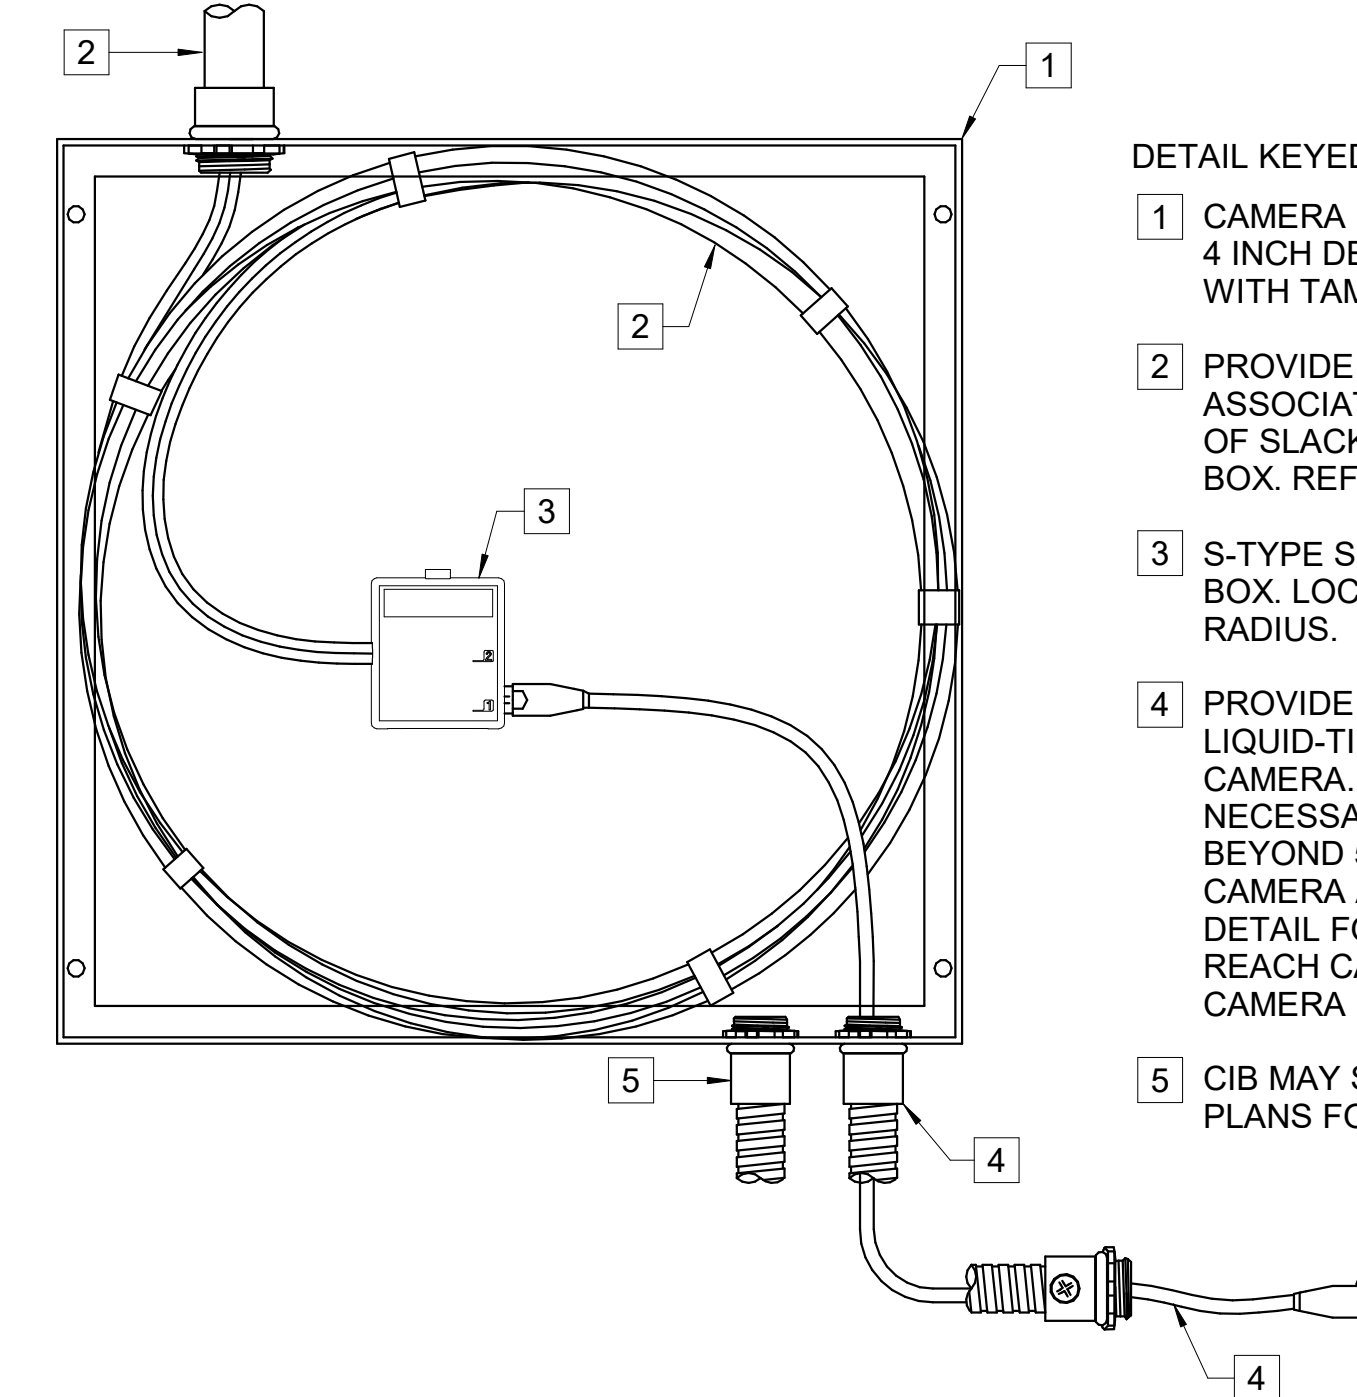


B4 CAMERA INTERFACE BOX / OUTLET DETAIL - TYPE S
NTS

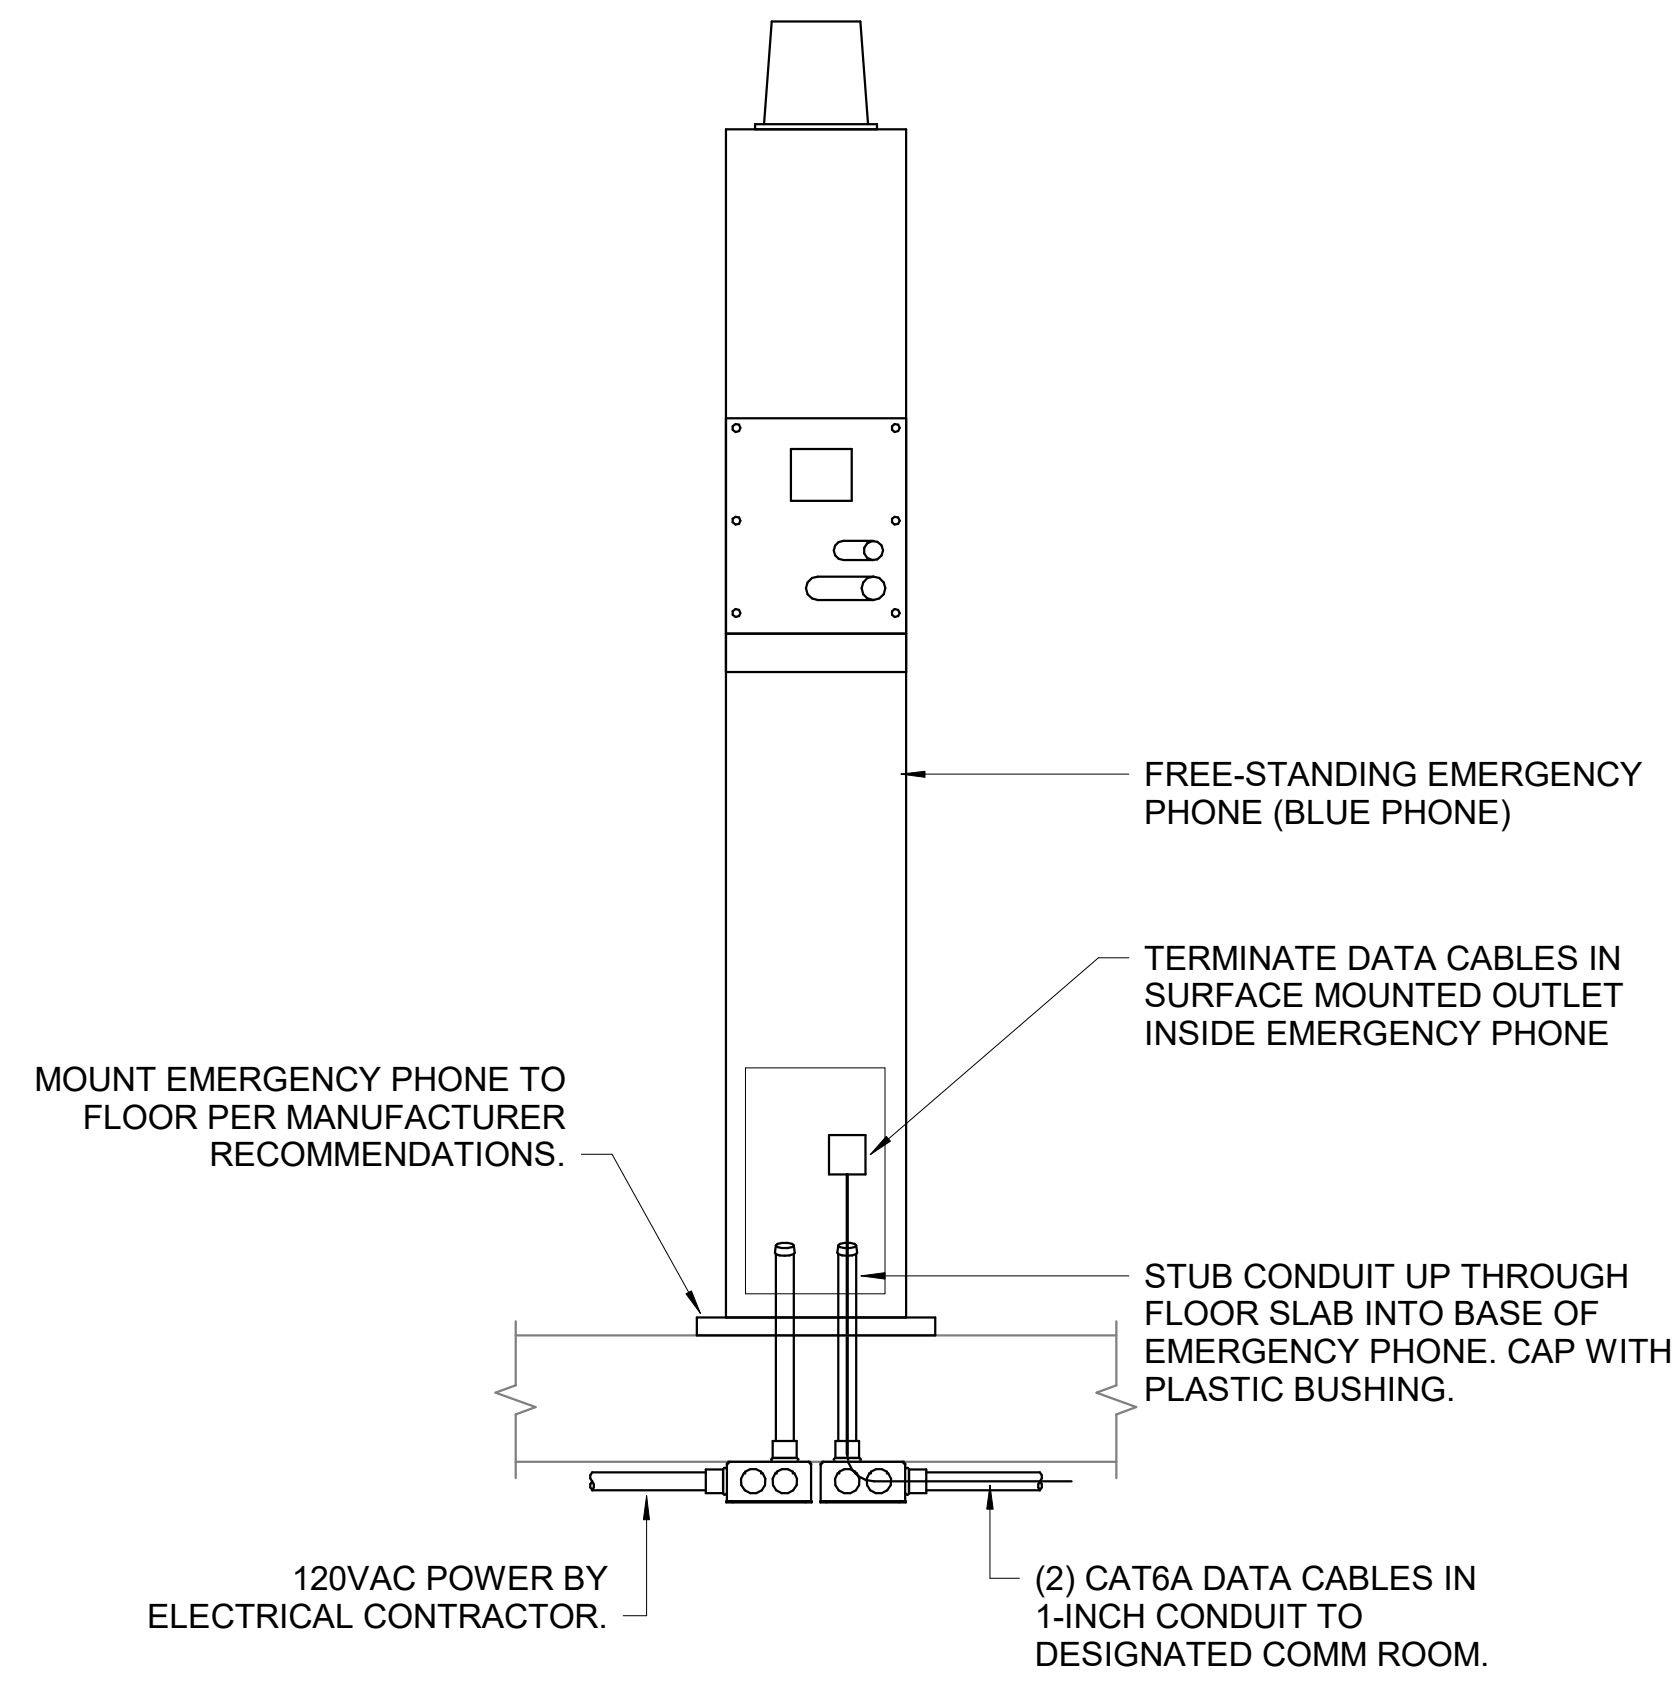

DETAIL NOTES:

- REFER TO SPECIFICATIONS FOR ADDITIONAL DETAILS RELATED TO EMERGENCY PHONE MOUNTING AND CABLING.
- CONDUIT STUBS SHOWN ARE INDICATIVE OF EMERGENCY PHONES LOCATED ON LEVELS B THROUGH E. LEVEL A LOCATIONS MAY REQUIRE SAW CUTTING OF EXISTING SLAB-ON-GRADE TO NEAREST VERTICAL PATHWAY.
- ELECTRICAL POWER SHOWN FOR REFERENCE ONLY. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL DETAILS. FOLLOW MANUFACTURER REQUIREMENTS FOR EMERGENCY PHONE POWER CONNECTIONS.


B1 EMERGENCY PHONE / OUTLET DETAIL - TYPE E
NTS

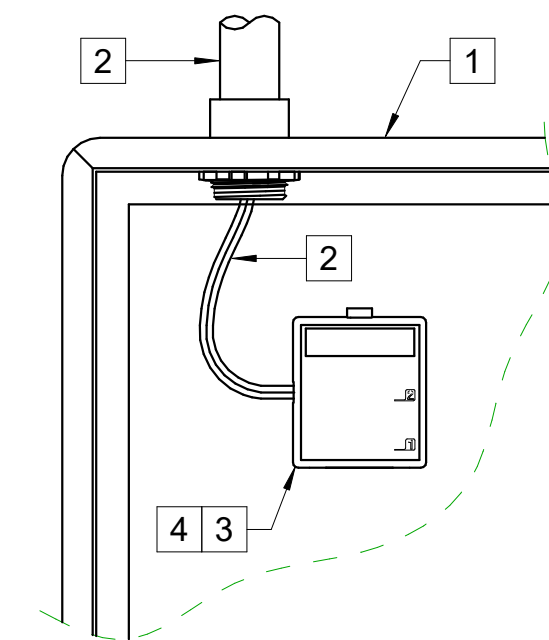


DETAIL KEYED NOTES: (THIS DETAIL ONLY)

- EQUIPMENT ENCLOSURE / PANEL
- PROVIDE CAT6A UTP DATA CABLE IN 1 INCH CONDUIT TO ASSOCIATED COMMUNICATION ROOM. REFER TO PLANS FOR QUANTITY OF CABLES. COIL MINIMUM 10FT SERVICE LOOP PER CABLE WITHIN ENCLOSURE OR OUTSIDE IN SEPARATE JUNCTION BOX.
- TERMINATE COPPER DATA CABLING IN SURFACE MOUNTED OUTLET FIX OUTLET IN PLACE WITHIN THE ENCLOSURE. LOCATE AS NECESSARY TO MAINTAIN MINIMUM CABLE BEND RADIUS AND SEPARATION FROM ELECTRICAL CABLES AND TERMINALS. COORDINATE LOCATION OF OUTLET WITH EQUIPMENT INSTALLER.
- PROVIDE CAT6A PATCH CORD TO EQUIPMENT NETWORK CONNECTION. COORDINATE LENGTH AND ROUTING WITH EQUIPMENT INSTALLER.

B2 OUTLET DETAIL - TYPE P
NTS

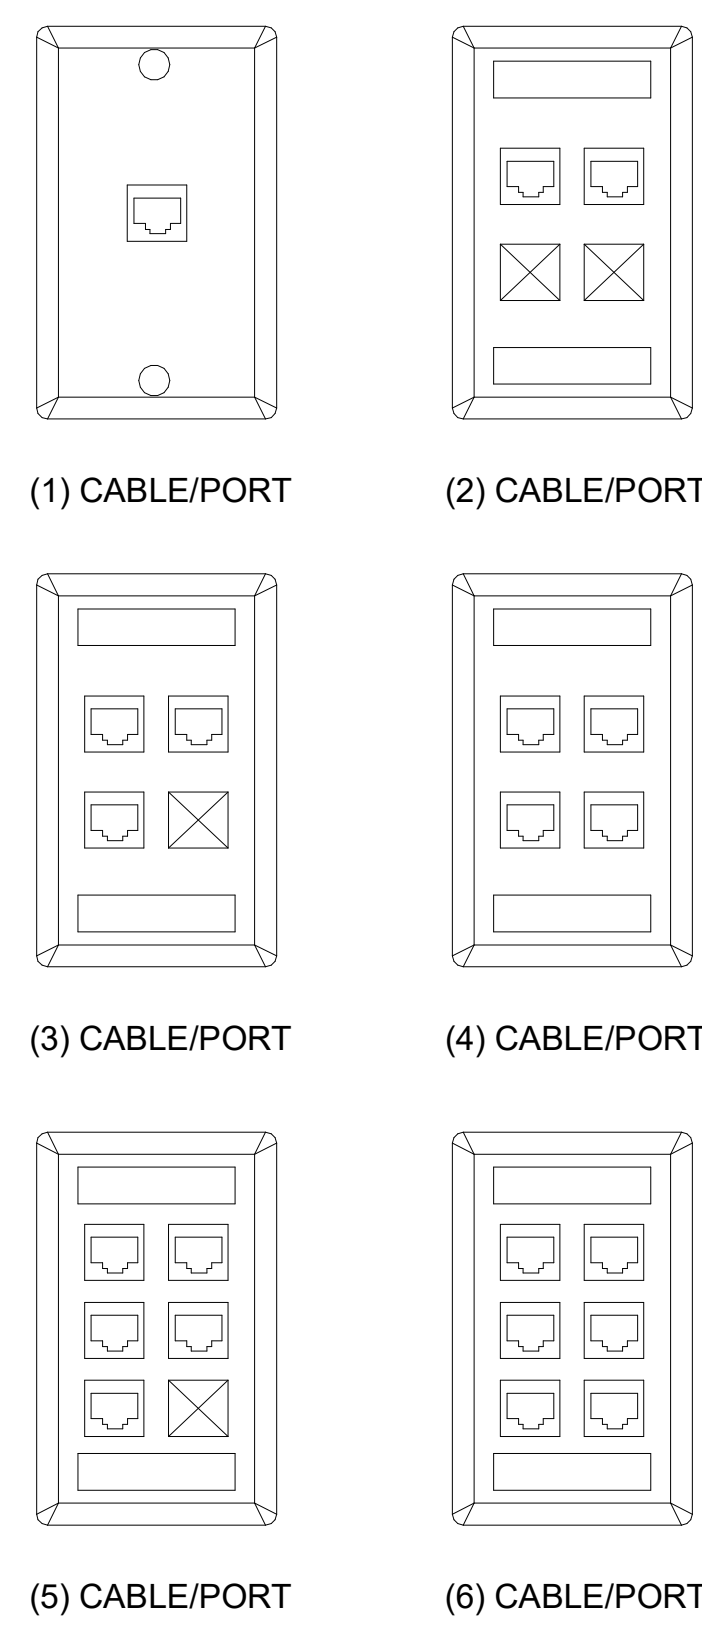


A1 DATA OUTLET PORT CONFIGURATIONS
NTS

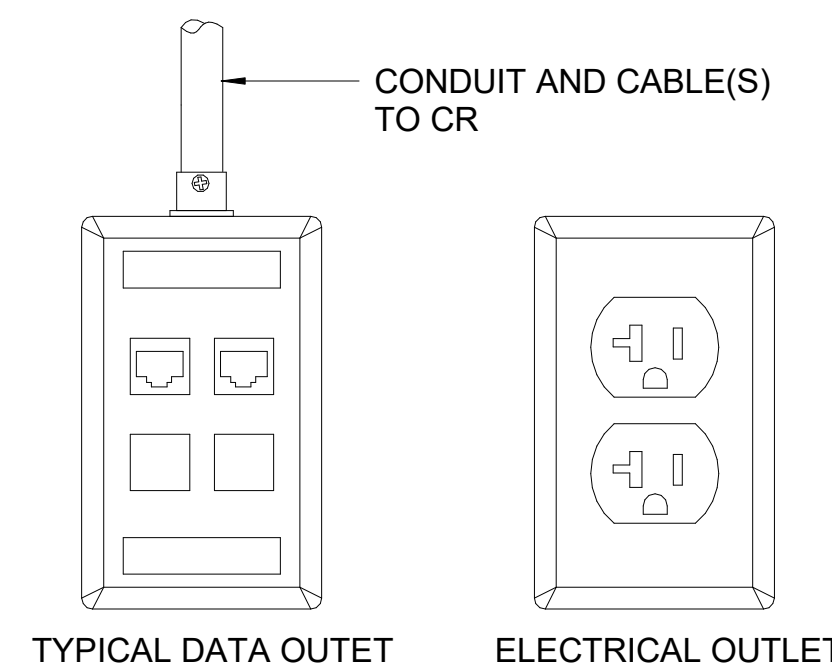

DETAIL NOTES:

- MINIMUM 4-11/16" BY 2 1/4" DEEP SQUARE BACK BOX WITH SINGLE GANG ADAPTER PLATE.
- PROVIDE MINIMUM 1" CONDUIT FOR 1-4 CATEGORY CABLES. REFER TO MANUFACTURE CABLE INSTALLATION FILL RATIOS FOR CONDUIT REQUIREMENTS.
- REFER TO FACEPLATE DETAILS AND DATA OUTLET SCHEDULE FOR PORT CONFIGURATION, CABLE QUANTITIES, AND MOUNTING HEIGHTS.
- DATA OUTLETS SHALL BE MOUNTED ADJACENT TO THE ELECTRICAL OUTLET UNLESS SPECIFICATIONS OR DRAWINGS PROVIDE OTHER DIRECTION.
- OUTLETS SHALL BE MOUNTED AT 18" AFF UNLESS OTHERWISE NOTED.


A2 TYPICAL OUTLET INSTALLATION DETAIL
NTS

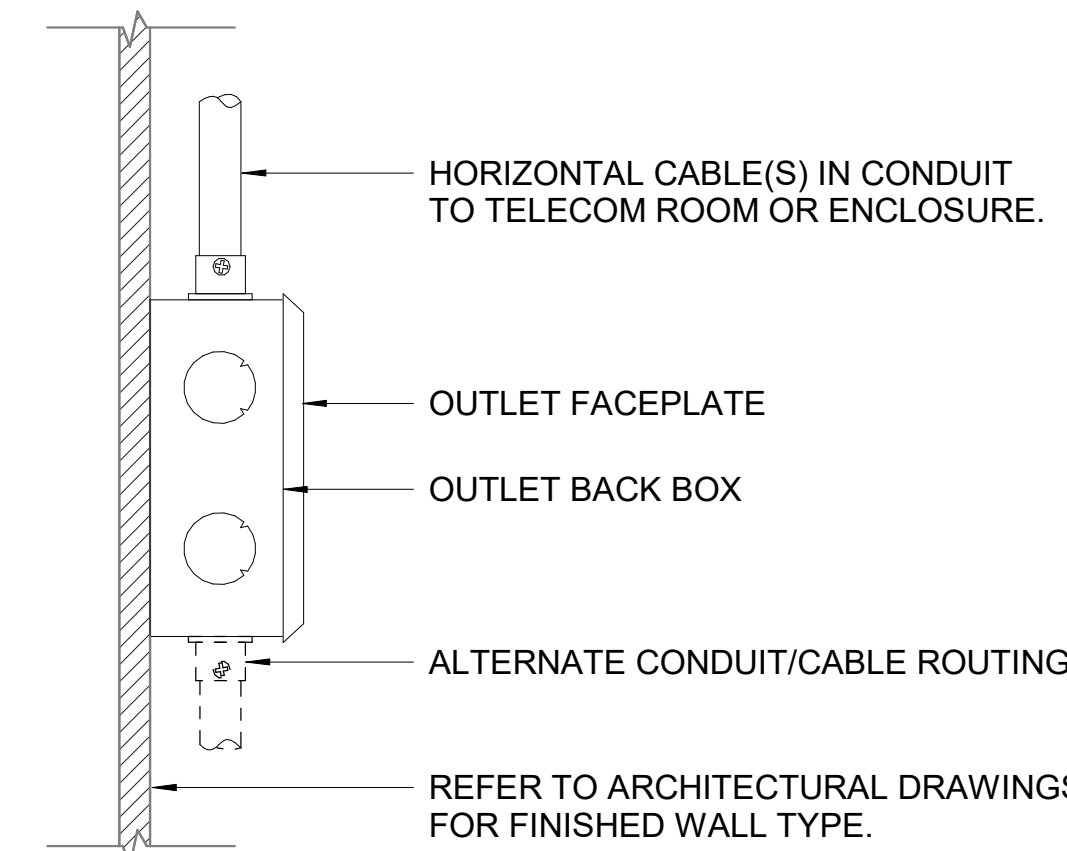

DETAIL NOTES:

- TELECOMMUNICATIONS OUTLET SURFACE-MOUNTED TO VERTICAL SURFACE. PROVIDE APPROPRIATELY SIZED DOUBLE-GANG METAL BACK BOX AND SINGLE-GANG ADAPTER RING.
- REFER TO FACEPLATE DETAILS AND SCS SCHEDULE FOR PORT CONFIGURATION AND CABLE QUANTITIES.
- PROVIDE MINIMUM 1 INCH CONDUIT FOR 1-4 CABLES. 1-1/2 INCH CONDUIT FOR GREATER THAN FOUR CABLES. REFER TO SCS SCHEDULE FOR DESIGNATED TELECOM ROOM OR ENCLOSURE.

A3 OUTLET DETAIL - SURFACE MOUNT
NTS

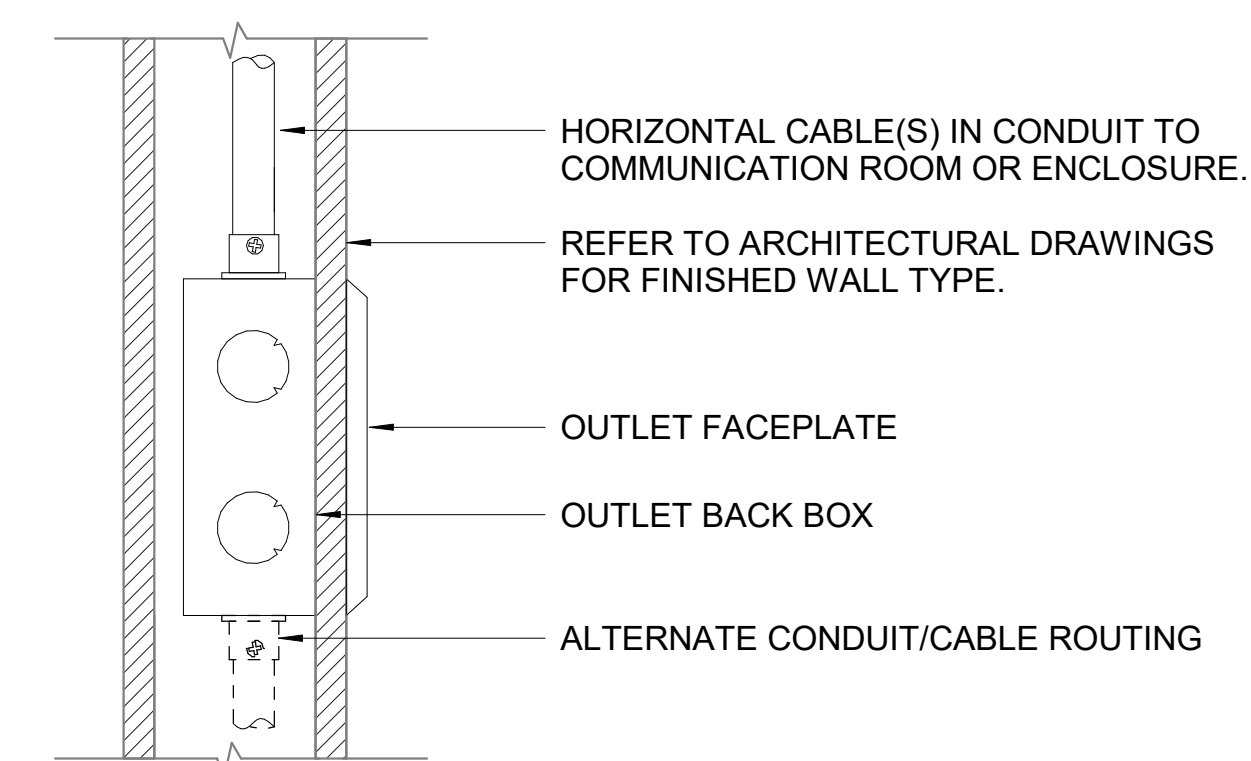


DETAIL NOTES:







- TELECOMMUNICATIONS OUTLET MOUNTED FLUSH INTO VERTICAL SURFACE. PROVIDE APPROPRIATELY SIZED DOUBLE-GANG METAL BACK BOX AND MUD RING.
- REFER TO FACEPLATE DETAILS AND SCS SCHEDULE FOR PORT CONFIGURATION AND CABLE QUANTITIES.
- PROVIDE MINIMUM 1 INCH CONDUIT FOR 1-4 CABLES. 1-1/2 INCH CONDUIT FOR GREATER THAN FOUR CABLES. REFER TO SCS SCHEDULE FOR DESIGNATED TELECOM ROOM OR ENCLOSURE.

A4 OUTLET DETAIL - FLUSH MOUNT
NTS


KEY PLAN

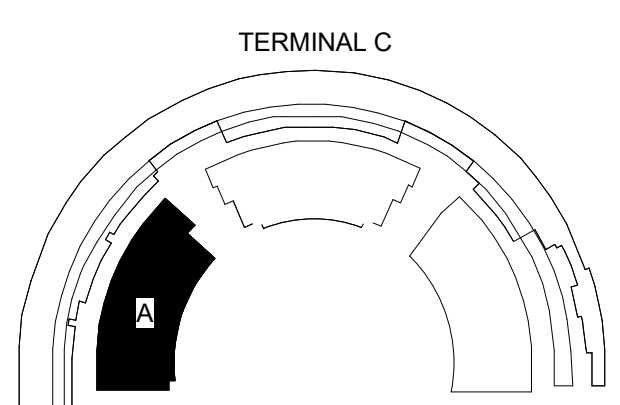

NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

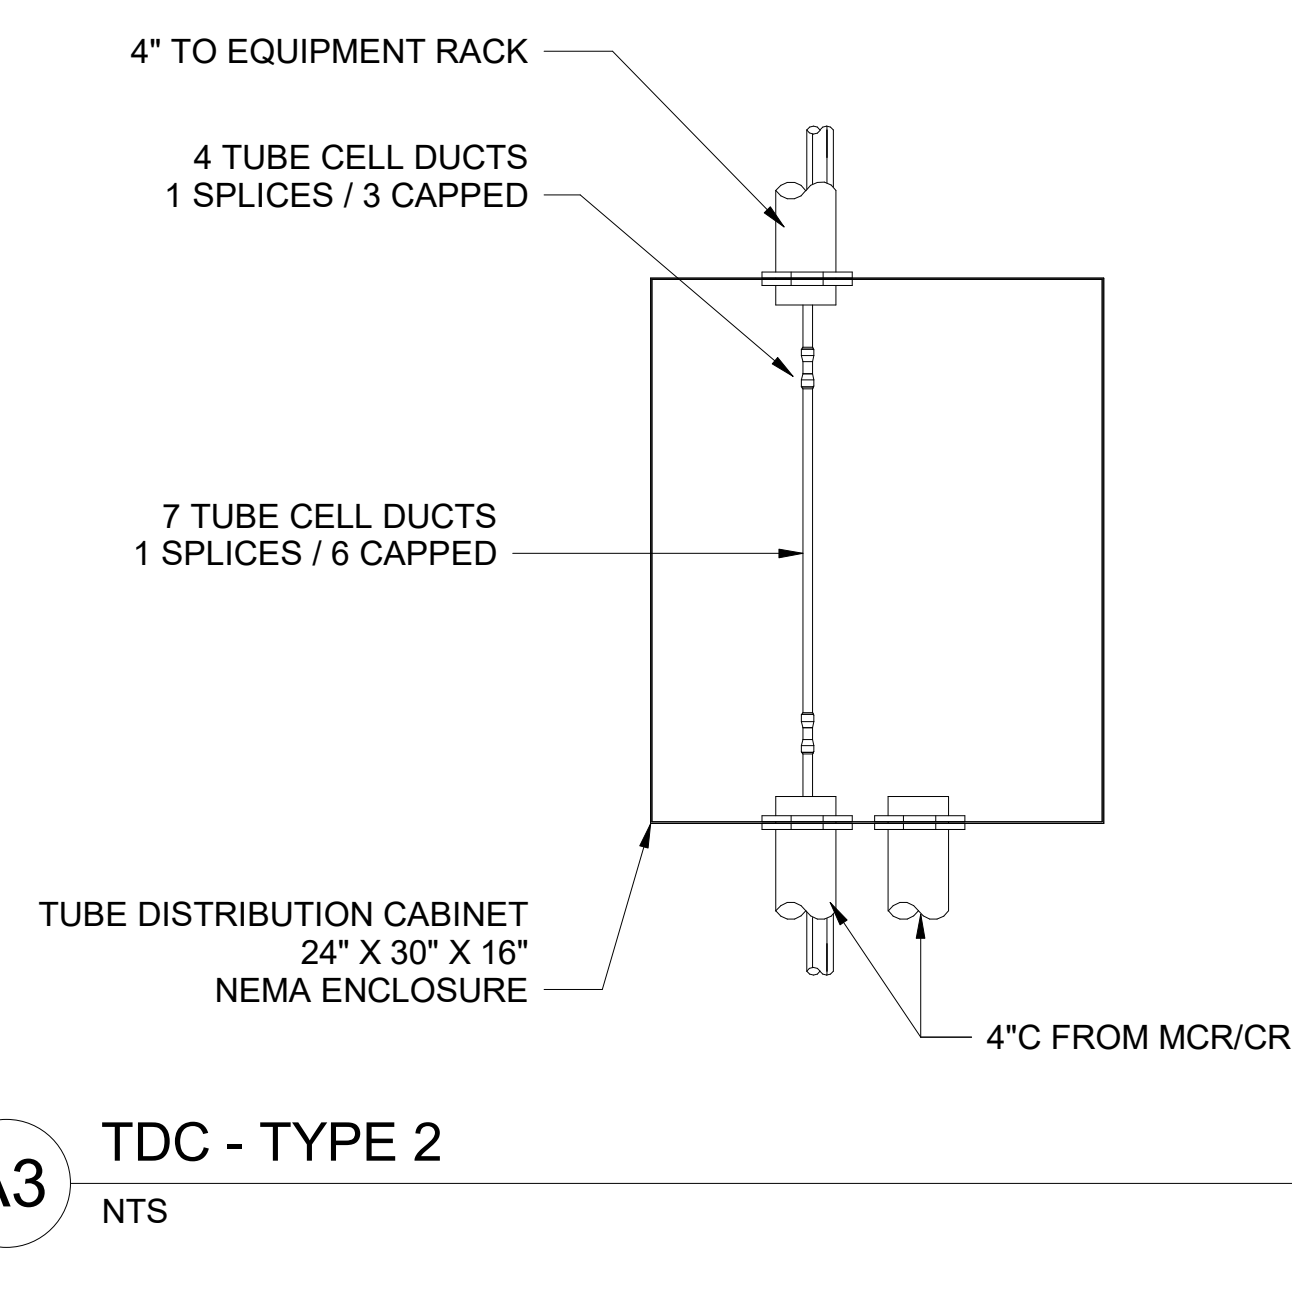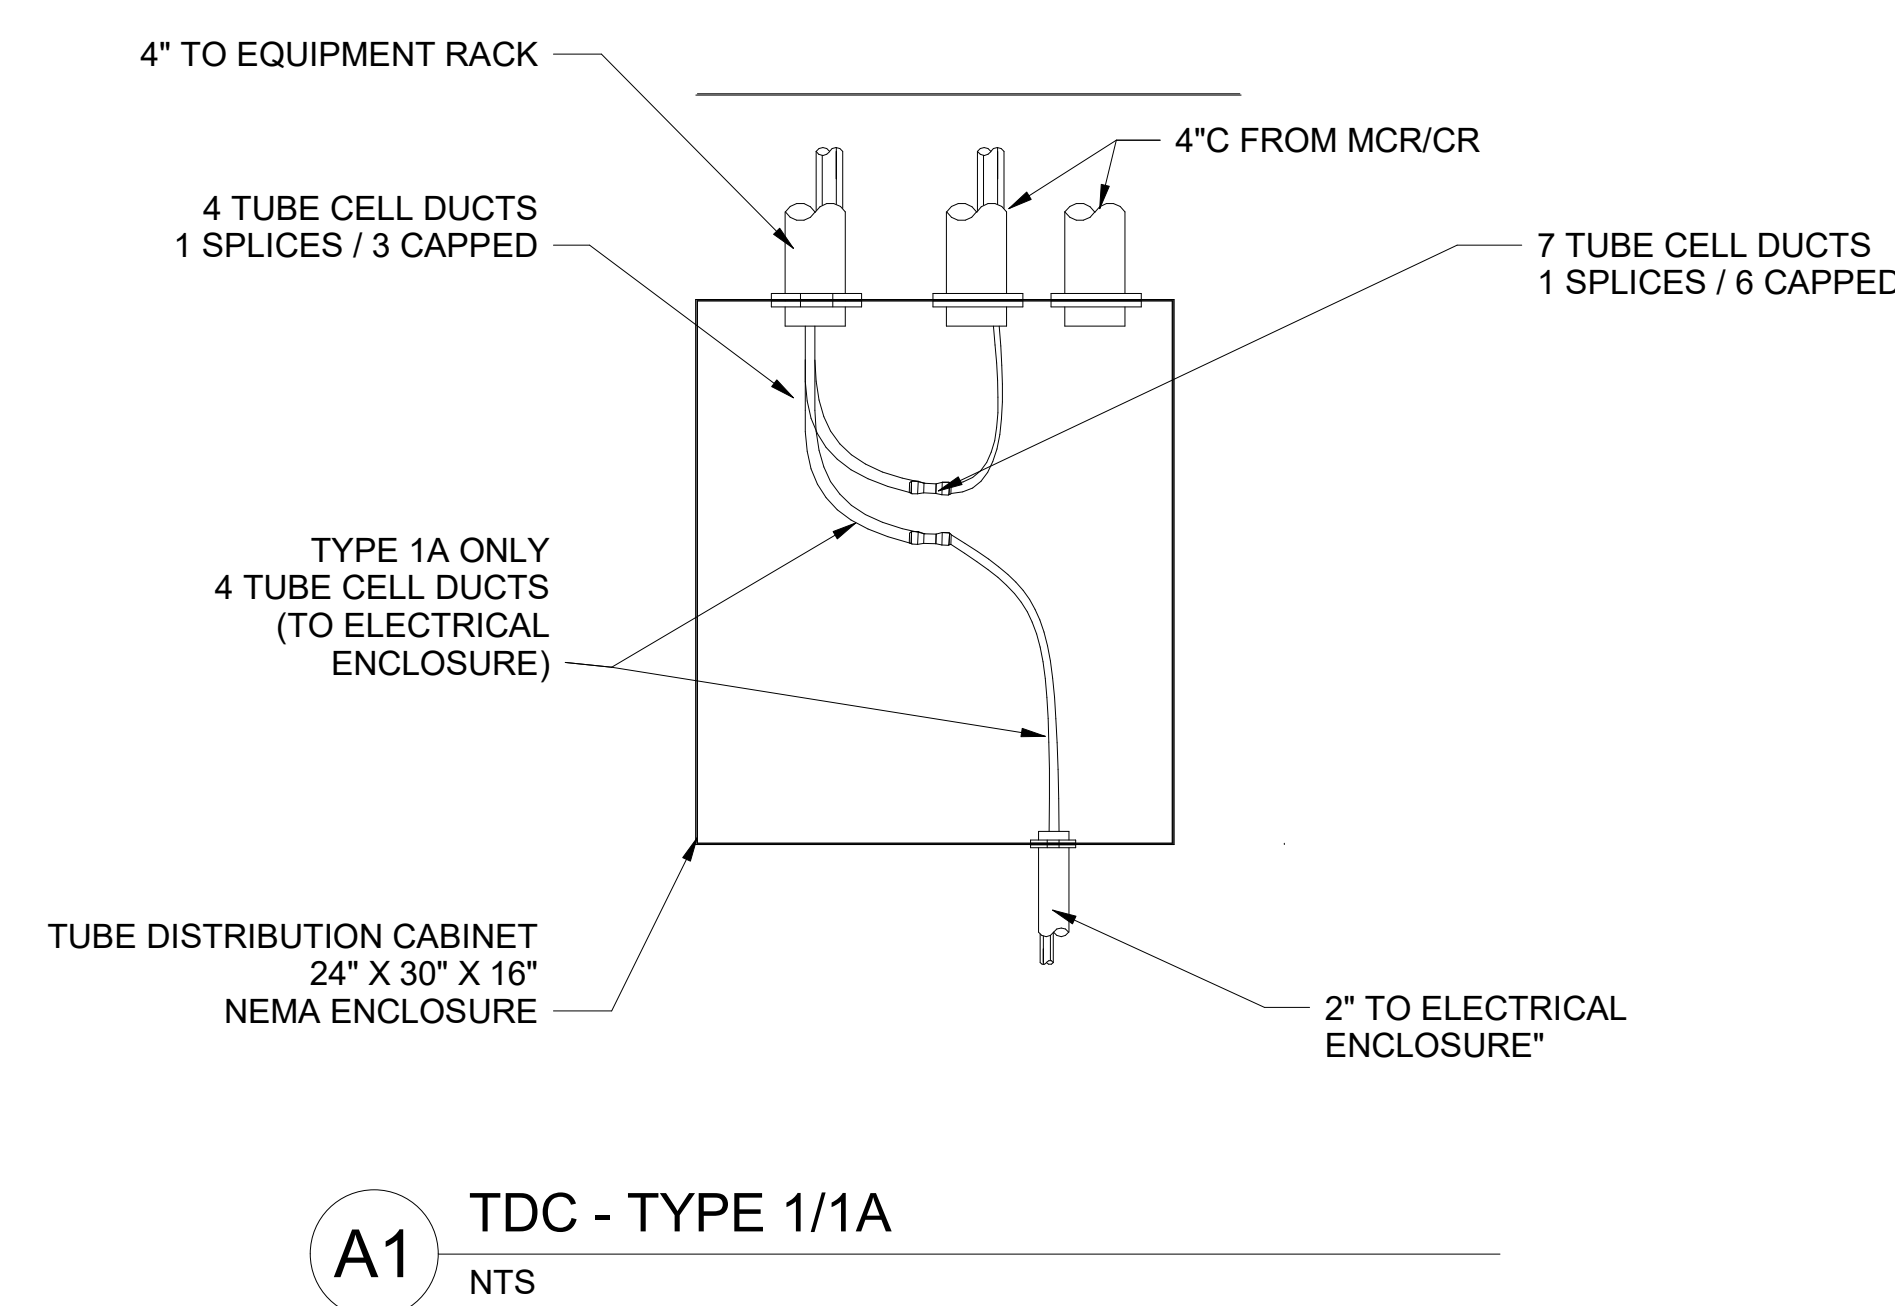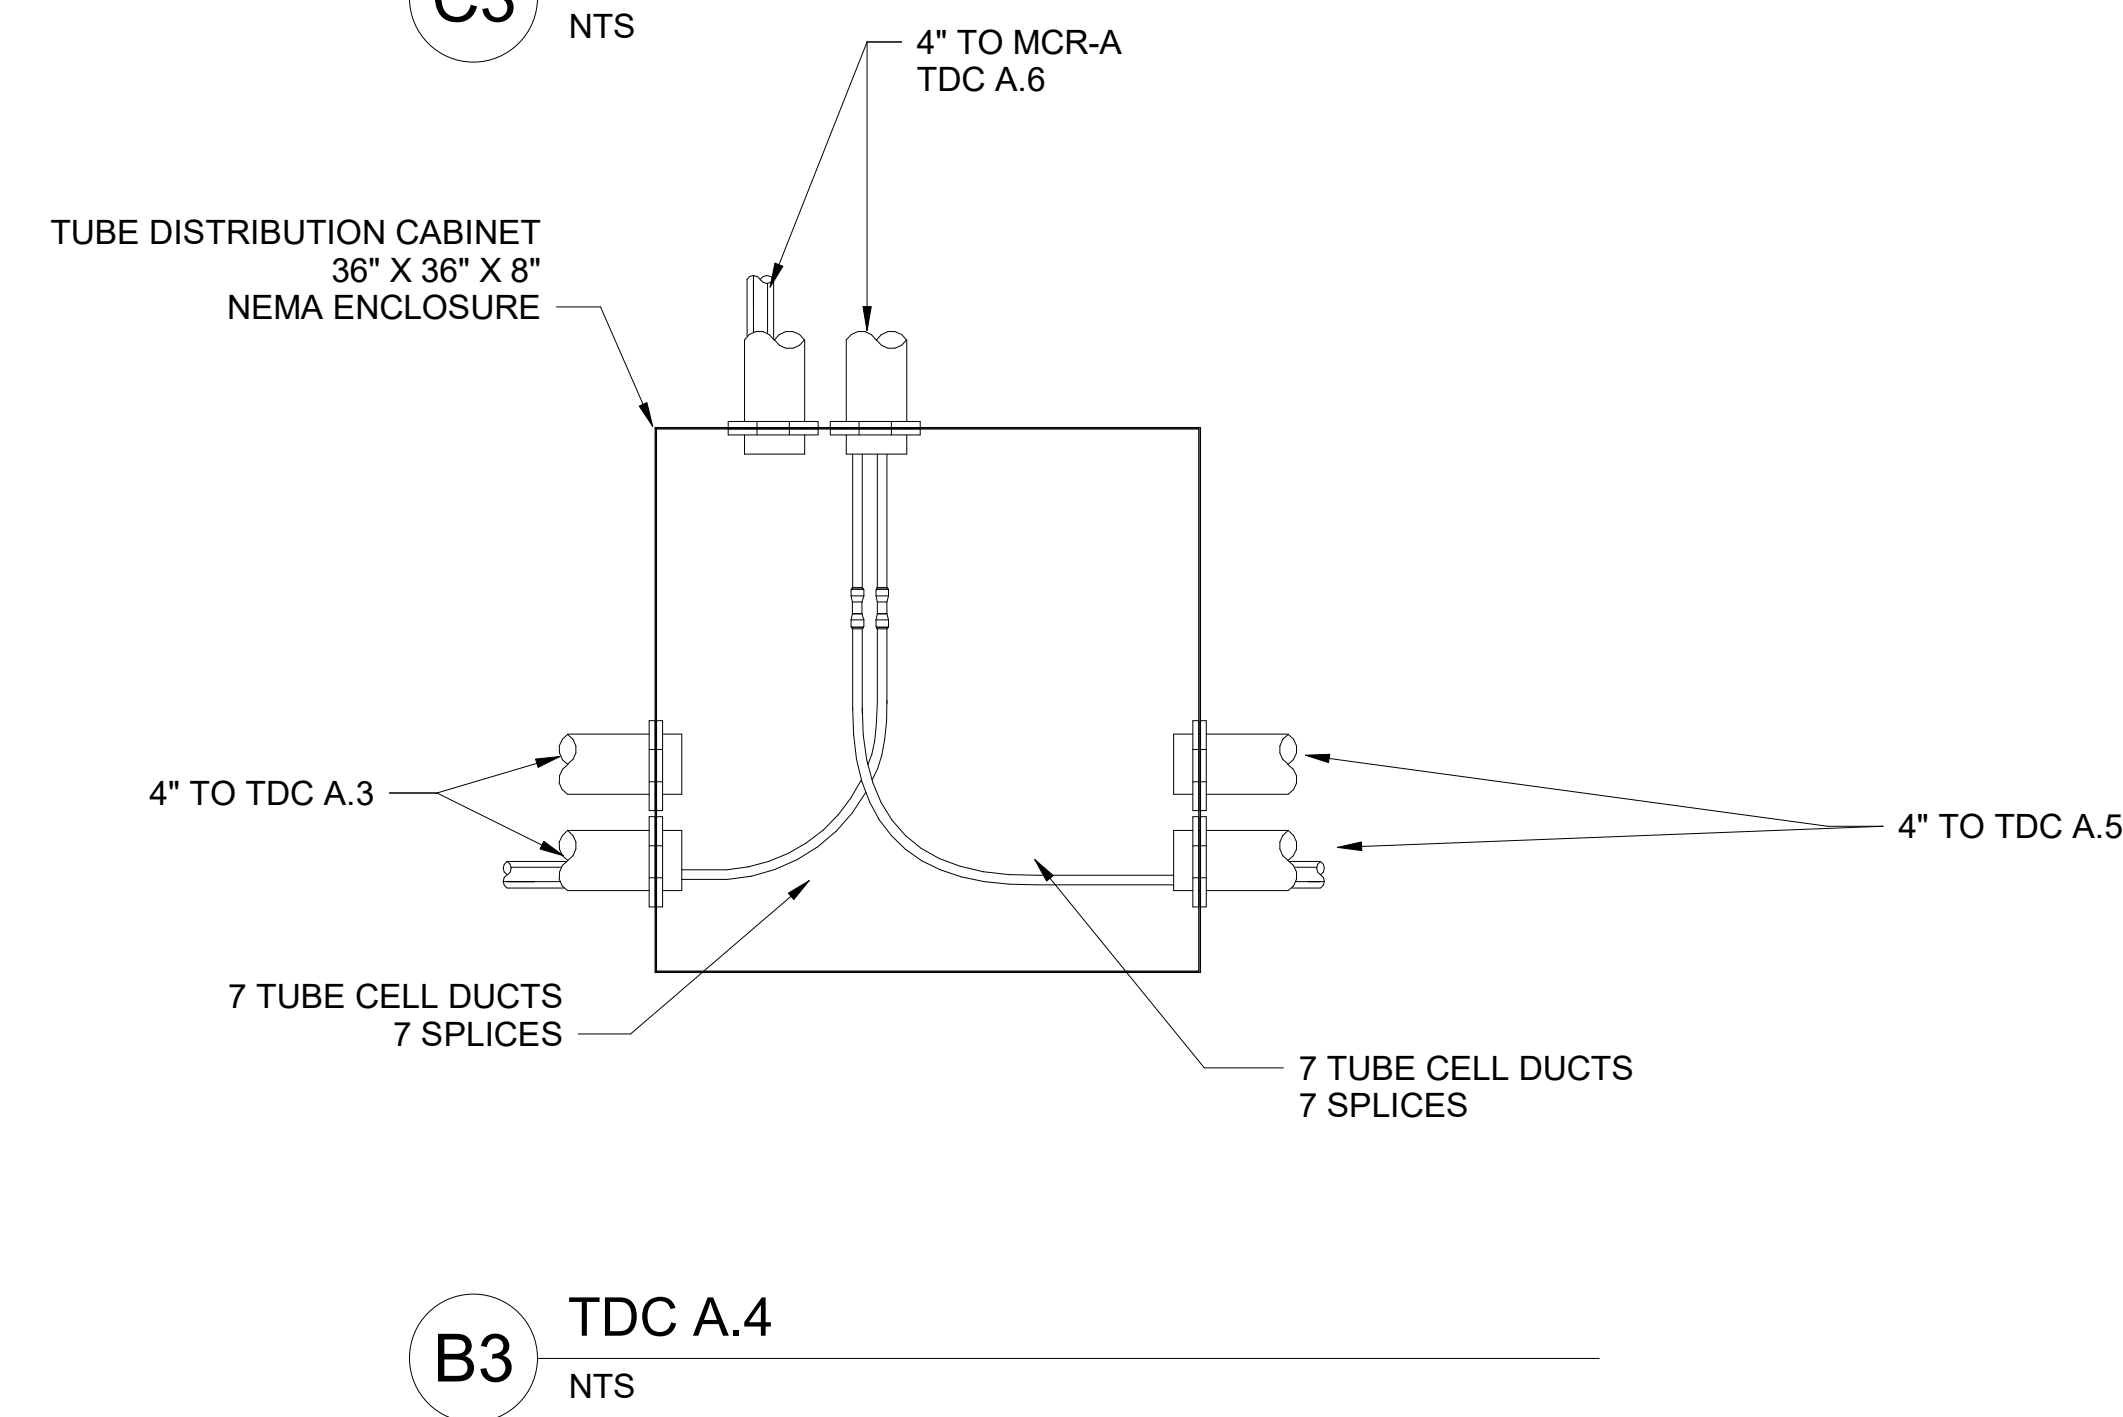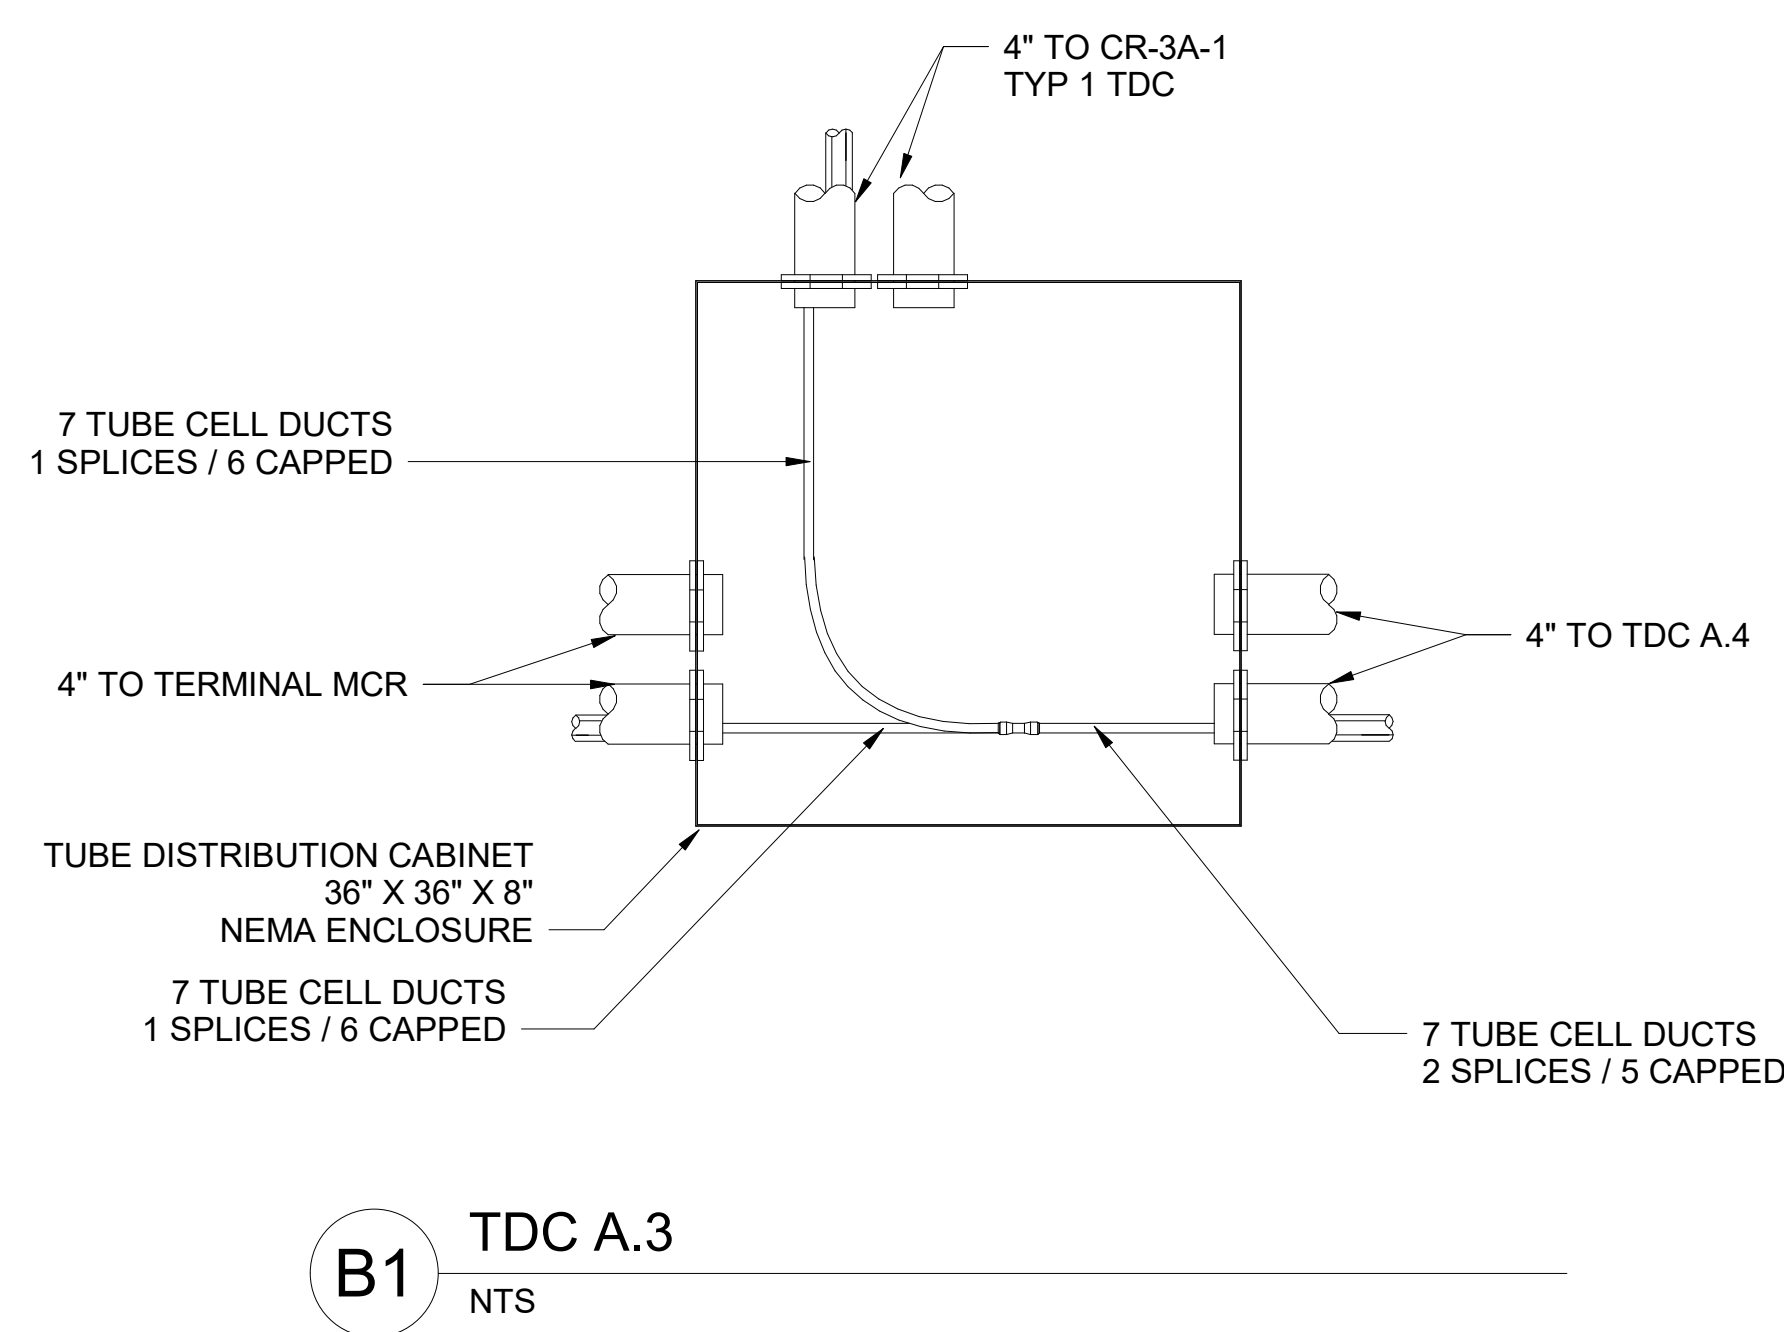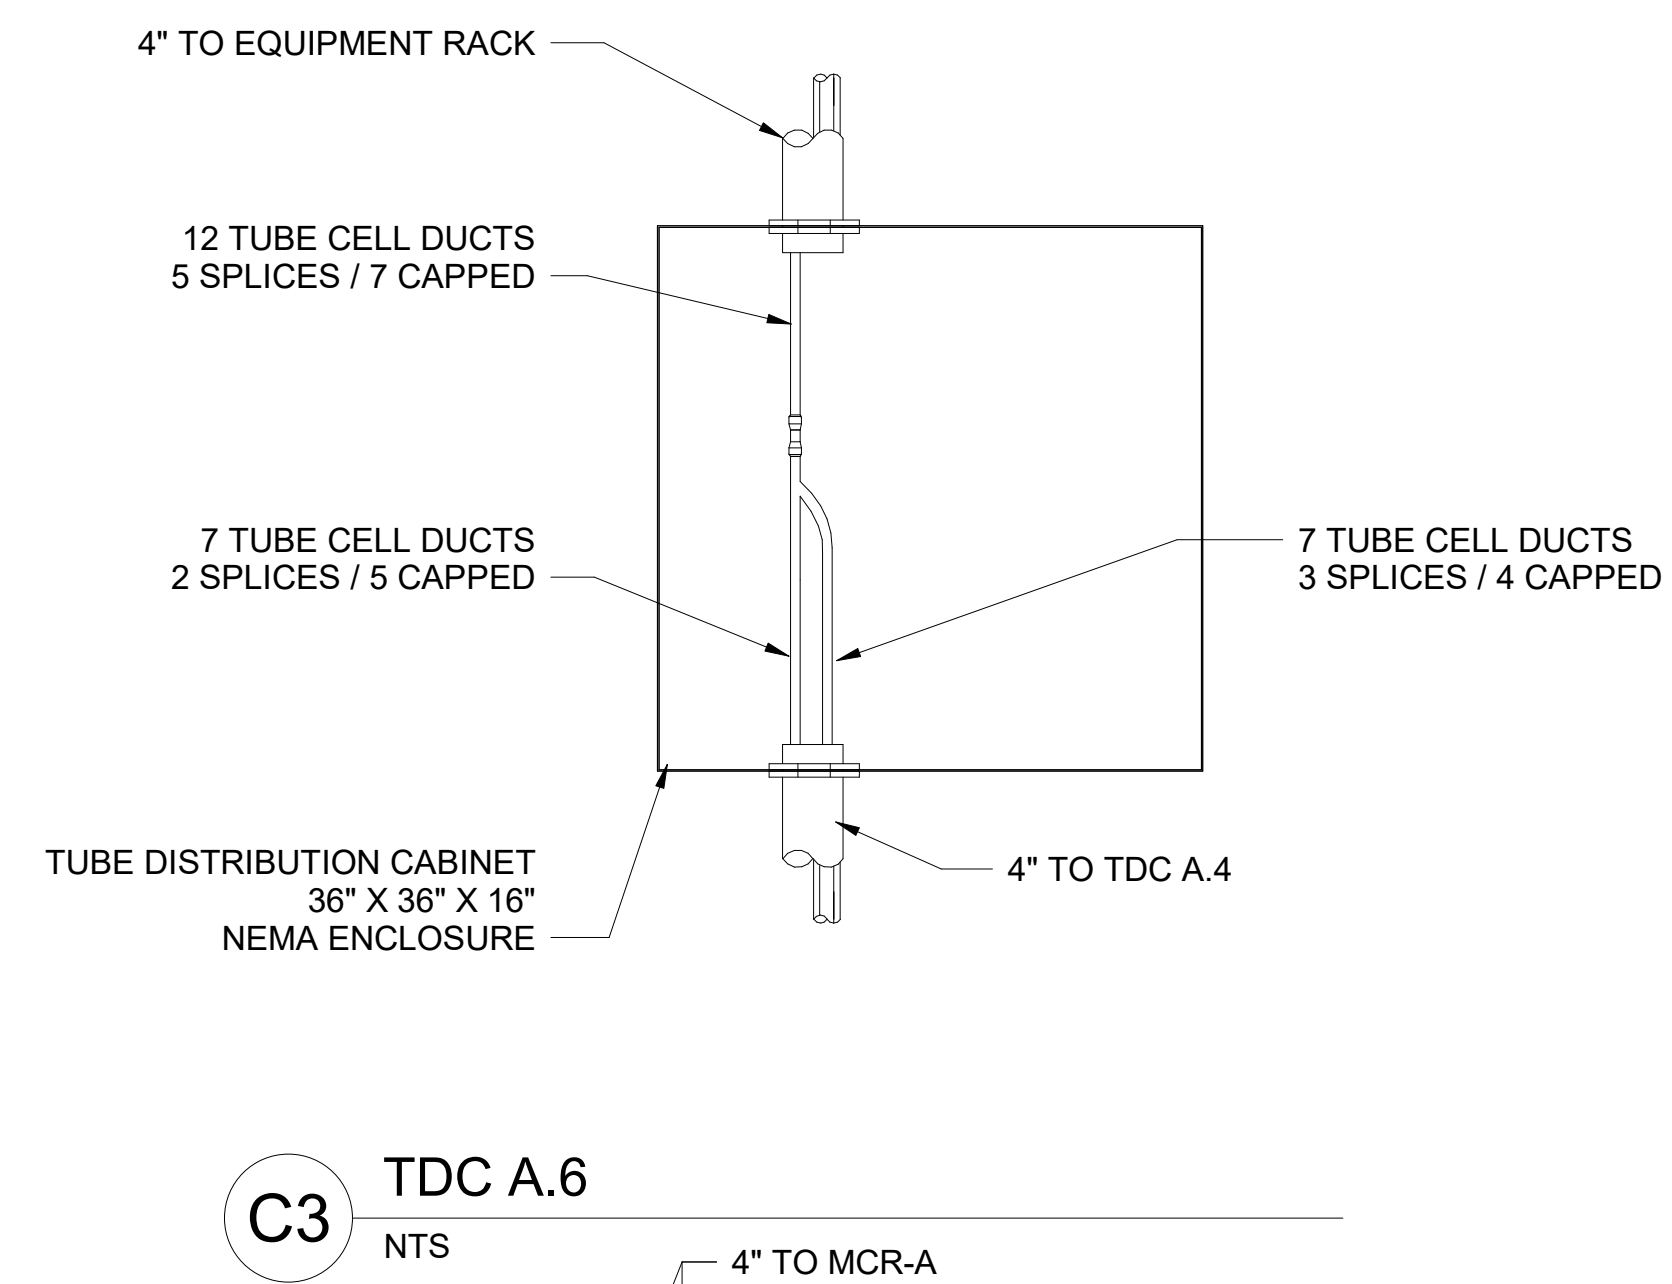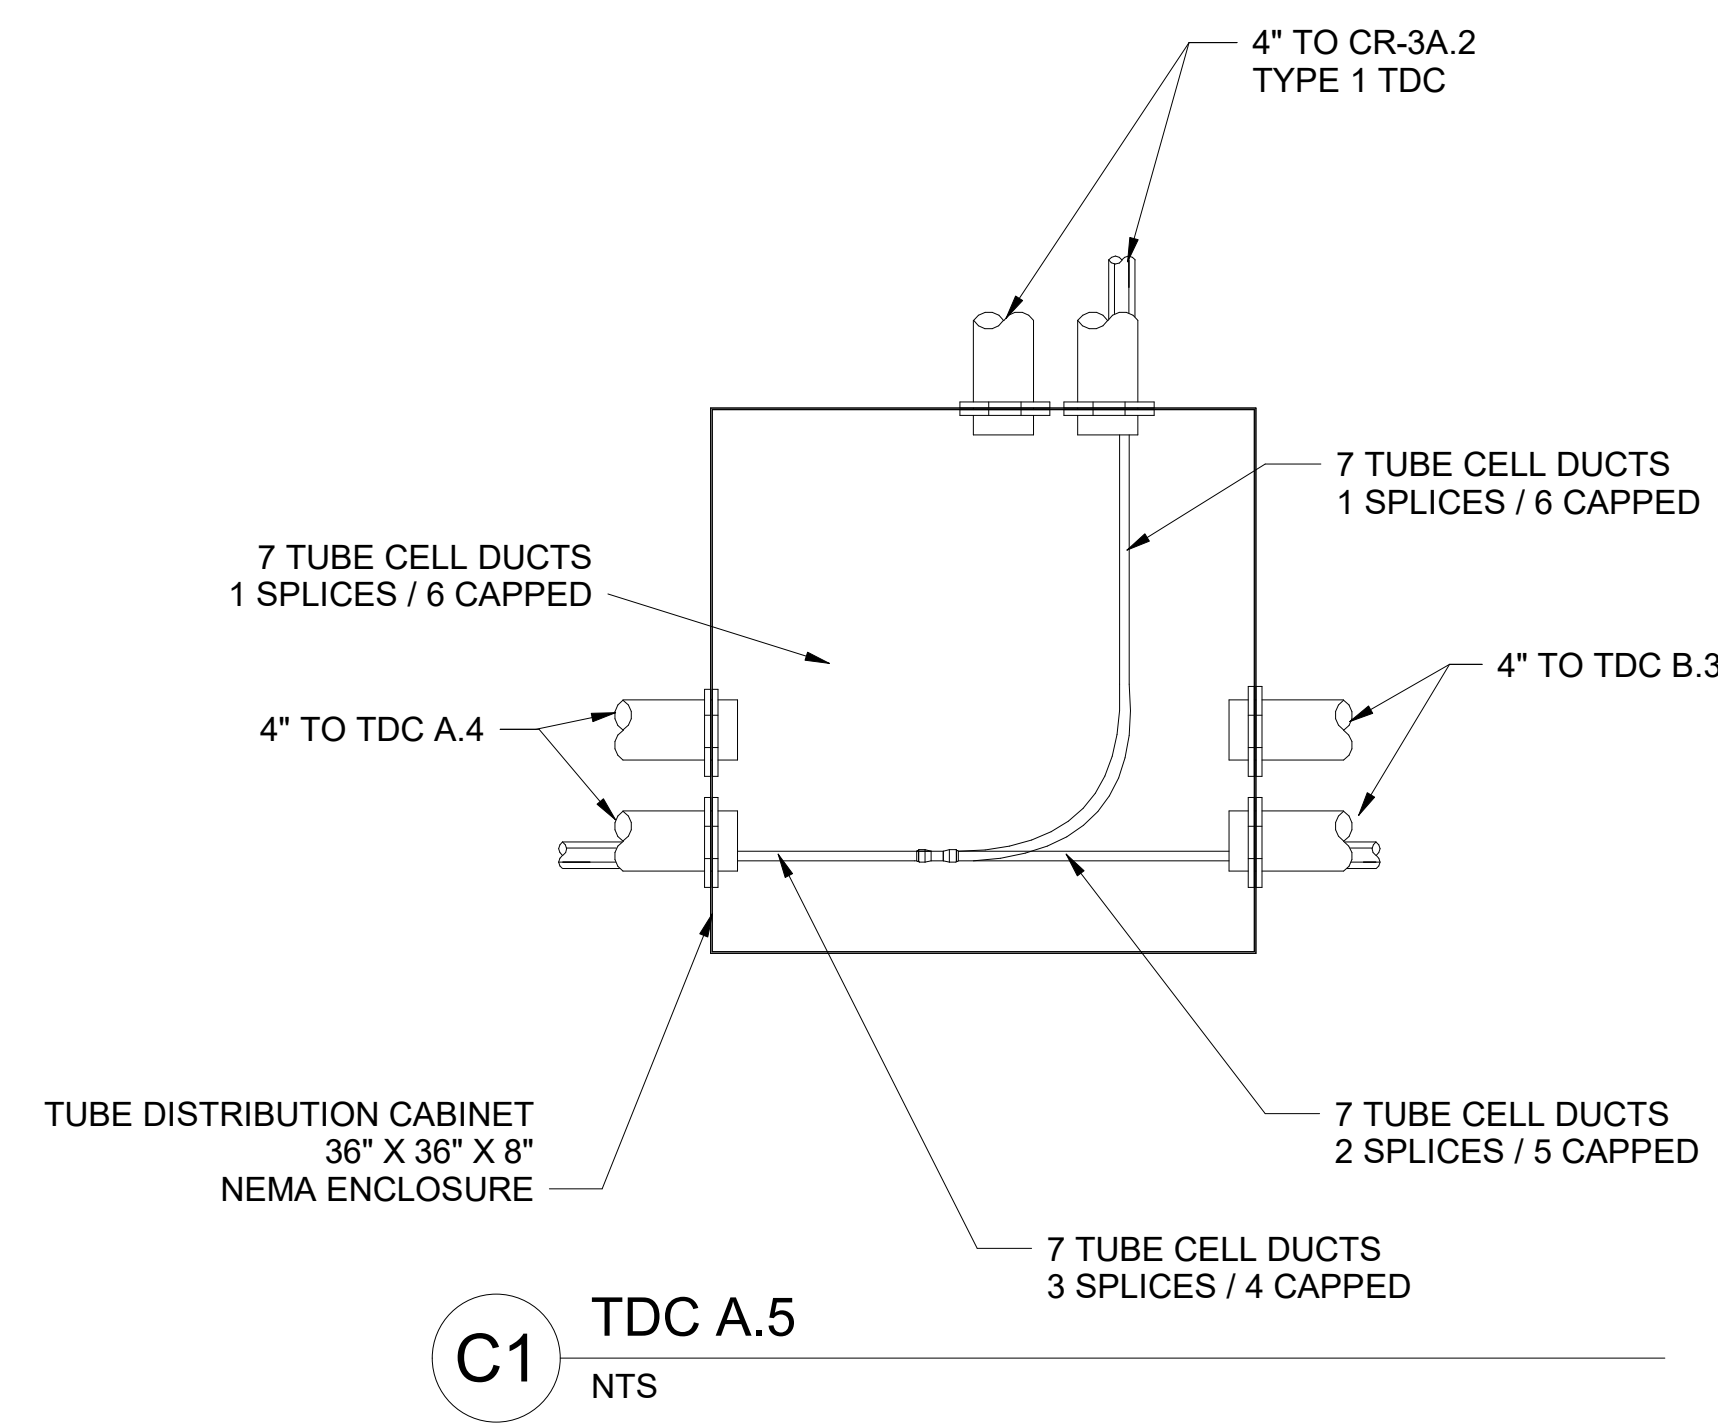

KEY PLAN

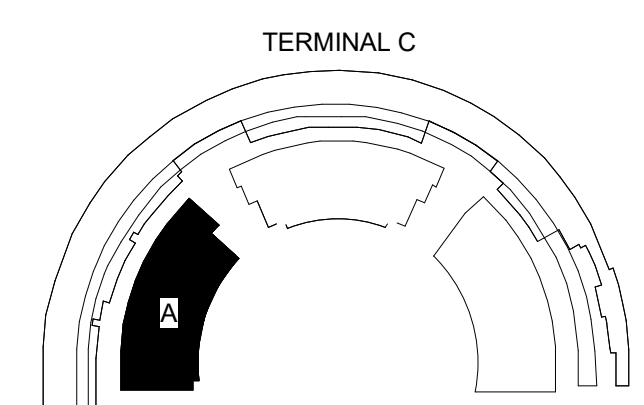

NO.	DATE	DESCRIPTION
2022-01-09	75% DESIGN	
2022-03-01	100% DESIGN	
2022-02-28	100% ISSUED FOR PERMIT (IFP)	

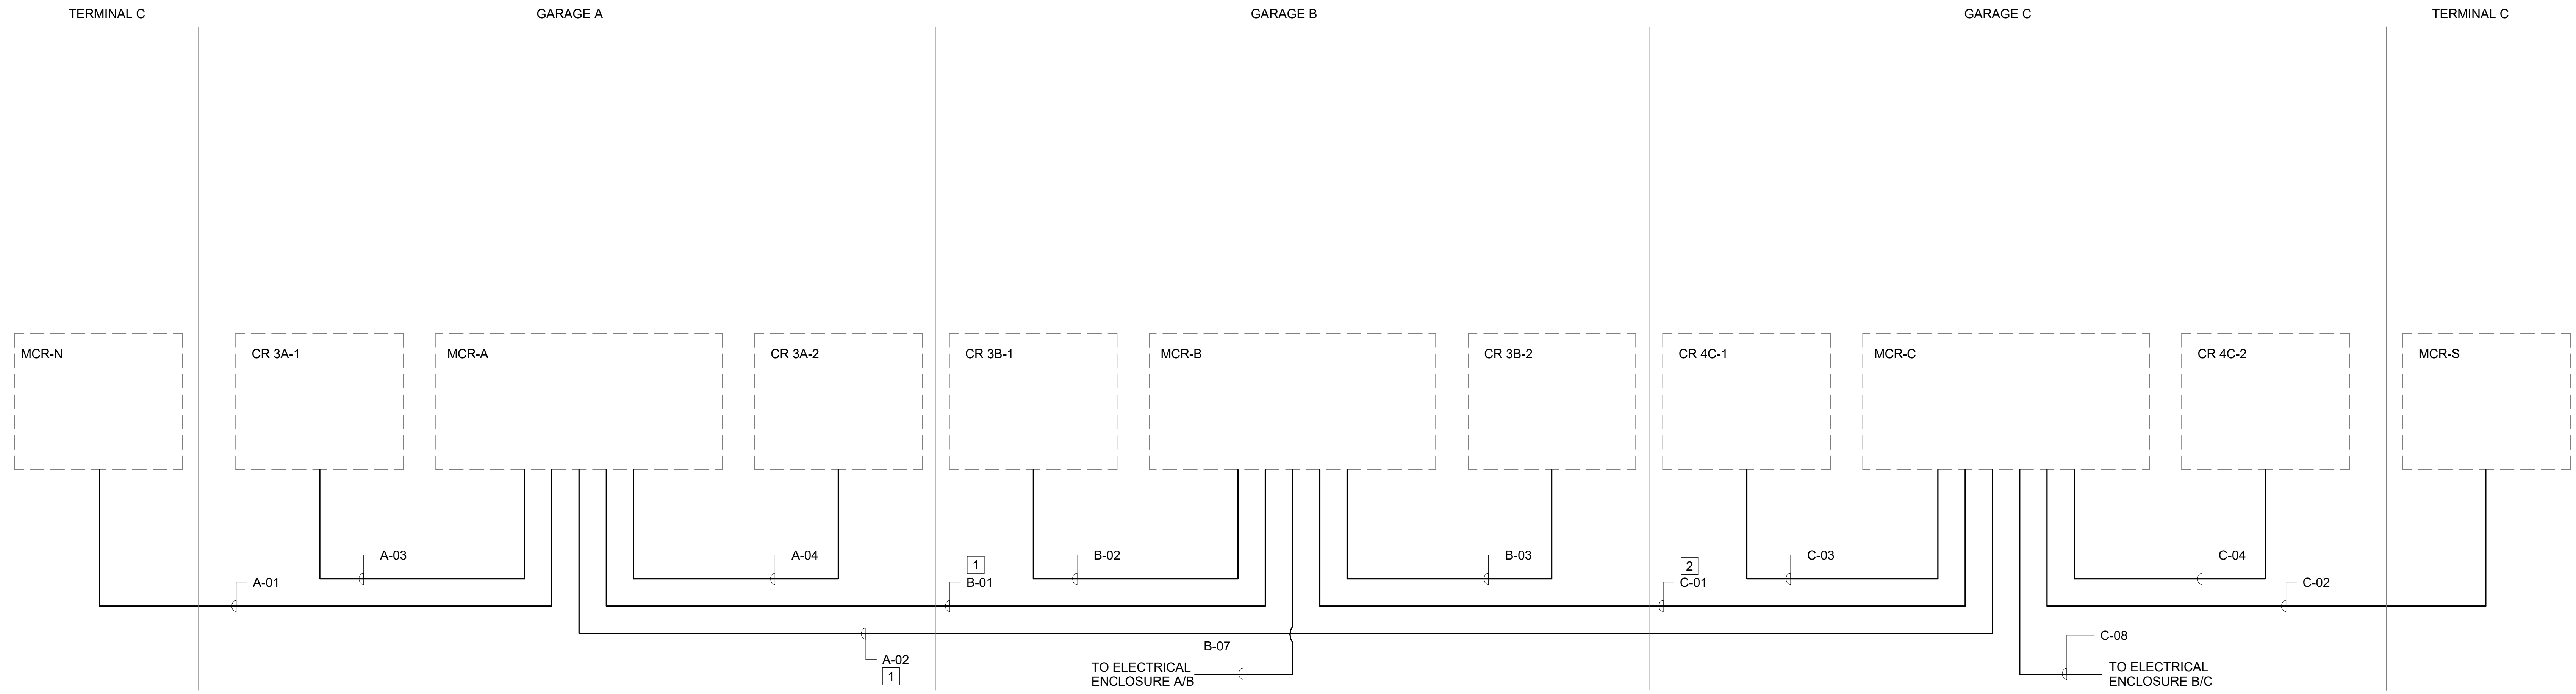



DIAGRAM KEYED NOTES

- 1 BACKBONE CABLE B-01 AND A-02 TO BE INSTALLED IN PHASE 3 WITH RENOVATIONS TO GARAGE A.
- 2 BACKBONE CABLE C-01 TO BE INSTALLED IN PHASE 2 WITH RENOVATIONS TO GARAGE B.
- 3 CONTRACTOR SHALL COORDINATE PATHWAY TO MCR-N AND MCR-S WITH TERMINAL RENOVATION CONTRACTOR AND COORDINATE FINAL TERMINATION LOCATIONS WITH DFW ITS.

A1 BACKBONE FIBER OPTIC CABLE DIAGRAM
NTS

CABLE ID	BACKBONE TYPE	STRUCTURED CABLING SYSTEM BACKBONE CABLE SCHEDULE								NOTES
		CABLE		FROM ROOM		TO ROOM		PATHWAY ID		
		STRANDS	TYPE	ROOM NUMBER	DEVICE NUMBER	ROOM NUMBER	DEVICE NUMBER			
A-01	MCR TO MCR	72	SMFO	MCR-N	TBD	MCR-A	C.1	A-C01 / C02 / C05	SEE KEYED NOTE 3	
A-02	MCR TO MCR	48	SMFO	MCR-A	C.1	MCR-C	C.1	A-C05 / C03, B-C01 / C02 / C03, C-C01 / C02 / C05		
A-03	MCR TO CR	48	SMFO	MCR-A	C.1	CR 3A-1	C.1	A-C05 / C02 / C04		
A-04	MCR TO CR	48	SMFO	MCR-A	C.1	MCR-A	C.1	A-C05 / C03 / C06		
B-01	MCR TO MCR	72	SMFO	MCR-A	C.1	MCR-B	C.1	A-C05 / C03, B-C01 / C02 / C05		
B-02	MCR TO CR	48	SMFO	MCR-B	C.1	CR 3B-1	C.1	B-C05 / C02 / C04		
B-03	MCR TO CR	48	SMFO	MCR-B	C.1	MCR-B	C.1	B-C05 / C03 / C06		
B-07	MCR TO TE	12	SMFO	MCR-B	C.1	A/B ELEC VAULT	C.1	B-C07		
C-01	MCR TO MCR	72	SMFO	MCR-B	C.1	MCR-C	C.1	B-C05 / C03, C-C01		
C-02	MCR TO MCR	72	SMFO	MCR-S	TBD	MCR-C	C.1	C-C02	SEE KEYED NOTE 3	
C-03	MCR TO CR	48	SMFO	MCR-C	C.1	CR 4C-1	C.1	C-C03		
C-04	MCR TO CR	48	SMFO	MCR-C	C.1	MCR-C	C.1	C-C04		
C-08	MCR TO TE	12	SMFO	MCR-C	C.1	B/C ELEC VAULT	C.1	C-C08		

KEY PLAN

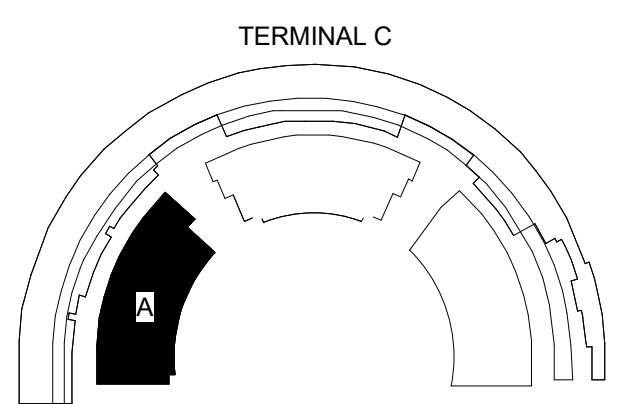

NO.	DATE	DESCRIPTION
1	2021-10-23	30% DESIGN
2	2022-01-06	70% DESIGN
3	2022-03-01	100% DESIGN
4	2022-07-28	100% ISSUED FOR PERMIT (IFP)

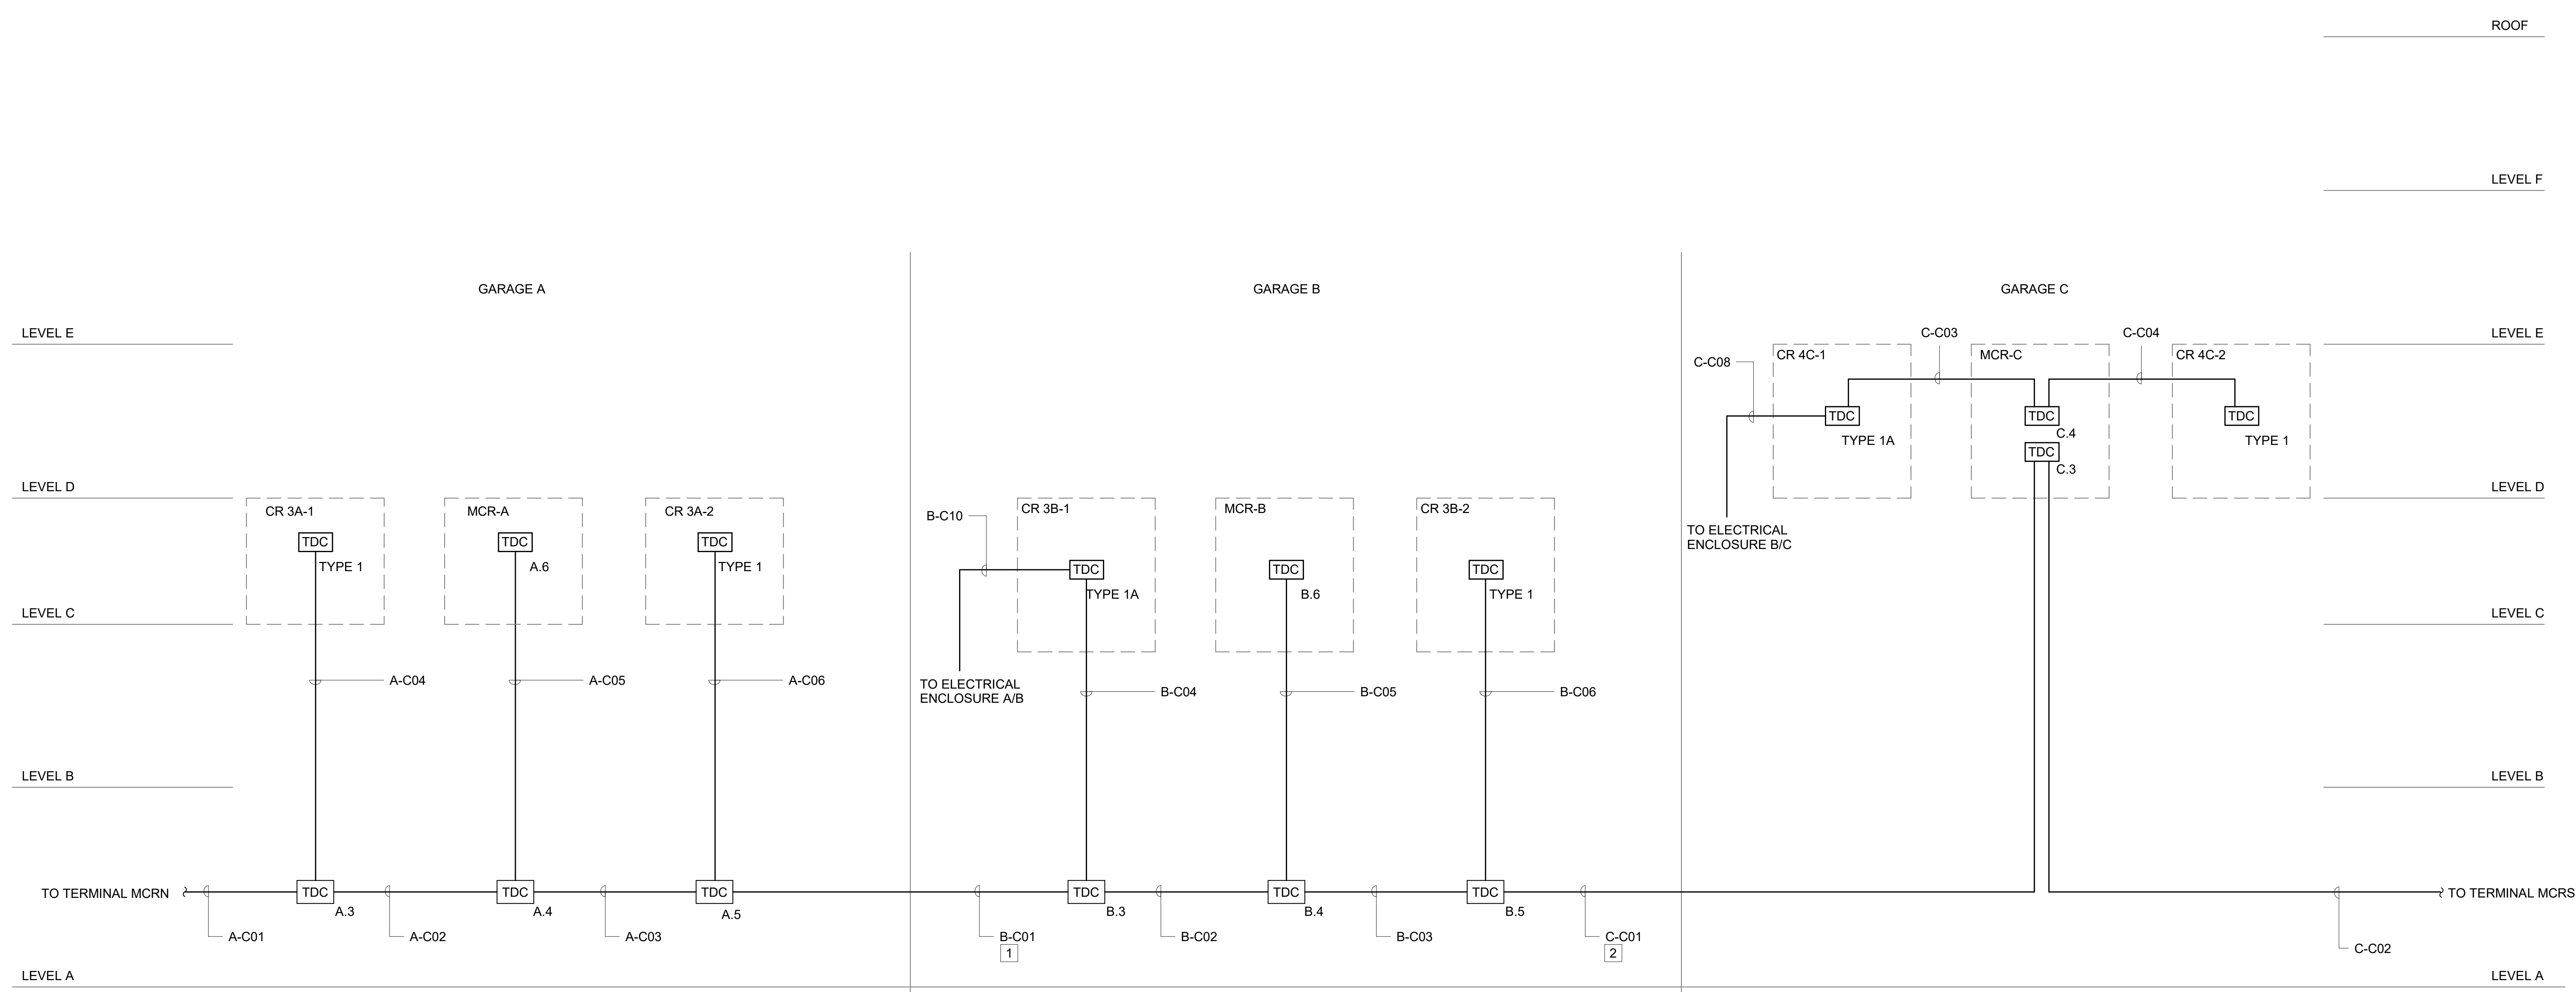



DIAGRAM KEYED NOTES

- 1 BACKBONE PATHWAY B-C01 PARTIAL CONSTRUCTED IN PHASE 2 ALONG WITH THE RENOVATION OF GARAGE B AND COMPLETED IN PHASE 3 WITH THE RENOVATION OF GARAGE A. REFER TO SHEET TN131A-900B FOR FURTHER INFORMATION.
- 2 BACKBONE PATHWAY C-C01 PARTIAL CONSTRUCTED IN PHASE 1 ALONG WITH THE CONSTRUCTION OF GARAGE C AND COMPLETED IN PHASE 2 WITH THE RENOVATION OF GARAGE B. REFER TO SHEET TN131B-900B FOR FURTHER INFORMATION.


A1 BACKBONE PATHWAYS RISER DIAGRAM
NTS

STRUCTURED CABLING SYSTEM BACKBONE PATHWAY SCHEDULE						
PATHWAY ID	FROM ROOM	TO ROOM	PATHWAY TYPE	AIR-BLOWN FIBER TUBE CELLS	ASSOCIATED CABLE ID(S)	NOTES
A-C01	TERM C MCR-N	TDC A.3	(2) 4" RMC	(1) 7-CELL	A-01	
A-C02	TDC A.3	TDC A.4	(2) 4" RMC	(1) 7-CELL	A-01 / 03	
A-C03	TDC A.4	TDC A.5	(2) 4" RMC	(1) 7-CELL	A-02 / 04, B-01	
A-C04	TDC A.3	CR 3A-1	(2) 4" RMC	(1) 7-CELL	A-03 /	
A-C05	TDC A.4	MCR-A (TDC A.6)	(2) 4" RMC	(1) 7-CELL	A-01 / 02 / 03 / 04, B-01	
A-C06	TDC A.5	MCR-A	(2) 4" RMC	(1) 7-CELL	A-04	
A-C10	TDC A.5	A/B ELEC VAULT	(1) 2" RMC	(1) 4-CELL	A-08	
B-C01	TDC A.5	TDC B.3	(2) 4" RMC	(1) 7-CELL	A-02, B-01	
B-C02	TDC B.3	TDC B.4	(2) 4" RMC	(1) 7-CELL	A-02, B-01 / 02	
B-C03	TDC B.4	TDC B.5	(2) 4" RMC	(1) 7-CELL	A-02, B-03, C-01	
B-C04	TDC B.3	CR 2B-1	(2) 4" RMC	(1) 7-CELL	B-02	
B-C05	TDC B.4	MCR-B (TDC B.6)	(2) 4" RMC	(1) 7-CELL	B-01 / 02 / 03 / 04, C-01	
B-C06	TDC B.5	MCR-B	(2) 4" RMC	(1) 7-CELL	B-03	
B-C07	TDC TYPE 1A	ELECTRICAL ENCLOSURE A/B	(2) 4" RMC	(1) 7-CELL	B-07	
C-C01	TDC B.5	MCR-C (TDC C.3)	(2) 4" RMC	(1) 7-CELL	A-02, C-01	
C-C02	MCR-C (TDC C.3)	TERM C MCR-S	(2) 4" RMC	(1) 7-CELL	C-02	
C-C03	MCR-C (TDC C.4)	CR 4C-1	(2) 4" RMC	(1) 7-CELL	C-02	
C-C04	MCR-C (TDC C.4)	MCR-C	(2) 4" RMC	(1) 7-CELL	C-04	
C-C08	MCR-C (TDC C.4)	MCR-C	(1) 2" RMC	(1) 7-CELL	C-02	

KEY PLAN

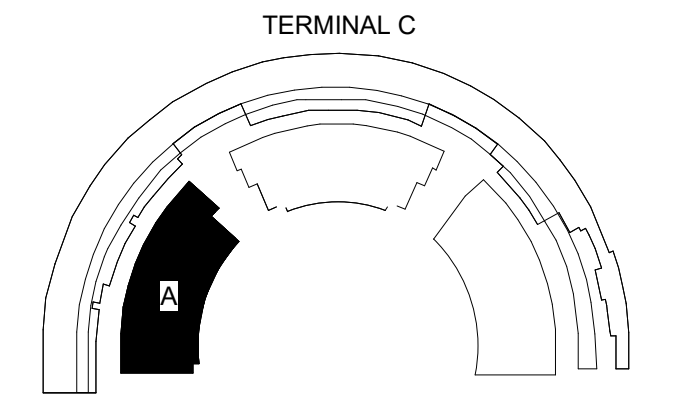

DFW DALLAS FORT WORTH INTERNATIONAL AIRPORT
2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

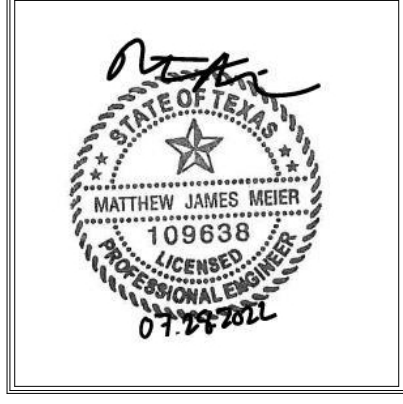

h+k Burns
Burns, Clark & Robinson, Inc. | 1311119-0100
717 South Memorial Street
Dallas, TX 75201
1-214-722-6000


DRAWN BY: BURNS
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NO.	DATE	DESCRIPTION
2021-10-23	30% DESIGN	
2022-01-06	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

NOT FOR BID OR CONSTRUCTION

TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE BACKBONE PATHWAY RISER DIAGRAM
PROJECT NUMBER: TFD-007
PERMIT NUMBER: B22-0022

SHEET NUMBER
TN611-900A

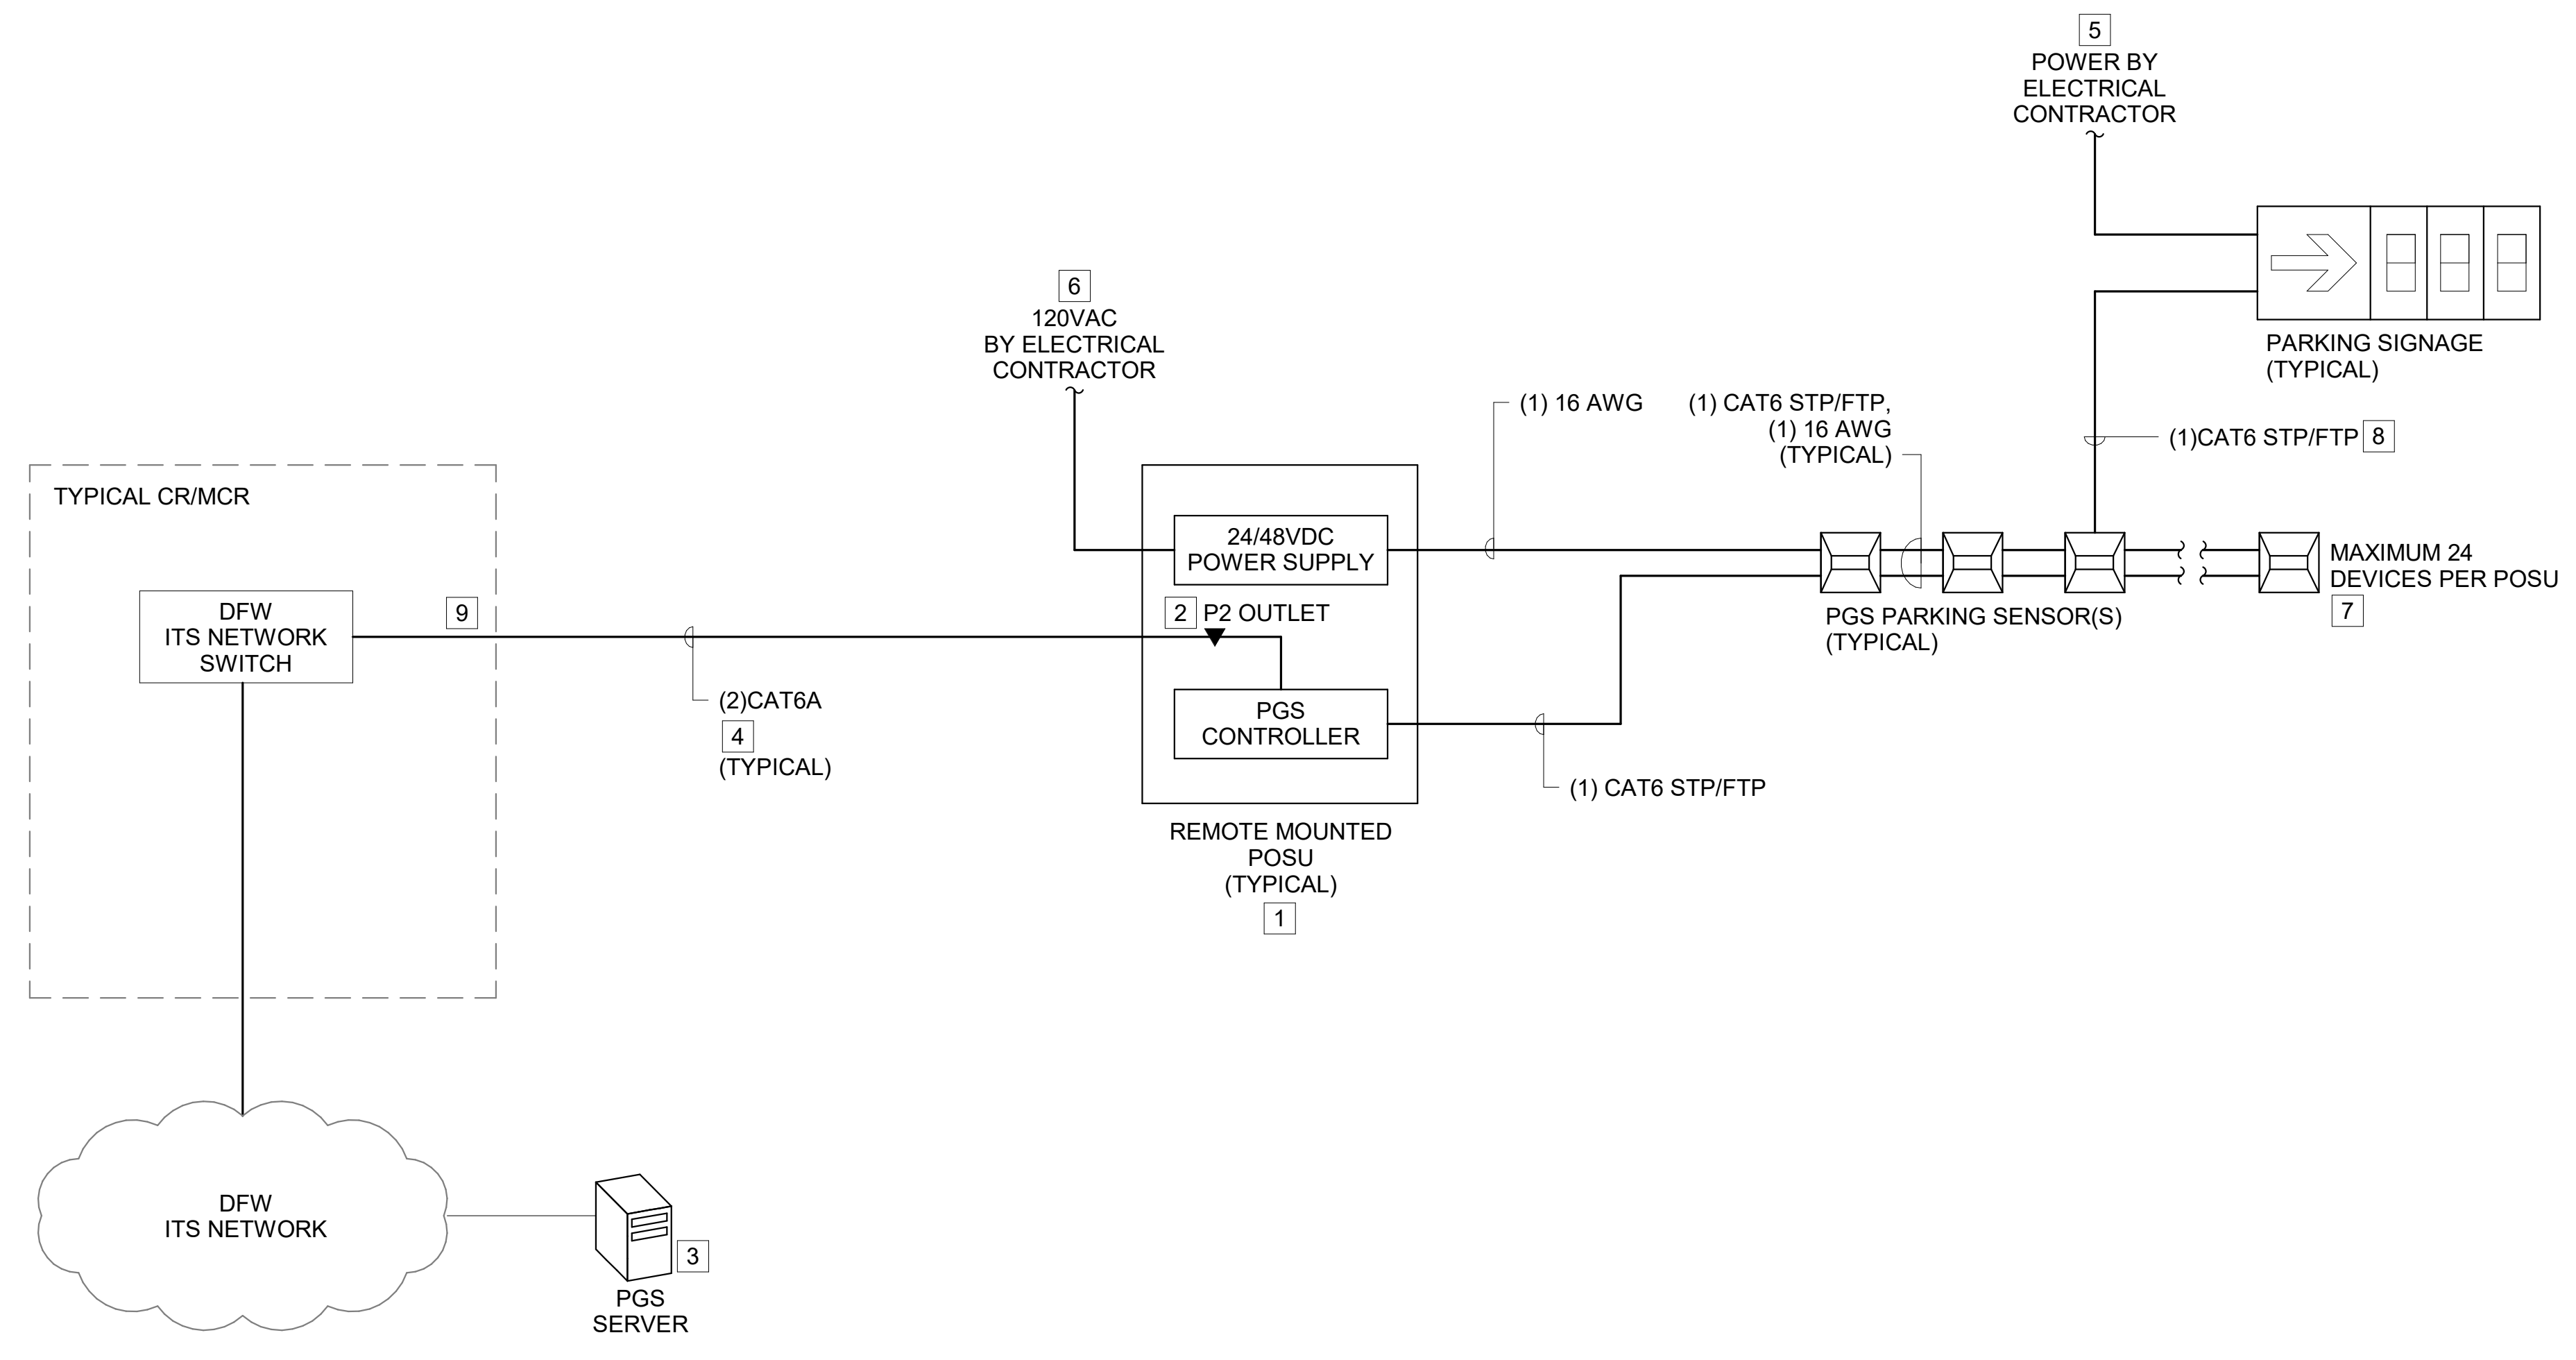

A1 PARKING GUIDANCE SYSTEM - CONNECTIVITY DIAGRAM


NTS

DIAGRAM KEYED NOTES: (THIS DIAGRAM ONLY)


- 1 QUANTITY AND LOCATION OF POSU PER FLOOR PLANS.
- 2 PROVIDE P2 OUTLET PER POSU LOCATION. MOUNT OUTLET INSIDE POSU ENCLOSURE OR EXTERIOR TO THE ENCLOSURE IN A DEDICATED ENCLOSURE. PROVIDE PATCH CORD TO CONNECT UP PGS CONTROLLER AT FIELD AND COMM ROOM LOCATIONS.
- 3 EXISTING PGS SERVER CONNECTED TO DFW ITS NETWORK. COORDINATE WITH DFW TO UPDATE PROGRAMMING AS NECESSARY TO SUPPORT TERMINAL C GARAGES.
- 4 ALL PGS CABLING IN CONDUIT.
- 5 SIGNAGE ELECTRICAL CONNECTION SHOWN FOR REFERENCE ONLY. REFER TO SIGNAGE AND ELECTRICAL DRAWINGS FOR FURTHER INFORMATION.
- 6 POSU ELECTRICAL CONNECTION SHOWN FOR REFERENCE ONLY. REFER TO ELECTRICAL DRAWINGS FOR FURTHER INFORMATION.
- 7 MAXIMUM OF 24 DEVICES, INCLUDING CONNECTIONS TO PARKING SIGNS, CAN BE SERVICED OUT OF A SINGLE POSU.
- 8 IF NECESSARY, PROVIDE FIBER AND MEDIA CONVERTERS TO REACH SIGNS BEYOND MAXIMUM COPPER DATA CABLING DISTANCES.
- 9 COPPER DATA CABLING TERMINATIONS AND PATCH CORDS IN CR/MCR OMITTED FOR CLARITY.

GENERAL NOTE

KEY PLAN

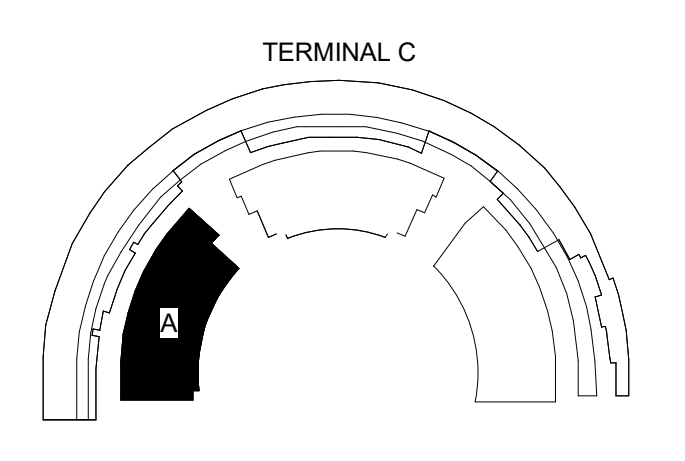

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261

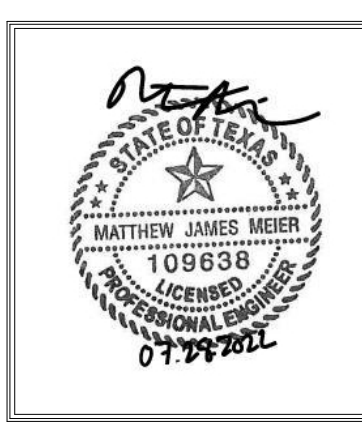

DRAWN BY: BURNS/HOK
APPROVED BY: MM/FR
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2021-10-28	30% DESIGN	
2022-01-09	70% DESIGN	
2022-03-01	100% DESIGN	
2022-07-28	100% ISSUED FOR PERMIT (IFP)	

TERMINAL C GARAGE & ROADWAYS
TELECOM PARKING GUIDANCE SYSTEM DIAGRAM

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER
TN640-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.

GARAGE A DATA OUTLET SCHEDULE					
OUTLET ID	LOCATION	MOUNT TYPE	PORT QTY	COMM ROOM	NOTES
A-AA01	LANE 1	W	2	3A-1	
A-AA02	LANE 4 STAIR #4 WALKWAY	S	1	MCR-A	
A-AA03	LANE 1	W	2	3A-1	
A-AA04	LANE 1	W	2	MCR-A	
A-AA05	LANE 1	W	2	MCR-A	
A-AA06	LANE 2	W	2	3A-1	
A-AA07	LANE 2	W	2	3A-1	
A-AA08	LANE 1 STAIR #7 WALKWAY	S	2	3A-1	
A-AA09	EXIT	S	1	3A-1	
A-AA11	LANE 4 STAIR #6 WALKWAY	S	1	3A-1	
A-AA12	LANE 2	S	1	3A-1	
A-AA13	LANE 2	W	2	MCR-A	
A-AA14	LANE 2	W	2	MCR-A	
A-AA15	LANE 1	W	2	MCR-A	
A-AA16	LANE 2	W	2	MCR-A	
A-AA19	STAIR #7	E	2	3A-1	
A-AA20	STAIR #6	E	2	3A-1	
A-AA21	STAIR #4	E	2	MCR-A	
A-AA22	STAIR #5	E	2	MCR-A	
A-AA23	LANE 2	P	2	3A-1	
A-AA24	LANE 3	P	2	3A-1	
A-AA29	ELEC	P	2	3A-1	
A-AA30	LANE 1 STAIR #5 WALKWAY	S	1	3A-1	
A-AA31	LANE 2 STAIR #5 WALKWAY	S	1	3A-1	
A-AB01	LANE 1	W	2	3A-2	
A-AB02	LANE 1	W	2	3A-2	
A-AB03	LANE 1 STAIR #2 WALKWAY	S	2	3A-2	
A-AB04	ENTRANCE	S	1	3A-2	
A-AB05	LANE 4 STAIR #1 WALKWAY	S	1	3A-2	
A-AB11	ELEV LOBBY	E	2	MCR-A	
A-AB13	STAIR #1	E	2	3A-2	
A-AB14	STAIR #2	E	2	3A-2	
A-AB15	ELEC A102	P	2	3A-2	
A-AB16	LANE 2	W	2	3A-2	
A-AB17	STAIR #3/LOBBY WALKWAY	S	2	MCR-A	
A-AB25	LANE 3	P	2	MCR-A	
A-AB26	LANE 2	P	2	MCR-A	
A-AB27	LANE 6	P	2	MCR-A	
A-AB28	LANE 6	P	2	MCR-A	
A-BA01	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-BA02	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-BA03	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-BA05	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-BA06	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-BA07	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-BA08	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-BA09	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-BA13	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-BA13	CURBSIDE ARRIVALS ROADWAY	S	2	3A-1	
A-BA14	CURBSIDE ARRIVALS ROADWAY	S	2	3A-1	
A-BA15	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-BA16	CURBSIDE ARRIVALS ROADWAY	S	2	MCR-A	
A-BA17	CURBSIDE ARRIVALS ROADWAY	S	2	MCR-A	
A-BA18	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-BB01	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-BB02	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-BB03	CURBSIDE ARRIVALS ROADWAY	S	2	MCR-A	
A-BB04	ELEV LOBBY	E	2	3A-1	
A-BB05	CURBSIDE ARRIVALS ROADWAY	S	2	MCR-A	
A-BB06	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-BB07	GENERAL OPEN GARAGE AREA	E	2	3A-1	


GARAGE A DATA OUTLET SCHEDULE					
OUTLET ID	LOCATION	MOUNT TYPE	PORT QTY	COMM ROOM	NOTES
A-BB08	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-BB09	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-BB10	CURBSIDE ARRIVALS ROADWAY	S	2	3A-2	
A-BB11	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-BB12	CURBSIDE ARRIVALS ROADWAY	S	2	3A-2	
A-BB13	CURBSIDE ARRIVALS ROADWAY	S	2	3A-2	
A-BB14	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-CA01	GENERAL OPEN GARAGE AREA	W	2	3A-1	
A-CA02	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-CA03	GENERAL OPEN GARAGE AREA	W	2	3A-1	
A-CA08	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-CA09	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-CA10	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-CA11	GENERAL OPEN GARAGE AREA	S	2	3A-1	
A-CA12	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-CA13	GENERAL OPEN GARAGE AREA	W	2	3A-1	
A-CA14	GENERAL OPEN GARAGE AREA	W	2	MCR-A	
A-CA15	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-CA16	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-CA17	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-CA18	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-CA19	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-CA20	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-CA21	GENERAL OPEN GARAGE AREA	S	2	MCR-A	
A-CA22	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-CA23	ELEC	P	2	MCR-A	
A-CA24	GENERAL OPEN GARAGE AREA	S	2	MCR-A	
A-CA25	VALET	B	4	MCR-A	
A-CA26	MCR-B	S	1	MCR-A	
A-CA27	3A-2	S	1	3A-2	
A-CA28	3A-1	P	2	3A-1	
A-CA29	3A-1	A	1	3A-1	
A-CA30	MCR-A	A	1	MCR-A	
A-CA31	3A-2	A	1	3A-2	
A-CA32	3A-1	S	1	3A-1	
A-CA33	3A-2	P	2	3A-2	
A-CA34	MCR-A	P	2	MCR-A	
A-CB01	GENERAL OPEN GARAGE AREA	W	2	3A-2	
A-CB02	GENERAL OPEN GARAGE AREA	W	2	3A-2	
A-CB03	GENERAL OPEN GARAGE AREA	W	2	3A-2	
A-CB09	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-CB10	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-CB11	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-CB13	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-CB14	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-CB15	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-CB16	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-CB17	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-CB18	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-CB19	GENERAL OPEN GARAGE AREA	P	2	3A-2	
A-CB21	ELEC	P	2	3A-2	
A-DA02	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-DA03	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-DA04	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-DA05	CURBSIDE DEPARTURES ROADWAY	S	2	3A-1	
A-DA06	CURBSIDE DEPARTURES ROADWAY	S	2	MCR-A	
A-DA06	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-DA07	CURBSIDE DEPARTURES ROADWAY	S	2	MCR-A	

GARAGE A DATA OUTLET SCHEDULE					
OUTLET ID	LOCATION	MOUNT TYPE	PORT QTY	COMM ROOM	NOTES
A-DA08	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-DA09	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-DA10	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-DA11	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-DA12	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-DA14	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-DA15	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-DA16	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-DA17	GENERAL OPEN GARAGE AREA	P	2	3A-1	
A-DA19	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-DA21	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-DA22	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-DA23	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-DA24	GENERAL OPEN GARAGE AREA	S	1	3A-1	
A-DA25	CURBSIDE DEPARTURES ROADWAY	S	2	3A-1	
A-DA26	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-DB04	CURBSIDE DEPARTURES ROADWAY	S	2	3A-2	
A-DB05	CURBSIDE DEPARTURES ROADWAY	S	2	3A-2	
A-DB06	CURBSIDE DEPARTURES ROADWAY	S	2	3A-2	
A-DB07	CURBSIDE DEPARTURES ROADWAY	S	2	3A-2	
A-DB08	CURBSIDE DEPARTURES ROADWAY	S	2	3A-2	
A-DB09	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-DB10	GENERAL OPEN GARAGE AREA	P	2	MCR-A	
A-DB11	GENERAL OPEN GARAGE AREA	P	2	MCR-A	
A-DB12	GENERAL OPEN GARAGE AREA	P	2	MCR-A	
A-DB13	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-DB14	GENERAL OPEN GARAGE AREA	P	2	MCR-A	
A-EA03	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-EA04	GENERAL OPEN GARAGE AREA	E	2	3A-1	
A-EA05	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-EA06	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-EB02	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-EB03	GENERAL OPEN GARAGE AREA	E	2	3A-2	
A-EB04	ELEV LOBBY A500	E	2	MCR-A	
A-EB06	GENERAL OPEN GARAGE AREA	E	2	MCR-A	
A-EB07	GENERAL OPEN GARAGE AREA	S	1	MCR-A	
A-EB08	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-EB09	GENERAL OPEN GARAGE AREA	S	1	3A-2	
A-EB11	ELEV LOBBY A500	S	1	MCR-A	
A-EB12	MACHINE RM. A501	S	2	MCR-A	
A-EB13	MACHINE RM. A501	P	2	MCR-A	

GENERAL NOTE

LEGEND

KEY PLAN

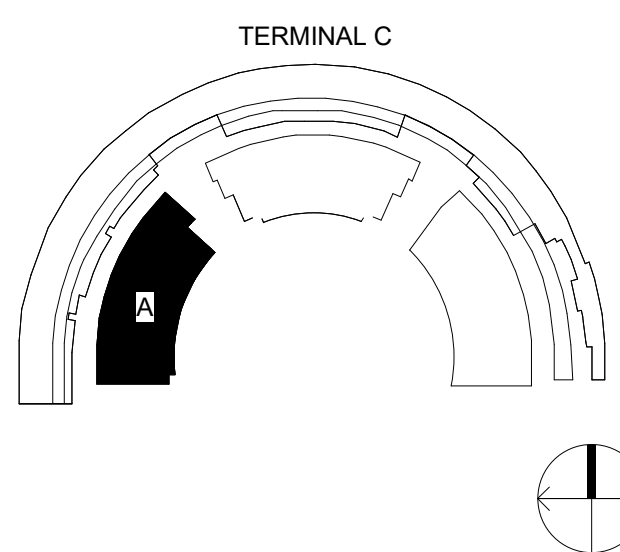

2330 N INTERNATIONAL PARKWAY
DFW AIRPORT, TX 75261



DRAWN BY: KB/DG
APPROVED BY: MM
ISSUE DATE: 2022-07-28

NOT FOR BID OR CONSTRUCTION

NO.	DATE	DESCRIPTION
2022-01-08		75% DESIGN
2022-03-01		100% DESIGN
2022-07-28		100% ISSUED FOR PERMIT (IFP)

TERMINAL C GARAGE & ROADWAYS
TELECOM GARAGE A (PHASE 3) DATA OUTLET SCHEDULE

PROJECT NUMBER: TFD-007

PERMIT NUMBER: B22-0022

SHEET NUMBER

TN801-900A

SCALE(S) AS NOTED ON THIS SHEET ARE BASED ON A FULL SIZE 30 X 42 SHEET.