







FORNLEIFAR




HOLTAVÖRÐUHEIÐARLÍNA 3

SEPTEMBER 2024


LANDSNET

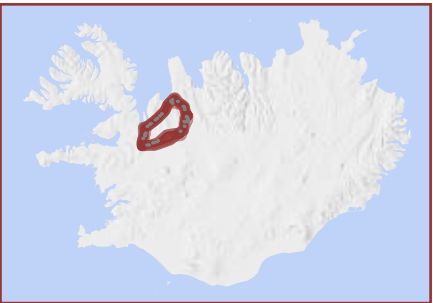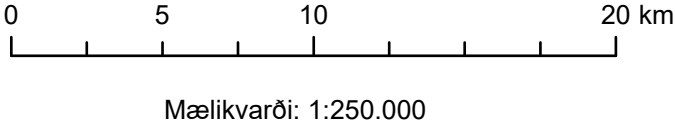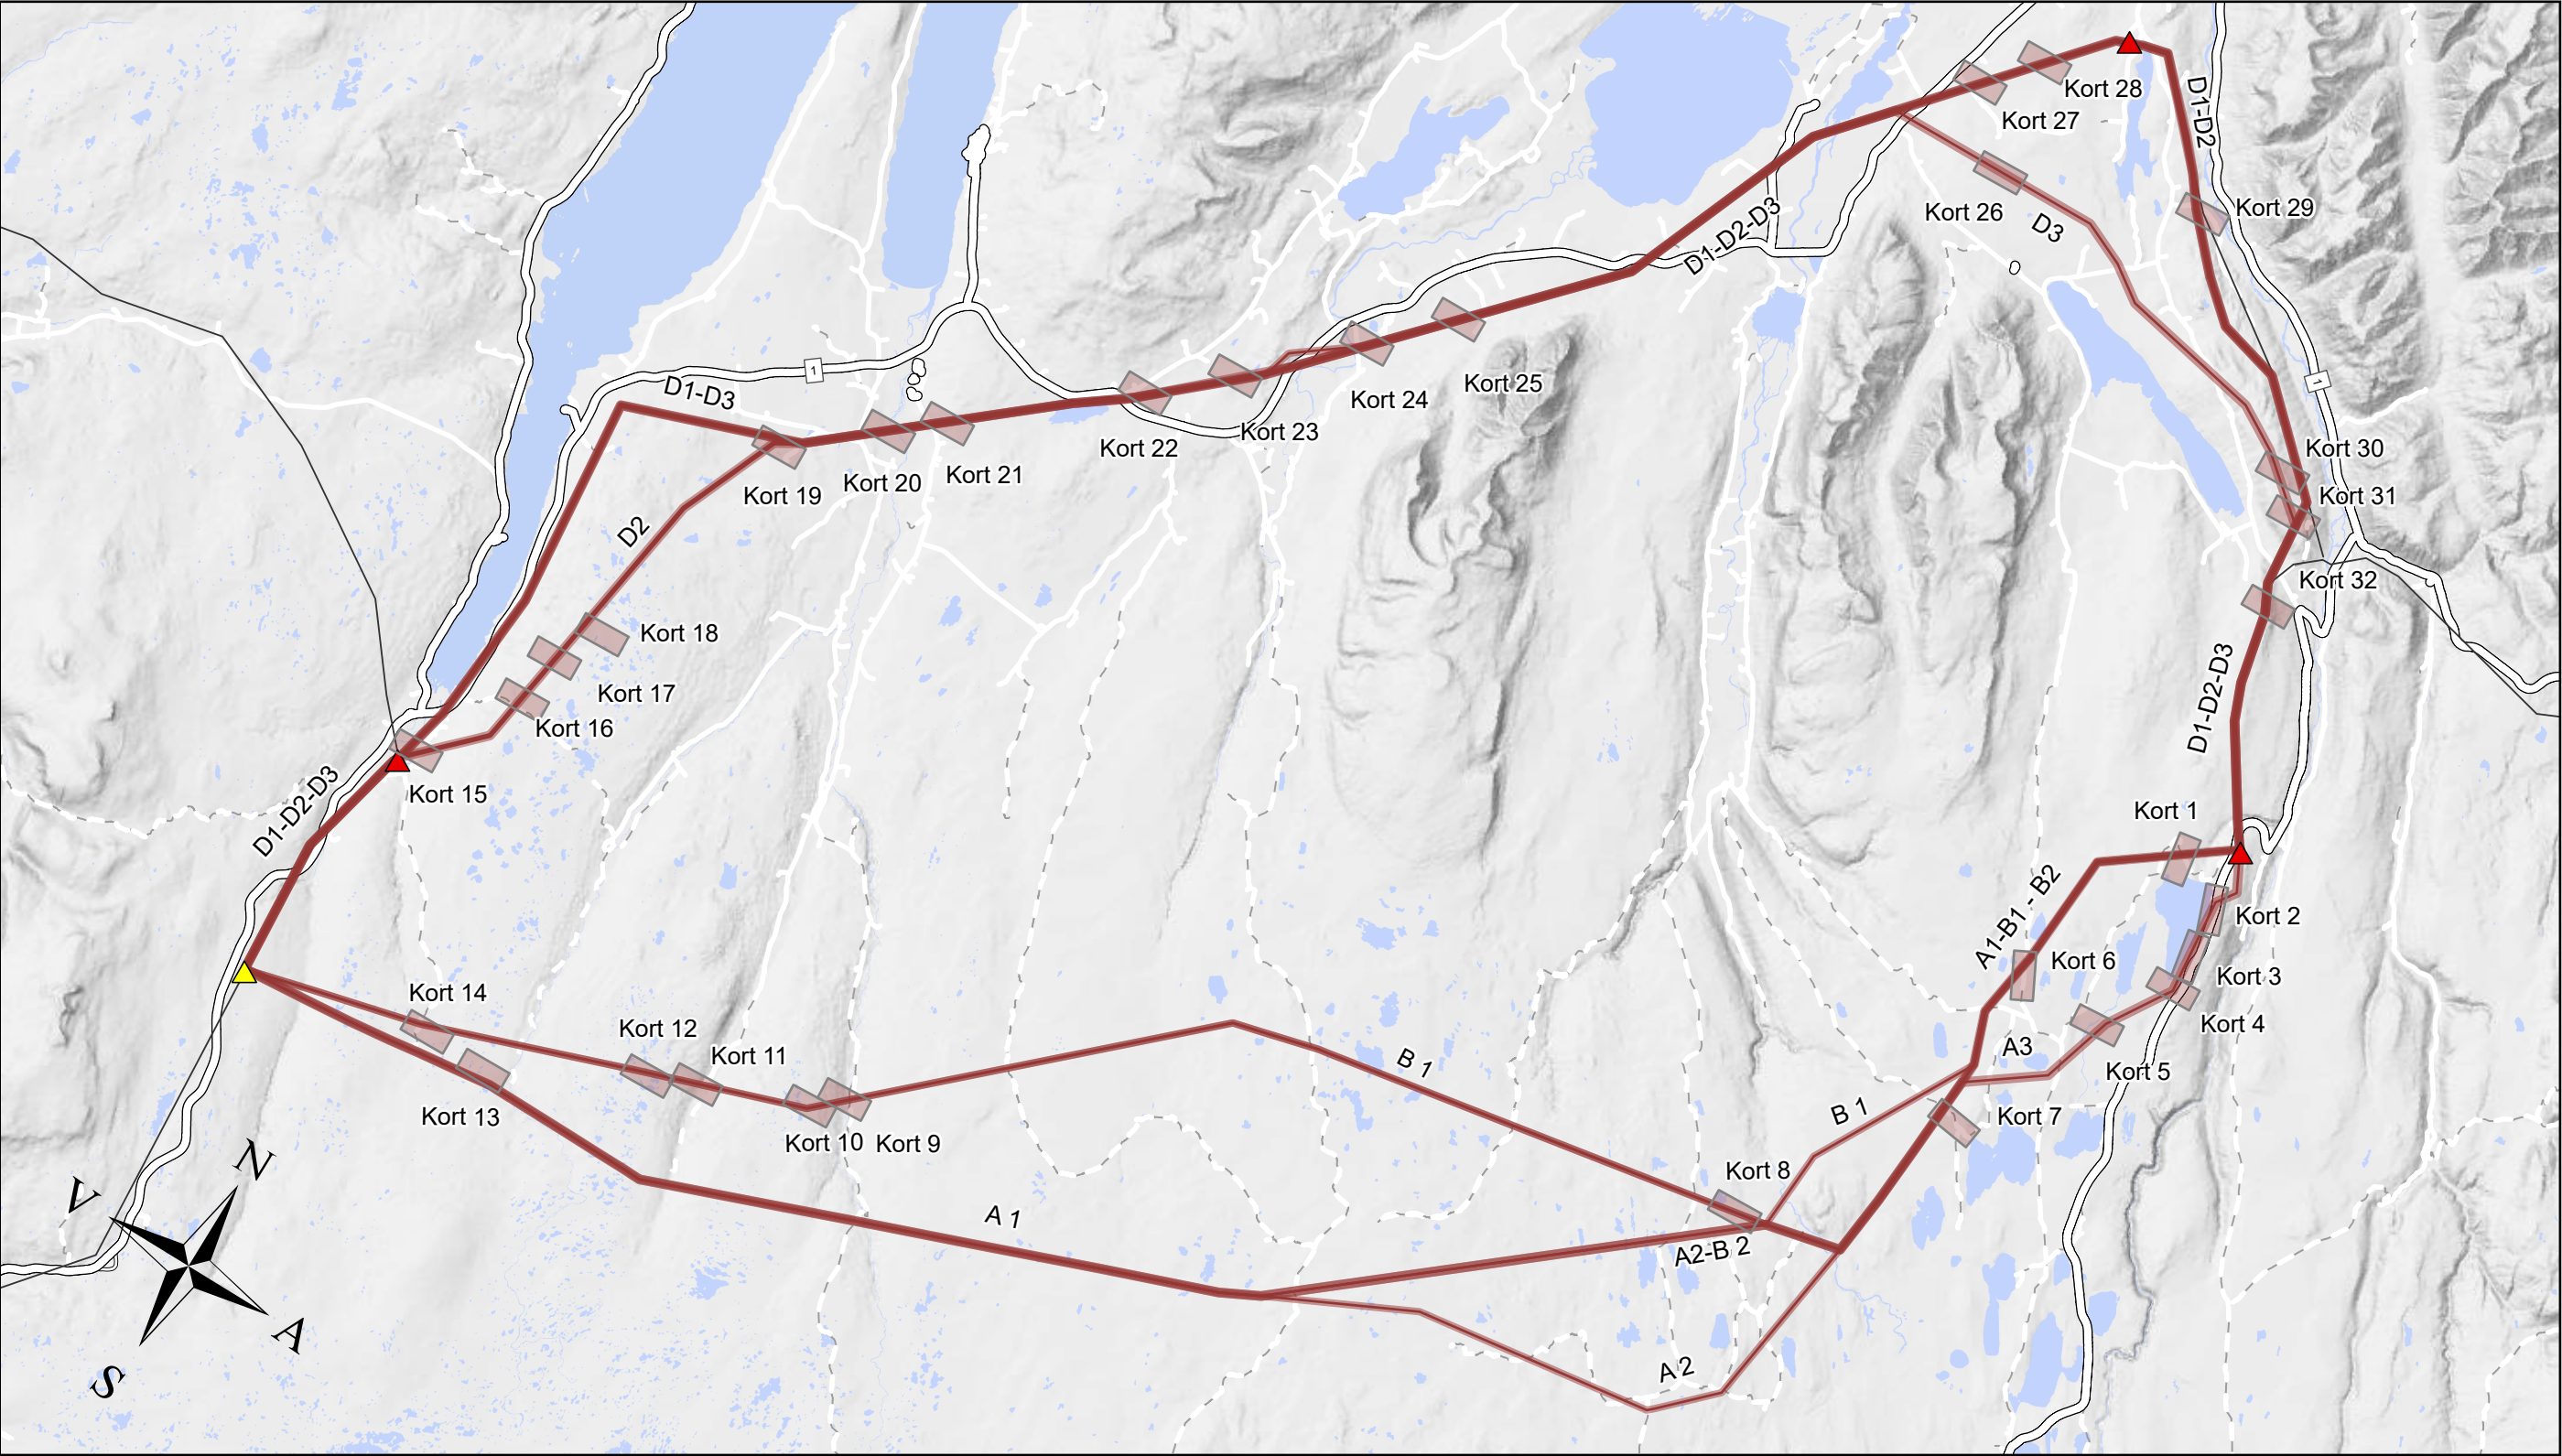

Kort 1

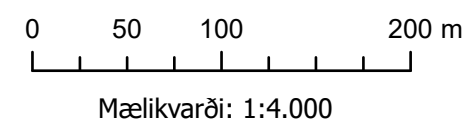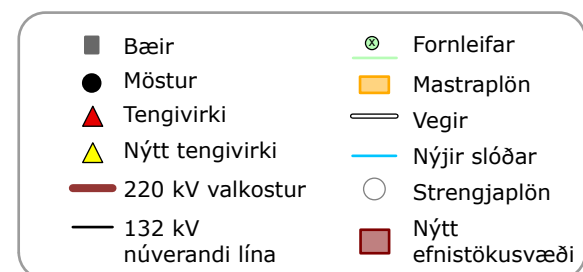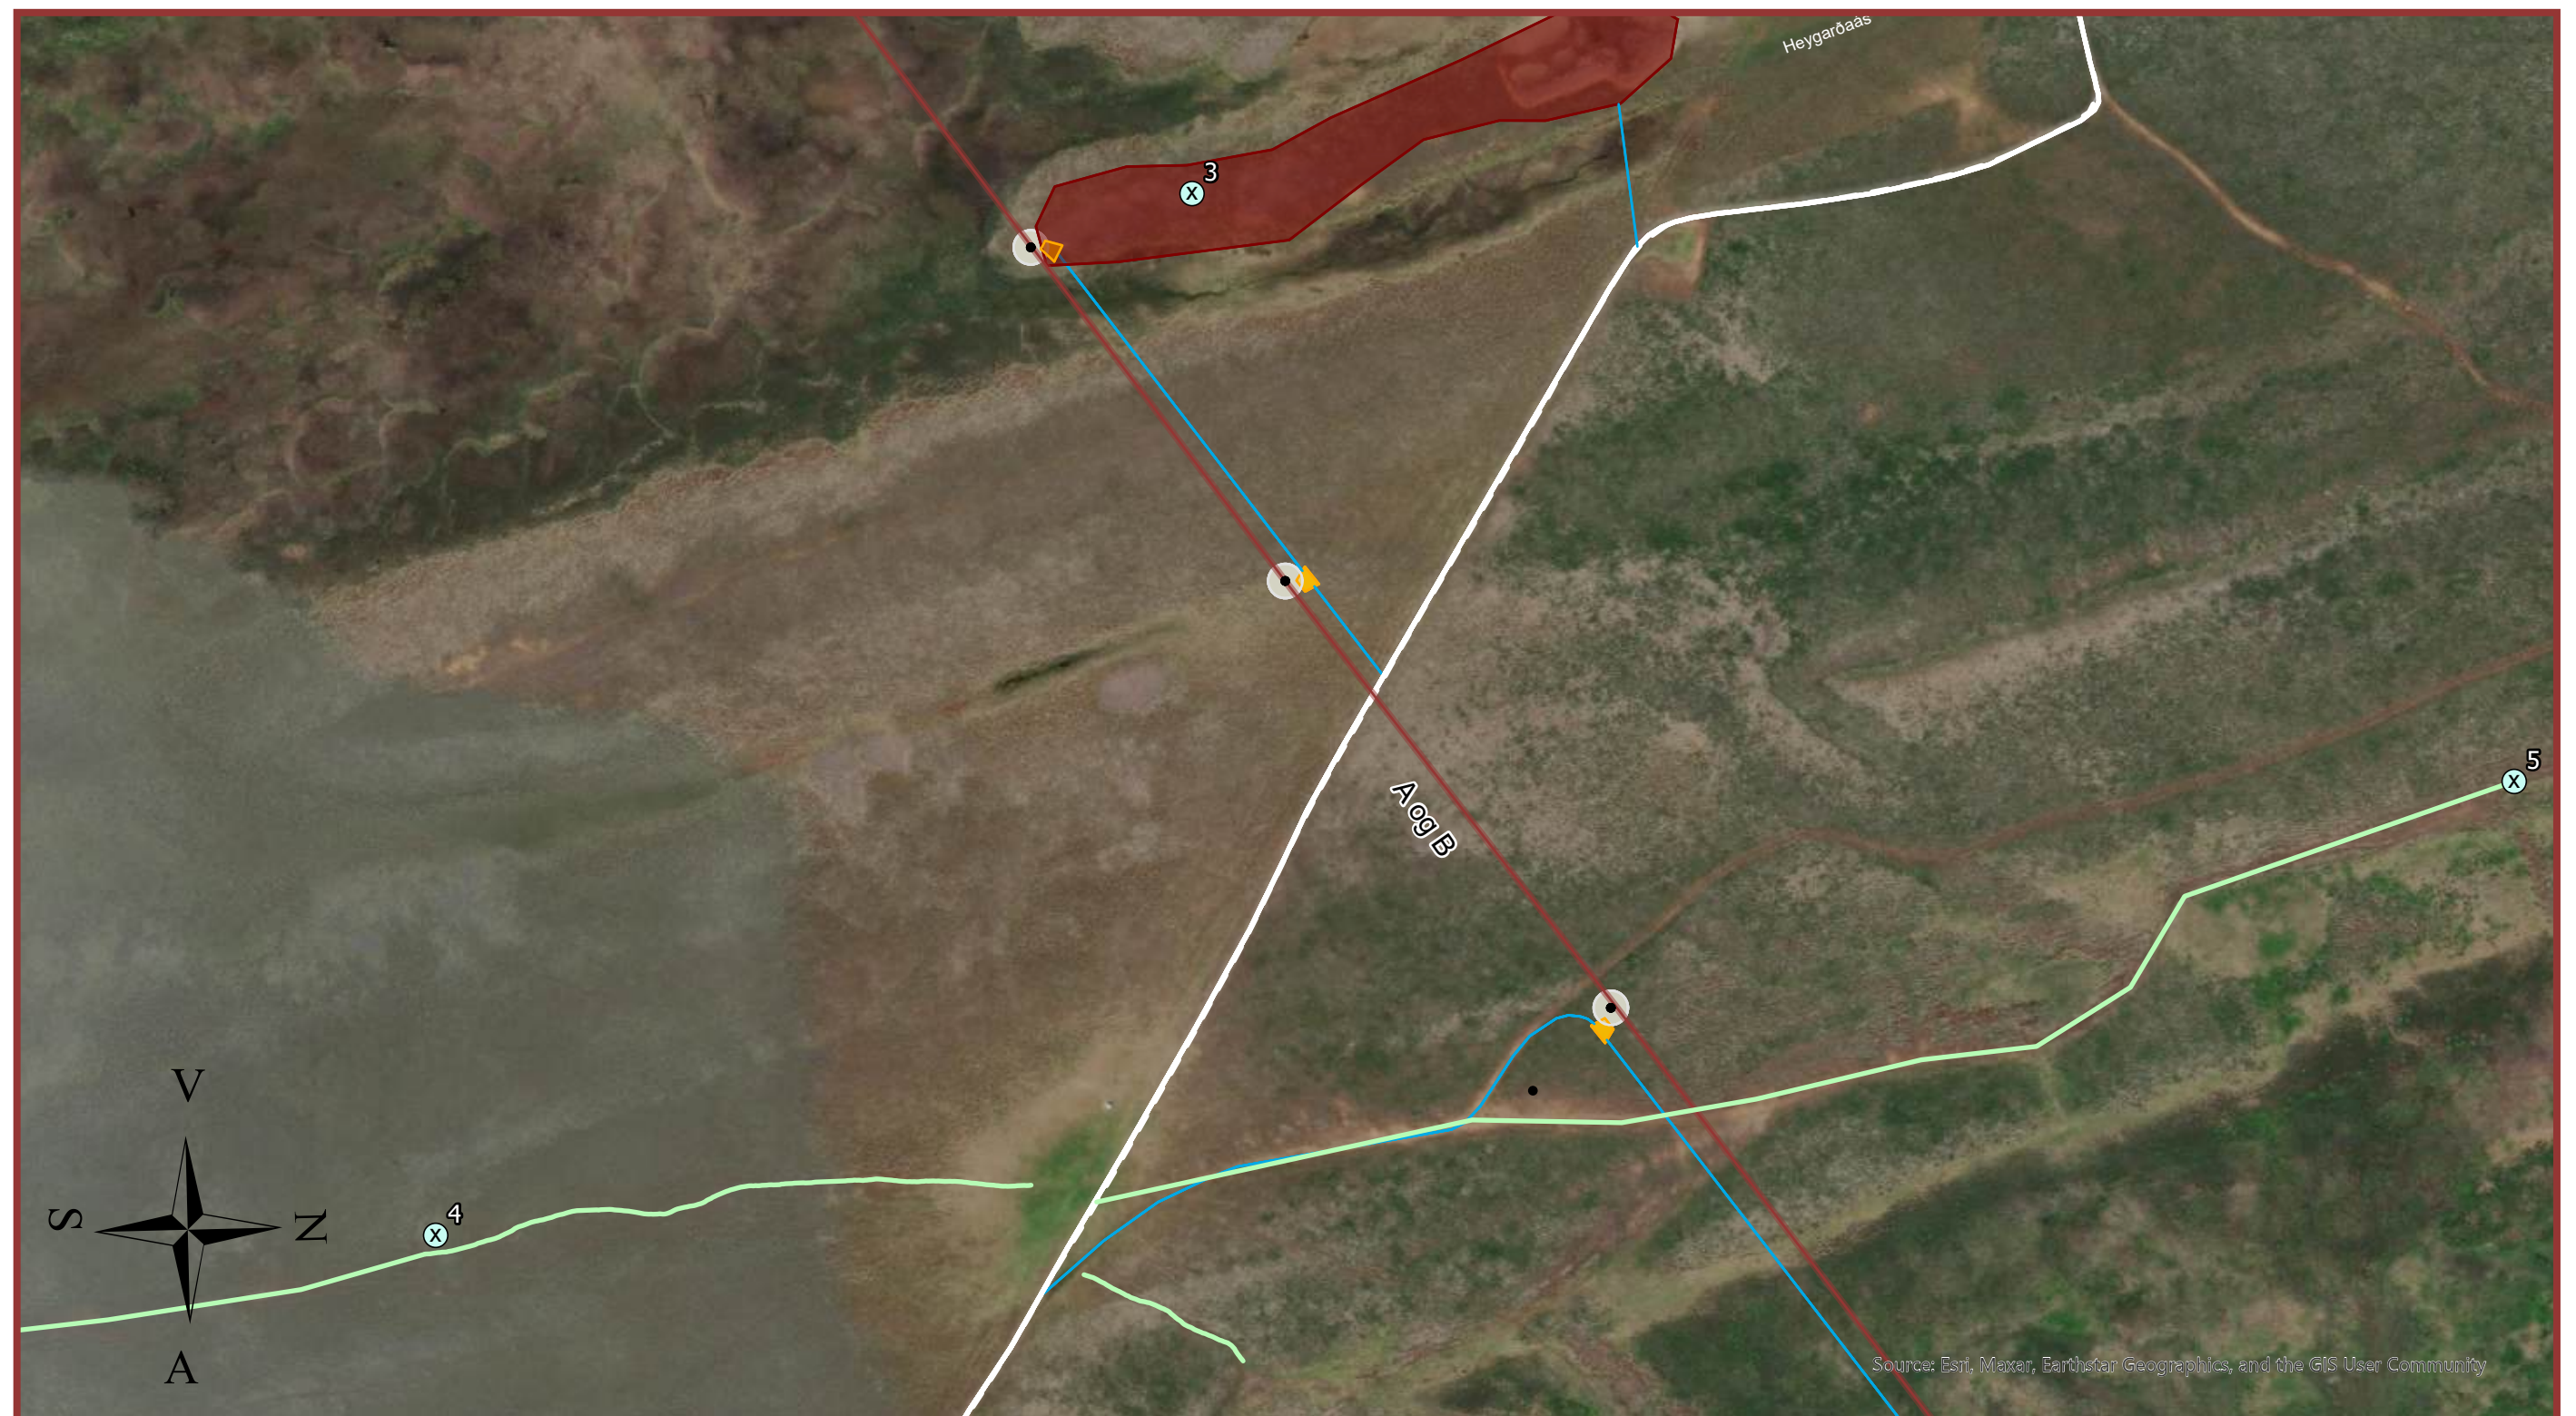

Valkostur A og B

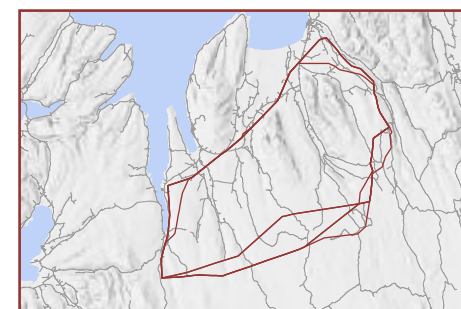


VSÓ RÁÐGJÖF



- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | □ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |


0 50 100 200 m
Mælikvarði: 1:4.000

Valkostur A3

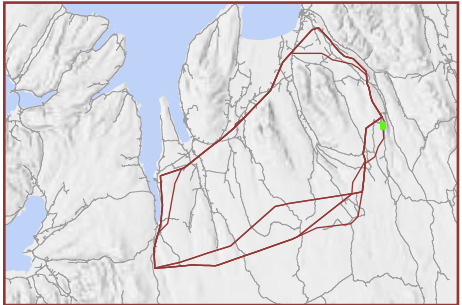




- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |



Valkostur A3

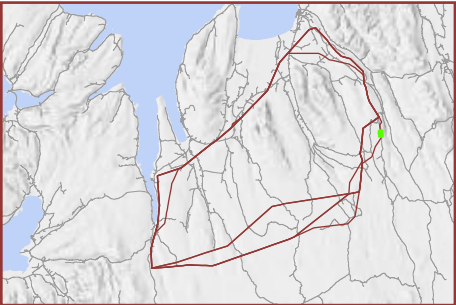





- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |


0 100 200 m
Mælikvarði: 1:4.000

Valkostur A3

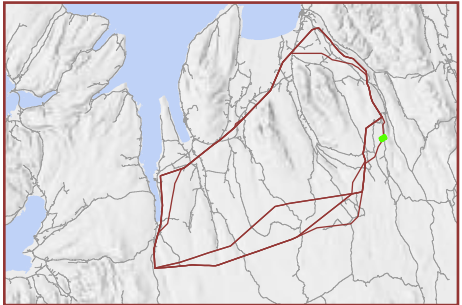


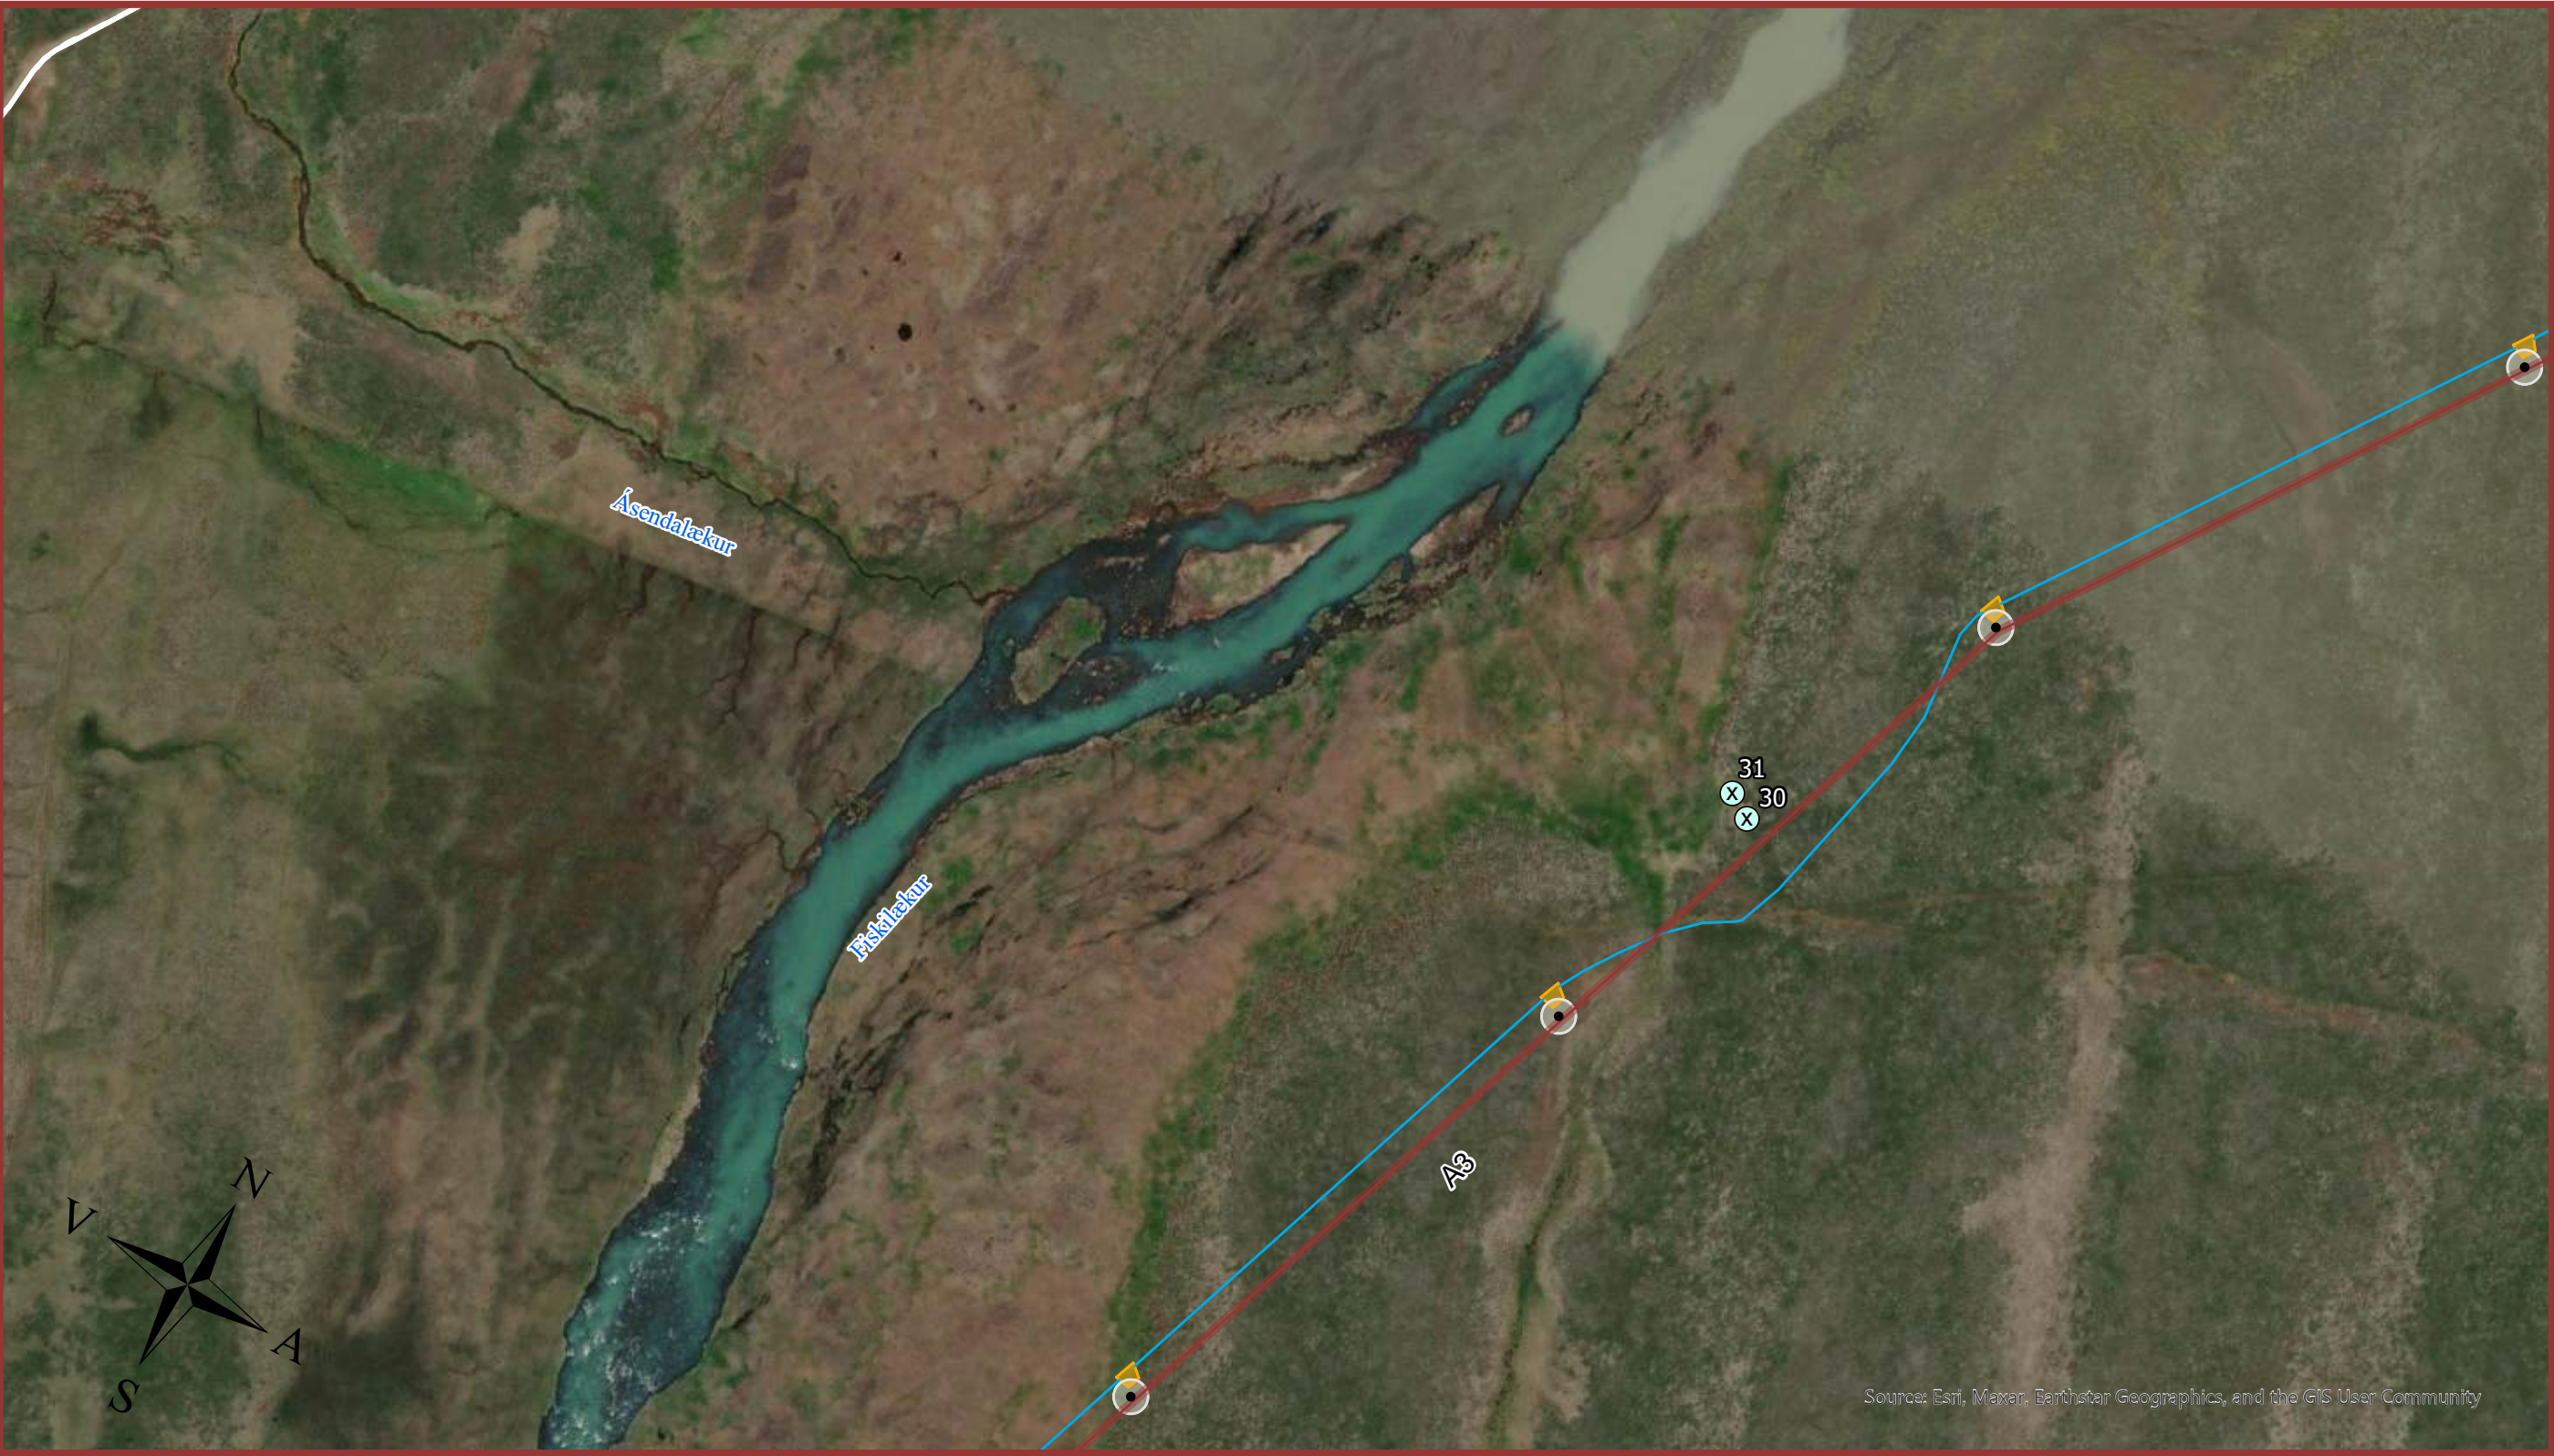

- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |




Valkostur A3

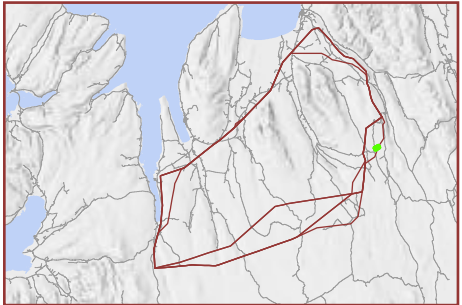






Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community

- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |





Valkostur B

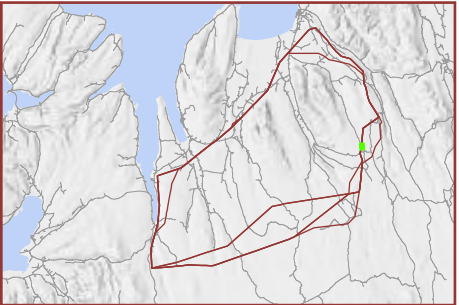

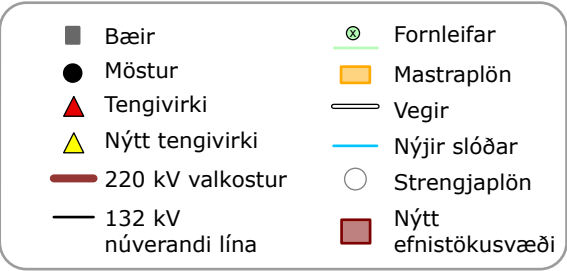

Valkostur A og B2

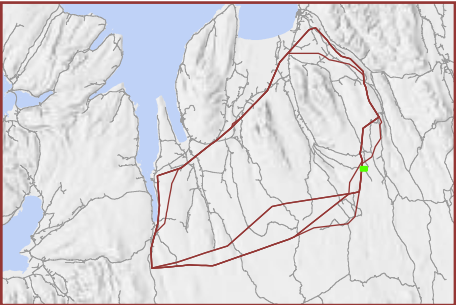

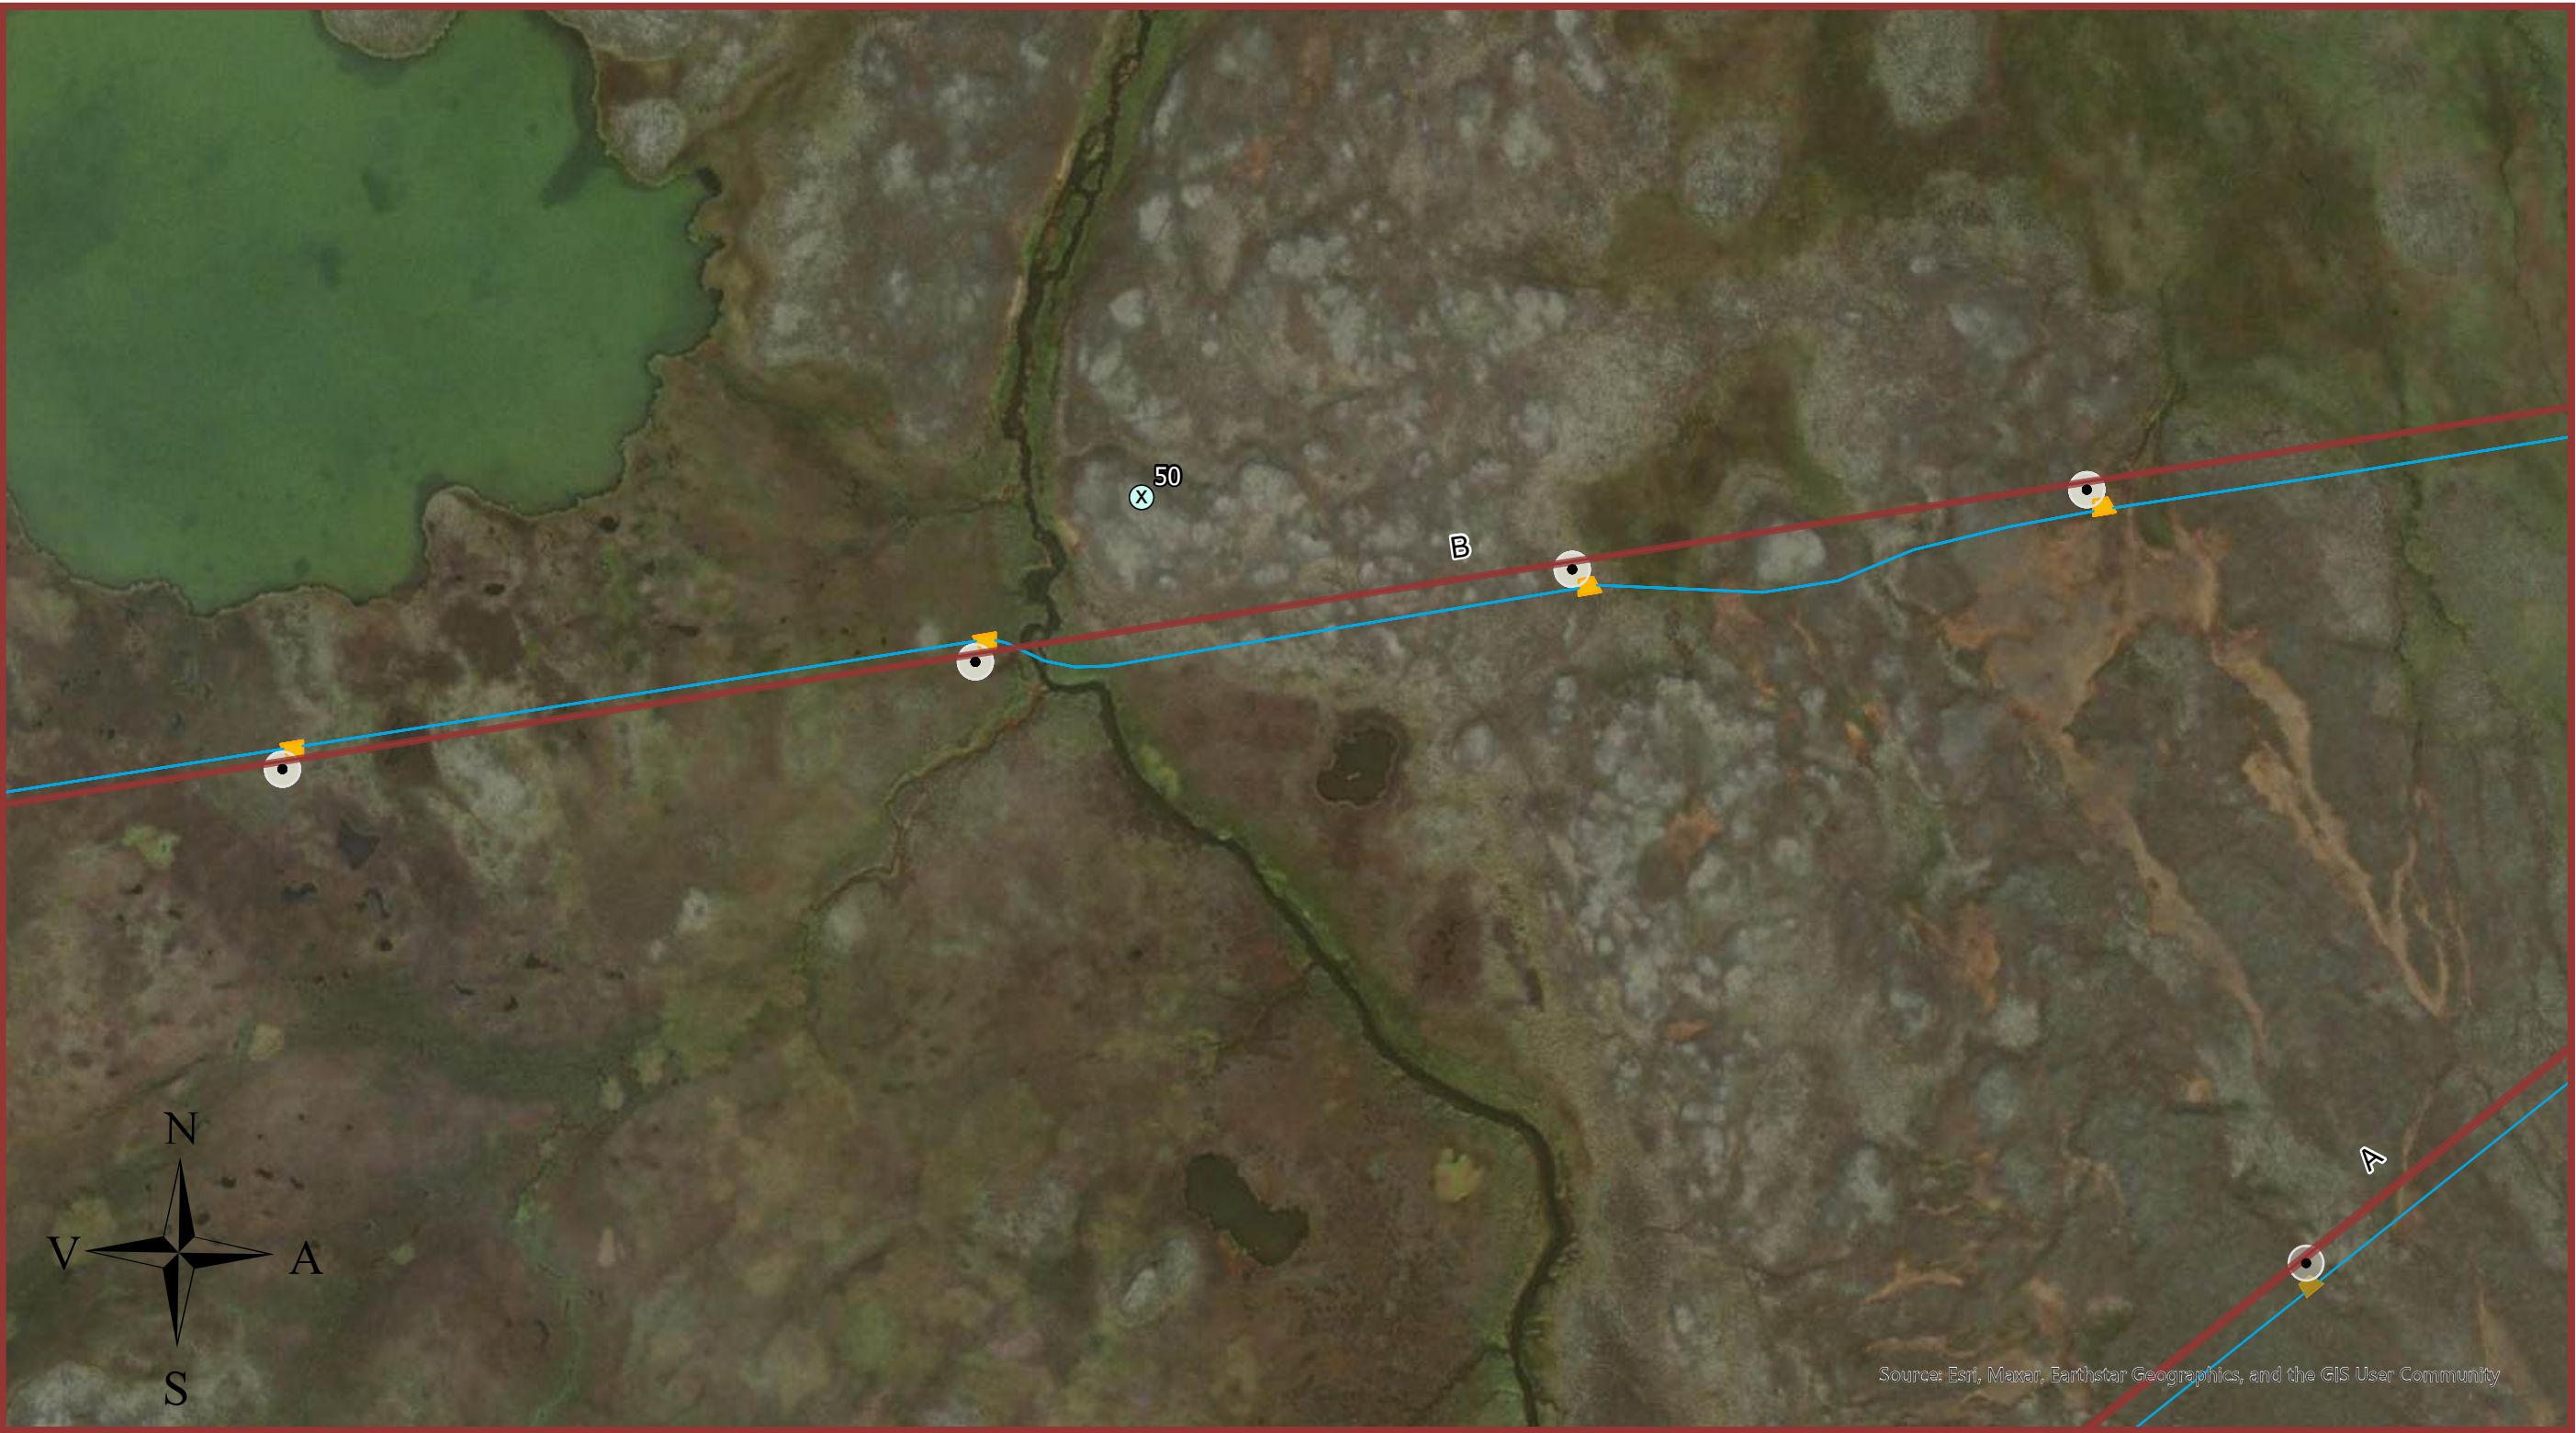


Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community


- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |

0 50 100 200 m
Mælikvarði: 1:4.000


Valkostur A og B



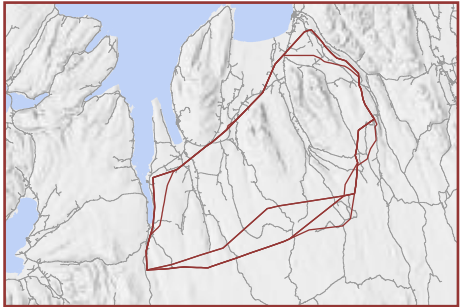


VSÓ RÁÐGJÖF

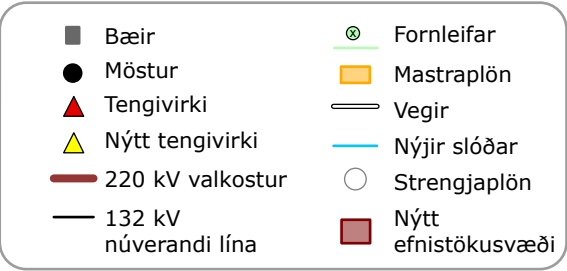


Valkostur B

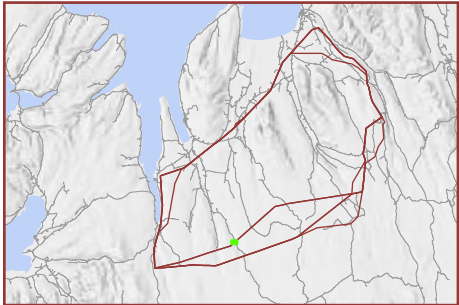

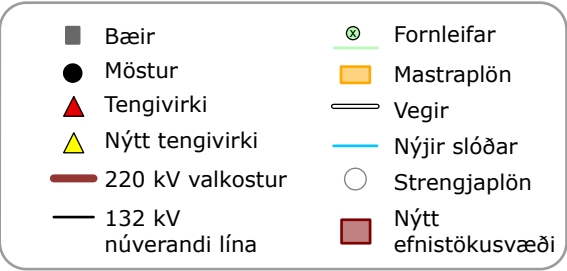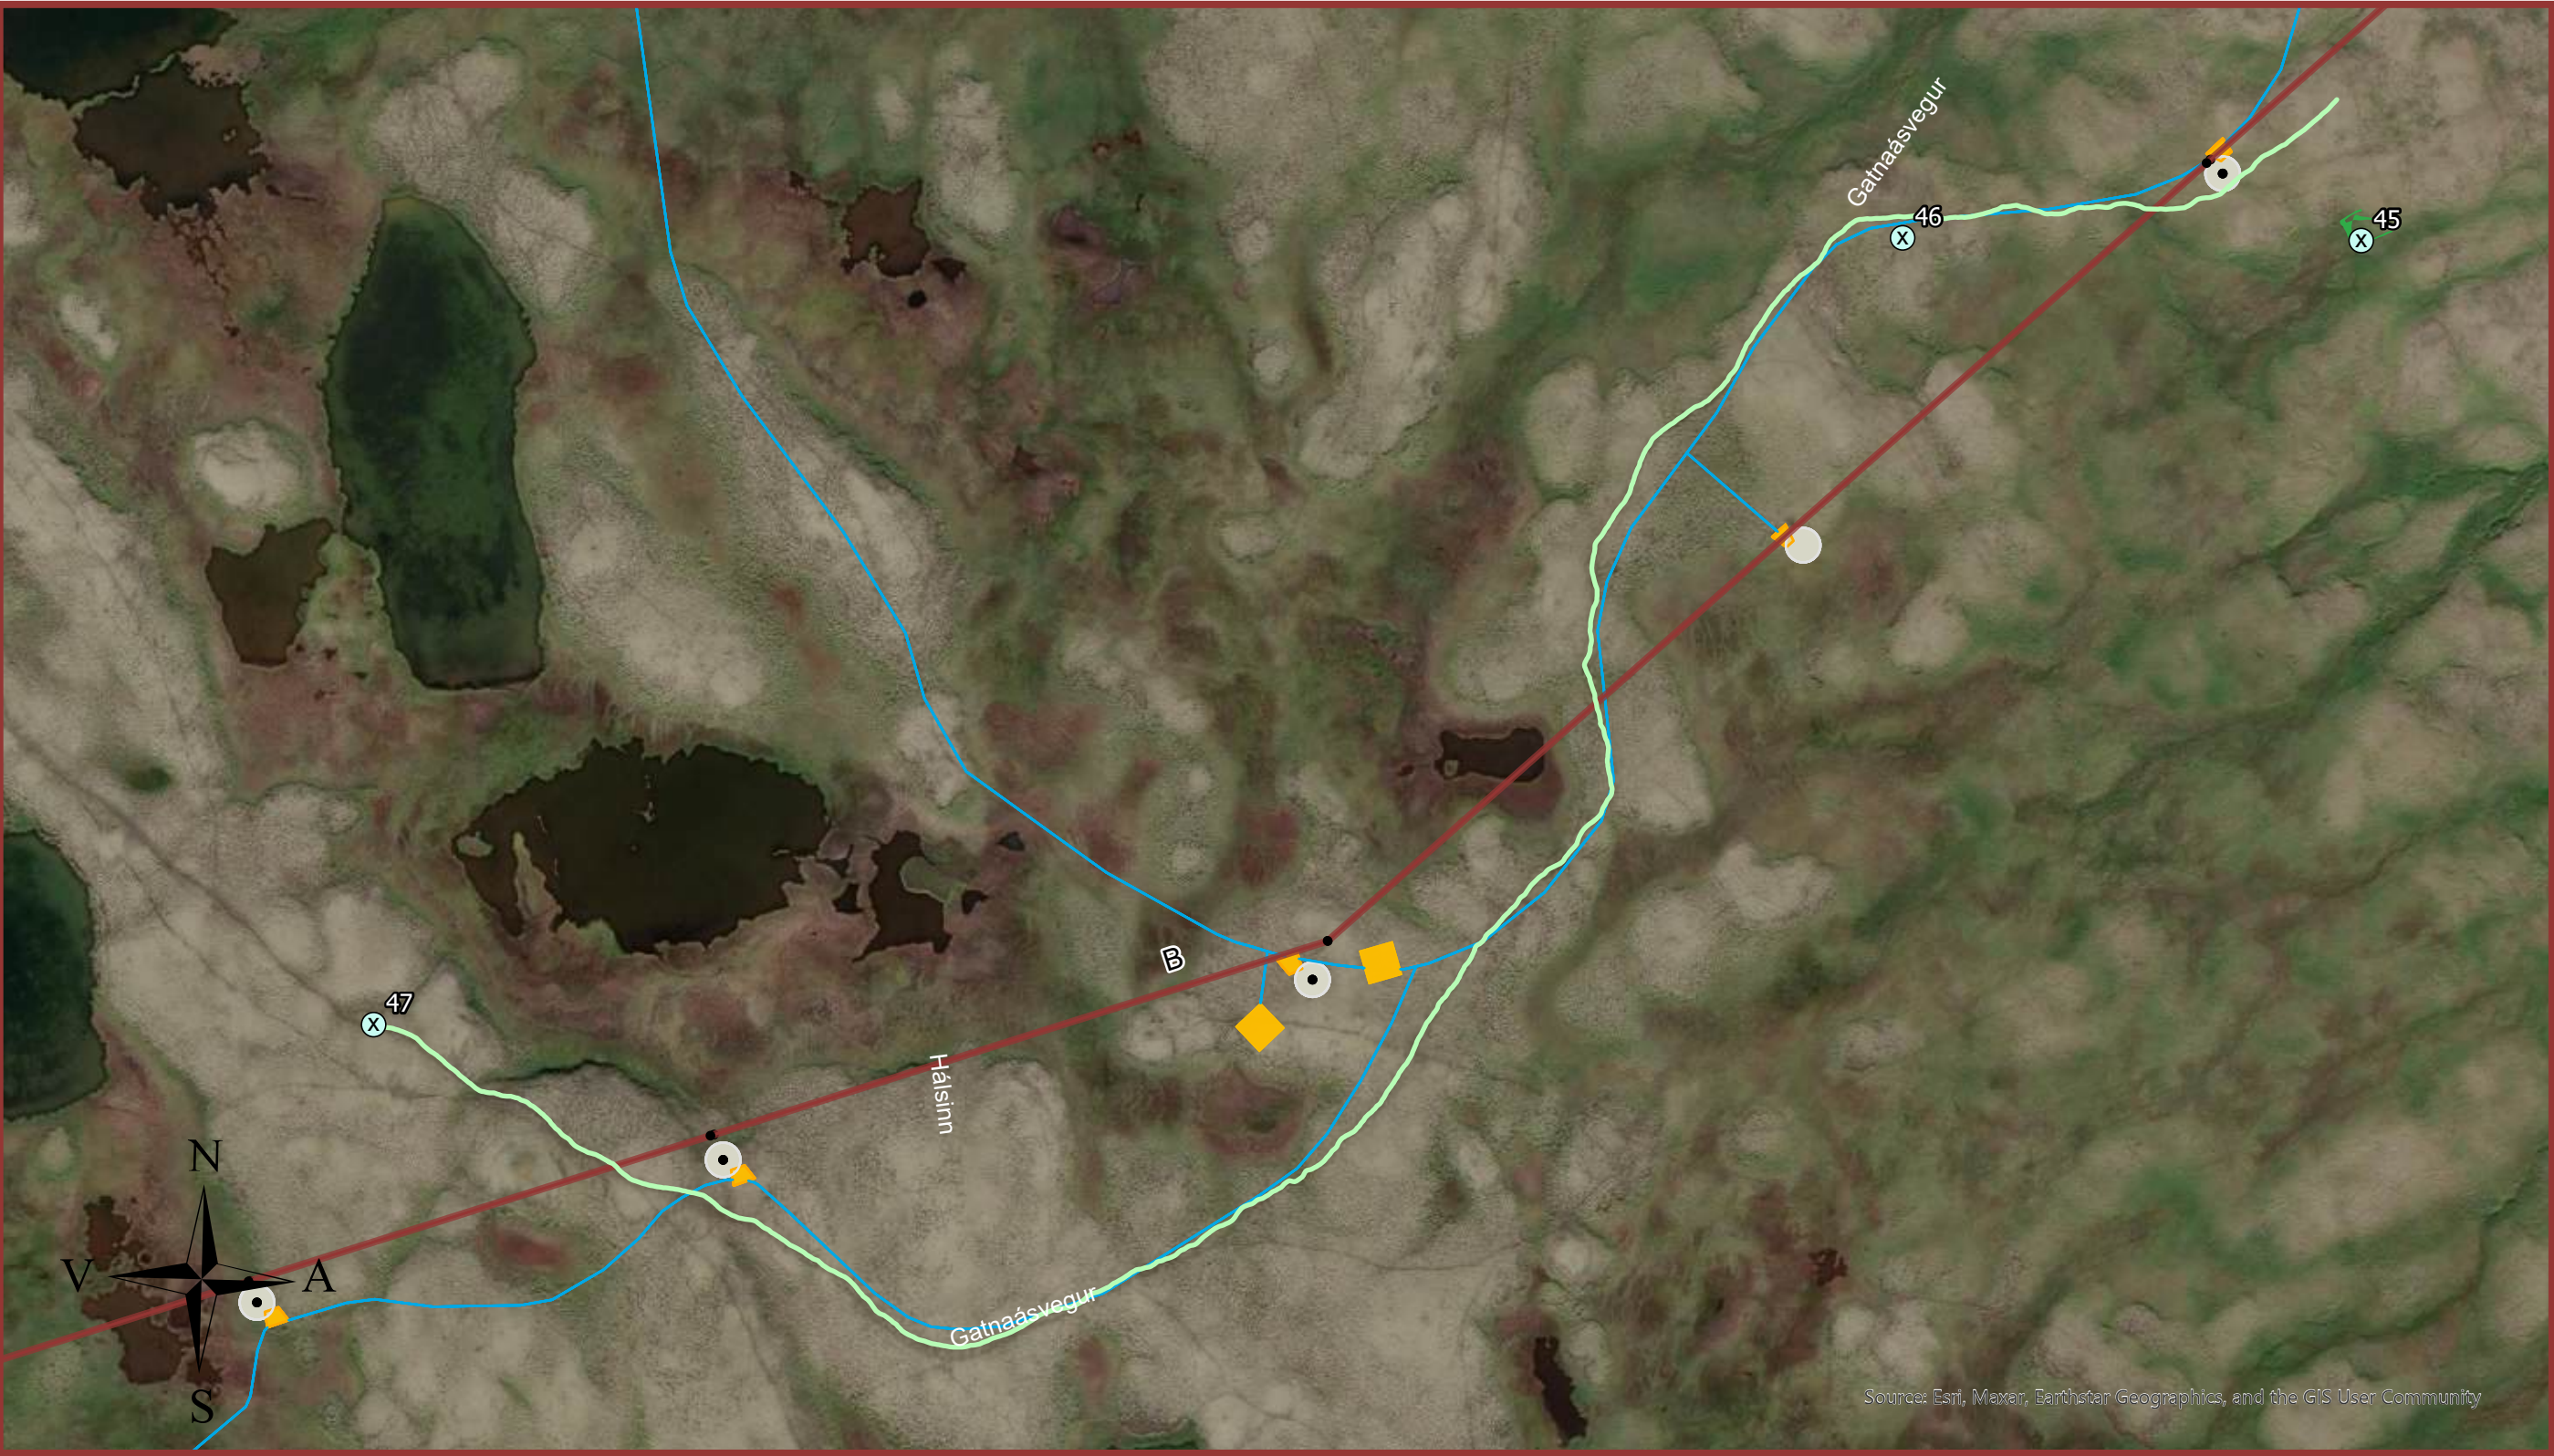


Valkostur B

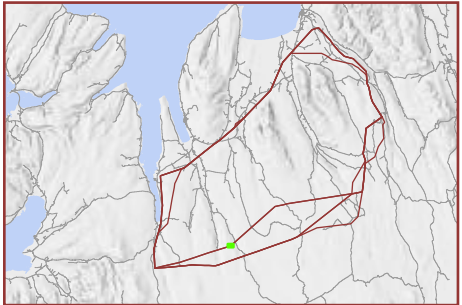







- Bæir
- Möstur
- ▲ Tengivirki
- ▲ Nýtt tengivirki
- 220 kV valkostur
- 132 kV núverandi lína
- ⊗ Fornleifar
- Mastraplön
- Vegir
- Nýtt slóðar
- Strengjaplön
- Nýtt efnistökusvæði

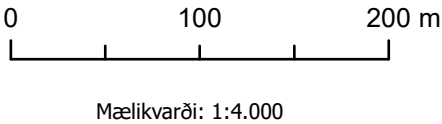



Valkostur B

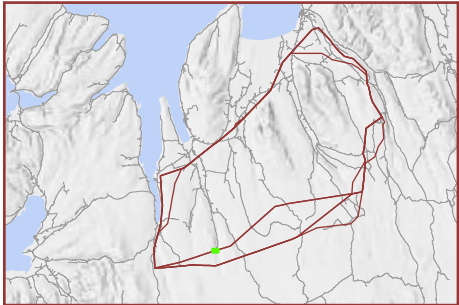

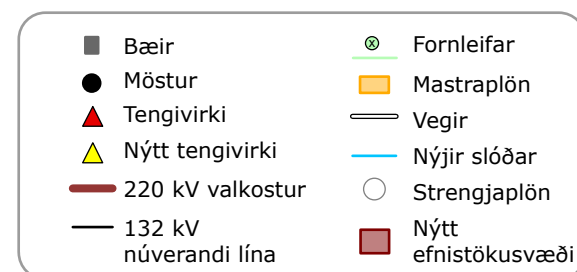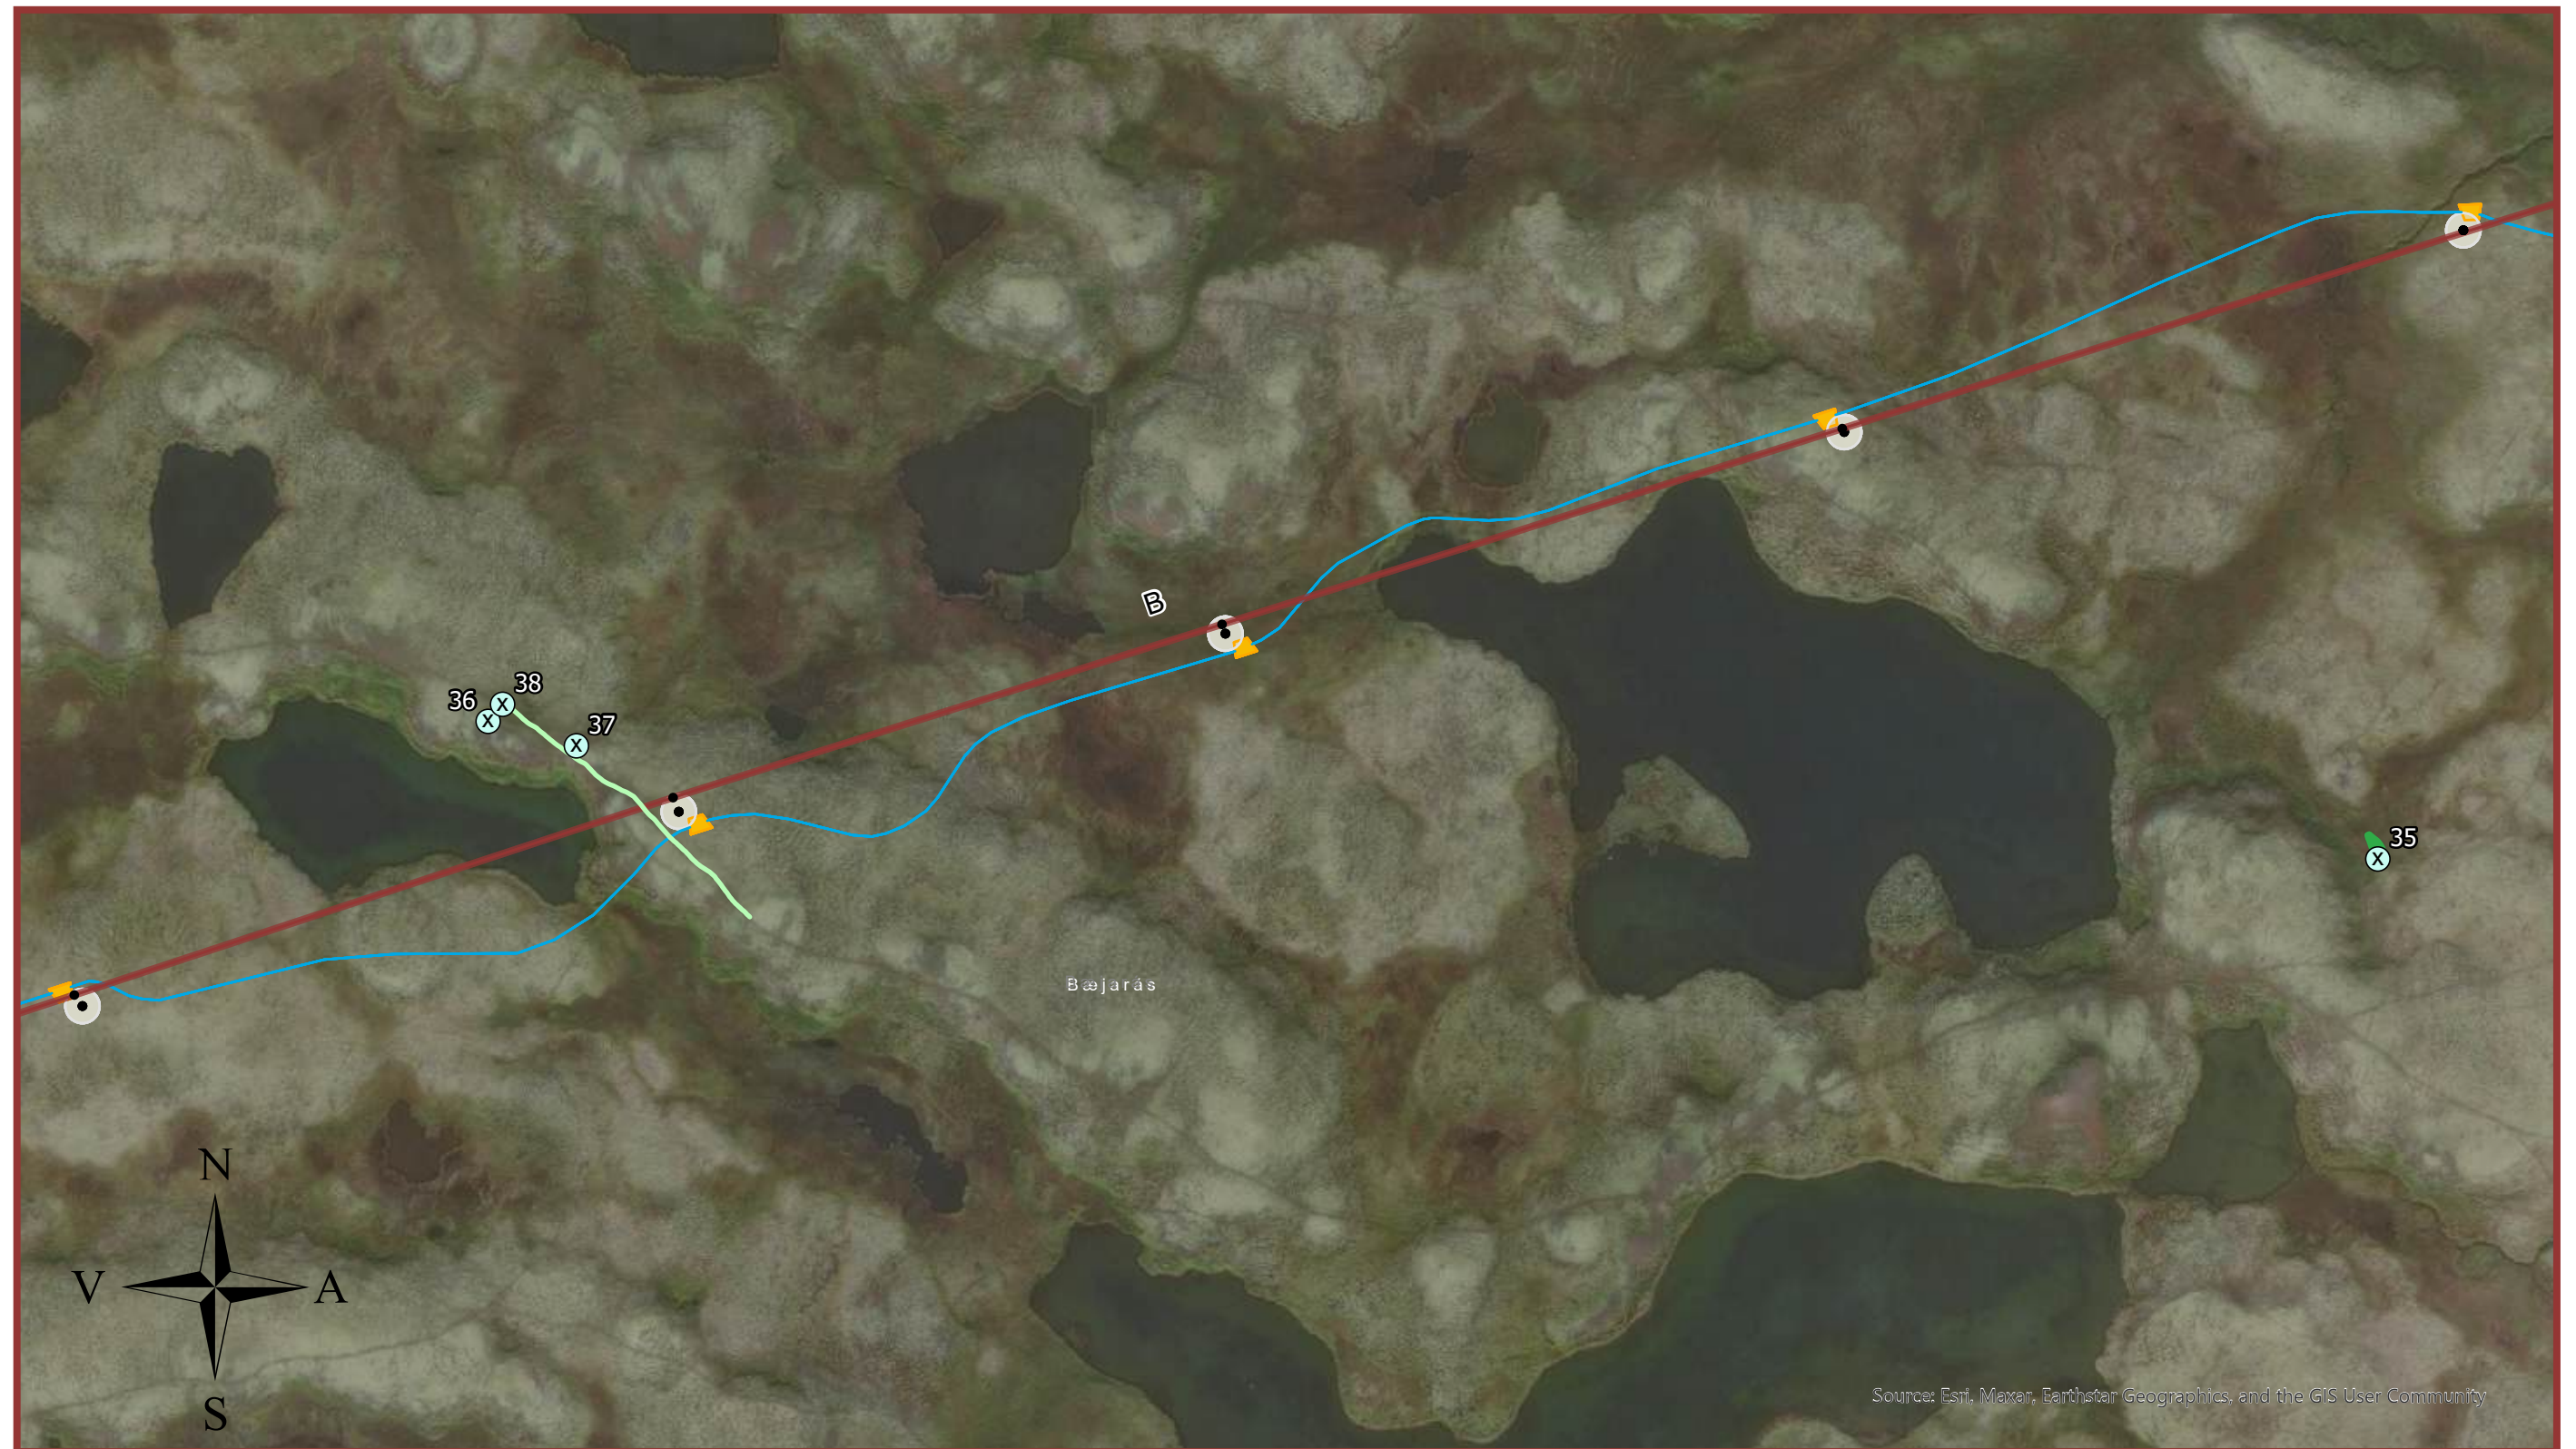


Valkostur B

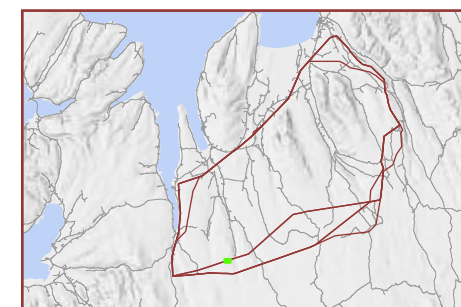



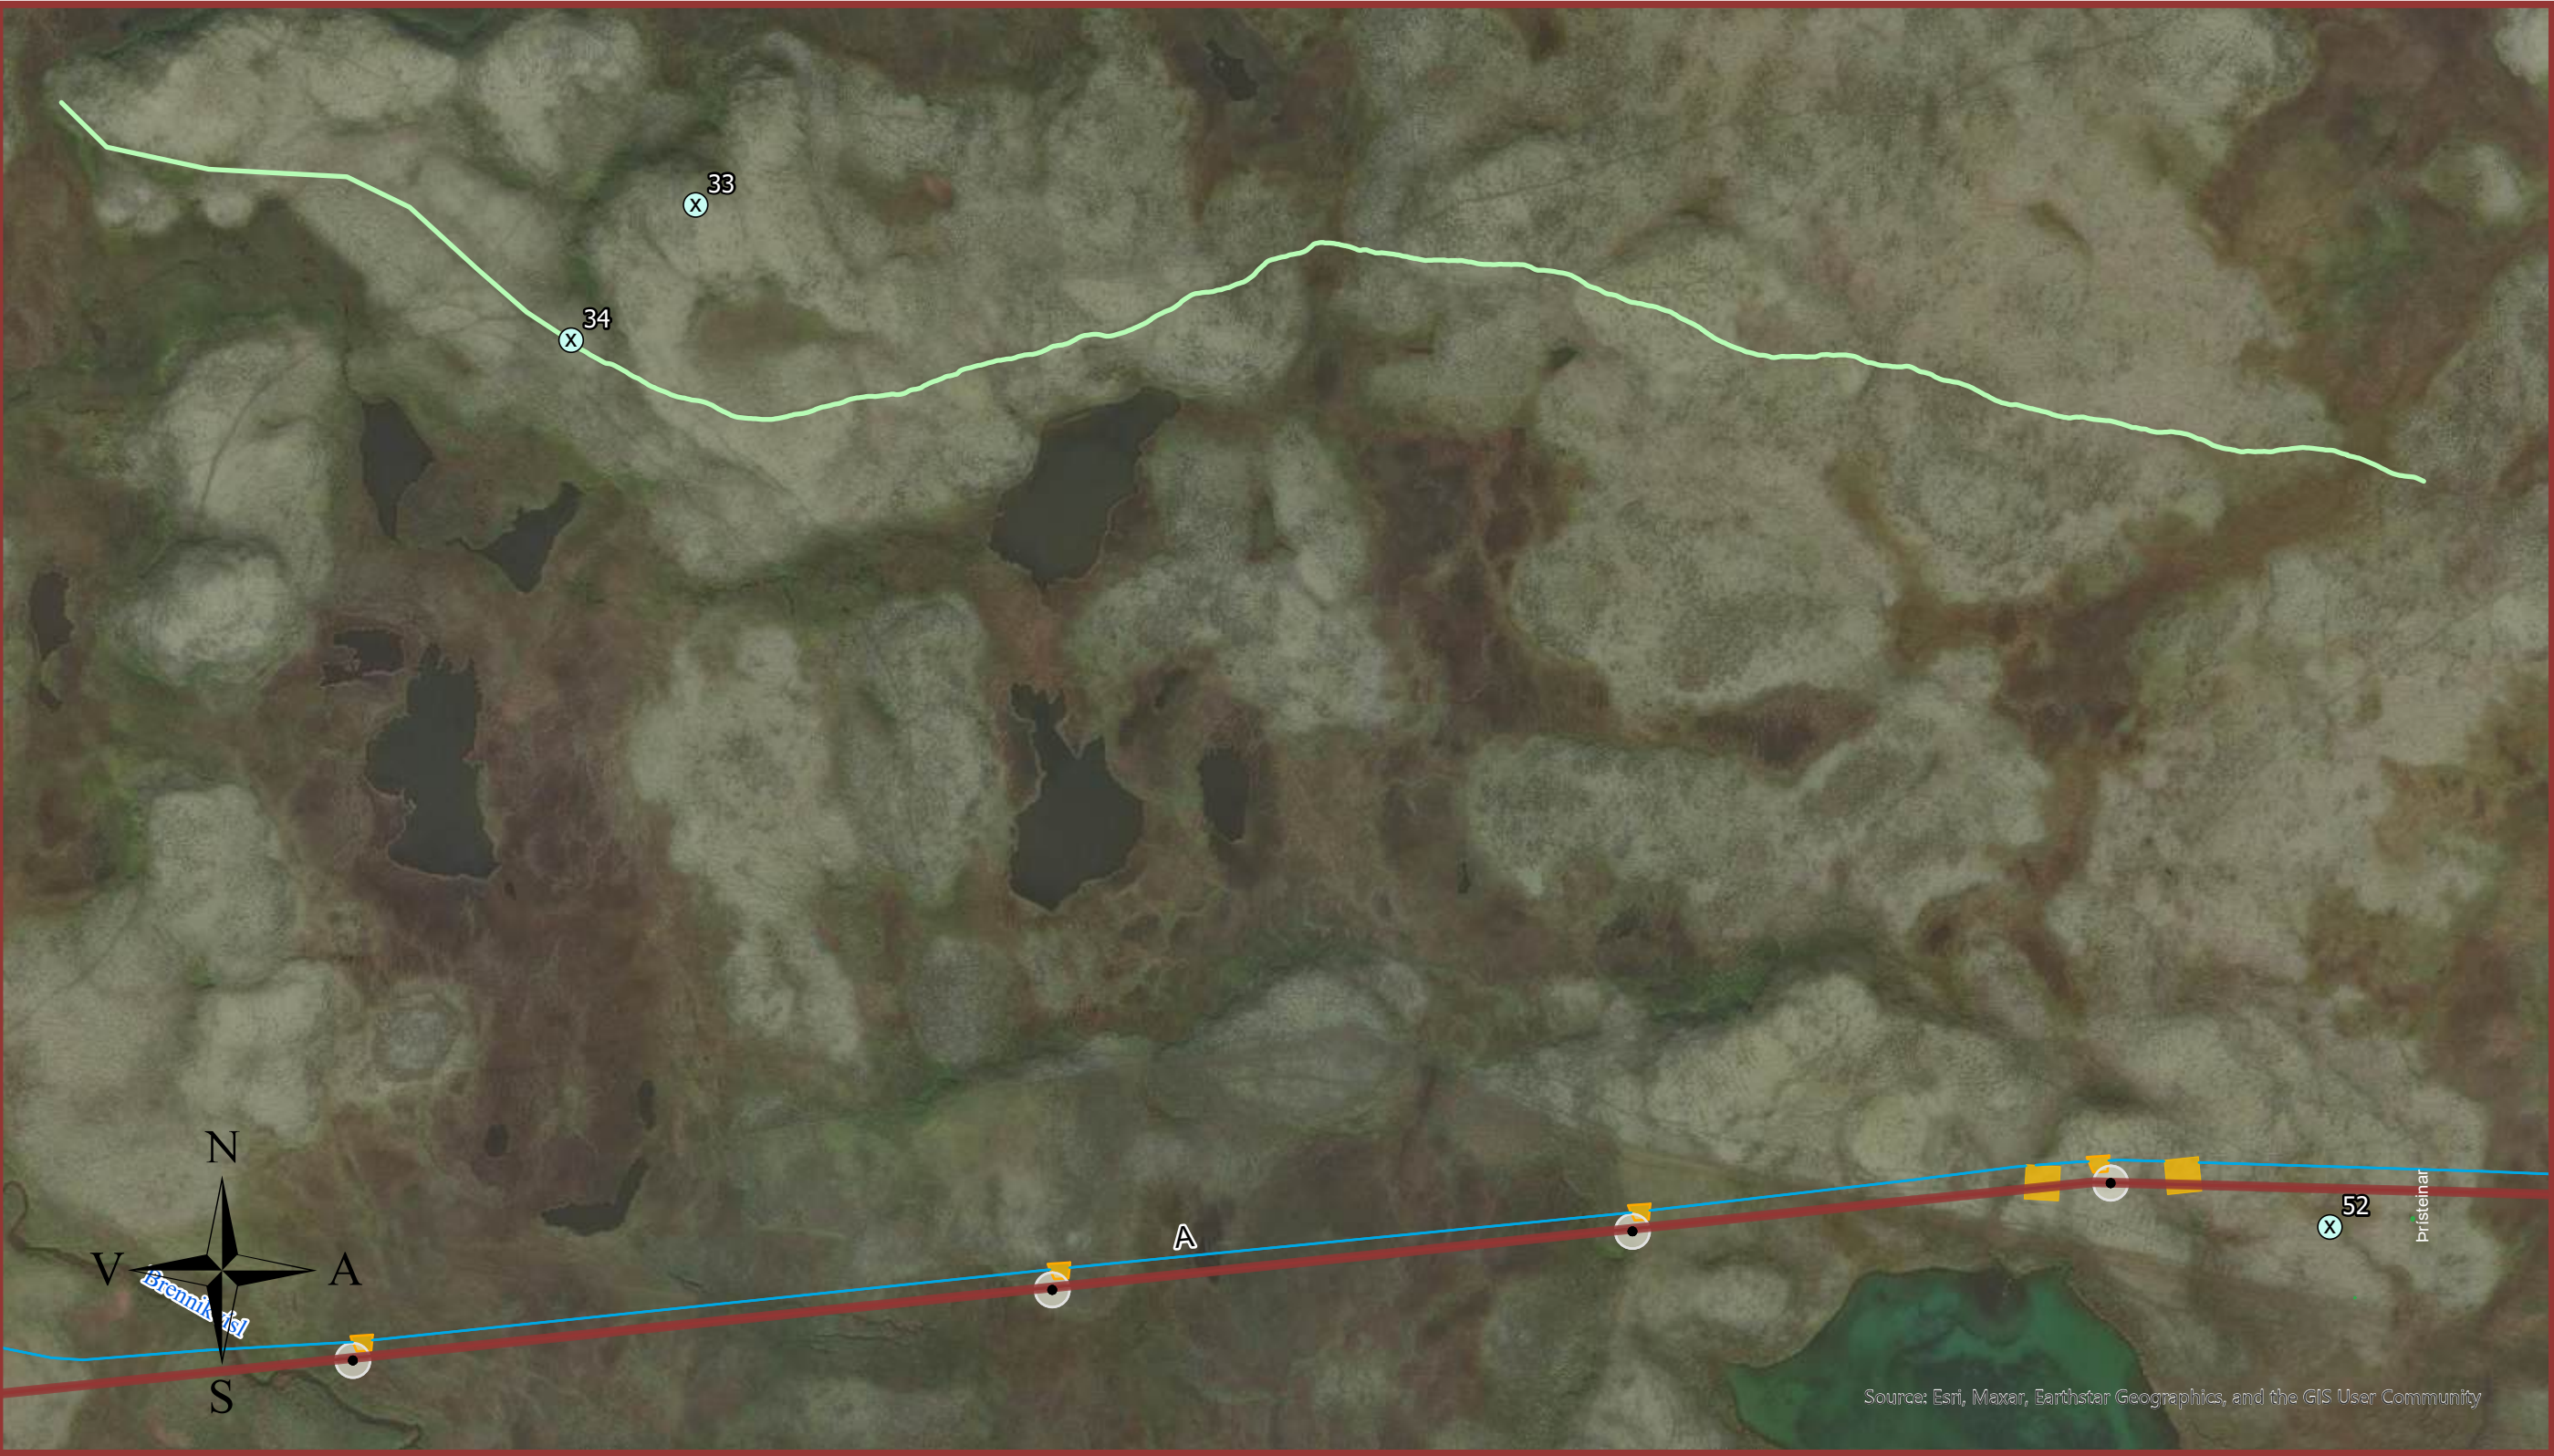


- | | |
|-------------------------|-----------------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | ■ Nýtt efnistökusvæði |






Valkostur A

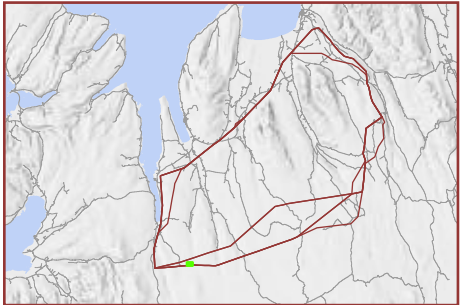

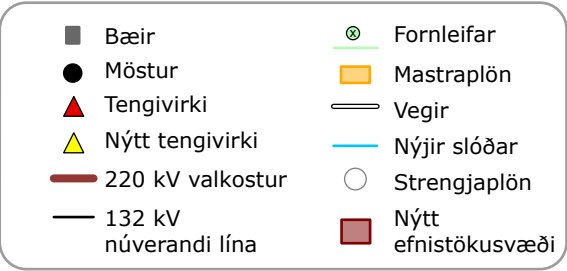


Valkostur B

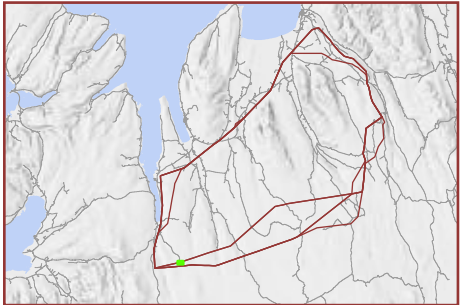

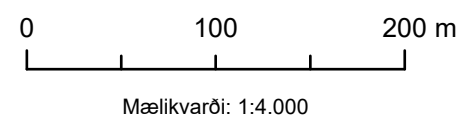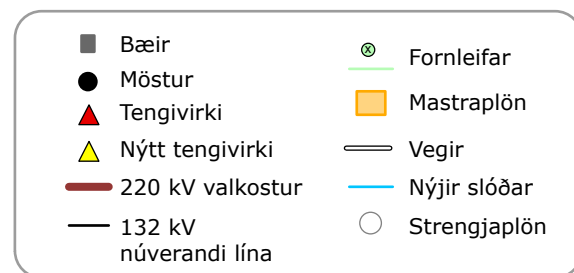

Valkostur D1 og D2

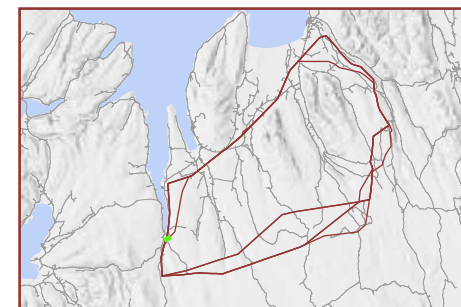







- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |


0 100 200 m
Mælikvarði: 1:4.000

Valkostur D2

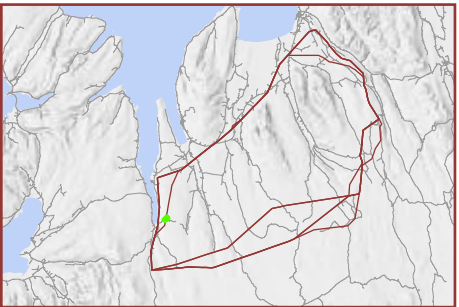

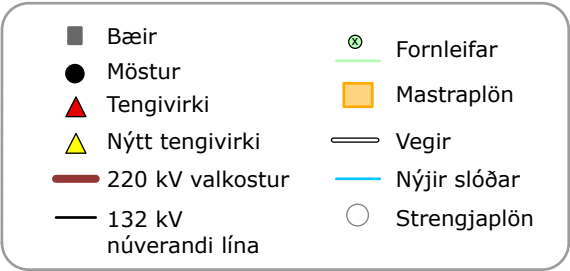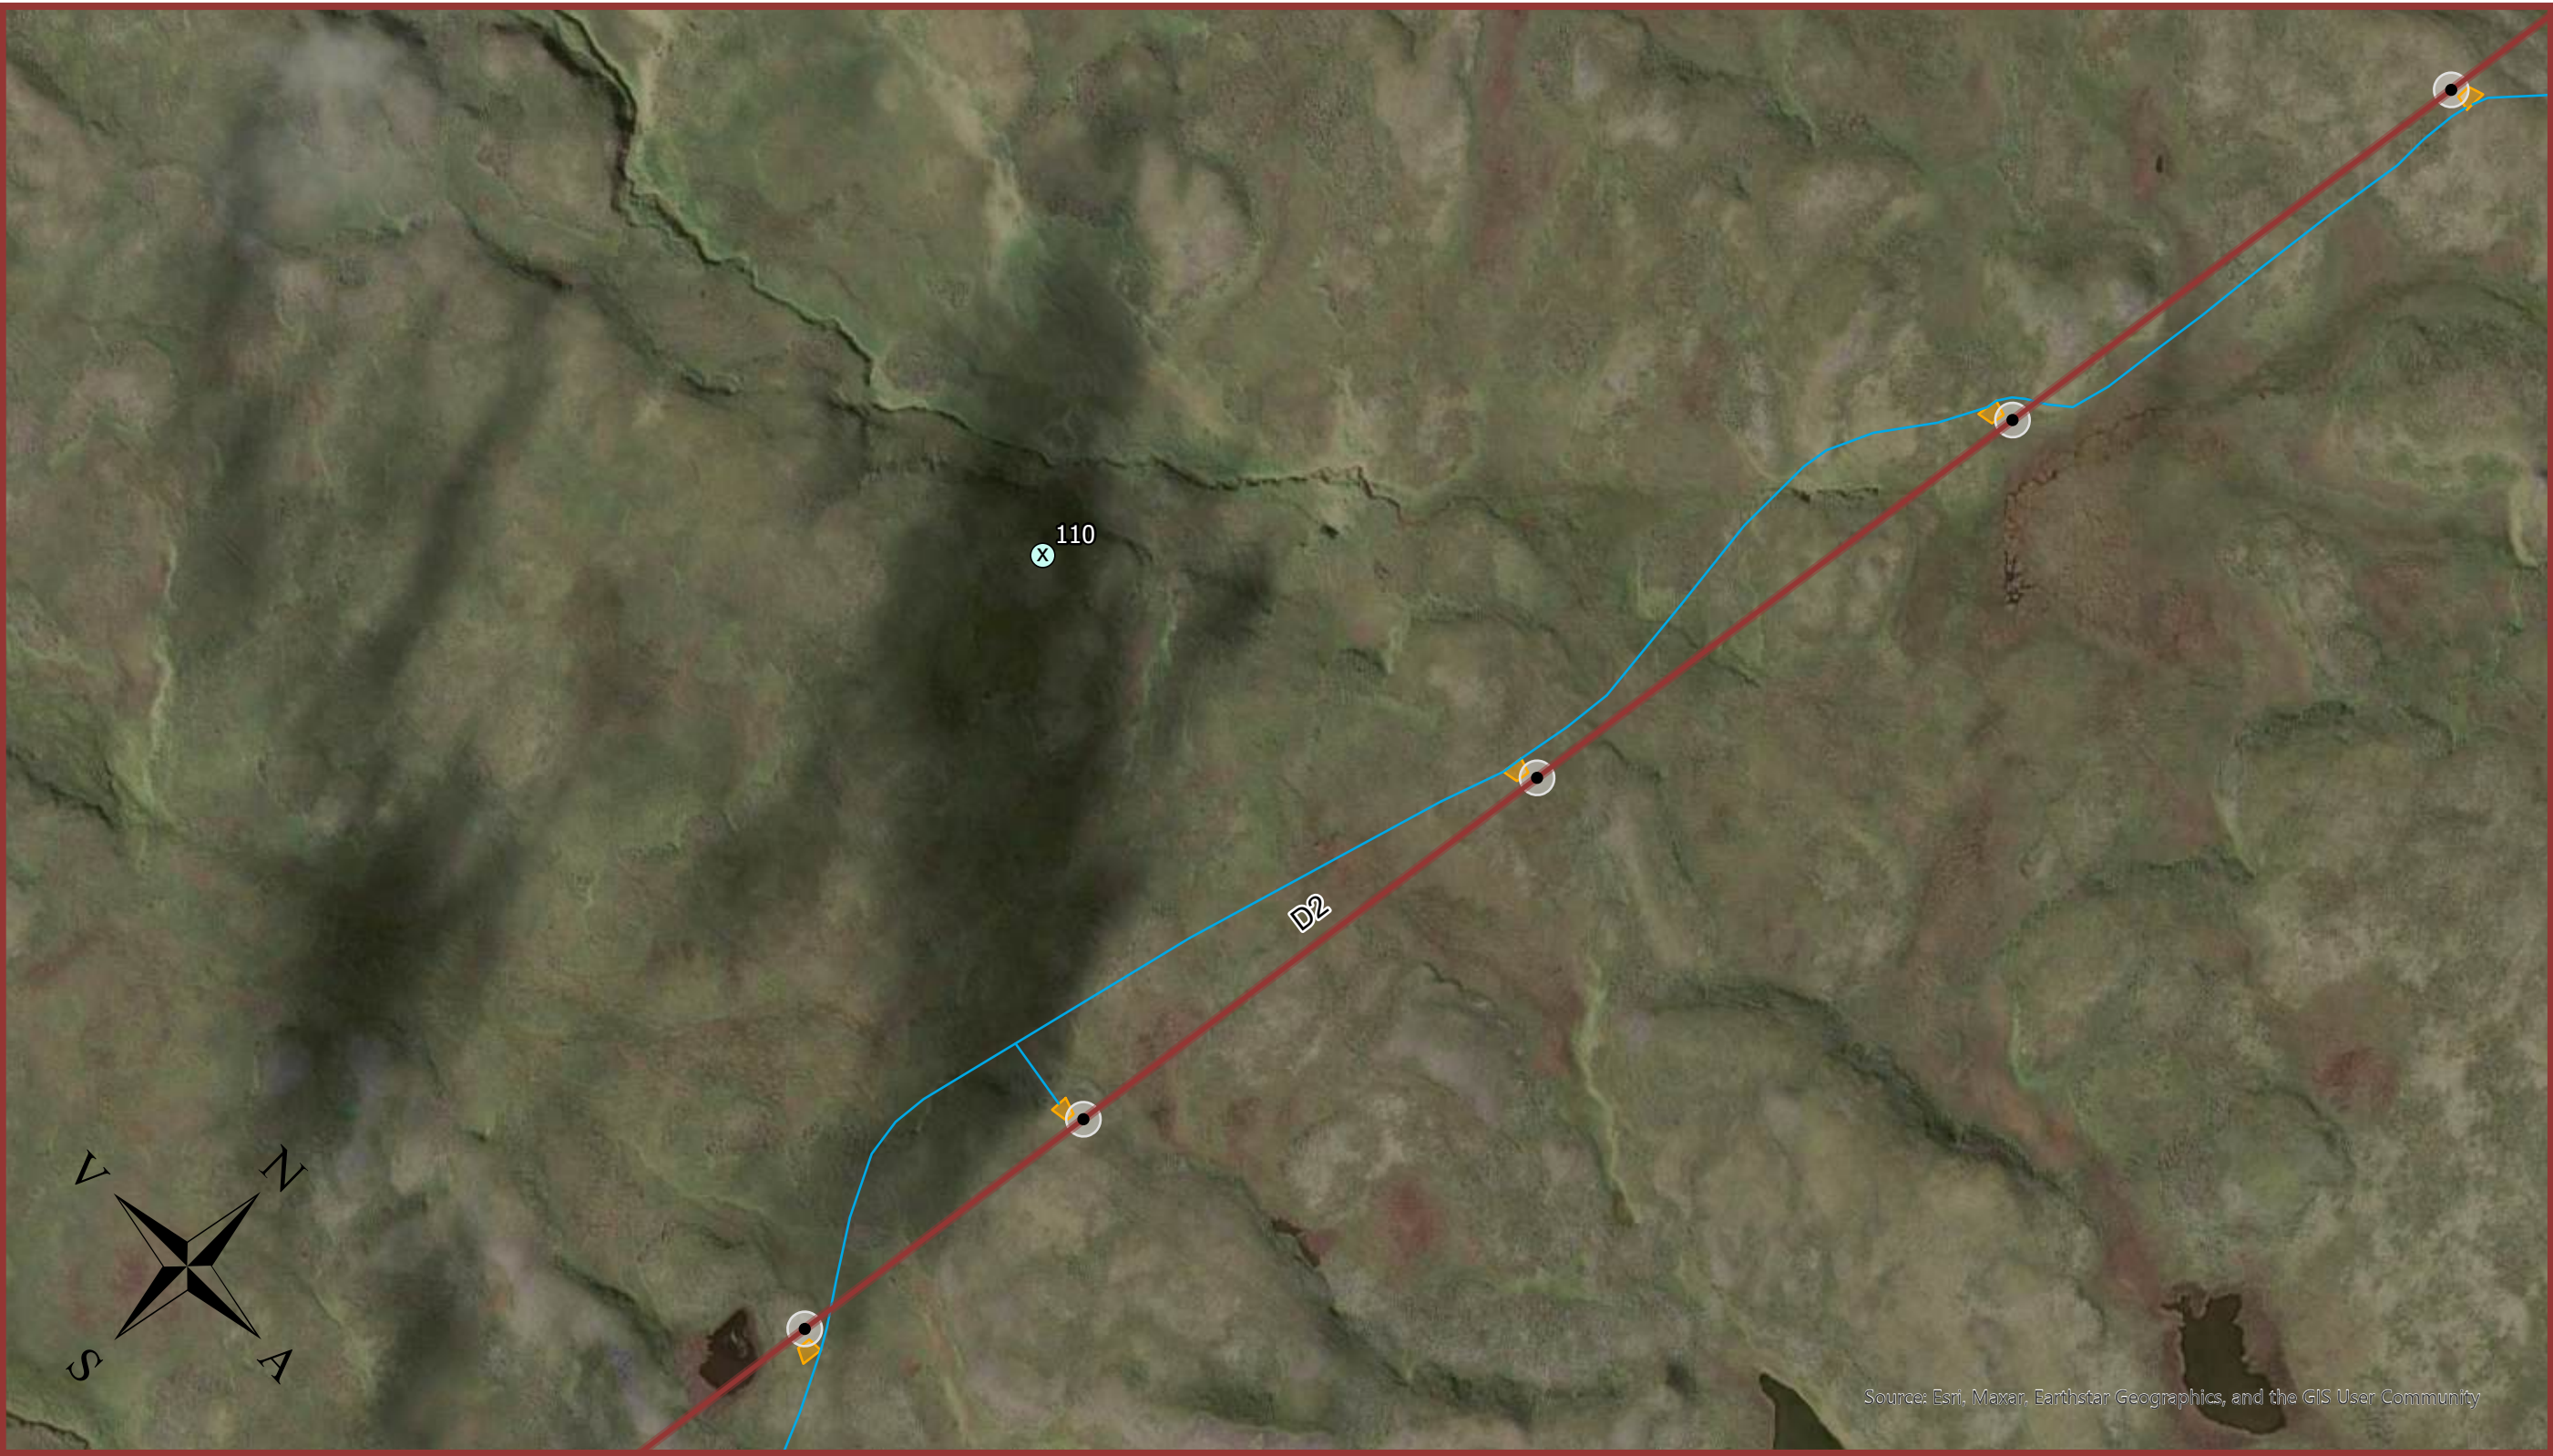


Valkostur D2

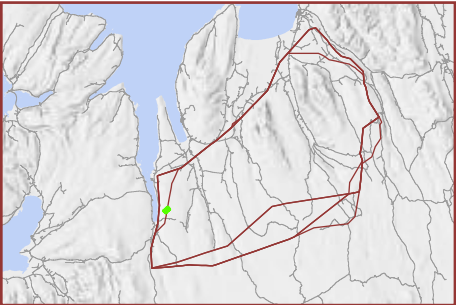




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊙ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |

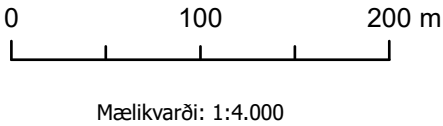

Valkostur D2

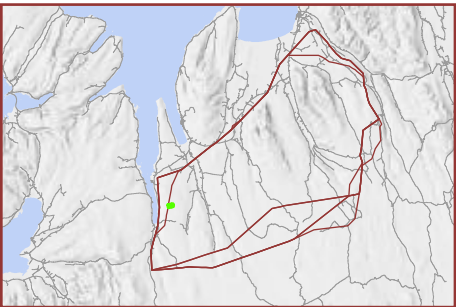




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |


0 100 200 m
Mælikvarði: 1:4.000

Valkostur D1 og D2

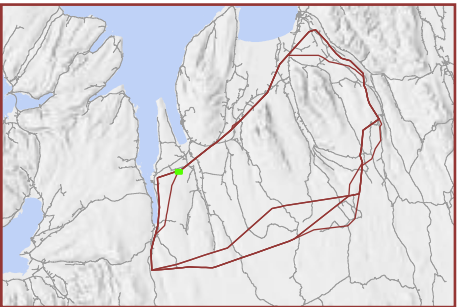




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |



Valkostur D

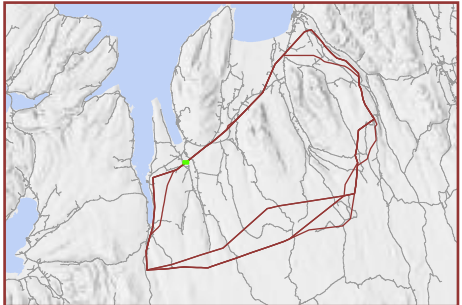




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊙ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |

0 100 200 m
Mælikvarði: 1:4.000

Valkostur D

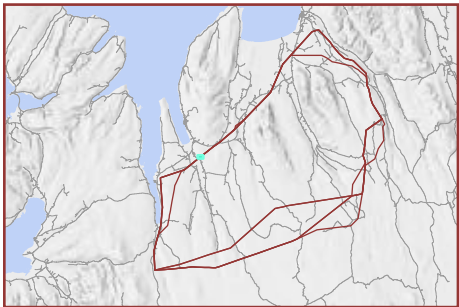

Holtavörðuheiðarlína 3

Kort 22



■ Bæir

● Möstur

▲ Tengivirki

▲ Nýtt tengivirki

— 220 kV valkostur

— 132 kV núverandi lína


⊙ Fornleifar

■ Mastraplön


— Vegir




— Nýjir slóðar

○ Strengjaplön

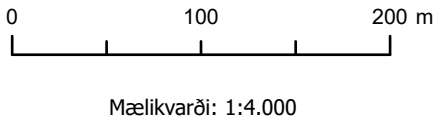




Valkostur D

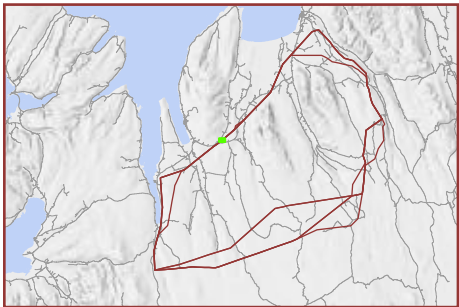

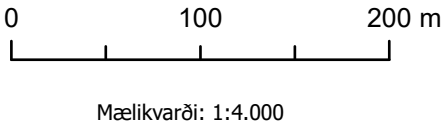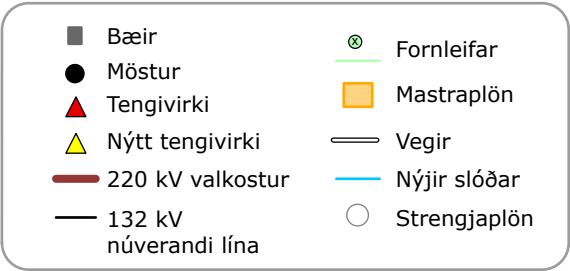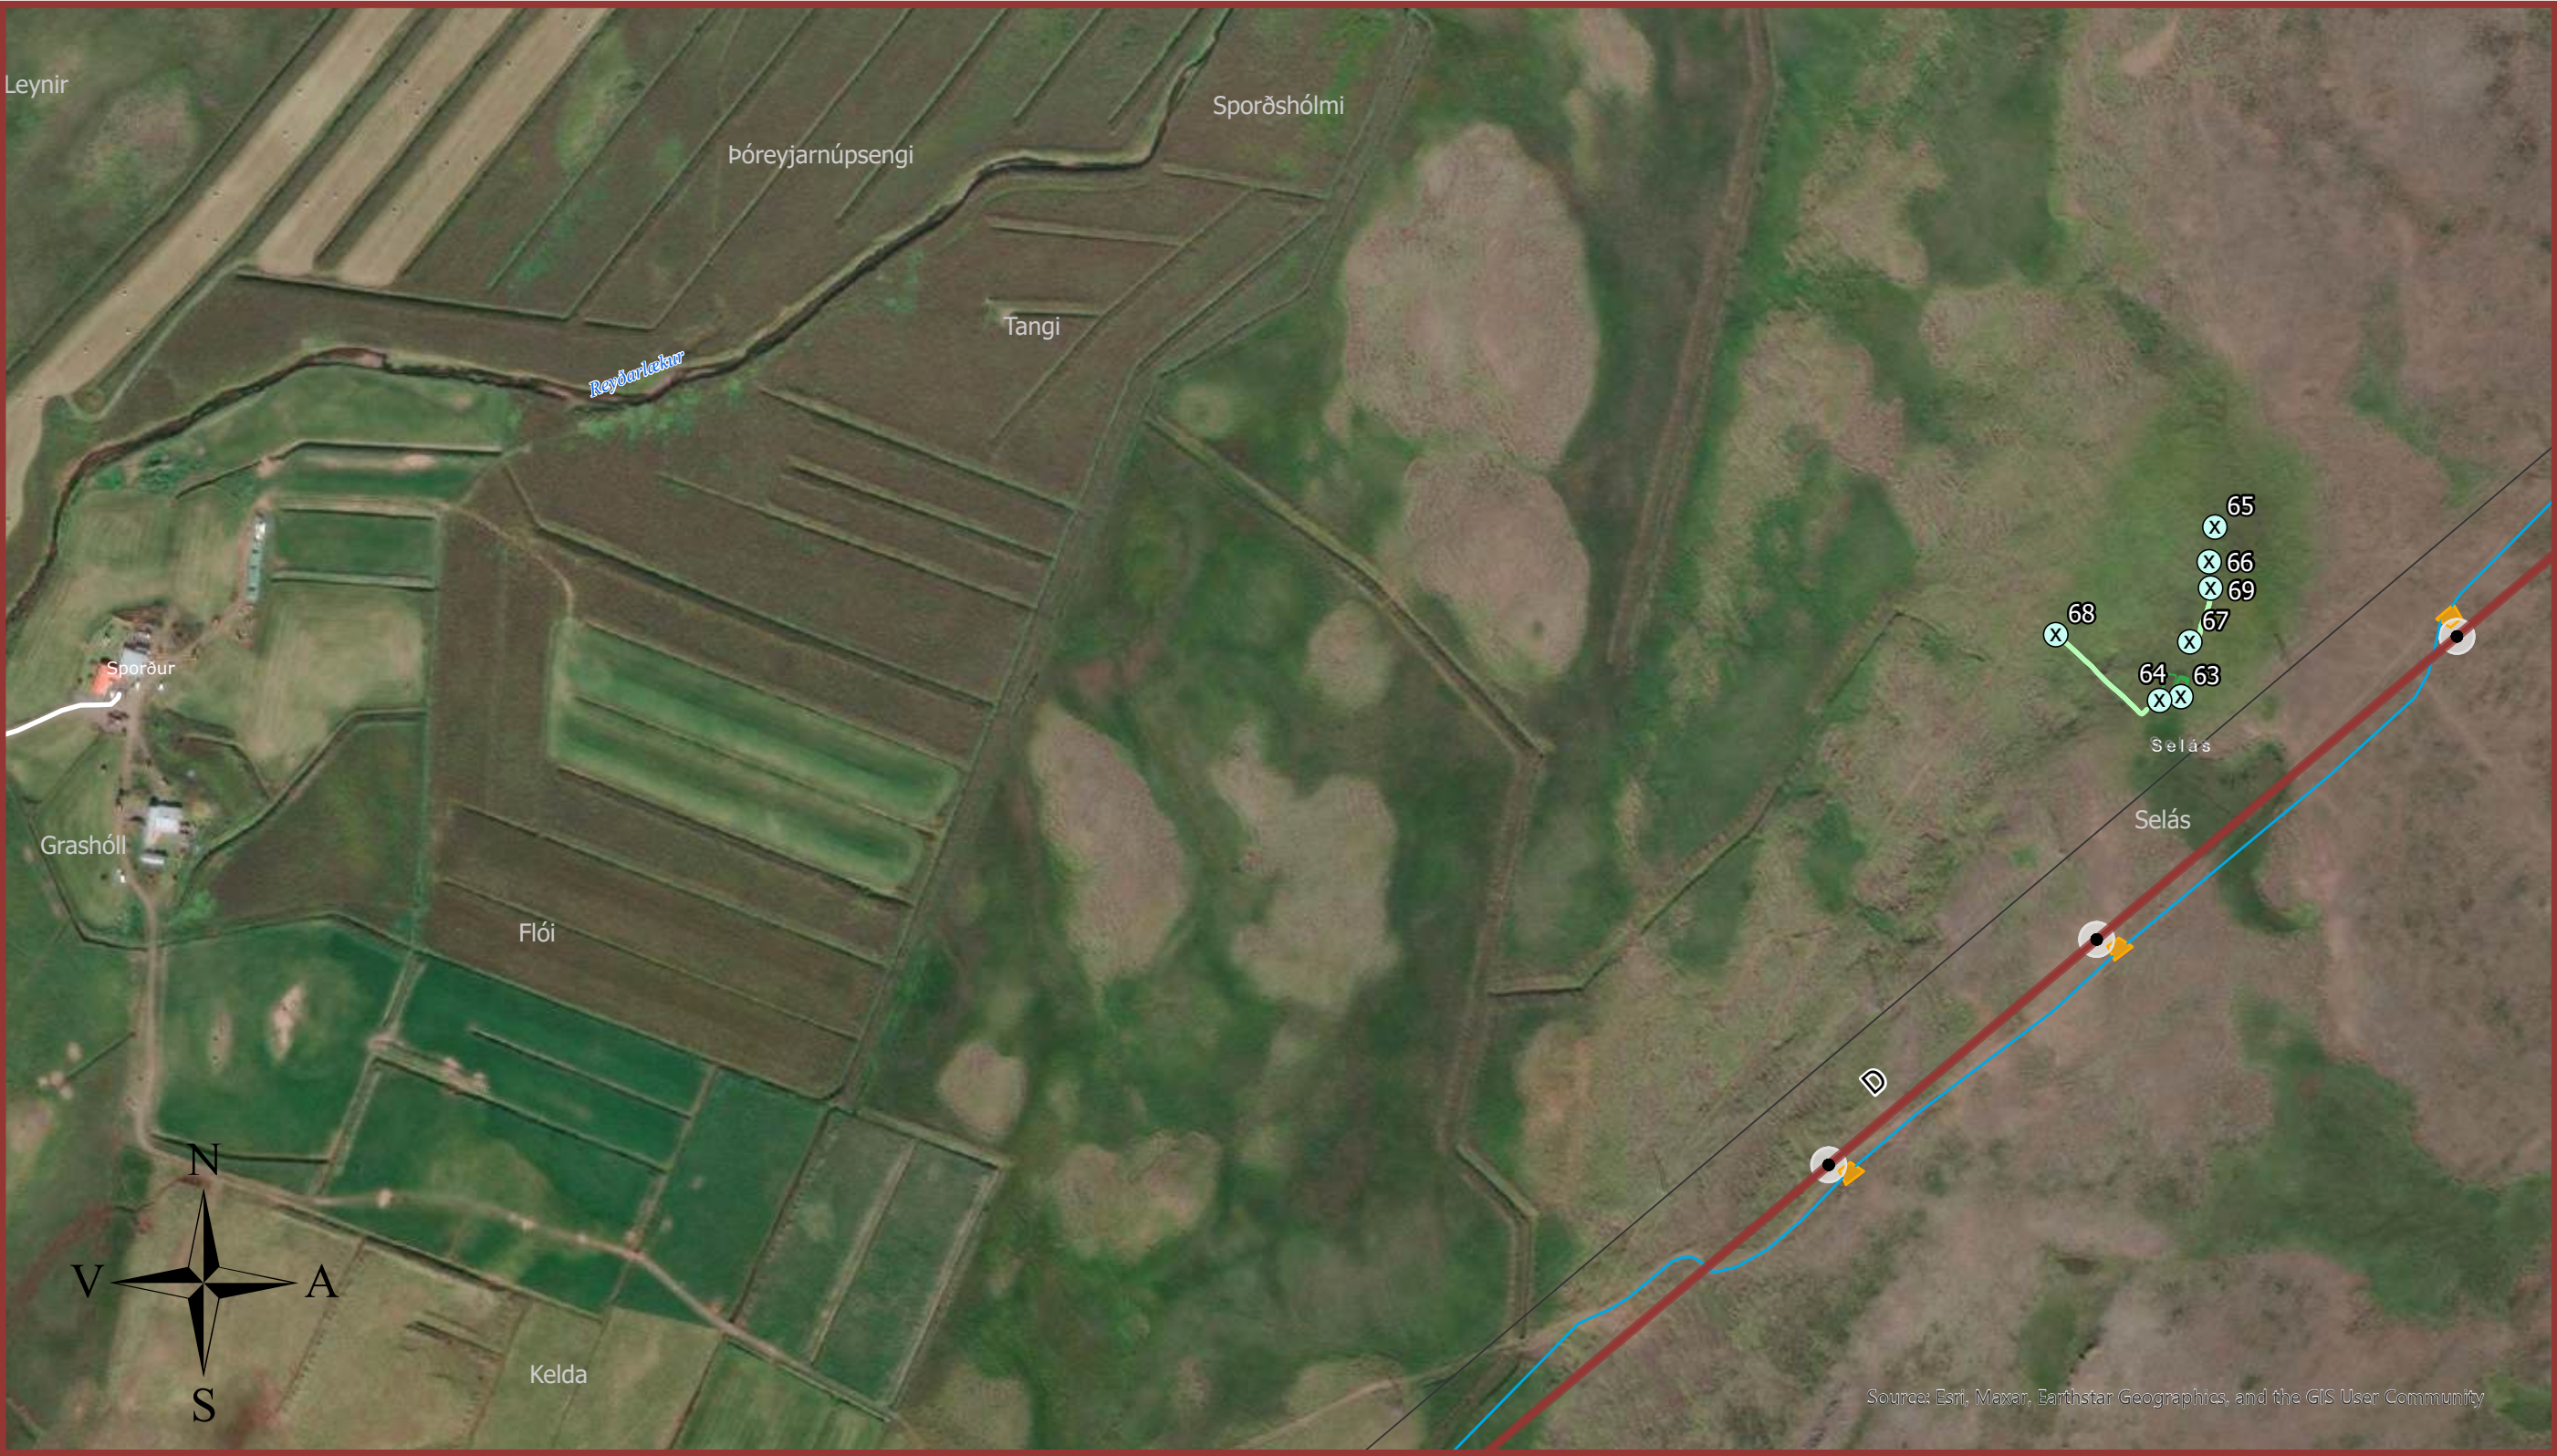


Valkostur D

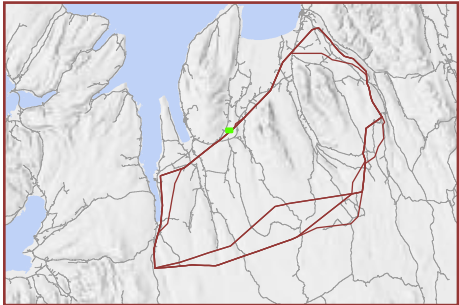

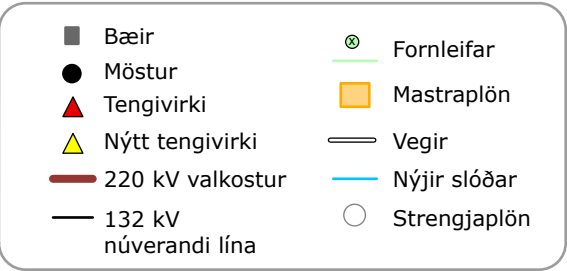

Valkostur D

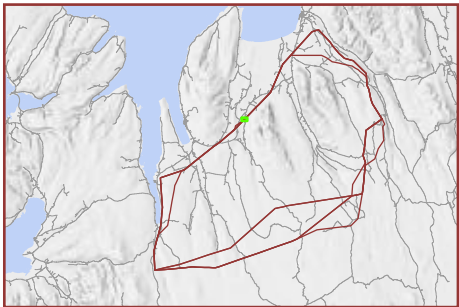




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |


0 100 200 m
Mælikvarði: 1:4.000

Valkostur D

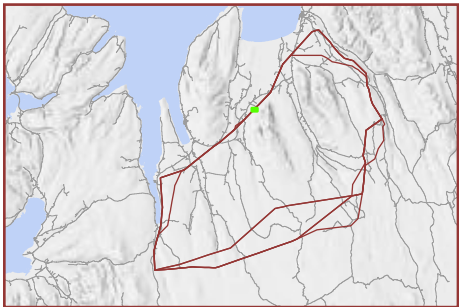






- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |




Valkostur D3

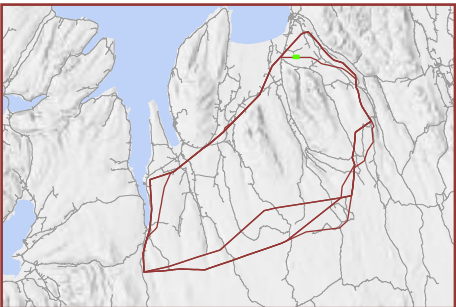

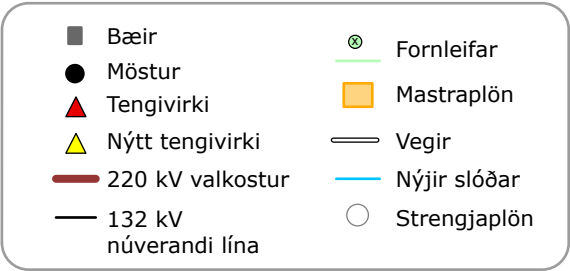

Valkostur D

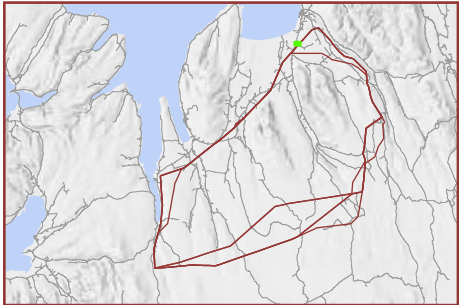




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |

0 100 200 m
Mælikvarði: 1:4.000

Valkostur D

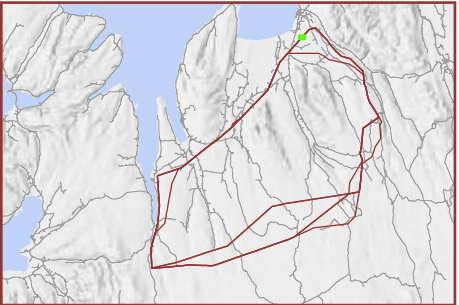




- Bæir
- Möstur
- ▲ Tengivirki
- ▲ Nýtt tengivirki
- 220 kV valkostur
- 132 kV núverandi lína
- Fornleifar
- Mastraplön
- Vegir
- Nýjir slóðar
- Strengjaplön

0 100 200 m
Mælikvarði: 1:4.000

Valkostur D

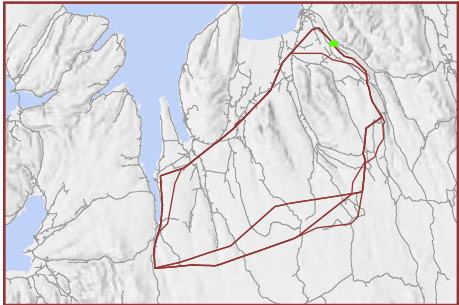




- | | |
|-------------------------|----------------|
| ■ Bæir | ⊗ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |

0 100 200 m
Mælikvarði: 1:4.000

Valkostur D3

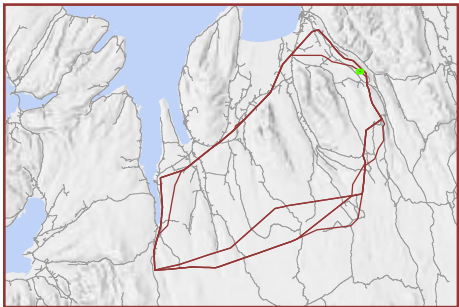




- Bæir
- Möstur
- ▲ Tengivirki
- ▲ Nýtt tengivirki
- 220 kV valkostur
- 132 kV núverandi lína
- ⊗ Fornleifar
- Mastraplön
- Vegir
- Nýjir slóðar
- Strengjaplön


0 100 200 m
Mælikvarði: 1:4.000

Valkostur D1 og D3

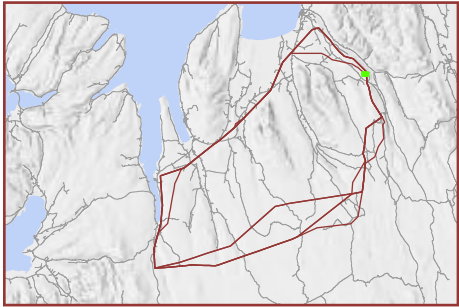



- | | |
|-------------------------|----------------|
| ■ Bæir | ⊙ Fornleifar |
| ● Möstur | ■ Mastraplön |
| ▲ Tengivirki | — Vegir |
| ▲ Nýtt tengivirki | — Nýjir slóðar |
| — 220 kV valkostur | ○ Strengjaplön |
| — 132 kV núverandi lína | |



Valkostur D

